# THE CHASE AT STONEY BROOK

## LOTS 1 - 20, PRESERVATION PARCEL 'A' AND NON-BUILDABLE PRESERVATION PARCELS 'B' THROUGH 'D'

## ROADS, STORMWATER MANAGEMENT AND STORM DRAIN CONSTRUCTION PLANS

### GENERAL NOTES

1.) THE PROJECT IS IN CONFORMANCE WITH THE LATEST HOWARD COUNTY STANDARDS UNLESS WAIVERS HAVE BEEN APPROVED.

2.) THE EXISTING TOPOGRAPHY SHOWN IS BASED ON FIELD SURVEY BY BENCHMARK ENGINEERING, INC. IN APRIL, 2003. AND SUPPLEMENTED WITH DIGITAL GIS TOPOGRAPHY PURCHASED FROM HOWARD COUNTY.

3.) THE COORDINATES SHOWN HEREON ARE BASED UPON THE HOWARD COUNTY GEODETIC CONTROL WHICH IS BASED UPON THE MARYLAND STATE PLANE COORDINATE SYSTEM. HOWARD COUNTY MONUMENT NOS. 07FB AND 07FA WERE USED FOR THIS PROJECT.

4.) WATER IS PRIVATE.

5.) SEWER IS PRIVATE.

6.) STORMWATER MANAGEMENT SHALL BE PROVIDED BY POCKET PONDS AND SHALLOW WETLANDS ON NON-BUILDABLE PRESERVATION PARCELS 'B' THRU 'D'. SWM FACILITIES ARE TO BE PRIVATELY OWNED AND MAINTAINED.

7.) EXISTING UTILITIES ARE BASED UPON FIELD SURVEY LOCATIONS.

8.) WETLAND DELINEATION PROVIDED BY WILDMAN ENVIRONMENTAL SERVICES DATED JANUARY, 2001 AND WAS APPROVED UNDER S-01-21.

9.) TRAFFIC STUDY WAS PREPARED BY LEE CUNNINGHAM & ASSOCIATES, INC. IN AUGUST, 2000 AND REVISED IN JANUARY, 2001 AND WAS APPROVED UNDER S-01-21.

10.) A NOISE STUDY PREPARED BY BENCHMARK ENGINEERING, INC. IN AUGUST 2001 AND WAS APPROVED UNDER S-01-21.

11.) THE GEOTECHNICAL REPORT FOR THIS PROJECT WAS PREPARED BY HILLIS CARNES ENGINEERING ASSOCIATES, INC. DATED JULY 7, 2003.

12.) THE SUBJECT PROPERTY IS ZONED RC-DEO PER THE 2-2-04 COMPREHENSIVE ZONING PLAN. ALL ADJACENT PROPERTIES ARE ZONED RC-DEO PER THE 2-2-04 COMPREHENSIVE ZONING PLAN.

13.) TO THE BEST OF OUR KNOWLEDGE, THERE ARE NO BURIAL GROUNDS OR CEMETERIES LOCATED ON THIS SITE.

14.) THERE SHALL BE NO DISTURBANCE WITHIN THE 100-YR FLOODPLAIN, WETLANDS, STREAMS, THEIR BUFFERS OR STEEP SLOPES THAT ARE AT LEAST 20,000 S.F. UNLESS APPROVED BY THE DEPARTMENT OF PLANNING AND ZONING.

15.) BOUNDARY IS BASED ON A FIELD RUN MONUMENTED BOUNDARY SURVEY PERFORMED BY BENCHMARK ENGINEERING, INC., DATED APRIL, 2003.

16.) THIS PROJECT IS NOT LOCATED WITHIN THE METROPOLITAN DISTRICT.

17.) THIS PLAN IS SUBJECT TO COMPLIANCE WITH THE SECOND AMENDMENT OF THE FOURTH EDITION OF THE SUBDIVISION AND LAND DEVELOPMENT REGULATIONS AS A CONSEQUENCE FOR ITS SUBMISSION PRIOR TO 11-15-2001. THIS PROJECT IS SUBJECT TO COMPLIANCE WITH THE 1993 ZONING REGULATIONS EFFECT PRIOR TO COUNCIL BILL 50-2001 BECAUSE THE PLAN HAS GIVEN TECHNICALLY COMPLETE APPROVAL PRIOR TO 11/1/01, IN ACCORDANCE WITH COUNCIL BILL 50-2003.

18.) [hatched symbol] THIS AREA DESIGNATES A PRIVATE SEWERAGE EASEMENT OF 10,000 SQUARE FEET AS REQUIRED BY THE STATE DEPARTMENT OF THE ENVIRONMENT FOR INDIVIDUAL SEWERAGE DISPOSAL. IMPROVEMENTS OF ANY NATURE IN THIS AREA IS RESTRICTED UNTIL PUBLIC SEWER IS AVAILABLE. THIS EASEMENT SHALL BECOME NULL AND VOID UPON CONNECTION TO A PUBLIC SEWERAGE SYSTEM. THE COUNTY HEALTH OFFICER SHALL HAVE THE AUTHORITY TO GRANT ADJUSTMENTS TO THE PRIVATE SEWERAGE EASEMENT. RECORDATION OF A MODIFIED SEWERAGE EASEMENT PLAT SHALL NOT BE NECESSARY.

19.) THE PURPOSE OF THE PRESERVATION PARCELS AND THE JUSTIFICATION FOR THE DESIGN OF THE CLUSTER SUBDIVISION IS AS FOLLOWS:

PRESERVATION PARCEL 'A' IS PROPOSED AS A BUILDABLE PARCEL TO ALLOW FOR 1 DWELLING UNIT. IT WILL BE A PART OF THE HOWARD COUNTY AGRICULTURAL LAND PRESERVATION PROGRAM BY PLACEMENT IN A HOWARD COUNTY AGRICULTURAL LAND PRESERVATION EASEMENT. IT WILL BE PRIVATELY OWNED WITH HOWARD COUNTY AGRICULTURAL LAND PRESERVATION PROGRAM AS THE EASEMENT HOLDER. There will be a Howard County Agricultural Land Preservation Program Easement.
PRESERVATION PARCELS 'B', 'C', AND 'D' ARE PROPOSED AS NON-BUILDABLE PRESERVATION PARCELS TO PROVIDE STORMWATER MANAGEMENT. THESE PARCELS ARE TO BE DEDICATED TO THE HOMEOWNERS ASSOCIATION WITH HOWARD COUNTY AS THE EASEMENT HOLDER.

20.) THIS PLAN COMPLIES WITH THE REQUIREMENTS OF SECTION 16.1200 OF THE HOWARD COUNTY CODE FOR FOREST CONSERVATION BY RETENTION OF 7.54 ACRES OF FOREST AND REFORESTATION OF 1.68 ACRES. FINANCIAL SURETY FOR THE 7.54 ACRES (328,442.40 S.F.) OF RETENTION IN THE AMOUNT OF $65,688.48 AND THE 1.68 ACRES (73,180.80 S.F.) OF REFORESTATION IN THE AMOUNT OF $36,590.40 HAS BEEN POSTED AS PART OF THE DPW DEVELOPER'S AGREEMENT FOR THE TOTAL AMOUNT OF $102,278.88.

21.) THE 100-YEAR FLOODPLAIN LIMITS SHOWN ON THIS PLAN ARE FROM A DETAILED STUDY BY BENCHMARK ENGINEERING, INC., DATED MARCH 5, 2004, AND FROM INFORMATION PROVIDED IN THE CATTAIL CREEK WATERSHED STUDY, CAPITAL PROJECT #D-1079 DATED JUNE, 1994. THE LIMITS AND CROSS-SECTION INFORMATION WAS OBTAINED THROUGH THE HOWARD COUNTY DEPARTMENT OF PUBLIC WORKS TRANSPORTATION AND WATERSHED DIVISION'S GIS NETWORK.

22.) ALL DRIVEWAY CULVERTS ARE TO BE 15" HDPEP. DESIGN CALCULATIONS ARE PROVIDED IN THE APPROVED STORM DRAIN REPORT.

23.) HOWARD COUNTY MONUMENT #07FA TO BE RELOCATED BY OTHERS.

24.) THE 65 dBA NOISE CONTOUR LINE DRAWN ON THIS SUBDIVISION PLAN IS ADVISORY AS REQUIRED BY THE HOWARD COUNTY DESIGN MANUAL, CHAPTER 5, REVISED FEBRUARY, 1992 AND CANNOT BE CONSIDERED TO EXACTLY LOCATE THE 65 dBA NOISE EXPOSURE. THE 65 dBA NOISE LINE WAS ESTABLISHED BY HOWARD COUNTY TO ALERT DEVELOPERS, BUILDERS AND FUTURE RESIDENTS THAT THE AREAS BEYOND THIS THRESHOLD MAY EXCEED GENERALLY ACCEPTED NOISE LEVELS ESTABLISHED BY THE U.S. DEPARTMENT OF HOUSING AND URBAN DEVELOPMENT

25.) ALL SIGN POSTS USED FOR TRAFFIC CONTROL SIGNS INSTALLED IN THE COUNTY RIGHT-OF-WAY SHALL BE MOUNTED ON A 2" GALVANIZED STEEL, PERFORATED, SQUARE TUBE POST (14 GAUGE) INSERTED INTO A 2-1/2" GALVANIZED STEEL, PERFORATED, SQUARE TUBE SLEEVE (12 GAUGE) - 3' LONG. A GALVANIZED STEEL POLE CAP SHALL BE MOUNTED ON TOP OF EACH POST.

26.) ALL LANDSCAPING REQUIREMENTS FOR THIS PROJECT SHALL BE IN ACCORDANCE WITH THE HOWARD COUNTY LANDSCAPE MANUAL AND SECTION 16.124(b)(3)(ii) OF THE SUBDIVISION REGULATIONS. FINANCIAL SURETY FOR THE REQUIRED LANDSCAPING WILL BE POSTED AS PART OF THE DPW DEVELOPER'S AGREEMENT IN THE AMOUNT OF $63,450.00.

27.) THE DEVELOPER HAS FILED A JOINT FEDERAL/STATE APPLICATION FOR THE ALTERATION OF ANY FLOODPLAIN, WATERWAY, TIDAL OR NONTIDAL WETLAND IN MARYLAND FOR THE NECESSARY ROAD CROSSINGS. MARYLAND DEPARTMENT OF THE ENVIRONMENT HAS DETERMINED THAT THERE ARE NO IMPACTS TO STATE JURISDICTIONAL WETLANDS, WATERWAYS OR FLOODPLAINS. THE U. S. ARMY CORPS OF ENGINEERS HAS AUTHORIZED THE DEVELOPER TO PERFORM WORK IN ACCORDANCE WITH THE TERMS AND CONDITIONS SPECIFIED IN SECTION VI OF THE MDSPGP-2 EFFECTIVE ON OCTOBER 1, 2001. THE TRACKING NUMBER IS 200662094/06-NT-3055.

28.) [cross-hatched symbol] THIS AREA DESIGNATES A SAND MOUND LOCATION FOR DISPOSAL OF SEWAGE. LOTS 6, 7, 10, 14 AND 1? CONTAIN SANDMOUNDS THAT ARE TO BE DESIGNED AT THE TIME OF PERMIT PLAN.

29.) DISTURBANCE TO FLOOD PLAIN ASSOCIATED WITH THE CONSTRUCTION OF THE ROADWAY CROSSING HAS BEEN APPROVED UNDER SECTION 16.115.(C) OF THE SUBDIVISION REGULATIONS BY THE DIVISION OF LAND DEVELOPMENT. THE DEPARTMENT OF PLANING AND ZONING HAS DETERMINED THAT THE DISTURBANCE AT THE STREAM CROSSING IS CONSIDERED "NECESSARY" IN ACCORDANCE WITH SECTION 16.116(C) OF THE SUBDIVISION REGULATIONS. THE DISTURBANCE WAS APPROVED BECAUSE CONSTRUCTING A SEPARATE ACCESS ONTO ROUTE 94 WOULD REQUIRE EXTENSIVE CLEARING AND GRADING ALONG THE SCENIC ROAD AND DUE TO THE PRESENCE OF STEEP SLOPES IN THE AREA.

30.) There are no Specimen Trees on this site.

### SITE ANALYSIS DATA CHART

GENERAL SITE DATA

| | |
|---|---|
| 1.) PRESENT ZONING: | RC-DEO |
| 2.) APPLICABLE DPZ FILE REFERENCES: | S-01-21, P-05-001 |
| 3.) PROPOSED USE OF SITE: | RESIDENTIAL (SFD) |
| 4.) PROPOSED WATER AND SEWER SYSTEMS: | PRIVATE |

AREA TABULATION

| | |
|---|---|
| 1.) GROSS TRACT AREA | 116.79 AC.± |
| 2.) AREA WITHIN 100-YEAR FLOODPLAIN | 23.62 AC.± |
| 3.) TOTAL AREA OF 25% OR GREATER STEEP SLOPES | 1.10 AC.± |
| 4.) NET TRACT AREA | 92.07 AC.± |
| 5.) TOTAL NUMBER OF LOTS ALLOWED PER ZONING 1 UNIT PER 4.25 GROSS ACRES | 27 |
| 6.) TOTAL NUMBER OF RESIDENTIAL UNITS/LOTS PROPOSED ON THIS SUBMISSION (20 CLUSTER LOTS+ PRES. PARCEL A) | 21 |
| 7.) AREA OF CLUSTER LOTS | 22.72 AC.± |
| 8.) AREA OF BUILDABLE PRESERVATION PARCEL | 83.33 AC.± |
| 9.) AREA OF NON-BUILDABLE PRESERVATION PARCELS | 6.35 AC.± |
| 10.) AREA OF ROAD RIGHT-OF-WAY | 4.39 AC.± |
| 11.) OPEN SPACE ON-TOTAL SITE | N/A |
| 11.) TOTAL NUMBER OF BUILDABLE PRESERVATION PARCELS | 1 |
| 12.) TOTAL NUMBER OF NON-BUILDABLE PRESERVATION PARCELS | 3 |

APPROVED: HOWARD COUNTY DEPARTMENT OF PUBLIC WORKS

[signature] 4-21-06
CHIEF, BUREAU OF HIGHWAYS — DATE

APPROVED: HOWARD COUNTY DEPT. OF PLANNING AND ZONING

Cindy Hamilton 5/12/06
CHIEF, DIVISION OF LAND DEVELOPMENT JA — DATE

[signature] 5/2/06
CHIEF, DEVELOPMENT ENGINEERING DIVISION MK — DATE

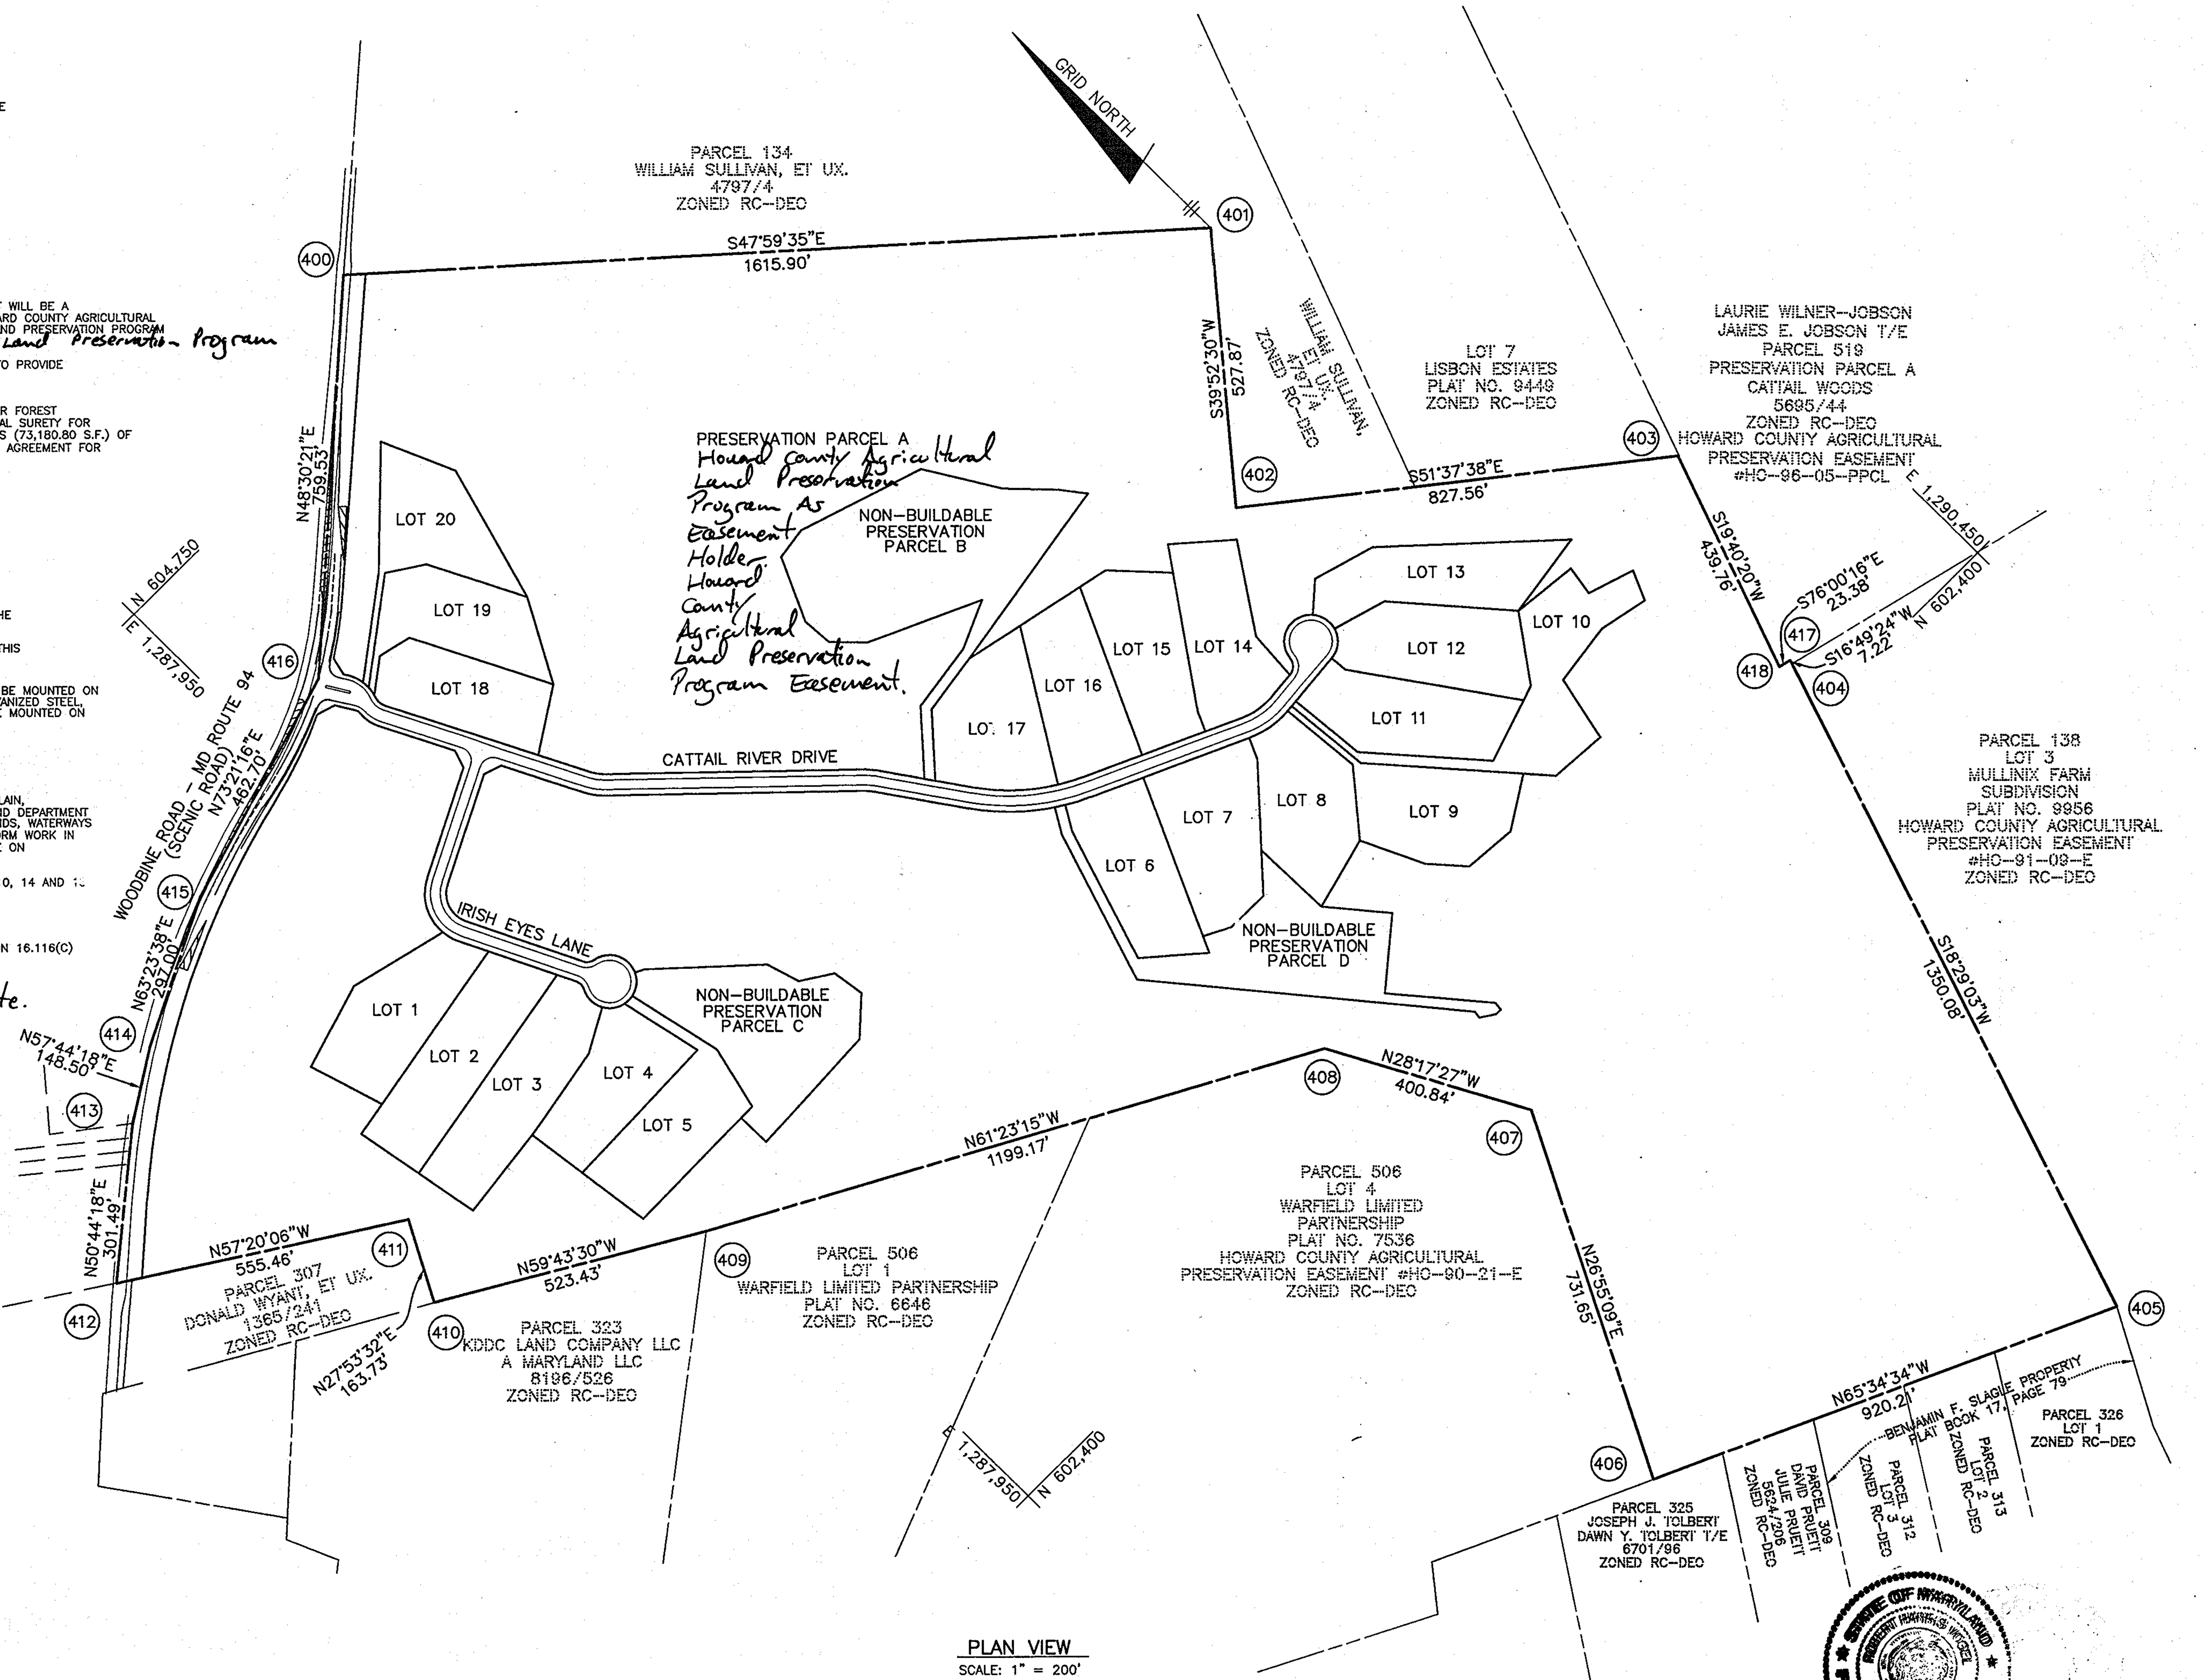


PLAN VIEW
SCALE: 1" = 200'

### BENCH MARKS NAD'83

HO. CO. #07FB
STAMPED BRASS DISK SET ON TOP OF CONCRETE BASE; 3.6' SOUTH OF EDGE OF PAVING OF ROUTE 94; 62.9' SOUTHWEST OF C&P POLE #15 AND 44.6' SOUTHEAST OF P.E. POLE #FS2601.
N 605463.426' E 1289326.119'
ELEV. 589.016'

HO. CO. #07FA
STAMPED BRASS DISK SET ON TOP OF CONCRETE BASE; 6.1' SOUTH OF THE EDGE OF PAVING OF ROUTE 94; 45.3' SOUTH OF P.E. SYSTEM POLE #FS6908 AND 26.6' NORTHEAST OF P.E. SYSTEM POLE #6909(C&P POLE #22).
N 604392.216' E 1288044.192'
ELEV. 593.432'

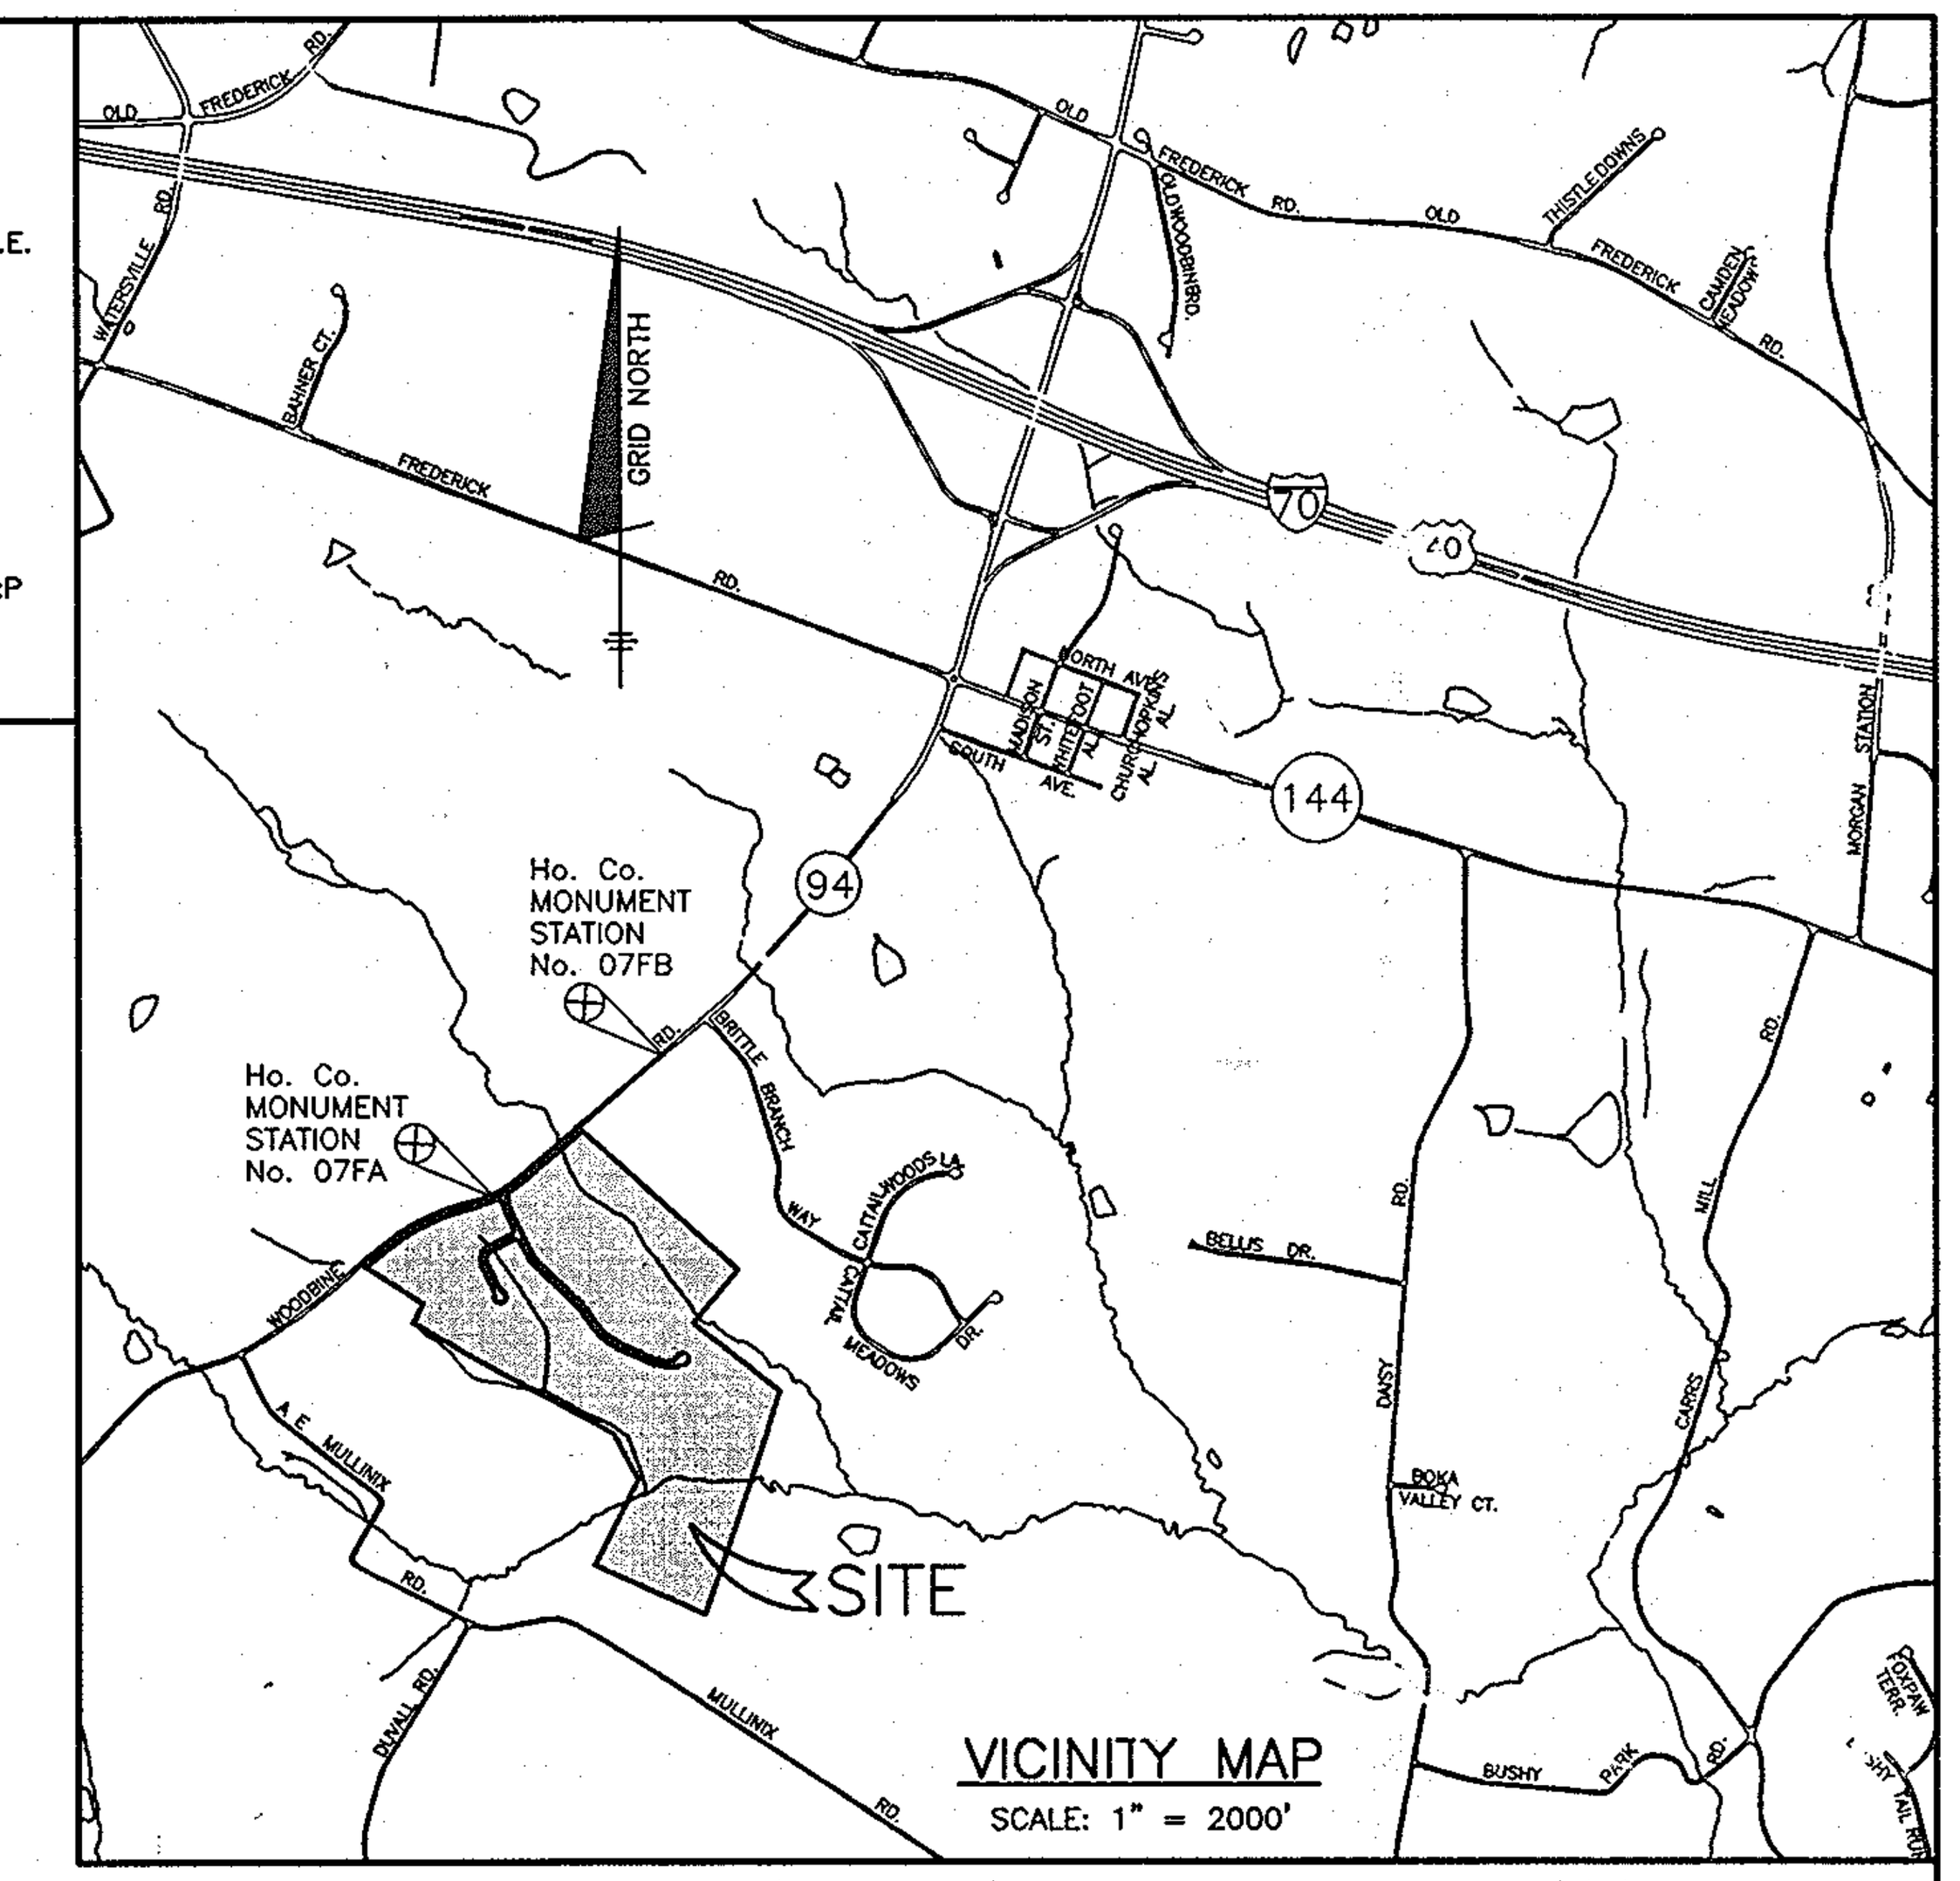


VICINITY MAP
SCALE: 1" = 2000'

### SHEET INDEX

| NO. | DESCRIPTION |
|---|---|
| 1 | TITLE SHEET |
| 2 | ROAD PLAN |
| 3 | ROAD PLAN |
| 4 | WOODBINE ROAD IMPROVEMENT PLAN |
| 5 | ROAD PROFILES |
| 6 | ROAD PROFILES AND DETAILS |
| 7 | STORMDRAIN DRAINAGE AREA MAP |
| 8 | STORMDRAIN PROFILES |
| 9 | STORMDRAIN PROFILES |
| 10 | GRADING, SEDIMENT AND EROSION CONTROL PLAN |
| 11 | GRADING, SEDIMENT AND EROSION CONTROL PLAN |
| 12 | SEDIMENT AND EROSION CONTROL NOTES AND DETAILS |
| 13 | LANDSCAPE PLAN |
| 14 | FOREST CONSERVATION PLAN |
| 15 | FOREST CONSERVATION PLAN |
| 16 | SWM DETAILS FACILITY #1 |
| 17 | SWM DETAILS FACILITY #2 |
| 18 | SWM DETAILS FACILITY #3 |
| 19 | SWM NOTES AND BORING LOGS |
| | |

### LEGEND

LIMIT OF WETLANDS
EXISTING WOODS LINE
PROPOSED WOODS LINE
EXISTING STRUCTURE
EXISTING WELL — EX. WELL
PROPOSED SEPTIC FIELD
100 YEAR FLOODPLAIN
PROP. STREET TREE
PROPOSED SANDMOUND AREA
SLOPES 25% AND GREATER
SLOPE BETWEEN 15% AND 24.9%

| NO. | DATE | REVISION |
|---|---|---|
| | | |

BENCHMARK
ENGINEERS ▲ LAND SURVEYORS ▲ PLANNERS
ENGINEERING, INC.
8480 BALTIMORE NATIONAL PIKE ▲ SUITE 418
ELLICOTT CITY, MARYLAND 21043
phone: 410-465-6105 ▲ fax: 410-465-6644
www.bei-civilengineering.com

Donald Mason
3/31/06

AS-BUILT CERTIFICATION
I HEREBY CERTIFY THAT THE FACILITY SHOWN ON THIS PLAN WAS CONSTRUCTED AS SHOWN ON THE "AS-BUILT" PLANS AND MEETS THE APPROVED PLANS & SPECIFICATIONS.
[signature] SIGNATURE — 16193 P.E. NO. — 01/31/13 DATE

OWNER/DEVELOPER:
TRINITY QUALITY HOMES, INC.
3675 PARK AVENUE
SUITE 301
ELLICOTT CITY, MD 21043
410-480-0023

PROJECT: THE CHASE AT STONEY BROOK
LOTS 1-20, PRESERVATION PARCEL "A" AND NON-BUILDABLE PRESERVATION PARCELS "B" THROUGH "D"

LOCATION: TAX MAP 7, BLOCK 17 PARCEL 133
4th ELECTION DISTRICT
HOWARD COUNTY, MARYLAND

TITLE: TITLE SHEET

DATE: ~~APRIL, 2006~~ MARCH, 2006 — PROJECT NO. 1187

DES: JMC | DRAFT: JMC | CHECK: DAM | SCALE: AS SHOWN | SHEET 1 OF 19

AS-BUILT 1/31/13

F-05-170

P:\1187\dwg\7009S01.dwg, Sheet 1, 3/31/2006 3:02:03 PM, imc, Oce TDS600 HDI for cvsler.oc3

## STREET LIGHT SCHEDULE

| SYMBOL | DESCRIPTION | LOCATION |
|---|---|---|
| | 250-WATT HPS VAPOR PENDANT FIXTURE (5A42) MOUNTED AT 30' ON A BRONZE FIBERGLASS POLE, USING A 12' ARM | OFFSET 54.9' LT C/L STA. 0+42.56 CATTAIL RIVER ROAD |

EXTEND ONE FOOT FULL DEPTH SAWCUT ONTO WOODBINE ROAD FOR ROAD WIDENING.

## CENTERLINE CONTROL DATA

| STREET NAME | STATION | NORTH | EAST |
|---|---|---|---|
| CATTAIL RIVER DRIVE | BEGIN=0+00.00 | 604434.35 | 1288084.37 |
| | PC=0+86.74 | 604360.39 | 1288129.68 |
| | PRC=1+26.01 | 604322.59 | 1288135.67 |
| | PT=1+61.18 | 604288.37 | 1288139.65 |
| | PC=5+63.11 | 603929.62 | 1288320.88 |
| | PT=5+96.40 | 603902.93 | 1288340.52 |
| | PC=10+81.38 | 603565.28 | 1288688.65 |
| | PT=11+00.78 | 603550.51 | 1288701.18 |
| | PC=12+80.13 | 603403.16 | 1288803.44 |
| | PT=14+98.96 | 603264.31 | 1288969.20 |
| | PC=18+15.00 | 603132.43 | 1289256.42 |
| | PT=18+92.99 | 603119.35 | 1289332.42 |
| | END=20+51.24 | 603160.70 | 1289457.46 |
| IRISH EYES LANE | BEGIN=0+00.00 | 604114.18 | 1288227.65 |
| | PC=2+62.72 | 603995.17 | 1287993.15 |
| | PT=3+79.12 | 603896.22 | 1287959.40 |
| | END=6+69.08 | 603634.99 | 1287959.40 |

## LEGEND

- LIMIT OF WETLANDS
- EXISTING WOODS LINE
- PROPOSED WOODS LINE
- EXISTING STRUCTURE
- EXISTING WELL (EX. WELL)
- PROPOSED SEPTIC FIELD
- 100 YEAR FLOODPLAIN
- FOREST CONSERVATION
- PROP. STREET TREE
- STEEP SLOPES 15-24.9%
- STEEP SLOPES 25% OR GREATER

## CENTER LINE CURVE DATA

| STREET NAME | STATION | RADIUS | LENGTH | DELTA | TANGENT | CHORD | |
|---|---|---|---|---|---|---|---|
| CATTAIL RIVER DRIVE | STA. 0+86.74 TO 1+26.01 | 50.00' | 32.27' | 45°00'00" | 20.71' | N08°59'59"W | 38.27' |
| | STA. 1+26.01 TO 1+61.18 | 50.00' | 35.17' | 40°18'24" | 18.35' | S06°38'53"E | 34.45' |
| | STA. 5+63.11 TO 5+96.40 | 100.00' | 33.29' | 19°04'26" | 16.80' | S36°20'18"E | 33.14' |
| | STA. 10+81.38 TO 11+00.78 | 100.00' | 19.40' | 11°06'58" | 9.73' | N40°19'02"W | 19.37' |
| | STA. 12+80.13 TO 14+98.96 | 410.00' | 218.82' | 30°34'45" | 112.08' | S50°02'56"E | 216.23' |
| | STA. 18+15.00 TO 18+92.99 | 150.00' | 78.00' | 29°47'31" | 39.90' | S80°14'04"E | 77.12' |
| IRISH EYES LANE | STA. 2+62.72 TO 3+79.12 | 75.00' | 116.40' | 88°55'13" | 73.60' | S18°44'19"W | 105.06' |

APPROVED: HOWARD COUNTY DEPARTMENT OF PUBLIC WORKS

CHIEF, BUREAU OF HIGHWAYS — DATE 4-21-06

APPROVED: HOWARD COUNTY DEPT. OF PLANNING AND ZONING

CHIEF, DIVISION OF LAND DEVELOPMENT — DATE 5/12/06

CHIEF, DEVELOPMENT ENGINEERING DIVISION — DATE 5/2/06


BENCHMARK
ENGINEERS ▲ LAND SURVEYORS ▲ PLANNERS
ENGINEERING, INC.
8480 BALTIMORE NATIONAL PIKE ▲ SUITE 418
ELLICOTT CITY, MARYLAND 21043
phone: 410-465-6105 ▲ fax: 410-465-6644
www.bei-civilengineering.com


3/31/06

OWNER/DEVELOPER:
TRINITY QUALITY HOMES, INC.
3675 PARK AVENUE
SUITE 301
ELLICOTT CITY, MD 21043
410-480-0023

PROJECT:
# THE CHASE AT STONEY BROOK
LOTS 1-20, PRESERVATION PARCEL "A" AND NON-BUILDABLE PRESERVATION PARCELS "B" THROUGH "D"

LOCATION:
TAX MAP No. 7, BLOCK No. 17, PARCEL No. 133
4th ELECTION DISTRICT
HOWARD COUNTY, MARYLAND

TITLE:
ROAD PLANS

DATE: AUGUST, 2005 / MARCH, 2006 — PROJECT NO. 1187

DES: JMC — DRAFT: LAB — CHECK: DAM — SCALE: 1" = 50' — SHEET 2 OF 19

F-05-170


51187dwg\7017s2_3.dwg, SHEET 2, 3/31/2006 2:07:33 PM,
mc, Oce TDS600 HDI for mylar.pc3

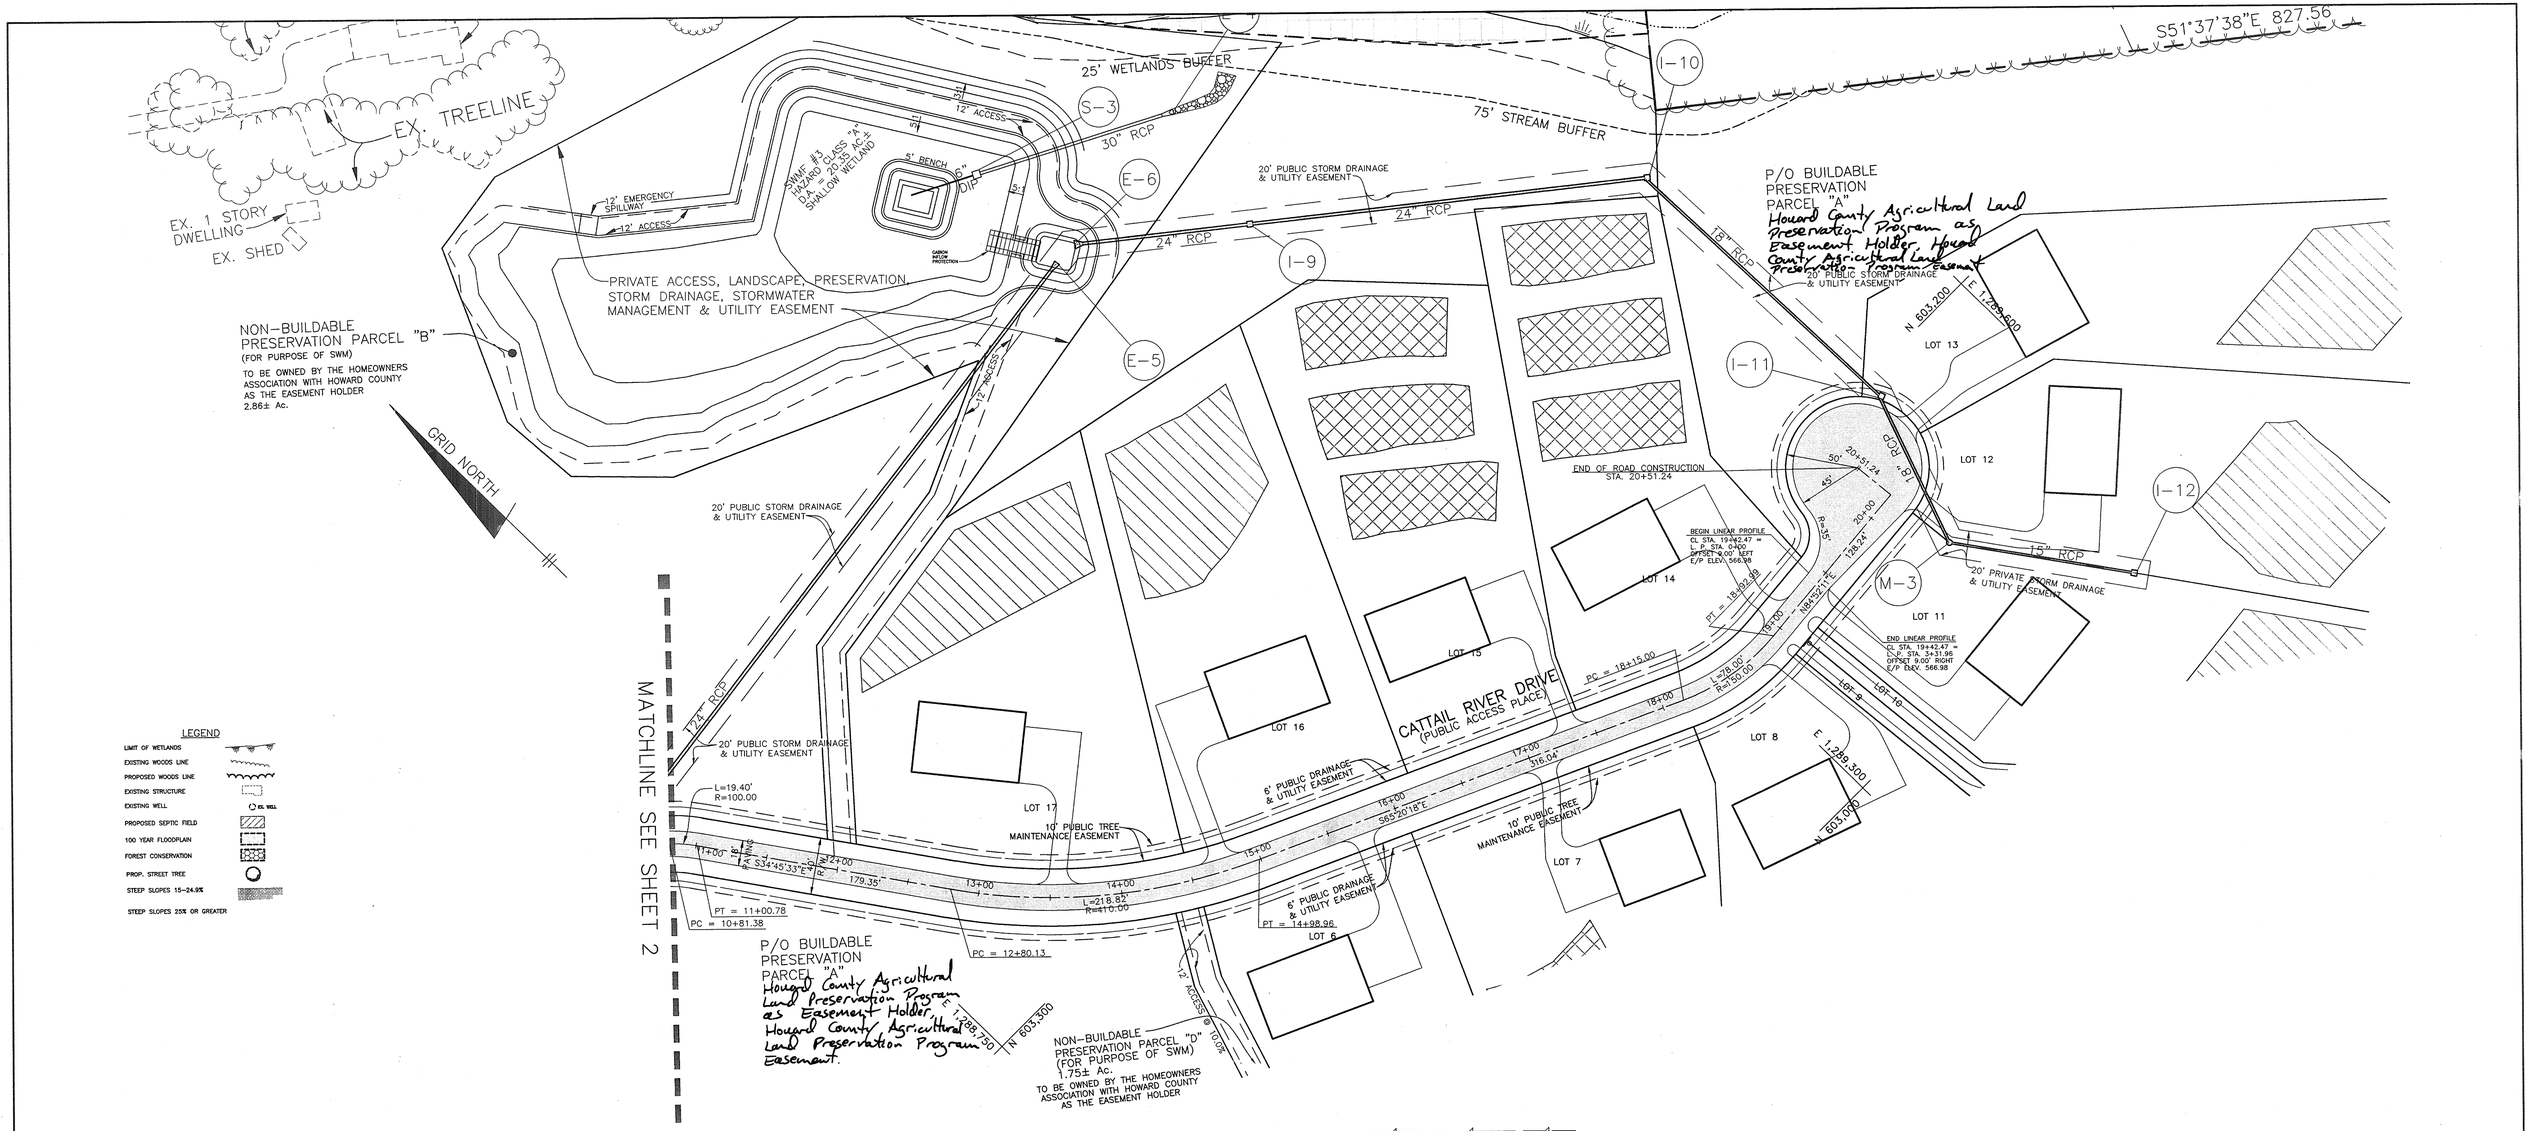


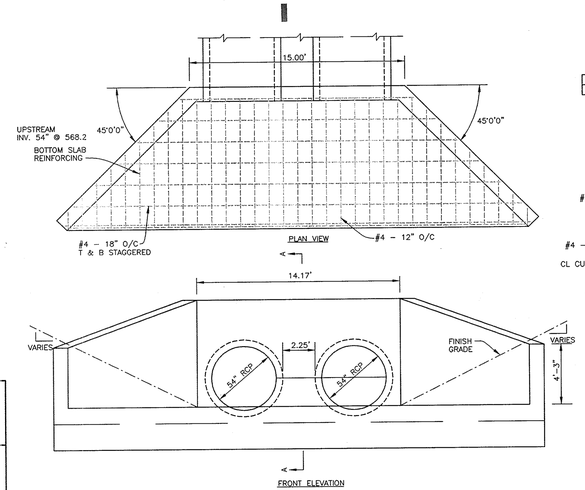


'HW2' MODIFIED TYPE 'A' HEADWALL

SCALE: 1" = 5'

| D | E | F | G | H | J | K | L | N |
|---|---|---|---|---|---|---|---|---|
| 54" | 15'-0" | 32'-2" | 9'-0" | 7'-6" | 4'-3" | 9" | 12" | 12" |

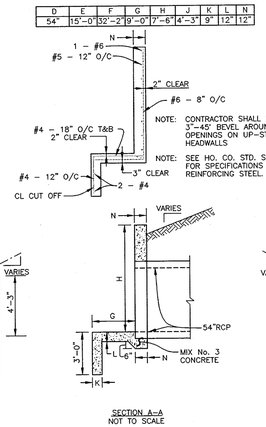


NOTE: CONTRACTOR SHALL PROVIDE 3"-45° BEVEL AROUND PIPE OPENINGS ON UP-STREAM HEADWALLS

NOTE: SEE HO. CO. STD. SD-5.11 FOR SPECIFICATIONS ON REINFORCING STEEL.

SECTION A-A
NOT TO SCALE

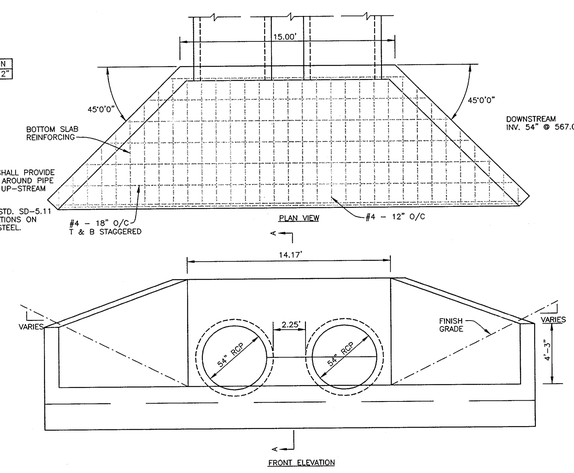


'HW1' MODIFIED TYPE 'A' HEADWALL

SCALE: 1" = 5'

APPROVED: HOWARD COUNTY DEPARTMENT OF PUBLIC WORKS

CHIEF, BUREAU OF HIGHWAYS — DATE 4-21-06

APPROVED: HOWARD COUNTY DEPT. OF PLANNING AND ZONING

CHIEF, DIVISION OF LAND DEVELOPMENT — DATE 5/2/06

CHIEF, DEVELOPMENT ENGINEERING DIVISION — DATE 5/2/06


BENCHMARK
ENGINEERS ▲ LAND SURVEYORS ▲ PLANNERS
ENGINEERING, INC.
8480 BALTIMORE NATIONAL PIKE ▲ SUITE 418
ELLICOTT CITY, MARYLAND 21043
phone: 410-465-6105 ▲ fax: 410-465-6644
www.bei-civilengineering.com


3/31/06

OWNER/DEVELOPER:

TRINITY QUALITY HOMES, INC.
3675 PARK AVENUE
SUITE 301
ELLICOTT CITY, MD 21043
410-480-0023

PROJECT:
THE CHASE AT STONEY BROOK
LOTS 1-20, PRESERVATION PARCEL "A" AND NON-BUILDABLE PRESERVATION PARCELS "B" THROUGH "D"

LOCATION:
TAX MAP No. 7, BLOCK No. 17, PARCEL No. 133
4th ELECTION DISTRICT
HOWARD COUNTY, MARYLAND

TITLE:
ROAD PLANS

| DES: JMC | DRAFT: LAB | CHECK: DAM | DATE: MAY, 2005 / MARCH, 2006 | PROJECT NO. 1187 |
|---|---|---|---|---|
| | | | SCALE: 1" = 50' | SHEET 3 OF 19 |

F-05-170

P:\1187\dwg\7017x2_3.dwg, SHEET 3, 3/31/2006 2:08:16 PM,
imc, Oce TDS600 HDI for mylar.pc3

EXTEND ONE FOOT FULL DEPTH SAWCUT ONTO WOODBINE ROAD FOR ROAD WIDENING.

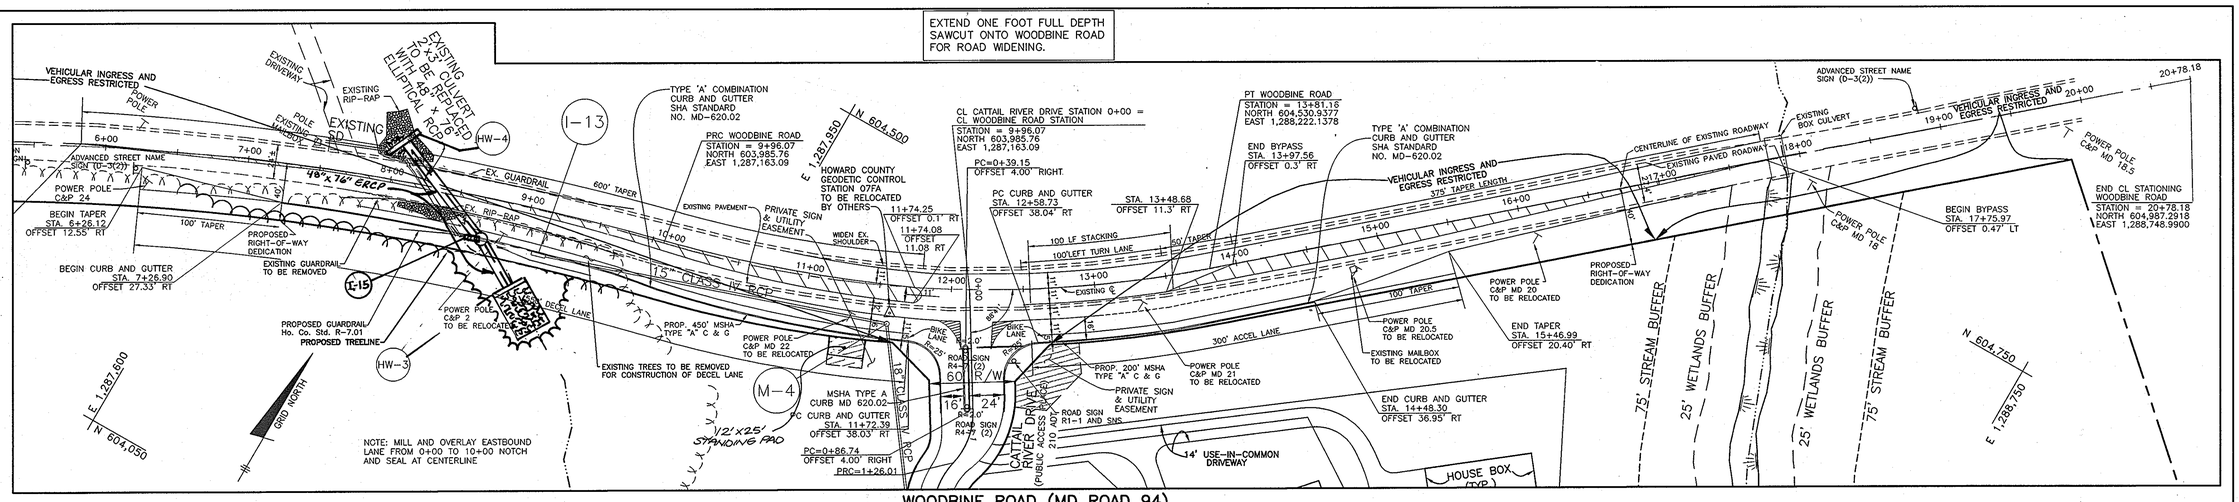


## WOODBINE ROAD (MD ROAD 94)

(SCENIC ROAD, MINOR ARTERIAL – 80' ULT. R/W)

## PLAN VIEW

SCALE: 1" = 50'




MSHA PAVING SECTION

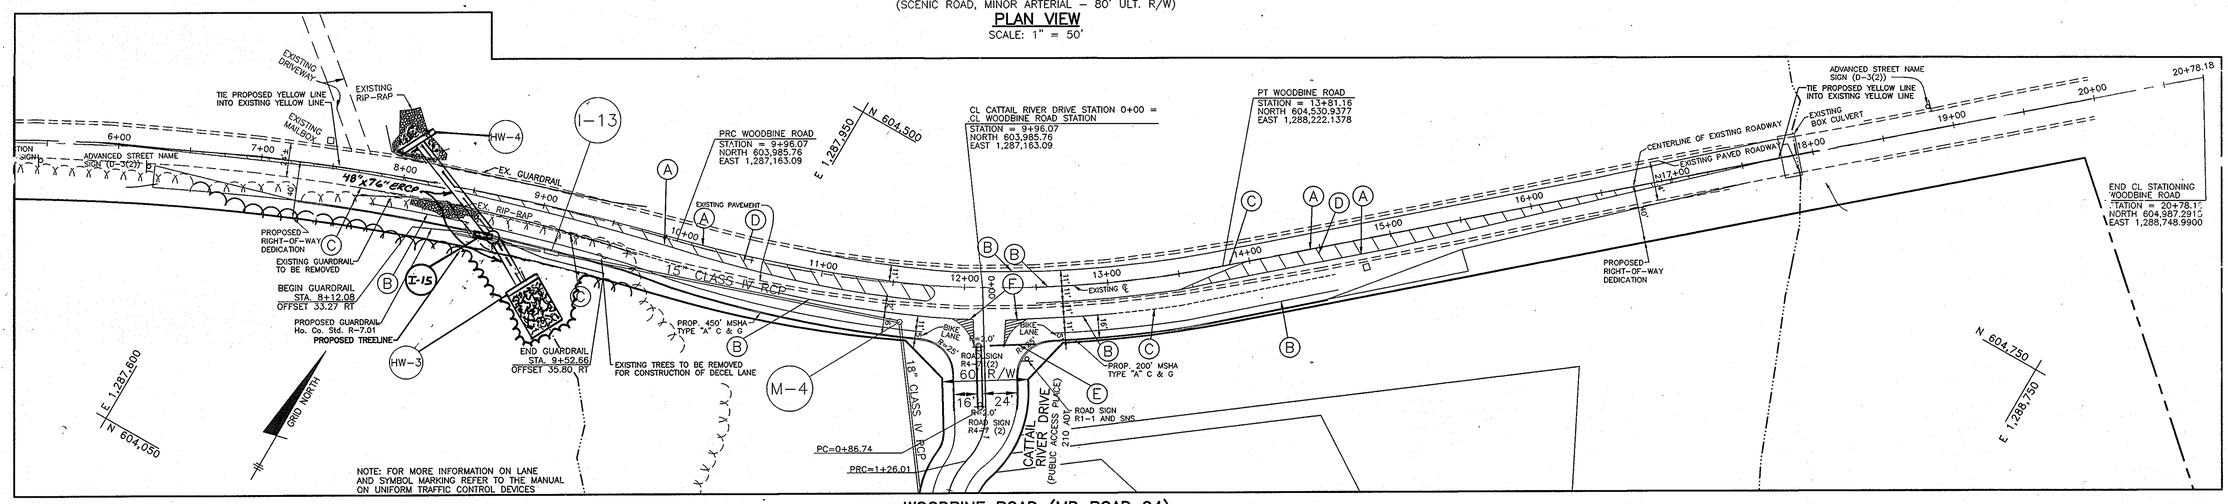


## WOODBINE ROAD (MD ROAD 94)

(SCENIC ROAD, MINOR ARTERIAL – 80' ULT. R/W)

## PLAN VIEW – STRIPING AND SIGNAGE

SCALE: 1" = 50'

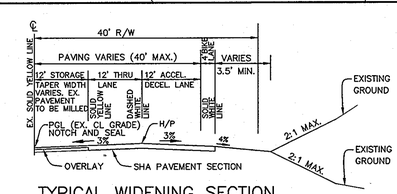


## TYPICAL WIDENING SECTION

WOODBINE ROAD – OPEN SECTION
NOT TO SCALE

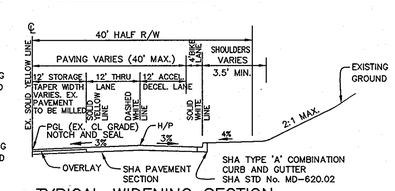


## TYPICAL WIDENING SECTION

WOODBINE ROAD – CURB AND GUTTER
NOT TO SCALE

## LINE LEGEND

- (A) DOUBLE YELLOW CENTERLINE 5" WIDE (EACH LINE)
- (B) SOLID WHITE (5" WIDE)
- (C) PUPPY TRACKS (5" WIDE – WHITE) (3' LONG/ 9' GAP)
- (D) HATCH LINES 12" WIDE ON 45° ANGLE EVERY 100' (YELLOW)
- (E) STOP BAR (24" WIDE – WHITE) (THERMPLASTIC)

APPROVED: HOWARD COUNTY DEPARTMENT OF PUBLIC WORKS

| | |
|---|---|
| CHIEF, BUREAU OF HIGHWAYS | DATE 4-21-06 |
| APPROVED: HOWARD COUNTY DEPT. OF PLANNING AND ZONING | |
| CHIEF, DIVISION OF LAND DEVELOPMENT | DATE 5/2/06 |
| CHIEF, DEVELOPMENT ENGINEERING DIVISION | DATE 5/2/06 |

STATE OF MARYLAND ROBERT HARRIS VOGEL No. 16193 PROFESSIONAL ENGINEER — 3/31/12

ROBERT H. VOGEL, P.E.
No. 16193
FOR REVISION #2 ONLY

| No. | DATE | REVISION |
|---|---|---|
| 2 | 6/11/12 | ADD 12'X25 STANDING PAD |
| 1 | 3-9-07 | REVISE HW3 – HW4 DESIGN |

BENCHMARK
ENGINEERS ▲ LAND SURVEYORS ▲ PLANNERS
ENGINEERING, INC.
8480 BALTIMORE NATIONAL PIKE ▲ SUITE 418
ELLICOTT CITY, MARYLAND 21043
phone: 410-465-6105 ▲ fax: 410-465-6644
www.bei-civilengineering.com

Donald Mann — 3/31/06

OWNER/DEVELOPER:
TRINITY QUALITY HOMES, INC.
3675 PARK AVENUE
SUITE 301
ELLICOTT CITY, MD 21043
410-480-0023

PROJECT: THE CHASE AT STONEY BROOK
LOTS 1–20, PRESERVATION PARCEL "A" AND NON-BUILDABLE PRESERVATION PARCELS "B" THROUGH "D"

LOCATION: TAX MAP NO. 7 BLOCK NO. 17 PARCEL NO. 133
4th ELECTION DISTRICT
HOWARD COUNTY, MARYLAND

TITLE: WOODBINE ROAD IMPROVEMENT PLAN

| DES: RPS | DRAFT: RPS | CHECK: DAM | DATE: MARCH, 2006 | PROJECT NO. 1187 |
|---|---|---|---|---|
| | | | SCALE: AS SHOWN | SHEET 4 OF 19 |

F-05-170

P:\1187\dwg\7017S04.dwg, Layout1, 3/31/2006 2:09:15 PM,
inc, Oce TDS600 HDI for mvhera:c3

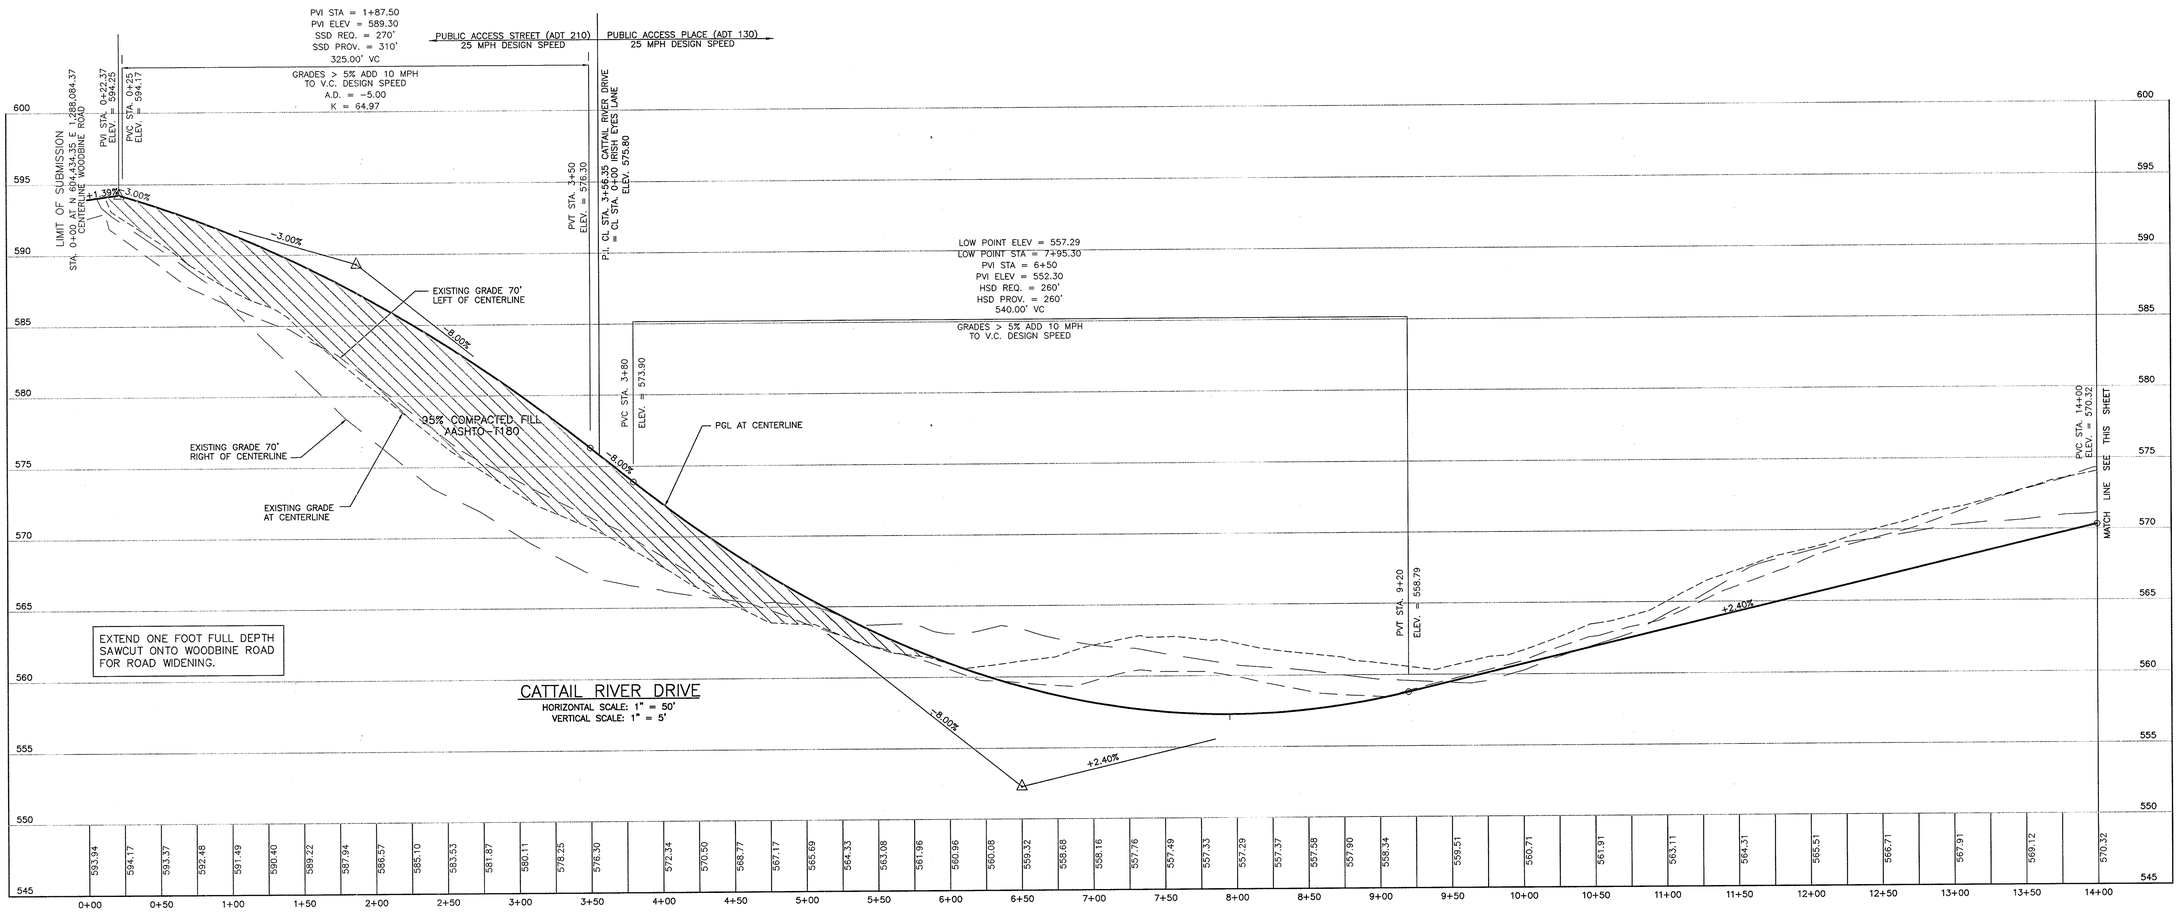


## CATTAIL RIVER DRIVE

HORIZONTAL SCALE: 1" = 50'
VERTICAL SCALE: 1" = 5'

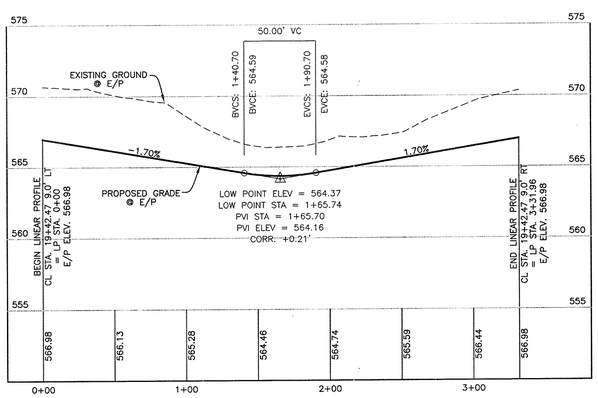


## CATTAIL RIVER DRIVE LINEAR PROFILE

HORIZONTAL SCALE: 1" = 50'
VERTICAL SCALE: 1" = 5'

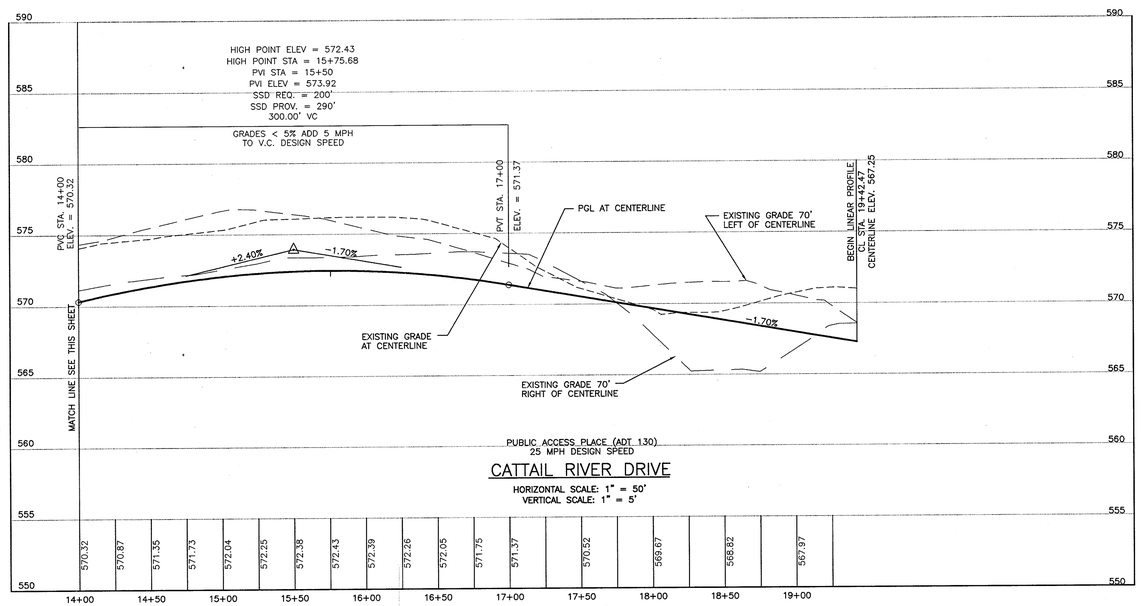


## CATTAIL RIVER DRIVE

HORIZONTAL SCALE: 1" = 50'
VERTICAL SCALE: 1" = 5'

APPROVED: HOWARD COUNTY DEPARTMENT OF PUBLIC WORKS

| | |
|---|---|
| CHIEF, BUREAU OF HIGHWAYS | DATE 4-21-06 |

APPROVED: HOWARD COUNTY DEPT. OF PLANNING AND ZONING

| | |
|---|---|
| CHIEF, DIVISION OF LAND DEVELOPMENT | DATE 5/12/06 |
| CHIEF, DEVELOPMENT ENGINEERING DIVISION | DATE 5/12/06 |


**BENCHMARK**
ENGINEERS ▲ LAND SURVEYORS ▲ PLANNERS
**ENGINEERING, INC.**
8480 BALTIMORE NATIONAL PIKE ▲ SUITE 418
ELLICOTT CITY, MARYLAND 21043
phone: 410-465-6105 ▲ fax: 410-465-6644
www.bei-civilengineering.com


STATE OF MARYLAND — DONALD MOSER — REGISTERED PROFESSIONAL ENGINEER — 3/31/06

OWNER/DEVELOPER:
TRINITY QUALITY HOMES, INC.
3675 PARK AVENUE
SUITE 301
ELLICOTT CITY, MD 21043
410-480-0023

PROJECT:
**THE CHASE AT STONEY BROOK**
LOTS 1-20, PRESERVATION PARCEL "A" AND NON-BUILDABLE PRESERVATION PARCELS "B" THROUGH "D"

LOCATION:
TAX MAP NO. 7 BLOCK NO. 17 PARCEL NO. 133
4th ELECTION DISTRICT
HOWARD COUNTY, MARYLAND

TITLE:
ROAD PROFILES

| | | | |
|---|---|---|---|
| DESIGN: JMC | DRAFT: RPS | DATE: AUGUST, 2005 / MARCH, 2006 | PROJECT NO. 1187 |
| | | SCALE: AS SHOWN | DRAWING 5 OF 19 |

F-05-170

P:\1187\dwg\70175S_6.dwg, Sheet 1, 3/31/2006 2:10:11 PM,
imc, Oce TDS600 HDI for mylar.pc3

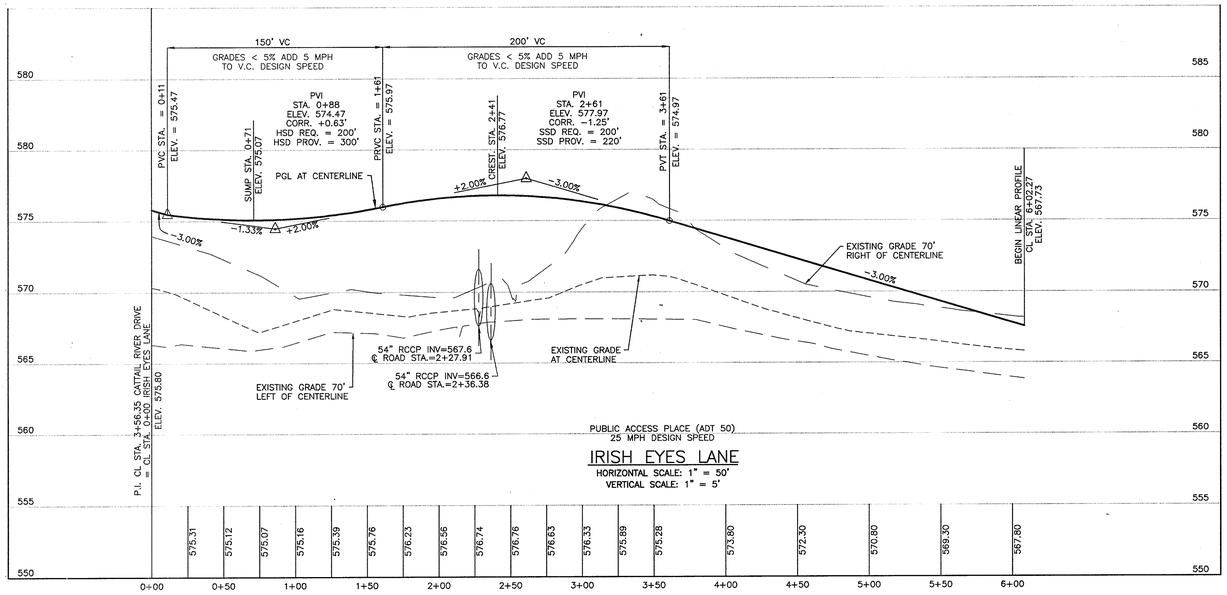


IRISH EYES LANE

HORIZONTAL SCALE: 1" = 50'
VERTICAL SCALE: 1" = 5'

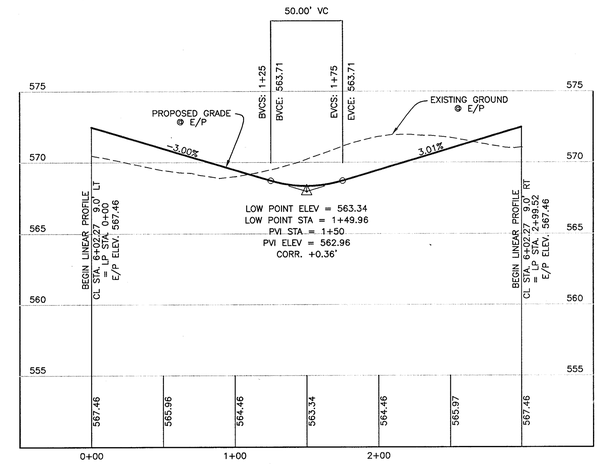


IRISH EYES LANE – LINEAR PROFILE

HORIZONTAL SCALE: 1" = 50'
VERTICAL SCALE: 1" = 5'




TYPICAL ROADWAY SECTION
AT CUL-DE-SAC

LINEAR PROFILE
NOT TO SCALE

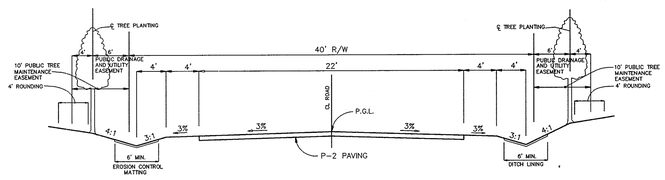


TYPICAL ROADWAY SECTION
CATTAIL RIVER DRIVE

(PUBLIC ACCESS STREET – 210 ADT)
DESIGN SPEED: 25 MPH
STA. 1+34.56 TO STA. 3+22.35
NOT TO SCALE

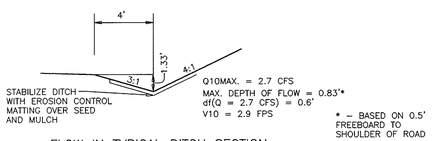


FLOW IN TYPICAL DITCH SECTION
NOT TO SCALE




P-2 PAVING DETAIL
NOT TO SCALE

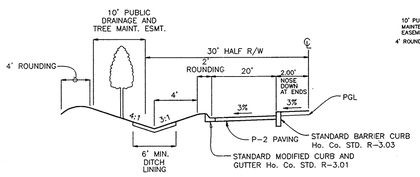


TYPICAL ROADWAY SECTION
20' PAVING W/ 4' ISLAND

(PUBLIC ACCESS STREET – 210 ADT)
DESIGN SPEED: 25 MPH
STA. 0+39.15 TO STA. 0+86.74
NOT TO SCALE

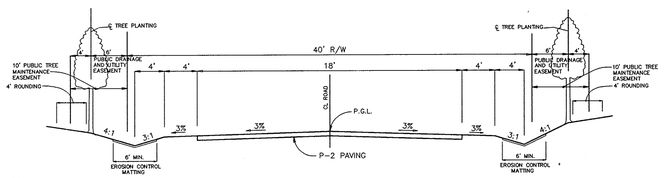


TYPICAL ROADWAY SECTION
CATTAIL RIVER DRIVE

(PUBLIC ACCESS PLACE – 130 ADT)
DESIGN SPEED: 25 MPH
STA. 3+90.35 TO STA. 19+42.47
NOT TO SCALE

NOTE: FROM 11+00 TO 12+50 AND 15+64.36 TO 17+14.36 6' PUBLIC DITCH EASEMENT ELIMINATED AND 10' PUBLIC TREE MAINTENANCE EASEMENT TO INCLUDE DITCH MAINTENANCE

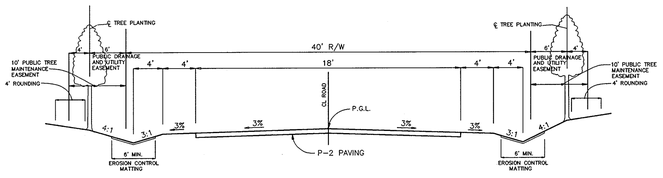


TYPICAL ROADWAY SECTION
IRISH EYES LANE

(PUBLIC ACCESS PLACE– 50 ADT)
DESIGN SPEED: 25 MPH
STA. 0+36.00 TO STA. 6+02.27
NOT TO SCALE

APPROVED: HOWARD COUNTY DEPARTMENT OF PUBLIC WORKS

CHIEF, BUREAU OF HIGHWAYS — DATE 4-21-06

APPROVED: HOWARD COUNTY DEPT. OF PLANNING AND ZONING

CHIEF, DIVISION OF LAND DEVELOPMENT — DATE 5/12/06

CHIEF, DEVELOPMENT ENGINEERING DIVISION — DATE 5/2/06


BENCHMARK
ENGINEERS △ LAND SURVEYORS △ PLANNERS
ENGINEERING, INC.
8480 BALTIMORE NATIONAL PIKE △ SUITE 418
ELLICOTT CITY, MARYLAND 21043
phone: 410-465-6105 △ fax: 410-465-6644
www.bei-civilengineering.com


STATE OF MARYLAND — DONALD MANN — REGISTERED PROFESSIONAL ENGINEER — 3/31/06

OWNER/DEVELOPER:
TRINITY QUALITY HOMES, INC.
3675 PARK AVENUE
SUITE 301
ELLICOTT CITY, MD 21043
410-480-0023

PROJECT:
THE CHASE AT STONEY BROOK
LOTS 1-20, PRESERVATION PARCEL "A" AND NON-BUILDABLE PRESERVATION PARCELS "B" THROUGH "D"

LOCATION:
TAX MAP NO. 7 BLOCK NO.17 PARCEL NO. 133
4th ELECTION DISTRICT
HOWARD COUNTY, MARYLAND

TITLE:
ROAD PROFILES AND DETAILS

DATE: AUGUST, 2005 / MARCH, 2006
PROJECT NO. 1187
DRAWING 6 OF 19
SCALE: AS SHOWN
DESIGN: JMC
DRAFT: RPS

F-05-170

P:\1187\dwg\701785_6.dwg, Sheet 2, 3/31/2006 2:10:55 PM,
Oce TDS600 HDI for mylar.pc3

## SOILS LEGEND

| SOIL | NAME | CLASS |
|---|---|---|
| ** Ba | Baile silt loam | D |
| * CuB | Comus silt loam, local alluvium, 3 to 8 percent slopes | B |
| GlB2 | Glenelg loam, 3 to 8 percent slopes, moderately eroded | B |
| GlC2 | Glenelg loam, 8 to 15 percent slopes, moderately eroded | B |
| GlC3 | Glenelg loam, 8 to 15 percent slopes, severely eroded | B |
| GlD3 | Glenelg loam, 15 to 25 percent slopes, severely eroded | B |
| GlD2 | Glenelg loam, 15 to 25 percent slopes, moderately eroded | B |
| * GnA | Glenville silt loam, 0 to 3 percent slopes | C |
| * GnB2 | Glenville silt loam, 3 to 8 percent slopes, moderately eroded | C |
| ** Ha | Hatboro silt loam | D |
| MtC2 | Mt. Airy channery loam, 8 to 15 percent slopes, moderately eroded | A |
| MtC3 | Mt. Airy channery loam, 8 to 15 percent slopes, severely eroded | A |
| MtD2 | Mt. Airy channery loam, 15 to 25 percent slopes, moderately eroded | A |
| MtE | Mt. Airy channery loam, 25 to 45 percent slopes | A |

*NOTES:*

- * Hydric soils and/or contains hydric inclusions
- ** May contain hydric inclusions
- † Generally only within 100-year floodplain areas

P/O BUILDABLE PRESERVATION PARCEL "A" Howard County Agricultural Land Preservation Program as Easement Holder, Howard County Agricultural Land Preservation Program Easement

## STORM DRAIN DATA

| INLET NO. | AREA (AC) | % IMPERVIOUS | SOIL CLASS | ZONING | 'C' FACTOR |
|---|---|---|---|---|---|
| I-1 | 2.60 | 26 | B, C | RC-DEO | 0.28 |
| I-1A | 2.85 | 19 | B, C | RC-DEO | 0.26 |
| I-2 | 0.90 | 38 | B | RC-DEO | 0.37 |
| I-3 | 0.54 | 49 | B | RC-DEO | 0.47 |
| I-4 | 0.43 | 100 | B | RC-DEO | 0.86 |
| I-5 | 0.29 | 81 | B | RC-DEO | 0.71 |
| I-6 | 0.09 | 100 | B, C | RC-DEO | 0.86 |
| I-7 | 0.39 | 74 | B, C | RC-DEO | 0.67 |
| I-8 | 0.48 | 69 | B | RC-DEO | 0.64 |
| I-9 | 1.59 | 17 | B | RC-DEO | 0.20 |
| I-10 | 0.36 | 13 | B | RC-DEO | 0.19 |
| I-11 | 1.54 | 49 | B | RC-DEO | 0.45 |
| I-12 | 2.26 | 20 | A, B | RC-DEO | 0.21 |
| I-13 | 0.22 | 100 | B, C | RC-DEO | 0.86 |
| I-14 | 1.15 | 15 | B | RC-DEO | 0.19 |

## SWALE DATA

| SWALE NO. | AREA (AC) | SOIL CLASS | ZONING | 'C' FACTOR |
|---|---|---|---|---|
| 1 | 1.84 | B | RC-DEO | 0.18 |
| 2 | 1.48 | A, B | RC-DEO | 0.17 |
| 3 | 1.59 | B | RC-DEO | 0.20 |
| 4 | 1.46 | B | RC-DEO | 0.19 |
| 5 | 3.56 | A, B | RC-DEO | 0.17 |

## LEGEND

- LIMIT OF WETLANDS
- EXISTING WOODS LINE
- PROPOSED WOODS LINE
- EXISTING STRUCTURE
- EXISTING WELL (EX. WELL)
- PROPOSED SEPTIC FIELD
- 100 YEAR FLOODPLAIN
- FOREST CONSERVATION
- PROP. STREET TREE
- STEEP SLOPES 15–24.9%
- STEEP SLOPES 25% OR GREATER
- PROPOSED SAND MOUND AREA

APPROVED: HOWARD COUNTY DEPARTMENT OF PUBLIC WORKS

[signature] 4-21-06
CHIEF, BUREAU OF HIGHWAYS — DATE

APPROVED: HOWARD COUNTY DEPT. OF PLANNING AND ZONING

[signature] 5/12/06
CHIEF, DIVISION OF LAND DEVELOPMENT — DATE

[signature] 5/2/06
CHIEF, DEVELOPMENT ENGINEERING DIVISION — DATE

**BENCHMARK ENGINEERING, INC.**
ENGINEERS ▲ LAND SURVEYORS ▲ PLANNERS
8480 BALTIMORE NATIONAL PIKE ▲ SUITE 418
ELLICOTT CITY, MARYLAND 21043
phone: 410-465-6105 ▲ fax: 410-465-6644
www.bei-civilengineering.com

[signature] 3/31/06

OWNER/DEVELOPER:
TRINITY QUALITY HOMES, INC.
3675 PARK AVENUE
SUITE 301
ELLICOTT CITY, MD 21043
410-480-0023

PROJECT:
THE CHASE AT STONEY BROOK
LOTS 1–20, PRESERVATION PARCEL "A" AND NON-BUILDABLE PRESERVATION PARCELS "B" THROUGH "D"

LOCATION:
TAX MAP No. 7, BLOCK No. 17, PARCEL No. 133
4th ELECTION DISTRICT
HOWARD COUNTY, MARYLAND

TITLE:
STORM DRAINAGE AREA MAP

DATE: AUGUST, 2005 / MARCH, 2006 — PROJECT NO. 1187

DES: JMC — DRAFT: RPS — CHECK: DAM — SCALE: 1" = 100' — SHEET 7 OF 19

F-05-170

1187\dwg\7025S1.dwg, StormDrainAreaMap, 3/31/2006 2:19:03 PM,
c, Oce TDS600 HDI for mylar.pc3

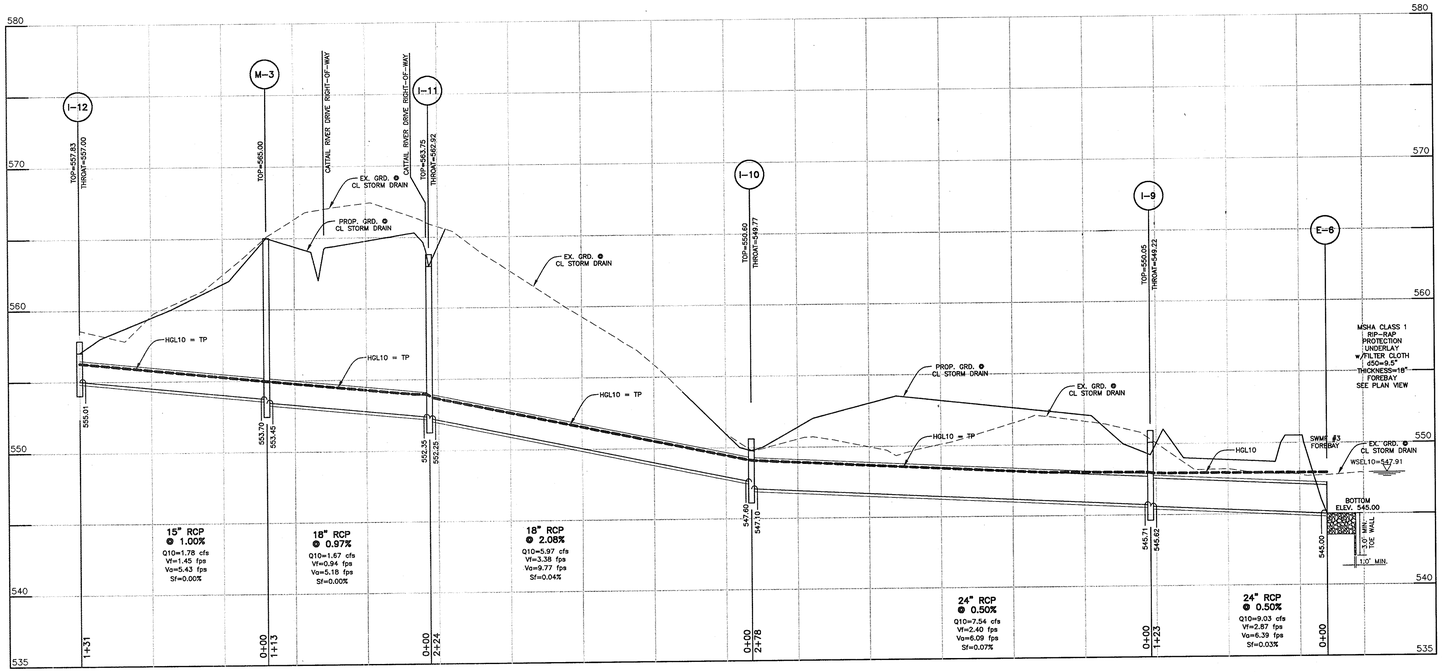


STORM DRAIN RUN E-6 TO I-12

HORIZONTAL SCALE: 1" = 50'
VERTICAL SCALE: 1" = 5'

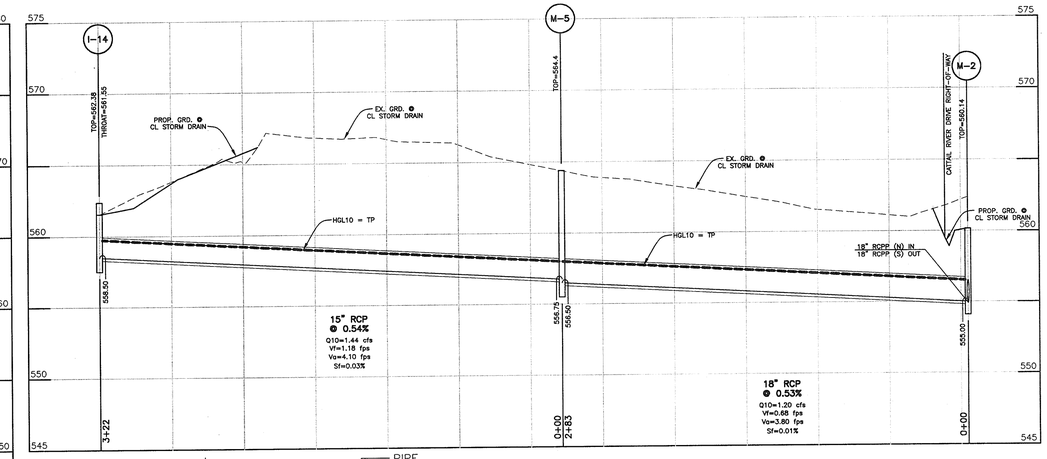


STORM DRAIN RUN M-2 TO I-14

HORIZONTAL SCALE: 1" = 50'
VERTICAL SCALE: 1" = 5'

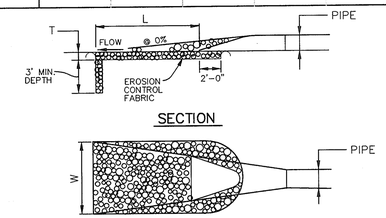


OUTLET PROTECTION DETAIL

NOT TO SCALE

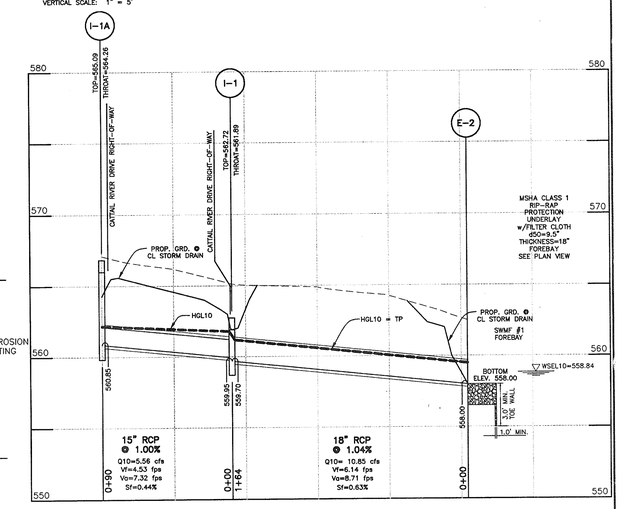


STORM DRAIN RUN E-2 TO I-1A

HORIZONTAL SCALE: 1" = 50'
VERTICAL SCALE: 1" = 5'

## STRUCTURE SCHEDULE

| NO. | TYPE | LOCATION | THROAT INV. | INVERT IN | INVERT OUT | TOP ELEV. | STANDARD | REMARKS |
|---|---|---|---|---|---|---|---|---|
| I-1 | TYPE "D" | STA. 1+49.72 OFF. 8.00' LT. | 561.89 | 559.95 | 559.70 | 562.72 | Ho.Co.STD. SD-4.11 | OPEN 4 SIDES |
| I-1A | TYPE "D" | STA. 2+41.22 OFF. 8.00' LT. | 564.26 | – | 560.85 | 565.09 | Ho.Co.STD. SD-4.11 | OPEN 4 SIDES |
| I-2 | TYPE "D" | STA. 10+55.62 OFF. 17.00' LT. | 560.32 | 550.65/550.40 | 549.91 | 561.15 | Ho.Co.STD. SD-4.11 | OPEN 2 SIDES |
| I-3 | TYPE "D" | STA. 10+55.62 OFF. 17.00' RT. | 560.32 | – | 554.05 | 561.15 | Ho.Co.STD. SD-4.11 | OPEN 2 SIDES |
| I-4 | TYPE "D" | STA. 7+95.30 OFF. 17.00' LT. | 555.57 | 553.25/553.10 | 553.00 | 556.40 | Ho.Co.STD. SD-4.11 | OPEN 2 SIDES |
| I-5 | TYPE "D" | STA. 3+73.35 OFF. 17.50' LT. | 572.70 | 567.10/567.10 | 567.00 | 573.53 | Ho.Co.STD. SD-4.11 | OPEN 2 SIDES |
| I-6 | TYPE "D" | STA. 0+70.69 OFF. 17.00' LT. | 573.35 | 570.66 | 570.41 | 574.18 | Ho.Co.STD. SD-4.11 | OPEN 2 SIDES |
| I-7 | TYPE "D" | STA. 0+70.69 OFF. 17.00' RT. | 573.35 | – | 571.00 | 574.18 | Ho.Co.STD. SD-4.11 | OPEN 2 SIDES |
| I-8 | TYPE "D" | STA. 3+95.30 OFF. 17.00' RT. | 555.57 | – | 553.59 | 556.40 | Ho.Co.STD. SD-4.11 | OPEN 2 SIDES |
| I-9 | TYPE "D" | N 603,582.83 E 1,289,282.13 | 549.22 | 545.71 | 545.62 | 550.05 | Ho.Co.STD. SD-4.11 | OPEN 2 SIDES |
| I-10 | TYPE "D" | N 603,408.33 E 1,289,499.70 | 549.77 | 547.60 | 547.10 | 550.60 | Ho.Co.STD. SD-4.11 | OPEN 2 SIDES |
| I-11 | TYPE "D" | STA. 1+65.74 OFF. 8.00' LT. | 562.92 | 552.35 | 552.25 | 563.75 | Ho.Co.STD. SD-4.11 | OPEN 4 SIDES |
| I-12 | TYPE "D" | N 602,971.22 E 1,289,539.93 | 557.00 | – | 555.01 | 557.83 | Ho.Co.STD. SD-4.11 | OPEN 2 SIDES |
| I-13 | 15' COG | STA. 9+15.30 OFF. 29.27' RT. | 583.33 | – | 579.20 | 584.20 | MD 374.51 | 15' OPENING |
| I-14 | TYPE "D" | N 604,455.39 E 1,288,577.30 | 561.55 | – | 558.50 | 562.38 | Ho.Co.STD. SD-4.11 | OPEN 2 SIDES |
| M-1 | 4'-0" STANDARD | N 602,676.37 E 1,289,007.90 | | 398.92 | 398.82 | 406.60 | Ho.Co.STD. G-5.12 | STANDARD PRECAST MANHOLE |
| M-2 | 4'-0" STANDARD | STA. 6+18.70 OFF. 5.00' LT. | | 555.00/555.00 | 554.90 | 560.14 | Ho.Co.STD. G-5.12 | STANDARD PRECAST MANHOLE |
| M-3 | 4'-0" STANDARD | N 603,078.08 E 1,289,464.88 | | 553.70 | 553.45 | 565.00 | Ho.Co.STD. G-5.12 | STANDARD PRECAST MANHOLE |
| M-4 | 4'-0" STANDARD | STA. 11+56.92 OFF. 27.10' RT. | | 576.70 | 576.45 | 593.26 | MD 383.01 | STANDARD PRECAST MANHOLE |
| M-5 | 4'-0" STANDARD | N 604,155.14 E 1,288,461.68 | | 556.75 | 556.50 | 564.4 | Ho.Co.STD. G-5.12 | STANDARD PRECAST MANHOLE |
| E-1 | TYPICAL CONCRETE | N 603,298.46 E 1,288,320.36 | | – | 554.0 | – | Ho.Co.STD. SD-5.51 | SWM OUTFALL |
| E-2 | TYPICAL RCP | N 603,447.57 E 1,288,193.44 | | – | 558.0 | – | Ho.Co.STD. SD-5.51 | OUTFALL INTO FOREBAY |
| E-3 | TYPICAL CONCRETE | N 602,453.87 E 1,289,192.94 | | – | 534.0 | – | Ho.Co.STD. SD-5.51 | SWM OUTFALL |
| E-4 | TYPICAL CONCRETE | N 603,676.31 E 1,289,300.75 | | – | 540.0 | – | Ho.Co.STD. SD-5.51 | SWM OUTFALL |
| E-5 | TYPICAL RCP | N 603,659.54 E 1,289,168.42 | | – | 545.0 | – | Ho.Co.STD. SD-5.51 | OUTFALL INTO FOREBAY |
| E-6 | TYPICAL RCP | N 603,659.83 E 1,289,186.13 | | – | 545.0 | – | Ho.Co.STD. SD-5.51 | OUTFALL INTO FOREBAY |
| HW-1 | CAST IN PLACE | N 603,986.76 E 1,288,041.43 | | – | 565.87 | 574.5 | Ho.Co.STD. G-5.21 | SEE DETAILS |
| HW-2 | CAST IN PLACE | N 604,032.42 E 1,288,000.00 | | 568.2 | – | 575.7 | Ho.Co.STD. G-5.21 | SEE DETAILS |
| HW-3 | CAST IN PLACE | N 604,292.98 E 1,287,774.84 | | – | 573.9 | 582.0 | -- | SEE DETAILS |
| HW-4 | CAST IN PLACE | N 604,318.57 E 1,287,696.02 | | 576.2 | – | 582.0 | -- | SEE DETAILS |

1) STRUCTURE TOP ELEVATION AND LOCATION FOR MANHOLES IS AT THE TOP AND CENTER OF RIM.
2) STRUCTURE TOP ELEVATION AND LOCATION FOR INLETS IS AT THE TOP, CENTER FACE OF THE INLET FOR CURB INLETS AND AT THE CENTER TOP FOR YARD INLETS.
3) STRUCTURE TOP ELEVATION AND LOCATION FOR END SECTIONS IS AT THE CONNECTION OF PIPE AND END SECTION AT CENTERLINE.
4) STRUCTURE TOP ELEVATION AND LOCATION FOR HEADWALLS IS AT THE MIDPOINT OF THE FACE OF THE MAIN WALL

## PIPE LENGTH SCHEDULE

| SIZE | TYPE | CLASS | TOTAL LENGTH |
|---|---|---|---|
| 15" | RCP | IV | 891' |
| 18" | RCP | IV | 1896' |
| 24" | RCP | IV | 892' |
| 54" | RCP | IV | 120' |
| 48" x 76" | RCP | IV | 70' |

## OUTLET PROTECTION SCHEDULE

| STRUCTURE | D-50 | LENGTH | WIDTH | THICKNESS | SHA CLASS |
|---|---|---|---|---|---|
| E-1 | 9.5" | 14' | 17' | 18" | 1 |
| E-2 | 9.5" | FOREBAY | FOREBAY | 18" | 1 |
| E-3 | 9.5" | 14' | 17' | 18" | 1 |
| E-4 | 9.5" | 44' | 20' | 18" | 1 |
| E-5 | 9.5" | FOREBAY | FOREBAY | 18" | 1 |
| E-6 | 9.5" | FOREBAY | FOREBAY | 18" | 1 |

## PIPE SCHEDULE

| RUN | SIZE | LENGTH | TYPE & CLASS |
|---|---|---|---|
| E-2 TO I-1 | 18" | 164' | RCP CLASS IV |
| I-1 TO I-1A | 15" | 90' | RCP CLASS IV |
| E-5 TO I-2 | 24" | 491' | RCP CLASS IV |
| I-2 TO I-4 | 18" | 260' | RCP CLASS IV |
| I-4 TO M-2 | 18" | 177' | RCP CLASS IV |
| M-2 TO I-5 | 18" | 242' | RCP CLASS IV |
| I-5 TO M-4 | 18" | 345' | RCP CLASS IV |
| M-4 TO I-13 | 15" | 246' | RCP CLASS IV |
| M-2 TO M-5 | 18" | 283' | RCP CLASS IV |
| M-5 TO I-14 | 15" | 322' | RCP CLASS IV |
| I-5 TO I-6 | 18" | 88' | RCP CLASS IV |
| I-6 TO I-7 | 15" | 34' | RCP CLASS IV |
| I-4 TO I-8 | 15" | 34' | RCP CLASS IV |
| I-2 TO I-3 | 15" | 34' | RCP CLASS IV |
| E-6 TO I-9 | 24" | 123' | RCP CLASS IV |
| I-9 TO I-10 | 24" | 278' | RCP CLASS IV |
| I-10 TO I-11 | 18" | 224' | RCP CLASS IV |
| I-11 TO M-3 | 18" | 113' | RCP CLASS IV |
| M-3 TO I-12 | 15" | 131' | RCP CLASS IV |
| HW-1 TO HW-2 | (2) 54" | 60' | RCP CLASS IV |
| HW-3 TO HW-4 | 48" x 76" | 70' | RCP CLASS IV |

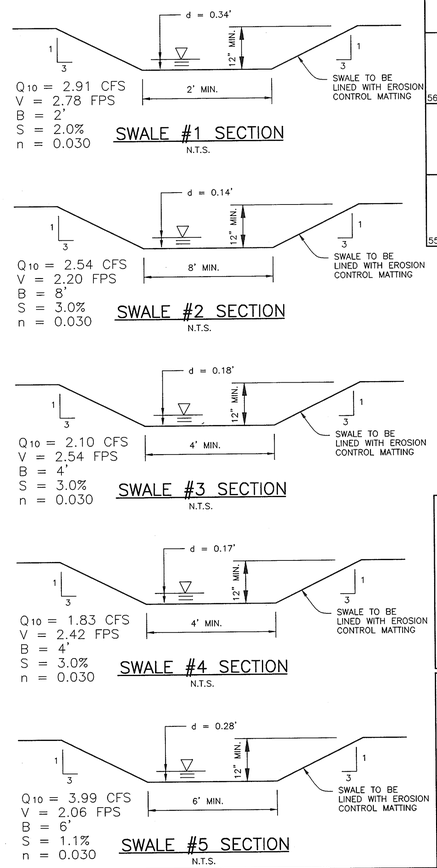


APPROVED: HOWARD COUNTY DEPARTMENT OF PUBLIC WORKS

CHIEF, BUREAU OF HIGHWAYS — DATE 4-21-06

APPROVED: HOWARD COUNTY DEPT. OF PLANNING AND ZONING

CHIEF, DIVISION OF LAND DEVELOPMENT — DATE 5/2/06

CHIEF, DEVELOPMENT ENGINEERING DIVISION — DATE 5/2/06


BENCHMARK
ENGINEERS ▲ LAND SURVEYORS ▲ PLANNERS
ENGINEERING, INC.
8480 BALTIMORE NATIONAL PIKE ▲ SUITE 418
ELLICOTT CITY, MARYLAND 21043
phone: 410-465-6105 ▲ fax: 410-465-6644
www.bei-civilengineering.com


Donald Mason 3/31/06

OWNER/DEVELOPER:
TRINITY QUALITY HOMES, INC.
3675 PARK AVENUE
SUITE 301
ELLICOTT CITY, MD 21043
410-480-0023

PROJECT: THE CHASE AT STONEY BROOK
LOTS 1-20, PRESERVATION PARCEL "A" AND NON-BUILDABLE PRESERVATION PARCELS "B" THROUGH "D"

LOCATION: TAX MAP NO. 7 BLOCK NO. 17 PARCEL NO. 133
4th ELECTION DISTRICT
HOWARD COUNTY, MARYLAND

TITLE: STORM DRAIN PROFILES

DESIGN: JMC | DRAFT: JMC | DATE: AUGUST, 2005 / MARCH, 2006 | PROJECT NO. 1187

SCALE: AS SHOWN | DRAWING 8 OF 19

F-05-170


n:\1187dwg\7044S8_9.dwg, Sheet 8, 3/31/2006 2:20:38 PM,
rmc, Oce TDS600 HDI for mylar.pc3

## DETAIL 25 – ROCK OUTLET PROTECTION I

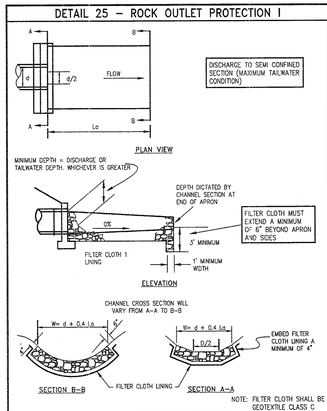


## ROCK OUTLET PROTECTION I

### CONSTRUCTION SPECIFICATIONS

1. The subgrade for the filter, rip-rap, or gabion shall be prepared to the required lines and grades. Any fill required in the subgrade shall be compacted to a density of approximately that of the surrounding undisturbed material.

2. The rock or gravel shall conform to the specified grading limits when installed respectively in the rip-rap or filter.

3. Geotextile shall be protected from punching, cutting, or tearing. Any damage other than an occasional small hole shall be repaired by placing another piece of geotextile over the damaged part or by completely replacing the geotextile. All overlaps whether for repairs or for joining two pieces of geotextile shall be a minimum of one foot.

4. Stone for the rip-rap or gabion outlets may be placed by equipment. They shall be constructed to the full course thickness in one operation and in such a manner as to avoid displacement of underlying materials. The stone for rip-rap or gabion outlets shall be delivered and placed in a manner that will ensure that it is reasonably homogeneous with the smaller stones and spalls filling the voids between the larger stones. Rip-rap shall be placed in a manner to prevent damage to the filter blanket or geotextile. Hand placement will be required to the extent necessary to prevent damage to the permanent works.

5. The stone shall be placed so that it blends in with the existing ground. If the stone is placed too high then the flow will be forced out of the channel and scour adjacent to the stone will occur.

| U.S. DEPARTMENT OF AGRICULTURE SOIL CONSERVATION SERVICE | PAGE F – 18 – 8 | MARYLAND DEPARTMENT OF ENVIRONMENT WATER MANAGEMENT ADMINISTRATION | U.S. DEPARTMENT OF AGRICULTURE SOIL CONSERVATION SERVICE | PAGE F – 18 – 8A | MARYLAND DEPARTMENT OF ENVIRONMENT WATER MANAGEMENT ADMINISTRATION |
|---|---|---|---|---|---|

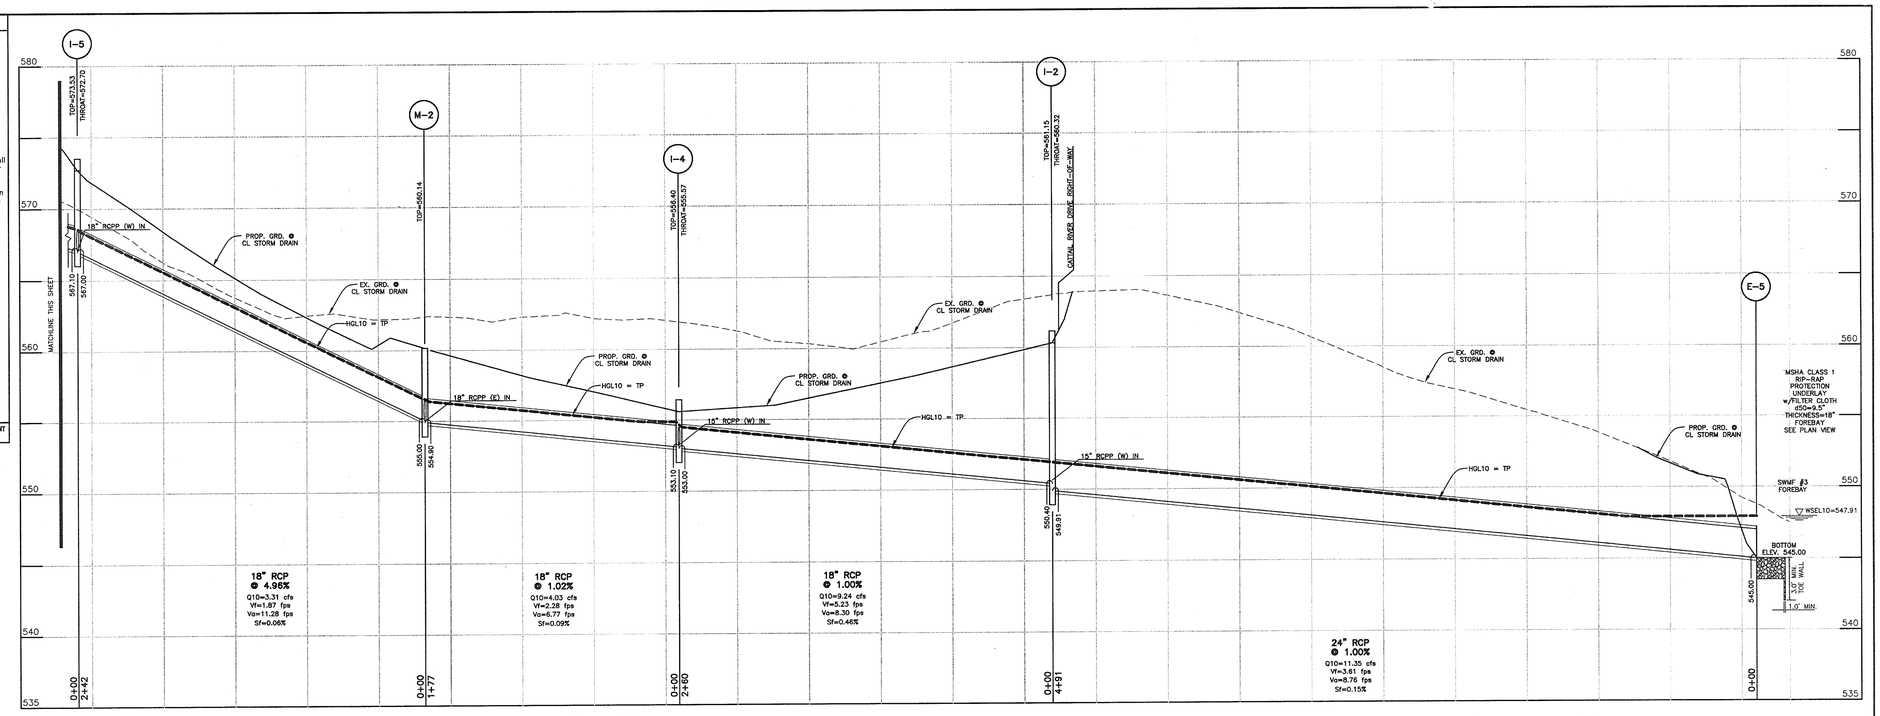


STORM DRAIN RUN E-5 TO I-13
HORIZONTAL SCALE: 1" = 50'
VERTICAL SCALE: 1" = 5'

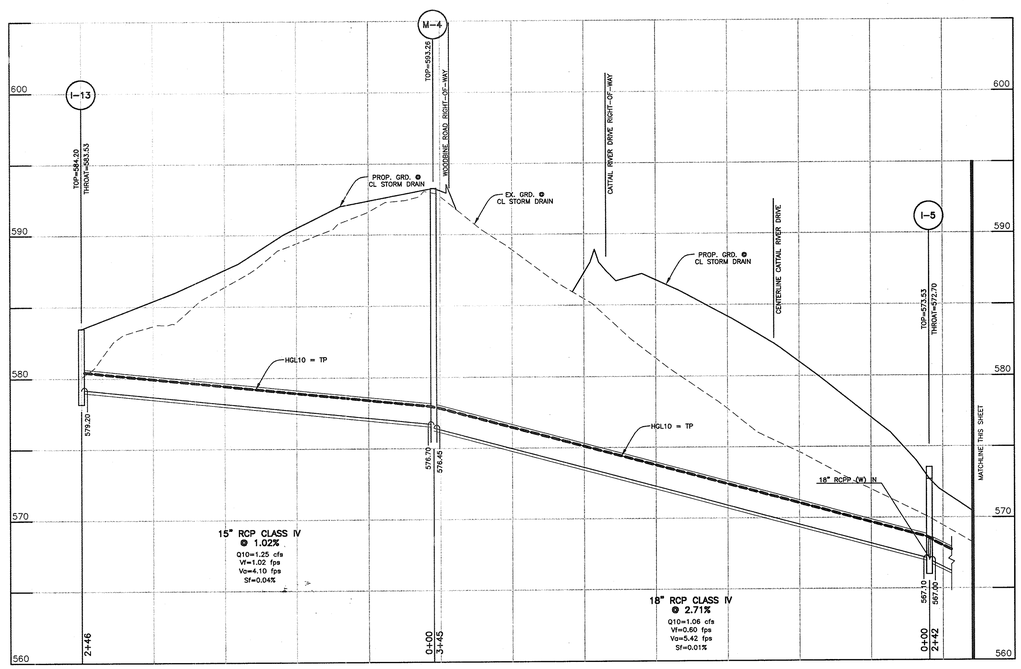


STORM DRAIN RUN E-5 TO I-13
HORIZONTAL SCALE: 1" = 50'
VERTICAL SCALE: 1" = 5'

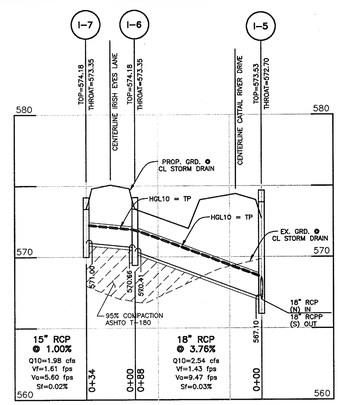


STORM DRAIN RUN I-5 TO I-7
HORIZONTAL SCALE: 1" = 50'
VERTICAL SCALE: 1" = 5'

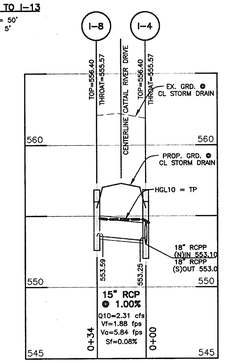


STORM DRAIN RUN I-4 TO I-8
HORIZONTAL SCALE: 1" = 50'
VERTICAL SCALE: 1" = 5'

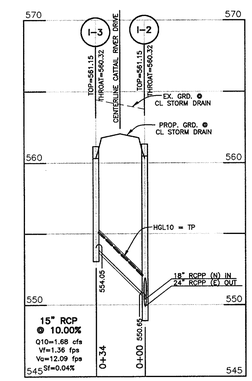


STORM DRAIN RUN I-2 TO I-3
HORIZONTAL SCALE: 1" = 50'
VERTICAL SCALE: 1" = 5'

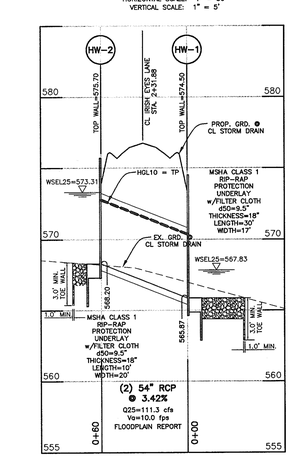


STORM DRAIN RUN HW-1 TO HW-2
HORIZONTAL SCALE: 1" = 50'
VERTICAL SCALE: 1" = 5'

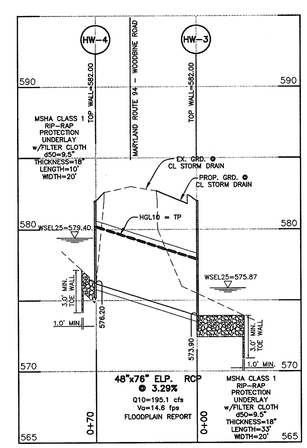


STORM DRAIN RUN HW-3 TO HW-4
HORIZONTAL SCALE: 1" = 50'
VERTICAL SCALE: 1" = 5'

APPROVED: HOWARD COUNTY DEPARTMENT OF PUBLIC WORKS

CHIEF, BUREAU OF HIGHWAYS — DATE 4-21-06

APPROVED: HOWARD COUNTY DEPT. OF PLANNING AND ZONING

CHIEF, DIVISION OF LAND DEVELOPMENT — DATE 5/2/06

CHIEF, DEVELOPMENT ENGINEERING DIVISION — DATE 5/2/06


BENCHMARK
ENGINEERS ▲ LAND SURVEYORS ▲ PLANNERS
ENGINEERING, INC.
8480 BALTIMORE NATIONAL PIKE ▲ SUITE 418
ELLICOTT CITY, MARYLAND 21043
phone: 410-465-6105 ▲ fax: 410-465-6644
www.bei-civilengineering.com


STATE OF MARYLAND — DONALD MOON — REGISTERED PROFESSIONAL ENGINEER — 8/31/06

OWNER/DEVELOPER:

TRINITY QUALITY HOMES, INC.
3675 PARK AVENUE
SUITE 301
ELLICOTT CITY, MD 21043
410-480-0023

PROJECT:
THE CHASE AT STONEY BROOK
LOTS 1-20, PRESERVATION PARCEL "A" AND NON-BUILDABLE PRESERVATION PARCELS "B" THROUGH "D"

LOCATION:
TAX MAP NO. 7 BLOCK NO. 17 PARCEL NO. 133
4th ELECTION DISTRICT
HOWARD COUNTY, MARYLAND

TITLE:
STORM DRAIN PROFILES

DATE: AUGUST, 2005 / MARCH, 2006 — PROJECT NO. 1187

DESIGN: JMC — DRAFT: JMC — SCALE: AS SHOWN — DRAWING 9 OF 19

F-05-170


\1187\dwg\7044S8_9.dwg, Sheet 9, 3/31/2006 2:20:12 PM,
pc, Oce TDS600 HDI for mylar.pc3

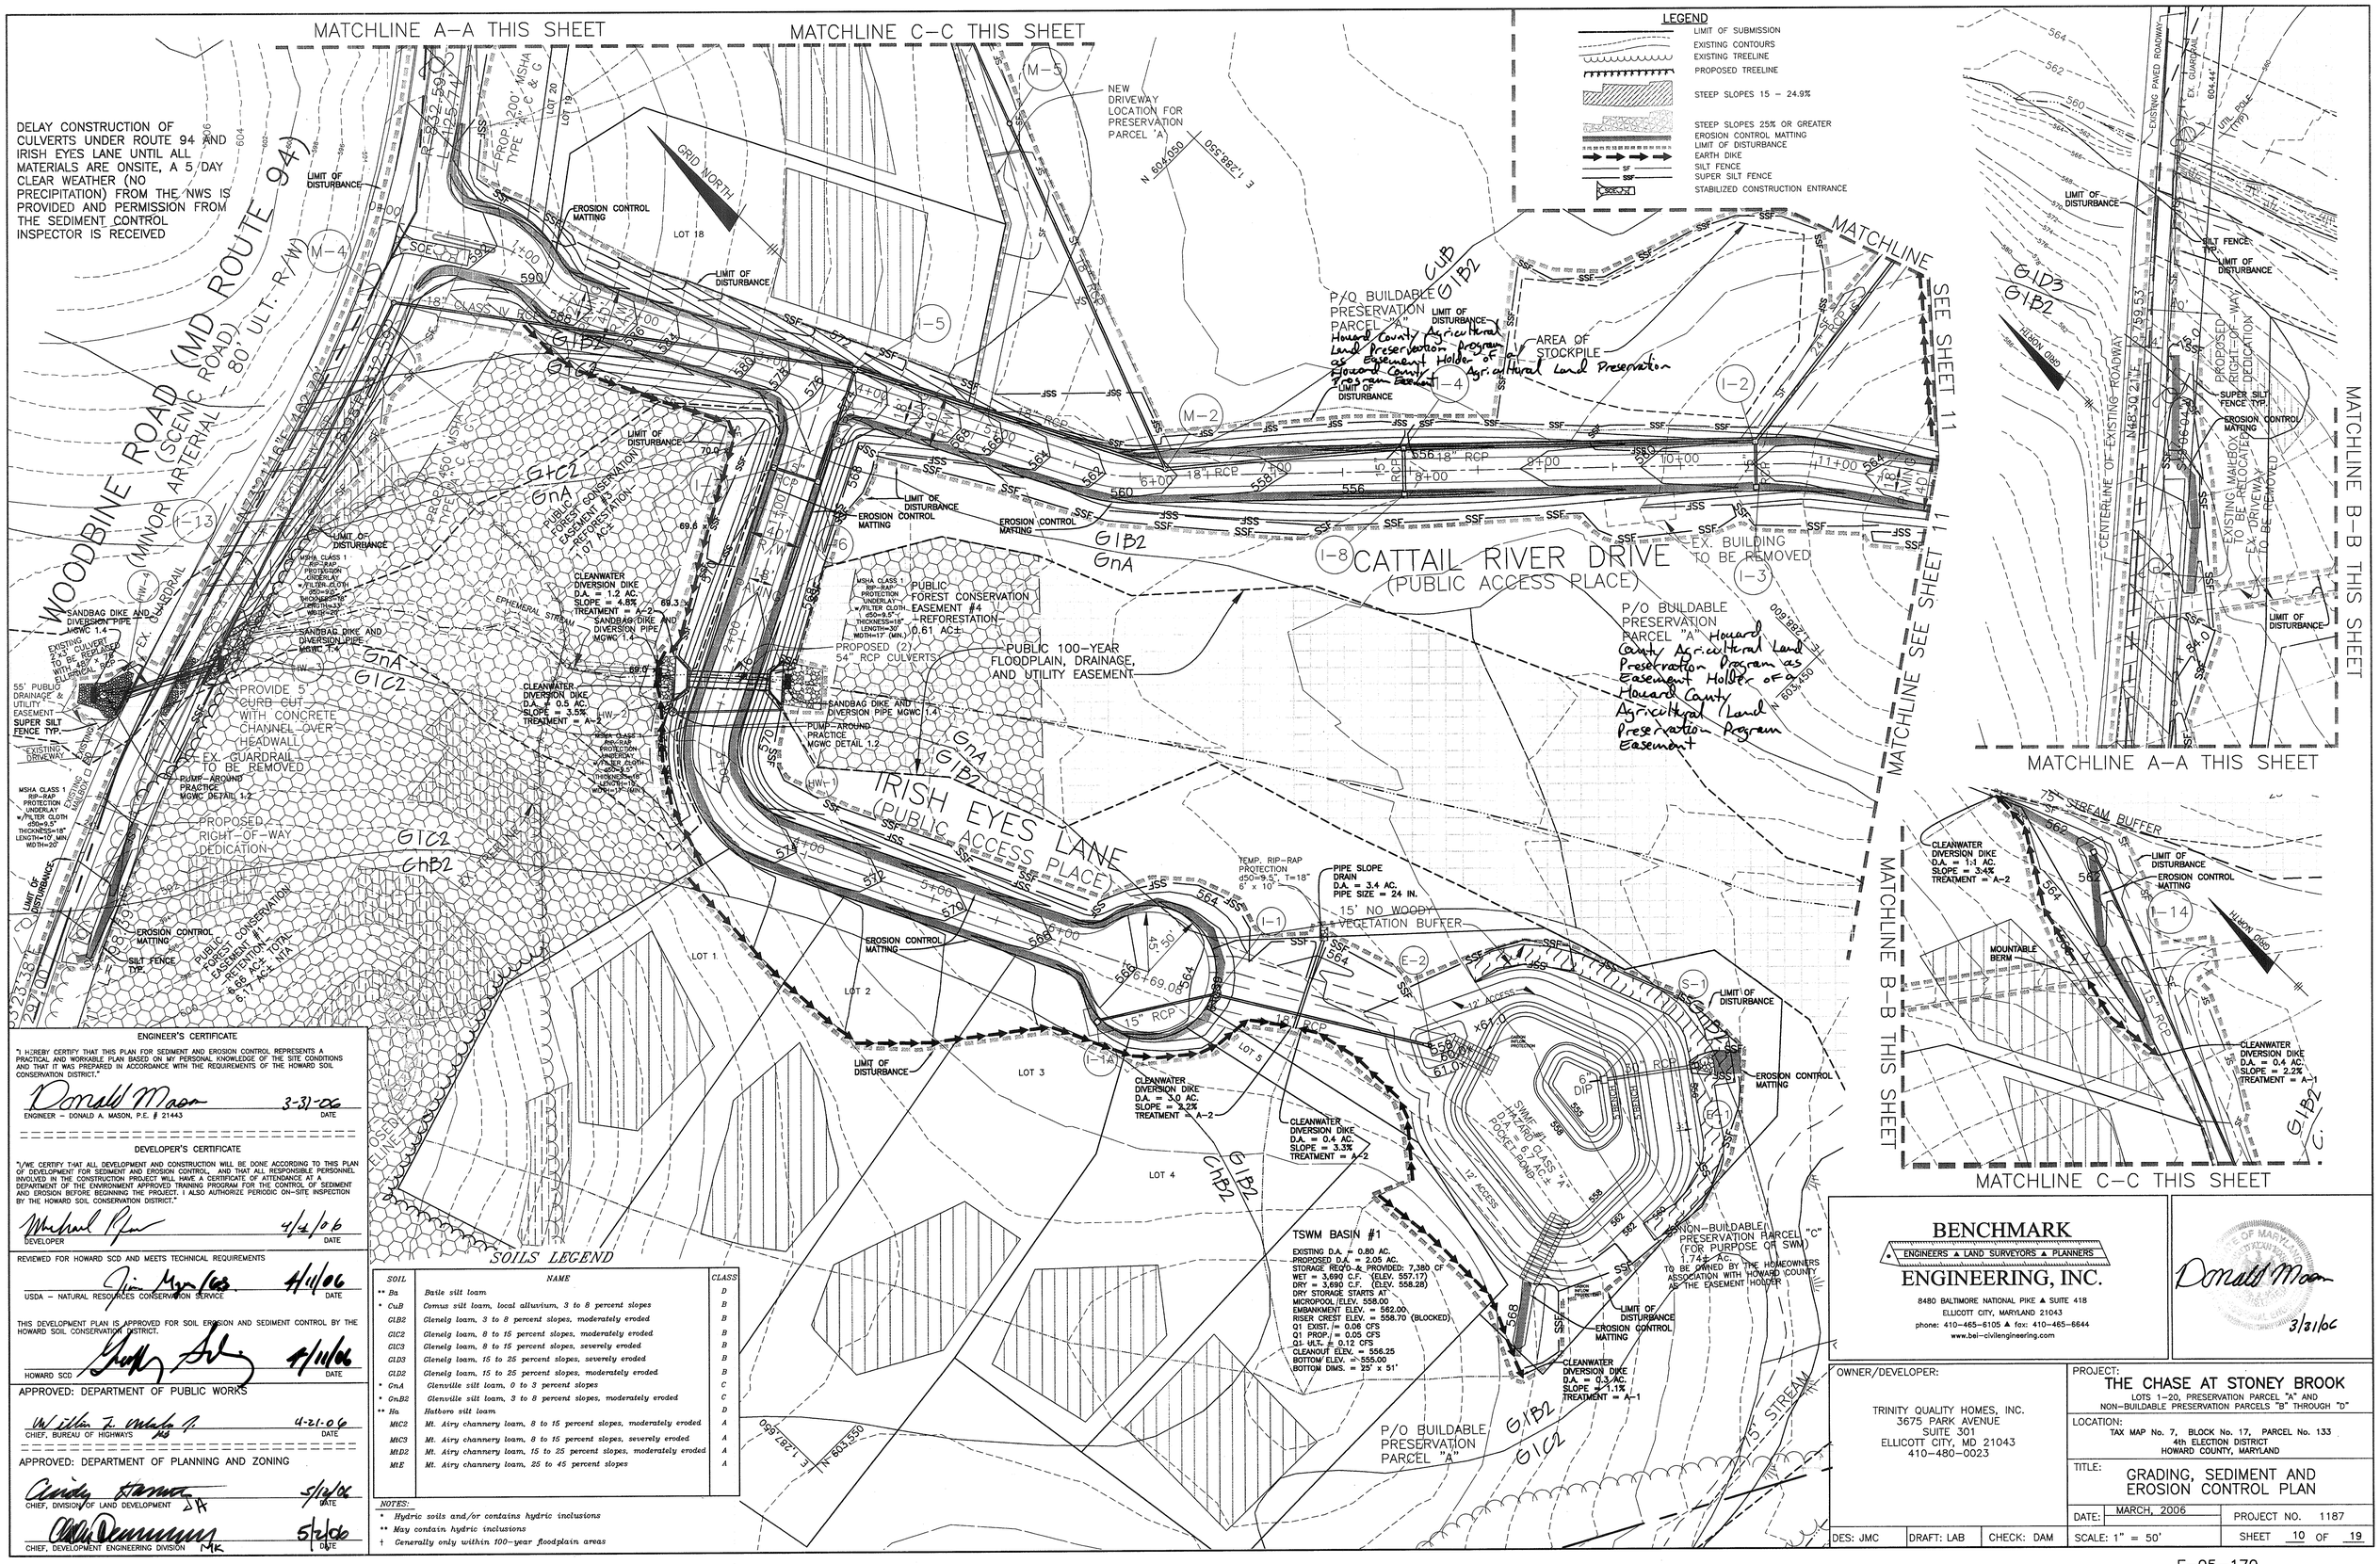


| SOIL | NAME | CLASS |
|---|---|---|
| ** Ba | Baile silt loam | D |
| * CuB | Comus silt loam, local alluvium, 3 to 8 percent slopes | B |
| GlB2 | Glenelg loam, 3 to 8 percent slopes, moderately eroded | B |
| GlC2 | Glenelg loam, 8 to 15 percent slopes, moderately eroded | B |
| GlC3 | Glenelg loam, 8 to 15 percent slopes, severely eroded | B |
| GlD3 | Glenelg loam, 15 to 25 percent slopes, severely eroded | B |
| GlD2 | Glenelg loam, 15 to 25 percent slopes, moderately eroded | B |
| * GnA | Glenville silt loam, 0 to 3 percent slopes | C |
| * GnB2 | Glenville silt loam, 3 to 8 percent slopes, moderately eroded | C |
| ** Ha | Hatboro silt loam | D |
| MtC2 | Mt. Airy channery loam, 8 to 15 percent slopes, moderately eroded | A |
| MtC3 | Mt. Airy channery loam, 8 to 15 percent slopes, severly eroded | A |
| MtD2 | Mt. Airy channery loam, 15 to 25 percent slopes, moderately eroded | A |
| MtE | Mt. Airy channery loam, 25 to 45 percent slopes | A |

NOTES:
* Hydric soils and/or contains hydric inclusions
** May contain hydric inclusions
† Generally only within 100-year floodplain areas

ENGINEER'S CERTIFICATE

"I HEREBY CERTIFY THAT THIS PLAN FOR SEDIMENT AND EROSION CONTROL REPRESENTS A PRACTICAL AND WORKABLE PLAN BASED ON MY PERSONAL KNOWLEDGE OF THE SITE CONDITIONS AND THAT IT WAS PREPARED IN ACCORDANCE WITH THE REQUIREMENTS OF THE HOWARD SOIL CONSERVATION DISTRICT."

Donald Mason — 3-31-06
ENGINEER – DONALD A. MASON, P.E. # 21443 — DATE

DEVELOPER'S CERTIFICATE

"I/WE CERTIFY THAT ALL DEVELOPMENT AND CONSTRUCTION WILL BE DONE ACCORDING TO THIS PLAN OF DEVELOPMENT FOR SEDIMENT AND EROSION CONTROL, AND THAT ALL RESPONSIBLE PERSONNEL INVOLVED IN THE CONSTRUCTION PROJECT WILL HAVE A CERTIFICATE OF ATTENDANCE AT A DEPARTMENT OF THE ENVIRONMENT APPROVED TRAINING PROGRAM FOR THE CONTROL OF SEDIMENT AND EROSION BEFORE BEGINNING THE PROJECT. I ALSO AUTHORIZE PERIODIC ON-SITE INSPECTION BY THE HOWARD SOIL CONSERVATION DISTRICT."

Michael Ryan — 4/4/06
DEVELOPER — DATE

REVIEWED FOR HOWARD SCD AND MEETS TECHNICAL REQUIREMENTS

Jim Myers — 4/11/06
USDA – NATURAL RESOURCES CONSERVATION SERVICE — DATE

THIS DEVELOPMENT PLAN IS APPROVED FOR SOIL EROSION AND SEDIMENT CONTROL BY THE HOWARD SOIL CONSERVATION DISTRICT.

4/11/06
HOWARD SCD — DATE

APPROVED: DEPARTMENT OF PUBLIC WORKS

William F. Mello P.E. — 4-21-06
CHIEF, BUREAU OF HIGHWAYS — DATE

APPROVED: DEPARTMENT OF PLANNING AND ZONING

5/2/06
CHIEF, DIVISION OF LAND DEVELOPMENT — DATE

5/2/06
CHIEF, DEVELOPMENT ENGINEERING DIVISION — DATE

BENCHMARK
ENGINEERS ▲ LAND SURVEYORS ▲ PLANNERS
ENGINEERING, INC.
8480 BALTIMORE NATIONAL PIKE ▲ SUITE 418
ELLICOTT CITY, MARYLAND 21043
phone: 410-465-6105 ▲ fax: 410-465-6644
www.bei-civilengineering.com

Donald Mason — 3/31/06

OWNER/DEVELOPER:
TRINITY QUALITY HOMES, INC.
3675 PARK AVENUE
SUITE 301
ELLICOTT CITY, MD 21043
410-480-0023

PROJECT:
THE CHASE AT STONEY BROOK
LOTS 1–20, PRESERVATION PARCEL "A" AND NON-BUILDABLE PRESERVATION PARCELS "B" THROUGH "D"

LOCATION:
TAX MAP No. 7, BLOCK No. 17, PARCEL No. 133
4th ELECTION DISTRICT
HOWARD COUNTY, MARYLAND

TITLE:
GRADING, SEDIMENT AND EROSION CONTROL PLAN

DATE: MARCH, 2006 | PROJECT NO. 1187
DES: JMC | DRAFT: LAB | CHECK: DAM | SCALE: 1" = 50' | SHEET 10 OF 19

F-05-170

P:\1187\dwg\7026S1.dwg, SHEET 10, 3/31/2006 2:02:31 PM,

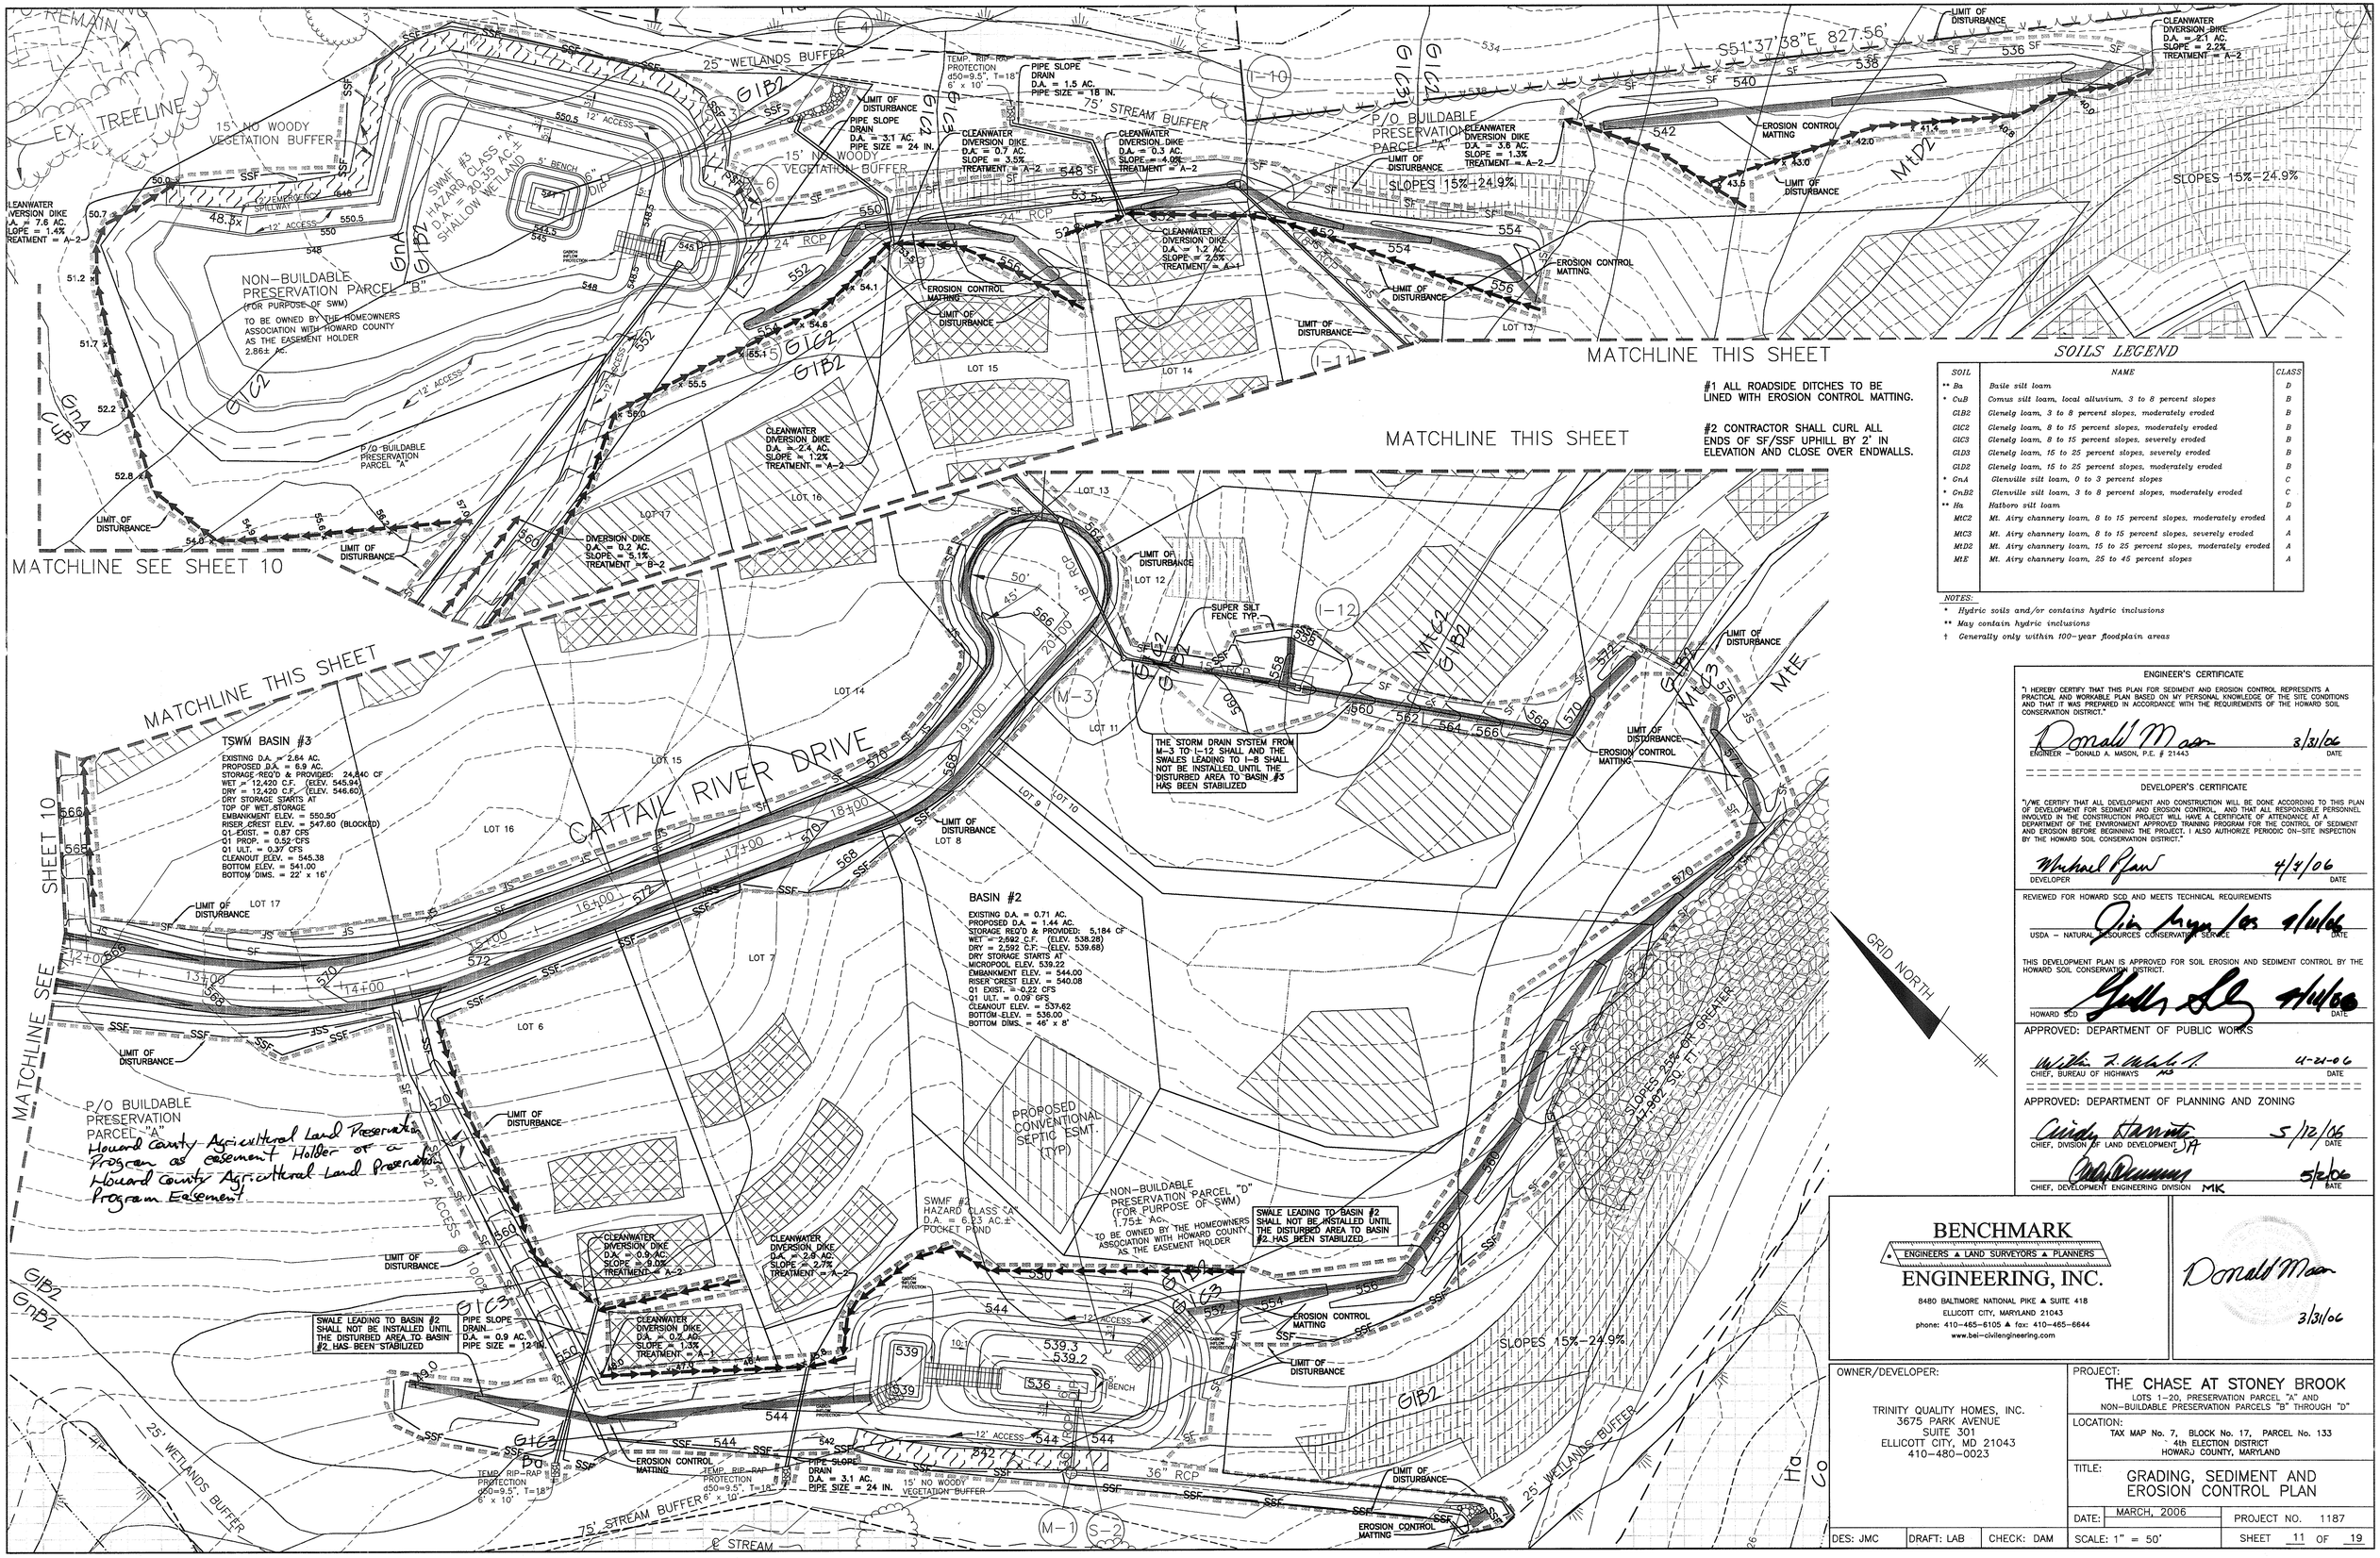


#1 ALL ROADSIDE DITCHES TO BE LINED WITH EROSION CONTROL MATTING.

#2 CONTRACTOR SHALL CURL ALL ENDS OF SF/SSF UPHILL BY 2' IN ELEVATION AND CLOSE OVER ENDWALLS.

## SOILS LEGEND

| SOIL | NAME | CLASS |
|---|---|---|
| ** Ba | Baile silt loam | D |
| * CuB | Comus silt loam, local alluvium, 3 to 8 percent slopes | B |
| GlB2 | Glenelg loam, 3 to 8 percent slopes, moderately eroded | B |
| GlC2 | Glenelg loam, 8 to 15 percent slopes, moderately eroded | B |
| GlC3 | Glenelg loam, 8 to 15 percent slopes, severely eroded | B |
| GlD3 | Glenelg loam, 15 to 25 percent slopes, severely eroded | B |
| GlD2 | Glenelg loam, 15 to 25 percent slopes, moderately eroded | B |
| * GnA | Glenville silt loam, 0 to 3 percent slopes | C |
| * GnB2 | Glenville silt loam, 3 to 8 percent slopes, moderately eroded | C |
| ** Ha | Hatboro silt loam | D |
| MtC2 | Mt. Airy channery loam, 8 to 15 percent slopes, moderately eroded | A |
| MtC3 | Mt. Airy channery loam, 8 to 15 percent slopes, severely eroded | A |
| MtD2 | Mt. Airy channery loam, 15 to 25 percent slopes, moderately eroded | A |
| MtE | Mt. Airy channery loam, 25 to 45 percent slopes | A |

NOTES:

* Hydric soils and/or contains hydric inclusions

** May contain hydric inclusions

† Generally only within 100-year floodplain areas

### ENGINEER'S CERTIFICATE

"I HEREBY CERTIFY THAT THIS PLAN FOR SEDIMENT AND EROSION CONTROL REPRESENTS A PRACTICAL AND WORKABLE PLAN BASED ON MY PERSONAL KNOWLEDGE OF THE SITE CONDITIONS AND THAT IT WAS PREPARED IN ACCORDANCE WITH THE REQUIREMENTS OF THE HOWARD SOIL CONSERVATION DISTRICT."

Donald Mason — 3/31/06
ENGINEER – DONALD A. MASON, P.E. # 21443 — DATE

### DEVELOPER'S CERTIFICATE

"I/WE CERTIFY THAT ALL DEVELOPMENT AND CONSTRUCTION WILL BE DONE ACCORDING TO THIS PLAN OF DEVELOPMENT FOR SEDIMENT AND EROSION CONTROL, AND THAT ALL RESPONSIBLE PERSONNEL INVOLVED IN THE CONSTRUCTION PROJECT WILL HAVE A CERTIFICATE OF ATTENDANCE AT A DEPARTMENT OF THE ENVIRONMENT APPROVED TRAINING PROGRAM FOR THE CONTROL OF SEDIMENT AND EROSION BEFORE BEGINNING THE PROJECT. I ALSO AUTHORIZE PERIODIC ON-SITE INSPECTION BY THE HOWARD SOIL CONSERVATION DISTRICT."

Michael Pfaff — 4/4/06
DEVELOPER — DATE

REVIEWED FOR HOWARD SCD AND MEETS TECHNICAL REQUIREMENTS

Jim Myers — 4/11/06
USDA – NATURAL RESOURCES CONSERVATION SERVICE — DATE

THIS DEVELOPMENT PLAN IS APPROVED FOR SOIL EROSION AND SEDIMENT CONTROL BY THE HOWARD SOIL CONSERVATION DISTRICT.

4/11/06
HOWARD SCD — DATE

APPROVED: DEPARTMENT OF PUBLIC WORKS

4-21-06
CHIEF, BUREAU OF HIGHWAYS — DATE

APPROVED: DEPARTMENT OF PLANNING AND ZONING

5/12/06
CHIEF, DIVISION OF LAND DEVELOPMENT — DATE

5/12/06
CHIEF, DEVELOPMENT ENGINEERING DIVISION — DATE


BENCHMARK
ENGINEERS ▲ LAND SURVEYORS ▲ PLANNERS
ENGINEERING, INC.
8480 BALTIMORE NATIONAL PIKE ▲ SUITE 418
ELLICOTT CITY, MARYLAND 21043
phone: 410-465-6105 ▲ fax: 410-465-6644
www.bei-civilengineering.com


Donald Mason
3/31/06

OWNER/DEVELOPER:
TRINITY QUALITY HOMES, INC.
3675 PARK AVENUE
SUITE 301
ELLICOTT CITY, MD 21043
410-480-0023

PROJECT:
THE CHASE AT STONEY BROOK
LOTS 1-20, PRESERVATION PARCEL "A" AND NON-BUILDABLE PRESERVATION PARCELS "B" THROUGH "D"

LOCATION:
TAX MAP No. 7, BLOCK No. 17, PARCEL No. 133
4th ELECTION DISTRICT
HOWARD COUNTY, MARYLAND

TITLE:
GRADING, SEDIMENT AND EROSION CONTROL PLAN

| DES: JMC | DRAFT: LAB | CHECK: DAM | DATE: MARCH, 2006 | PROJECT NO. 1187 |
|---|---|---|---|---|
| | | | SCALE: 1" = 50' | SHEET 11 OF 19 |

F-05-170

P:\1187dwg\7026S1.dwg, SHEET 11, 3/31/2006 2:03:01 PM,
Inc, Oce TDS600 HDI for mylar.pc3

# TOPSOIL SPECIFICATIONS

I. Topsoil salvaged from the existing site may be used provided that it meets that standards as set forth in these specifications. Typically, the depth of topsoil to be salvaged for a given soil type can be found in the representative soil profile section in the Soil Survey published by USDA-SCS in cooperation with Maryland Agricultural Experimental Station.

II. Topsoil Specifications – Soil to be used as topsoil must meet the following:

I. Topsoil shall be a loam, sandy loam, clay loam, silt loam, sandy clay loam, loamy sand. Other soils may be used if recommended by an agronomist or soil scientist and approved by the appropriate approval authority. Regardless, topsoil shall not be a mixture of contrasting texture subsoils and shall contain less than 5% by volume of cinders, stones, slag, coarse fragments, gravel, sticks, roots, trash, or other materials larger than 1-1/2" in diameter.

ii. Topsoil must be free of plants or plant parts such as Bermuda grass, quack grass, Johnson grass, nutsedge, poison ivy, thistle, or others as specified.

iii. Where the subsoil is either highly acidic or composed of heavy clays, ground limestone shall be spread at the rate of 4-8 tons/acre (200-400 pounds per 1,000 square feet) prior to the placement of topsoil. Lime shall be distributed uniformly over designated areas and worked into the soil in conjunction with tillage operations as described in the following procedures.

III. For sites having disturbed areas under 5 acres:

I. Place topsoil (if required) and apply soil amendments as specified in 20.0 Vegetative Stabilization – Section I – Vegetative Stabilization Methods and Materials.

IV. For sites having disturbed areas over 5 acres:

I. On soil meeting Topsoil specifications, obtain test results dictating fertilizer and lime amendments required to bring the soil into compliance with the following:

a. pH for topsoil shall be between 6.0 and 7.5. If the tested soil demonstrates a pH of less than 6.0, sufficient lime shall be prescribed to raise the pH to 6.5 or higher.

b. Organic content or topsoil shall be not less than 1.5 percent by weight.

c. Topsoil having soluble salt content greater than 500 parts per million shall not be used.

d. No sod or seed shall be placed on soil which has been treated with soil sterilants or chemicals used for weed control until sufficient time has elapsed (14 days min.) to permit dissipation of phyto-toxic materials.

Note: Topsoil substitutes or amendments, as recommended by a qualified agronomist or soil scientist and approved by the appropriate approval authority, may be used in lieu of natural topsoil.

ii. Place topsoil (if required) and apply soil amendments as specified in 20.0 Vegetative Stabilization – Section I – Vegetative Stabilization Methods and Materials.

V. Topsoil Application

I. When topsoiling, maintain needed erosion and sediment control practices such as diversions, grade stabilization structures, earth dikes, slope silt fence and sediment traps and basins.

ii. Grades on the areas to be topsoiled, which have been previously established, shall be maintained, albeit 4" – 8" higher in elevation.

iii. Topsoil shall be uniformly distributed in a 4" – 8" layer and lightly compacted to a minimum thickness of 4". Spreading shall be performed in such a manner that sodding or seeding can proceed with a minimum of additional soil preparation and tillage. Any irregularities in the surface resulting from topsoiling or other operations shall be corrected in order to prevent the formation of depressions or water pockets.

iv. Topsoil shall not be placed while the topsoil or subsoil is in a frozen or muddy condition, when the subsoil is excessively wet or in a condition that may otherwise be detrimental to proper grading and seedbed preparation.

VI. Alternative for Permanent Seeding – Instead of applying the full amounts of lime and commercial fertilizer, composted sludge and amendments may be applied as specified below:

I. Composted Sludge Material for use as a soil conditioner for sites having distributed areas over 5 acres shall be tested to prescribe amendments and for sites having disturbed areas under 5 acres shall conform to the following requirements:

a. Composted sludge shall be supplied by, or originate from, a person or persons that are permitted (at the time of acquisition of the compost) by the Maryland Department of the Environment under COMAR 26.04.06.

b. Composted sludge shall contain at least 1 percent nitrogen, 1.5 percent phosphorus, and 0.2 percent potassium and have a pH of 7.0 to 8.0. If compost does not meet these requirements, the appropriate constituents must be added to meet the requirements prior to use.

c. Composted sludge shall be applied at a rate of 1 ton/1,000 square feet.

iv. Composted sludge shall be amended with a potassium fertilizer applied at the rate of 4 lb/1,000 square feet, and 1/3 the normal lime application rate.

References: Guidelines Specifications, Soil Preparation and Sodding. MD-VA, Pub. #1, Cooperative Extension Service, University of Maryland and Virginia Polytechnic Institutes, Revised 1973.

# SEQUENCE OF CONSTRUCTION

NOTIFY SEDIMENT CONTROL DIVISION 48 HOURS PRIOR TO START OF CONSTRUCTION

1. OBTAIN GRADING PERMIT AND MSHA ACCESS PERMIT. OBTAIN MDE PERMIT PRIOR TO ANY DISTURBANCES IN REGULATED AREAS. (DAY 1)
2. INSTALL STABILIZED CONSTRUCTION ENTRANCE, TREE PROTECTION FENCES, SUPER SILT FENCES, SILT FENCES AND TEMPORARY CLEANWATER DIVERSION DIKES. RELOCATE UTILITY POLES ALONG ROUTE 94. (DAY 2–12)
3. UPON APPROVAL OF THE HOWARD COUNTY SEDIMENT CONTROL INSPECTOR, INSTALL THE ELLIPTICAL (ROUTE 94) AND 54" CULVERTS DURING A 5-DAY CLEAR WEATHER FORECAST FROM NWS. CLOSE SSF OVER ENDWALLS. (DAY 13–17)
4. INSTALL SEDIMENT BASINS. (DAY 17–45)
5. INSTALL ANY REMAINING SEDIMENT CONTROL DEVICES. (DAY 46–50)
6. UPON APPROVAL OF THE HOWARD COUNTY SEDIMENT CONTROL INSPECTOR, BRING ROAD BEDS TO SUBGRADE AND STABILIZE SLOPES IN ACCORDANCE WITH TEMPORARY SEEDBED NOTES. UTILIZE DUST CONTROL METHODS. (DAY 51–81)
7. UPON APPROVAL OF THE HOWARD COUNTY SEDIMENT CONTROL INSPECTOR, INSTALL STORM DRAINS. THE STORM DRAIN SYSTEMS FROM M-3 TO I-12 AND THE SWALES THAT DRAINS TO POND #2 SHALL NOT BE INSTALLED AT THIS TIME. (DAY 82–112)
8. PAVE ROADWAYS. (DAY 113–128)
9. COMPLETE GRADING OF SITE AND STABLIZE DISTURBED AREAS IN ACCORDANCE WITH THE PERMANENT SEEDBED NOTES. (DAY 129–144)
10. UPON APPROVAL OF THE HOWARD COUNTY SEDIMENT CONTROL INSPECTOR, INSTALL THE STORM DRAINS FROM M-3 TO I-12 AND THE SWALES THAT DRAIN TO POND #2. (DAY 145–147)
11. UPON APPROVAL OF THE HOWARD COUNTY SEDIMENT CONTROL INSPECTOR, CONVERT SEDIMENT BASINS TO STORMWATER MANAGEMENT FACILITIES. SHAPE FACILITIES PER FINAL GRADES SHOWN ON THE PLANS AND STABILIZE DISTURBED AREAS IN ACCORDANCE WITH THE PERMANENT SEEDBED NOTES. CONTRACTOR SHALL REMOVE ALL OLD AND NEW TRASH, JUNK AND DEBRIS FROM ENTIRE SITE. (DAY 148–153)
12. UPON APPROVAL OF THE HOWARD COUNTY SEDIMENT CONTROL INSPECTOR, REMOVE REMAINING SEDIMENT CONTROL DEVICES, WITH THE EXCEPTION OF THE CLEANWATER DIVERSION DIKES, AND STABILIZED DISTURBED AREAS IN ACCORDANCE WITH THE PERMANENT SEEDBED NOTES. (DAY 154–161)
13. ONCE ALL PONDS ARE COMPLETE AND DISTURBED AREAS ARE STABILIZED REMOVE CLEANWATER DIVERSION DIKES. (DAY 162–170)

# 30.0 DUST CONTROL

Definition

Controlling dust blowing and movement on construction sites and roads.

Purpose

To prevent blowing and movement of dust from exposed soil surfaces, reduce on and off-site damage, health hazards, and improve traffic safety.

Conditions Where Practice Applies

This practice is applicable to areas subject to dust blowing and movement where on and off-site damage is likely without treatment.

Specifications

Temporary Methods
1. Mulches – See standards for vegetative stabilization with mulches only. Mulch should be crimped or tracked to prevent blowing.
2. Vegetative Cover – See standards for temporary vegetative cover.
3. Tillage – To roughen surface and bring clods to the surface. This is an emergency measure which should be used before soil blowing starts. Begin plowing on windward side of site. Chisel-type plows spaced about 12" apart, spring-toothed harrows, and similiar plows are examples of equipment which may produce the desired effect.
4. Irrigation – This is generally done as an emergency treatment. Site is sprinkled with water until the surface is moist. Repeat as needed. At no time should the site be irrigated to the point that runoff begins to flow.
5. Barriers – Solid board fences, silt fences, snow fences, burlap fences, straw bales, and similiar material can be used to control air currents and soil blowing. Barriers placed at right angles to prevailing currents at intervals of about 10 times their height are effective in controlling soil blowing.
6. Calcium Chloride – Apply at rates that will keep surface moist. May need retreatment.

Permanent Methods
1. Permanent Vegetation – See standards for permanent vegetative cover, and permanent stabilization with sod. Existing trees or large shrubs may afford valuable protection if left in place.
2. Topsoiling – Covering with less erosive soil materials. See standards for topsoiling.
3. Stone – Cover surface with crushed stone or coarse gravel.

References
1. Agriculture Handbook 346. Wind Erosion Forces in the United States and Their Use in Predicting Soil Loss.
2. Agriculture Information Bulletin 354. How to Control Wind Erosion, USDA-ARS.

## BEST MANAGEMENT PRACTICES FOR WORKING IN NONTIDAL WETLANDS AND WATERS OF THE STATE

1) NO EXCESS FILL, CONSTRUCTION MATERIAL, OR DEBRIS SHALL BE STOCKPILES OR STORED IN NONTIDAL WETLANDS, THE NONTIDAL WETLAND BUFFER, OR WATERS OF THE STATE.
2) PLACE MATERIALS IN A LOCATION AND MANNER THAT DOES NOT ADVERSLY IMPACT SURFACE OR SUBSURFACE WATER FLOW INTO OR OUR OF NONTIDAL WETLANDS OR WATERS OF THE STATE.
3) DO NOT USE EXCAVATED MATERIAL AS BACKFILL IF IT CONTAINS WASTE METAL PRODUCTS, UNSIGHTLY DEBRIS, TOXIC MATERIAL, OR ANY OTHER DELETERIOUS SUBSTANCE. IF ADDITAIONSL BACKFILL IS REQUIRED, USE CLEAN MATERIAL FREE OF WASTE METAL PRODUCTS, UNSIGHTLY DEBRIS, TOXIC MATERIAL, OR ANY OTHER DELETERIOUS SUBSTANCE.
4) PLACE HEAVY EQUIPMENT ON MATS OR SUITABLY OPERATE TEH EQUIPMENT TO PREVENT DAMAGE TO NONTIDAL WETLANDS, THE NONTIDAL WETLAND BUFFER, AND WATERS OF THE STATE.
5) REPAIR AND MAINTAIN ANY SERVICEABLE STRUCTURE OR FILL SO THERE IS NO PERMENANT LOSS OF NONTIDAL WETLANDS OR PERMANENT MODIFICATION OF WATERS OF THE STATE IN EXCESS OF THAT LOST UNDER THE ORIGINALLY AUTHORIZED STRUCTURE OR FILL.
6) RECTIFY ANY NONTIDAL WETLANDS, NONTIDAL WETLANDS BUFFER, OR WATERS OF THE STATE TEMPORARILY IMPACTED BY ANY CONSTRUCTIO9IN RELATED ACTIVITIES.
7) SEED MIX USED FOR STABILIZATION IN NONTIDAL WETLANDS AND THE NONTIDAL WETLAND BUFFER SHALL CONSIST OF ONE OR MORE OF THE FOLLOWING SPECIES: ANNUAL RYEGRASS (Lolium multiflorum), MILLET (Setaria italica), BARLEY (Hordeum sp.), OATS (Uniola sp.), AND/OR RYE (Secale cereale). THESE SPECIES WILL ALLOW FOR STABILIZATION OF THE SITE WHILE ALSO ALLOWING OF THE VOLUNARY REVEGETATION OF NATIVE WETLAND SPECIES. OTHER NONPERSISENT VEGETAION MAY BE ACCEPTABLE BUT MUST BE APPROVED BY THE NONTIDAL WETLANDS AND WATERWAYS DIVISION. KENTUCKY 31 FESCUE SHALL NOT BE USED IN NONTIDAL WETLAND OR NONTIDAL WETLAND BUFFER AREAS. THE AREA SHOULD BE SEEDED AND MULCHED TO REDUCE EROSION AFTER CONSTRUCTION ACTIVITIES HAVE BEEN COMPLETED.
8) AFTER INSTALLATION OF UNDERGROUND UTILITY LINES IN NONTIDAL WETLANDS AND WATERS OF THE STATE HAS BEEN COMPLETED, GRADES AND ELEVATIONS SHALL BE RETURNED TO PRE-CONSTRUCTION CONDITIONS.
9) TO PROTECT AQUADIC SPECIES, IN STREAM WORK IS PROHIBITED AS DETERMINED BY THE CLASSIFICATION OF STREAM:

USE III WATERS: IN-STREAM WORK SHALL NOT BE CONDUCTED DURING THE PERIOD OCTOBER 1 THROUGH APRIL 30, INCLUSIVE, DURING ANY YEAR.

10) STORMWATER RUNOFF FROM IMPERVIOUS SURFACES SHALL BE CONTROLLED TO PREVENT THE DISCHARGE OF POLLUTANTS INTO NONTIDAL WETLANDS AND WATERWAYS.
11) CULVERTS AND ASSOCIATED RIPRAP EROSION PROTECTION SHALL BE CONSTRUCTED SO AS NOT TO OBSTRUCT THE MOVEMENT OF AQUATIC SPECIES, UNLESS THE PURPOSE OF THE ACTIVITY IS TO IMPOUND WATER.

# SEDIMENT CONTROL NOTES

1. A MINIMUM OF 24 HOURS NOTICE MUST BE GIVEN TO THE HOWARD COUNTY DEPARTMENT OF INSPECTION, LICENSES AND PERMITS, SEDIMENT CONTROL DIVISION PRIOR TO THE START OF ANY CONSTRUCTION, (313-1850).
2. ALL VEGETATIVE AND STRUCTURAL PRACTICES ARE TO BE INSTALLED ACCORDING TO THE PROVISIONS OF THIS PLAN AND ARE TO BE IN CONFORMANCE WITH THE MOST CURRENT "MARYLAND STANDARDS AND SPECIFICATION FOR SOIL EROSION AND SEDIMENT CONTROL", REVISIONS THERETO.
3. FOLLOWING INITIAL SOIL DISTURBANCE OR REDISTURBANCE, PERMANENT OR TEMPORARY STABILIZATION SHALL BE COMPLETED WITHIN: A) 7 CALENDAR DAYS FOR ALL PERIMETER SEDIMENT CONTROL STRUCTURES, DIKES, PERIMETER SLOPES AND ALL SLOPES GREATER THAN 3:1, B) 14 DAYS AS TO ALL OTHER DISTURBED OR GRADED AREAS ON THE PROJECT SITE.
4. ALL SEDIMENT TRAPS/BASINS SHOWN MUST BE FENCED AND WARNING SIGNS POSTED AROUND THEIR PERIMETER IN ACCORDANCE WITH VOL. 1, CHAPTER 12, OF THE HOWARD COUNTY DESIGN MANUAL, STORM DRAINAGE.
5. ALL DISTURBED AREAS MUST BE STABILIZED WITHIN THE TIME PERIOD SPECIFIED ABOVE IN ACCORDANCE WITH THE 1994 MARYLAND STANDARDS AND SPECIFICATIONS FOR SOIL EROSION AND SEDIMENT CONTROL FOR PERMANENT SEEDINGS (SEC. 51) SOD (SEC. 54), TEMPORARY SEEDING (SEC. 50) AND MULCHING (SEC. 52). TEMPORARY STABILIZATION WITH MULCH ALONE CAN ONLY BE DONE WHEN RECOMMENDED SEEDING DATES DO NOT ALLOW FOR PROPER GERMINATION AND ESTABLISHMENT OF GRASSES.
6. ALL SEDIMENT CONTROL STRUCTURES ARE TO REMAIN IN PLACE AND ARE TO BE MAINTAINED IN OPERATIVE CONDITION UNTIL PERMISSION FOR THEIR REMOVAL HAS BEEN OBTAINED FROM THE HOWARD COUNTY SEDIMENT CONTROL INSPECTOR.
7. SITE ANALYSIS:

| | | |
|---|---|---|
| TOTAL AREA OF SITE | 116.79 | ACRES |
| AREA DISTURBED | 18.73 | ACRES |
| AREA TO BE ROOFED OR PAVED | 8.60 | ACRES |
| AREA TO BE VEGETATIVELY STABILIZED | 10.13 | ACRES |
| TOTAL CUT | 19,031 | CY |
| TOTAL FILL | 16,081 | CY |
| OFFSITE WASTE AREA LOCATION | IF AN OFFSITE LOCATION IS NEEDED THAT SITE MUST HAVE AN APPROVED SED. CONTROL PLAN AND GRADING PERMIT | |

8. ANY SEDIMENT CONTROL PRACTICE WHICH IS DISTURBED BY GRADING ACTIVITY FOR PLACEMENT OF UTILITIES MUST BE REPAIRED ON THE SAME DAY OF DISTURBANCE.
9. ADDITIONAL SEDIMENT CONTROL MUST BE PROVIDED, IF DEEMED NECESSARY BY THE HOWARD COUNTY SEDIMENT CONTROL INSPECTOR.
10. ON ALL SITES WITH DISTURBED AREAS IN EXCESS OF 2 ACRES, APPROVAL OF THE INSPECTION AGENCY SHALL BE REQUESTED UPON COMPLETION OF INSTALLATION OF PERIMETER EROSION AND SEDIMENT CONTROLS, BUT BEFORE PROCEEDING WITH ANY OTHER EARTH DISTURBANCE OR GRADING. OTHER BUILDING OR GRADING INSPECTION APPROVALS MAY NOT BE AUTHORIZED UNTIL THIS INITIAL APPROVAL BY THE INSPECTION AGENCY IS MADE.
11. TRENCHES FOR THE CONSTRUCTION OF UTILITIES IS LIMITED TO THREE PIPE LENGTHS OR THAT WHICH CAN BE BACK FILLED AND STABILIZED WITHIN ONE WORKING DAY, WHICHEVER IS SHORTER.

## TEMPORARY SEEDBED PREPARATIONS

APPLY TO GRADED OR CLEARED AREAS LIKELY TO BE REDISTURBED WHERE A SHORT-TERM VEGETATIVE COVER IS NEEDED.

SEEDBED PREPARATION: LOOSEN UPPER THREE INCHES OF SOIL BY RAKING, DISCING OR OTHER ACCEPTABLE MEANS BEFORE SEEDING, IF NOT PREVIOUSLY LOOSENED.

SOIL AMENDMENTS: APPLY 600 LBS PER ACRE 10-10-10 FERTILIZER (14 LBS/1000 SQ FT).

SEEDING: FOR PERIOD MARCH 1 THROUGH APRIL 30 AND FROM AUGUST 15 THROUGH NOV. 15, SEED WITH 2-1/2 BUSHELS PER ACRE OF ANNUAL RYE (3.2 LBS/1000 SQ FT). FOR THE PERIOD MAY 1 THROUGH AUGUST 14, SEED WITH 3 LBS PER ACRE OF WEEPING LOVEGRASS (.07 LBS/1000 SQ FT). FOR THE PERIOD NOVEMBER 16 THROUGH FEBRUARY 28, PROTECT SITE BY APPLYING 2 TONS PER ACRE OF WELL ANCHORED STRAW MULCH AND SEED AS SOON AS POSSIBLE IN THE SPRING, OR USE SOD.

MULCHING: APPLY 1-1/2 TO 2 TONS PER ACRE (70 TO 90 LBS/1000 SQ FT) OF UNROTTED SMALL GRAIN STRAW IMMEDIATELY AFTER SEEDING. ANCHOR MULCH IMMEDIATELY AFTER APPLICATION USING MULCH ANCHORING TOOL OR 218 GALLONS PER ACRE (5 GAL/1000 SQ FT) OF EMULSIFIED ASPHALT ON FLAT AREAS. ON SLOPES, 8 FT. OR HIGHER, USE 348 GALLONS PER ACRE (8 GAL/1000 SQ FT) FOR ANCHORING.

REFER TO THE 1994 MARYLAND STANDARDS AND SPECIFICATIONS FOR SOIL EROSION AND SEDIMENT CONTROL FOR RATE AND METHODS NOT COVERED.

## PERMANENT SEEDBED PREPARATIONS

SEEDBED PREPARATION: LOOSEN UPPER THREE INCHES OF SOIL BY RAKING, DISCING OR OTHER ACCEPTABLE MEANS BEFORE SEEDING, IF NOT PREVIOUSLY LOOSENED.

SOIL AMENDMENTS: IN LIEU OF SOIL TEST RECOMMENDATIONS, USE ON OF THE FOLLOWING SCHEDULES:

1. PREFERRED – APPLY 2 TONS PER ACRE DOLOMITIC LIMESTONE (92 LBS/1000 SQ FT) AND 600 LBS PER ACRE 10-10-10 FERTILIZER (14 LBS/1000 SQ FT) BEFORE SEEDING. HARROW OR DISC INTO UPPER THREE INCHES OF SOIL. AT TIME OF SEEDING, APPLY 400 LBS PER ACRE 30-0-0- UREAFORM FERTILIZER (9 LBS/1000 SQ FT).
2. ACCEPTABLE – APPLY 2 TONS PER ACRE DOLOMITIC LIMESTONE (92 LBS/1000 SQ FT) AND 1000 LBS PER ACRE 10-10-10 FERTILIZER (23 LBS/1000 SQ FT) BEFORE SEEDING. HARROW OR DISC INTO UPPER THREE INCHES OF SOIL.

SEEDING: FOR THE PERIODS MARCH 1 THROUGH APRIL 30 AND AUGUST 1 THROUGH OCTOBER 15, SEED WITH 60 LBS PER ACRE (1.4 LBS/1000 SQ FT) OF KENTUCKY 31 TALL FESCUE PER ACRE AND 2 LBS PER ACRE (.05 LBS/1000 SQ FT) OF WEEPING LOVEGRASS. DURING THE PERIOD OF OCTOBER 16 THROUGH FEBRUARY 28, PROTECT SITE BY: OPTION (1) 2 TONS PER ACRE OF WELL ANCHORED STRAW MULCH AND SEED AS SOON AS POSSIBLE IN THE SPRING. OPTION (2) USE SOD. OPTION (3) SEED WITH 60 LBS PER ACRE OF KENTUCKY 31 TALL FESCUE AND MULCH WITH 2 TONS PER ACRE OF WELL ANCHORED STRAW.

MULCHING: APPLY 1-1/2 TO 2 TONS PER ACRE (70 TO 90 LBS/1000 SQ FT) OF UNROTTED SMALL GRAIN STRAW IMMEDIATELY AFTER SEEDING. ANCHOR MULCH IMMEDIATELY AFTER APPLICATION USING MULCH ANCHORING TOOL OR 218 GALLONS PER ACRE (5 GAL/1000 SQ FT) OF EMULSIFIED ASPHALT ON FLAT AREAS. ON SLOPES 8 FEET OR HIGHER, USE 348 GALLONS PER ACRE (8 GAL/1000 SQ FT) FOR ANCHORING.

MAINTENANCE: INSPECT ALL SEEDED AREAS AND MAKE NEEDED REPAIRS, REPLACEMENTS AND RESEEDINGS.

Maryland's Guidelines To Waterway Construction
DETAIL 1.4: DIVERSION PIPE

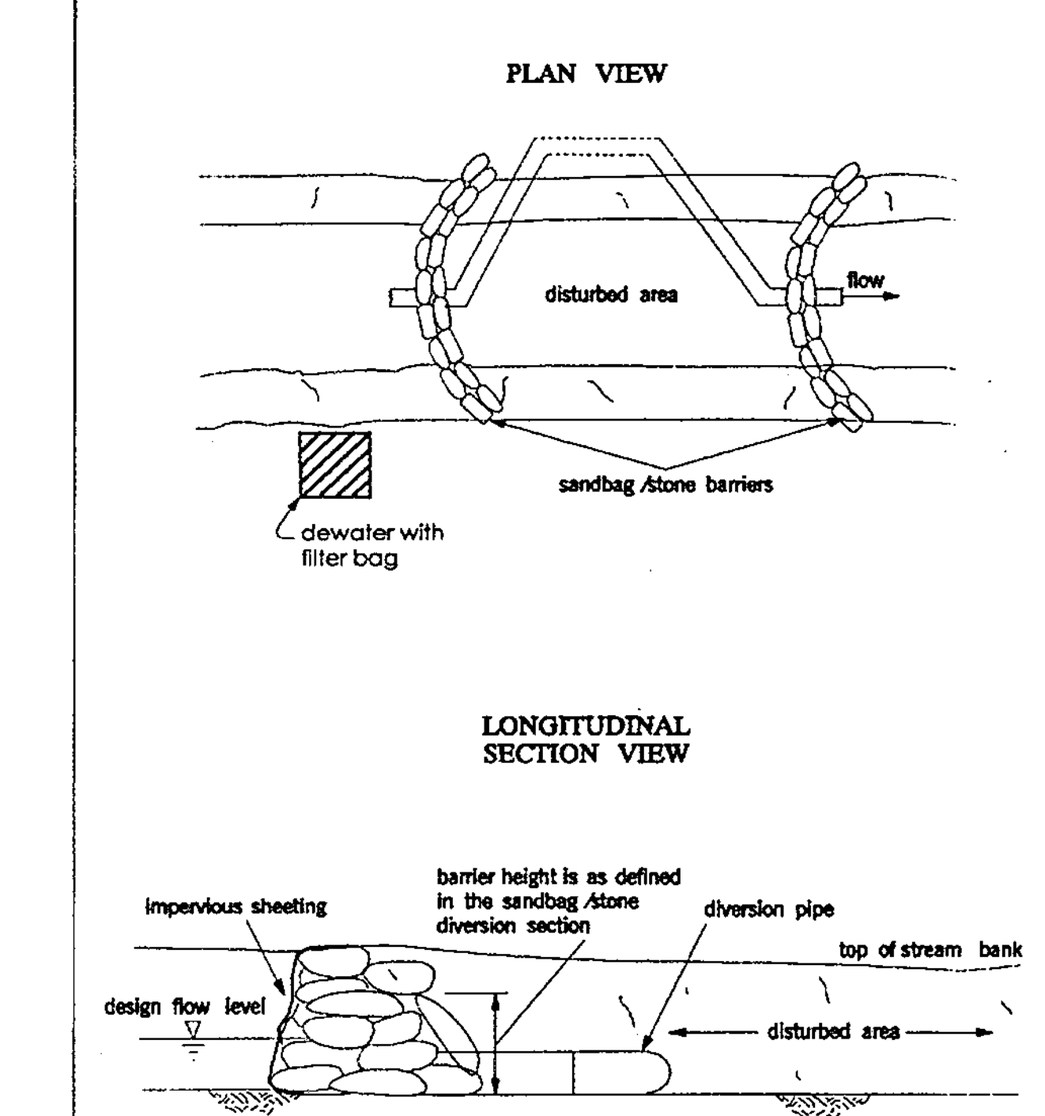


TEMPORARY INSTREAM CONSTRUCTION MEASURES | REVISED NOVEMBER 2000 PAGE 1.4 - 2 | MARYLAND DEPARTMENT OF THE ENVIRONMENT WATER MANAGEMENT ADMINISTRATION

### MGWC 1.4: DIVERSION PIPE

[redacted]

DESCRIPTION

The work should consist of installing flow diversion pipes in combination with sandbag or stone diversions when construction activities occur within the stream channel.

EFFECTIVE USES & LIMITATIONS

Diversion pipes with an insufficient flow capacity can cause the channel diversion to fail thereby resulting in severe erosion of the disturbed channel section under construction. Therefore, in-channel construction activities should occur only during periods of low flow.

MATERIAL SPECIFICATIONS

Materials for stream diversions should meet the following requirements:

- *Riprap*: Stone should be washed and have a minimum diameter of 6 inches (15 centimeters).
- *Sandbags*: Sandbags should consist of materials which are resistant to ultra-violet radiation, tearing, and puncture and should be woven tightly enough to prevent leakage of fill material (i.e., sand, fine gravel, etc.).
- *Sheeting*: Sheeting should consist of polyethylene or other material which is impervious and resistant to puncture and tearing.

INSTALLATION GUIDELINES

All erosion and sediment control devices including mandatory dewatering basins should be installed as the first order of business according to a plan approved by the WMA or local authority. Installation should proceed from upstream to downstream during low flow conditions. If necessary, silt fence or straw bales should be installed around the perimeter of the work area.

Diversion pipes with sandbag or stone barriers should be completed as follows (refer to Detail 1.4):

1. Sandbag/stone barriers should be sized and installed as detailed in MGWC 1.5: Sandbag/Stone Diversion. The materials should be sized to withstand baseflow velocities.
2. All excavated material should be deposited and stabilized in an approved area outside the 100-year floodplain unless otherwise authorized by the WMA.
3. Sediment-laden water from the construction area should be pumped to a dewatering basin.
4. The diversion pipe should have a minimum capacity sufficient to convey the 2-year flow for projects with a duration of two weeks or greater. For projects of shorter duration, the capacity of the pipe can be reduced accordingly.
5. If necessary, silt fence or straw bales should be installed around the perimeter of the work area.
6. Sediment control devices are to remain in place until all disturbed areas are stabilized and the inspecting authority approves their removal.

*TEMPORARY INSTREAM CONSTRUCTION MEASURES* | *MARYLAND DEPARTMENT OF THE ENVIRONMENT WATERWAY CONSTRUCTION GUIDELINES REVISED NOVEMBER 2000*

*PAGE 1.4 - 1*

Maryland's Guidelines To Waterway Construction
DETAIL 1.5: SANDBAG/STONE DIVERSION

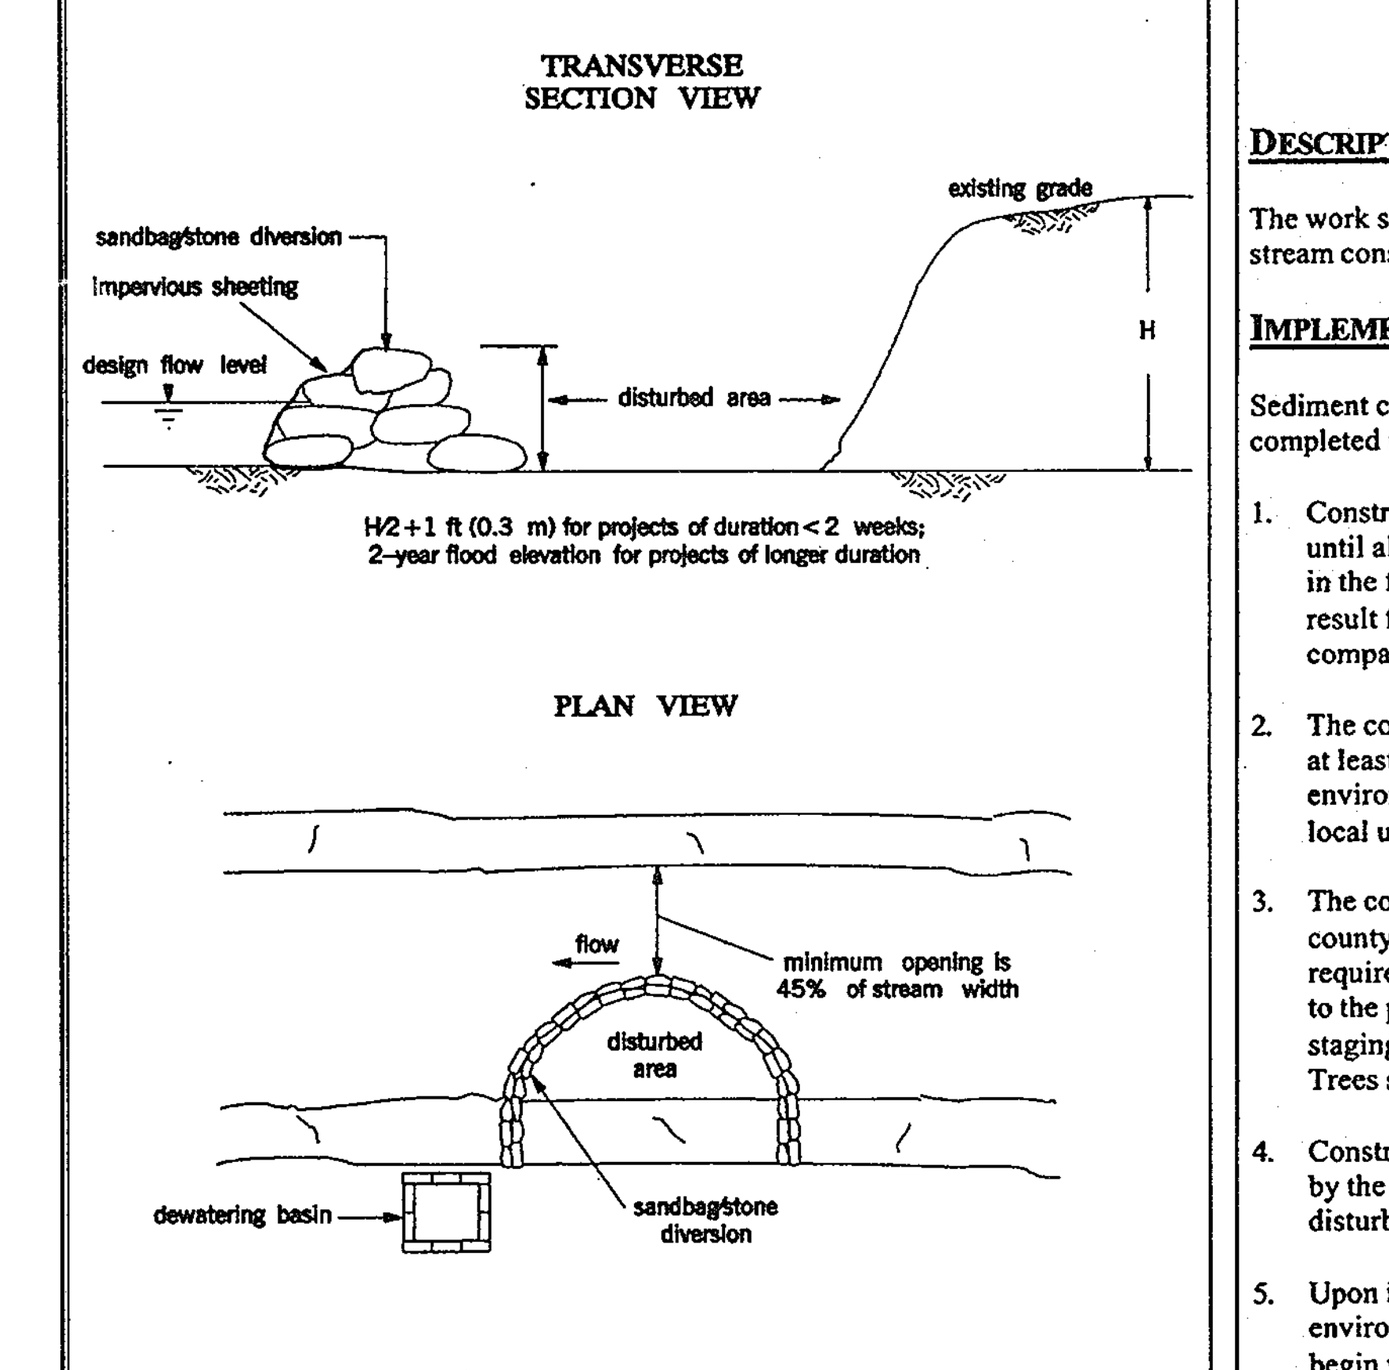


TEMPORARY INSTREAM CONSTRUCTION MEASURES | REVISED NOVEMBER 2000 PAGE 1.5 - 3 | MARYLAND DEPARTMENT OF THE ENVIRONMENT WATER MANAGEMENT ADMINISTRATION

Maryland's Guidelines To Waterway Construction
DETAIL 1.2: PUMP-AROUND PRACTICE

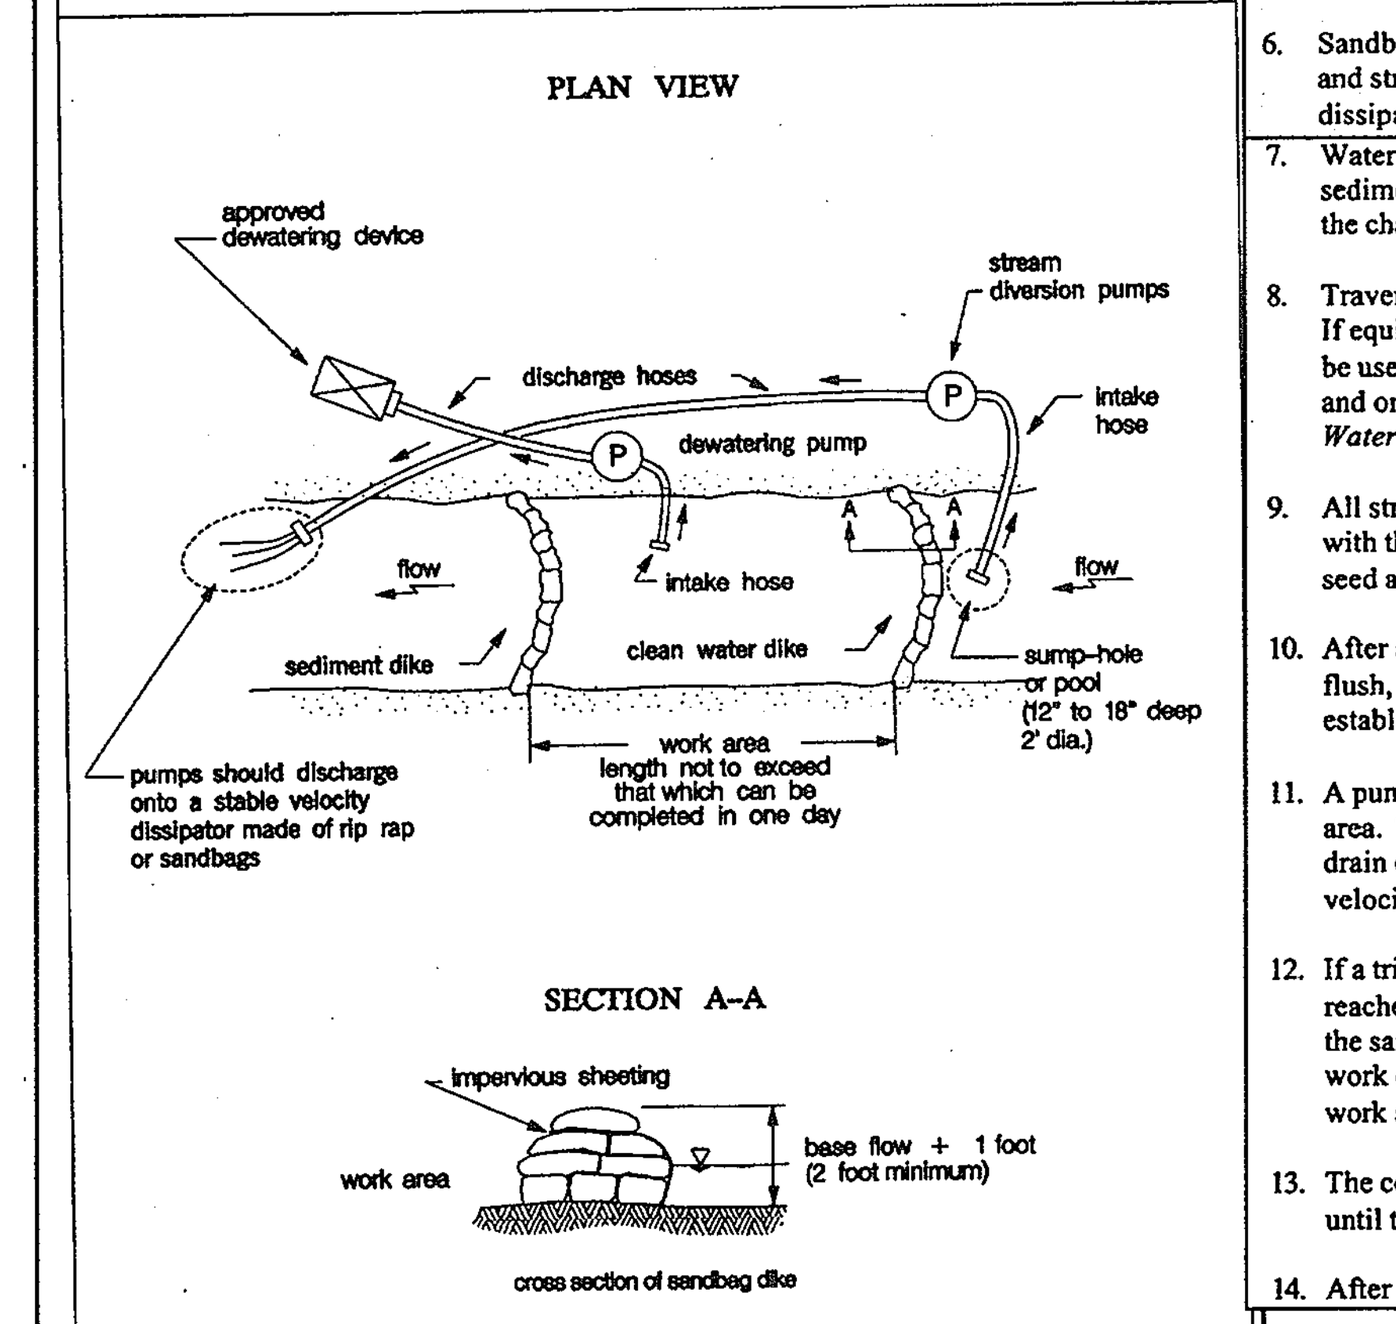


TEMPORARY INSTREAM CONSTRUCTION MEASURES | REVISED NOVEMBER 2000 PAGE 1.2 - 3 | MARYLAND DEPARTMENT OF THE ENVIRONMENT WATER MANAGEMENT ADMINISTRATION

### MGWC 1.2: PUMP-AROUND PRACTICE

*Temporary measure for dewatering in-channel construction sites*

DESCRIPTION

The work should consist of installing a temporary pump around and supporting measures to divert flow around in-stream construction sites.

IMPLEMENTATION SEQUENCE

Sediment control measures, pump-around practices, and associated channel and bank construction should be completed in the following sequence (refer to Detail 1.2):

1. Construction activities including the installation of erosion and sediment control measures should not begin until all necessary easements and/or right-of-ways have been acquired. All existing utilities should be marked in the field prior to construction. The contractor is responsible for any damage to existing utilities that may result from construction and should repair the damage at his/her own expense to the county's or utility company's satisfaction.
2. The contractor should notify the Maryland Department of the Environment or WMA sediment control inspector at least 5 days before beginning construction. Additionally, the contractor should inform the local environmental protection and resource management inspection and enforcement division and the provider of local utilities a minimum of 48 hours before starting construction.
3. The contractor should conduct a pre-construction meeting on site with the WMA sediment control inspector, the county project manager, and the engineer to review limits of disturbance, erosion and sediment control requirements, and the sequence of construction. The contractor should stake out all limits of disturbance prior to the pre-construction meeting so they may be reviewed. The participants will also designate the contractor's staging areas and flag all trees within the limit of disturbance which will be removed for construction access. Trees should not be removed within the limit of disturbance without approval from the WMA or local authority.
4. Construction should not begin until all sediment and erosion control measures have been installed and approved by the engineer and the sediment control inspector. The contractor should stay within the limits of the disturbance as shown on the plans and minimize disturbance within the work area whenever possible.
5. Upon installation of all sediment control measures and approval by the sediment control inspector and the local environmental protection and resource management inspection and enforcement division, the contractor should begin work at the upstream section and proceed downstream beginning with the establishment of stabilized construction entrances. In some cases, work may begin downstream if appropriate. The sequence of construction must be followed unless the contractor gets written approval for deviations from the WMA or local authority. The contractor should only begin work in an area which can be completed by the end of the day including grading adjacent to the channel. At the end of each work day, the work area must be stabilized and the pump around removed from the channel. Work should not be conducted in the channel during rain events.
6. Sandbag dikes should be situated at the upstream and downstream ends of the work area as shown on the plans, and stream flow should be pumped around the work area. The pump should discharge onto a stable velocity dissipater made of riprap or sandbags.
7. Water from the work area should be pumped to a sediment filtering measure such as a dewatering basin, sediment bag, or other approved source. The measure should be located such that the water drains back into the channel below the downstream sandbag dike.
8. Traversing a channel reach with equipment within the work area where no work is proposed should be avoided. If equipment has to traverse such a reach for access to another area, then timber mats or similar measures should be used to minimize disturbance to the channel. Temporary stream crossings should be used only when necessary and only where noted on the plans or specified. (*See Section 4, Stream Crossings, Maryland Guidelines to Waterway Construction*).
9. All stream restoration measures should be installed as indicated by the plans and all banks graded in accordance with the grading plans and typical cross- sections. All grading must be stabilized at the end of each day with seed and mulch or seed and matting as specified on the plans.
10. After an area is completed and stabilized, the clean water dike should be removed. After the first sediment flush, a new clean water dike should be established upstream from the old sediment dike. Finally, upon establishment of a new sediment dike below the old one, the old sediment dike should be removed.
11. A pump around must be installed on any tributary or storm drain outfall which contributes baseflow to the work area. This should be accomplished by locating a sandbag dike at the downstream end of the tributary or storm drain outfall and pumping the stream flow around the work area. This water should discharge onto the same velocity dissipater used for the main stem pump around.
12. If a tributary is to be restored, construction should take place on the tributary before work on the main stem reaches the tributary confluence. Construction in the tributary, including pump around practices, should follow the same sequence as for the main stem of the river or stream. When construction on the tributary is completed, work on the main stem should resume. Water from the tributary should continue to be pumped around the work area in the main stem.
13. The contractor is responsible for providing access to and maintaining all erosion and sediment control devices until the sediment control inspector approves their removal.
14. After construction, all disturbed areas should be regraded and revegetated as per the planting plan.

### MGWC 1.5: SANDBAG/STONE CHANNEL DIVERSION

*Temporary measure for dewatering in-channel construction sites*

DESCRIPTION

The work should consist of installing sandbag or stone flow diversions for the purpose of erosion control when construction activities occur within the stream channel.

EFFECTIVE USES & LIMITATIONS

Diversions are used to isolate work areas from flow during the construction of in-stream projects. Diversions which have an insufficient flow capacity can fail and severely erode the disturbed channel section under construction. Therefore, in-channel construction activities should occur only during periods of low rainfall. This temporary measure may not be practical in large channels.

MATERIAL SPECIFICATIONS

Materials for sandbag and stone stream diversions should meet the following requirements:

- *Riprap*: Riprap should be washed and have a minimum diameter of 6 inches (0.15 meters).
- *Sandbags*: Sandbags should consist of materials which are resistant to ultra-violet radiation, tearing, and puncture and should be woven tightly enough to prevent leakage of the fill material (i.e., sand, fine gravel, etc.).
- *Sheeting*: Sheeting should consist of polyethylene or other materials which are impervious and resistant to puncture and tearing.

INSTALLATION GUIDELINES

All erosion and sediment control devices, including dewatering basins, should be implemented as the first order of business according to a plan approved by the WMA or local authority. Installation should proceed from upstream to downstream during periods of low flow. If necessary, silt fence or straw bales should be installed around the perimeter of the work area.

Sandbag/stone diversions can be used independently or as components of other stream diversion techniques. Installation of this measure should proceed as follows (refer to Detail 1.5):

1. The diversion structure should be installed from upstream to downstream.
2. The height of the sandbag/stone diversion should be a function of the duration of the project in the stream reach. For projects with a duration less than 2 weeks, the height of the diversion should be one half the streambank height, measured from the channel bed, plus 1 foot (0.3 meters) or bankfull height, whichever is greater. For projects of longer duration, the top of the sandbag or stone diversion should correspond to bankfull height. For diversion structures utilizing sandbags, the stream bed should be hand prepared prior to placement of the base layer of sandbags in order to ensure a water tight fit. Additionally, it may be necessary to prepare the bank in a similar fashion.
3. All excavated material should be deposited and stabilized in an approved area outside the 100-year floodplain unless otherwise authorized by the WMA.
4. Sediment-laden water from the construction area should be pumped to a dewatering basin.
5. Sheeting on the diversion should be positioned such that the upstream portion covers the downstream portion with at least a 18-inch (0.45 meters) overlap.
6. Sandbag or stone diversions should not obstruct more than 45% of the stream width. Additionally, bank stabilization measures should be placed in the constricted section if accelerated erosion and bank scour are observed during the construction time or if project time is expected to last more than 2 weeks.
7. Prior to removal of these temporary structures, any accumulated sediment should be removed, deposited and stabilized in an approved area outside the 100-year floodplain unless authorized by the WMA.
8. Sediment control devices are to remain in place until all disturbed areas are stabilized in accordance with an approved sediment and erosion control plan and the inspecting authority approves their removal.

### ENGINEER'S CERTIFICATE

"I HEREBY CERTIFY THAT THIS PLAN FOR SEDIMENT AND EROSION CONTROL REPRESENTS A PRACTICAL AND WORKABLE PLAN BASED ON MY PERSONAL KNOWLEDGE OF THE SITE CONDITIONS AND THAT IT WAS PREPARED IN ACCORDANCE WITH THE REQUIREMENTS OF THE HOWARD SOIL CONSERVATION DISTRICT."

ENGINEER – DONALD A. MASON, P.E. # 21443 — DATE 3/31/06

### DEVELOPER'S CERTIFICATE

"I/WE CERTIFY THAT ALL DEVELOPMENT AND CONSTRUCTION WILL BE DONE ACCORDING TO THIS PLAN OF DEVELOPMENT FOR SEDIMENT AND EROSION CONTROL, AND THAT ALL RESPONSIBLE PERSONNEL INVOLVED IN THE CONSTRUCTION PROJECT WILL HAVE A CERTIFICATE OF ATTENDANCE AT A DEPARTMENT OF THE ENVIRONMENT APPROVED TRAINING PROGRAM FOR THE CONTROL OF SEDIMENT AND EROSION BEFORE BEGINNING THE PROJECT. I ALSO AUTHORIZE PERIODIC ON-SITE INSPECTION BY THE HOWARD SOIL CONSERVATION DISTRICT."

DEVELOPER — DATE 4/4/06

REVIEWED FOR HOWARD SCD AND MEETS TECHNICAL REQUIREMENTS

USDA – NATURAL RESOURCES CONSERVATION SERVICE — DATE 4/11/06

THIS DEVELOPMENT PLAN IS APPROVED FOR SOIL EROSION AND SEDIMENT CONTROL BY THE HOWARD SOIL CONSERVATION DISTRICT.

HOWARD SCD — DATE

APPROVED: DEPARTMENT OF PUBLIC WORKS

CHIEF, BUREAU OF HIGHWAYS — DATE 4-21-06

APPROVED: DEPARTMENT OF PLANNING AND ZONING

CHIEF, DIVISION OF LAND DEVELOPMENT — DATE 5/12/06

CHIEF, DEVELOPMENT ENGINEERING DIVISION MK — DATE

### DETAIL 20A – REMOVABLE PUMPING STATION

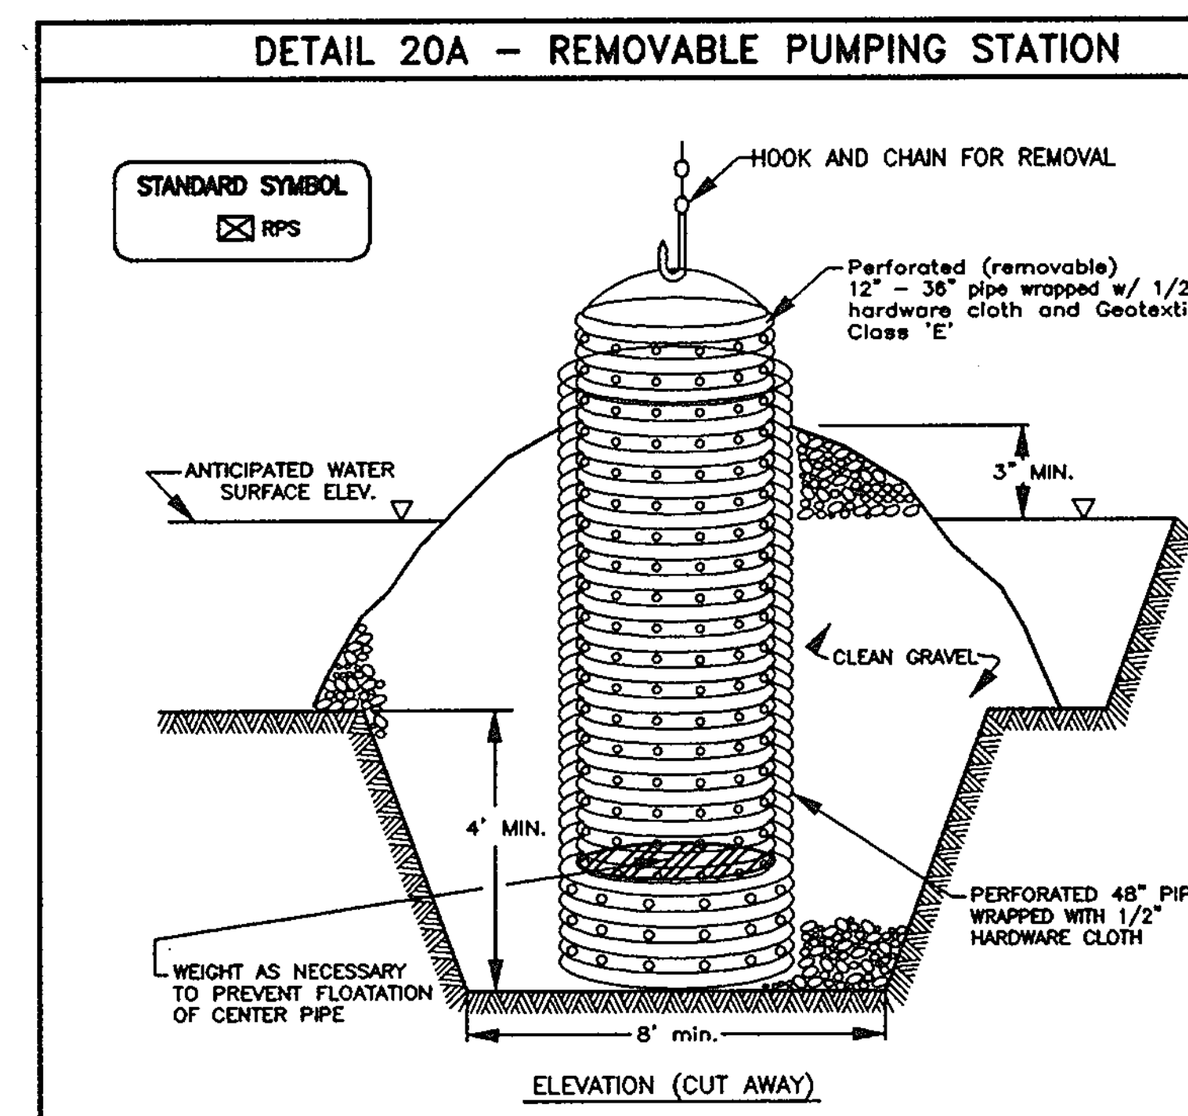


Construction Specifications

1. The outer pipe should be 48" dia. or shall, in any case, be at least 4" greater in diameter than the center pipe. The outer pipe shall be wrapped with 1/2" hardware cloth to prevent backfill material from entering the perforations.
2. After installing the outer pipe, backfill around outer pipe with 2" aggregate or clean gravel.
3. The inside stand pipe (center pipe) should be constructed by perforating a corrugated or PVC pipe between 12" and 36" in diameter. The perforations shall be 1/2" X 6" slits or 1" diameter holes 6" on center. The center pipe shall be wrapped with 1/2" hardware cloth first, then wrapped again with Geotextile Class C.
4. The center pipe should extend 12" to 18" above the anticipated water surface elevation or riser crest elevation when dewatering a basin.

U.S. DEPARTMENT OF AGRICULTURE SOIL CONSERVATION SERVICE | PAGE D – 12 – 5 | MARYLAND DEPARTMENT OF ENVIRONMENT WATER MANAGEMENT ADMINISTRATION

### DETAIL 18 – SEDIMENT BASIN BAFFLES

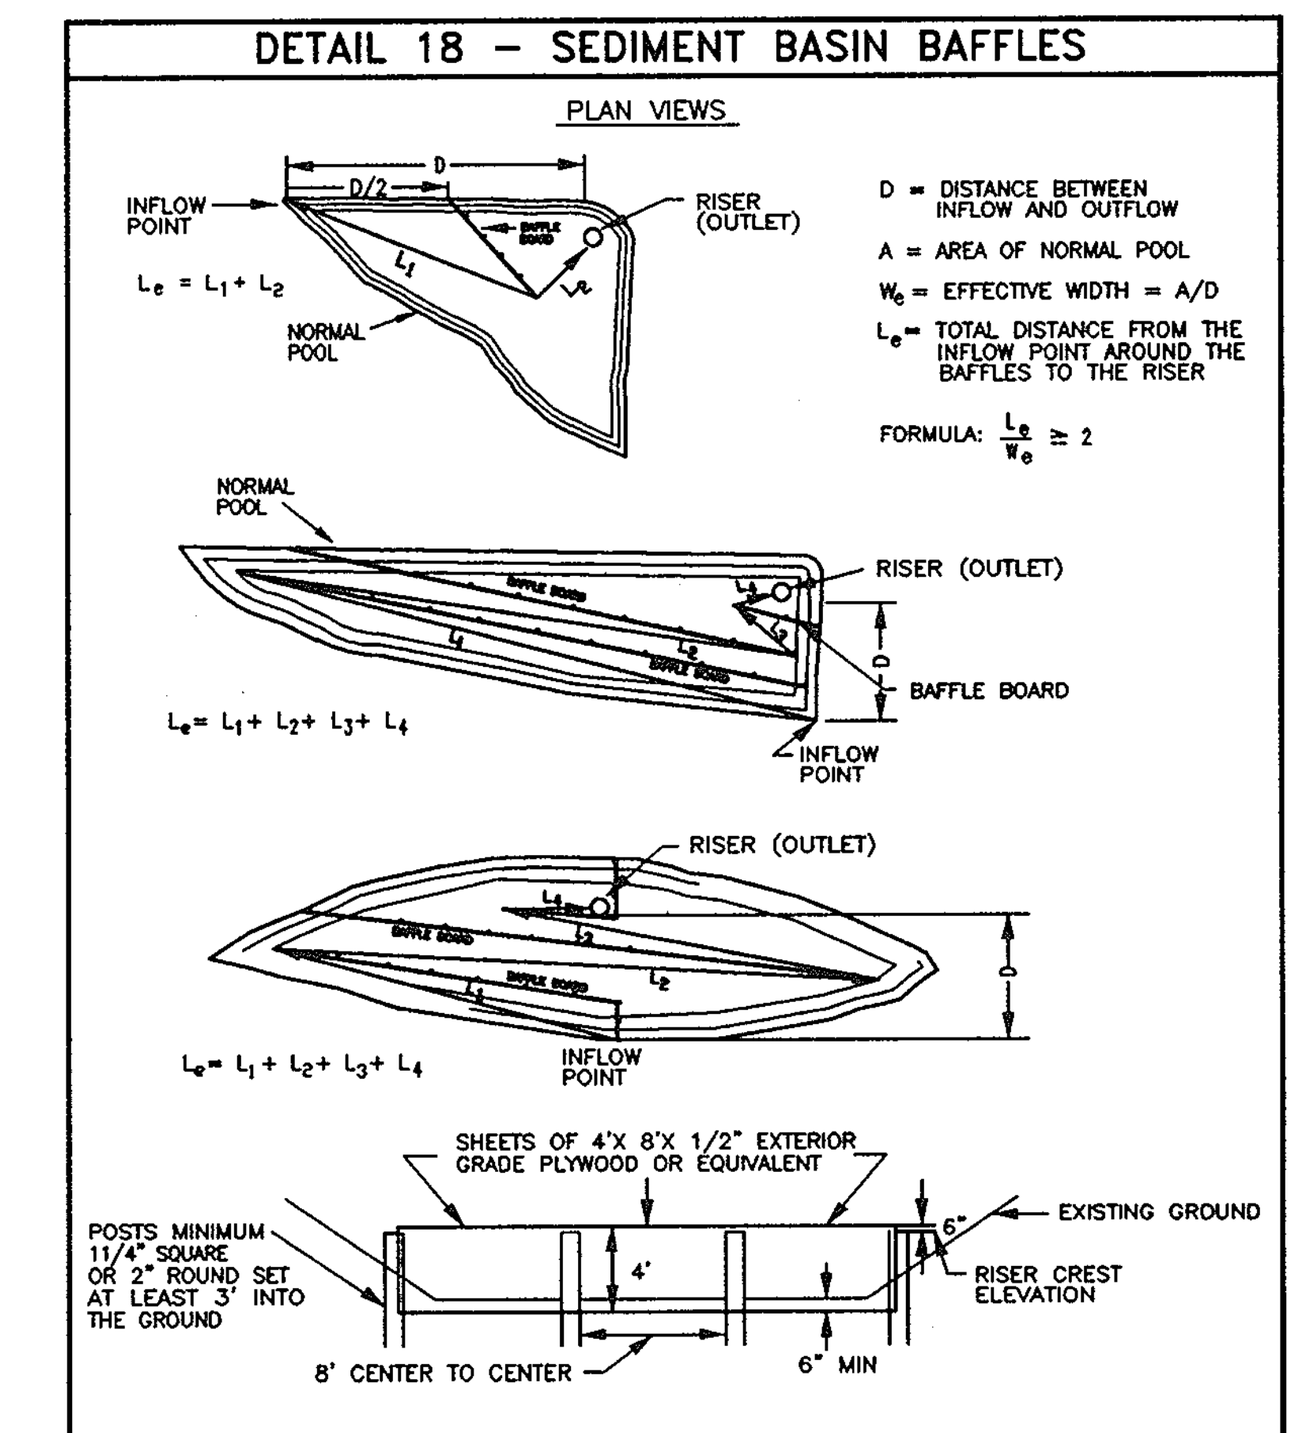


U.S. DEPARTMENT OF AGRICULTURE SOIL CONSERVATION SERVICE | PAGE C – 10 – 28 | MARYLAND DEPARTMENT OF ENVIRONMENT WATER MANAGEMENT ADMINISTRATION

### TREE PROTECTION FENCE

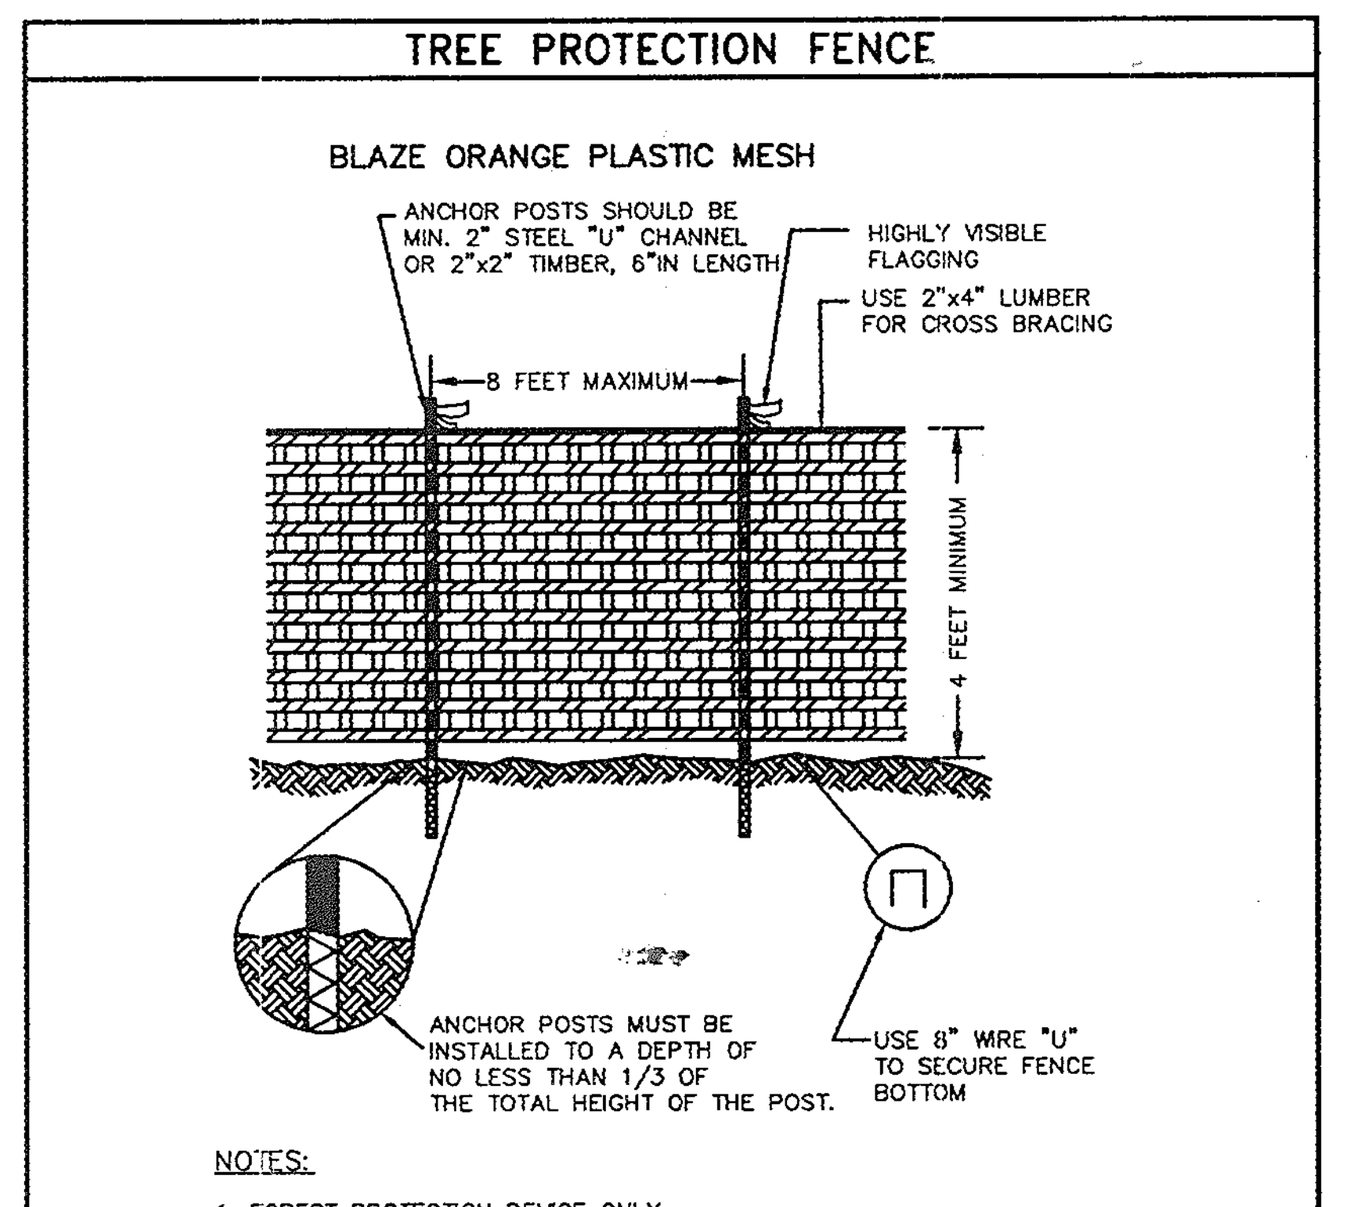


NOTES:
1. FOREST PROTECTION DEVICE ONLY.
2. RETENTION AREA WILL BE SET AS PART OF THE REVIEW PROCESS.
3. BOUNDARIES OF RETENTION AREA SHOULD BE STAKED AND FLAGGED PRIOR TO INSTALLING DEVICES.
4. AVOID ROOT DAMAGE WHEN PLACING ANCHOR POSTS.
5. DEVICE SHOULD BE PROPERLY MAINTAINED DURING CONSTRUCTION
6. PROTECTIVE SIGNAGE IS ALSO REQUIRED.

### DETAIL 1 – EARTH DIKE

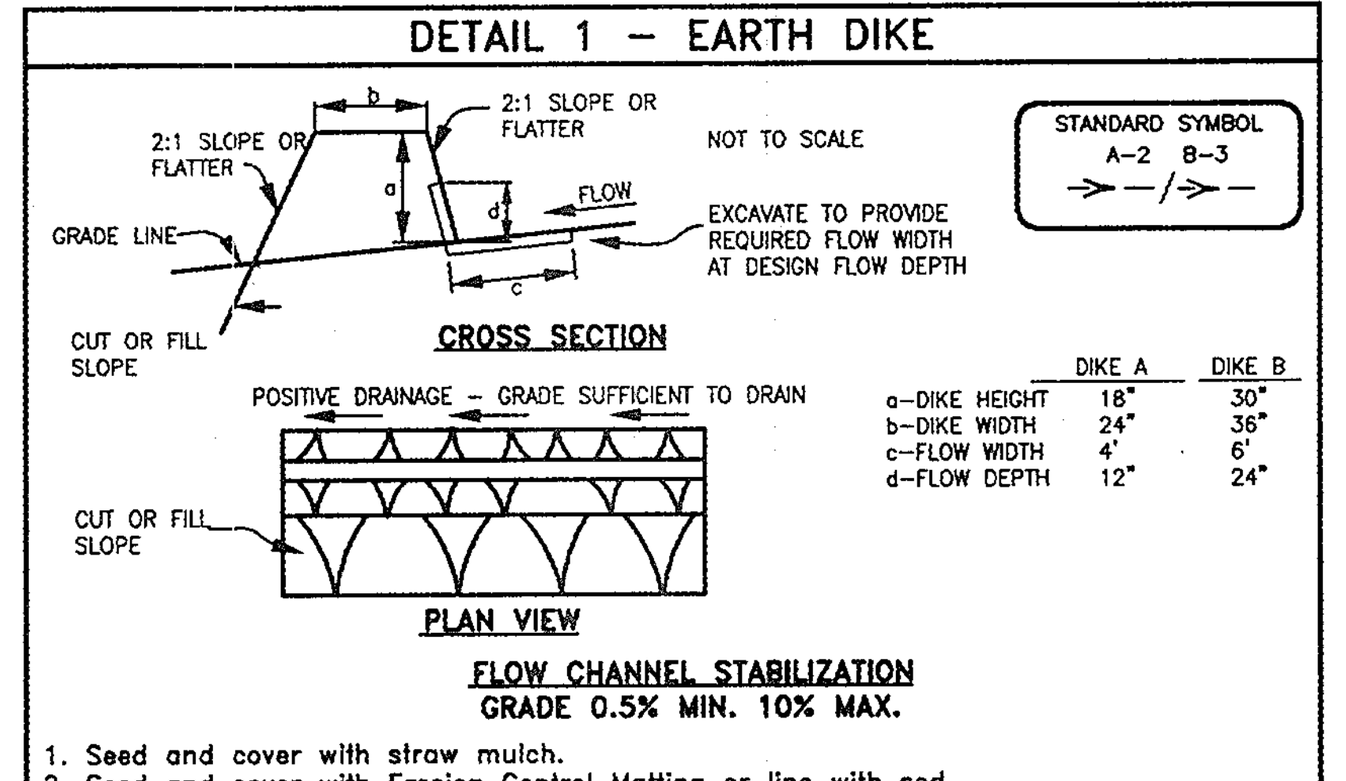


| | DIKE A | DIKE B |
|---|---|---|
| a-DIKE HEIGHT | 18" | 30" |
| b-DIKE WIDTH | 24" | 36" |
| c-FLOW WIDTH | 4' | 6' |
| d-FLOW DEPTH | 12" | 24" |

FLOW CHANNEL STABILIZATION
GRADE 0.5% MIN. 10% MAX.

1. Seed and cover with straw mulch.
2. Seed and cover with Erosion Control Matting or line with sod.
3. 4" – 7" stone or recycled concrete equivalent pressed into the soil 7" minimum.

CONSTRUCTION SPECIFICATIONS

1. All temporary earth dikes shall have uninterrupted positive grade to an outlet. Spot elevations may be necessary for grades less than 1%.
2. Runoff diverted from a disturbed area shall be conveyed to a sediment trapping device.
3. Runoff diverted from an undisturbed area shall outlet directly into an undisturbed, stabilized area at a non-erosive velocity.
4. All trees, brush, stumps, obstructions, and other objectional material shall be removed and disposed of so as not to interfere with the proper functioning of the dike.
5. The dike shall be excavated or shaped to line, grade and cross section as required to meet the criteria specified herein and be free of bank projections or other irregularities which will impede normal flow.
6. Fill shall be compacted by earth moving equipment.
7. All earth removed and not needed for construction shall be placed so that it will not interfere with the functioning of the dike.
8. Inspection and maintenance must be provided periodically and after each rain event.

U.S. DEPARTMENT OF AGRICULTURE SOIL CONSERVATION SERVICE | PAGE A – 1 – 6 | MARYLAND DEPARTMENT OF ENVIRONMENT WATER MANAGEMENT ADMINISTRATION

### DETAIL 24 – STABILIZED CONSTRUCTION ENTRANCE

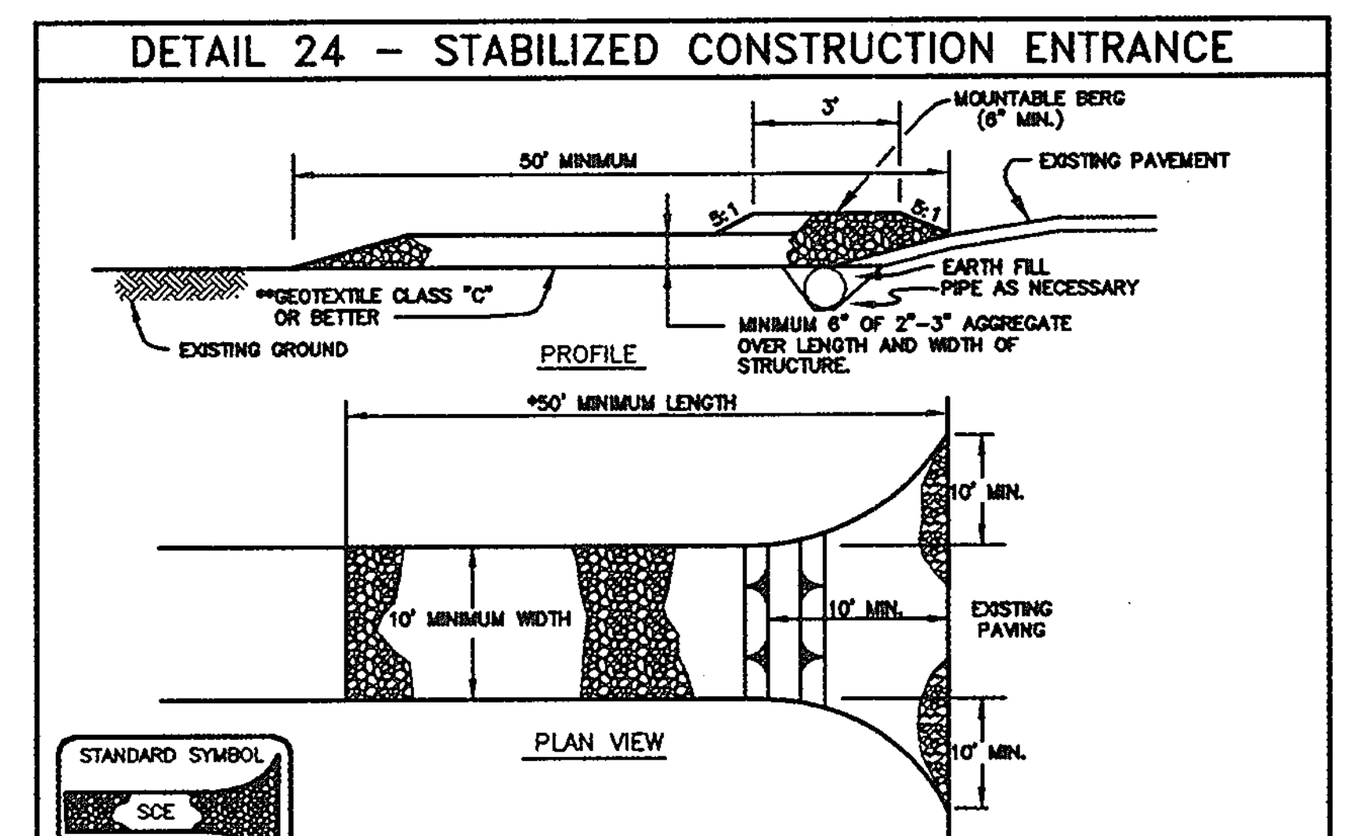


Construction Specifications

1. Length – minimum of 50' (*30' for single residence lot).
2. Width- 10' minimum, should be flared at the existing road to provide a turning radius.
3. Geotextile fabric (filter cloth) shall be placed over the existing ground prior to placing stone. **The plan approval authority may not require single family residence to use geotextile.
4. Stone – crushed aggregate (2" to 3") or reclaimed or recycled concrete equivalent shall be placed at least 6" deep over the length and width of the entrance.
5. Surface Water – all surface water flowing to or diverted toward construction entrances shall be piped through the entrance, maintaining positive drainage. Pipe installed through the stabilized construction entrance shall be protected with a mounted berg with 5:1 slopes and a minimum of 6" of stone over the pipe. Pipe has to be sized according to the drainage. When the SCE is located at a high spot and has no drainage to convey a pipe will not be necessary. Pipe should be sized according to the amount of runoff to be conveyed. A 6" minimum will be required.
6. Location – A stabilized construction entrance shall be located at every point where construction traffic enters or leaves a construction site. Vehicles leaving the site must travel over the entire length of the stabilized construction entrance.

U.S. DEPARTMENT OF AGRICULTURE SOIL CONSERVATION SERVICE | PAGE F – 17 – 3 | MARYLAND DEPARTMENT OF ENVIRONMENT WATER MANAGEMENT ADMINISTRATION

### DETAIL 22 – SILT FENCE

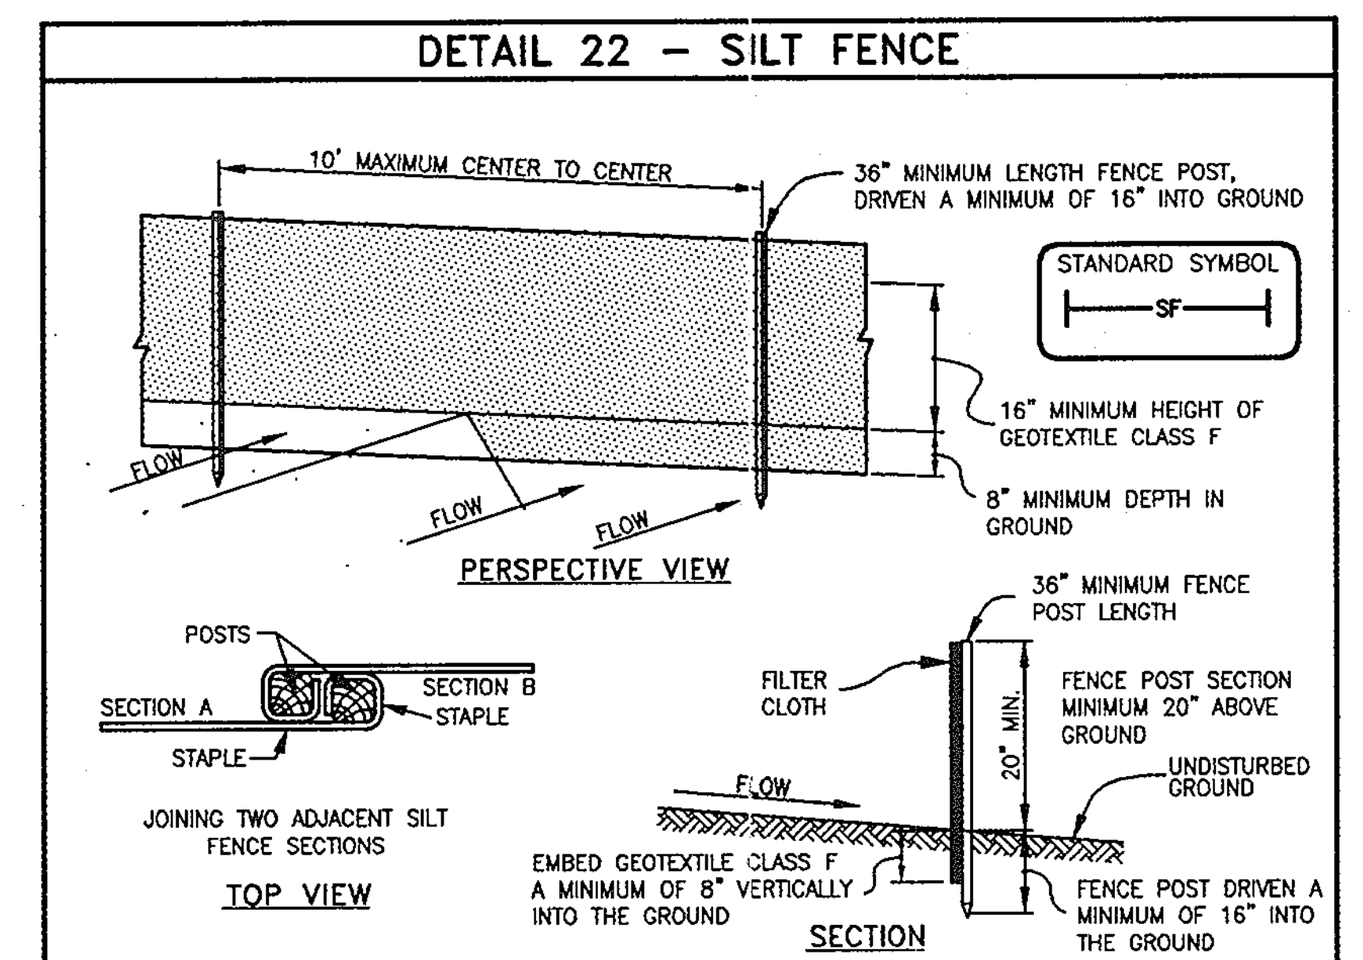


CONSTRUCTION NOTES FOR FABRICATED SILT FENCE

1. Fence posts shall be a minimum of 36" long driven 16" minimum into the ground. Wood posts shall be 1 1/2" x 1 1/2" square (minimum) cut, or 1 3/4" diameter (minimum) round and shall be of sound quality hardwood. Steel posts will be standard T or U section weighing not less than 1.00 pond per linear foot.
2. Geotextile shall be fastened securely to each fence post with wire ties or staples at top and mid-section and shall meet the following requirements for Geotextile Class F:

| | | |
|---|---|---|
| Tensile Strength | 50 lbs/in (min.) | Test: MSMT 509 |
| Tensile Modulus | 20 lbs/in (min.) | Test: MSMT 509 |
| Flow Rate | 0.3 gal ft / minute (max.) | Test: MSMT 322 |
| Filtering Efficiency | 75% (min.) | Test: MSMT 322 |

3. Where ends of geotextile fabric come together, they shall be overlapped, folded and stapled to prevent sediment bypass.
4. Silt Fence shall be inspected after each rainfall event and maintained when bulges occur or when sediment accumulation reached 50% of the fabric height.

U.S. DEPARTMENT OF AGRICULTURE SOIL CONSERVATION SERVICE | PAGE E – 15 – 3 | MARYLAND DEPARTMENT OF ENVIRONMENT WATER MANAGEMENT ADMINISTRATION

### DETAIL 33 – SUPER SILT FENCE

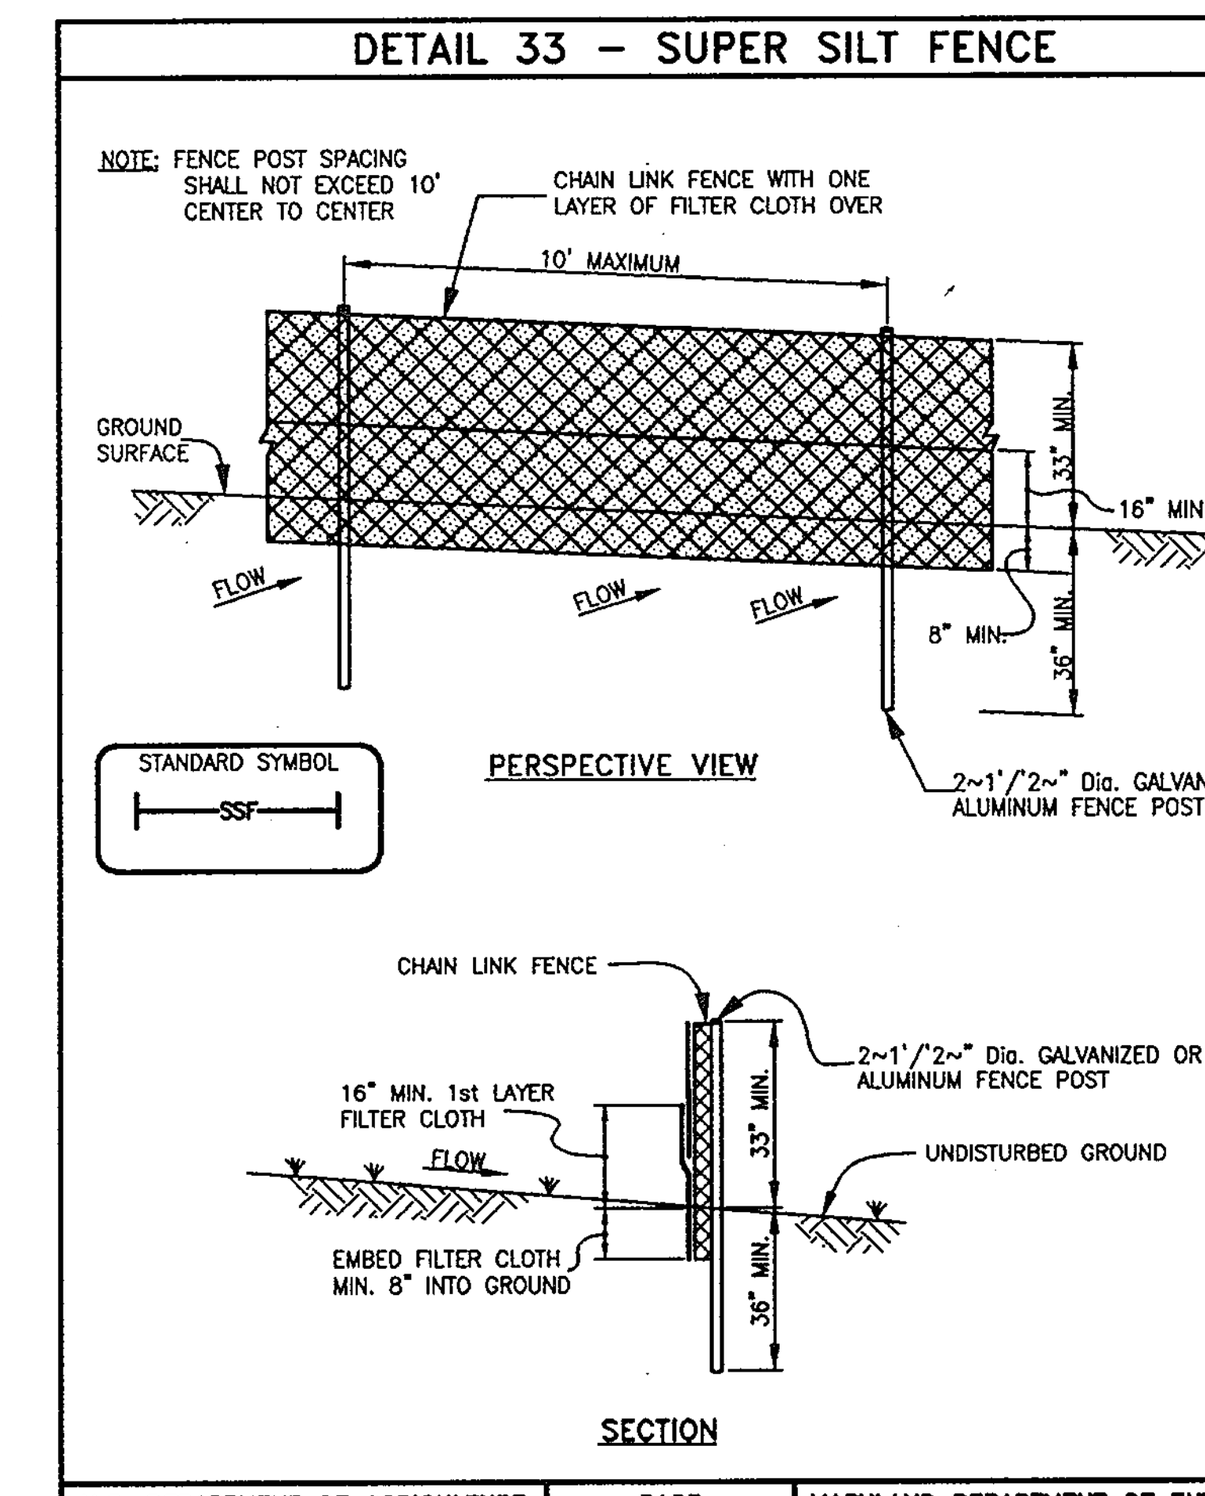


U.S. DEPARTMENT OF AGRICULTURE SOIL CONSERVATION SERVICE | PAGE H – 26 – 3 | MARYLAND DEPARTMENT OF ENVIRONMENT WATER MANAGEMENT ADMINISTRATION

### SUPER SILT FENCE

CONSTRUCTION SPECIFICATIONS

1. Fencing shall be 42" in height and constructed in accordance with the latest Maryland State Highway Details for Chain Link Fencing. The specification for a 6' fence shall be used, substituting 42" fabric and 6' length posts.
2. Chain link fence shall be fastened securely to the fence posts with wire ties. The lower tension wire, brace and truss rods, drive anchors and post caps are not required except on the ends of the fence.
3. Filter cloth shall be fastened securely to the chain link fence with ties spaced every 24" at the top and mid section.
4. Filter cloth shall be embedded a minimum of 8" into the ground.
5. When two sections of filter cloth adjoin each other, they shall be overlapped by 6" and folded.
6. Maintenance shall be performed as needed and silt buildups removed when "bulges" develop in the silt fence, or when silt reaches 50% of fence height
7. Filter cloth shall be fastened securely to each fence post with wire ties or staples at top and mid section and shall meet the following requirements for Geotextile Class F:

| | | |
|---|---|---|
| Tensile Strength | 50 lbs/in (min.) | Test: MSMT 509 |
| Tensile Modulus | 20 lbs/in (min.) | Test: MSMT 509 |
| Flow Rate | 0.3 gal/ft /minute (max.) | Test: MSMT 322 |
| Filtering Efficiency | 75% (min.) | Test: MSMT 322 |

SUPER SILT FENCE DESIGN CRITERIA

| Slope | Slope Steepness | Slope Length (maximum) | Silt Fence Length (maximum) |
|---|---|---|---|
| 0 – 10% | 0 – 10:1 | Unlimited | Unlimited |
| 10 – 20% | 10:1 – 5:1 | 200 feet | 1,500 feet |
| 20 – 33% | 5:1 – 3:1 | 100 feet | 1,000 feet |
| 33 – 50% | 3:1 – 2:1 | 100 feet | 500 feet |
| 50% + | 2:1 + | 50 feet | 250 feet |

U.S. DEPARTMENT OF AGRICULTURE SOIL CONSERVATION SERVICE | PAGE E – 26 – 3A | MARYLAND DEPARTMENT OF ENVIRONMENT WATER MANAGEMENT ADMINISTRATION

| NO. | DATE | REVISION |
|---|---|---|
| | | |

BENCHMARK
ENGINEERS ▲ LAND SURVEYORS ▲ PLANNERS
ENGINEERING, INC.
8480 BALTIMORE NATIONAL PIKE ▲ SUITE 418
ELLICOTT CITY, MARYLAND 21043
phone: 410-465-6105 ▲ fax: 410-465-6644
email: Benchmrk@cais.com

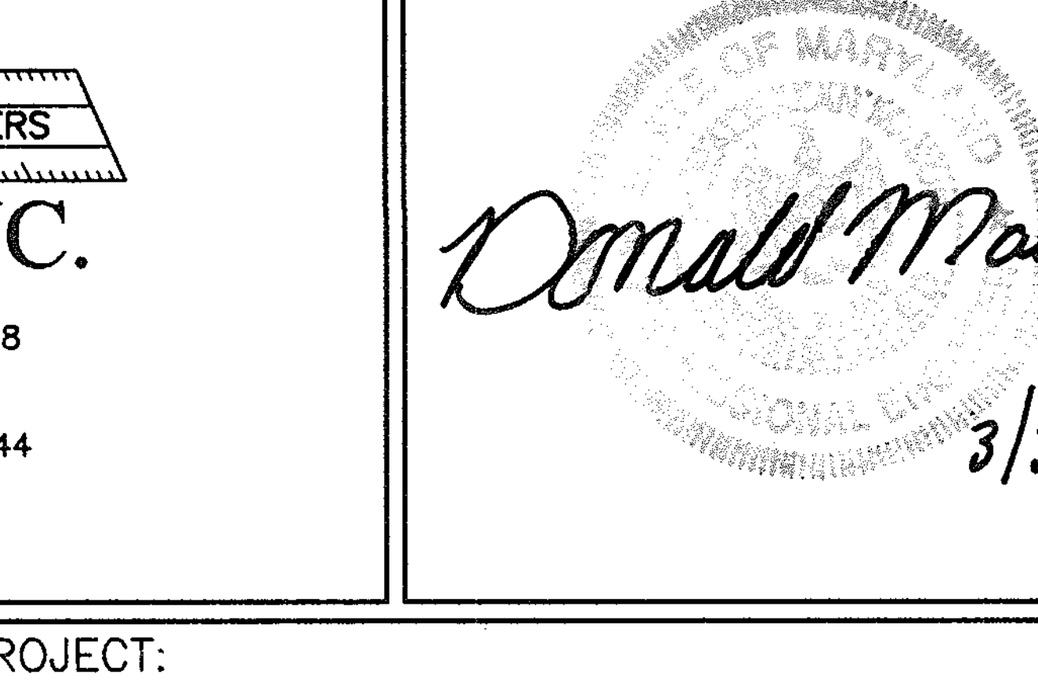


OWNER/DEVELOPER:
TRINITY QUALITY HOMES, INC.
3675 PARK AVENUE
SUITE 301
ELLICOTT CITY, MD 21043
410-480-0023

PROJECT:
THE CHASE AT STONEY BROOK
LOTS 1-20, PRESERVATION PARCEL "A" AND NON-BUILDABLE PRESERVATION PARCELS "B" THROUGH "D"

LOCATION: TAX MAP No. 7 BLOCK No. 17 PARCEL No. 133
4th ELECTION DISTRICT
HOWARD COUNTY, MARYLAND

TITLE: SEDIMENT & EROSION CONTROL NOTES AND DETAILS

| DATE: | MARCH, 2006 | PROJECT NO. 1187 |
|---|---|---|
| DESIGN: JMC / DRAFT: LAB / CHECK: DAM | SCALE: NOT TO SCALE | SHEET 12 OF 19 |

F-05-170

P:\1187\dwg\7023s12.dwg, Sheet 12, 3/31/2006 2:13:44 PM,
mc, Oce TDS600 HDI for mylar.pc3

NOTE:

AT THE TIME OF INSTALLMENT, ALL SHRUBS AND OTHER PLANTINGS HEREWITH LISTED AND APPROVED FOR THIS SITE, SHALL BE OF THE PROPER HEIGHT REQUIREMENTS IN ACCORDANCE WITH THE HOWARD COUNTY LANDSCAPE MANUAL. IN ADDITION, NO SUBSTITUTIONS OR RELOCATION OF REQUIRED PLANTINGS MAY BE MADE WITHOUT PRIOR REVIEW AND APPROVAL FROM THE DEPARTMENT OF PLANNING AND ZONING. ANY DEVIATION FROM THIS APPROVED LANDSCAPE PLAN MAY RESULT IN DENIAL OR DELAY IN RELEASE OF LANDSCAPE SURETY UNTIL SUCH TIME AS ALL REQUIRED MATERIALS ARE PLANTED AND/OR REVISIONS ARE MADE TO APPLICABLE PLANS AND CERTIFICATIONS.

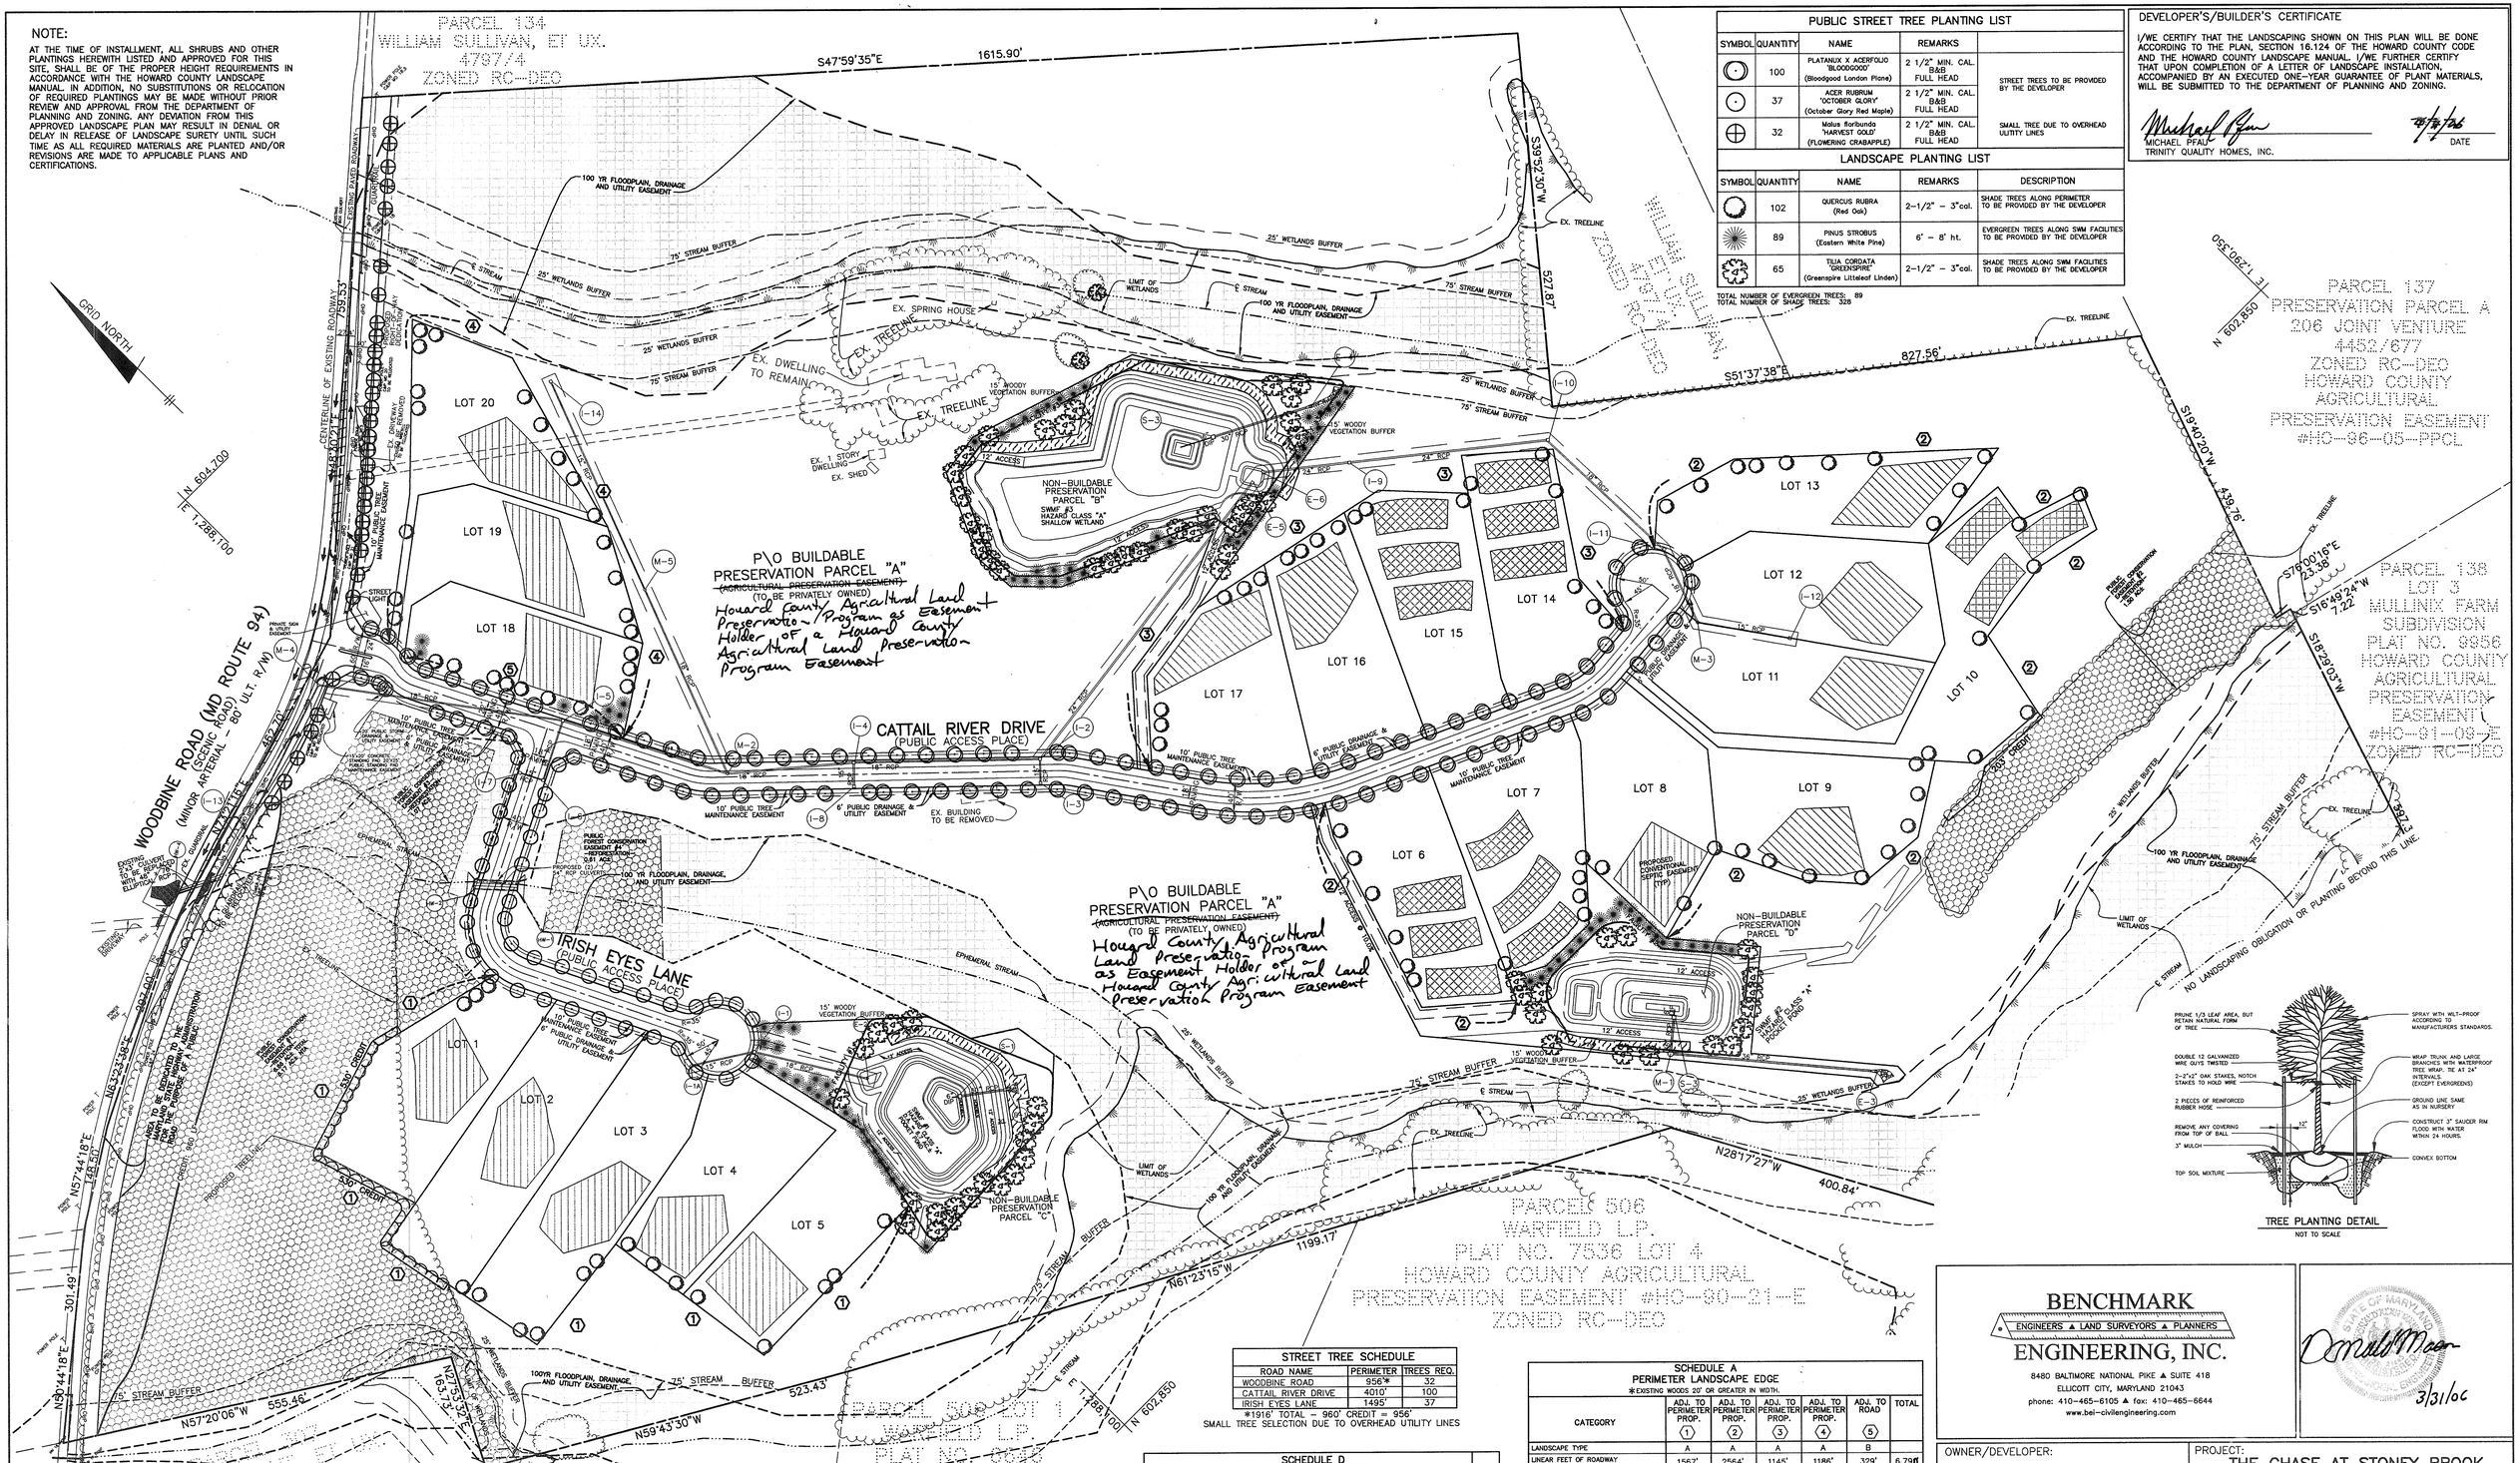


| PUBLIC STREET TREE PLANTING LIST | | | | |
|---|---|---|---|---|
| SYMBOL | QUANTITY | NAME | REMARKS | |
| | 100 | PLATANUX X ACERFOLIO 'BLOODGOOD' (Bloodgood London Plane) | 2 1/2" MIN. CAL. B&B FULL HEAD | STREET TREES TO BE PROVIDED BY THE DEVELOPER |
| | 37 | ACER RUBRUM 'OCTOBER GLORY' (October Glory Red Maple) | 2 1/2" MIN. CAL. B&B FULL HEAD | |
| | 32 | Malus floribunda 'HARVEST GOLD' (FLOWERING CRABAPPLE) | 2 1/2" MIN. CAL. B&B FULL HEAD | SMALL TREE DUE TO OVERHEAD ULITITY LINES |

| LANDSCAPE PLANTING LIST | | | | |
|---|---|---|---|---|
| SYMBOL | QUANTITY | NAME | REMARKS | DESCRIPTION |
| | 102 | QUERCUS RUBRA (Red Oak) | 2-1/2" - 3"cal. | SHADE TREES ALONG PERIMETER TO BE PROVIDED BY THE DEVELOPER |
| | 89 | PINUS STROBUS (Eastern White Pine) | 6' - 8' ht. | EVERGREEN TREES ALONG SWM FACILITIES TO BE PROVIDED BY THE DEVELOPER |
| | 65 | TILIA CORDATA 'GREENSPIRE' (Greenspire Littleleaf Linden) | 2-1/2" - 3"cal. | SHADE TREES ALONG SWM FACILITIES TO BE PROVIDED BY THE DEVELOPER |

TOTAL NUMBER OF EVERGREEN TREES: 89
TOTAL NUMBER OF SHADE TREES: 326

## DEVELOPER'S/BUILDER'S CERTIFICATE

I/WE CERTIFY THAT THE LANDSCAPING SHOWN ON THIS PLAN WILL BE DONE ACCORDING TO THE PLAN, SECTION 16.124 OF THE HOWARD COUNTY CODE AND THE HOWARD COUNTY LANDSCAPE MANUAL. I/WE FURTHER CERTIFY THAT UPON COMPLETION OF A LETTER OF LANDSCAPE INSTALLATION, ACCOMPANIED BY AN EXECUTED ONE-YEAR GUARANTEE OF PLANT MATERIALS, WILL BE SUBMITTED TO THE DEPARTMENT OF PLANNING AND ZONING.

MICHAEL PFAU
TRINITY QUALITY HOMES, INC.

4/3/06
DATE




TREE PLANTING DETAIL
NOT TO SCALE

| STREET TREE SCHEDULE | | |
|---|---|---|
| ROAD NAME | PERIMETER | TREES REQ. |
| WOODBINE ROAD | 956* | 32 |
| CATTAIL RIVER DRIVE | 4010' | 100 |
| IRISH EYES LANE | 1495' | 37 |

*1916' TOTAL - 960' CREDIT = 956'
SMALL TREE SELECTION DUE TO OVERHEAD UTILITY LINES

| SCHEDULE D<br>SWM AREA LANDSCAPING | | | | |
|---|---|---|---|---|
| | FACILITY 1 | FACILITY 2 | FACILITY 3 | TOTAL |
| LINEAR FEET OF PERIMETER | 966 | 804 | 1479 | 3249 |
| LINEAR FEET OF EXISTING WOODS LINE | 0 | 0 | 0 | 0 |
| LINEAR FEET OF REQUIRED PLANTING | 966 | 804 | 1479 | 3249 |
| BUFFER TYPE | "B" | "B" | "B" | – |
| NUMBER OF TREES REQUIRED<br>SHADE TREES<br>EVERGREEN TREES | <br>19<br>24 | <br>16<br>20 | <br>30<br>37 | <br>65<br>81 |
| NUMBER OF TREES PROVIDED<br>SHADE TREES<br>EVERGREEN TREES | <br>19<br>24 | <br>16<br>20 | <br>30<br>37 | <br>65<br>81 |
| CREDIT FOR EXISTING VEGETATION (NO, YES AND %) | NO | NO | NO | – |
| CREDIT FOR OTHER LANDSCAPING (NO, YES AND %) | NO | NO | NO | – |

| SCHEDULE A<br>PERIMETER LANDSCAPE EDGE<br>*EXISTING WOODS 20' OR GREATER IN WIDTH. | | | | | | |
|---|---|---|---|---|---|---|
| CATEGORY | ADJ. TO PERIMETER PROP. (1) | ADJ. TO PERIMETER PROP. (2) | ADJ. TO PERIMETER PROP. (3) | ADJ. TO PERIMETER PROP. (4) | ADJ. TO ROAD (5) | TOTAL |
| LANDSCAPE TYPE | A | A | A | A | B | |
| LINEAR FEET OF ROADWAY FRONTAGE/PERIMETER | 1567' | 2564' | 1145' | 1186' | 329' | 6,790' |
| CREDIT FOR EXISTING VEGETATION (YES, NO, LINEAR FEET) (DESCRIBE BELOW IF NEEDED) | YES* 530' | YES* 203' | NO | NO | NO | 733 |
| CREDIT FOR WALL, FENCE OR BERM (YES, NO, LINEAR FEET) (DESCRIBE BELOW IF NEEDED) | NO | NO | NO | NO | NO | |
| NUMBER OF PLANTS REQUIRED<br>SHADE TREES<br>EVERGREEN TREES<br>OTHER TREES (2:1 SUBSTITUTE)<br>SHRUBS | 1037'<br>17<br>–<br>–<br>– | 2361'<br>39<br>–<br>–<br>– | 1145'<br>19<br>–<br>–<br>– | 1186'<br>20<br>–<br>–<br>– | 328'<br>7<br>8<br>–<br>– | 6,057'<br>102<br>8<br>–<br>– |
| NUMBER OF PLANTS PROVIDED<br>SHADE TREES<br>EVERGREEN TREES<br>OTHER TREES (2:1 SUBSTITUTE)<br>SHRUBS | 1037'<br>17<br>–<br>–<br>– | 2361'<br>39<br>–<br>–<br>– | 1145'<br>19<br>–<br>–<br>– | 1186'<br>20<br>–<br>–<br>– | 328'<br>7<br>8<br>–<br>– | 6,057'<br>102<br>8<br>–<br>– |

## LANDSCAPE NOTES:

1. TREES SHOULD BE PLANTED A MINIMUM OF 6 FEET FROM THE EDGE OF PAVING AND MUST BE A MINIMUM OF 5 FEET FROM ANY STORM DRAIN.
2. TREES MUST BE PLANTED A MINIMUM OF 5 FEET FROM AN OPEN SPACE ACCESS STRIP, 10 FEET FROM A DRIVEWAY AND 15' FROM ANY STREET LIGHT.
3. SEE TREE PLANTING DETAIL - THIS SHEET.
4. THIS PLAN HAS BEEN PREPARED IN ACCORDANCE WITH THE PROVISIONS OF SECTION 16.124 OF THE HOWARD COUNTY CODE AND THE HOWARD COUNTY LANDSCAPE MANUAL.
5. FINANCIAL SURETY FOR THE REQUIRED LANDSCAPING HAS BEEN POSTED AS PART OF THE DPW DEVELOPER'S AGREEMENT IN THE AMOUNT OF $63,450.00. ($50,100.00 FOR 167 SHADE TREES, $13,350.00 FOR 89 EVERGREENS.

APPROVED: HOWARD COUNTY DEPARTMENT OF PUBLIC WORKS

CHIEF, BUREAU OF HIGHWAYS — DATE 4-21-06

APPROVED: HOWARD COUNTY DEPT. OF PLANNING AND ZONING

CHIEF, DIVISION OF LAND DEVELOPMENT — DATE 5/2/06

CHIEF, DEVELOPMENT ENGINEERING DIVISION MK — DATE 5/2/06


BENCHMARK
ENGINEERS ▲ LAND SURVEYORS ▲ PLANNERS
ENGINEERING, INC.
8480 BALTIMORE NATIONAL PIKE ▲ SUITE 418
ELLICOTT CITY, MARYLAND 21043
phone: 410-465-6105 ▲ fax: 410-465-6644
www.bei-civilengineering.com


STATE OF MARYLAND — DONALD T. MEAN — REGISTERED PROFESSIONAL ENGINEER — No. 19644
3/31/06

OWNER/DEVELOPER:
TRINITY QUALITY HOMES, INC.
3675 PARK AVENUE
SUITE 301
ELLICOTT CITY, MD 21043
410-480-0023

PROJECT:
THE CHASE AT STONEY BROOK
LOTS 1-20, PRESERVATION PARCEL "A" AND NON-BUILDABLE PRESERVATION PARCELS "B" THROUGH "D"

LOCATION:
TAX MAP No. 7 BLOCK No. 17 PARCEL No. 133
4th ELECTION DISTRICT
HOWARD COUNTY, MARYLAND

TITLE:
LANDSCAPE PLAN

DATE: AUGUST, 2005 / MARCH, 2006 — PROJECT NO. 1187

DES: JMC — DRAFT: RCS — CHECK: DAM — SCALE: 1" = 100' — SHEET 13 OF 19

F-05-170


187dwg\3022513.dwg, sheet 13, 3/31/2006 2:12:36 PM,
Oce TDS600 HDI for mylar.pc3

## BENCHMARK

ENGINEERS ▲ LAND SURVEYORS ▲ PLANNERS

**ENGINEERING, INC.**

8480 BALTIMORE NATIONAL PIKE ▲ SUITE 418
ELLICOTT CITY, MARYLAND 21043
phone: 410-465-6105 ▲ fax: 410-465-6644
www.bei-civilengineering.com

### LEGEND

- EXISTING CONTOURS
- PROPOSED CONTORS
- EXISTING TREELINE
- PROPOSED TREELINE
- SOIL DELINEATION LINE
- SOIL TYPE
- FOREST CONSERVATION EASEMENT
- STEEP SLOPES 25% OR GREATER
- STEEP SLOPES 15 - 24.9 %
- FCE — FOREST CONSERVATION SIGN
- X — TREE PROTECTION FENCE

### SOILS LEGEND

| SOIL | NAME | CLASS |
|---|---|---|
| ** Ba | Baile silt loam | D |
| * CuB | Comus silt loam, local alluvium, 3 to 8 percent slopes | B |
| GlB2 | Glenelg loam, 3 to 8 percent slopes, moderately eroded | B |
| GlC2 | Glenelg loam, 8 to 15 percent slopes, moderately eroded | B |
| GlC3 | Glenelg loam, 8 to 15 percent slopes, severely eroded | B |
| GlD3 | Glenelg loam, 15 to 25 percent slopes, severely eroded | B |
| GlD2 | Glenelg loam, 15 to 25 percent slopes, moderately eroded | B |
| * GnA | Glenville silt loam, 0 to 3 percent slopes | C |
| * GnB2 | Glenville silt loam, 3 to 8 percent slopes, moderately eroded | C |
| ** Ha | Hatboro silt loam | D |
| MtC2 | Mt. Airy channery loam, 8 to 15 percent slopes, moderately eroded | A |
| MtC3 | Mt. Airy channery loam, 8 to 15 percent slopes, severely eroded | A |
| MtD2 | Mt. Airy channery loam, 15 to 25 percent slopes, moderately eroded | A |
| MtE | Mt. Airy channery loam, 25 to 45 percent slopes | A |

NOTES:
* Hydric soils and/or contains hydric inclusions
** May contain hydric inclusions
† Generally only within 100-year floodplain areas

APPROVED: HOWARD COUNTY DEPARTMENT OF PUBLIC WORKS

CHIEF, BUREAU OF HIGHWAYS — DATE 4-21-06

APPROVED: HOWARD COUNTY DEPT. OF PLANNING AND ZONING

CHIEF, DIVISION OF LAND DEVELOPMENT — DATE 5/2/06

CHIEF, DEVELOPMENT ENGINEERING DIVISION — DATE 5/2/06

3/31/06

| DATE | NO. | REVISION |
|---|---|---|

OWNER/DEVELOPER:
TRINITY QUALITY HOMES, INC.
3675 PARK AVENUE
SUITE 301
ELLICOTT CITY, MD 21043
410-480-0023

PROJECT:
# THE CHASE AT STONEY BROOK

AREA:
TAX MAP 7 BLOCK 17 PARCEL 133
4 th ELECTION DISTRICT
HOWARD COUNTY, MARYLAND

TITLE:
## FOREST CONSERVATION PLAN

**WILDMAN ENVIRONMENTAL SERVICES**
4747 BONNIE BRANCH RD.
ELLICOTT CITY, MD. 21043
PHONE: 410-869-9999
FAX: 410-869-9901

DESIGNED BY: R.B.W.
DRAWN BY: D.B.T./J.E.P.
PROJECT NO. 1025
DATE: MARCH, 2006
SCALE: 1"= 100'
SHEET NO. 14 OF 19

F-05-170

1874dwg\7052s14_15.dwg, Sheet 14, 3/31/2006 3:19:02 PM,
, Oce TDS600 HDI for mylar.pc3

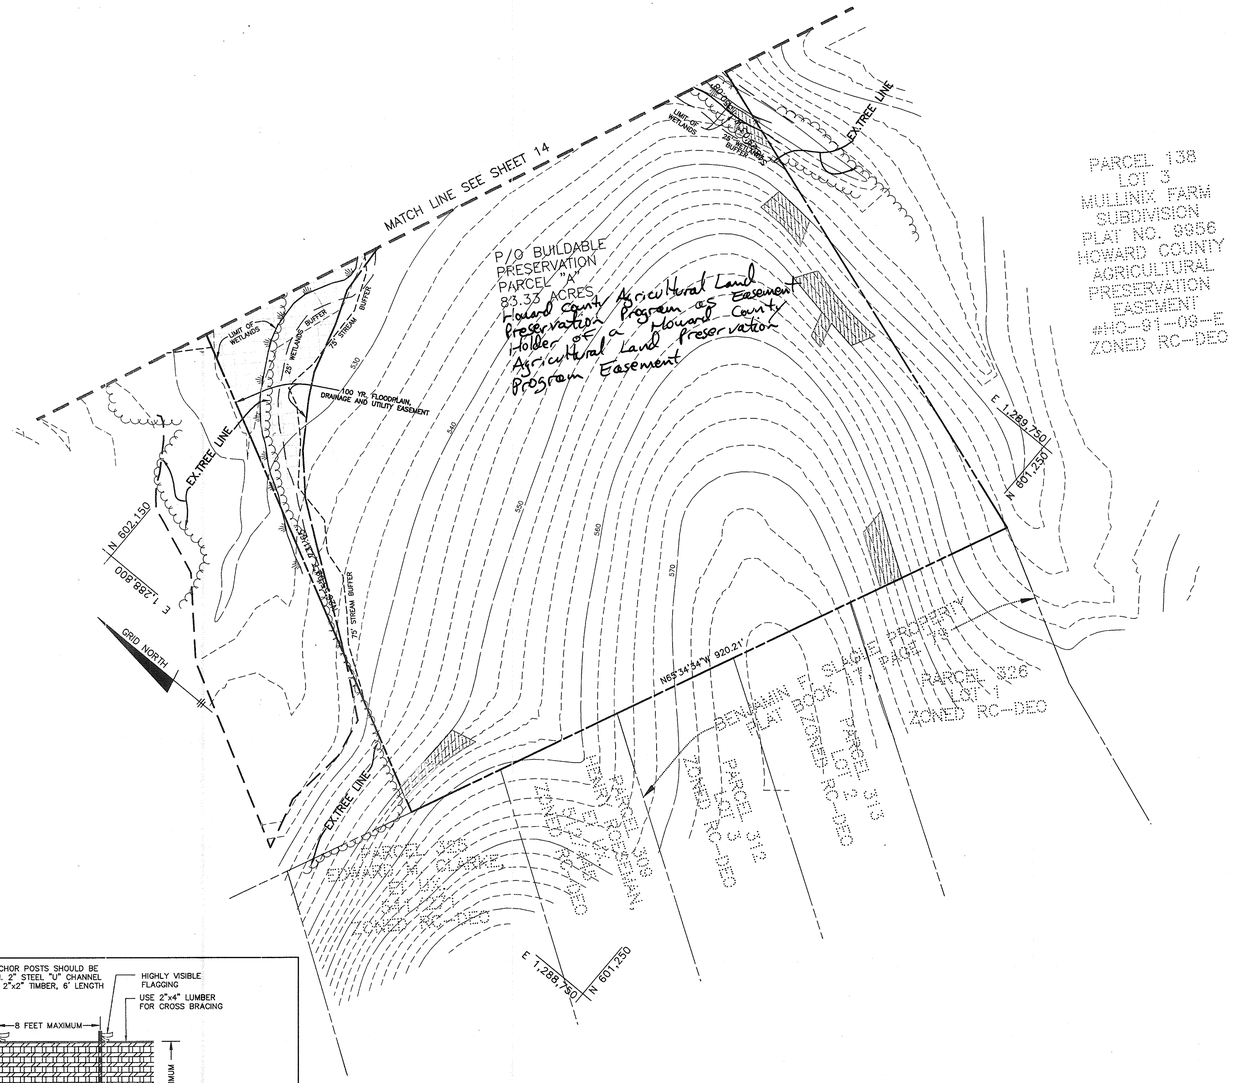


## FOREST CONSERVATION NOTES:

1. ANY FOREST CONSERVATION EASEMENT (FCE) AREA SHOWN HEREON IS SUBJECT TO PROTECTIVE COVENANTS WHICH WILL BE RECORDED IN THE LAND RECORDS OF HOWARD COUNTY WHICH RESTRICT THE DISTURBANCE AND USE OF THESE AREAS.
2. FORESTED AREAS OCCURRING OUTSIDE OF THE FCE SHALL NOT BE CONSIDERED PART OF THE FCE AND SHALL NOT BE SUBJECT TO PROTECTIVE LAND COVENANTS.
3. LIMITS OF DISTURBANCE SHALL BE RESTRICTED TO AREAS OUTSIDE THE LIMIT OF TEMPORARY FENCING OR THE FCE BOUNDARY, WHICHEVER IS GREATER.
4. THERE SHALL BE NO CLEARING, GRADING, CONSTRUCTION OR DISTURBANCE OF VEGETATION IN THE FOREST CONSERVATION EASEMENT, EXCEPT AS PERMITTED BY HOWARD COUNTY DPZ.
5. NO STOCKPILES, PARKING AREAS, EQUIPMENT CLEANING AREAS, ETC. SHALL OCCUR WITHIN AREAS DESIGNATED AS FOREST CONSERVATION EASEMENTS.
6. TEMPORARY FENCING SHALL BE USED TO PROTECT FOREST RESOURCES DURING CONSTRUCTION. THE FENCING SHALL BE PLACED ALONG ALL FCE BOUNDARIES WHICH OCCUR WITHIN 15 FEET OF THE PROPOSED LIMITS.
7. PERMANENT SIGNAGE SHALL BE PLACED 50-100' APART ALONG THE BOUNDARIES OF ALL AREAS INCLUDED IN FOREST CONSERVATION EASEMENTS.
8. FOREST CONSERVATION OBLIGATIONS ARE MET BY 7.54 ACRES OF RETENTION AND 1.68 ACRES OF REFORESTATION ON SITE. FINANCIAL SURETY FOR THE REQUIRED OBLIGATION MUST BE POSTED AS PART OF THE DEVELOPER'S AGREEMENT IN THE AMOUNT OF $102,278.88. THE TOTAL FOREST CONSERVATION OBLIGATION IS 9.22 ACRES.

**NOTE:**

WHIP PLANTINGS SHOULD BE INSTALLED IN A CURVILINEAR PATTERN TO FACILITATE MAINTENANCE BUT AVOID A GRID APPEARANCE. TREE SHELTERS SHOULD BE INSTALLED ON ALL WHIP PLANTINGS.

### FOREST CONSERVATION EASEMENT #3 (1.07 ACRES±)

| QTY.*** | SPECIES | SIZE | SPACING |
|---|---|---|---|
| 40 | Acer rubrum – RED MAPLE | 2–3' WHIP | ** |
| 35 | Robinia pseudoacacia – BLACK LOCUST | 2–3' WHIP | ** |
| 50 | Juglans nigra – BLACK WALNUT | 2–3' WHIP | ** |
| 40 | Juniperus virginiana – RED CEDAR | 2–3' WHIP | ** |
| 50 | Liriodendron tulipifera – POPLAR | 2–3' WHIP | ** |
| 20 | Nyssa sylvatica – BLACK GUM | 2–3' WHIP | ** |
| 50 | Prunus serotina – BLACK CHERRY | 2–3' WHIP | ** |
| 45 | Platanus occidentalis – SYCAMORE | 2–3' WHIP | ** |
| 30 | Quercus rubra – RED OAK | 2–3' WHIP | ** |
| 15 | Sassafras albidum – SASSAFRAS | 2–3' WHIP | ** |
| 375 | TOTAL 375 PLANTINGS REQUIRED | | |

### FOREST CONSERVATION EASEMENT #4 (0.61 ACRES±)

| QTY.*** | SPECIES | SIZE | SPACING |
|---|---|---|---|
| 30 | Acer rubrum – RED MAPLE | 2–3' WHIP | ** |
| 15 | Robinia pseudoacacia – BLACK LOCUST | 2–3' WHIP | ** |
| 24 | Juglans nigra – BLACK WALNUT | 2–3' WHIP | ** |
| 25 | Juniperus virginiana – RED CEDAR | 2–3' WHIP | ** |
| 30 | Liriodendron tulipifera – POPLAR | 2–3' WHIP | ** |
| 10 | Nyssa sylvatica – BLACK GUM | 2–3' WHIP | ** |
| 30 | Prunus serotina – BLACK CHERRY | 2–3' WHIP | ** |
| 25 | Platanus occidentalis – SYCAMORE | 2–3' WHIP | ** |
| 15 | Quercus rubra – RED OAK | 2–3' WHIP | ** |
| 10 | Sassafras albidum – SASSAFRAS | 2–3' WHIP | ** |
| 214 | TOTAL 207 PLANTINGS REQUIRED | | |

**KEY:**

** PLANTINGS TO BE SPACED AN AVERAGE OF 11 FOOT CENTERS – PLANTINGS SHOULD BE INSTALLED AS RANDOM OF AN ARRAINGEMENT AS POSSIBLE WITH GROUPING 3 TO 5 PLANTINGS AS EACH LOCATION.

PER COUNTY REQUIREMENTS, TREE SHELTERS SHOULD BE USED.

*** THE DEVELOPER RESERVE THE OPTION TO USE THE ALTERNATIVE PLANT MATERIAL SIZE AND DENSITY. IF 1" CALIPER TREES ARE USED THE QUANTITY REQUIRED SHALL BE 57.1% OF THE QUANTITY SPECIFIED IN THE ABOVE TABLE, IF 2" CALIPER TREES ARE PLANTED THE QUANTITY SHALL BE 28.6% OF THE QUANTITY SPECIFIED.

| Site Data | |
|---|---|
| | Areas |
| Gross Area: | 116.79 |
| 100 Year Floodplain: | 23.62 |
| Agricultural Pres. | 83.33 |
| Net Tract Area (NTA): | 33.46 |
| Existing Forest on NTA: | 8.46 |
| Afforestation Threshold: | 6.69 |
| Reforestation Threshold: | 8.37 |
| Forest not retained in FCE: | 0.92 |
| NTA Forest to be Retained in FCE: | 7.54 |

## APPENDIX E
## FOREST CONSERVATION WORKSHEET

**I. BASIC SITE DATA** (ACRES (1/10 acre))

| | |
|---|---|
| GROSS SITE AREA | 116.79 |
| AREA WITHIN 100 YEAR FLOOD PLAIN | 23.62 |
| AREA OF PRESERVATION PARCEL | 83.33 |
| AREA WITHIN AGRICULTURAL USE OR PRESERVATION PARCEL OUTSIDE OF FLOODPLAIN (IF APPLICABLE) | 59.71 |
| NET TRACT AREA | 33.46 |
| LAND USE CATEGORY (R–RLD, R–RMD, R–S, C/I/O, I) | R–RMD |

**II. INFORMATION FOR CALCULATIONS**

| | | |
|---|---|---|
| A. | NET TRACT AREA | 33.46 |
| B. | REFORESTATION THRESHOLD (25% x A) | 8.37 |
| C. | AFFORESTATION MINIMUM (20% x A) | 6.69 |
| D. | EXISTING FOREST ON NET TRACT AREA | 8.46 |
| E. | FOREST AREAS TO BE CLEARED | 0.92 |
| F. | FOREST AREAS TO BE RETAINED (RETENTION) | 7.54 |

**III. DETERMINING REQUIREMENTS: AFFORESTATION OR REFORESTATION**

1. Reforestation

If existing forest areas equal or exceed the afforestation minimum (if D equals or is more than C), and clearing of forest areas is proposed, reforestation requirements may apply.

GO TO SECTION IV

If existing forest areas equal or exceed the afforestation minimum (if D equals or is more than C), and no clearing of existing forest resources is proposed, no reforestation is required. No further calculations are needed.

2. Afforestation

If existing forest areas are less than the afforestation minimum (if D is less than C), afforestation requirements apply.

GO TO SECTION V

**NOTE:**

1. THIS PROJECT IS USING RURAL CLUSTER OPTION 'C' PER APPENDIX 'L' OF THE FOREST CONSERVATION MANUAL TO CALCULATE ITS FOREST CONSERVATION OBLIGATION.
2. THE 83.33 ACRES EXCLUDED FROM THE THE NET TRACT AREA IS PRESERVATION PARCEL 'A'.
3. There are no specimen trees on this site.

**IV. REFORESTATION CALCULATIONS** (ACRES (1/10 acre))

| | |
|---|---|
| A. NET TRACT AREA | 33.46 |
| B. REFORESTATION THRESHOLD (25% x A) | 8.37 |
| D. EXISTING FOREST ON NET TRACT AREA | 8.46 |
| E. FOREST AREAS TO BE CLEARED | 0.92 |
| F. FOREST AREAS TO BE RETAINED | 7.54 |
| G. FOREST AREAS CLEARED ABOVE REFORESTATION THRESHOLD (D–F, If F equals or is greater than B, Alternate 1) (D–B, If F is less than B, Alternate 2) | 0.09 |
| H. FOREST AREAS CLEARED BELOW REFORESTATION THRESHOLD (B–F, If applicable) | 0.83 |
| I. FOREST AREAS RETAINED ABOVE REFORESTATION THRESHOLD (F–B, Retention Credit, if applicable) | 0 |

SELECT THE ALTERNATE THAT APPLIES:

1. Clearing above the threshold only

If forest areas to be retained equal or are greater than the reforestation threshold (if F equals or is greater than B), the following calculations apply:

| | |
|---|---|
| REFORESTATION FOR CLEARING ABOVE THRESHOLD G x 1/4 | 0.02 |
| CREDIT FOR FOREST AREAS RETAINED ABOVE THRESHOLD I = Retention Credit | 0 |
| TOTAL REFORESTATION REQUIRED (G x 1/4) – I | 0 |

If the total reforestation requirement is equal to or less than 0, no reforestation is required.

2. Clearing below the threshold

If forest areas to be retained are less than the reforestation threshold (if F is less than B), the following calculations apply:

| | |
|---|---|
| REFORESTATION FOR CLEARING ABOVE THRESHOLD G x 1/4 | 0.02 |
| REFORESTATION FOR CLEARING BELOW THRESHOLD H x 2 | 1.66 |
| TOTAL REFORESTATION REQUIRED (G x 1/4) + (H x 2) | 1.68 |

Since clearing occurs below the threshold, no forest retention credit is possible

| FOREST CONSERVATION TABULATION | | |
|---|---|---|
| DESIGNATION | TYPE | ACREAGE |
| #1 | RETENTION | 6.04 NTA |
| #2 | RETENTION | 1.50 |
| #3 | REFORESTATION | 1.07 |
| #4 | REFORESTATION | 0.61 |
| TOTAL: | MIX | 9.24 |

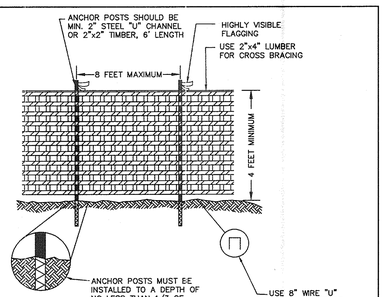


NOTES:
1. BLAZE ORANGE OR BLUE PLASTIC MESH FENCE FOR FOREST PROTECTION DEVICE ONLY.
2. BOUNDARIES OF RETENTION AREA WILL BE ESTABLISHED AS PART OF THE FOREST CONSERVATION PLAN REVIEW PROCESS.
3. BOUNDARIES OF RETENTION AREA SHOULD BE STAKED AND FLAGGED PRIOR TO INSTALLATION.
4. AVOID DAMAGE TO CRITICAL ROOT ZONE. DO NOT DAMAGE OR SEVER LARGE ROOTS WHEN INSTALLING POSTS.
5. PROTECTIVE SIGNS ARE REQUIRED.
6. DEVICE SHOULD BE MAINTAINED THROUGHOUT CONSTRUCTION.

ADAPTED FROM PRINCE GEORGE'S COUNTY, MD. WOODLAND CONSERVATION MANUAL AND FOREST CONSERVATION MANUAL, 1991.

PLASTIC MESH TREE PROTECTION FENCE

FOREST RETENTION AREA

MACHINERY, DUMPING OR STORAGE OF ANY MATERIALS IS *PROHIBITED*

VIOLATORS ARE SUBJECT TO FINES AS IMPOSED BY THE HOWARD COUNTY FOREST CONSERVATION ACT OF 1992

MIN. 15" / MIN. 11"

SPECIMEN TREE

DO NOT REMOVE

MACHINERY, DUMPING OR STORAGE OF ANY MATERIALS IS *PROHIBITED*

VIOLATORS ARE SUBJECT TO FINES AS IMPOSED BY THE HOWARD COUNTY FOREST CONSERVATION ACT OF 1992

MIN. 15" / MIN. 11"

Forest Conservation Area

REFORESTATION PROJECT

*Trees For Your Future*

MIN. 15" / MIN. 11"

PROTECTIVE SIGNAGE

*SOILS LEGEND*

| SOIL | NAME | CLASS |
|---|---|---|
| ** Ba | Basile silt loam | D |
| * CuB | Cornus silt loam, local alluvium, 3 to 8 percent slopes | B |
| GlB2 | Glenelg loam, 3 to 8 percent slopes, moderately eroded | B |
| GlC2 | Glenelg loam, 8 to 15 percent slopes, moderately eroded | B |
| GlC3 | Glenelg loam, 8 to 15 percent slopes, severely eroded | B |
| GlD3 | Glenelg loam, 15 to 25 percent slopes, severely eroded | B |
| GlD2 | Glenelg loam, 15 to 25 percent slopes, moderately eroded | B |
| * GnA | Glenville silt loam, 0 to 3 percent slopes | C |
| * GnB2 | Glenville silt loam, 3 to 8 percent slopes, moderately eroded | C |
| ** Ha | Hatboro silt loam | D |
| MfC2 | Mt. Airy channery loam, 8 to 15 percent slopes, moderately eroded | A |
| MfC3 | Mt. Airy channery loam, 8 to 15 percent slopes, severely eroded | A |
| MfD2 | Mt. Airy channery loam, 15 to 25 percent slopes, moderately eroded | A |
| MfE | Mt. Airy channery loam, 25 to 45 percent slopes | A |

*NOTES:*
* *Hydric soils and/or contains hydric inclusions*
** *May contain hydric inclusions*
† *Generally only within 100-year floodplain areas*

**LEGEND**

EXISTING CONTOURS
PROPOSED CONTORS
EXISTING TREELINE
PROPOSED TREELINE
SOIL DELINEATION LINE
GlB2 SOIL TYPE
FOREST CONSERVATION EASEMENT
STEEP SLOPES 25% OR GREATER
STEEP SLOPES 15 – 24.9 %
FCE FOREST CONSERVATION SIGN
TREE PROTECTION FENCE

Donald Moore 3/31/06

APPROVED: HOWARD COUNTY DEPARTMENT OF PUBLIC WORKS
William F. Weber Jr. 4-21-06
CHIEF, BUREAU OF HIGHWAYS MR DATE

APPROVED: HOWARD COUNTY DEPT. OF PLANNING AND ZONING
Cindy Harrod 5/12/06
CHIEF, DIVISION OF LAND DEVELOPMENT JA DATE
5/2/06
CHIEF, DEVELOPMENT ENGINEERING DIVISION MK DATE


BENCHMARK
ENGINEERS ▲ LAND SURVEYORS ▲ PLANNERS
ENGINEERING, INC.
8480 BALTIMORE NATIONAL PIKE ▲ SUITE 418
ELLICOTT CITY, MARYLAND 21043
phone: 410-465-6105 ▲ fax: 410-465-6644
www.bei-civilengineering.com


| DATE | NO. | REVISION |
|---|---|---|

OWNER/DEVELOPER:
TRINITY QUALITY HOMES, INC.
3675 PARK AVENUE
SUITE 301
ELLICOTT CITY, MD 21043
410-480-0023

PROJECT:
THE CHASE AT STONEY BROOK

AREA:
TAX MAP 7 BLOCK 17 PARCEL 133
4 th ELECTION DISTRICT
HOWARD COUNTY, MARYLAND

TITLE:
FOREST CONSERVATION PLAN


WILDMAN ENVIRONMENTAL SERVICES
4747 BONNIE BRANCH RD.
ELLICOTT CITY, MD. 21043
PHONE: 410-869-9999
FAX: 410-869-9901


| | |
|---|---|
| DESIGNED BY: | R.B.W. |
| DRAWN BY: | D.B.T./J.E.P. |
| PROJECT NO. | 1025 |
| DATE: | MARCH, 2006 |
| SCALE: | 1"= 100' |
| SHEET NO. | 15 OF 19 |

F-05-170


P:\1187\dwg\7052s14_15.dwg, Sheet 15, 3/31/2006 3:19:11 PM, jmc, Oce TDS600 HDI for mylar.pc3




NOTES:

1. IF WATER IS ENCOUNTERED DURING THE CONSTRUCTION OF THE CORE TRENCH, IT IS TO BE REMOVED BY PUMPING.
2. CORE TRENCH SHALL CONSIST OF IMPERVIOUS MATERIAL (GC, SC, CL, CH) AS DIRECTED BY A GEOTECHNICAL ENGINEER ONSITE AND MAY REQUIRE TO BE HAULED FROM AN OFFSITE LOCATION.

## CORE TRENCH SECTION
NOT TO SCALE




## PROFILE THROUGH FOREBAY WEIR
NOT TO SCALE

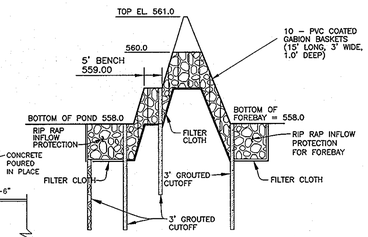


## TYPICAL SECTION OF GABION WEIR AT FOREBAY
NOT TO SCALE




NOTE:
LOCATE COLLARS A MINIMUM OF 3' FROM ANY PIPE JOINT

## ANTI-SEEP COLLAR
NOT TO SCALE




## GABION BASKET LAYOUT
NOT TO SCALE

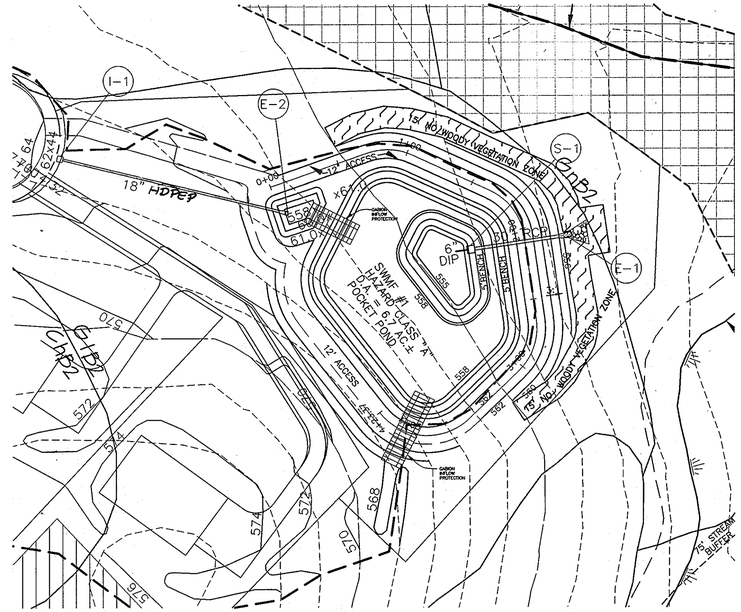


## POND #1 DETAIL
SCALE: 1" = 50'

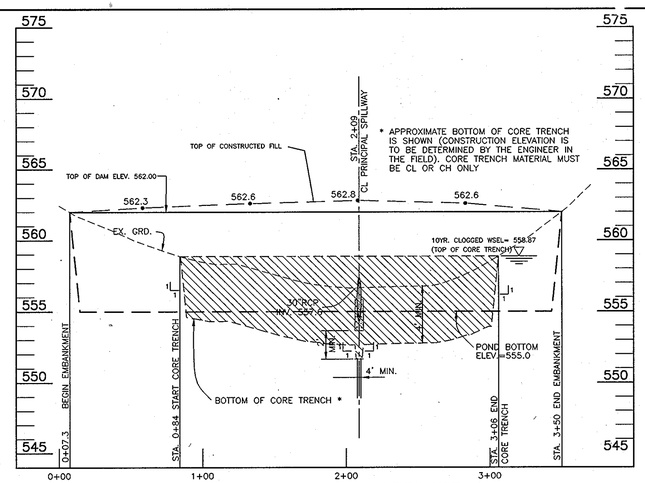


* APPROXIMATE BOTTOM OF CORE TRENCH IS SHOWN (CONSTRUCTION ELEVATION IS TO BE DETERMINED BY THE ENGINEER IN THE FIELD). CORE TRENCH MATERIAL MUST BE CL OR CH ONLY

## PROFILE ALONG CL OF EMBANKMENT
SCALE: 1"=50' HORIZ., 1"=5' VERT.

## OPERATION AND MAINTENANCE SCHEDULE FOR PRIVATELY OWNED AND MAINTAINED EXTENDED DETENTION POND

**ROUTINE MAINTENANCE:**

1. FACILITY SHALL BE INSPECTED ANNUALLY AND AFTER MAJOR STORMS. INSPECTIONS SHALL BE PERFORMED DURING WET WEATHER TO DETERMINE IF THE POND IS FUNCTIONING PROPERLY.
2. TOP AND SIDE SLOPES OF THE EMBANKMENT SHALL BE MOWED A MINIMUM OF TWO (2) TIMES PER YEAR, ONCE IN JUNE AND ONCE IN SEPTEMBER. OTHER SIDE SLOPES AND MAINTENANCE ACCESS SHALL BE MOWED AS NEEDED.
3. DEBRIS AND LITTER SHALL BE REMOVED DURING REGULAR MOWING OPERATIONS AND AS NEEDED.
4. VISIBLE SIGNS OF EROSION IN THE POND AS WELL AS THE RIP-RAP OR GABION OUTLET AREA SHALL BE REPAIRED AS SOON AS IT IS NOTICED.

**NON-ROUTINE MAINTENANCE:**

1. STRUCTURAL COMPONENTS OF THE POND SUCH AS THE DAM, THE RISER, AND THE PIPES SHALL BE REPAIRED UPON THE DETECTION OF ANY DAMAGE. THE COMPONENTS SHALL BE INSPECTED DURING ROUTINE MAINTENANCE OPERATIONS.
2. SEDIMENTS SHALL BE REMOVED FROM THE POND, AND FOREBAY, NO LATER THAN WHEN THE CAPACITY OF THE POND, OR FOREBAY, IS HALF FULL OF SEDIMENT, OR, WHEN DEEMED NECESSARY FOR AESTHETIC REASONS, UPON APPROVAL FROM THE DEPARTMENT OF PUBLIC WORKS.

## AS-BUILT CERTIFICATION

I HEREBY CERTIFY THAT THE FACILITY SHOWN ON THIS PLAN WAS CONSTRUCTED AS SHOWN ON THE "AS-BUILT" PLANS AND MEETS THE APPROVED PLANS AND SPECIFICATIONS.

PE NO. 21443

DONALD A. MASON — DATE

CERTIFY MEANS TO STATE OR DECLARE A PROFESSIONAL OPINION BASED UPON ONSITE INSPECTIONS AND MATERIAL TESTS WHICH ARE CONDUCTED DURING CONSTRUCTION. THE ONSITE INSPECTIONS AND MATERIAL TESTS ARE THOSE INSPECTIONS AND TESTS DEEMED SUFFICIENT AND APPROPRIATE BY COMMONLY ACCEPTED ENGINEERING STANDARDS. CERTIFY DOES NOT MEAN OR IMPLY A GUARANTEE BY THE ENGINEER NOR DOES AN ENGINEER'S CERTIFICATION RELIEVE ANY OTHER PARTY FROM MEETING REQUIREMENTS IMPOSED BY CONTRACT, EMPLOYMENT, OR OTHER MEANS, INCLUDING MEETING COMMONLY ACCEPTED INDUSTRY PRACTICES.

**BY THE DEVELOPER:**

"I/WE CERTIFY THAT ALL DEVELOPMENT AND/OR CONSTRUCTION WILL BE DONE ACCORDING TO THESE PLANS, AND THAT ANY RESPONSIBLE PERSONNEL INVOLVED IN THE CONSTRUCTION PROJECT WILL HAVE A CERTIFICATE OF ATTENDANCE AT A DEPARTMENT OF THE ENVIRONMENT APPROVED TRAINING PROGRAM FOR THE CONTROL OF SEDIMENT AND EROSION BEFORE BEGINNING THE PROJECT. I SHALL ENGAGE A REGISTERED PROFESSIONAL ENGINEER TO SUPERVISE POND CONSTRUCTION AND PROVIDE THE HOWARD SOIL CONSERVATION DISTRICT WITH AN "AS-BUILT" PLAN OF THE POND WITHIN 30 DAYS OF COMPLETION. I ALSO AUTHORIZE PERIODIC ON-SITE INSPECTIONS BY THE HOWARD SOIL CONSERVATION DISTRICT."

DEVELOPER — DATE 4/4/06

**BY THE ENGINEER:**

"I/WE CERTIFY THAT THIS PLAN FOR POND CONSTRUCTION, EROSION AND SEDIMENT CONTROL REPRESENTS A PRACTICAL AND WORKABLE PLAN BASED ON MY PERSONAL KNOWLEDGE OF THE SITE CONDITIONS. THIS PLAN WAS PREPARED IN ACCORDANCE WITH THE REQUIREMENTS OF THE HOWARD SOIL CONSERVATION DISTRICT. I HAVE NOTIFIED THE DEVELOPER THAT HE/SHE MUST ENGAGE A REGISTERED PROFESSIONAL ENGINEER TO SUPERVISE POND CONSTRUCTION AND PROVIDE THE HOWARD SOIL CONSERVATION DISTRICT WITH AN "AS-BUILT" PLAN OF THE POND WITHIN 30 DAYS OF COMPLETION."

ENGINEER – DONALD A. MASON, P.E. # 21443 — DATE 3/31/06

THESE PLANS HAVE BEEN REVIEWED FOR THE HOWARD SOIL CONSERVATION DISTRICT AND MEET THE TECHNICAL REQUIREMENTS FOR SMALL POND CONSTRUCTION, SOIL EROSION, AND SEDIMENT CONTROL.

USDA – NATURAL RESOURCES CONSERVATION SERVICE — DATE 4/4/06

THESE PLANS FOR SMALL POND CONSTRUCTION, SOIL EROSION, AND SEDIMENT CONTROL MEET THE REQUIREMENTS OF THE HOWARD SOIL CONSERVATION DISTRICT.

HOWARD SOIL CONSERVATION DISTRICT — DATE 4/14/06

APPROVED: DEPARTMENT OF PUBLIC WORKS

CHIEF, BUREAU OF HIGHWAYS — DATE 4-21-06

APPROVED: DEPARTMENT OF PLANNING AND ZONING

CHIEF, DIVISION OF LAND DEVELOPMENT — DATE 5/12/06

CHIEF, DEVELOPMENT ENGINEERING DIVISION — DATE 5/12/06

## SOILS LEGEND

| SOIL | NAME | CLASS |
|---|---|---|
| ** Ba | Baile silt loam | D |
| * CuB | Comus silt loam, local alluvium, 3 to 8 percent slopes | B |
| GlB2 | Glenelg loam, 3 to 8 percent slopes, moderately eroded | B |
| GlC2 | Glenelg loam, 8 to 15 percent slopes, moderately eroded | B |
| GlC3 | Glenelg loam, 8 to 15 percent slopes, severely eroded | B |
| GlD3 | Glenelg loam, 15 to 25 percent slopes, severely eroded | B |
| GlD2 | Glenelg loam, 15 to 25 percent slopes, moderately eroded | B |
| * GnA | Glenville silt loam, 0 to 3 percent slopes | C |
| * GnB2 | Glenville silt loam, 3 to 8 percent slopes, moderately eroded | C |
| ** Ha | Hatboro silt loam | D |
| MtC2 | Mt. Airy channery loam, 8 to 15 percent slopes, moderately eroded | A |
| MtC3 | Mt. Airy channery loam, 8 to 15 percent slopes, severely eroded | A |
| MtD2 | Mt. Airy channery loam, 15 to 25 percent slopes, moderately eroded | A |
| MtE | Mt. Airy channery loam, 25 to 45 percent slopes | A |

*NOTES:*

* *Hydric soils and/or contains hydric inclusions*

** *May contain hydric inclusions*

† *Generally only within 100-year floodplain areas*




## TYPE A-2 CONCRETE CRADLE
NOT TO SCALE



TOP

NOTES:

1. TRASH RACK SHALL BE GALVANIZED AFTER FABRICATION
2. TRASH RACK SHALL BE PAINTED BATTLESHIP GRAY.
2. TRASH RACK TO BE INSTALLED UPON CONVERSION TO SWM POND.




## TSWM PERFORATION DETAIL
NOT TO SCALE

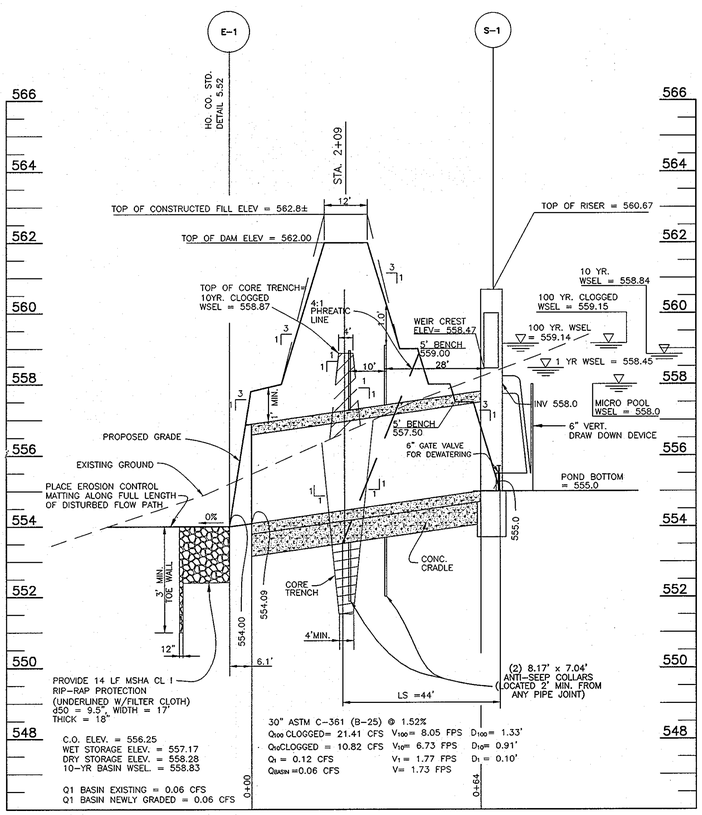


## SECTION THRU PRINCIPAL SPILLWAY
SCALE: 1"=20' HORIZ., 1"=2' VERT.

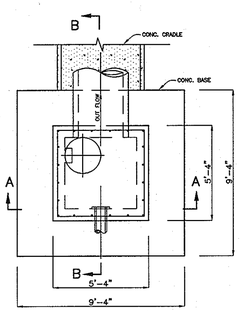





FRONT ELEVATION




SIDE ELEVATION

## TRASH RACK DETAIL
SCALE: 1" = 4'

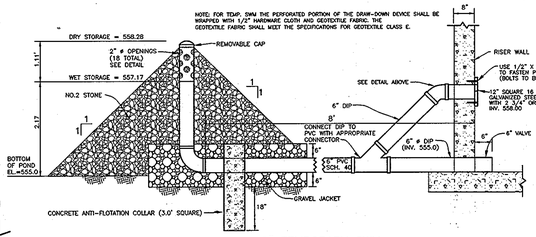


## 6" TEMPORARY SWM VERTICAL DRAW-DOWN DEVICE
NOT TO SCALE

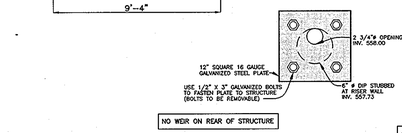


NO WEIR ON REAR OF STRUCTURE




SECTION A-A
FRONT VIEW

4' WEIR TO BE PLACED ON BOTH SIDES

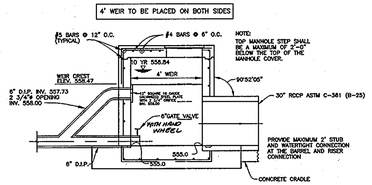


SECTION B-B
SIDE VIEW




FRONT AND SIDE ELEVATIONS
BLOCKING DETAIL FOR POND #1 TEMPORARY SWM DURING CONSTRUCTION
NOT TO SCALE

CONTROL STRUCTURE – POND #1
SCALE: 1" = 4'

STATE OF MARYLAND — ROBERT HARRY VOEBEL — No. 16993 — PROFESSIONAL ENGINEER — 3/31/12

ROBERT H. VOEBEL, P.E.
NO. 16993
FOR REVISION #2 ONLY

| NO. | DATE | REVISION |
|---|---|---|
| | | |
| | | |
| 2 | 6/11/12 | REVISE PLAN TO DELETE WATERTIGHT MANHOLE FRAME AND COVER; ADD HAND WHEEL TO POND DRAIN AND RELOCATE STANDING PAD |
| 1 | 12/06/06 | REVISE STORM DRAIN MATERIAL |


BENCHMARK
ENGINEERS ▲ LAND SURVEYORS ▲ PLANNERS
ENGINEERING, INC.
8480 BALTIMORE NATIONAL PIKE ▲ SUITE 418
ELLICOTT CITY, MARYLAND 21043
phone: 410-465-6105 ▲ fax: 410-465-6644
www.bei-civilengineering.com


3/31/06

OWNER/DEVELOPER:
TRINITY QUALITY HOMES, INC.
3675 PARK AVENUE
SUITE 301
ELLICOTT CITY, MD 21043
410-480-0023

PROJECT:
# THE CHASE AT STONEY BROOK
LOTS 1-20, PRESERVATION PARCEL "A" AND NON-BUILDABLE PRESERVATION PARCELS "B" THROUGH "D"

LOCATION:
TAX MAP 7, BLOCK 17 PARCEL 133
4th ELECTION DISTRICT
HOWARD COUNTY, MARYLAND

TITLE:
STORMWATER MANAGEMENT FACILITY #1 (POCKET POND)

DATE: MARCH, 2006 — PROJECT NO. 1187

DES: JMC — DRAFT: JMC — CHECK: DAM — SCALE: AS SHOWN — SHEET 16 OF 19

F-05-170


P:\11187dwg\7024F123S16-18.dwg, SWMF1, 3/31/2006 2:16:00 PM, imc, Oce TDS600 H20 for mylar.pc3

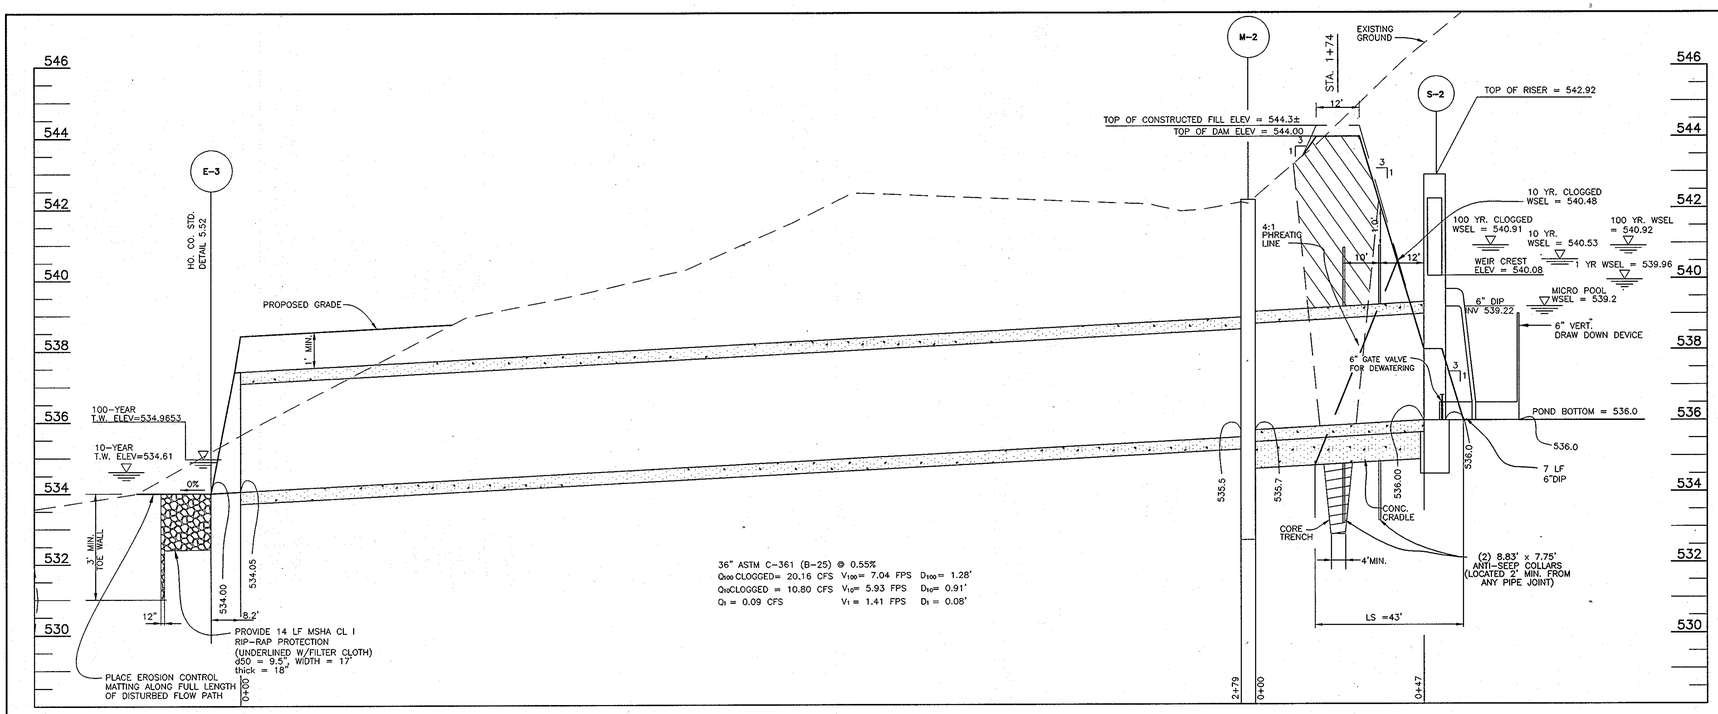


SECTION THRU PRINCIPAL SPILLWAY
SCALE: 1"=20' HORIZ., 1"=2' VERT.

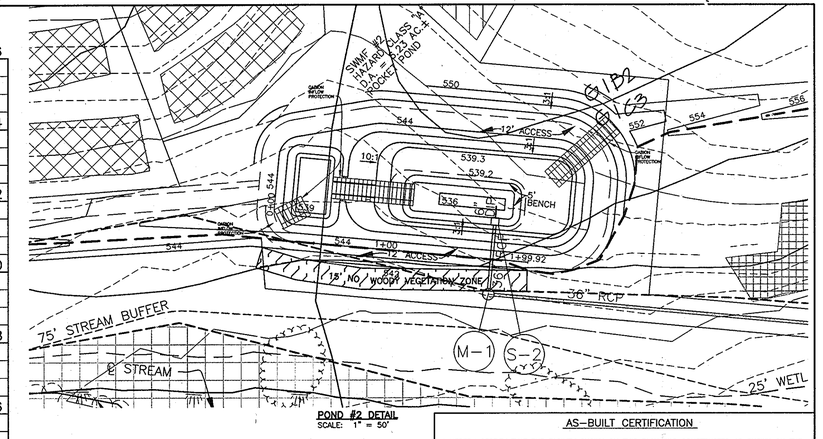


POND #2 DETAIL
SCALE: 1" = 50'

## OPERATION AND MAINTENANCE SCHEDULE FOR PRIVATELY OWNED AND MAINTAINED EXTENDED DETENTION POND

**ROUTINE MAINTENANCE:**

1. FACILITY SHALL BE INSPECTED ANNUALLY AND AFTER MAJOR STORMS. INSPECTIONS SHALL BE PERFORMED DURING WET WEATHER TO DETERMINE IF THE POND IS FUNCTIONING PROPERLY.
2. TOP AND SIDE SLOPES OF THE EMBANKMENT SHALL BE MOWED A MINIMUM OF TWO (2) TIMES PER YEAR, ONCE IN JUNE AND ONCE IN SEPTEMBER. OTHER SIDE SLOPES AND MAINTENANCE ACCESS SHALL BE MOWED AS NEEDED.
3. DEBRIS AND LITTER SHALL BE REMOVED DURING REGULAR MOWING OPERATIONS AND AS NEEDED.
4. VISIBLE SIGNS OF EROSION IN THE POND AS WELL AS THE RIP-RAP OR GABION OUTLET AREA SHALL BE REPAIRED AS SOON AS IT IS NOTICED.

**NON-ROUTINE MAINTENANCE:**

1. STRUCTURAL COMPONENTS OF THE POND SUCH AS THE DAM, THE RISER, AND THE PIPES SHALL BE REPAIRED UPON THE DETECTION OF ANY DAMAGE. THE COMPONENTS SHALL BE INSPECTED DURING ROUTINE MAINTENANCE OPERATIONS.
2. SEDIMENTS SHALL BE REMOVED FROM THE POND, AND FOREBAY, NO LATER THAN WHEN THE CAPACITY OF THE POND, OR FOREBAY, IS HALF FULL OF SEDIMENT, OR, WHEN DEEMED NECESSARY FOR AESTHETIC REASONS, UPON APPROVAL FROM THE DEPARTMENT OF PUBLIC WORKS.

## AS-BUILT CERTIFICATION

I HEREBY CERTIFY THAT THE FACILITY SHOWN ON THIS PLAN WAS CONSTRUCTED AS SHOWN ON THE "AS-BUILT" PLANS AND MEETS THE APPROVED PLANS AND SPECIFICATIONS.

PE NO. 21443

DONALD A. MASON

DATE

CERTIFY MEANS TO STATE OR DECLARE A PROFESSIONAL OPINION BASED UPON ONSITE INSPECTIONS AND MATERIAL TESTS WHICH ARE CONDUCTED DURING CONSTRUCTION. THE ONSITE INSPECTIONS AND MATERIAL TESTS ARE THOSE INSPECTIONS AND TESTS DEEMED SUFFICIENT AND APPROPRIATE BY COMMONLY ACCEPTED ENGINEERING STANDARDS. CERTIFY DOES NOT MEAN OR IMPLY A GUARANTEE BY THE ENGINEER NOR DOES AN ENGINEER'S CERTIFICATION RELIEVE ANY OTHER PARTY FROM MEETING REQUIREMENTS IMPOSED BY CONTRACT, EMPLOYMENT, OR OTHER MEANS, INCLUDING MEETING COMMONLY ACCEPTED INDUSTRY PRACTICES.

BY THE DEVELOPER:

"I/WE CERTIFY THAT ALL DEVELOPMENT AND/OR CONSTRUCTION WILL BE DONE ACCORDING TO THESE PLANS, AND THAT ANY RESPONSIBLE PERSONNEL INVOLVED IN THE CONSTRUCTION PROJECT WILL HAVE A CERTIFICATE OF ATTENDANCE AT A DEPARTMENT OF THE ENVIRONMENT APPROVED TRAINING PROGRAM FOR THE CONTROL OF SEDIMENT AND EROSION BEFORE BEGINNING THE PROJECT. I SHALL ENGAGE A REGISTERED PROFESSIONAL ENGINEER TO SUPERVISE POND CONSTRUCTION AND PROVIDE THE HOWARD SOIL CONSERVATION DISTRICT WITH AN "AS-BUILT" PLAN OF THE POND WITHIN 30 DAYS OF COMPLETION. I ALSO AUTHORIZE PERIODIC ON-SITE INSPECTIONS BY THE HOWARD SOIL CONSERVATION DISTRICT."

DEVELOPER — DATE 4/4/06

BY THE ENGINEER:

"I/WE CERTIFY THAT THIS PLAN FOR POND CONSTRUCTION, EROSION AND SEDIMENT CONTROL REPRESENTS A PRACTICAL AND WORKABLE PLAN BASED ON MY PERSONAL KNOWLEDGE OF THE SITE CONDITIONS. THIS PLAN WAS PREPARED IN ACCORDANCE WITH THE REQUIREMENTS OF THE HOWARD SOIL CONSERVATION DISTRICT. I HAVE NOTIFIED THE DEVELOPER THAT HE/SHE MUST ENGAGE A REGISTERED PROFESSIONAL ENGINEER TO SUPERVISE POND CONSTRUCTION AND PROVIDE THE HOWARD SOIL CONSERVATION DISTRICT WITH AN "AS-BUILT" PLAN OF THE POND WITHIN 30 DAYS OF COMPLETION."

ENGINEER – DONALD A. MASON, P.E. # 21443 — DATE 3/31/06

THESE PLANS HAVE BEEN REVIEWED FOR THE HOWARD SOIL CONSERVATION DISTRICT AND MEET THE TECHNICAL REQUIREMENTS FOR SMALL POND CONSTRUCTION, SOIL EROSION, AND SEDIMENT CONTROL.

USDA – NATURAL RESOURCES CONSERVATION SERVICE — DATE 4/11/06

THESE PLANS FOR SMALL POND CONSTRUCTION, SOIL EROSION, AND SEDIMENT CONTROL MEET THE REQUIREMENTS OF THE HOWARD SOIL CONSERVATION DISTRICT.

HOWARD SOIL CONSERVATION DISTRICT — DATE 4/14/06

APPROVED: DEPARTMENT OF PUBLIC WORKS

CHIEF, BUREAU OF HIGHWAYS — DATE 4-21-06

APPROVED: DEPARTMENT OF PLANNING AND ZONING

CHIEF, DIVISION OF LAND DEVELOPMENT — DATE 5/12/06

CHIEF, DEVELOPMENT ENGINEERING DIVISION — DATE 5/8/06

STATE OF MARYLAND — ROBERT H. VOGEL — No. 18930 — PROFESSIONAL ENGINEER — 7/13/07

ROBERT H. VOGEL, P.E. NO 18930 FOR REVISION #2 ONLY




GABION BASKET LAYOUT
NOT TO SCALE




PROFILE THROUGH FOREBAY WEIR
NOT TO SCALE




NOTES:

1. IF WATER IS ENCOUNTERED DURING THE CONSTRUCTION OF THE CORE TRENCH, IT IS TO BE REMOVED BY PUMPING.
2. CORE TRENCH SHALL CONSIST OF IMPERVIOUS MATERIAL (GC, SC, CL, CH) AS DIRECTED BY A GEOTECHNICAL ENGINEER ONSITE AND MAY REQUIRE TO BE HAULED FROM AN OFFSITE LOCATION.

CORE TRENCH SECTION
NOT TO SCALE

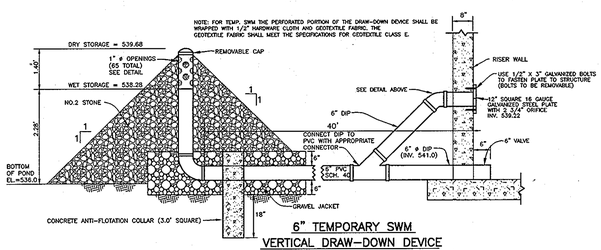


6" TEMPORARY SWM VERTICAL DRAW-DOWN DEVICE
NOT TO SCALE




TSWM PERFORATION DETAIL
NOT TO SCALE

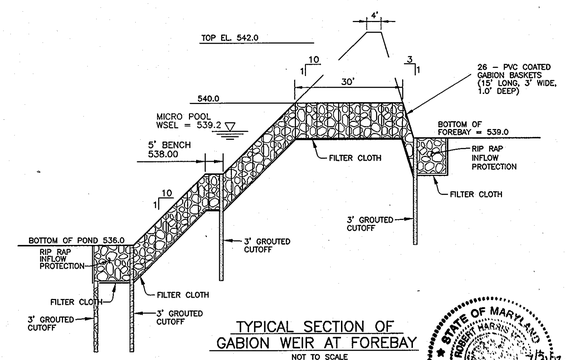


TYPICAL SECTION OF GABION WEIR AT FOREBAY
NOT TO SCALE

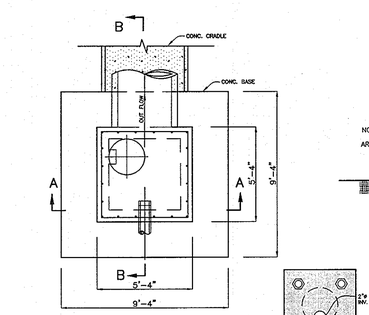


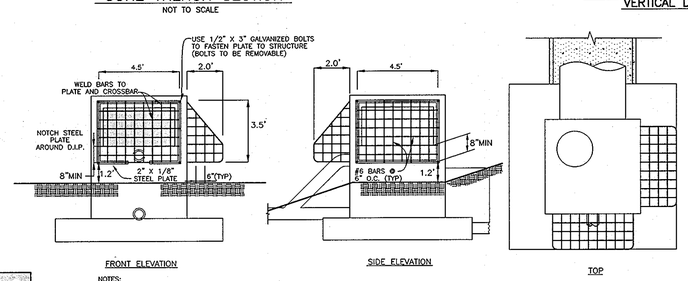


FRONT ELEVATION

SIDE ELEVATION

NOTES:

1. TRASH RACK SHALL BE GALVANIZED AFTER FABRICATION
2. TRASH RACK SHALL BE PAINTED BATTLESHIP GRAY.
2. TRASH RACK TO BE INSTALLED UPON CONVERSION TO SWM POND.

TRASH RACK DETAIL
SCALE: 1" = 4'

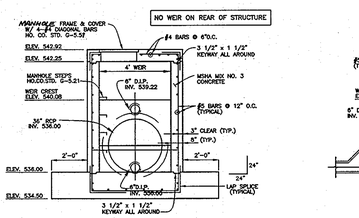


SECTION A–A
FRONT VIEW

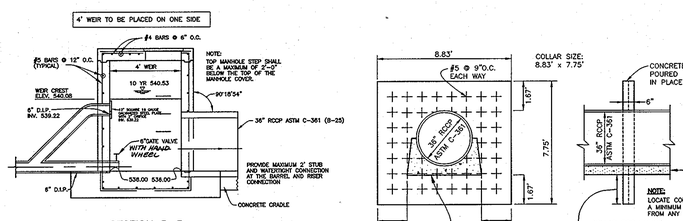


SECTION B–B
SIDE VIEW

CONTROL STRUCTURE – POND #2
SCALE: 1" = 4'

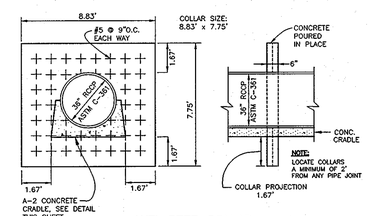





ANTI-SEEP COLLAR
NOT TO SCALE




TYPE A–2
CONCRETE CRADLE
NOT TO SCALE

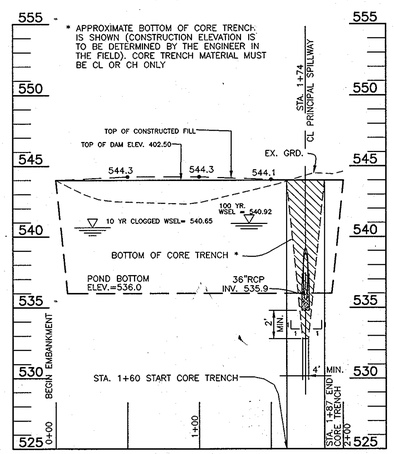


PROFILE ALONG CL OF EMBANKMENT
SCALE: 1"=50' HORIZ., 1"=5' VERT.

| NO. | DATE | REVISION |
|---|---|---|
| 2 | 6/11/12 | REVISE PLAN TO DELETE WATERTIGHT MANHOLE FRAME AND COVER |
| 2 | 6/11/12 | ADD HAND WHEEL TO POND DRAIN, RELOCATE STANDING PAD |

BENCHMARK
ENGINEERS ▲ LAND SURVEYORS ▲ PLANNERS
ENGINEERING, INC.
8480 BALTIMORE NATIONAL PIKE ▲ SUITE 418
ELLICOTT CITY, MARYLAND 21043
phone: 410-465-6105 ▲ fax: 410-465-6644
www.bel-civilengineering.com

Donald Mason 3/31/06

OWNER/DEVELOPER:
TRINITY QUALITY HOMES, INC.
3675 PARK AVENUE
SUITE 301
ELLICOTT CITY, MD 21043
410-480-3023

PROJECT:
THE CHASE AT STONEY BROOK
LOTS 1–20, PRESERVATION PARCEL "A" AND NON-BUILDABLE PRESERVATION PARCELS "B" THROUGH "D"

LOCATION:
TAX MAP 7, BLOCK 17 PARCEL 133
4th ELECTION DISTRICT
HOWARD COUNTY, MARYLAND

TITLE:
STORMWATER MANAGEMENT FACILITY #2
(POCKET POND)

DATE: MARCH, 2006 — PROJECT NO. 1187

DES: JMC — DRAFT: JMC — CHECK: DAM — SCALE: AS SHOWN — SHEET 17 OF 19

F-05-170

P:\1187dwg\7024F123S16-18.dwg, SWMP2, 3/31/2006 2:16:46 PM, imc, Oce TDS600 HDI for mylar.pc3

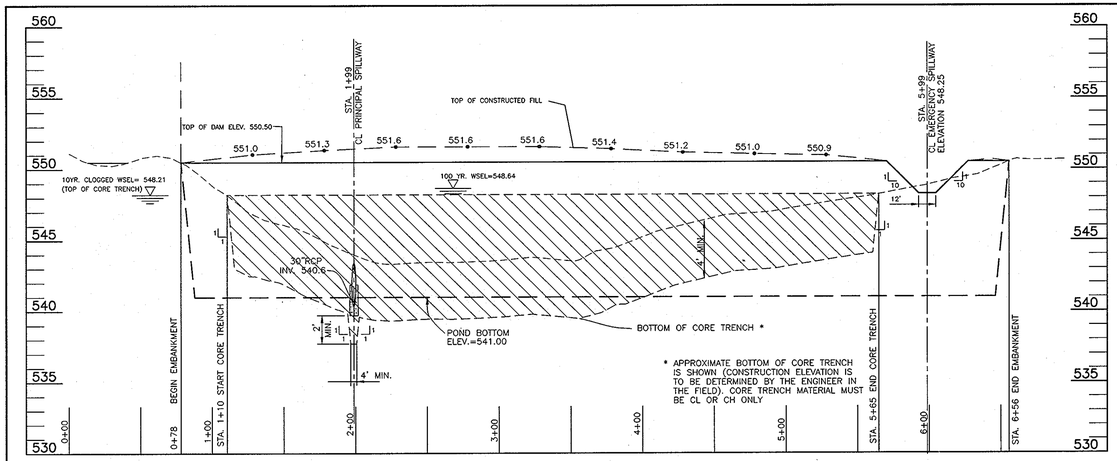


PROFILE ALONG CL OF EMBANKMENT

SCALE: 1"=50' HORIZ., 1"=5' VERT.

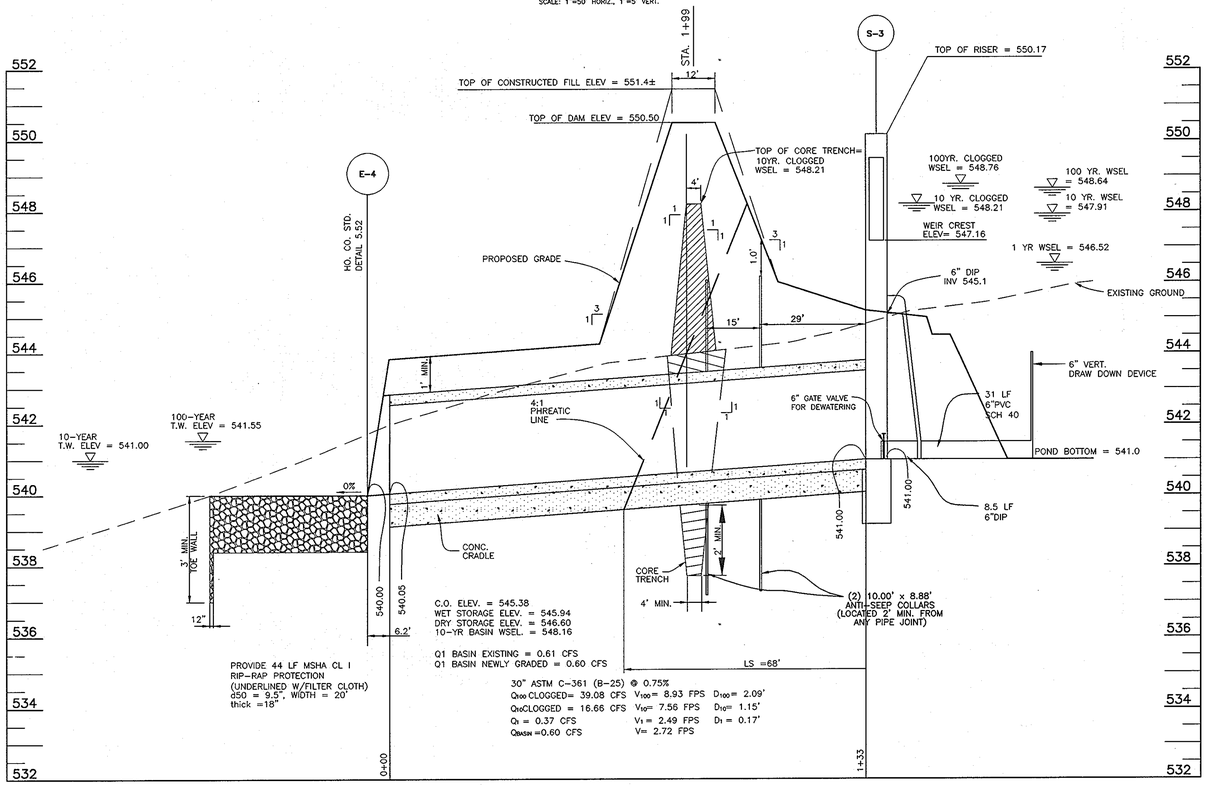


SECTION THRU PRINCIPAL SPILLWAY

SCALE: 1"=20' HORIZ., 1"=2' VERT.

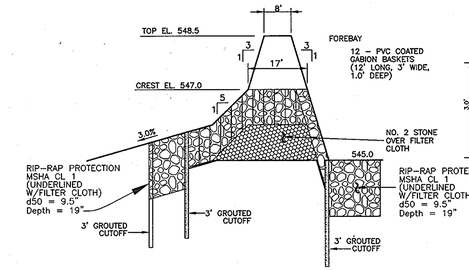


TYPICAL SECTION OF GABION WEIR AT FOREBAY

N.T.S.

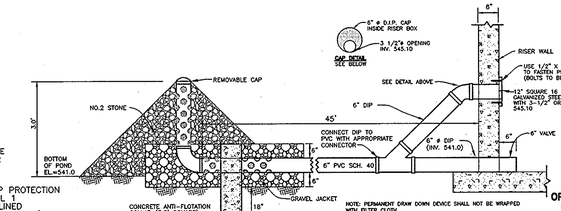


6" PIPE DETAIL AND LOW FLOW CONTROL ORIFICE

NOT TO SCALE

SEE GRADING PLAN FOR POND DETAIL




TSWM PERFORATION DETAIL

NOT TO SCALE

## OPERATION AND MAINTENANCE SCHEDULE FOR PRIVATELY OWNED AND MAINTAINED EXTENDED DETENTION POND

**ROUTINE MAINTENANCE:**

1. FACILITY SHALL BE INSPECTED ANNUALLY AND AFTER MAJOR STORMS. INSPECTIONS SHALL BE PERFORMED DURING WET WEATHER TO DETERMINE IF THE POND IS FUNCTIONING PROPERLY.
2. TOP AND SIDE SLOPES OF THE EMBANKMENT SHALL BE MOWED A MINIMUM OF TWO (2) TIMES PER YEAR, ONCE IN JUNE AND ONCE IN SEPTEMBER. OTHER SIDE SLOPES AND MAINTENANCE ACCESS SHALL BE MOWED AS NEEDED.
3. DEBRIS AND LITTER SHALL BE REMOVED DURING REGULAR MOWING OPERATIONS AND AS NEEDED.
4. VISIBLE SIGNS OF EROSION IN THE POND AS WELL AS THE RIP-RAP OR GABION OUTLET AREA SHALL BE REPAIRED AS SOON AS IT IS NOTICED.

**NON-ROUTINE MAINTENANCE:**

1. STRUCTURAL COMPONENTS OF THE POND SUCH AS THE DAM, THE RISER, AND THE PIPES SHALL BE REPAIRED UPON THE DETECTION OF ANY DAMAGE. THE COMPONENTS SHALL BE INSPECTED DURING ROUTINE MAINTENANCE OPERATIONS.
2. SEDIMENTS SHALL BE REMOVED FROM THE POND, AND FOREBAY, NO LATER THAN WHEN THE CAPACITY OF THE POND, OR FOREBAY, IS HALF FULL OF SEDIMENT, OR, WHEN DEEMED NECESSARY FOR AESTHETIC REASONS, UPON APPROVAL FROM THE DEPARTMENT OF PUBLIC WORKS.

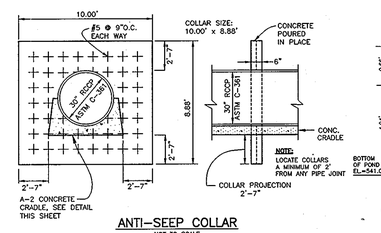


ANTI-SEEP COLLAR

NOT TO SCALE

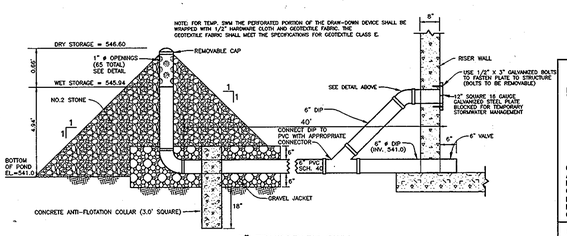


6" TEMPORARY SWM VERTICAL DRAW-DOWN DEVICE

NOT TO SCALE




TYPE A-2 CONCRETE CRADLE

NOT TO SCALE

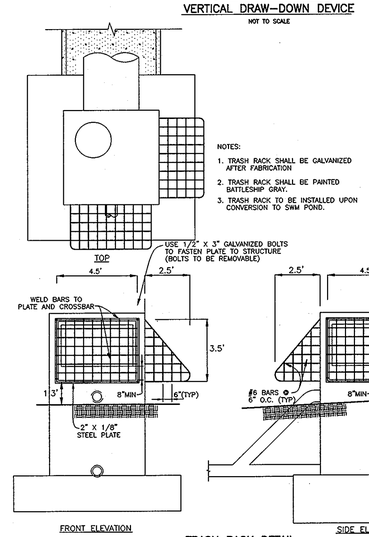


TRASH RACK DETAIL

SCALE: 1" = 4'

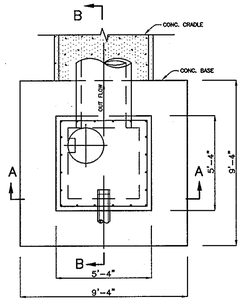





SECTION A-A FRONT VIEW

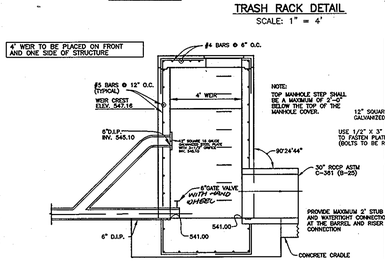


CONTROL STRUCTURE - POND #3

SCALE: 1" = 4'

SECTION B-B SIDE VIEW

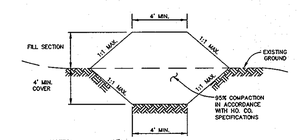


NOTES:

1. IF WATER IS ENCOUNTERED DURING THE CONSTRUCTION OF THE CORE TRENCH, IT IS TO BE REMOVED BY PUMPING.
2. CORE TRENCH SHALL CONSIST OF IMPERVIOUS MATERIAL (GC, SC, CL, CH) AS DIRECTED BY A GEOTECHNICAL ENGINEER ONSITE AND MAY REQUIRE TO BE HAULED FROM AN OFFSITE LOCATION.

CORE TRENCH SECTION

NOT TO SCALE




GABION BASKET LAYOUT

SCALE: 1"=20'




PROFILE THROUGH FOREBAY WEIR

NOT TO SCALE

FOREBAY
Q=20.38 cfs
H=1.01'
L=8.0'
C=2.5




BLOCKING DETAIL FOR POND #3 TEMPORARY SWM DURING CONSTRUCTION

NOT TO SCALE




SECTION THROUGH EMERGENCY SPILLWAY

SCALE: 1"=50' HORIZ., 1"=5' VERT.

PROVIDE 44 LF MSHA CL I RIP-RAP PROTECTION (UNDERLINED W/FILTER CLOTH) d50 = 9.5", WIDTH = 20' thick =18"

## AS-BUILT CERTIFICATION

I HEREBY CERTIFY THAT THE FACILITY SHOWN ON THIS PLAN WAS CONSTRUCTED AS SHOWN ON THE "AS-BUILT" PLANS AND MEETS THE APPROVED PLANS AND SPECIFICATIONS.

DONALD A. MASON — PE NO. 21443

DATE

CERTIFY MEANS TO STATE OR DECLARE A PROFESSIONAL OPINION BASED UPON ONSITE INSPECTIONS AND MATERIAL TESTS WHICH ARE CONDUCTED DURING CONSTRUCTION. THE ONSITE INSPECTIONS AND MATERIAL TESTS ARE THOSE INSPECTIONS AND TESTS DEEMED SUFFICIENT AND APPROPRIATE BY COMMONLY ACCEPTED ENGINEERING STANDARDS. CERTIFY DOES NOT MEAN OR IMPLY A GUARANTEE BY THE ENGINEER NOR DOES AN ENGINEER'S CERTIFICATION RELIEVE ANY OTHER PARTY FROM MEETING REQUIREMENTS IMPOSED BY CONTRACT, EMPLOYMENT, OR OTHER MEANS, INCLUDING MEETING COMMONLY ACCEPTED INDUSTRY PRACTICES.

BY THE DEVELOPER:

"I/WE CERTIFY THAT ALL DEVELOPMENT AND/OR CONSTRUCTION WILL BE DONE ACCORDING TO THESE PLANS, AND THAT ANY RESPONSIBLE PERSONNEL INVOLVED IN THE CONSTRUCTION PROJECT WILL HAVE A CERTIFICATE OF ATTENDANCE AT A DEPARTMENT OF THE ENVIRONMENT APPROVED TRAINING PROGRAM FOR THE CONTROL OF SEDIMENT AND EROSION BEFORE BEGINNING THE PROJECT. I SHALL ENGAGE A REGISTERED PROFESSIONAL ENGINEER TO SUPERVISE POND CONSTRUCTION AND PROVIDE THE HOWARD SOIL CONSERVATION DISTRICT WITH AN "AS-BUILT" PLAN OF THE POND WITHIN 30 DAYS OF COMPLETION. I ALSO AUTHORIZE PERIODIC ON-SITE INSPECTIONS BY THE HOWARD SOIL CONSERVATION DISTRICT."

DEVELOPER — 4/4/06 DATE

BY THE ENGINEER:

"I/WE CERTIFY THAT THIS PLAN FOR POND CONSTRUCTION, EROSION AND SEDIMENT CONTROL REPRESENTS A PRACTICAL AND WORKABLE PLAN BASED ON MY PERSONAL KNOWLEDGE OF THE SITE CONDITIONS. THIS PLAN WAS PREPARED IN ACCORDANCE WITH THE REQUIREMENTS OF THE HOWARD SOIL CONSERVATION DISTRICT. I HAVE NOTIFIED THE DEVELOPER THAT HE/SHE MUST ENGAGE A REGISTERED PROFESSIONAL ENGINEER TO SUPERVISE POND CONSTRUCTION AND PROVIDE THE HOWARD SOIL CONSERVATION DISTRICT WITH AN "AS-BUILT" PLAN OF THE POND WITHIN 30 DAYS OF COMPLETION."

ENGINEER - DONALD A. MASON, P.E. # 21443 — 3/31/06 DATE

THESE PLANS HAVE BEEN REVIEWED FOR THE HOWARD SOIL CONSERVATION DISTRICT AND MEET THE TECHNICAL REQUIREMENTS FOR SMALL POND CONSTRUCTION, SOIL EROSION, AND SEDIMENT CONTROL.

USDA - NATURAL RESOURCES CONSERVATION SERVICE — 4/14/06 DATE

THESE PLANS FOR SMALL POND CONSTRUCTION, SOIL EROSION, AND SEDIMENT CONTROL MEET THE REQUIREMENTS OF THE HOWARD SOIL CONSERVATION DISTRICT.

HOWARD SOIL CONSERVATION DISTRICT — 4/14/06 DATE

APPROVED: DEPARTMENT OF PUBLIC WORKS

CHIEF, BUREAU OF HIGHWAYS — 4-21-06 DATE

APPROVED: DEPARTMENT OF PLANNING AND ZONING

CHIEF, DIVISION OF LAND DEVELOPMENT — 5/12/06 DATE

CHIEF, DEVELOPMENT ENGINEERING DIVISION — 5/12/06 DATE

| NO. | DATE | REVISION |
|---|---|---|
| 2 | 6/11/12 | REVISE PLAN TO DELETE WATERTHIGHT MANHOLE FRAME AND COVER ADD HAND WHEEL TO POND DRAIN, RELOCATE STANDING PAD |


BENCHMARK
ENGINEERS ▲ LAND SURVEYORS ▲ PLANNERS
ENGINEERING, INC.
8480 BALTIMORE NATIONAL PIKE ▲ SUITE 418
ELLICOTT CITY, MARYLAND 21043
phone: 410-465-6105 ▲ fax: 410-465-6644
www.bei-civilengineering.com


3/31/06

OWNER/DEVELOPER:

TRINITY QUALITY HOMES, INC.
3675 PARK AVENUE
SUITE 301
ELLICOTT CITY, MD 21043
410-480-0023

PROJECT: THE CHASE AT STONEY BROOK
LOTS 1-20, PRESERVATION PARCEL "A" AND NON-BUILDABLE PRESERVATION PARCELS "B" THROUGH "D"

LOCATION: TAX MAP 7, BLOCK 17 PARCEL 133, 4th ELECTION DISTRICT, HOWARD COUNTY, MARYLAND

TITLE: STORMWATER MANAGEMENT FACILITY #3 (SHALLOW WETLAND)

DATE: JANUARY, 2006 — PROJECT NO. 1187

DES: JMC — DRAFT: JMC — CHECK: DAM — SCALE: AS SHOWN — SHEET 18 OF 19

STATE OF MARYLAND — ROBERT H. VOGEL — No. 16193 — PROFESSIONAL ENGINEER — 7/13/12

ROBERT H. VOGEL, P.E. NO.16193 FOR REVISION # 2

F-05-170

P:\11187\dwg\7024F123S16-18.dwg, SWMF3, 3/31/2006 2:17:44 PM, inc, Oce TDS600 HDF for mylar.pc3

# CONSTRUCTION SPECIFICATIONS

These specifications are appropriate to all ponds within the scope of the Standard for practice MD–378. All references to ASTM and AASHTO specifications apply to the most recent version.

Site Preparation

Areas designated for borrow areas, embankment, and structural works shall be cleared, grubbed and stripped to topsoil. All trees, vegetation, roots and other objectionable material shall be removed. Channel banks and sharp breaks shall be sloped to no steeper than 1:1. All trees shall be cleared and grubbed within 15 feet of the toe of the embankment.

Areas to be covered by the reservoir will be cleared of all trees, brush, logs, fences, rubbish and other objectionable material unless otherwise designated on the plans. Trees, brush, and stumps shall be cut approximately level with the ground surface. For dry stormwater management ponds, a minimum of a 25–foot radius around the inlet structure shall be cleared.

All cleared and grubbed material shall be disposed of outside and below the limits of the dam and reservoir as directed by the owner or his representative. When specified, a sufficient quantity of topsoil will be stockpiled in a suitable location for use on the embankment and other designated areas.

Earth Fill

Material – The fill material shall be taken from approved designated borrow areas. If shall be free of roots, stumps, wood, rubbish, stones greater than 6", frozen or other objectionable material. Fill material for the center of the embankment, and cut off trench shall conform to Unified Soil Classification GC, SC, CH, or CL and must have at least 30% passing the #200 sieve. Consideration may be given to the use of other materials in the embankment if designed by a geotechnical engineer. Such special designs must have construction supervised by a geotechnical engineer.

Materials used in the outer shell of the embankment must have the capability to support vegetation of the quality required to prevent erosion of the embankment.

Placement – Areas on which fill is to be placed shall be scarified prior to placement of fill. Fill materials shall be placed in maximum 8 inch thick (before compaction) layers which are to be continuous over the entire length of the fill. The most permeable borrow material shall be placed in the downstream portions of the embankment. The principal spillway must be installed concurrently with fill placement and not excavated into the embankment.

Compaction – the movement of the hauling and spreading equipment over the fill shall be controlled so that the entire surface of each lift shall be traversed by not less than one tread track of heavy equipment or compaction shall be achieved by a minimum of four complete passes of a sheepsfoot, rubber tired or vibratory roller. Fill material shall contain sufficient moisture such that the required degree of compaction will be obtained with teh equipment used. The fill material shall contain sufficient moisture so that if formed into a ball it will not crumble, yet not be so wet that water can be squeezed out.

When required by the reviewing agency the minimum required density shall not be less than 95% of maximum dry density with a moisture content within a 2% of the optimum. Each layer of fill shall be compacted as necessary to obtain that density, and is to be certified by the Engineer at the time of construction. All compaction is to be determined by AASHTO Method T–99 (Standard Proctor).

Cut Off Trench – The cutoff trench shall be excavated into impervious material along or parallel to the centerline of the embankment as shown on the plans. The bottom width of the trench shall be governed by the equipment used for excavation, with the minimum width being four feet. The depth shall be a least four feet below existing grade or as shown on the plans. The side slopes of the trench shall be 1 to 1 or flatter. The backfill shall be compacted with construction equipment, rollers, or hand tampers to assure maximum density and minimum permeability.

Embankment Core – The core shall be parallel to the centerline of the embankment as shower on the plans. The top width of the cores shall be a minimum of four feet. The height shall extend up to at least the 10 year water elevation or as shown on the plans. The side slopes shall be 1 to 1 or flatter. The core shall be compacted with construction equipment, rollers, or hand tampers to assure maximum density and minimum permeability. In addition, the core shall be placed concurrently with the outer shell of the embankment.

Structure Backfill

Backfill adjacent to pipes or structures shall be of the type and quality conforming to that specified for the adjoining fill material. The fill shall be placed in horizontal layers not to exceed four inches in thickness and compacted by hand tampers or other manually directed compaction equipment. The material needs to fill completely all spaces under and adjacent to the pipe. At no time during the backfilling operation shall driven equipment be allowed to operate closer than four feet, measured horizontally, to any part of a structure. Under no circumstances shall equipment be driven over any part of a concrete structure or pipe, unless there is a compacted fill of 24" or greater over the structure or pipe.

Structure backfill may be flowable fill meeting the requirements of Maryland Department of Transportation, State Highway Administration Standard Specifications for Construction and Materials, Section 313 as modified. The mixture shall have a 100–200 psi; 28 day unconfined compressive strength. The flowable fill shall have a minimum pH of 4.0 and a minimum resistively of 2,000 ohm–cm. Material shall be placed such that a minimum of 6" (measured perpendicular to the outside of the pipe) of flowable fill shall be under (bedding), over and, on the sided of the pipe. It only needs to extend up to the spring line for rigid conduits. Average slump of the fill shall be 7" to assure flowability of the material. Adequate measures shall be taken (sand bags, etc.) to prevent floating the pipe. When using flowable fill, all metal pipe shall be bituminous coated. Any adjoining soil fill shall be placed in horizontal layers not to exceed four inches in thickness and compacted by hand tampers or other manually directed compaction equipment. The material shall completely fill all voids adjacent to the flowable fill zone. At no time during the backfilling operation shall driven equipment be allowed to operate closer than four feet, measured horizontally, to any part of a structure. Under no circumstances shall equipment be driven over any part of a structure or pipe unless there is a compacted fill of 24" or greater over the structure or pipe. Backfill material outside the structural backfill (flowable fill) zone shall be of the type and quality conforming to that specified for the core of the embankment or other embankment materials.

Pipe Conduits

All pipes shall be circular in cross section

Corrugated Metal Pipe – all of the following criteria shall apply for corrugated metal pipe:

1. Materials – (Polymer Coated steel pipe) – Steel pipes with polymeric coatings shall have a minimum coating thickness of 0.01 inch (10 mil) on both sides of the pipe. This pipe and its appurtenances shall conform to the requirements of AASHTO Specifications M–245 & M–246 with watertight coupling bands or flanges.

Materials – (Aluminum Coated Steel Pipe) – This pipe and its appurtenances shall conform to the requirements of AASHTO Specification M–274 with watertight coupling bands or flanges. Aluminum Coated Steel Pipe, when used with flowable fill or when soil and/or water conditions warrant the need for increased durability, shall be fully bituminous coated per requirements of AASHTO Specification M–190 Type A. Any aluminum coating damaged or otherwise removed shall be replaced with cold applied bituminous coating compound. Aluminum surfaces that are to be in contact with concrete shall be painted with one coat of zinc chromate primer or two coats of asphalt.

Materials – (Aluminum Pipe) – This pipe and its appurtenances shall conform to the requirements of AASHTO Specification M–196 or M–211 with watertight coupling bands or flanges. Aluminum Pipe, when used with flowable fill or when soil and/or water conditions warrant for increased durability, shall be fully bituminous coated per requirements of AASHTO Specification M–190 Type A. Aluminum surfaces that are to be contact with concrete shall be painted with one coat of zinc chromate primer or two coats of asphalt. Hot dip galvanized bolts may be used for connections. The pH of the surrounding soils shall be between 4 and 9.

2. Coupling bands, anti–seep collars, end sections, etc., must be composed of the same material and coatings as the pipe. Metals must be insulated from dissimilar materials with use of rubber or plastic insulating materials at least 24 mils in thickness.

3. Connections – All connections with pipes must be completely watertight. The drain pipe or barrel connection to the riser shall be welded all around when the pipe and riser are metal. Anti–seep collars shall be connected to the pipe in such a manner as to be completely watertight. Dimple bands are not considered to be watertight.

All connection shall use a rubber or neoprene gasket when joining pipe sections. The end of each pipe shall be re–rolled on adequate number of corrugations to accommodate the bandwidth. The following type connections are acceptable for pipes less than 24 inches in diameter: flanges on both ends of the pipe with a circular 3/8 inch closed cell neoprene gasket, prepunched to the flange bolt circle, sandwiched between adjacent flanges; a 12–inch wide standard lap type band with 12–inch wide by 3/8–inch thick closed cell circular neoprene gasket; and a 12–inch wide hugger type band with o–ring gaskets having a minimum diameter of 1/2 inch greater than the corrugation depth. Pipes 24 inches in diameter and larger shall be connected by a 24 inch long annular corrugated band using a minimum of 4 (four) rods and lugs, 2 on each connecting pipe end. A 24–inch wide by 3/8–inch thick closed cell circular neoprene gasket will be installed with 12 inches on the end of each pipe. Flanged joints with 3/8 inch closed cell gaskets the full width of the flange is also acceptable.

Helically corrugated pipe shall have either continuously welded seams or have lock seams with internal caulking or a neoprene bead.

4. Bedding – The pipe shall be firmly and uniformly bedded throughout its entire length. Where rock or soft, spongy or other unstable soil is encountered, all such material shall be removed and replaced with suitable earth compacted to provide adequate support.

5. Backfilling shall conform to "Structure Backfill".

6. Other details (anti–seep collars, valves, etc.) shall be as shown on the drawings.

Reinforced Concrete Pipe – All of the following criteria shall apply for reinforced concrete pipe:

1. Materials – Reinforced concrete pipe shall have bell and spigot joints with rubber gaskets and shall equal or exceed ASTM C–361.

2. Bedding – Reinforced concrete pipe conduits shall be laid in a concrete bedding/cradle for their entire length. This bedding/cradle shall consist of high slump concrete placed under the pipe and up the sides of the pipe at least 50% of its outside diameter with a minimum thickness of 6 inches. Where a concrete cradle is not needed for structural reasons, flowable fill may be used a described in the "Structure Backfill" section of this standard. Gravel bedding is not permitted.

3. Laying pipe – Bell and spigot pipe shall be places with the bell end upstream. Joints shall be made in accordance with recommendations of the manufacturer of the material. After the joints are sealed for the entire line, the bedding shall be placed so that all spaces under the pipe are filled. Care shall be exercised to prevent any deviation form the original line and grade of the pipe. The first joint must be located within 4 feet from the riser.

4. Backfilling shall conform to "Structure Backfill".

5. Other details (anti–seep collars, valves, etc.) shall be shown on the drawings.

Plastic Pipe – The following criteria shall apply for plastic pipe:

1. Materials – PVC pipe shall be PVC–1120 or PVC–1220 conforming to ASTM D–1785 or ASTM D–2241. Corrugated High Density Polyethylene (HDPE) pipe, couplings and fittings shall conform to the following: 4" – 10" inch pipe shall meet the requirements of AASHTO M252 Type S, and 12" through 24" inch shall meet the requirements of AASHTO M294 Type S.

2. Joints and connections to anti–seep collars shall be completely watertight.

3. Bedding – The pipe shall be firmly and uniformly bedded throughout its entire length. Where rock or soft, spongy or other unstable soil is encountered, all such material shall be removed and replaced with suitable earth compacted to provide adequate support.

4. Backfilling shall conform to "Structure Backfill".

5. Other details (anti–seep collars, valves, etc.) shall be as shown on the drawings.

Drainage Diaphragms – When a drainage diaphragm is used, a registered professional engineer will supervise the design and construction inspection.

Concrete

Concrete shall meet the requirements of Maryland Department of Transportation, State Highway Administration Standard Specifications for Construction and Materials, Section 414, Mix No. 3.

Rock Riprap

Rock riprap shall meet the requirements of Maryland Department of Transportation, State Highway Administration Standard Specifications for Construction and Materials, Section 311.

Geotextile shall be placed under all riprap and shall meet the requirements of Maryland Department of Transportation, State Highway Administration Standard Specifications for Construction and Materials, Section 921.09, Class C.

Care of Water during Construction

All work on permanent structures shall be carried out in areas free from water. The contractor shall construct and maintain all temporary dikes, levees, cofferdams, drainage channels, and stream diversions necessary to protect the areas to be occupied by the permanent works. The contractor shall also furnish, install, operate, and maintain all necessary pumping and other equipment required for removal of water from various parts of the work and for maintaining the evacuations, foundation, and other parts of the work free from water as required or directed by the engineer for constructing each part of the work. After having served their purpose, all temporary protective works shall be removed or leveled and graded to the extent required to prevent obstruction in any degree whatsoever of the flow of water to the spillway or outlet works and so as not to interfere in any way with the operation or maintenance of the structure. Stream diversions shall be maintained until the full flow can be passed through the permanent works. The removal of water from the required excavation and the foundation shall be accomplished in a manner and to the extent that will maintain stability of the excavated slopes and bottom required excavations and will allow satisfactory performance of all construction operations. During the placing and compacting of material in required excavations, the water level at the location being refilled shall be maintained below the bottom of the excavation at such locations which may require draining the water sumps from which the water shall be pumped.

Stabilization

All borrow areas shall be graded to provide proper drainage and left in a sightly condition. All exposed surfaces of the embankment, spillway, spoil and borrow areas, and berms shall be stabilized by seeding, liming, fertilizing and mulching in accordance with the Natural Resources Conservation Service Standards and Specifications for Critical Area Planting (MD–342) or as shown on the accompanying drawings.

Erosion and Sediment Control

Construction operations will be carried out in such a manner that erosion will be controlled and water and air pollution minimized. State and local laws concerning pollution abatement will be followed. Construction plans shall detail erosion and sediment control measures.

HILLIS - CARNES ENGINEERING ASSOCIATES, INC.
RECORD OF SOIL EXPLORATION
Page 1 of 1

Project Name: Cattail Creek Overlook — Boring Number: B-1
Location: Lisbon, Maryland — Job #: 03329A

Datum: — Hammer Wt.: 140 Lbs. — Hole Diameter: 8" — Foreman: Jerry Herst
Surf. Elev.: 561.06 — Hammer Drop: 30 Inches — Rock Core Dia.: — — Inspector:
Date Started: 06-30-03 — Pipe Size: 2.0 Inches OD — Boring Method: HSA — Completed: 06-30-03

| ELEV. | SOIL DESCRIPTION (Color, Moisture, Density, Size, Proportion) | STRA | DEPTH | SCALE | CON | SAMPLE BLOWS 6" | NO. | REC | BORING & SAMPLING NOTES |
|---|---|---|---|---|---|---|---|---|---|
| | SURFACE | | 0.0 | | | | | | 1.0' Topsoil |
| | Brown, moist, stiff, clayey silt trace gravel (ML) | | 2.0 | | I | 2-3-21 | 1 | 9" | |
| | Brown, moist, medium stiff to stiff sandy silt, trace to little clay (ML) | | 4.0 | | I | 4-6-5 | 2 | 18" | |
| | | | | | I | 3-3-3 | 3 | 18" | Caved in at 6.5' at Completion |
| | | | 10.0 | | D | 5-6-6 | 4 | 14" | * Installed a 7.0' inshu pipe |
| | | | 15.0 | 15.0 | D | 5-8-10 | 5 | 18" | Groundwater encountered at 12.5' while drilling; Backfilled after 24 hours |
| | Bottom of Test Hole at 15.0' | | | 20.0 | | | | | |

SAMPLER TYPE: DRIVEN SPLIT SPOON UNLESS OTHERWISE NOTED; PT-PRESSED SHELBY TUBE; CA-CONTINUOUS FLIGHT AUGER; RC-ROCK CORE
SAMPLE CONDITIONS: D-DISINTEGRATED; I-INTACT; U-UNDISTURBED; L-LOST
GROUND WATER DEPTH: AT COMPLETION ___ Dry ___ FT.; AFTER 24 hrs. 4.5 FT.; AFTER ___ FT.
BORING METHOD: HSA-HOLLOW STEM AUGERS; CFA-CONT. FLIGHT AUGERS; DC-DRIVING CASING; MD-MUD DRILLING
STANDARD PENETRATION TEST-DRIVING 2" OD SAMPLER 1' WITH 140# HAMMER FALLING 30"-COUNT MADE AT 6" INTERVALS

HILLIS - CARNES ENGINEERING ASSOCIATES, INC.
RECORD OF SOIL EXPLORATION
Page 1 of 1

Project Name: Cattail Creek Overlook — Boring Number: B-2
Location: Lisbon, Maryland — Job #: 03329A

Datum: — Hammer Wt.: 140 Lbs. — Hole Diameter: 8" — Foreman: Jerry Herst
Surf. Elev.: 562.66 — Hammer Drop: 30 Inches — Rock Core Dia.: — — Inspector:
Date Started: 06-30-03 — Pipe Size: 2.0 Inches OD — Boring Method: HSA — Completed: 06-30-03

| ELEV. | SOIL DESCRIPTION (Color, Moisture, Density, Size, Proportion) | STRA | DEPTH | SCALE | CON | SAMPLE BLOWS 6" | NO. | REC | BORING & SAMPLING NOTES |
|---|---|---|---|---|---|---|---|---|---|
| | SURFACE | | 0.0 | | | | | | 1.0' Topsoil |
| | Brown dry, medium stiff, sandy silt, trace gravel, trace roots (ML) | | 2.0 | | I | 3-3-4 | 1 | 9" | No groundwater encountered while drilling |
| | Brown, moist, stiff sandy silt (ML) | | 5.0 | | I | 3-6-7 | 2 | 18" | |
| | Brown, moist medium stiff to stiff silty clay (CL) | | | | I | 3-3-4 | 3 | 18" | Caved in at 6.5' at Completion |
| | | | 10.0 | | I | 3-4-7 | 4 | 18" | Caved in at 8.5' after 24 hours |
| | Brown, moist, stiff silt little decomposed rock fragments (ML) | | 15.0 | 15.0 | I | 3-7-11 | 5 | 18" | Backfilled after 24 hours |
| | Bottom of Test Hole at 15.0' | | | 20.0 | | | | | |

SAMPLER TYPE: DRIVEN SPLIT SPOON UNLESS OTHERWISE NOTED; PT-PRESSED SHELBY TUBE; CA-CONTINUOUS FLIGHT AUGER; RC-ROCK CORE
SAMPLE CONDITIONS: D-DISINTEGRATED; I-INTACT; U-UNDISTURBED; L-LOST
GROUND WATER DEPTH: AT COMPLETION ___ Dry ___ FT.; AFTER 24 hrs. 6.5' FT.; AFTER ___ FT.
BORING METHOD: HSA-HOLLOW STEM AUGERS; CFA-CONT. FLIGHT AUGERS; DC-DRIVING CASING; MD-MUD DRILLING
STANDARD PENETRATION TEST-DRIVING 2" OD SAMPLER 1' WITH 140# HAMMER FALLING 30"-COUNT MADE AT 6" INTERVALS

HILLIS - CARNES ENGINEERING ASSOCIATES, INC.
RECORD OF SOIL EXPLORATION
Page 1 of 1

Project Name: Cattail Creek Overlook — Boring Number: B-3
Location: Lisbon, Maryland — Job #: 03329A

Datum: — Hammer Wt.: 140 Lbs. — Hole Diameter: 8" — Foreman: Jerry Herst
Surf. Elev.: 558.77 — Hammer Drop: 30 Inches — Rock Core Dia.: — — Inspector:
Date Started: 06-30-03 — Pipe Size: 2.0 Inches OD — Boring Method: HSA — Completed: 06-30-03

| ELEV. | SOIL DESCRIPTION (Color, Moisture, Density, Size, Proportion) | STRA | DEPTH | SCALE | CON | SAMPLE BLOWS 6" | NO. | REC | BORING & SAMPLING NOTES |
|---|---|---|---|---|---|---|---|---|---|
| | SURFACE | | 0.0 | | | | | | 1.0' Topsoil |
| | Brown, moist, soft silt trace clay (ML) | | 2.0 | | I | 2-2-2 | 1 | 12" | No groundwater encountered while drilling |
| | Brown, moist, medium stiff silty clay (CL) | | 5.0 | | I | 2-2-2 | 2 | 9" | |
| | | | | | I | 3-3-6 | 3 | 18" | Caved in at 7.5' at Completion |
| | Brown mold stiff to hard sandy silt, trace decomposed rock fragments (ML) | | 10.0 | | I | 5-8-10 | 4 | 18" | Caved in at 6.8' after 24 hours |
| | | | | | I | 10-17-32 | 5 | 18" | Backfilled after 24 hours |
| | Bottom of Test Hole at 15.0' | | 15.0 | 15.0 | | | | | |

SAMPLER TYPE: DRIVEN SPLIT SPOON UNLESS OTHERWISE NOTED; PT-PRESSED SHELBY TUBE; CA-CONTINUOUS FLIGHT AUGER; RC-ROCK CORE
SAMPLE CONDITIONS: D-DISINTEGRATED; I-INTACT; U-UNDISTURBED; L-LOST
GROUND WATER DEPTH: AT COMPLETION ___ Dry ___ FT.; AFTER 24 hrs. 4.0' FT.; AFTER ___ FT.
BORING METHOD: HSA-HOLLOW STEM AUGERS; CFA-CONT. FLIGHT AUGERS; DC-DRIVING CASING; MD-MUD DRILLING
STANDARD PENETRATION TEST-DRIVING 2" OD SAMPLER 1' WITH 140# HAMMER FALLING 30"-COUNT MADE AT 6" INTERVALS

HILLIS - CARNES ENGINEERING ASSOCIATES, INC.
RECORD OF SOIL EXPLORATION
Page 1 of 1

Project Name: Cattail Creek Overlook — Boring Number: B-4
Location: Lisbon, Maryland — Job #: 03329A

Datum: — Hammer Wt.: 140 Lbs. — Hole Diameter: 8" — Foreman: Jerry Herst
Surf. Elev.: 564.78 — Hammer Drop: 30 Inches — Rock Core Dia.: — — Inspector:
Date Started: 06-30-03 — Pipe Size: 2.0 Inches OD — Boring Method: HSA — Completed: 06-30-03

| ELEV. | SOIL DESCRIPTION (Color, Moisture, Density, Size, Proportion) | STRA | DEPTH | SCALE | CON | SAMPLE BLOWS 6" | NO. | REC | BORING & SAMPLING NOTES |
|---|---|---|---|---|---|---|---|---|---|
| | SURFACE | | 0.0 | | | | | | 1.0' Topsoil |
| | Brown, moist, soft, clayey silt, trace gravel (ML) | | 2.0 | | I | 2-2-3 | 1 | 14" | |
| | Brown, moist medium stiff sandy silt, trace gravel (ML) | | 5.0 | | I | 5-6-5 | 2 | 14" | |
| | Brown, moist, stiff, sandy silt, trace clay (ML) | | | | I | 4-8-10 | 3 | 18" | Caved in at 7.5' at Completion |
| | | | 10.0 | | I | 4-9-14 | 4 | 18" | Caved in at 7.5' after 24 hours |
| | Brown, moist, medium stiff clayey silt (ML) | | 12.0 | | I | 4-5-4 | 5 | 18" | Groundwater encountered at 13.0' while drilling; Backfilled after 24 hours |
| | Bottom of Test Hole at 15.0' | | 15.0 | 15.0 | | | | | |

SAMPLER TYPE: DRIVEN SPLIT SPOON UNLESS OTHERWISE NOTED; PT-PRESSED SHELBY TUBE; CA-CONTINUOUS FLIGHT AUGER; RC-ROCK CORE
SAMPLE CONDITIONS: D-DISINTEGRATED; I-INTACT; U-UNDISTURBED; L-LOST
GROUND WATER DEPTH: AT COMPLETION ___ Dry ___ FT.; AFTER 24 hrs. 4.5' FT.; AFTER ___ FT.
BORING METHOD: HSA-HOLLOW STEM AUGERS; CFA-CONT. FLIGHT AUGERS; DC-DRIVING CASING; MD-MUD DRILLING
STANDARD PENETRATION TEST-DRIVING 2" OD SAMPLER 1' WITH 140# HAMMER FALLING 30"-COUNT MADE AT 6" INTERVALS

HILLIS - CARNES ENGINEERING ASSOCIATES, INC.
RECORD OF SOIL EXPLORATION
Page 1 of 1

Project Name: Cattail Creek Overlook — Boring Number: B-5
Location: Lisbon, Maryland — Job #: 03329A

Datum: — Hammer Wt.: 140 Lbs. — Hole Diameter: 8" — Foreman: Jerry Herst
Surf. Elev.: 561.94 — Hammer Drop: 30 Inches — Rock Core Dia.: — — Inspector:
Date Started: 06-30-03 — Pipe Size: 2.0 Inches OD — Boring Method: HSA — Completed: 06-30-03

| ELEV. | SOIL DESCRIPTION (Color, Moisture, Density, Size, Proportion) | STRA | DEPTH | SCALE | CON | SAMPLE BLOWS 6" | NO. | REC | BORING & SAMPLING NOTES |
|---|---|---|---|---|---|---|---|---|---|
| | SURFACE | | 0.0 | | | | | | 1.0' Topsoil |
| | Brown, moist, medium stiff sandy silt, trace gravel trace roots (ML) | | 2.0 | | I | 3-3-4 | 1 | 9" | |
| | Light gray, dry, stiff to hard sandy silt, trace decomposed rock fragments (ML) | | 5.0 | | D | 6-11-18 | 2 | 18" | |
| | | | | | D | 10-19-13 | 3 | 12" | Caved in at 7.7' at Completion |
| | Light gray, moist, hard sandy silt, some decomposed rock fragments (ML) (Decomposed Rock) | | 10.0 | | D | 25-50/4" | 4 | 10" | Caved in at 8.8' after 24 hours; Groundwater encountered at 11.0' while drilling |
| | Bottom of Test Hole at 15.0' | | 15.0 | 15.0 | D | 28-50/4" | 5 | 9" | Backfilled after 24 hours |
| | | | | 20.0 | | | | | |

SAMPLER TYPE: DRIVEN SPLIT SPOON UNLESS OTHERWISE NOTED; PT-PRESSED SHELBY TUBE; CA-CONTINUOUS FLIGHT AUGER; RC-ROCK CORE
SAMPLE CONDITIONS: D-DISINTEGRATED; I-INTACT; U-UNDISTURBED; L-LOST
GROUND WATER DEPTH: AT COMPLETION ___ 7.0' FT.; AFTER 24 hrs. 5.5' FT.; AFTER ___ FT.
BORING METHOD: HSA-HOLLOW STEM AUGERS; CFA-CONT. FLIGHT AUGERS; DC-DRIVING CASING; MD-MUD DRILLING
STANDARD PENETRATION TEST-DRIVING 2" OD SAMPLER 1' WITH 140# HAMMER FALLING 30"-COUNT MADE AT 6" INTERVALS

HILLIS - CARNES ENGINEERING ASSOCIATES, INC.
RECORD OF SOIL EXPLORATION
Page 1 of 1

Project Name: Cattail Creek Overlook — Boring Number: B-6
Location: Lisbon, Maryland — Job #: 03329A

Datum: — Hammer Wt.: 140 Lbs. — Hole Diameter: 8" — Foreman: Jerry Herst
Surf. Elev.: 541.94 — Hammer Drop: 30 Inches — Rock Core Dia.: — — Inspector:
Date Started: 06-30-03 — Pipe Size: 2.0 Inches OD — Boring Method: HSA — Completed: 06-30-03

| ELEV. | SOIL DESCRIPTION (Color, Moisture, Density, Size, Proportion) | STRA | DEPTH | SCALE | CON | SAMPLE BLOWS 6" | NO. | REC | BORING & SAMPLING NOTES |
|---|---|---|---|---|---|---|---|---|---|
| | SURFACE | | 0.0 | | | | | | 1.0' Topsoil |
| | Brown, moist, soft, sandy clay trace roots (CL) | | 2.0 | | I | 2-2-2 | 1 | 9" | |
| | Brown, dry, stiff sandy silt trace decomposed rock fragments (ML) | | 5.0 | | I | 10-10-13 | 2 | 18" | Caved in at 7.5' at Completion |
| | | | | | I | 4-6-9 | 3 | 18" | Caved in at 6.9' after 72 hours |
| | Light gray, dry, hard, sandy silt, trace decomposed rock fragments (ML) (Decomposed Rock) | | 10.0 | | D | 6-8-13 | 4 | 14" | Groundwater encountered at 9.0' while drilling |
| | Bottom of Test Hole at 15.0' | | 15.0 | 15.0 | D | 12-24-41 | 5 | 18" | Backfilled after 72 hours |
| | | | | 20.0 | | | | | |

SAMPLER TYPE: DRIVEN SPLIT SPOON UNLESS OTHERWISE NOTED; PT-PRESSED SHELBY TUBE; CA-CONTINUOUS FLIGHT AUGER; RC-ROCK CORE
SAMPLE CONDITIONS: D-DISINTEGRATED; I-INTACT; U-UNDISTURBED; L-LOST
GROUND WATER DEPTH: AT COMPLETION ___ 3.5 FT.; AFTER 72 hrs. 3.2 FT.; AFTER ___ FT.
BORING METHOD: HSA-HOLLOW STEM AUGERS; CFA-CONT. FLIGHT AUGERS; DC-DRIVING CASING; MD-MUD DRILLING
STANDARD PENETRATION TEST-DRIVING 2" OD SAMPLER 1' WITH 140# HAMMER FALLING 30"-COUNT MADE AT 6" INTERVALS

HILLIS - CARNES ENGINEERING ASSOCIATES, INC.
RECORD OF SOIL EXPLORATION
Page 1 of 1

Project Name: Cattail Creek Overlook — Boring Number: B-7
Location: Lisbon, Maryland — Job #: 03329A

Datum: — Hammer Wt.: 140 Lbs. — Hole Diameter: 8" — Foreman: Jerry Herst
Surf. Elev.: 564.67 — Hammer Drop: 30 Inches — Rock Core Dia.: — — Inspector:
Date Started: 06-27-03 — Pipe Size: 2.0 Inches OD — Boring Method: HSA — Completed: 06-27-03

| ELEV. | SOIL DESCRIPTION (Color, Moisture, Density, Size, Proportion) | STRA | DEPTH | SCALE | CON | SAMPLE BLOWS 6" | NO. | REC | BORING & SAMPLING NOTES |
|---|---|---|---|---|---|---|---|---|---|
| | SURFACE | | 0.0 | | | | | | 1.0' Topsoil |
| | Brown, wet, soft, sandy clay trace roots (CL) | | 2.0 | | I | 2-2-2 | 1 | 9" | |
| | Brown, dry, stiff sandy silt trace decomposed rock fragments (ML) | | 5.0 | | I | 10-10-13 | 2 | 18" | Caved in at 7.5' at Completion |
| | | | | | I | 4-6-9 | 3 | 18" | Caved in at 6.9' after 72 hours |
| | Light gray, dry, hard, sandy silt, trace decomposed rock fragments (ML) (Decomposed Rock) | | 10.0 | | I | 6-8-13 | 4 | 14" | Groundwater encountered at 9.0' while drilling |
| | Bottom of Test Hole at 15.0' | | 15.0 | 15.0 | D | 12-24-41 | 5 | 18" | Backfilled after 72 hours |
| | | | | 20.0 | | | | | |

SAMPLER TYPE: DRIVEN SPLIT SPOON UNLESS OTHERWISE NOTED; PT-PRESSED SHELBY TUBE; CA-CONTINUOUS FLIGHT AUGER; RC-ROCK CORE
SAMPLE CONDITIONS: D-DISINTEGRATED; I-INTACT; U-UNDISTURBED; L-LOST
GROUND WATER DEPTH: AT COMPLETION ___ 3.5 FT.; AFTER 72 hrs. 3.2 FT.; AFTER ___ FT.
BORING METHOD: HSA-HOLLOW STEM AUGERS; CFA-CONT. FLIGHT AUGERS; DC-DRIVING CASING; MD-MUD DRILLING
STANDARD PENETRATION TEST-DRIVING 2" OD SAMPLER 1' WITH 140# HAMMER FALLING 30"-COUNT MADE AT 6" INTERVALS

HILLIS - CARNES ENGINEERING ASSOCIATES, INC.
RECORD OF SOIL EXPLORATION
Page 1 of 1

Project Name: Cattail Creek Overlook — Boring Number: B-8
Location: Lisbon, Maryland — Job #: 03329A

Datum: — Hammer Wt.: 140 Lbs. — Hole Diameter: 8" — Foreman: Jerry Herst
Surf. Elev.: 543.09 — Hammer Drop: 30 Inches — Rock Core Dia.: — — Inspector:
Date Started: 06-27-03 — Pipe Size: 2.0 Inches OD — Boring Method: HSA — Completed: 06-27-03

| ELEV. | SOIL DESCRIPTION (Color, Moisture, Density, Size, Proportion) | STRA | DEPTH | SCALE | CON | SAMPLE BLOWS 6" | NO. | REC | BORING & SAMPLING NOTES |
|---|---|---|---|---|---|---|---|---|---|
| | SURFACE | | 0.0 | | | | | | 0" Topsoil |
| | Brown, moist, soft, clay (CL) | | 2.0 | | I | 2-2-3 | 1 | 14" | |
| | Brown, moist, medium stiff to stiff sandy silt (ML) | | 5.0 | | D | 4-8-6 | 2 | 18" | |
| | | | | | I | 3-3-5 | 3 | 18" | Caved in at 9.0' at Completion |
| | Dark gray to brown, moist, stiff sandy silt, trace decomposed rock fragments (ML) | | 10.0 | | I | 5-5-7 | 4 | 18" | Caved in at 5.5' after 72 hours |
| | | | | | I | 5-9-10 | 5 | 18" | Groundwater encountered at 13.0' while drilling; Backfilled after 72 hours |
| | Bottom of Test Hole at 15.0' | | 15.0 | 15.0 | | | | | |
| | | | | 20.0 | | | | | |

SAMPLER TYPE: DRIVEN SPLIT SPOON UNLESS OTHERWISE NOTED; PT-PRESSED SHELBY TUBE; CA-CONTINUOUS FLIGHT AUGER; RC-ROCK CORE
SAMPLE CONDITIONS: D-DISINTEGRATED; I-INTACT; U-UNDISTURBED; L-LOST
GROUND WATER DEPTH: AT COMPLETION ___ 8.5 FT.; AFTER 72 hrs. 1.5 FT.; AFTER ___ FT.
BORING METHOD: HSA-HOLLOW STEM AUGERS; CFA-CONT. FLIGHT AUGERS; DC-DRIVING CASING; MD-MUD DRILLING
STANDARD PENETRATION TEST-DRIVING 2" OD SAMPLER 1' WITH 140# HAMMER FALLING 30"-COUNT MADE AT 6" INTERVALS

HILLIS - CARNES ENGINEERING ASSOCIATES, INC.
RECORD OF SOIL EXPLORATION
Page 1 of 1

Project Name: Cattail Creek Overlook — Boring Number: B-9
Location: Lisbon, Maryland — Job #: 03329A

Datum: — Hammer Wt.: 140 Lbs. — Hole Diameter: 8" — Foreman: Jerry Herst
Surf. Elev.: 547.47 — Hammer Drop: 30 Inches — Rock Core Dia.: — — Inspector:
Date Started: 06-27-03 — Pipe Size: 2.0 Inches OD — Boring Method: HSA — Completed: 06-27-03

| ELEV. | SOIL DESCRIPTION (Color, Moisture, Density, Size, Proportion) | STRA | DEPTH | SCALE | CON | SAMPLE BLOWS 6" | NO. | REC | BORING & SAMPLING NOTES |
|---|---|---|---|---|---|---|---|---|---|
| | SURFACE | | 0.0 | | | | | | 1.0' Topsoil |
| | Dark brown, moist, soft, silty clay trace roots (CL) | | 2.0 | | I | 2-2-2 | 1 | 9" | |
| | Brown, moist, stiff to hard sandy silt, trace decomposed rock fragments trace clay (ML) | | 5.0 | | D | 4-5-7 | 2 | 14" | |
| | | | | | I | 4-6-10 | 3 | 16" | Caved in at 7.0' at Completion |
| | | | 10.0 | | I | 10-14-17 | 4 | 18" | Caved in at 5.3' after 72 hours; Groundwater encountered at 12.0' while drilling |
| | | | 15.0 | 15.0 | I | 8-11-15 | 5 | 12" | Backfilled after 72 hours |
| | Bottom of Test Hole at 15.0' | | | 20.0 | | | | | |

SAMPLER TYPE: DRIVEN SPLIT SPOON UNLESS OTHERWISE NOTED; PT-PRESSED SHELBY TUBE; CA-CONTINUOUS FLIGHT AUGER; RC-ROCK CORE
SAMPLE CONDITIONS: D-DISINTEGRATED; I-INTACT; U-UNDISTURBED; L-LOST
GROUND WATER DEPTH: AT COMPLETION ___ 4.5 FT.; AFTER 72 hrs. 3.5 FT.; AFTER ___ FT.
BORING METHOD: HSA-HOLLOW STEM AUGERS; CFA-CONT. FLIGHT AUGERS; DC-DRIVING CASING; MD-MUD DRILLING
STANDARD PENETRATION TEST-DRIVING 2" OD SAMPLER 1' WITH 140# HAMMER FALLING 30"-COUNT MADE AT 6" INTERVALS

| NO. | DATE | REVISION |
|---|---|---|
| | | |

BENCHMARK
ENGINEERS ▲ LAND SURVEYORS ▲ PLANNERS
ENGINEERING, INC.
8480 BALTIMORE NATIONAL PIKE ▲ SUITE 418
ELLICOTT CITY, MARYLAND 21043
phone: 410–465–6105 ▲ fax: 410–465–6644
www.bei–civilengineering.com

STATE OF MARYLAND — DONALD MOON — REGISTERED PROFESSIONAL ENGINEER
3/31/06

OWNER/DEVELOPER:
TRINITY QUALITY HOMES, INC.
3675 PARK AVENUE
SUITE 301
ELLICOTT CITY, MD 21043
410–480–0023

PROJECT:
THE CHASE AT STONEY BROOK
LOTS 1–20, PRESERVATION PARCEL "A" AND NON–BUILDABLE PRESERVATION PARCELS "B" THROUGH "D"

LOCATION:
TAX MAP 7, BLOCK 17 PARCEL 133
4th ELECTION DISTRICT
HOWARD COUNTY, MARYLAND

TITLE:
SWM NOTES AND SOIL BORING LOGS

DATE: MARCH, 2006 — PROJECT NO. 1187

DES: JMC — DRAFT: LAB — CHECK: DAM — SCALE: AS SHOWN — SHEET 19 OF 19

F–05–170

APPROVED: HOWARD COUNTY DEPARTMENT OF PUBLIC WORKS
CHIEF, BUREAU OF HIGHWAYS — DATE 4-21-06

APPROVED: HOWARD COUNTY DEPT. OF PLANNING AND ZONING
CHIEF, DIVISION OF LAND DEVELOPMENT — DATE 5/12/06
CHIEF, DEVELOPMENT ENGINEERING DIVISION — DATE 5/2/06

n:\1187dwg\7033x19.dwg, Sheet 1, 3/31/2006 2:21:36 PM,
Oce TDS600 HDI for mylar.pc3




NOTES:

1. IF WATER IS ENCOUNTERED DURING THE CONSTRUCTION OF THE CORE TRENCH, IT IS TO BE REMOVED BY PUMPING.
2. CORE TRENCH SHALL CONSIST OF IMPERVIOUS MATERIAL (GC, SC, CL, CH) AS DIRECTED BY A GEOTECHNICAL ENGINEER ONSITE AND MAY REQUIRE TO BE HAULED FROM AN OFFSITE LOCATION.

## CORE TRENCH SECTION

NOT TO SCALE




## PROFILE THROUGH FOREBAY WEIR

NOT TO SCALE

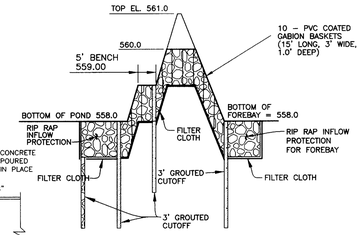


## TYPICAL SECTION OF GABION WEIR AT FOREBAY

NOT TO SCALE

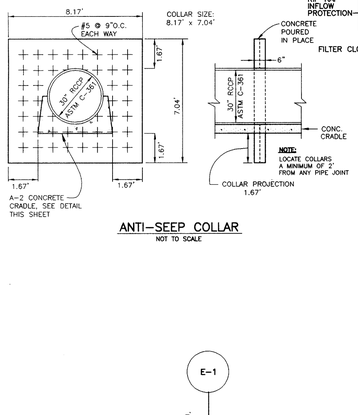


## ANTI-SEEP COLLAR

NOT TO SCALE




## GABION BASKET LAYOUT

NOT TO SCALE

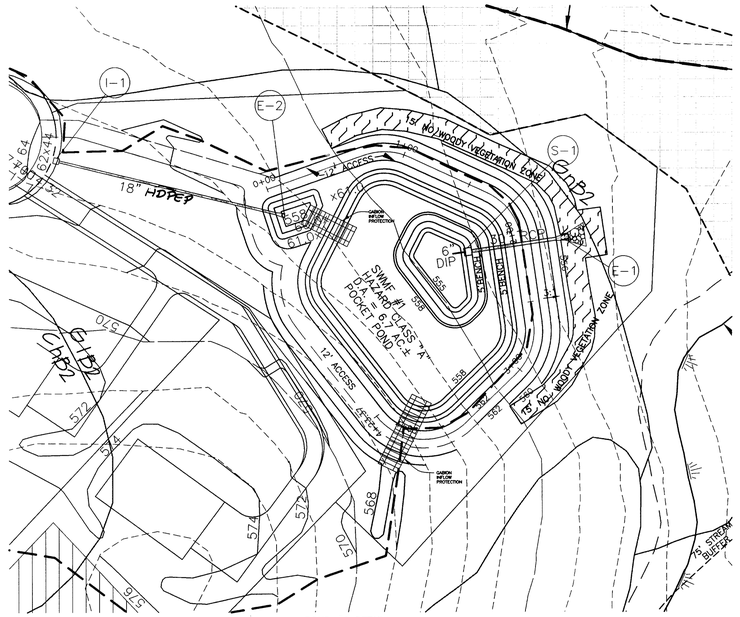


## POND #1 DETAIL

SCALE: 1" = 50'

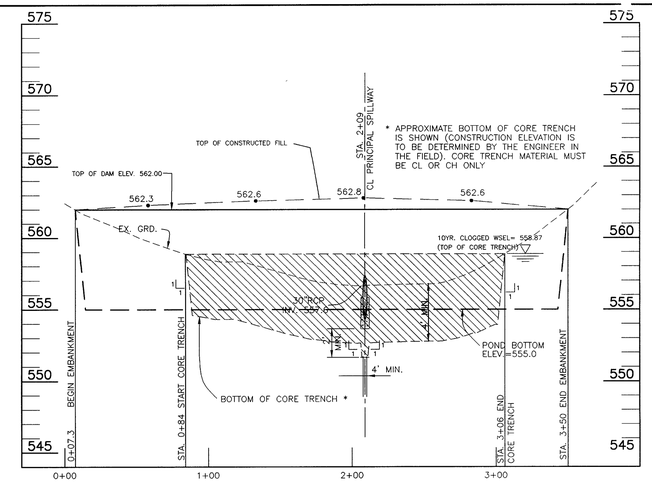


* APPROXIMATE BOTTOM OF CORE TRENCH IS SHOWN (CONSTRUCTION ELEVATION IS TO BE DETERMINED BY THE ENGINEER IN THE FIELD). CORE TRENCH MATERIAL MUST BE CL OR CH ONLY

## PROFILE ALONG CL OF EMBANKMENT

SCALE: 1"=50' HORIZ., 1"=5' VERT.

## OPERATION AND MAINTENANCE SCHEDULE FOR PRIVATELY OWNED AND MAINTAINED EXTENDED DETENTION POND

**ROUTINE MAINTENANCE:**

1. FACILITY SHALL BE INSPECTED ANNUALLY AND AFTER MAJOR STORMS. INSPECTIONS SHALL BE PERFORMED DURING WET WEATHER TO DETERMINE IF THE POND IS FUNCTIONING PROPERLY.
2. TOP AND SIDE SLOPES OF THE EMBANKMENT SHALL BE MOWED A MINIMUM OF TWO (2) TIMES PER YEAR, ONCE IN JUNE AND ONCE IN SEPTEMBER. OTHER SIDE SLOPES AND MAINTENANCE ACCESS SHALL BE MOWED AS NEEDED.
3. DEBRIS AND LITTER SHALL BE REMOVED DURING REGULAR MOWING OPERATIONS AND AS NEEDED.
4. VISIBLE SIGNS OF EROSION IN THE POND AS WELL AS THE RIP-RAP OR GABION OUTLET AREA SHALL BE REPAIRED AS SOON AS IT IS NOTICED.

**NON-ROUTINE MAINTENANCE:**

1. STRUCTURAL COMPONENTS OF THE POND SUCH AS THE DAM, THE RISER, AND THE PIPES SHALL BE REPAIRED UPON THE DETECTION OF ANY DAMAGE. THE COMPONENTS SHALL BE INSPECTED DURING ROUTINE MAINTENANCE OPERATIONS.
2. SEDIMENTS SHALL BE REMOVED FROM THE POND, AND FOREBAY, NO LATER THAN WHEN THE CAPACITY OF THE POND, OR FOREBAY, IS HALF FULL OF SEDIMENT, OR, WHEN DEEMED NECESSARY FOR AESTHETIC REASONS, UPON APPROVAL FROM THE DEPARTMENT OF PUBLIC WORKS.

## SOILS LEGEND

| SOIL | NAME | CLASS |
|---|---|---|
| ** Ba | Baile silt loam | D |
| * CuB | Comus silt loam, local alluvium, 3 to 8 percent slopes | B |
| GlB2 | Glenelg loam, 3 to 8 percent slopes, moderately eroded | B |
| GlC2 | Glenelg loam, 8 to 15 percent slopes, moderately eroded | B |
| GlC3 | Glenelg loam, 8 to 15 percent slopes, severely eroded | B |
| GlD3 | Glenelg loam, 15 to 25 percent slopes, severely eroded | B |
| GlD2 | Glenelg loam, 15 to 25 percent slopes, moderately eroded | B |
| * GnA | Glenville silt loam, 0 to 3 percent slopes | C |
| * GnB2 | Glenville silt loam, 3 to 8 percent slopes, moderately eroded | C |
| ** Ha | Hatboro silt loam | D |
| MtC2 | Mt. Airy channery loam, 8 to 15 percent slopes, moderately eroded | A |
| MtC3 | Mt. Airy channery loam, 8 to 15 percent slopes, severely eroded | A |
| MtD2 | Mt. Airy channery loam, 15 to 25 percent slopes, moderately eroded | A |
| MtE | Mt. Airy channery loam, 25 to 45 percent slopes | A |

*NOTES:*

* *Hydric soils and/or contains hydric inclusions*

** *May contain hydric inclusions*

† *Generally only within 100-year floodplain areas*

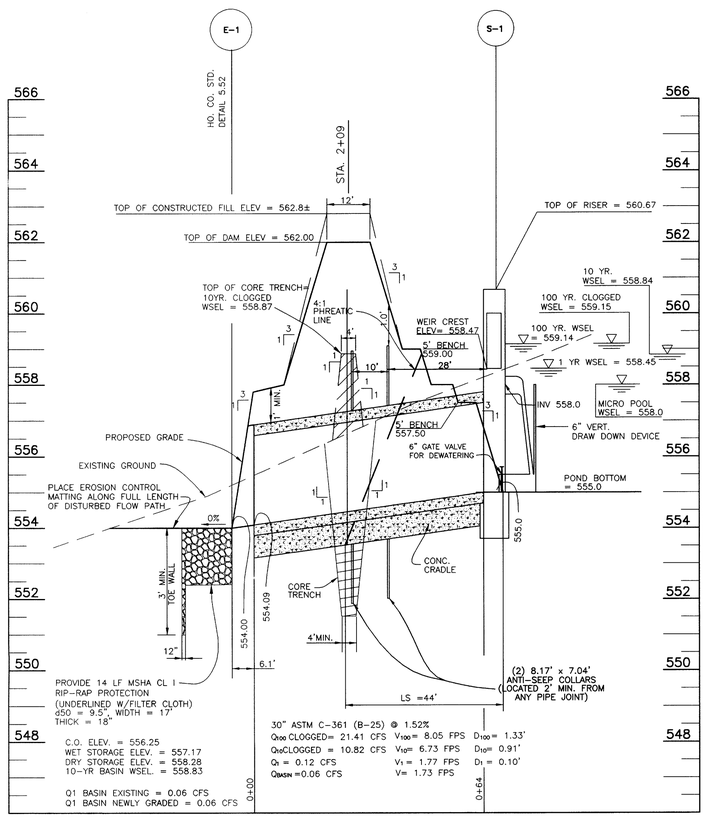


## SECTION THRU PRINCIPAL SPILLWAY

SCALE: 1"=20' HORIZ., 1"=2' VERT.




## TYPE A-2 CONCRETE CRADLE

NOT TO SCALE



TOP

NOTES:

1. TRASH RACK SHALL BE GALVANIZED AFTER FABRICATION
2. TRASH RACK SHALL BE PAINTED BATTLESHIP GRAY.
2. TRASH RACK TO BE INSTALLED UPON CONVERSION TO SWM POND.




## TSWM PERFORATION DETAIL

NOT TO SCALE

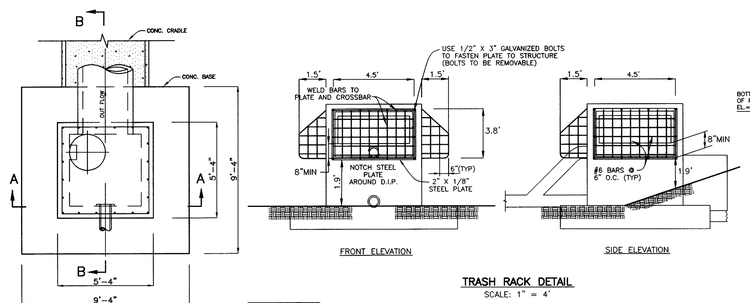


FRONT ELEVATION

SIDE ELEVATION

## TRASH RACK DETAIL

SCALE: 1" = 4'




## 6" TEMPORARY SWM VERTICAL DRAW-DOWN DEVICE

NOT TO SCALE




NO WEIR ON REAR OF STRUCTURE




SECTION A-A
FRONT VIEW

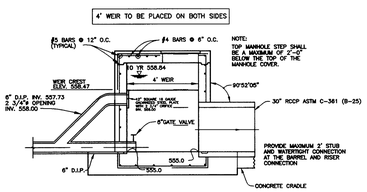


SECTION B-B
SIDE VIEW

CONTROL STRUCTURE - POND #1

SCALE: 1" = 4'




FRONT AND SIDE ELEVATIONS

## BLOCKING DETAIL FOR POND #1 TEMPORARY SWM DURING CONSTRUCTION

NOT TO SCALE

### AS-BUILT CERTIFICATION

I HEREBY CERTIFY THAT THE FACILITY SHOWN ON THIS PLAN WAS CONSTRUCTED AS SHOWN ON THE "AS-BUILT" PLANS AND MEETS THE APPROVED PLANS AND SPECIFICATIONS.

PE NO. 21443

DONALD A. MASON — DATE

CERTIFY MEANS TO STATE OR DECLARE A PROFESSIONAL OPINION BASED UPON ONSITE INSPECTIONS AND MATERIAL TESTS WHICH ARE CONDUCTED DURING CONSTRUCTION. THE ONSITE INSPECTIONS AND MATERIAL TESTS ARE THOSE INSPECTIONS AND TESTS DEEMED SUFFICIENT AND APPROPRIATE BY COMMONLY ACCEPTED ENGINEERING STANDARDS. CERTIFY DOES NOT MEAN OR IMPLY A GUARANTEE BY THE ENGINEER NOR DOES AN ENGINEER'S CERTIFICATION RELIEVE ANY OTHER PARTY FROM MEETING REQUIREMENTS IMPOSED BY CONTRACT, EMPLOYMENT, OR OTHER MEANS, INCLUDING MEETING COMMONLY ACCEPTED INDUSTRY PRACTICES.

### BY THE DEVELOPER:

"I/WE CERTIFY THAT ALL DEVELOPMENT AND/OR CONSTRUCTION WILL BE DONE ACCORDING TO THESE PLANS, AND THAT ANY RESPONSIBLE PERSONNEL INVOLVED IN THE CONSTRUCTION PROJECT WILL HAVE A CERTIFICATE OF ATTENDANCE AT A DEPARTMENT OF THE ENVIRONMENT APPROVED TRAINING PROGRAM FOR THE CONTROL OF SEDIMENT AND EROSION BEFORE BEGINNING THE PROJECT. I SHALL ENGAGE A REGISTERED PROFESSIONAL ENGINEER TO SUPERVISE POND CONSTRUCTION AND PROVIDE THE HOWARD SOIL CONSERVATION DISTRICT WITH AN "AS-BUILT" PLAN OF THE POND WITHIN 30 DAYS OF COMPLETION. I ALSO AUTHORIZE PERIODIC ON-SITE INSPECTIONS BY THE HOWARD SOIL CONSERVATION DISTRICT."

DEVELOPER — 4/4/06 DATE

### BY THE ENGINEER:

"I/WE CERTIFY THAT THIS PLAN FOR POND CONSTRUCTION, EROSION AND SEDIMENT CONTROL REPRESENTS A PRACTICAL AND WORKABLE PLAN BASED ON MY PERSONAL KNOWLEDGE OF THE SITE CONDITIONS. THIS PLAN WAS PREPARED IN ACCORDANCE WITH THE REQUIREMENTS OF THE HOWARD SOIL CONSERVATION DISTRICT. I HAVE NOTIFIED THE DEVELOPER THAT HE/SHE MUST ENGAGE A REGISTERED PROFESSIONAL ENGINEER TO SUPERVISE POND CONSTRUCTION AND PROVIDE THE HOWARD SOIL CONSERVATION DISTRICT WITH AN "AS-BUILT" PLAN OF THE POND WITHIN 30 DAYS OF COMPLETION."

ENGINEER – DONALD A. MASON, P.E. # 21443 — 3/31/06 DATE

THESE PLANS HAVE BEEN REVIEWED FOR THE HOWARD SOIL CONSERVATION DISTRICT AND MEET THE TECHNICAL REQUIREMENTS FOR SMALL POND CONSTRUCTION, SOIL EROSION, AND SEDIMENT CONTROL.

USDA – NATURAL RESOURCES CONSERVATION SERVICE — 4/4/06 DATE

THESE PLANS FOR SMALL POND CONSTRUCTION, SOIL EROSION, AND SEDIMENT CONTROL MEET THE REQUIREMENTS OF THE HOWARD SOIL CONSERVATION DISTRICT.

HOWARD SOIL CONSERVATION DISTRICT — 4/4/06 DATE

APPROVED: DEPARTMENT OF PUBLIC WORKS

CHIEF, BUREAU OF HIGHWAYS — 4-21-06 DATE

APPROVED: DEPARTMENT OF PLANNING AND ZONING

CHIEF, DIVISION OF LAND DEVELOPMENT — 5/12/06 DATE

CHIEF, DEVELOPMENT ENGINEERING DIVISION — 5/12/06 DATE

| NO. | DATE | REVISION |
|---|---|---|
| 1 | 12/06/06 | REVISE STORM DRAIN MATERIAL |


BENCHMARK
ENGINEERS ▲ LAND SURVEYORS ▲ PLANNERS
ENGINEERING, INC.
8480 BALTIMORE NATIONAL PIKE ▲ SUITE 418
ELLICOTT CITY, MARYLAND 21043
phone: 410-465-6105 ▲ fax: 410-465-6644
www.bei-civilengineering.com


3/31/06

OWNER/DEVELOPER:

TRINITY QUALITY HOMES, INC.
3675 PARK AVENUE
SUITE 301
ELLICOTT CITY, MD 21043
410-480-0023

PROJECT: THE CHASE AT STONEY BROOK
LOTS 1-20, PRESERVATION PARCEL "A" AND NON-BUILDABLE PRESERVATION PARCELS "B" THROUGH "D"

LOCATION: TAX MAP 7, BLOCK 17 PARCEL 133, 4th ELECTION DISTRICT, HOWARD COUNTY, MARYLAND

TITLE: STORMWATER MANAGEMENT FACILITY #1 (POCKET POND)

DATE: MARCH, 2006 — PROJECT NO. 1187

DES: JMC — DRAFT: JMC — CHECK: DAM — SCALE: AS SHOWN — SHEET 16 OF 19

F-05-170


P:\1187\dwg\7024F123S16-18.dwg, SWMF1, 3/31/2006 2:16:00 PM,
imc, Oce TDS600 HDI for mylar.pc3

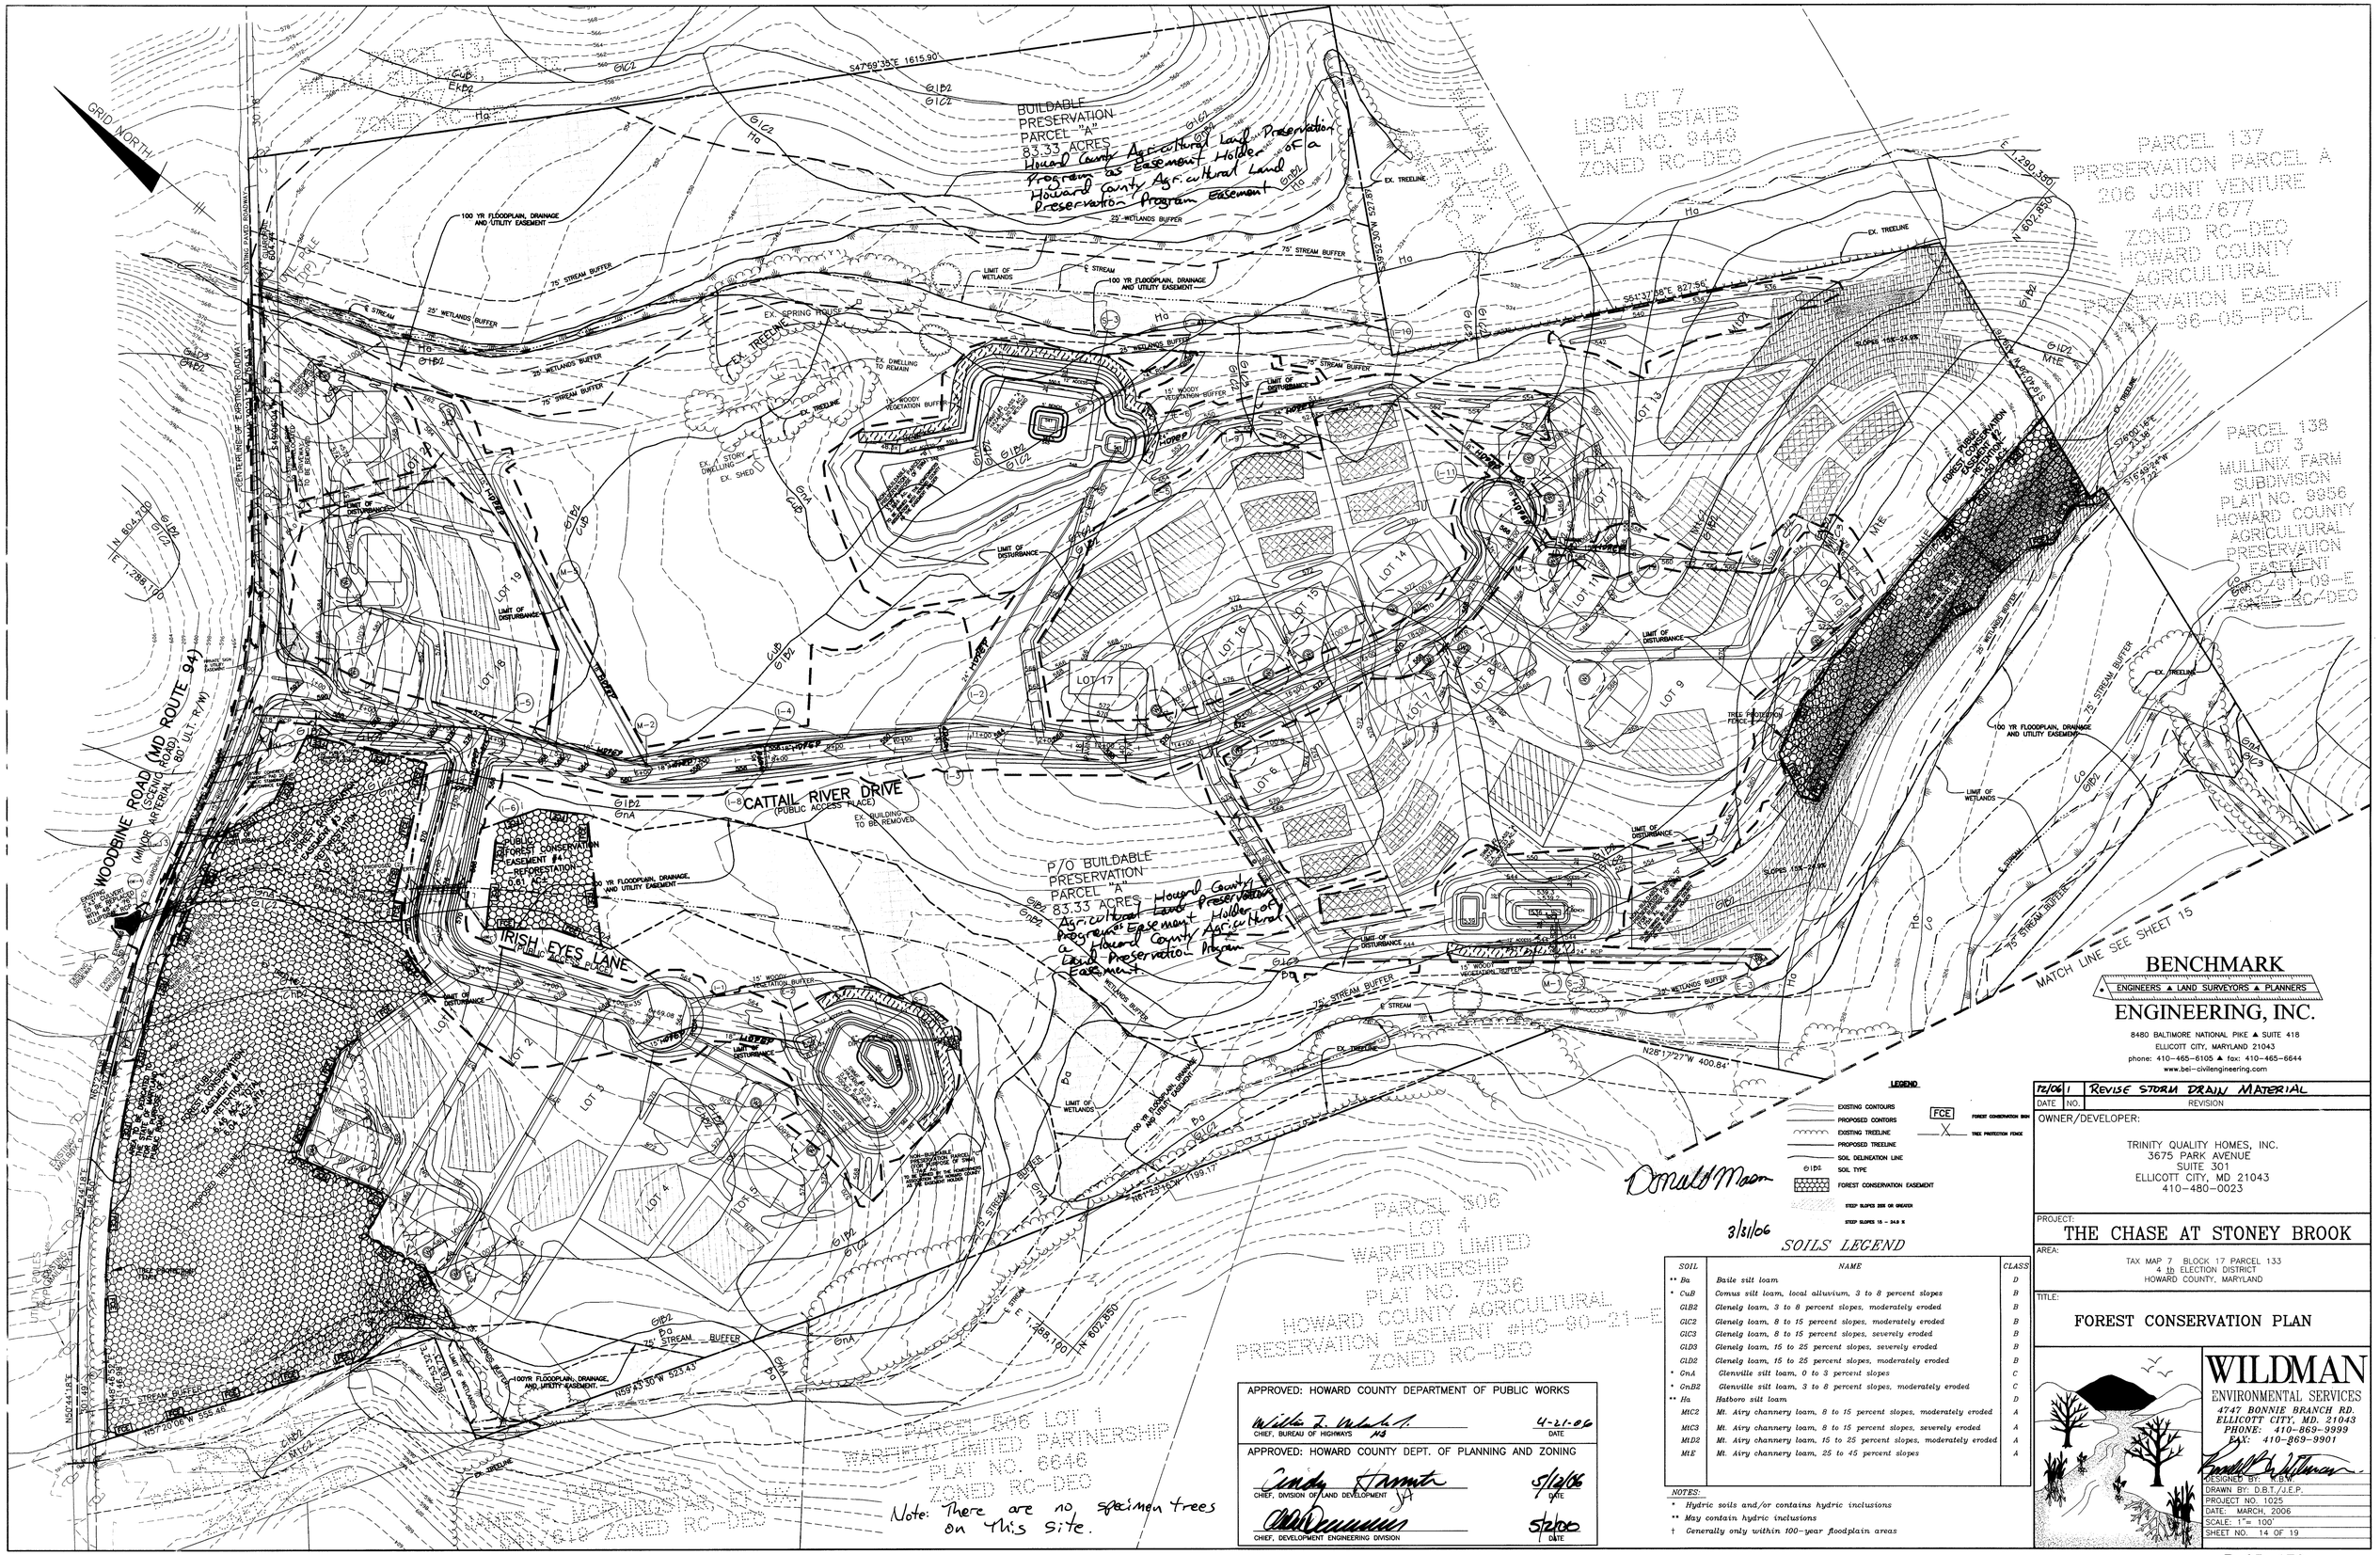


## SOILS LEGEND

| SOIL | NAME | CLASS |
|---|---|---|
| ** Ba | Basile silt loam | D |
| * CuB | Comus silt loam, local alluvium, 3 to 8 percent slopes | B |
| GlB2 | Glenelg loam, 3 to 8 percent slopes, moderately eroded | B |
| GlC2 | Glenelg loam, 8 to 15 percent slopes, moderately eroded | B |
| GlC3 | Glenelg loam, 8 to 15 percent slopes, severely eroded | B |
| GlD3 | Glenelg loam, 15 to 25 percent slopes, severely eroded | B |
| GlD2 | Glenelg loam, 15 to 25 percent slopes, moderately eroded | B |
| * GnA | Glenville silt loam, 0 to 3 percent slopes | C |
| * GnB2 | Glenville silt loam, 3 to 8 percent slopes, moderately eroded | C |
| ** Ha | Hatboro silt loam | D |
| MtC2 | Mt. Airy channery loam, 8 to 15 percent slopes, moderately eroded | A |
| MtC3 | Mt. Airy channery loam, 8 to 15 percent slopes, severely eroded | A |
| MtD2 | Mt. Airy channery loam, 15 to 25 percent slopes, moderately eroded | A |
| MtE | Mt. Airy channery loam, 25 to 45 percent slopes | A |

NOTES:
* Hydric soils and/or contains hydric inclusions
** May contain hydric inclusions
† Generally only within 100-year floodplain areas

APPROVED: HOWARD COUNTY DEPARTMENT OF PUBLIC WORKS

CHIEF, BUREAU OF HIGHWAYS — DATE 4-21-06

APPROVED: HOWARD COUNTY DEPT. OF PLANNING AND ZONING

CHIEF, DIVISION OF LAND DEVELOPMENT — DATE 5/2/06

CHIEF, DEVELOPMENT ENGINEERING DIVISION — DATE 5/2/06


BENCHMARK
ENGINEERS ▲ LAND SURVEYORS ▲ PLANNERS
ENGINEERING, INC.
8480 BALTIMORE NATIONAL PIKE ▲ SUITE 418
ELLICOTT CITY, MARYLAND 21043
phone: 410-465-6105 ▲ fax: 410-465-6644
www.bei-civilengineering.com


| DATE | NO. | REVISION |
|---|---|---|
| 12/06 | 1 | REVISE STORM DRAIN MATERIAL |

OWNER/DEVELOPER:
TRINITY QUALITY HOMES, INC.
3675 PARK AVENUE
SUITE 301
ELLICOTT CITY, MD 21043
410-480-0023

PROJECT:
THE CHASE AT STONEY BROOK

AREA:
TAX MAP 7 BLOCK 17 PARCEL 133
4 th ELECTION DISTRICT
HOWARD COUNTY, MARYLAND

TITLE:
FOREST CONSERVATION PLAN


WILDMAN
ENVIRONMENTAL SERVICES
4747 BONNIE BRANCH RD.
ELLICOTT CITY, MD. 21043
PHONE: 410-869-9999
FAX: 410-869-9901


DESIGNED BY: R.B.W.
DRAWN BY: D.B.T./J.E.P.
PROJECT NO. 1025
DATE: MARCH, 2006
SCALE: 1"= 100'
SHEET NO. 14 OF 19

F-05-170

P:\11187dwg\7052s14_15.dwg, Sheet 14, 3/31/2006 3:19:02 PM,
jmc, Oce TDS600 HDI for mylar.pc3

NOTE:

AT THE TIME OF INSTALLMENT, ALL SHRUBS AND OTHER PLANTINGS HEREWITH LISTED AND APPROVED FOR THIS SITE, SHALL BE OF THE PROPER HEIGHT REQUIREMENTS IN ACCORDANCE WITH THE HOWARD COUNTY LANDSCAPE MANUAL. IN ADDITION, NO SUBSTITUTIONS OR RELOCATION OF REQUIRED PLANTINGS MAY BE MADE WITHOUT PRIOR REVIEW AND APPROVAL FROM THE DEPARTMENT OF PLANNING AND ZONING. ANY DEVIATION FROM THIS APPROVED LANDSCAPE PLAN MAY RESULT IN DENIAL OR DELAY IN RELEASE OF LANDSCAPE SURETY UNTIL SUCH TIME AS ALL REQUIRED MATERIALS ARE PLANTED AND/OR REVISIONS ARE MADE TO APPLICABLE PLANS AND CERTIFICATIONS.

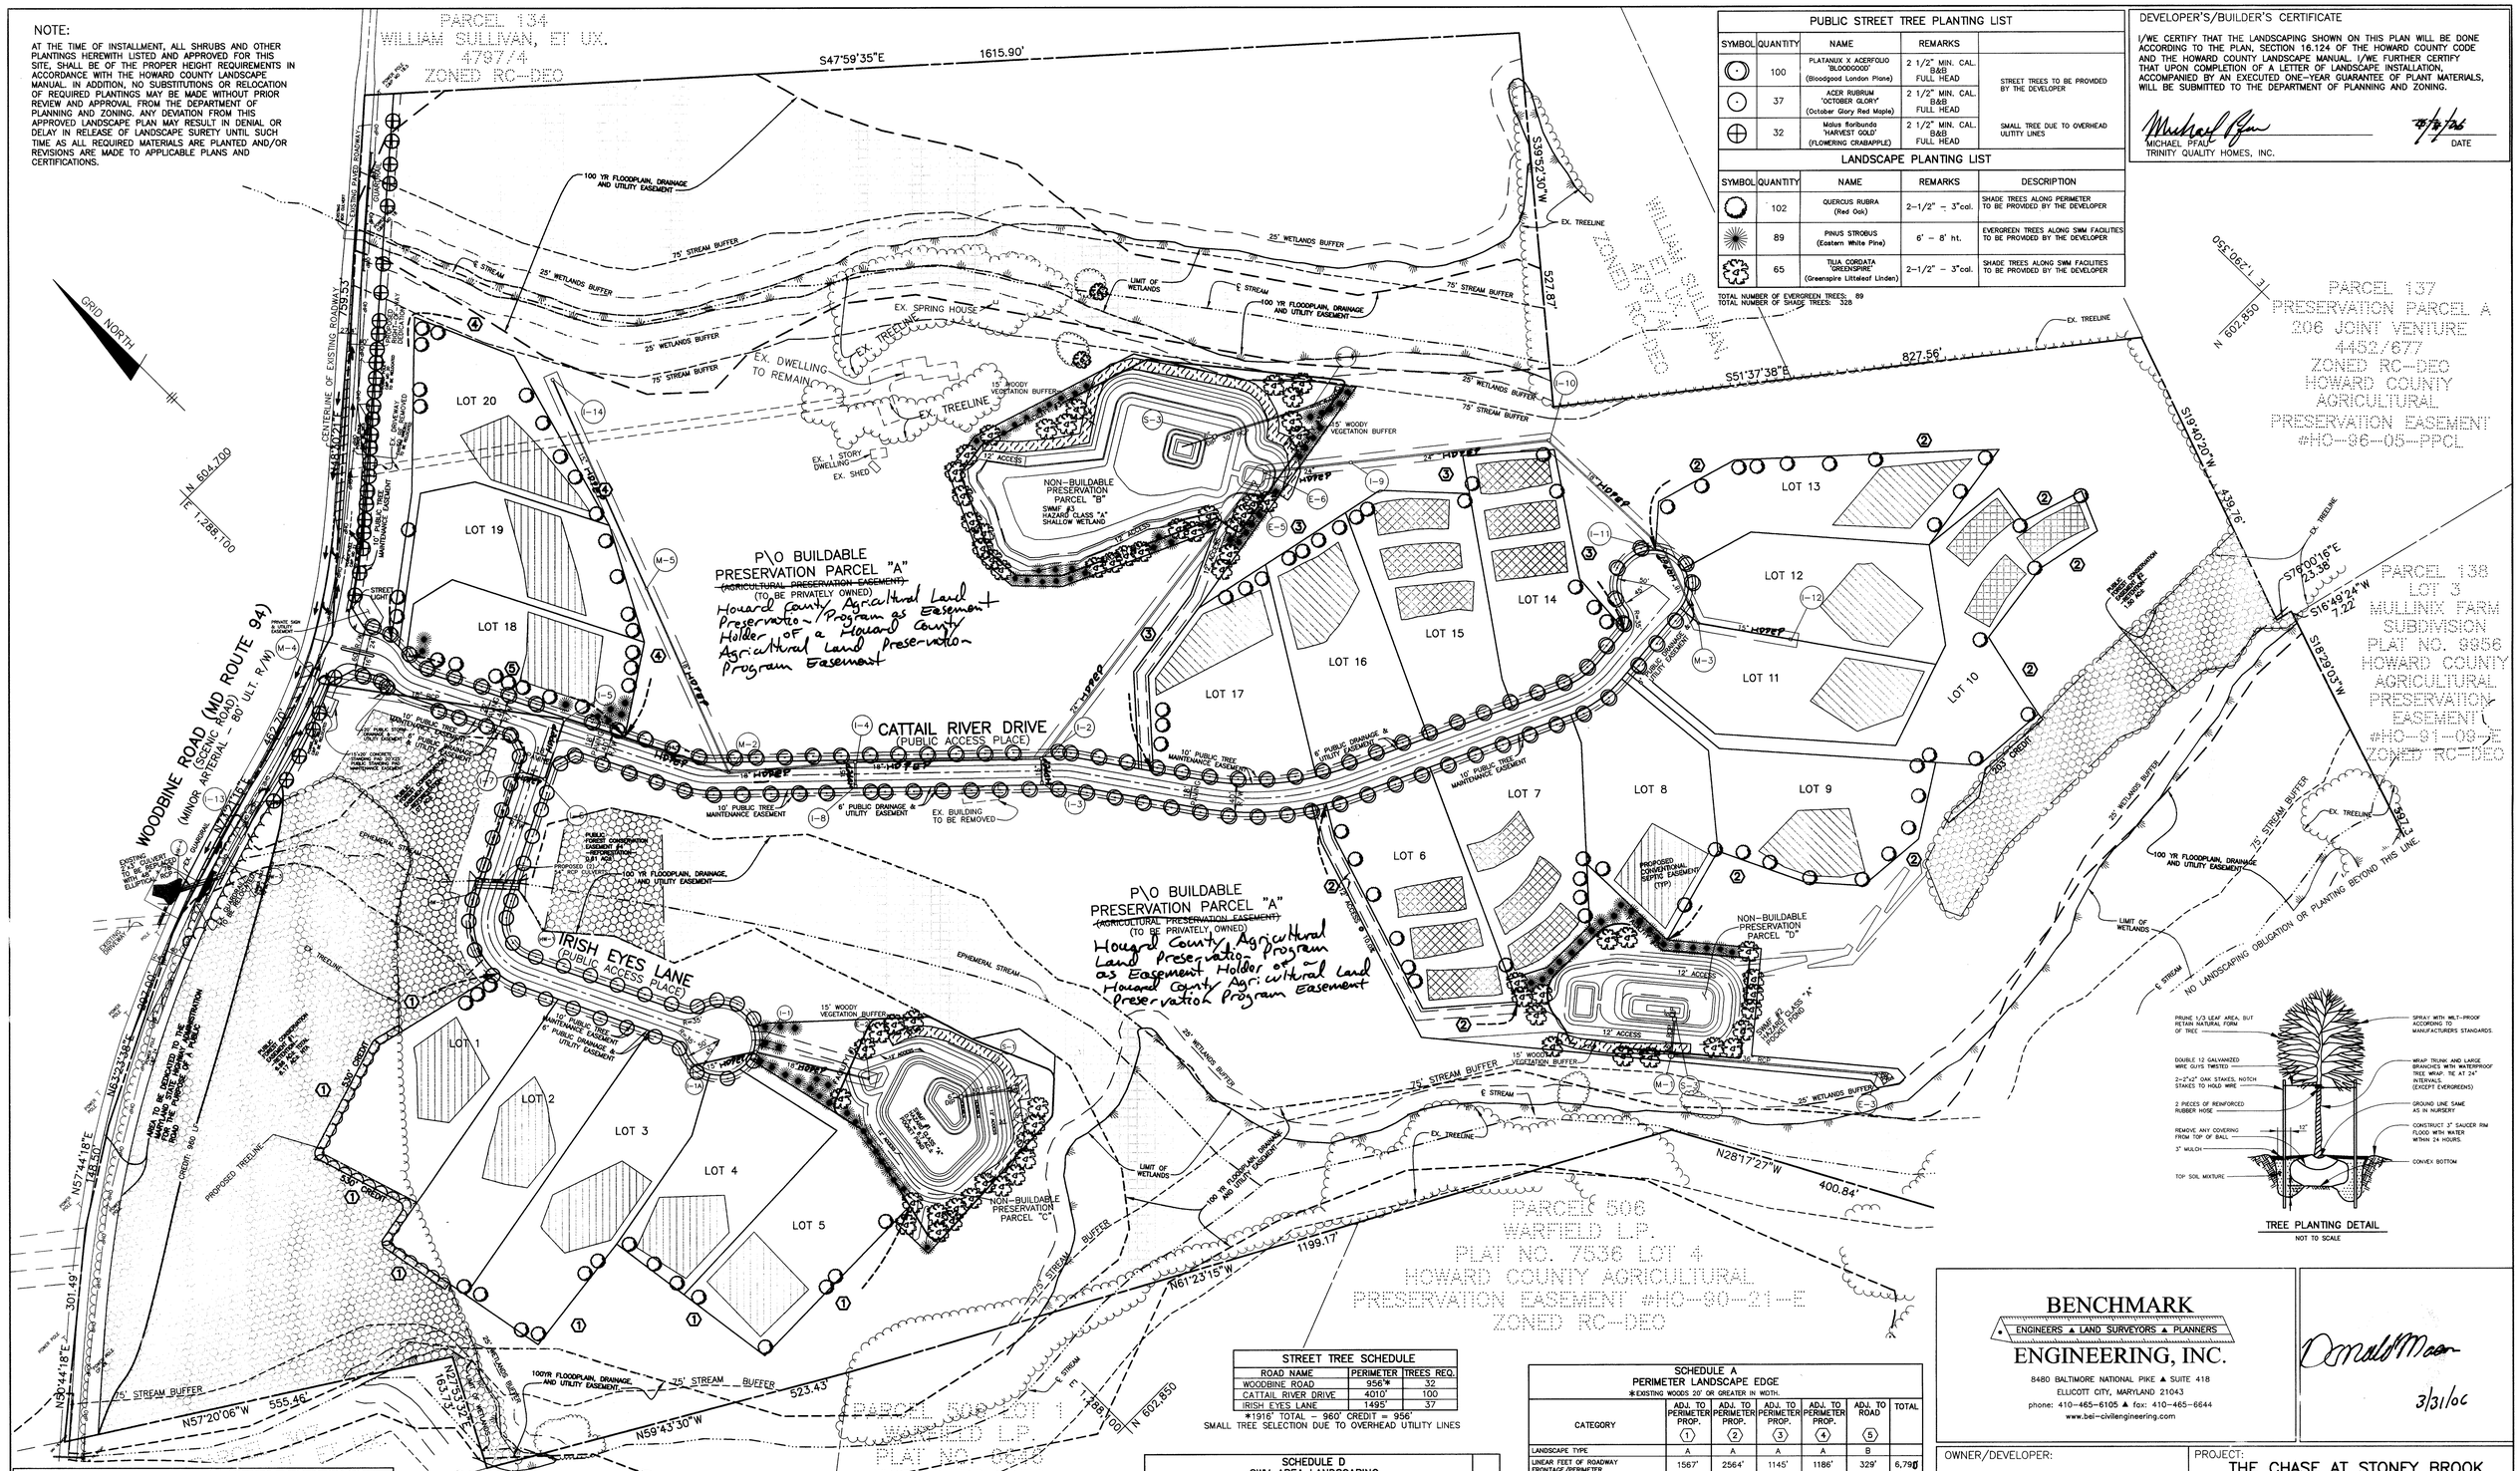


## PUBLIC STREET TREE PLANTING LIST

| SYMBOL | QUANTITY | NAME | REMARKS | |
|---|---|---|---|---|
| | 100 | PLATANUX X ACERFOLIO 'BLOODGOOD' (Bloodgood London Plane) | 2 1/2" MIN. CAL. B&B FULL HEAD | STREET TREES TO BE PROVIDED BY THE DEVELOPER |
| | 37 | ACER RUBRUM 'OCTOBER GLORY' (October Glory Red Maple) | 2 1/2" MIN. CAL. B&B FULL HEAD | |
| | 32 | Malus floribunda 'HARVEST GOLD' (FLOWERING CRABAPPLE) | 2 1/2" MIN. CAL. B&B FULL HEAD | SMALL TREE DUE TO OVERHEAD UUTITY LINES |

## LANDSCAPE PLANTING LIST

| SYMBOL | QUANTITY | NAME | REMARKS | DESCRIPTION |
|---|---|---|---|---|
| | 102 | QUERCUS RUBRA (Red Oak) | 2-1/2" - 3"cal. | SHADE TREES ALONG PERIMETER TO BE PROVIDED BY THE DEVELOPER |
| | 89 | PINUS STROBUS (Eastern White Pine) | 6' - 8' ht. | EVERGREEN TREES ALONG SWM FACILITIES TO BE PROVIDED BY THE DEVELOPER |
| | 65 | TILIA CORDATA 'GREENSPIRE' (Greenspire Littleleaf Linden) | 2-1/2" - 3"cal. | SHADE TREES ALONG SWM FACILITIES TO BE PROVIDED BY THE DEVELOPER |

TOTAL NUMBER OF EVERGREEN TREES: 89
TOTAL NUMBER OF SHADE TREES: 328

## DEVELOPER'S/BUILDER'S CERTIFICATE

I/WE CERTIFY THAT THE LANDSCAPING SHOWN ON THIS PLAN WILL BE DONE ACCORDING TO THE PLAN, SECTION 16.124 OF THE HOWARD COUNTY CODE AND THE HOWARD COUNTY LANDSCAPE MANUAL. I/WE FURTHER CERTIFY THAT UPON COMPLETION OF A LETTER OF LANDSCAPE INSTALLATION, ACCOMPANIED BY AN EXECUTED ONE-YEAR GUARANTEE OF PLANT MATERIALS, WILL BE SUBMITTED TO THE DEPARTMENT OF PLANNING AND ZONING.

MICHAEL PFAU
TRINITY QUALITY HOMES, INC.

DATE




TREE PLANTING DETAIL
NOT TO SCALE

## STREET TREE SCHEDULE

| ROAD NAME | PERIMETER | TREES REQ. |
|---|---|---|
| WOODBINE ROAD | 956'* | 32 |
| CATTAIL RIVER DRIVE | 4010' | 100 |
| IRISH EYES LANE | 1495' | 37 |

*1916' TOTAL - 960' CREDIT = 956'
SMALL TREE SELECTION DUE TO OVERHEAD UTILITY LINES

## SCHEDULE A
## PERIMETER LANDSCAPE EDGE

*EXISTING WOODS 20' OR GREATER IN WIDTH.

| CATEGORY | ADJ. TO PERIMETER PROP. 1 | ADJ. TO PERIMETER PROP. 2 | ADJ. TO PERIMETER PROP. 3 | ADJ. TO PERIMETER PROP. 4 | ADJ. TO ROAD 5 | TOTAL |
|---|---|---|---|---|---|---|
| LANDSCAPE TYPE | A | A | A | A | B | |
| LINEAR FEET OF ROADWAY FRONTAGE/PERIMETER | 1567' | 2564' | 1145' | 1186' | 329' | 6,791 |
| CREDIT FOR EXISTING VEGETATION (YES, NO, LINEAR FEET) (DESCRIBE BELOW IF NEEDED) | YES* 530' | YES* 203' | NO | NO | NO | 733 |
| CREDIT FOR WALL, FENCE OR BERM (YES, NO, LINEAR FEET) (DESCRIBE BELOW IF NEEDED) | NO | NO | NO | NO | NO | |
| NUMBER OF PLANTS REQUIRED | 1037' | 2361' | 1145' | 1186' | 328' | 6,057 |
| SHADE TREES | 17 | 39 | 19 | 20 | 7 | 102 |
| EVERGREEN TREES | – | – | – | – | 8 | 8 |
| OTHER TREES (2:1 SUBSTITUTE) | – | – | – | – | – | – |
| SHRUBS | – | – | – | – | – | – |
| NUMBER OF PLANTS PROVIDED | 1037' | 2361' | 1145' | 1186' | 328' | 6,057 |
| SHADE TREES | 17 | 39 | 19 | 20 | 7 | 102 |
| EVERGREEN TREES | – | – | – | – | 8 | 8 |
| OTHER TREES (2:1 SUBSTITUTE) | – | – | – | – | – | – |
| SHRUBS | – | – | – | – | – | – |

## SCHEDULE D
## SWM AREA LANDSCAPING

| | FACILITY 1 | FACILITY 2 | FACILITY 3 | TOTAL |
|---|---|---|---|---|
| LINEAR FEET OF PERIMETER | 966 | 804 | 1479 | 3249 |
| LINEAR FEET OF EXISTING WOODS LINE | 0 | 0 | 0 | 0 |
| LINEAR FEET OF REQUIRED PLANTING | 966 | 804 | 1479 | 3249 |
| BUFFER TYPE | "B" | "B" | "B" | – |
| NUMBER OF TREES REQUIRED | | | | |
| SHADE TREES | 19 | 16 | 30 | 65 |
| EVERGREEN TREES | 24 | 20 | 37 | 81 |
| NUMBER OF TREES PROVIDED | | | | |
| SHADE TREES | 19 | 16 | 30 | 65 |
| EVERGREEN TREES | 24 | 20 | 37 | 81 |
| CREDIT FOR EXISTING VEGETATION (NO, YES AND %) | NO | NO | NO | – |
| CREDIT FOR OTHER LANDSCAPING (NO, YES AND %) | NO | NO | NO | – |

## LANDSCAPE NOTES:

1. TREES SHOULD BE PLANTED A MINIMUM OF 6 FEET FROM THE EDGE OF PAVING AND MUST BE A MINIMUM OF 5 FEET FROM ANY STORM DRAIN.
2. TREES MUST BE PLANTED A MINIMUM OF 5 FEET FROM AN OPEN SPACE ACCESS STRIP, 10 FEET FROM A DRIVEWAY AND 15' FROM ANY STREET LIGHT.
3. SEE TREE PLANTING DETAIL - THIS SHEET.
4. THIS PLAN HAS BEEN PREPARED IN ACCORDANCE WITH THE PROVISIONS OF SECTION 16.124 OF THE HOWARD COUNTY CODE AND THE HOWARD COUNTY LANDSCAPE MANUAL.
5. FINANCIAL SURETY FOR THE REQUIRED LANDSCAPING HAS BEEN POSTED AS PART OF THE DPW DEVELOPER'S AGREEMENT IN THE AMOUNT OF $63,450.00. ($50,100.00 FOR 167 SHADE TREES, $13,350.00 FOR 89 EVERGREENS.

APPROVED: HOWARD COUNTY DEPARTMENT OF PUBLIC WORKS

CHIEF, BUREAU OF HIGHWAYS — DATE 4-21-06

APPROVED: HOWARD COUNTY DEPT. OF PLANNING AND ZONING

CHIEF, DIVISION OF LAND DEVELOPMENT — DATE 5/2/06

CHIEF, DEVELOPMENT ENGINEERING DIVISION — DATE 5/2/06


BENCHMARK
ENGINEERS ▲ LAND SURVEYORS ▲ PLANNERS
ENGINEERING, INC.
8480 BALTIMORE NATIONAL PIKE ▲ SUITE 418
ELLICOTT CITY, MARYLAND 21043
phone: 410-465-6105 ▲ fax: 410-465-6644
www.bei-civilengineering.com


3/31/06

OWNER/DEVELOPER:
TRINITY QUALITY HOMES, INC.
3675 PARK AVENUE
SUITE 301
ELLICOTT CITY, MD 21043
410-480-0023

| NO. | DATE | REVISION |
|---|---|---|
| 1 | 12/06 | REVISE STORM DRAIN MATERIAL |

PROJECT:
THE CHASE AT STONEY BROOK
LOTS 1-20, PRESERVATION PARCEL "A" AND NON-BUILDABLE PRESERVATION PARCELS "B" THROUGH "D"

LOCATION:
TAX MAP No. 7 BLOCK No. 17 PARCEL No. 133
4th ELECTION DISTRICT
HOWARD COUNTY, MARYLAND

TITLE:
LANDSCAPE PLAN

DATE: AUGUST, 2005 / MARCH, 2006 — PROJECT NO. 1187

DES: JMC — DRAFT: RPS — CHECK: DAM — SCALE: 1" = 100' — SHEET 13 OF 19

F-05-170

P:\1187\dwg\7022S13.dwg, sheet 13, 3/31/2006 2:12:36 PM, jmc, Oce TDS600 HDI for mylar.pc3

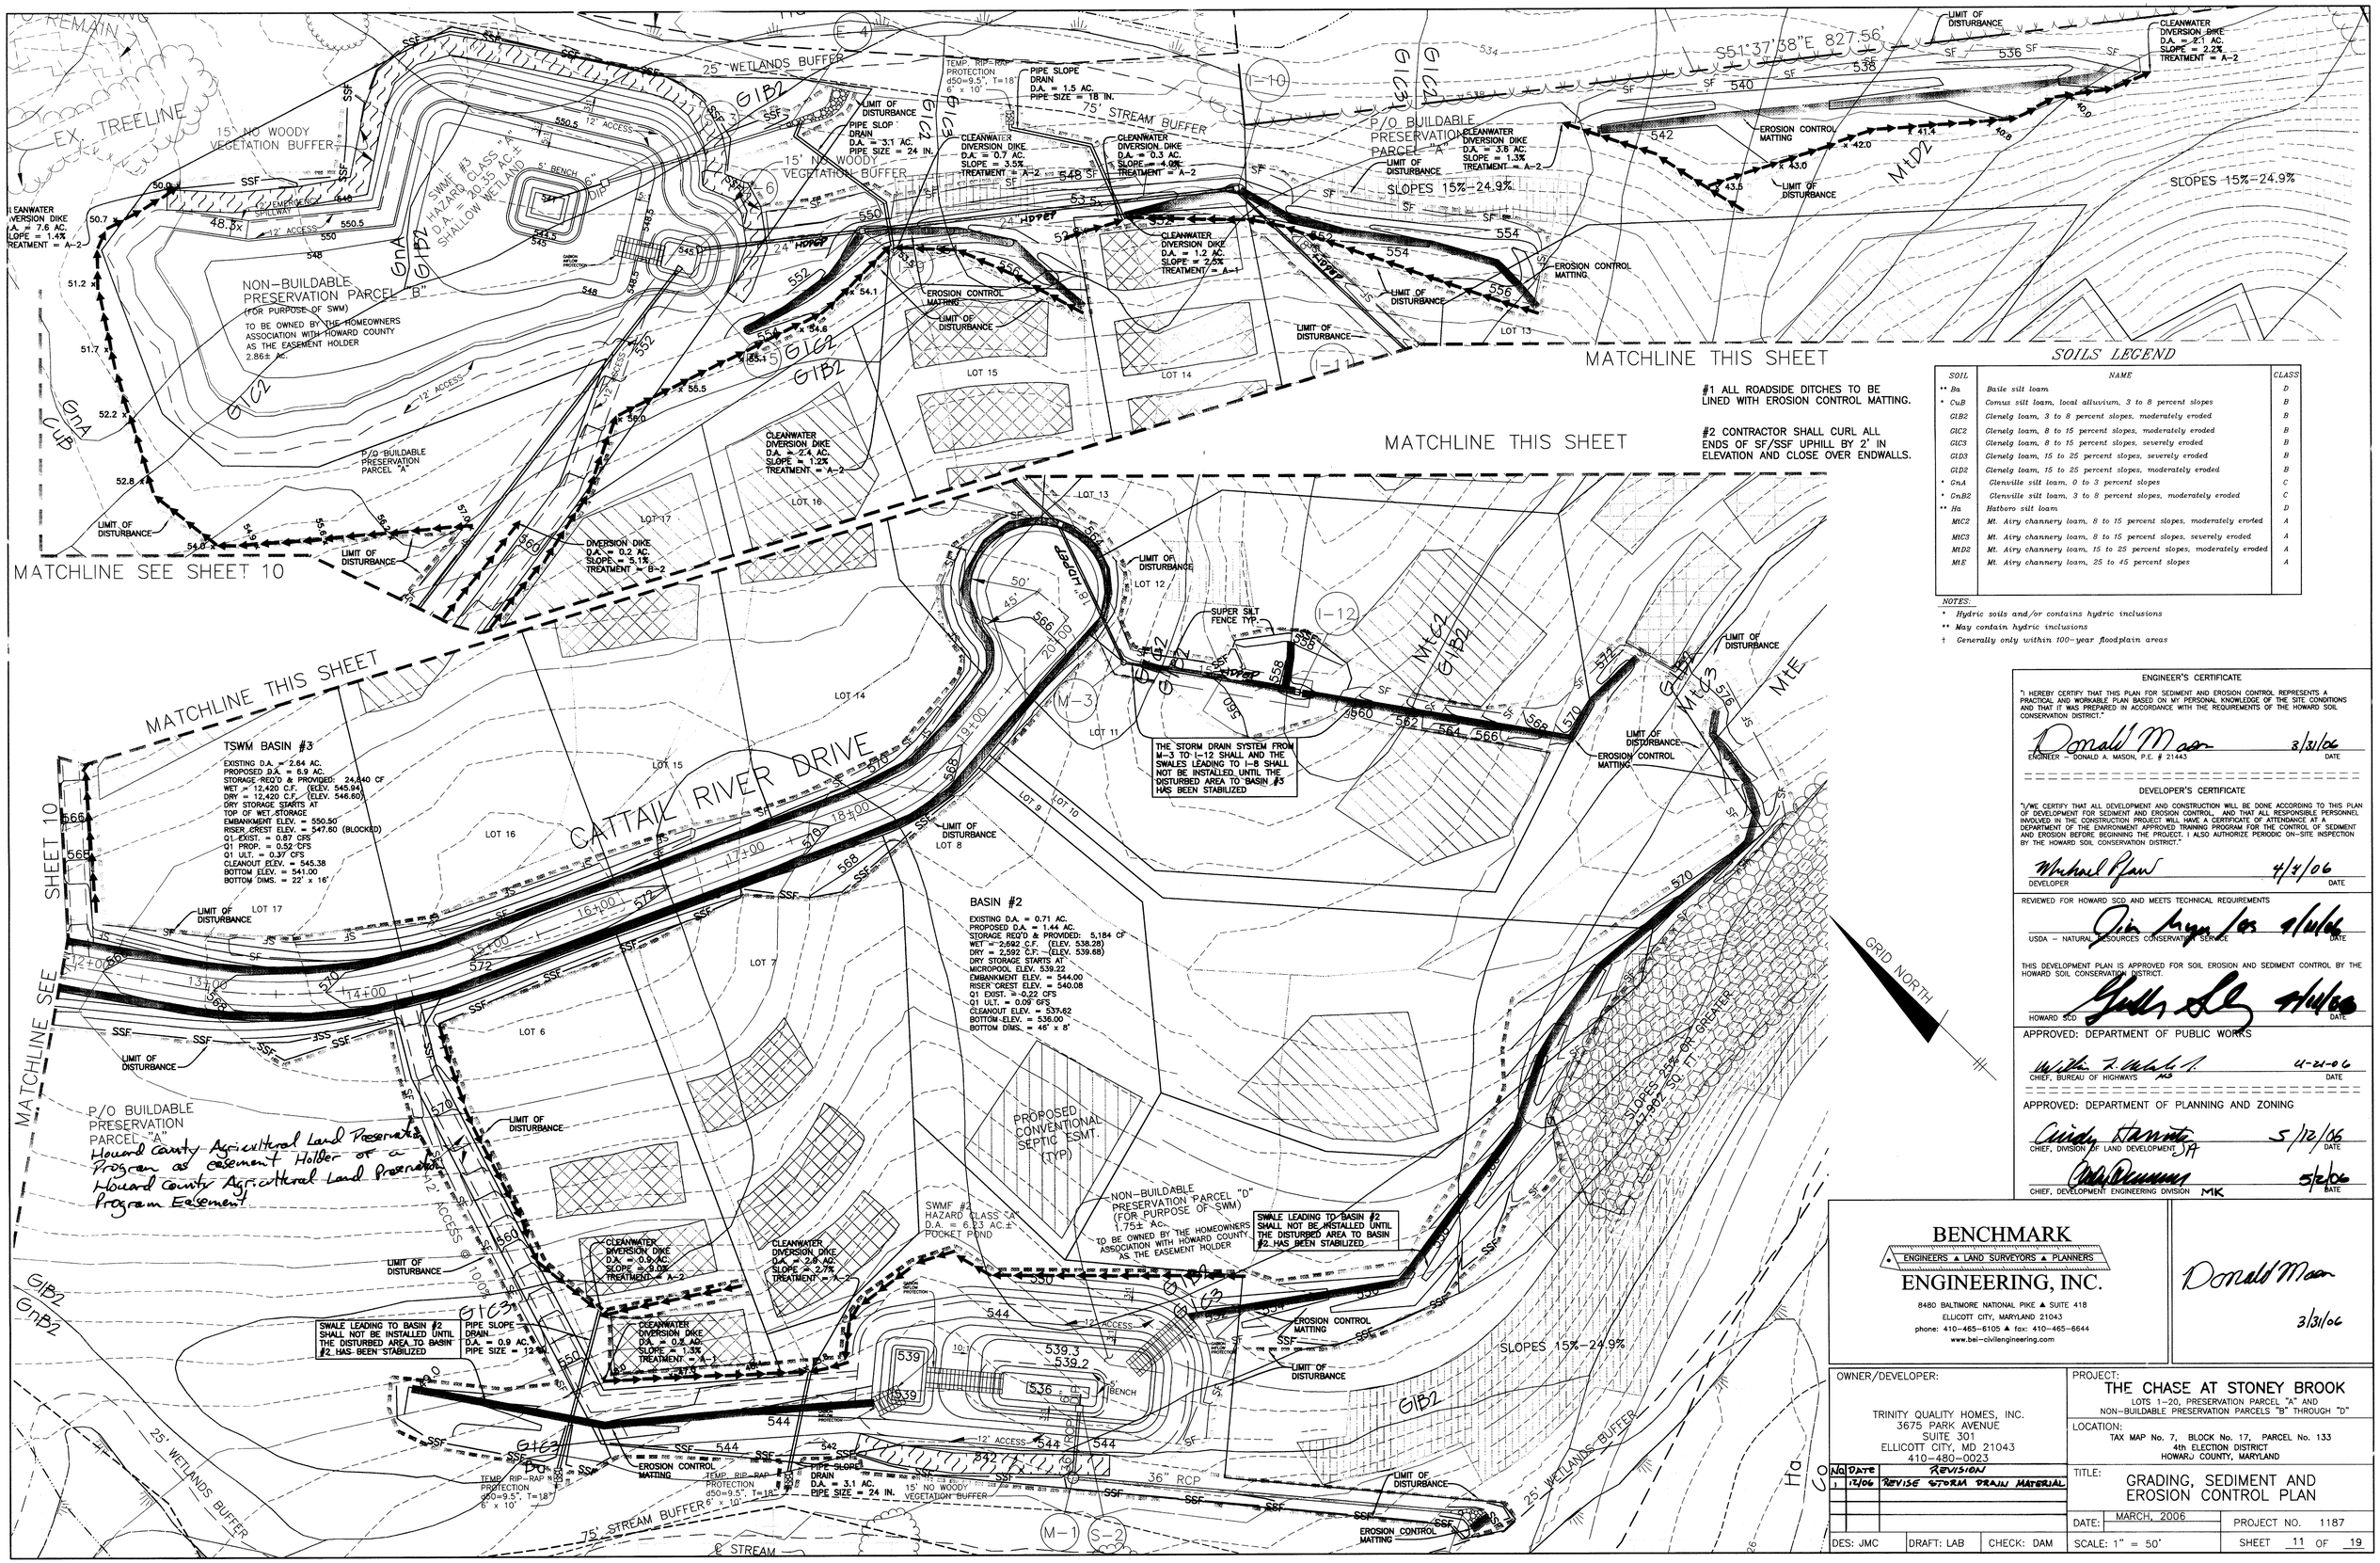


#1 ALL ROADSIDE DITCHES TO BE LINED WITH EROSION CONTROL MATTING.

#2 CONTRACTOR SHALL CURL ALL ENDS OF SF/SSF UPHILL BY 2' IN ELEVATION AND CLOSE OVER ENDWALLS.

## SOILS LEGEND

| SOIL | NAME | CLASS |
|---|---|---|
| ** Ba | Baile silt loam | D |
| * CuB | Comus silt loam, local alluvium, 3 to 8 percent slopes | B |
| GlB2 | Glenelg loam, 3 to 8 percent slopes, moderately eroded | B |
| GlC2 | Glenelg loam, 8 to 15 percent slopes, moderately eroded | B |
| GlC3 | Glenelg loam, 8 to 15 percent slopes, severely eroded | B |
| GlD3 | Glenelg loam, 15 to 25 percent slopes, severely eroded | B |
| GlD2 | Glenelg loam, 15 to 25 percent slopes, moderately eroded | B |
| * GnA | Glenville silt loam, 0 to 3 percent slopes | C |
| * GnB2 | Glenville silt loam, 3 to 8 percent slopes, moderately eroded | C |
| ** Ha | Hatboro silt loam | D |
| MtC2 | Mt. Airy channery loam, 8 to 15 percent slopes, moderately eroded | A |
| MtC3 | Mt. Airy channery loam, 8 to 15 percent slopes, severely eroded | A |
| MtD2 | Mt. Airy channery loam, 15 to 25 percent slopes, moderately eroded | A |
| MtE | Mt. Airy channery loam, 25 to 45 percent slopes | A |

NOTES:

* Hydric soils and/or contains hydric inclusions

** May contain hydric inclusions

† Generally only within 100-year floodplain areas

### ENGINEER'S CERTIFICATE

"I HEREBY CERTIFY THAT THIS PLAN FOR SEDIMENT AND EROSION CONTROL REPRESENTS A PRACTICAL AND WORKABLE PLAN BASED ON MY PERSONAL KNOWLEDGE OF THE SITE CONDITIONS AND THAT IT WAS PREPARED IN ACCORDANCE WITH THE REQUIREMENTS OF THE HOWARD SOIL CONSERVATION DISTRICT."

ENGINEER – DONALD A. MASON, P.E. # 21443 — DATE 3/31/06

### DEVELOPER'S CERTIFICATE

"I/WE CERTIFY THAT ALL DEVELOPMENT AND CONSTRUCTION WILL BE DONE ACCORDING TO THIS PLAN OF DEVELOPMENT FOR SEDIMENT AND EROSION CONTROL, AND THAT ALL RESPONSIBLE PERSONNEL INVOLVED IN THE CONSTRUCTION PROJECT WILL HAVE A CERTIFICATE OF ATTENDANCE AT A DEPARTMENT OF THE ENVIRONMENT APPROVED TRAINING PROGRAM FOR THE CONTROL OF SEDIMENT AND EROSION BEFORE BEGINNING THE PROJECT. I ALSO AUTHORIZE PERIODIC ON-SITE INSPECTION BY THE HOWARD SOIL CONSERVATION DISTRICT."

DEVELOPER — DATE 4/4/06

REVIEWED FOR HOWARD SCD AND MEETS TECHNICAL REQUIREMENTS

USDA – NATURAL RESOURCES CONSERVATION SERVICE — DATE 4/4/06

THIS DEVELOPMENT PLAN IS APPROVED FOR SOIL EROSION AND SEDIMENT CONTROL BY THE HOWARD SOIL CONSERVATION DISTRICT.

HOWARD SCD — DATE 4/4/06

APPROVED: DEPARTMENT OF PUBLIC WORKS

CHIEF, BUREAU OF HIGHWAYS — DATE 4-24-06

APPROVED: DEPARTMENT OF PLANNING AND ZONING

CHIEF, DIVISION OF LAND DEVELOPMENT — DATE 5/12/06

CHIEF, DEVELOPMENT ENGINEERING DIVISION MK — DATE 5/2/06


BENCHMARK
ENGINEERS ▲ LAND SURVEYORS ▲ PLANNERS
ENGINEERING, INC.
8480 BALTIMORE NATIONAL PIKE ▲ SUITE 418
ELLICOTT CITY, MARYLAND 21043
phone: 410-465-6105 ▲ fax: 410-465-6644
www.bei-civilengineering.com


3/31/06

OWNER/DEVELOPER:
TRINITY QUALITY HOMES, INC.
3675 PARK AVENUE
SUITE 301
ELLICOTT CITY, MD 21043
410-480-0023

PROJECT:
# THE CHASE AT STONEY BROOK
LOTS 1-20, PRESERVATION PARCEL "A" AND NON-BUILDABLE PRESERVATION PARCELS "B" THROUGH "D"

LOCATION:
TAX MAP No. 7, BLOCK No. 17, PARCEL No. 133
4th ELECTION DISTRICT
HOWARD COUNTY, MARYLAND

| NO | DATE | REVISION |
|---|---|---|
| 1 | 1/06 | REVISE STORM DRAIN MATERIAL |

TITLE:
## GRADING, SEDIMENT AND EROSION CONTROL PLAN

DATE: MARCH, 2006 — PROJECT NO. 1187

DES: JMC — DRAFT: LAB — CHECK: DAM — SCALE: 1" = 50' — SHEET 11 OF 19

F-05-170

P:\1187.dwg\7026S1.dwg, SHEET 11, 3/31/2006 2:03:01 PM,
Exc. Oce TDS8600 HDI for xrvlar.pc3

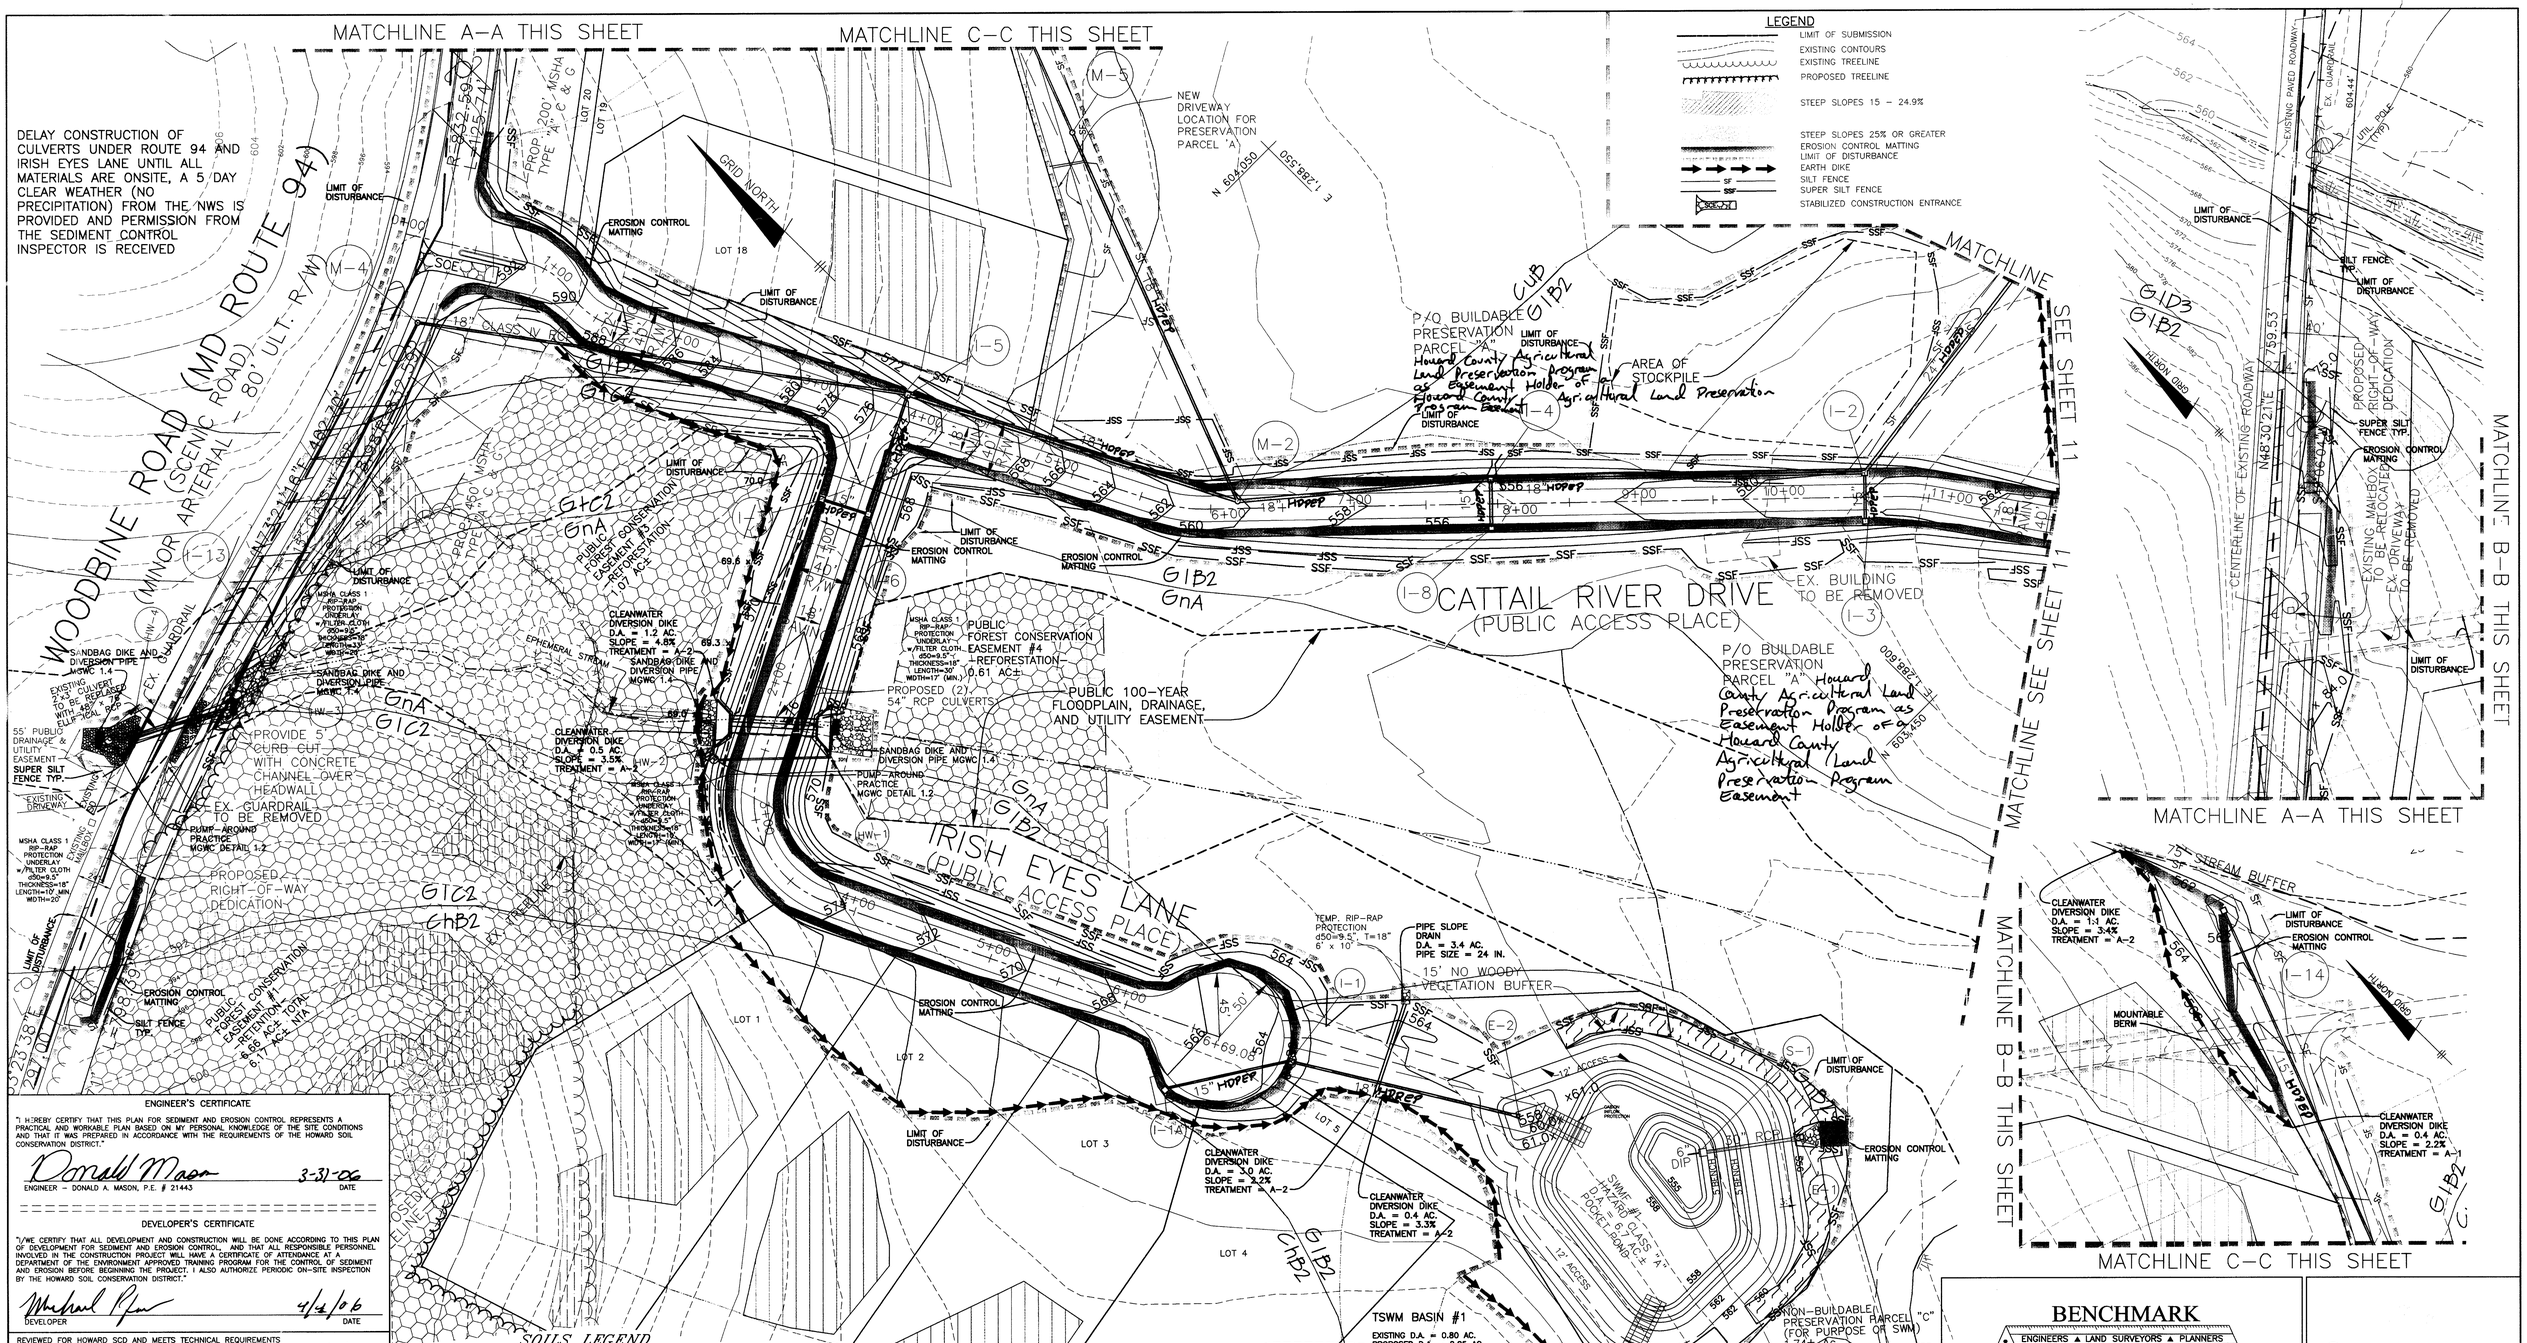


| SOIL | NAME | CLASS |
|---|---|---|
| ** Ba | Baile silt loam | D |
| * CuB | Comus silt loam, local alluvium, 3 to 8 percent slopes | B |
| GlB2 | Glenelg loam, 3 to 8 percent slopes, moderately eroded | B |
| GlC2 | Glenelg loam, 8 to 15 percent slopes, moderately eroded | B |
| GlC3 | Glenelg loam, 8 to 15 percent slopes, severely eroded | B |
| GlD3 | Glenelg loam, 15 to 25 percent slopes, severely eroded | B |
| GlD2 | Glenelg loam, 15 to 25 percent slopes, moderately eroded | B |
| * GnA | Glenville silt loam, 0 to 3 percent slopes | C |
| * GnB2 | Glenville silt loam, 3 to 8 percent slopes, moderately eroded | C |
| ** Ha | Hatboro silt loam | D |
| MtC2 | Mt. Airy channery loam, 8 to 15 percent slopes, moderately eroded | A |
| MtC3 | Mt. Airy channery loam, 8 to 15 percent slopes, severely eroded | A |
| MtD2 | Mt. Airy channery loam, 15 to 25 percent slopes, moderately eroded | A |
| MtE | Mt. Airy channery loam, 25 to 45 percent slopes | A |

*NOTES:*
* *Hydric soils and/or contains hydric inclusions*
** *May contain hydric inclusions*
† *Generally only within 100-year floodplain areas*

### ENGINEER'S CERTIFICATE

"I HEREBY CERTIFY THAT THIS PLAN FOR SEDIMENT AND EROSION CONTROL REPRESENTS A PRACTICAL AND WORKABLE PLAN BASED ON MY PERSONAL KNOWLEDGE OF THE SITE CONDITIONS AND THAT IT WAS PREPARED IN ACCORDANCE WITH THE REQUIREMENTS OF THE HOWARD SOIL CONSERVATION DISTRICT."

Donald Mason — 3-31-06
ENGINEER – DONALD A. MASON, P.E. # 21443 — DATE

### DEVELOPER'S CERTIFICATE

"I/WE CERTIFY THAT ALL DEVELOPMENT AND CONSTRUCTION WILL BE DONE ACCORDING TO THIS PLAN OF DEVELOPMENT FOR SEDIMENT AND EROSION CONTROL, AND THAT ALL RESPONSIBLE PERSONNEL INVOLVED IN THE CONSTRUCTION PROJECT WILL HAVE A CERTIFICATE OF ATTENDANCE AT A DEPARTMENT OF THE ENVIRONMENT APPROVED TRAINING PROGRAM FOR THE CONTROL OF SEDIMENT AND EROSION BEFORE BEGINNING THE PROJECT. I ALSO AUTHORIZE PERIODIC ON-SITE INSPECTION BY THE HOWARD SOIL CONSERVATION DISTRICT."

Michael Ryan — 4/4/06
DEVELOPER — DATE

REVIEWED FOR HOWARD SCD AND MEETS TECHNICAL REQUIREMENTS

Jim Myers — 4/11/06
USDA – NATURAL RESOURCES CONSERVATION SERVICE — DATE

THIS DEVELOPMENT PLAN IS APPROVED FOR SOIL EROSION AND SEDIMENT CONTROL BY THE HOWARD SOIL CONSERVATION DISTRICT.

4/11/06
HOWARD SCD — DATE

APPROVED: DEPARTMENT OF PUBLIC WORKS

William F. Weber Jr. — 4-21-06
CHIEF, BUREAU OF HIGHWAYS — DATE

APPROVED: DEPARTMENT OF PLANNING AND ZONING

Cindy Carman — 5/2/06
CHIEF, DIVISION OF LAND DEVELOPMENT — DATE

5/2/06
CHIEF, DEVELOPMENT ENGINEERING DIVISION — DATE

**BENCHMARK**
ENGINEERS ▲ LAND SURVEYORS ▲ PLANNERS
**ENGINEERING, INC.**
8480 BALTIMORE NATIONAL PIKE ▲ SUITE 418
ELLICOTT CITY, MARYLAND 21043
phone: 410-465-6105 ▲ fax: 410-465-6644
www.bei-civilengineering.com

Donald Mason
3/31/06

OWNER/DEVELOPER:
TRINITY QUALITY HOMES, INC.
3675 PARK AVENUE
SUITE 301
ELLICOTT CITY, MD 21043
410-480-0023

| No. | DATE | REVISION |
|---|---|---|
| 1 | 12/06 | REVISE STORM DRAIN MATERIAL |

DES: JMC | DRAFT: LAB | CHECK: DAM

PROJECT:
**THE CHASE AT STONEY BROOK**
LOTS 1-20, PRESERVATION PARCEL "A" AND NON-BUILDABLE PRESERVATION PARCELS "B" THROUGH "D"

LOCATION:
TAX MAP No. 7, BLOCK No. 17, PARCEL No. 133
4th ELECTION DISTRICT
HOWARD COUNTY, MARYLAND

TITLE:
GRADING, SEDIMENT AND EROSION CONTROL PLAN

DATE: MARCH, 2006 | PROJECT NO. 1187
SCALE: 1" = 50' | SHEET 10 OF 19

F-05-170

P:\1187dwg\7026S1.dwg, SHEET 10, 3/31/2006 2:02:31 PM,

## DETAIL 25 – ROCK OUTLET PROTECTION I

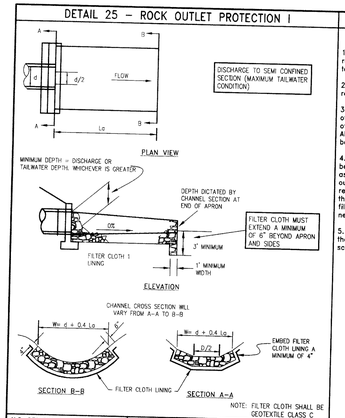


| U.S. DEPARTMENT OF AGRICULTURE SOIL CONSERVATION SERVICE | PAGE F – 18 – 8 | MARYLAND DEPARTMENT OF ENVIRONMENT WATER MANAGEMENT ADMINISTRATION |
|---|---|---|

## ROCK OUTLET PROTECTION I

### CONSTRUCTION SPECIFICATIONS

1. The subgrade for the filter, rip-rap, or gabion shall be prepared to the required lines and grades. Any fill required in the subgrade shall be compacted to a density of approximately that of the surrounding undisturbed material.

2. The rock or gravel shall conform to the specified grading limits when installed respectively in the rip-rap or filter.

3. Geotextile shall be protected from punching, cutting, or tearing. Any damage other than an occasional small hole shall be repaired by placing another piece of geotextile over the damaged part or by completely replacing the geotextile. All overlaps whether for repairs or for joining two pieces of geotextile shall be a minimum of one foot.

4. Stone for the rip-rap or gabion outlets may be placed by equipment. They shall be constructed to the full course thickness in one operation and in such a manner as to avoid displacement of underlying materials. The stone for rip-rap or gabion outlets shall be delivered and placed in a manner that will ensure that it is reasonably homogeneous with the smaller stones and spalls filling the voids between the larger stones. Rip-rap shall be placed in a manner to prevent damage to the filter blanket or geotextile. Hand placement will be required to the extent necessary to prevent damage to the permanent works.

5. The stone shall be placed so that it blends in with the existing ground. If the stone is placed too high then the flow will be forced out of the channel and scour adjacent to the stone will occur.

| U.S. DEPARTMENT OF AGRICULTURE SOIL CONSERVATION SERVICE | PAGE F – 18 – 8A | MARYLAND DEPARTMENT OF ENVIRONMENT WATER MANAGEMENT ADMINISTRATION |
|---|---|---|

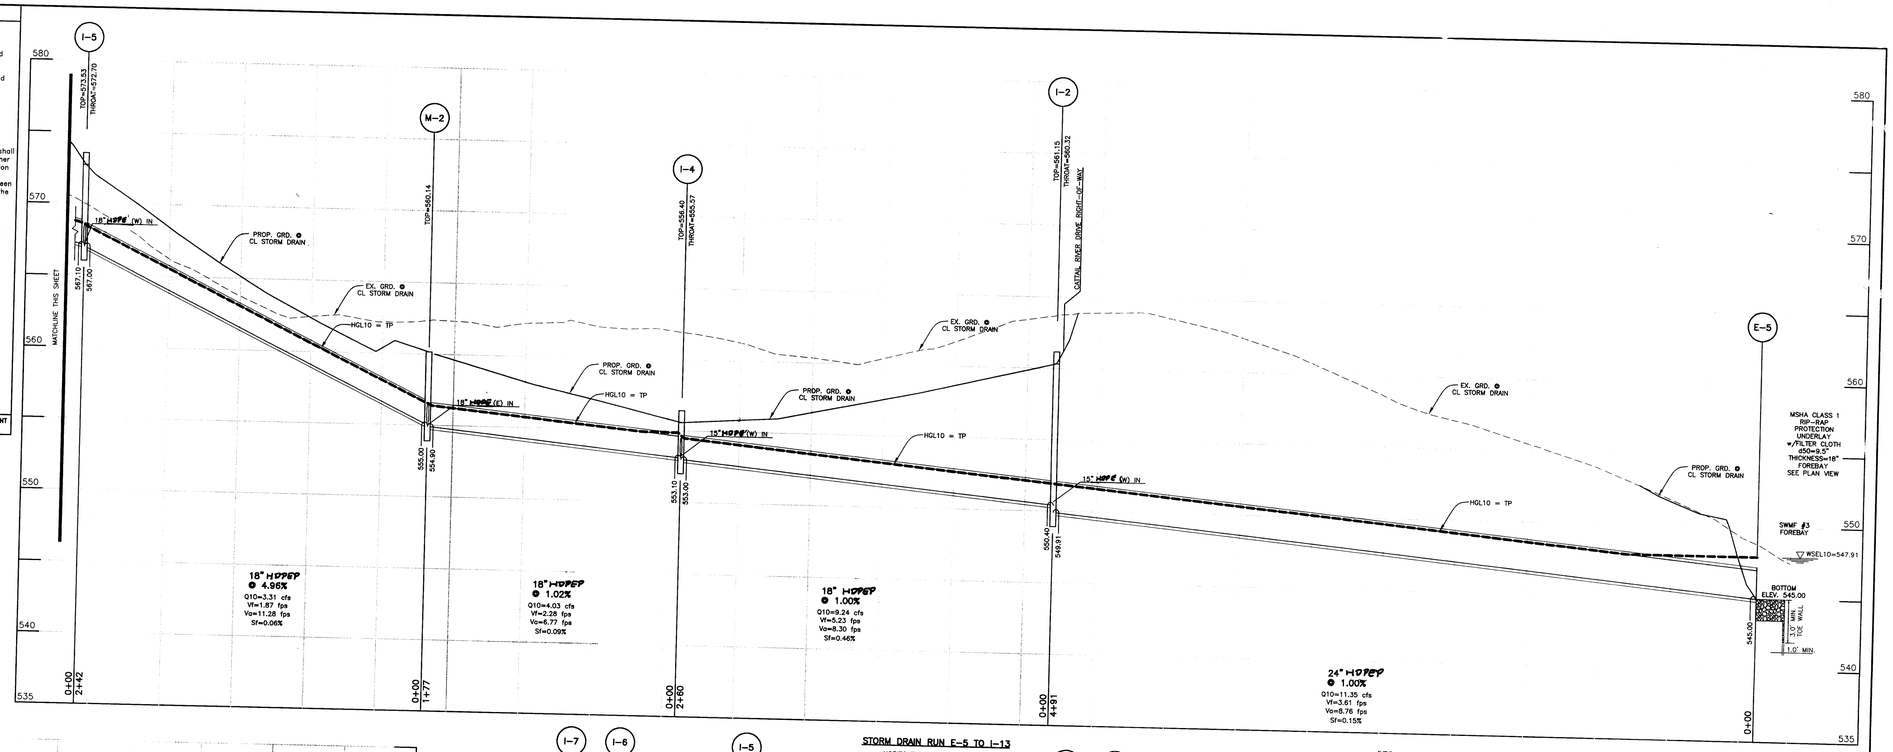


STORM DRAIN RUN E-5 TO I-13
HORIZONTAL SCALE: 1" = 50'
VERTICAL SCALE: 1" = 5'

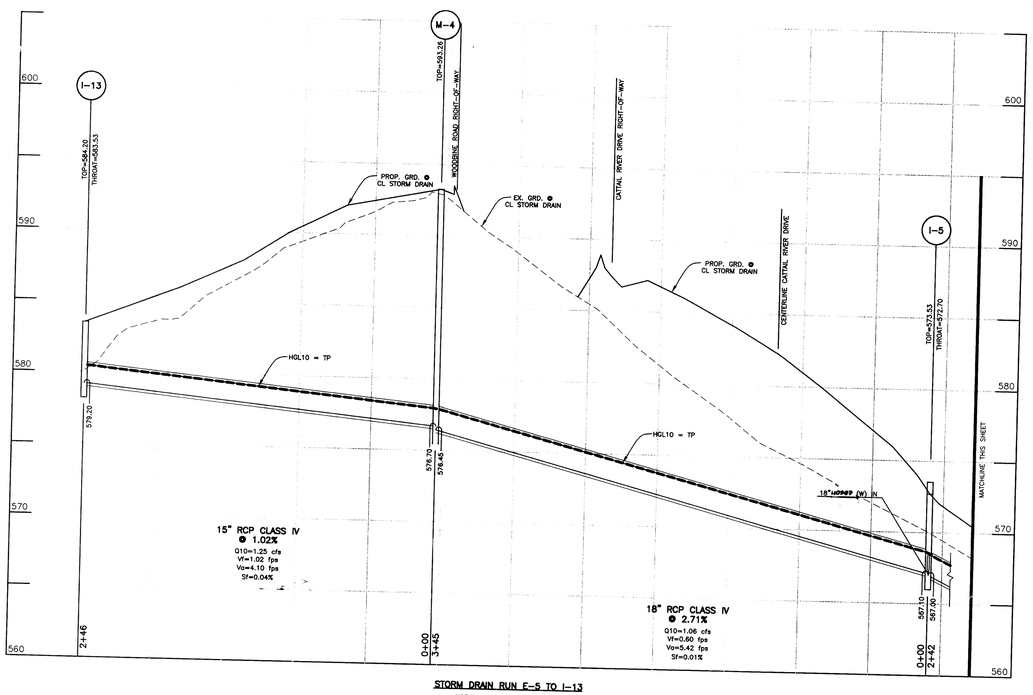


STORM DRAIN RUN E-5 TO I-13
HORIZONTAL SCALE: 1" = 50'
VERTICAL SCALE: 1" = 5'

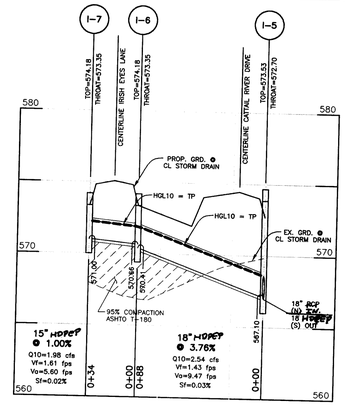


STORM DRAIN RUN I-5 TO I-7
HORIZONTAL SCALE: 1" = 50'
VERTICAL SCALE: 1" = 5'

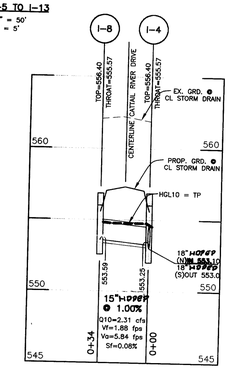


STORM DRAIN RUN I-4 TO I-8
HORIZONTAL SCALE: 1" = 50'
VERTICAL SCALE: 1" = 5'

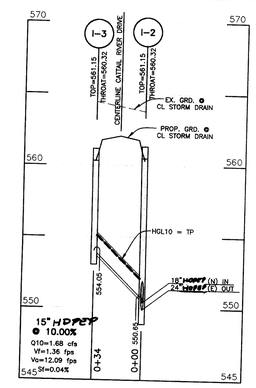


STORM DRAIN RUN I-2 TO I-3
HORIZONTAL SCALE: 1" = 50'
VERTICAL SCALE: 1" = 5'

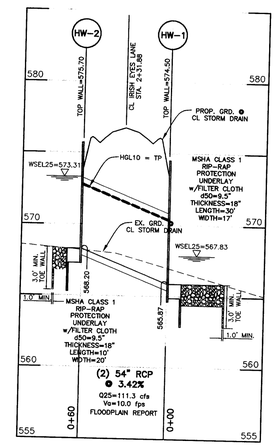


STORM DRAIN RUN HW-1 TO HW-2
HORIZONTAL SCALE: 1" = 50'
VERTICAL SCALE: 1" = 5'

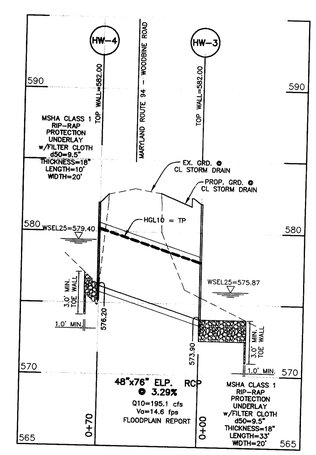


STORM DRAIN RUN HW-3 TO HW-4
HORIZONTAL SCALE: 1" = 50'
VERTICAL SCALE: 1" = 5'

| No. | DATE | REVISION |
|---|---|---|
| 1 | 12/6/06 | REVISE STORM DRAIN MATERIAL |

**BENCHMARK**
ENGINEERS ▲ LAND SURVEYORS ▲ PLANNERS
**ENGINEERING, INC.**
8480 BALTIMORE NATIONAL PIKE ▲ SUITE 418
ELLICOTT CITY, MARYLAND 21043
phone: 410-465-6105 ▲ fax: 410-465-6644
www.bei-civilengineering.com

Donald Mason
3/31/06

OWNER/DEVELOPER:
TRINITY QUALITY HOMES, INC.
3675 PARK AVENUE
SUITE 301
ELLICOTT CITY, MD 21043
410-480-0023

PROJECT:
THE CHASE AT STONEY BROOK
LOTS 1-20, PRESERVATION PARCEL "A" AND NON-BUILDABLE PRESERVATION PARCELS "B" THROUGH "D"

LOCATION:
TAX MAP NO. 7 BLOCK NO. 17 PARCEL NO. 133
4th ELECTION DISTRICT
HOWARD COUNTY, MARYLAND

TITLE:
STORM DRAIN PROFILES

DATE: AUGUST, 2005
MARCH, 2006

PROJECT NO. 1187

APPROVED: HOWARD COUNTY DEPARTMENT OF PUBLIC WORKS
CHIEF, BUREAU OF HIGHWAYS — DATE 4-21-06

APPROVED: HOWARD COUNTY DEPT. OF PLANNING AND ZONING
CHIEF, DIVISION OF LAND DEVELOPMENT — DATE 5/12/06
CHIEF, DEVELOPMENT ENGINEERING DIVISION — DATE 5/2/06

wg\704458_9.dwg, Sheet 9, 3/31/2006 2:20:12 PM,
ps5600 HDI for mvlar.pc3

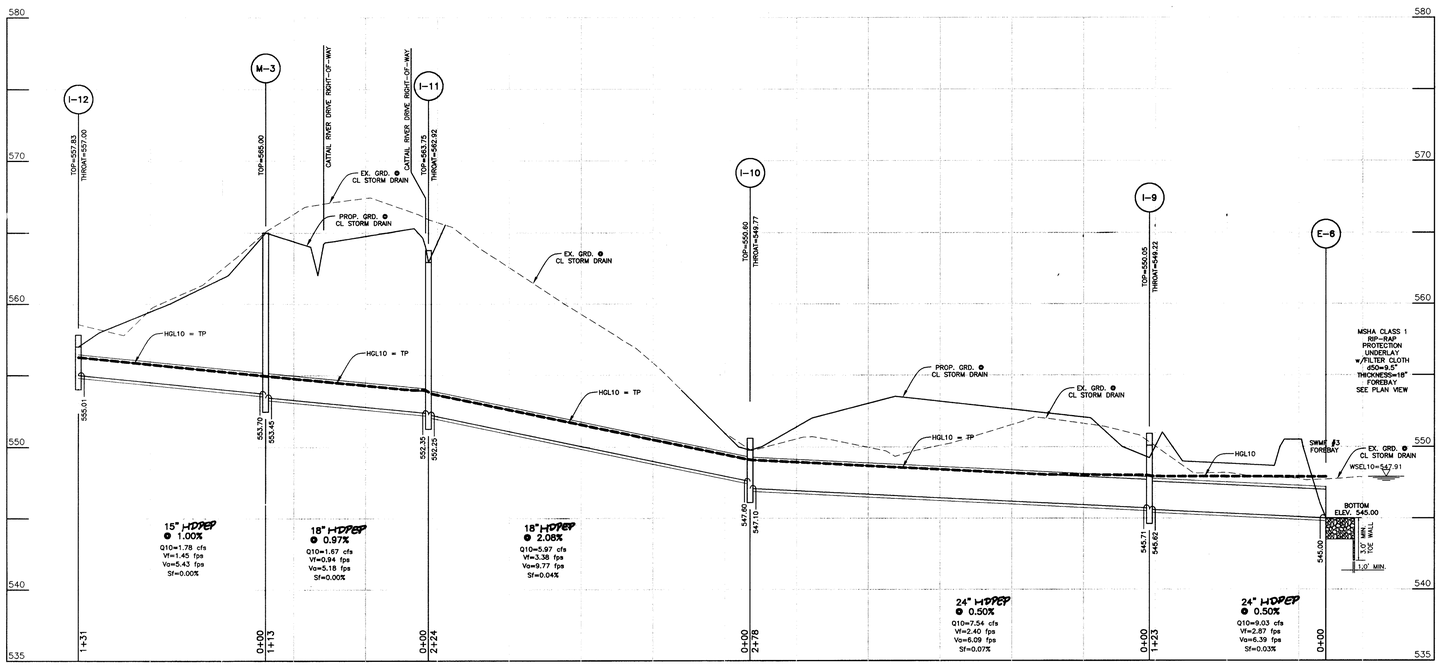


STORM DRAIN RUN E-6 TO I-12
HORIZONTAL SCALE: 1" = 50'
VERTICAL SCALE: 1" = 5'

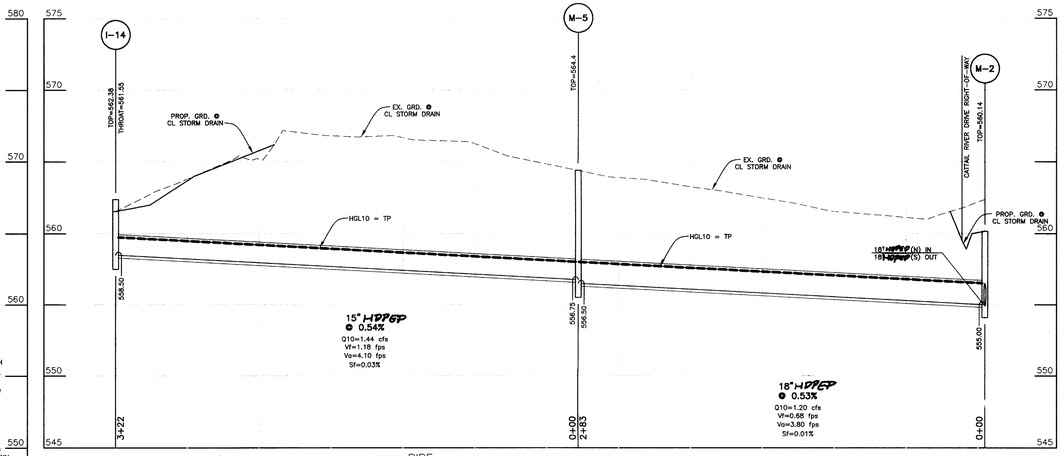


STORM DRAIN RUN M-2 TO I-14
HORIZONTAL SCALE: 1" = 50'
VERTICAL SCALE: 1" = 5'

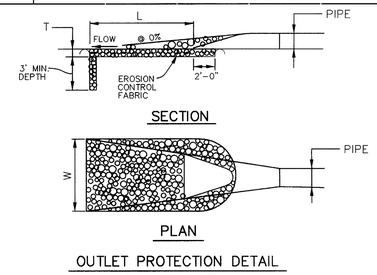


OUTLET PROTECTION DETAIL
NOT TO SCALE

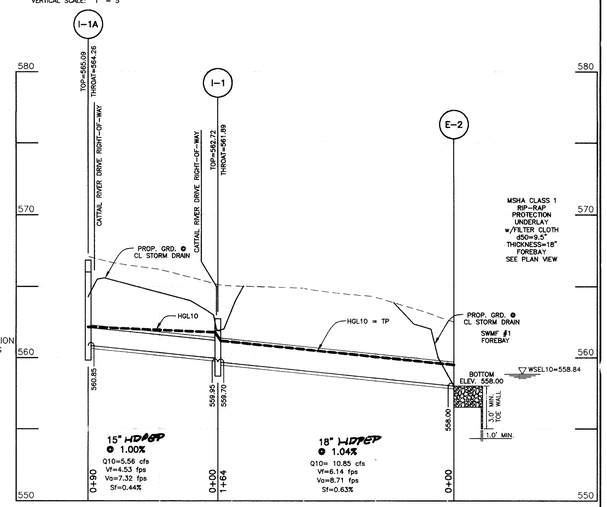


STORM DRAIN RUN E-2 TO I-1A
HORIZONTAL SCALE: 1" = 50'
VERTICAL SCALE: 1" = 5'

## STRUCTURE SCHEDULE

| NO. | TYPE | LOCATION | THROAT INV. | INVERT IN | INVERT OUT | TOP ELEV. | STANDARD | REMARKS |
|---|---|---|---|---|---|---|---|---|
| I-1 | TYPE "D" | STA. 1+49.72 OFF. 8.00' LT. | 561.89 | 559.95 | 559.70 | 562.72 | Ho.Co.STD. SD-4.11 | OPEN 4 SIDES |
| I-1A | TYPE "D" | STA. 2+41.22 OFF. 8.00' LT. | 564.26 | – | 560.85 | 565.09 | Ho.Co.STD. SD-4.11 | OPEN 4 SIDES |
| I-2 | TYPE "D" | STA. 10+55.62 OFF. 17.00' LT. | 560.32 | 550.65/550.40 | 549.91 | 561.15 | Ho.Co.STD. SD-4.11 | OPEN 2 SIDES |
| I-3 | TYPE "D" | STA. 10+55.62 OFF. 17.00' RT. | 560.32 | – | 554.05 | 561.15 | Ho.Co.STD. SD-4.11 | OPEN 2 SIDES |
| I-4 | TYPE "D" | STA. 7+95.30 OFF. 17.00' LT. | 555.57 | 553.25/553.10 | 553.00 | 556.40 | Ho.Co.STD. SD-4.11 | OPEN 2 SIDES |
| I-5 | TYPE "D" | STA. 3+73.35 OFF. 17.50' LT. | 572.70 | 567.10/567.10 | 567.00 | 573.53 | Ho.Co.STD. SD-4.11 | OPEN 2 SIDES |
| I-6 | TYPE "D" | STA. 0+70.69 OFF. 17.00' LT. | 573.35 | 570.66 | 570.41 | 574.18 | Ho.Co.STD. SD-4.11 | OPEN 2 SIDES |
| I-7 | TYPE "D" | STA. 0+70.69 OFF. 17.00' RT. | 573.35 | – | 571.00 | 574.18 | Ho.Co.STD. SD-4.11 | OPEN 2 SIDES |
| I-8 | TYPE "D" | STA. 3+95.30 OFF. 17.00' RT. | 555.57 | – | 553.59 | 556.40 | Ho.Co.STD. SD-4.11 | OPEN 2 SIDES |
| I-9 | TYPE "D" | N 603,582.83 E 1,289,282.13 | 549.22 | 545.71 | 545.62 | 550.05 | Ho.Co.STD. SD-4.11 | OPEN 2 SIDES |
| I-10 | TYPE "D" | N 603,408.33 E 1,289,499.70 | 549.77 | 547.60 | 547.10 | 550.60 | Ho.Co.STD. SD-4.11 | OPEN 2 SIDES |
| I-11 | TYPE "D" | STA. 1+65.74 OFF. 8.00' LT. | 562.92 | 552.35 | 552.25 | 563.75 | Ho.Co.STD. SD-4.11 | OPEN 4 SIDES |
| I-12 | TYPE "D" | N 602,971.22 E 1,289,539.93 | 557.00 | – | 555.01 | 557.83 | Ho.Co.STD. SD-4.11 | OPEN 2 SIDES |
| I-13 | 15' COG | STA. 9+15.30 OFF. 29.27' RT. | 583.33 | – | 579.20 | 584.20 | MD 374.51 | 15' OPENING |
| I-14 | TYPE "D" | N 604,455.39 E 1,288,577.30 | 561.55 | – | 558.50 | 562.38 | Ho.Co.STD. SD-4.11 | OPEN 2 SIDES |
| M-1 | 4'-0" STANDARD | N 602,676.37 E 1,289,007.90 | | 398.92 | 398.82 | 406.60 | Ho.Co.STD. G-5.12 | STANDARD PRECAST MANHOLE |
| M-2 | 4'-0" STANDARD | STA. 6+18.70 OFF. 5.00' LT. | | 555.00/555.00 | 554.90 | 560.14 | Ho.Co.STD. G-5.12 | STANDARD PRECAST MANHOLE |
| M-3 | 4'-0" STANDARD | N 603,078.08 E 1,289,464.88 | | 553.70 | 553.45 | 565.00 | Ho.Co.STD. G-5.12 | STANDARD PRECAST MANHOLE |
| M-4 | 4'-0" STANDARD | STA. 11+56.92 OFF. 27.10' RT. | | 576.70 | 576.45 | 593.26 | MD 383.01 | STANDARD PRECAST MANHOLE |
| M-5 | 4'-0" STANDARD | N 604,155.14 E 1,288,461.68 | | 556.75 | 556.50 | 564.4 | Ho.Co.STD. G-5.12 | STANDARD PRECAST MANHOLE |
| E-1 | TYPICAL CONCRETE | N 603,298.46 E 1,288,320.36 | | – | 554.0 | – | Ho.Co.STD. SD-5.51 | SWM OUTFALL |
| E-2 | 18" METAL | N 603,447.57 E 1,288,193.44 | | – | 558.0 | – | Ho.Co.STD. SD-5.61 | OUTFALL INTO FOREBAY |
| E-3 | TYPICAL CONCRETE | N 602,453.87 E 1,289,192.94 | | – | 534.0 | – | Ho.Co.STD. SD-5.51 | SWM OUTFALL |
| E-4 | TYPICAL CONCRETE | N 603,676.31 E 1,289,300.75 | | – | 540.0 | – | Ho.Co.STD. SD-5.51 | SWM OUTFALL |
| E-5 | 24" METAL | N 603,659.54 E 1,289,168.42 | | – | 545.0 | – | Ho.Co.STD. SD-5.61 | OUTFALL INTO FOREBAY |
| E-6 | 24" METAL | N 603,659.83 E 1,289,186.13 | | – | 545.0 | – | Ho.Co.STD. SD-5.61 | OUTFALL INTO FOREBAY |
| HW-1 | CAST IN PLACE | N 603,986.76 E 1,288,041.43 | | – | 565.87 | 574.5 | Ho.Co.STD. G-5.21 | SEE DETAILS |
| HW-2 | CAST IN PLACE | N 604,032.42 E 1,288,000.00 | | 568.2 | – | 575.7 | Ho.Co.STD. G-5.21 | SEE DETAILS |
| HW-3 | CAST IN PLACE | N 604,292.98 E 1,287,774.84 | | – | 573.9 | 582.0 | -- | SEE DETAILS |
| HW-4 | CAST IN PLACE | N 604,318.57 E 1,287,696.02 | | 576.2 | – | 582.0 | -- | SEE DETAILS |

1) STRUCTURE TOP ELEVATION AND LOCATION FOR MANHOLES IS AT THE TOP AND CENTER OF RIM.
2) STRUCTURE TOP ELEVATION AND LOCATION FOR INLETS IS AT THE TOP, CENTER FACE OF THE INLET FOR CURB INLETS AND AT THE CENTER TOP FOR YARD INLETS.
3) STRUCTURE TOP ELEVATION AND LOCATION FOR END SECTIONS IS AT THE CONNECTION OF PIPE AND END SECTION AT CENTERLINE.
4) STRUCTURE TOP ELEVATION AND LOCATION FOR HEADWALLS IS AT THE MIDPOINT OF THE FACE OF THE MAIN WALL

## PIPE LENGTH SCHEDULE

| SIZE | TYPE | CLASS | TOTAL LENGTH |
|---|---|---|---|
| 15" | RCP | IV | 322' |
| 18" | RCP | IV | 283' |
| 24" | HDPEP | * | 892' |
| 54" | RCP | IV | 120' |
| 48" x 76" | RCP | IV | 70' |
| 15" | HDPEP | * | 569' |
| 18" | HDPEP | * | 1613' |

* SMOOTH BORE INTERIOR FINISH

## OUTLET PROTECTION SCHEDULE

| STRUCTURE | D-50 | LENGTH | WIDTH | THICKNESS | SHA CLASS |
|---|---|---|---|---|---|
| E-1 | 9.5" | 14' | 17' | 18" | 1 |
| E-2 | 9.5" | FOREBAY | FOREBAY | 18" | 1 |
| E-3 | 9.5" | 14' | 17' | 18" | 1 |
| E-4 | 9.5" | 44' | 20' | 18" | 1 |
| E-5 | 9.5" | FOREBAY | FOREBAY | 18" | 1 |
| E-6 | 9.5" | FOREBAY | FOREBAY | 18" | 1 |

## PIPE SCHEDULE

| RUN | SIZE | LENGTH | TYPE & CLASS |
|---|---|---|---|
| E-2 TO I-1 | 18" | 164' | HDPEP |
| I-1 TO I-1A | 15" | 90' | HDPEP |
| E-5 TO I-2 | 24" | 491' | HDPEP |
| I-2 TO I-4 | 18" | 260' | HDPEP |
| I-4 TO M-2 | 18" | 177' | HDPEP |
| M-2 TO I-5 | 18" | 242' | HDPEP |
| I-5 TO M-4 | 18" | 345' | RCP CLASS IV |
| M-4 TO I-13 | 15" | 246' | RCP CLASS IV |
| M-2 TO M-5 | 18" | 283' | HDPEP |
| M-5 TO I-14 | 15" | 322' | HDPEP |
| I-5 TO I-6 | 18" | 88' | HDPEP |
| I-6 TO I-7 | 15" | 34' | HDPEP |
| I-4 TO I-8 | 15" | 34' | HDPEP |
| I-2 TO I-3 | 15" | 34' | HDPEP |
| E-6 TO I-9 | 24" | 123' | HDPEP |
| I-9 TO I-10 | 24" | 278' | HDPEP |
| I-10 TO I-11 | 18" | 224' | HDPEP |
| I-11 TO M-3 | 18" | 113' | HDPEP |
| M-3 TO I-12 | 15" | 131' | HDPEP |
| HW-1 TO HW-2 | (2) 54" | 60' | RCP CLASS IV |
| HW-3 TO HW-4 | 48" x 76" | 70' | RCP CLASS IV |




Q10 = 2.91 CFS
V = 2.78 FPS
B = 2'
S = 2.0%
n = 0.030

SWALE #1 SECTION
N.T.S.

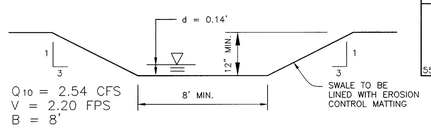


Q10 = 2.54 CFS
V = 2.20 FPS
B = 8'
S = 3.0%
n = 0.030

SWALE #2 SECTION
N.T.S.

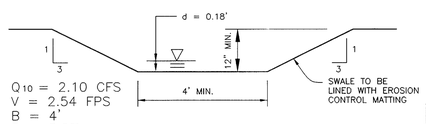


Q10 = 2.10 CFS
V = 2.54 FPS
B = 4'
S = 3.0%
n = 0.030

SWALE #3 SECTION
N.T.S.

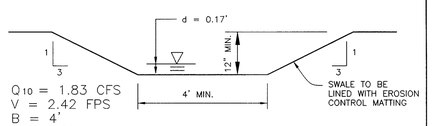


Q10 = 1.83 CFS
V = 2.42 FPS
B = 4'
S = 3.0%
n = 0.030

SWALE #4 SECTION
N.T.S.

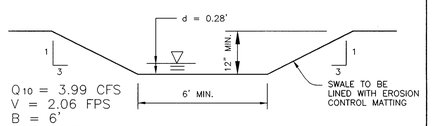


Q10 = 3.99 CFS
V = 2.06 FPS
B = 6'
S = 1.1%
n = 0.030

SWALE #5 SECTION
N.T.S.

APPROVED: HOWARD COUNTY DEPARTMENT OF PUBLIC WORKS

CHIEF, BUREAU OF HIGHWAYS — DATE 4-21-06

APPROVED: HOWARD COUNTY DEPT. OF PLANNING AND ZONING

CHIEF, DIVISION OF LAND DEVELOPMENT — DATE 5/2/06

CHIEF, DEVELOPMENT ENGINEERING DIVISION — DATE 5/2/06




CONNECTION FOR HDPEP TO METAL END-SECTION
NOT TO SCALE

| No. | DATE | REVISION |
|---|---|---|
| 1 | 12/4/06 | REVISE STORM DRAIN MATERIAL |

**BENCHMARK**
ENGINEERS ▲ LAND SURVEYORS ▲ PLANNERS
**ENGINEERING, INC.**
8480 BALTIMORE NATIONAL PIKE ▲ SUITE 418
ELLICOTT CITY, MARYLAND 21043
phone: 410-465-6105 ▲ fax: 410-465-6644
www.bei-civilengineering.com

Donald Mason
3/31/06

OWNER/DEVELOPER:
TRINITY QUALITY HOMES, INC.
3675 PARK AVENUE
SUITE 301
ELLICOTT CITY, MD 21043
410-480-0023

PROJECT:
THE CHASE AT STONEY BROOK
LOTS 1-20, PRESERVATION PARCEL "A" AND NON-BUILDABLE PRESERVATION PARCELS "B" THROUGH "D"

LOCATION:
TAX MAP NO. 7 BLOCK NO. 17 PARCEL NO. 133
4th ELECTION DISTRICT
HOWARD COUNTY, MARYLAND

TITLE:
STORM DRAIN PROFILES

DATE: AUGUST, 2005 / MARCH, 2006 — PROJECT NO. 1187
DESIGN: JMC — DRAFT: JMC — SCALE: AS SHOWN — DRAWING 8 OF 19

F-05-170

P:\1187dwg\7044S8_9.dwg, Sheet 8, 3/31/2006 2:20:38 PM,
Inc. Oce TDS600 HDI for mylar.pc3

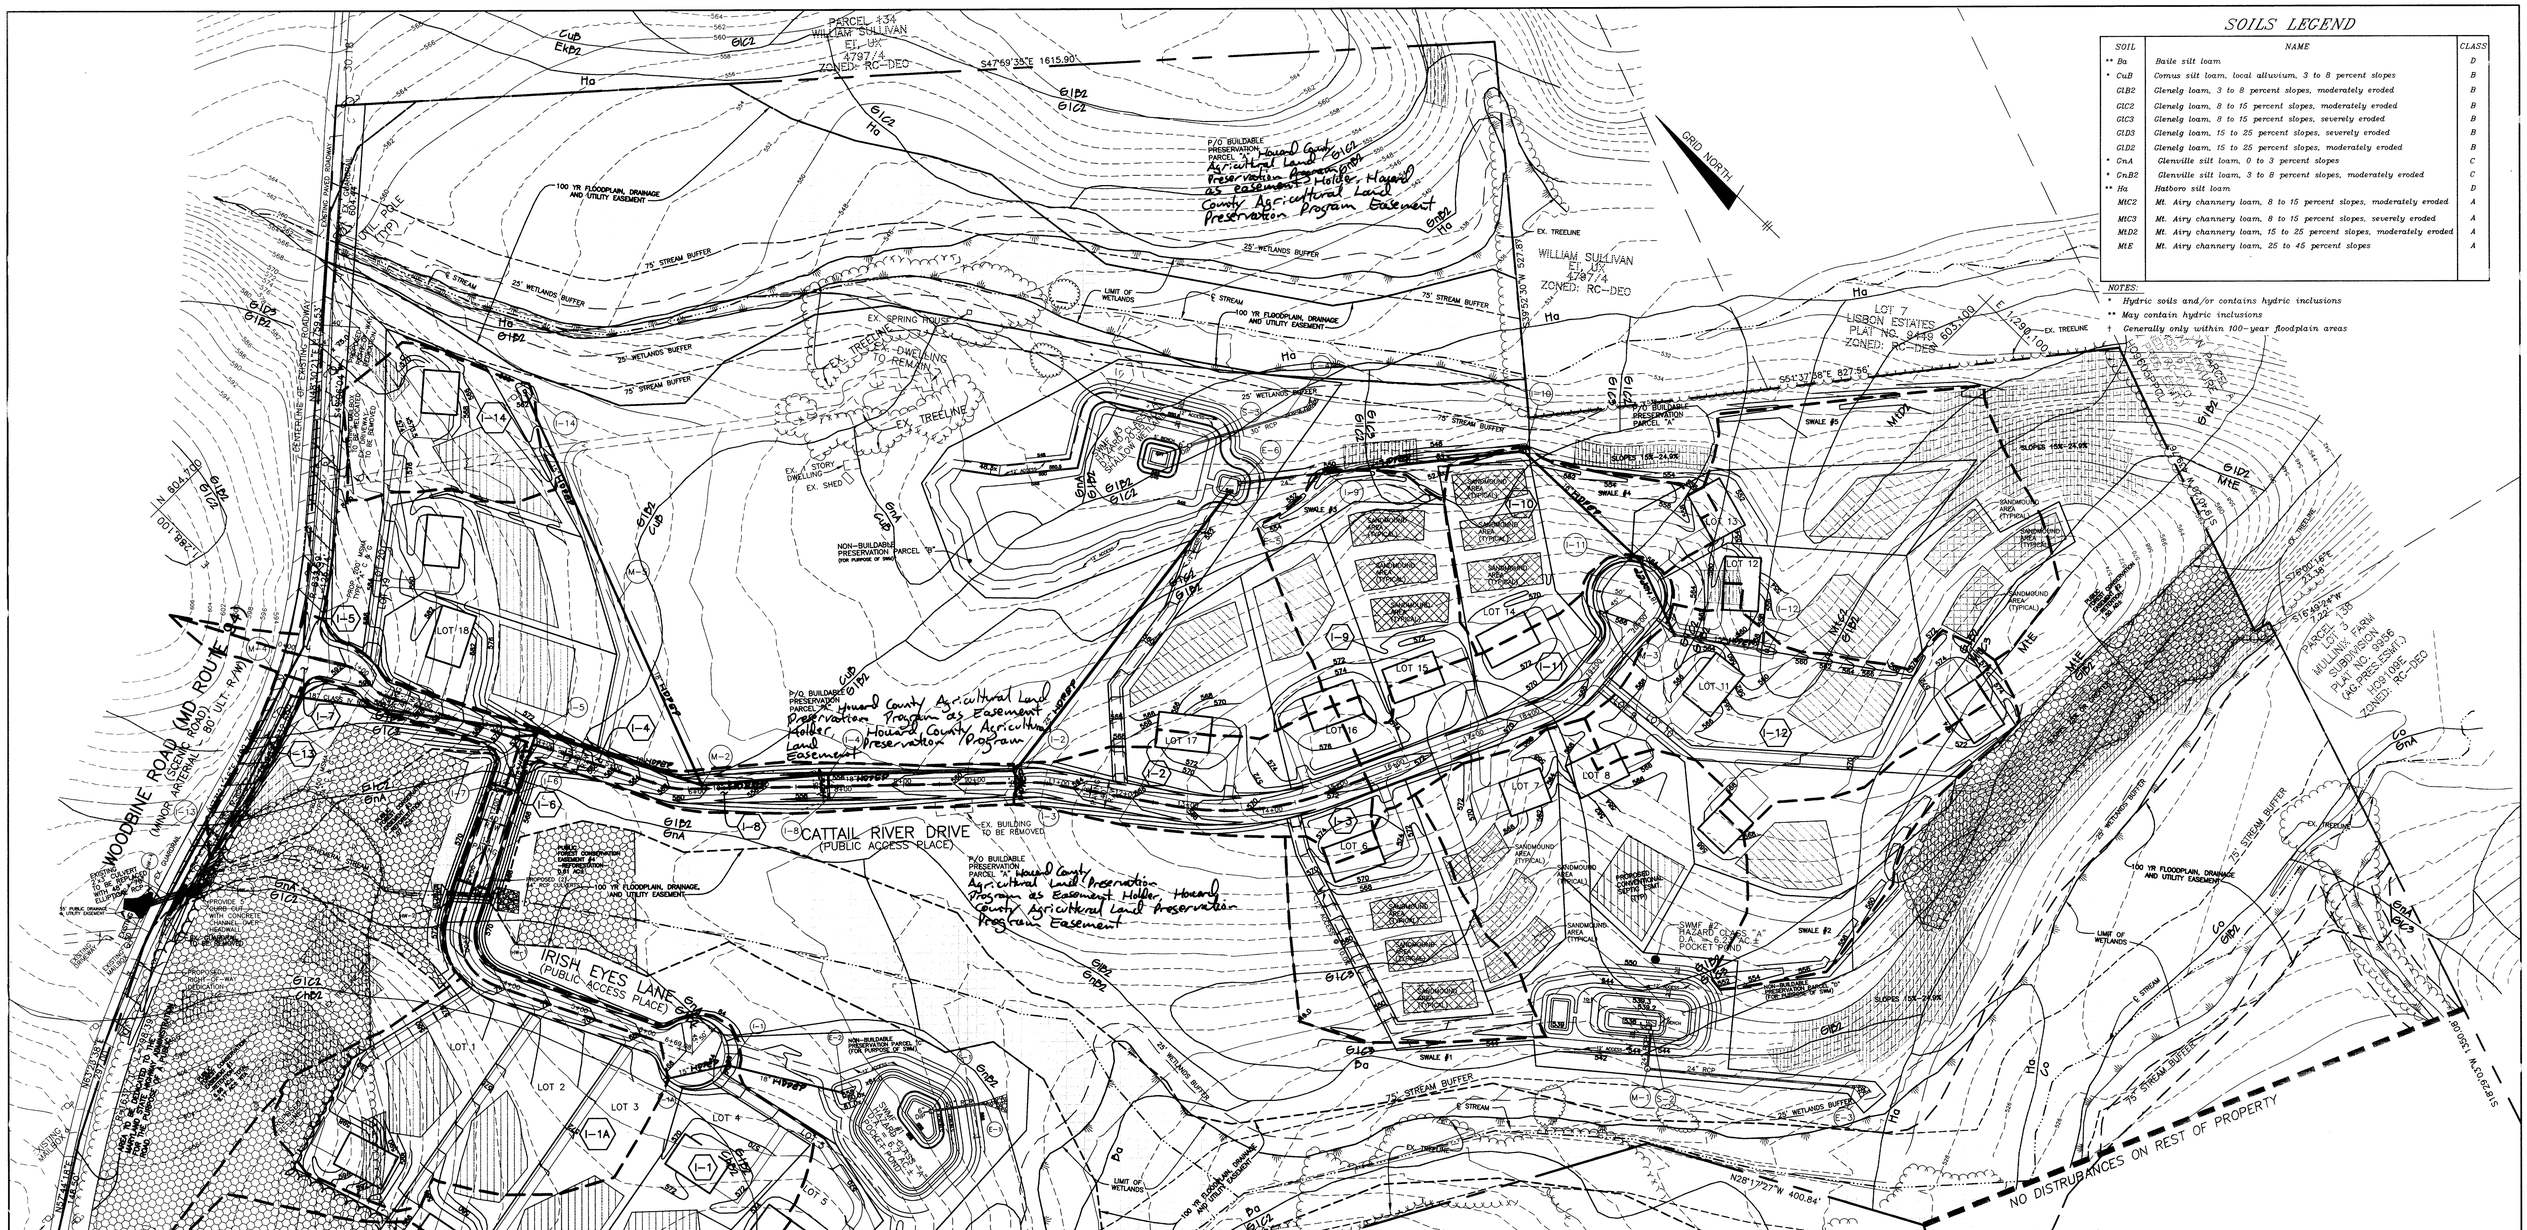


## SOILS LEGEND

| SOIL | NAME | CLASS |
|---|---|---|
| ** Ba | Baile silt loam | D |
| * CuB | Comus silt loam, local alluvium, 3 to 8 percent slopes | B |
| GlB2 | Glenelg loam, 3 to 8 percent slopes, moderately eroded | B |
| GlC2 | Glenelg loam, 8 to 15 percent slopes, moderately eroded | B |
| GlC3 | Glenelg loam, 8 to 15 percent slopes, severely eroded | B |
| GlD3 | Glenelg loam, 15 to 25 percent slopes, severely eroded | B |
| GlD2 | Glenelg loam, 15 to 25 percent slopes, moderately eroded | B |
| * GnA | Glenville silt loam, 0 to 3 percent slopes | C |
| * GnB2 | Glenville silt loam, 3 to 8 percent slopes, moderately eroded | C |
| ** Ha | Hatboro silt loam | D |
| MtC2 | Mt. Airy channery loam, 8 to 15 percent slopes, moderately eroded | A |
| MtC3 | Mt. Airy channery loam, 8 to 15 percent slopes, severely eroded | A |
| MtD2 | Mt. Airy channery loam, 15 to 25 percent slopes, moderately eroded | A |
| MtE | Mt. Airy channery loam, 25 to 45 percent slopes | A |

NOTES:

* Hydric soils and/or contains hydric inclusions

** May contain hydric inclusions

† Generally only within 100-year floodplain areas

## SWALE DATA

| SWALE NO. | AREA (AC) | SOIL CLASS | ZONING | 'C' FACTOR |
|---|---|---|---|---|
| 1 | 1.84 | B | RC-DEO | 0.18 |
| 2 | 1.46 | A, B | RC-DEO | 0.17 |
| 3 | 1.59 | B | RC-DEO | 0.20 |
| 4 | 1.46 | B | RC-DEO | 0.19 |
| 5 | 3.56 | A, B | RC-DEO | 0.17 |

## STORM DRAIN DATA

| INLET NO. | AREA (AC) | % IMPERVIOUS | SOIL CLASS | ZONING | 'C' FACTOR |
|---|---|---|---|---|---|
| I-1 | 2.60 | 26 | B, C | RC-DEO | 0.28 |
| I-1A | 2.85 | 19 | B, C | RC-DEO | 0.26 |
| I-2 | 0.90 | 38 | B | RC-DEO | 0.37 |
| I-3 | 0.54 | 49 | B | RC-DEO | 0.47 |
| I-4 | 0.43 | 100 | B | RC-DEO | 0.86 |
| I-5 | 0.29 | 81 | B | RC-DEO | 0.71 |
| I-6 | 0.09 | 100 | B, C | RC-DEO | 0.86 |
| I-7 | 0.39 | 74 | B, C | RC-DEO | 0.67 |
| I-8 | 0.48 | 69 | B | RC-DEO | 0.64 |
| I-9 | 1.59 | 17 | B | RC-DEO | 0.20 |
| I-10 | 0.36 | 13 | B | RC-DEO | 0.19 |
| I-11 | 1.54 | 49 | B | RC-DEO | 0.45 |
| I-12 | 2.26 | 20 | A, B | RC-DEO | 0.21 |
| I-13 | 0.22 | 100 | B, C | RC-DEO | 0.86 |
| I-14 | 1.15 | 15 | B | RC-DEO | 0.19 |

## LEGEND

- LIMIT OF WETLANDS
- EXISTING WOODS LINE
- PROPOSED WOODS LINE
- EXISTING STRUCTURE
- EXISTING WELL — EX. WELL
- PROPOSED SEPTIC FIELD
- 100 YEAR FLOODPLAIN
- FOREST CONSERVATION
- PROP. STREET TREE
- STEEP SLOPES 15-24.9%
- STEEP SLOPES 25% OR GREATER
- PROPOSED SAND MOUND AREA

APPROVED: HOWARD COUNTY DEPARTMENT OF PUBLIC WORKS

CHIEF, BUREAU OF HIGHWAYS — DATE 4-21-06

APPROVED: HOWARD COUNTY DEPT. OF PLANNING AND ZONING

CHIEF, DIVISION OF LAND DEVELOPMENT — DATE 5/2/06

CHIEF, DEVELOPMENT ENGINEERING DIVISION — DATE 5/2/06

| No. | DATE | REVISION |
|---|---|---|
| 1 | 8/6/06 | REVISE STORM DRAIN MATERIAL |


BENCHMARK
ENGINEERS ▲ LAND SURVEYORS ▲ PLANNERS
ENGINEERING, INC.
8480 BALTIMORE NATIONAL PIKE ▲ SUITE 418
ELLICOTT CITY, MARYLAND 21043
phone: 410-465-6105 ▲ fax: 410-465-6644
www.bei-civilengineering.com


Donald Moore 3/31/06

OWNER/DEVELOPER:

TRINITY QUALITY HOMES, INC.
3675 PARK AVENUE
SUITE 301
ELLICOTT CITY, MD 21043
410-480-0023

PROJECT:
# THE CHASE AT STONEY BROOK
LOTS 1-20, PRESERVATION PARCEL "A" AND NON-BUILDABLE PRESERVATION PARCELS "B" THROUGH "D"

LOCATION:
TAX MAP No. 7, BLOCK No. 17, PARCEL No. 133
4th ELECTION DISTRICT
HOWARD COUNTY, MARYLAND

TITLE:
## STORM DRAINAGE AREA MAP

DATE: AUGUST, 2005 / MARCH, 2006 — PROJECT NO. 1187

DES: JMC — DRAFT: RPS — CHECK: DAM — SCALE: 1" = 100' — SHEET 7 OF 19

F-05-170

P:\1187dwg\7025S1.dwg, StormDrainAreaMap, 3/31/2006 2:19:03 PM,
jmc, Oce TDS600 HDI for mylar.pc3

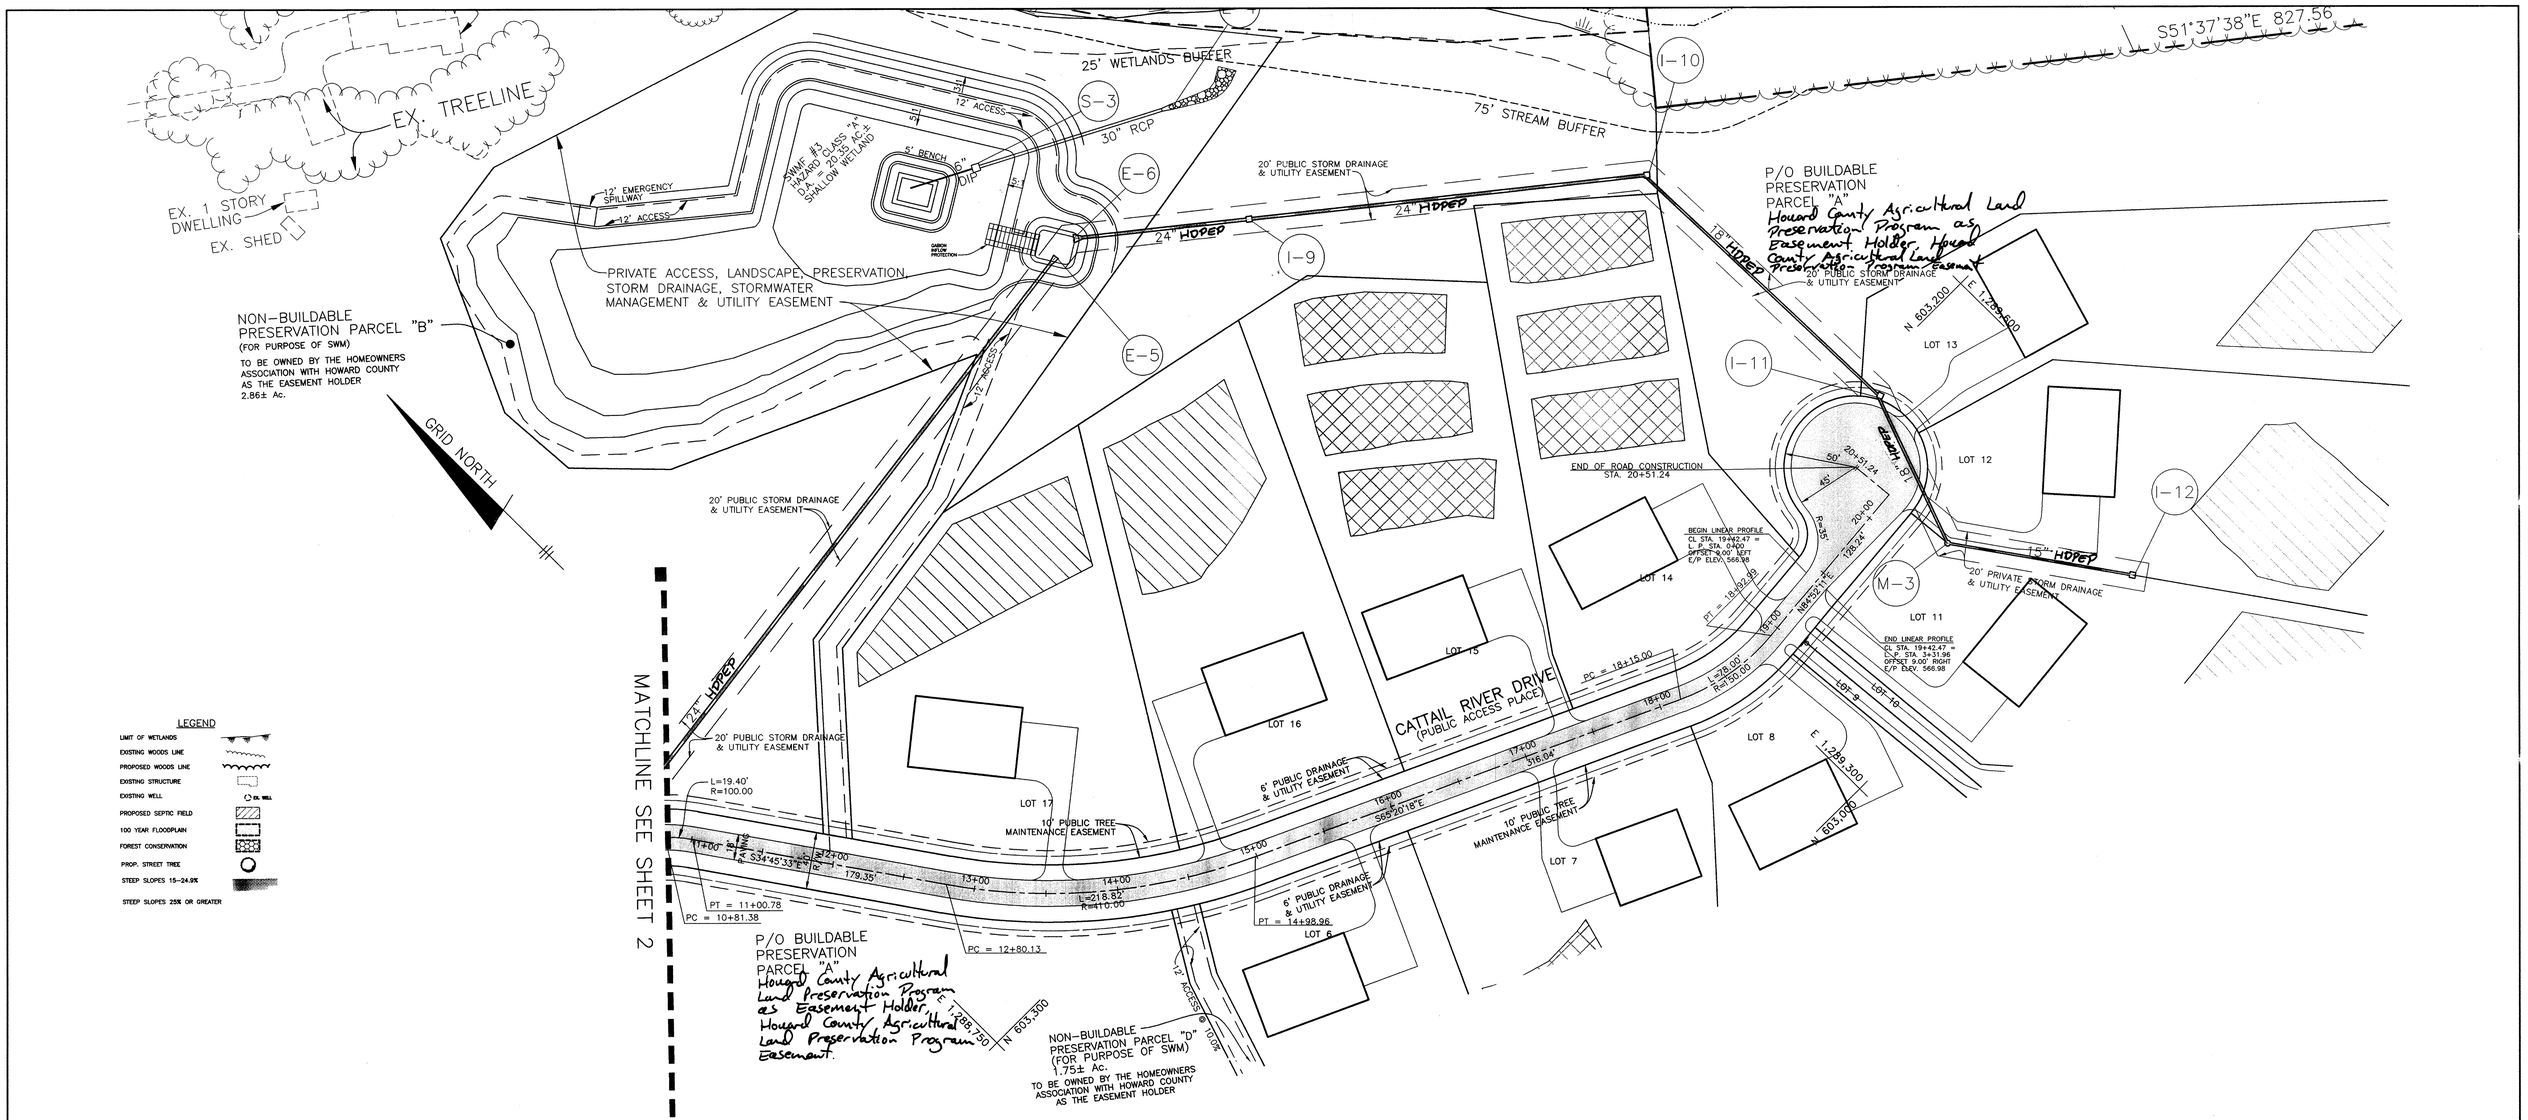


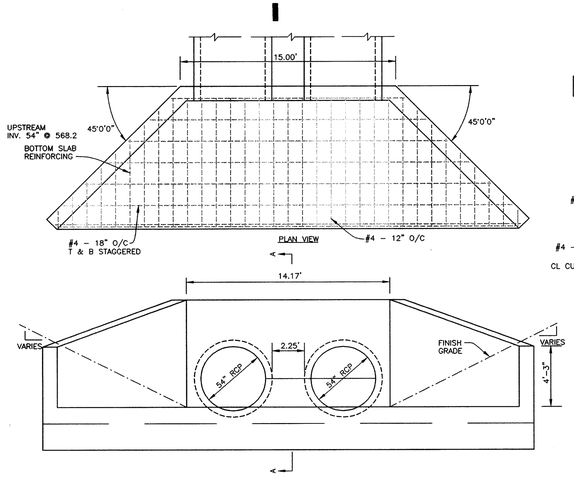


'HW2' MODIFIED TYPE 'A' HEADWALL

SCALE: 1" = 5'

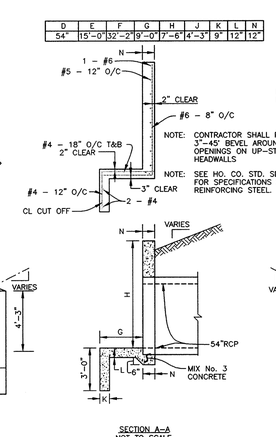


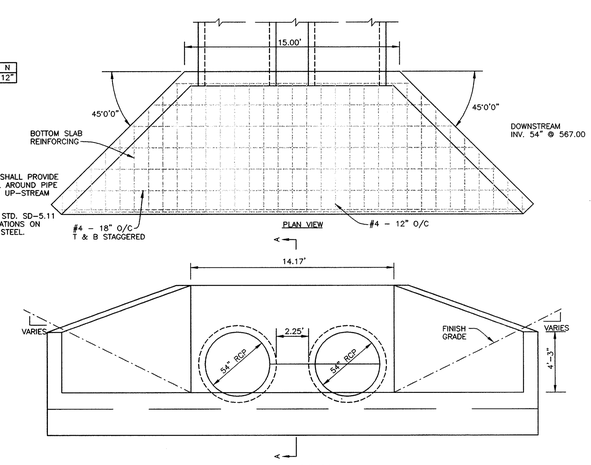


'HW1' MODIFIED TYPE 'A' HEADWALL

SCALE: 1" = 5'

| No. | DATE | REVISION |
|---|---|---|
| 1 | 12/6/06 | REVISE STORM DRAIN MATERIAL |

**BENCHMARK**
ENGINEERS ▲ LAND SURVEYORS ▲ PLANNERS
ENGINEERING, INC.
8480 BALTIMORE NATIONAL PIKE ▲ SUITE 418
ELLICOTT CITY, MARYLAND 21043
phone: 410-465-6105 ▲ fax: 410-465-6644
www.bei-civilengineering.com

3/31/06

OWNER/DEVELOPER:
TRINITY QUALITY HOMES, INC.
3675 PARK AVENUE
SUITE 301
ELLICOTT CITY, MD 21043
410-480-0023

PROJECT:
**THE CHASE AT STONEY BROOK**
LOTS 1-20, PRESERVATION PARCEL "A" AND NON-BUILDABLE PRESERVATION PARCELS "B" THROUGH "D"

LOCATION:
TAX MAP No. 7, BLOCK No. 17, PARCEL No. 133
4th ELECTION DISTRICT
HOWARD COUNTY, MARYLAND

TITLE:
ROAD PLANS

DATE: MAY, 2005 / MARCH, 2006
PROJECT NO. 1187
DES: JMC | DRAFT: LAB | CHECK: DAM
SCALE: 1" = 50'
SHEET 3 OF 19

APPROVED: HOWARD COUNTY DEPARTMENT OF PUBLIC WORKS
CHIEF, BUREAU OF HIGHWAYS — DATE 4-21-06

APPROVED: HOWARD COUNTY DEPT. OF PLANNING AND ZONING
CHIEF, DIVISION OF LAND DEVELOPMENT — DATE 5/2/06
CHIEF, DEVELOPMENT ENGINEERING DIVISION — DATE 5/2/06

P:\1187\dwg\7017s2_3.dwg, SHEET 3, 3/31/2006 2:08:16 PM,
inc, Oce TDS600 HDI for mylar.pc3

F-05-170

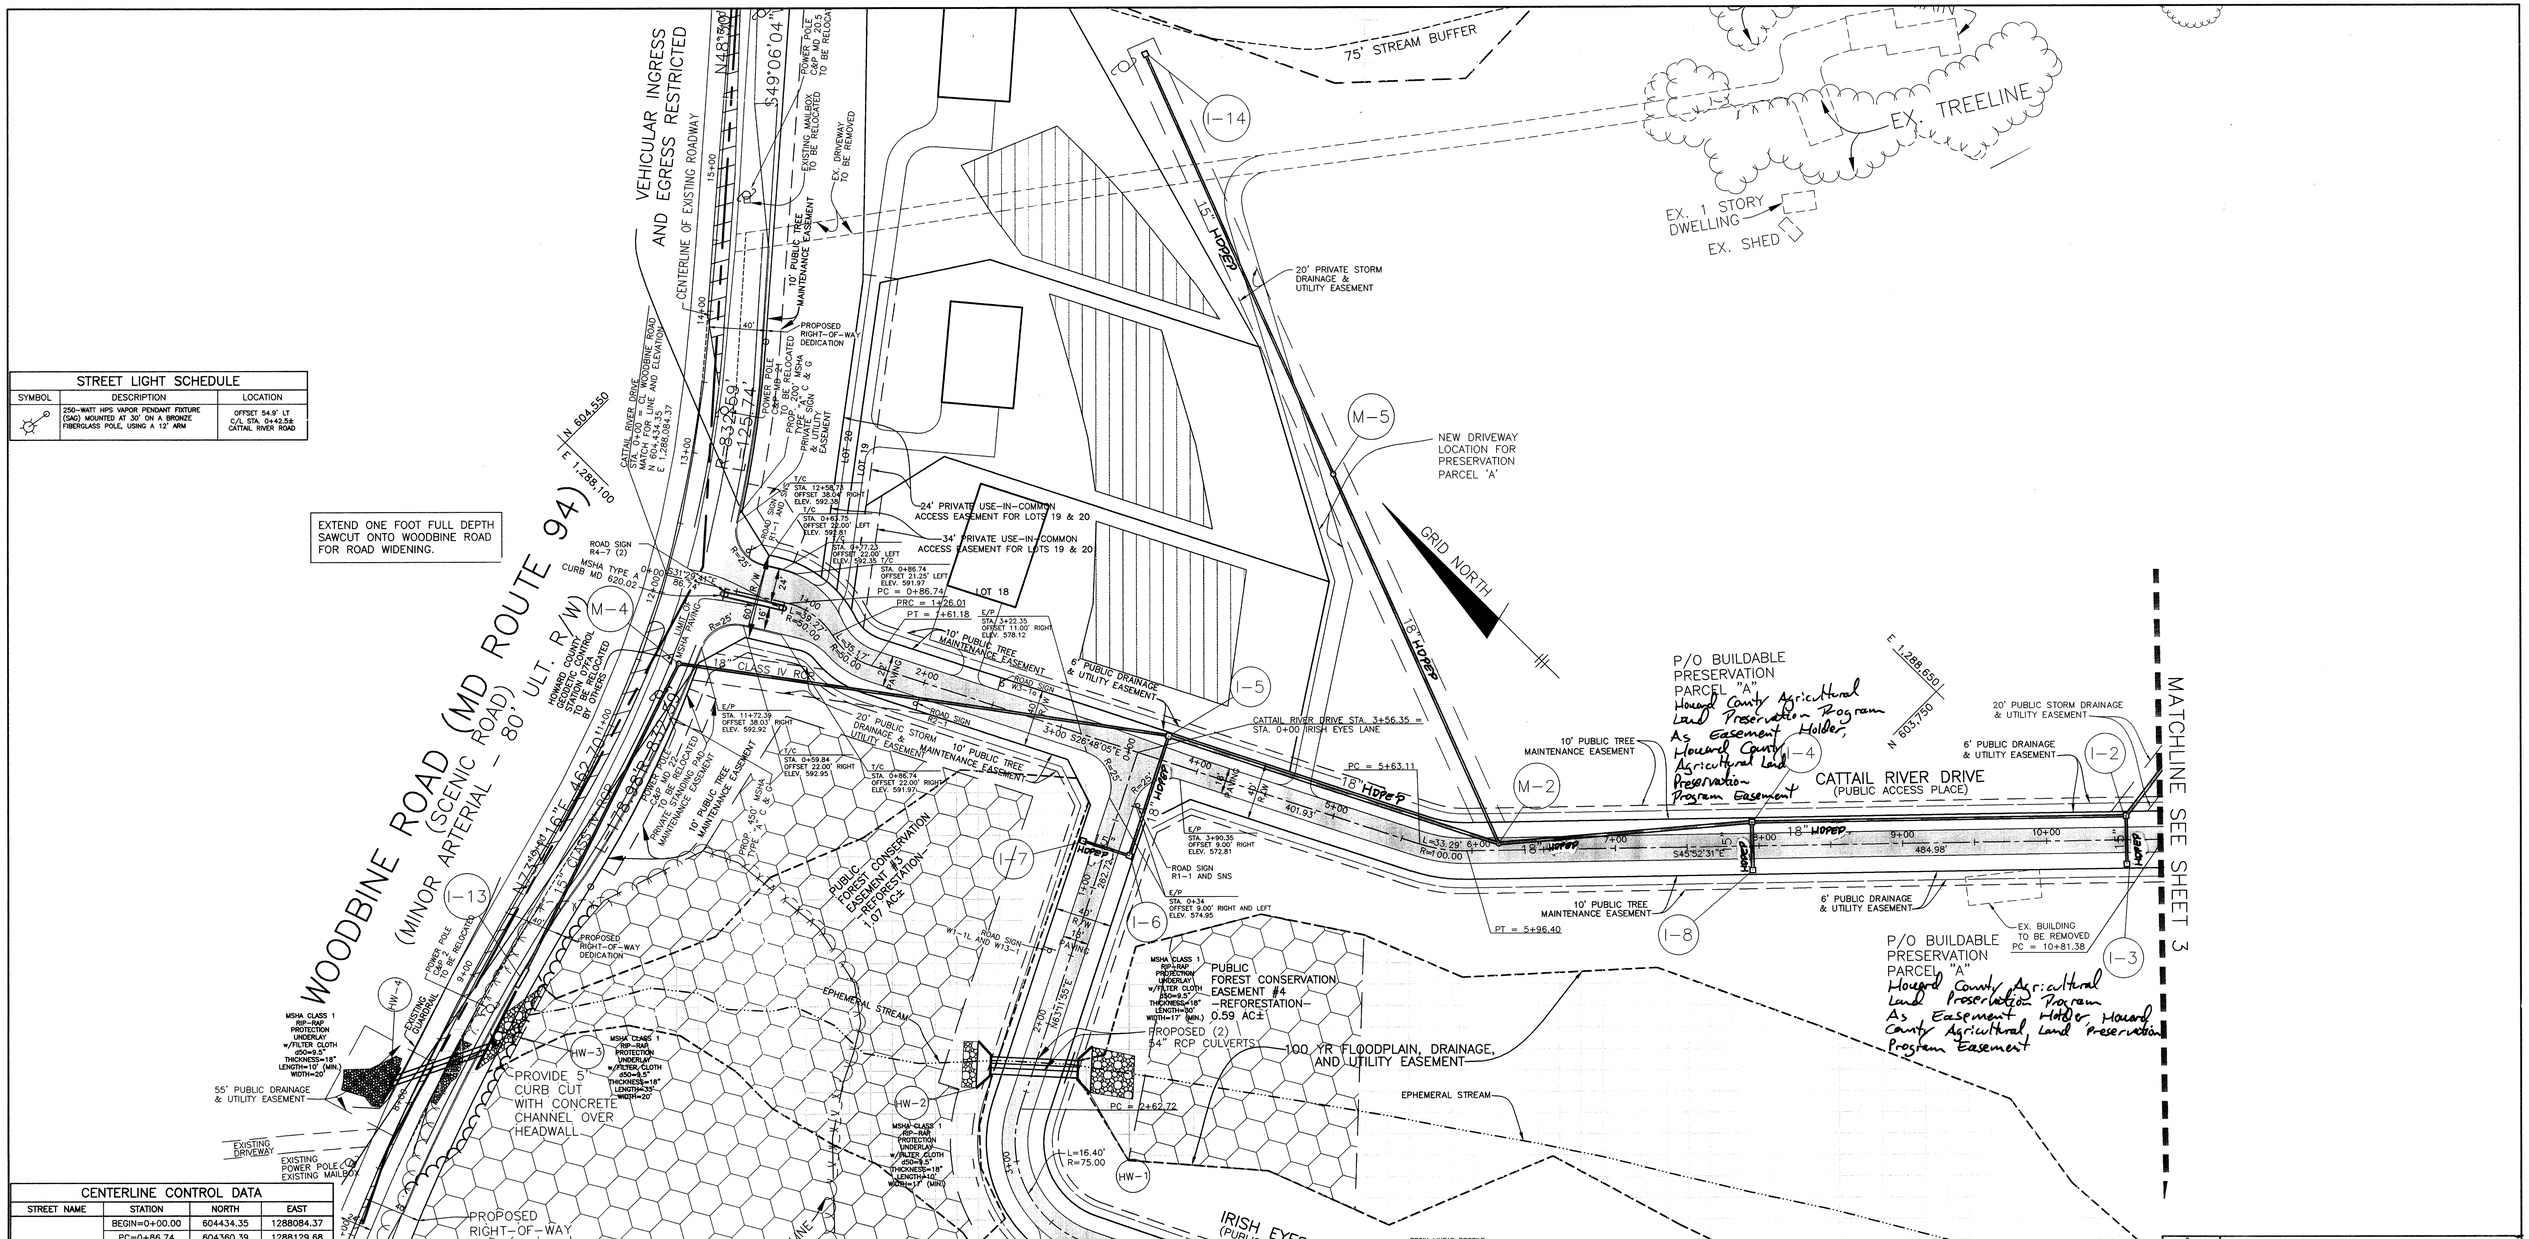


| STREET LIGHT SCHEDULE | | |
|---|---|---|
| SYMBOL | DESCRIPTION | LOCATION |
| | 250-WATT HPS VAPOR PENDANT FIXTURE (SAG) MOUNTED AT 30' ON A BRONZE FIBERGLASS POLE, USING A 12' ARM | OFFSET 54.9' LT C/L STA. 0+42.56 CATTAIL RIVER ROAD |

| CENTERLINE CONTROL DATA | | | |
|---|---|---|---|
| STREET NAME | STATION | NORTH | EAST |
| CATTAIL RIVER DRIVE | BEGIN=0+00.00 | 604434.35 | 1288084.37 |
| | PC=0+86.74 | 604360.39 | 1288129.68 |
| | PRC=1+26.01 | 604322.59 | 1288135.67 |
| | PT=1+61.18 | 604288.37 | 1288139.65 |
| | PC=5+63.11 | 603929.62 | 1288320.88 |
| | PT=5+96.40 | 603902.93 | 1288340.52 |
| | PC=10+81.38 | 603565.28 | 1288688.65 |
| | PT=11+00.78 | 603550.51 | 1288701.18 |
| | PC=12+80.13 | 603403.16 | 1288803.44 |
| | PT=14+98.96 | 603264.31 | 1288969.20 |
| | PC=18+15.00 | 603132.43 | 1289256.42 |
| | PT=18+92.99 | 603119.35 | 1289332.42 |
| | END=20+51.24 | 603160.70 | 1289457.46 |
| IRISH EYES LANE | BEGIN=0+00.00 | 604114.18 | 1288227.65 |
| | PC=2+62.72 | 603995.17 | 1287993.15 |
| | PT=3+79.12 | 603896.22 | 1287959.40 |
| | END=6+69.08 | 603634.99 | 1287959.40 |

LEGEND

- LIMIT OF WETLANDS
- EXISTING WOODS LINE
- PROPOSED WOODS LINE
- EXISTING STRUCTURE
- EXISTING WELL
- PROPOSED SEPTIC FIELD
- 100 YEAR FLOODPLAIN
- FOREST CONSERVATION
- PROP. STREET TREE
- STEEP SLOPES 15-24.9%
- STEEP SLOPES 25% OR GREATER

| CENTER LINE CURVE DATA | | | | | | | |
|---|---|---|---|---|---|---|---|
| STREET NAME | STATION | RADIUS | LENGTH | DELTA | TANGENT | CHORD | |
| CATTAIL RIVER DRIVE | STA. 0+86.74 TO 1+26.01 | 50.00' | 32.27' | 45°00'00" | 20.71' | N08°59'59"W | 38.27' |
| | STA. 1+26.01 TO 1+61.18 | 50.00' | 35.17' | 40°18'24" | 18.35' | S06°38'53"E | 34.45' |
| | STA. 5+63.11 TO 5+96.40 | 100.00' | 33.29' | 19°04'26" | 16.80' | S36°20'18"E | 33.14' |
| | STA. 10+81.38 TO 11+00.78 | 100.00' | 19.40' | 11°06'58" | 9.73' | N40°19'02"W | 19.37' |
| | STA. 12+80.13 TO 14+98.96 | 410.00' | 218.82' | 30°34'45" | 112.08' | S50°02'56"E | 216.23' |
| | STA. 18+15.00 TO 18+92.99 | 150.00' | 78.00' | 29°47'31" | 39.90' | S80°14'04"E | 77.12' |
| IRISH EYES LANE | STA. 2+62.72 TO 3+79.12 | 75.00' | 116.40' | 88°55'13" | 73.60' | S18°44'19"W | 105.06' |

APPROVED: HOWARD COUNTY DEPARTMENT OF PUBLIC WORKS

CHIEF, BUREAU OF HIGHWAYS — DATE 4-21-06

APPROVED: HOWARD COUNTY DEPT. OF PLANNING AND ZONING

CHIEF, DIVISION OF LAND DEVELOPMENT — DATE 5/12/06

CHIEF, DEVELOPMENT ENGINEERING DIVISION — DATE 6/2/06

| No. | DATE | REVISION |
|---|---|---|
| 1 | 12/4/06 | REVISE STORM DRAIN MATERIAL |

BENCHMARK
ENGINEERS ▲ LAND SURVEYORS ▲ PLANNERS
ENGINEERING, INC.
8480 BALTIMORE NATIONAL PIKE ▲ SUITE 418
ELLICOTT CITY, MARYLAND 21043
phone: 410-465-6105 ▲ fax: 410-465-6644
www.bei-civilengineering.com

Donald Mann 3/31/06

OWNER/DEVELOPER:
TRINITY QUALITY HOMES, INC.
3675 PARK AVENUE
SUITE 301
ELLICOTT CITY, MD 21043
410-480-0023

PROJECT:
THE CHASE AT STONEY BROOK
LOTS 1-20, PRESERVATION PARCEL "A" AND NON-BUILDABLE PRESERVATION PARCELS "B" THROUGH "D"

LOCATION:
TAX MAP No. 7, BLOCK No. 17, PARCEL No. 133
4th ELECTION DISTRICT
HOWARD COUNTY, MARYLAND

TITLE:
ROAD PLANS

DES: JMC | DRAFT: LAB | CHECK: DAM

DATE: AUGUST, 2005 / MARCH, 2006 | PROJECT NO. 1187

SCALE: 1" = 50' | SHEET 2 OF 19

F-05-170

P:\1187\dwg\7017s2_3.dwg, SHEET 2, 3/31/2006 2:07:33 PM,
jmc, Oce TDS600 HDI for mylar.pc3

NOTE:

THE REMOVAL OF 436 S.F. OF NTA FOREST CONSERVATION RETENTION IS MIDIGATED BY THE ADDITION OF 371 S.F. NTA RETENTION. A NEW DEED OF FOREST CONSERVATION EASEMENT SHALL BE RECORDED WITH THE FINAL PLAT OF DEVISION UNDER F-07-107

436 S.F. OF NTA RETENTION TO BE RE-PLACED

371 S.F. NTA TO BE ADDED TO FOREST CONSERVATION RETENTION

Note: There are no specimen trees on this site.

BUILDABLE PRESERVATION PARCEL "A" 83.33 ACRES Howard County Agricultural Land Preservation Program as Easement Holder of a Howard County Agricultural Land Preservation Program Easement (ERP)

P/O BUILDABLE PRESERVATION PARCEL "A" 83.33 ACRES Howard County Agricultural Land Preservation Program Easement Holder of a Howard County Agricultural Land Preservation Program Easement

PARCEL 137 PRESERVATION PARCEL A 206 JOINT VENTURE 4452/677 ZONED RC-DEO HOWARD COUNTY AGRICULTURAL PRESERVATION EASEMENT F-96-05-PPCL

LOT 7 LISBON ESTATES PLAT NO. 9448 ZONED RC-DEO

PARCEL 138 LOT 3 MULLINIX FARM SUBDIVISION PLAT NO. 9956 HOWARD COUNTY AGRICULTURAL PRESERVATION EASEMENT F-01-09-E ZONED RC/DEO

PARCEL 306 LOT 4 WARFIELD LIMITED PARTNERSHIP PLAT NO. 7536 HOWARD COUNTY AGRICULTURAL PRESERVATION EASEMENT #HO-90-21-E ZONED RC-DEO

PARCEL 306 LOT 1 WARFIELD LIMITED PARTNERSHIP PLAT NO. 8648 ZONED RC-DEO

WOODBINE ROAD (MD ROUTE 94) (SCENIC ROAD) (MINOR ARTERIAL 60' ULT. R/W)

CATTAIL RIVER DRIVE (PUBLIC ACCESS PLACE)

IRISH EYES LANE (PUBLIC ACCESS PLACE)

MATCH LINE SEE SHEET 15

APPROVED: HOWARD COUNTY DEPARTMENT OF PUBLIC WORKS

| | |
|---|---|
| CHIEF, BUREAU OF HIGHWAYS | DATE 4-21-06 |

APPROVED: HOWARD COUNTY DEPT. OF PLANNING AND ZONING

| | |
|---|---|
| CHIEF, DIVISION OF LAND DEVELOPMENT | DATE 5/12/06 |
| CHIEF, DEVELOPMENT ENGINEERING DIVISION | DATE 5/12/06 |

Donald Moore 3/31/06

LEGEND

- EXISTING CONTOURS
- PROPOSED CONTOURS
- EXISTING TREELINE
- PROPOSED TREELINE
- SOIL DELINEATION LINE
- SOIL TYPE
- FOREST CONSERVATION EASEMENT
- STEEP SLOPES 25% OR GREATER
- STEEP SLOPES 15% - 24.9 %
- FCE — FOREST CONSERVATION SIGN
- X — TREE PROTECTION FENCE

SOILS LEGEND

| SOIL | NAME | CLASS |
|---|---|---|
| ** Ba | Baile silt loam | D |
| * CuB | Comus silt loam, local alluvium, 3 to 8 percent slopes | B |
| GlB2 | Glenelg loam, 3 to 8 percent slopes, moderately eroded | B |
| GlC2 | Glenelg loam, 8 to 15 percent slopes, moderately eroded | B |
| GlC3 | Glenelg loam, 8 to 15 percent slopes, severely eroded | B |
| GlD3 | Glenelg loam, 15 to 25 percent slopes, severely eroded | B |
| GlD2 | Glenelg loam, 15 to 25 percent slopes, moderately eroded | B |
| * GnA | Glenville silt loam, 0 to 3 percent slopes | C |
| * GnB2 | Glenville silt loam, 3 to 8 percent slopes, moderately eroded | C |
| ** Ha | Hatboro silt loam | D |
| MtC2 | Mt. Airy channery loam, 3 to 15 percent slopes, moderately eroded | A |
| MtC3 | Mt. Airy channery loam, 3 to 15 percent slopes, severely eroded | A |
| MtD2 | Mt. Airy channery loam, 15 to 25 percent slopes, moderately eroded | A |
| MtE | Mt. Airy channery loam, 25 to 45 percent slopes | A |

NOTES:

* Hydric soils and/or contains hydric inclusions

** May contain hydric inclusions

† Generally only within 100-year floodplain areas


BENCHMARK
ENGINEERS ▲ LAND SURVEYORS ▲ PLANNERS
ENGINEERING, INC.
8480 BALTIMORE NATIONAL PIKE ▲ SUITE 418
ELLICOTT CITY, MARYLAND 21043
phone: 410-465-6105 ▲ fax: 410-465-6644
www.bei-civilengineering.com


| DATE | NO. | REVISION |
|---|---|---|
| 3-2-07 | 2 | REVISE FCE1 / HW-3 TO HW-4 |
| 12/06 | 1 | REVISE STORM DRAIN MATERIAL |

OWNER/DEVELOPER:

TRINITY QUALITY HOMES, INC.
3675 PARK AVENUE
SUITE 301
ELLICOTT CITY, MD 21043
410-480-0023

PROJECT:

THE CHASE AT STONEY BROOK

AREA:

TAX MAP 7 BLOCK 17 PARCEL 133
4 th ELECTION DISTRICT
HOWARD COUNTY, MARYLAND

TITLE:

FOREST CONSERVATION PLAN


WILDMAN
ENVIRONMENTAL SERVICES
4747 BONNIE BRANCH RD.
ELLICOTT CITY, MD. 21043
PHONE: 410-869-9999
FAX: 410-869-9901


| | |
|---|---|
| DESIGNED BY: | JBW |
| DRAWN BY: | D.B.T./J.E.P. |
| PROJECT NO. | 1025 |
| DATE: | MARCH, 2006 |
| SCALE: | 1" = 100' |
| SHEET NO. | 14 OF 19 |

F-05-170


P:\1187dwg\7052s14_15.dwg, Sheet 14, 3/31/2006 3:19:02 PM,
jane, Oce TDS600 HDI for mylar.pc3

NOTE:

AT THE TIME OF INSTALLMENT, ALL SHRUBS AND OTHER PLANTINGS HEREWITH LISTED AND APPROVED FOR THIS SITE, SHALL BE OF THE PROPER HEIGHT REQUIREMENTS IN ACCORDANCE WITH THE HOWARD COUNTY LANDSCAPE MANUAL. IN ADDITION, NO SUBSTITUTIONS OR RELOCATION OF REQUIRED PLANTINGS MAY BE MADE WITHOUT PRIOR REVIEW AND APPROVAL FROM THE DEPARTMENT OF PLANNING AND ZONING. ANY DEVIATION FROM THIS APPROVED LANDSCAPE PLAN MAY RESULT IN DENIAL OR DELAY IN RELEASE OF LANDSCAPE SURETY UNTIL SUCH TIME AS ALL REQUIRED MATERIALS ARE PLANTED AND/OR REVISIONS ARE MADE TO APPLICABLE PLANS AND CERTIFICATIONS.

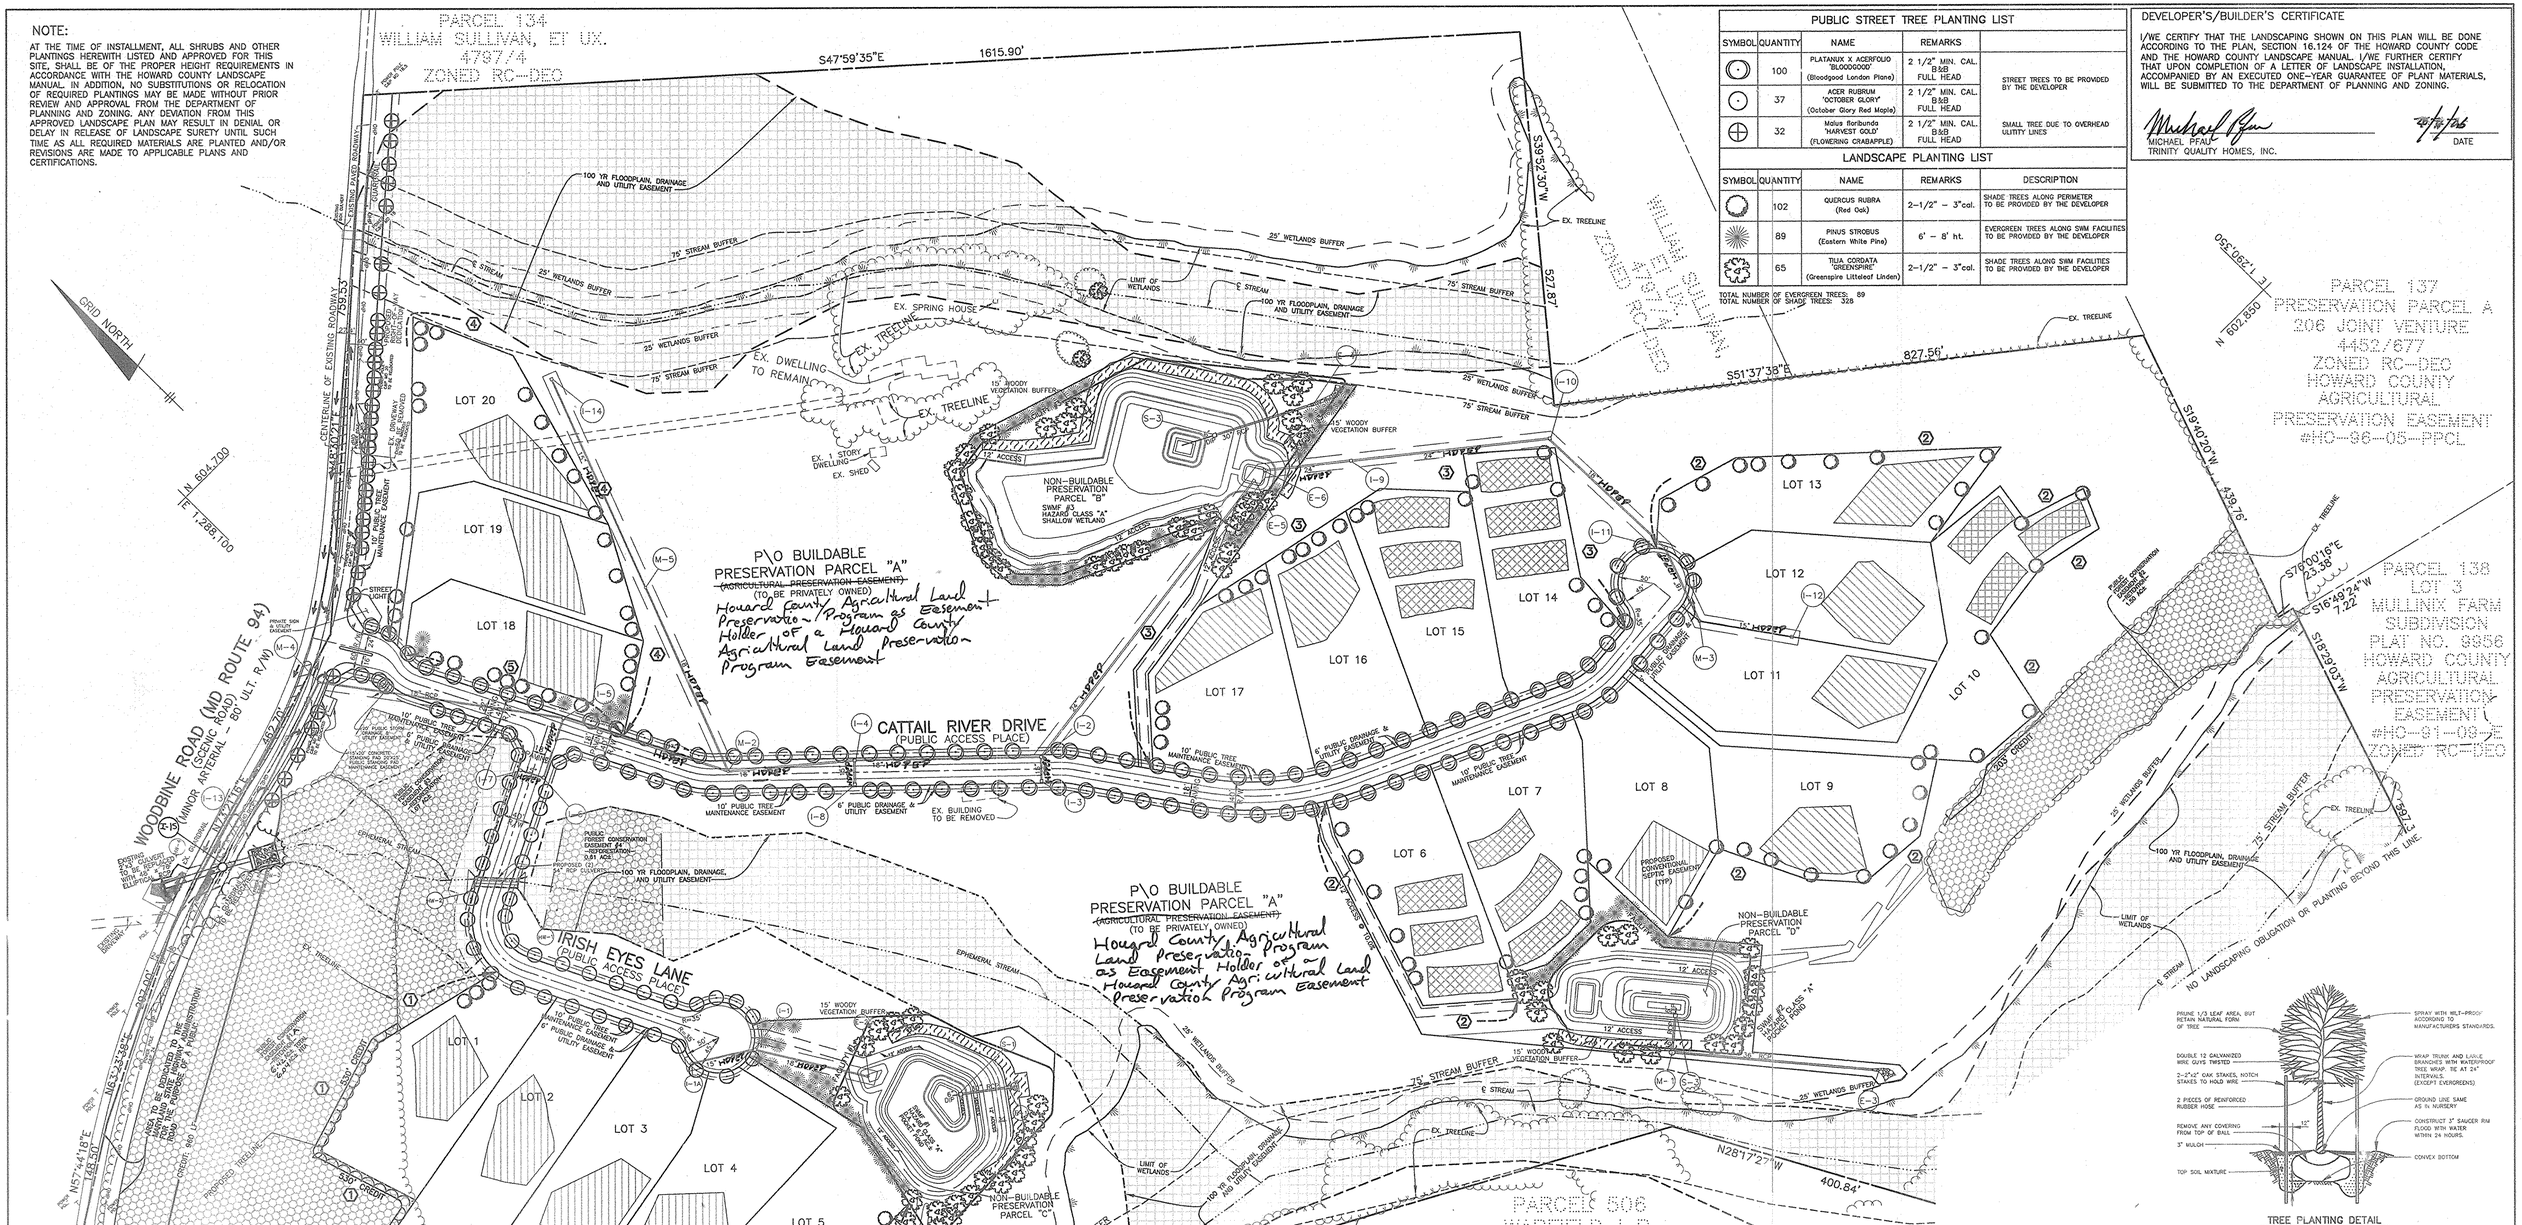


## PUBLIC STREET TREE PLANTING LIST

| SYMBOL | QUANTITY | NAME | REMARKS | |
|---|---|---|---|---|
| | 100 | PLATANUX X ACERFOLIO 'BLOODGOOD' (Bloodgood London Plane) | 2 1/2" MIN. CAL. B&B FULL HEAD | STREET TREES TO BE PROVIDED BY THE DEVELOPER |
| | 37 | ACER RUBRUM 'OCTOBER GLORY' (October Glory Red Maple) | 2 1/2" MIN. CAL. B&B FULL HEAD | |
| | 32 | Malus floribunda 'HARVEST GOLD' (FLOWERING CRABAPPLE) | 2 1/2" MIN. CAL. B&B FULL HEAD | SMALL TREE DUE TO OVERHEAD ULITITY LINES |

## LANDSCAPE PLANTING LIST

| SYMBOL | QUANTITY | NAME | REMARKS | DESCRIPTION |
|---|---|---|---|---|
| | 102 | QUERCUS RUBRA (Red Oak) | 2-1/2" – 3"col. | SHADE TREES ALONG PERIMETER TO BE PROVIDED BY THE DEVELOPER |
| | 89 | PINUS STROBUS (Eastern White Pine) | 6' – 8' ht. | EVERGREEN TREES ALONG SWM FACILITIES TO BE PROVIDED BY THE DEVELOPER |
| | 65 | TILIA CORDATA 'GREENSPIRE' (Greenspire Littleleaf Linden) | 2-1/2" – 3"col. | SHADE TREES ALONG SWM FACILITIES TO BE PROVIDED BY THE DEVELOPER |

TOTAL NUMBER OF EVERGREEN TREES: 89
TOTAL NUMBER OF SHADE TREES: 326

## DEVELOPER'S/BUILDER'S CERTIFICATE

I/WE CERTIFY THAT THE LANDSCAPING SHOWN ON THIS PLAN WILL BE DONE ACCORDING TO THE PLAN, SECTION 16.124 OF THE HOWARD COUNTY CODE AND THE HOWARD COUNTY LANDSCAPE MANUAL. I/WE FURTHER CERTIFY THAT UPON COMPLETION OF A LETTER OF LANDSCAPE INSTALLATION, ACCOMPANIED BY AN EXECUTED ONE-YEAR GUARANTEE OF PLANT MATERIALS, WILL BE SUBMITTED TO THE DEPARTMENT OF PLANNING AND ZONING.

MICHAEL PFAU
TRINITY QUALITY HOMES, INC.

DATE




TREE PLANTING DETAIL
NOT TO SCALE

## STREET TREE SCHEDULE

| ROAD NAME | PERIMETER | TREES REQ. |
|---|---|---|
| WOODBINE ROAD | 956'* | 32 |
| CATTAIL RIVER DRIVE | 4010' | 100 |
| IRISH EYES LANE | 1495' | 37 |

*1916' TOTAL – 960' CREDIT = 956'
SMALL TREE SELECTION DUE TO OVERHEAD UTILITY LINES

## SCHEDULE A
## PERIMETER LANDSCAPE EDGE
*EXISTING WOODS 20' OR GREATER IN WIDTH.

| CATEGORY | ADJ. TO PERIMETER PROP. 1 | ADJ. TO PERIMETER PROP. 2 | ADJ. TO PERIMETER PROP. 3 | ADJ. TO PERIMETER PROP. 4 | ADJ. TO ROAD 5 | TOTAL |
|---|---|---|---|---|---|---|
| LANDSCAPE TYPE | A | A | A | A | B | |
| LINEAR FEET OF ROADWAY FRONTAGE/PERIMETER | 1567' | 2564' | 1145' | 1186' | 329' | 6,790 |
| CREDIT FOR EXISTING VEGETATION (YES, NO, LINEAR FEET) (DESCRIBE BELOW IF NEEDED) | YES* 530' | YES* 203' | NO | NO | NO | 733 |
| CREDIT FOR WALL, FENCE OR BERM (YES, NO, LINEAR FEET) (DESCRIBE BELOW IF NEEDED) | NO | NO | NO | NO | NO | |
| NUMBER OF PLANTS REQUIRED | 1037' | 2361' | 1145' | 1186' | 328' | 6,057 |
| SHADE TREES | 17 | 39 | 19 | 20 | 7 | 102 |
| EVERGREEN TREES | – | – | – | – | 8 | 8 |
| OTHER TREES (2:1 SUBSTITUTE) | – | – | – | – | – | – |
| SHRUBS | – | – | – | – | – | – |
| NUMBER OF PLANTS PROVIDED | 1037' | 2361' | 1145' | 1186' | 328' | 6,057 |
| SHADE TREES | 17 | 39 | 19 | 20 | 7 | 102 |
| EVERGREEN TREES | – | – | – | – | 8 | 8 |
| OTHER TREES (2:1 SUBSTITUTE) | – | – | – | – | – | – |
| SHRUBS | – | – | – | – | – | – |

## SCHEDULE D
## SWM AREA LANDSCAPING

| | FACILITY 1 | FACILITY 2 | FACILITY 3 | TOTAL |
|---|---|---|---|---|
| LINEAR FEET OF PERIMETER | 966 | 804 | 1479 | 3249 |
| LINEAR FEET OF EXISTING WOODS LINE | 0 | 0 | 0 | 0 |
| LINEAR FEET OF REQUIRED PLANTING | 966 | 804 | 1479 | 3249 |
| BUFFER TYPE | "B" | "B" | "B" | – |
| NUMBER OF TREES REQUIRED | | | | |
| SHADE TREES | 19 | 16 | 30 | 65 |
| EVERGREEN TREES | 24 | 20 | 37 | 81 |
| NUMBER OF TREES PROVIDED | | | | |
| SHADE TREES | 19 | 16 | 30 | 65 |
| EVERGREEN TREES | 24 | 20 | 37 | 81 |
| CREDIT FOR EXISTING VEGETATION (NO, YES AND X) | NO | NO | NO | – |
| CREDIT FOR OTHER LANDSCAPING (NO, YES AND X) | NO | NO | NO | – |

## LANDSCAPE NOTES:

1. TREES SHOULD BE PLANTED A MINIMUM OF 6 FEET FROM THE EDGE OF PAVING AND MUST BE A MINIMUM OF 5 FEET FROM ANY STORM DRAIN.
2. TREES MUST BE PLANTED A MINIMUM OF 5 FEET FROM AN OPEN SPACE ACCESS STRIP, 10 FEET FROM A DRIVEWAY AND 15' FROM ANY STREET LIGHT.
3. SEE TREE PLANTING DETAIL – THIS SHEET.
4. THIS PLAN HAS BEEN PREPARED IN ACCORDANCE WITH THE PROVISIONS OF SECTION 16.124 OF THE HOWARD COUNTY CODE AND THE HOWARD COUNTY LANDSCAPE MANUAL.
5. FINANCIAL SURETY FOR THE REQUIRED LANDSCAPING HAS BEEN POSTED AS PART OF THE DPW DEVELOPER'S AGREEMENT IN THE AMOUNT OF $63,450.00. ($50,100.00 FOR 167 SHADE TREES, $13,350.00 FOR 89 EVERGREENS.

APPROVED: HOWARD COUNTY DEPARTMENT OF PUBLIC WORKS

CHIEF, BUREAU OF HIGHWAYS — DATE 4-21-06

APPROVED: HOWARD COUNTY DEPT. OF PLANNING AND ZONING

CHIEF, DIVISION OF LAND DEVELOPMENT — DATE 5/8/06

CHIEF, DEVELOPMENT ENGINEERING DIVISION — DATE 5/2/06


BENCHMARK
ENGINEERS ▲ LAND SURVEYORS ▲ PLANNERS
ENGINEERING, INC.
8480 BALTIMORE NATIONAL PIKE ▲ SUITE 418
ELLICOTT CITY, MARYLAND 21043
phone: 410-465-6105 ▲ fax: 410-465-6644
www.bei-civilengineering.com


3/31/06

OWNER/DEVELOPER:
TRINITY QUALITY HOMES, INC.
3675 PARK AVENUE
SUITE 301
ELLICOTT CITY, MD 21043
410-480-0023

| NO. | DATE | REVISION |
|---|---|---|
| 1 | 12/06 | REVISE STORM DRAIN MATERIAL |
| 2 | 2/9/07 | REVISE HW-3 TO HW-4 |

DES: JMC | DRAFT: RPS | CHECK: DAM

PROJECT:
THE CHASE AT STONEY BROOK
LOTS 1-20, PRESERVATION PARCEL "A" AND NON-BUILDABLE PRESERVATION PARCELS "B" THROUGH "D"

LOCATION:
TAX MAP No. 7 BLOCK No. 17 PARCEL No. 133
4th ELECTION DISTRICT
HOWARD COUNTY, MARYLAND

TITLE:
LANDSCAPE PLAN

DATE: AUGUST, 2005 / MARCH, 2006
PROJECT NO. 1187
SCALE: 1" = 100'
SHEET 13 OF 19

F-05-170

P:\1187\dwg\7022S13.dwg, sheet 13, 3/31/2006 2:12:36 PM,
ine, Oce TDS600 HDI for mylar.pc3

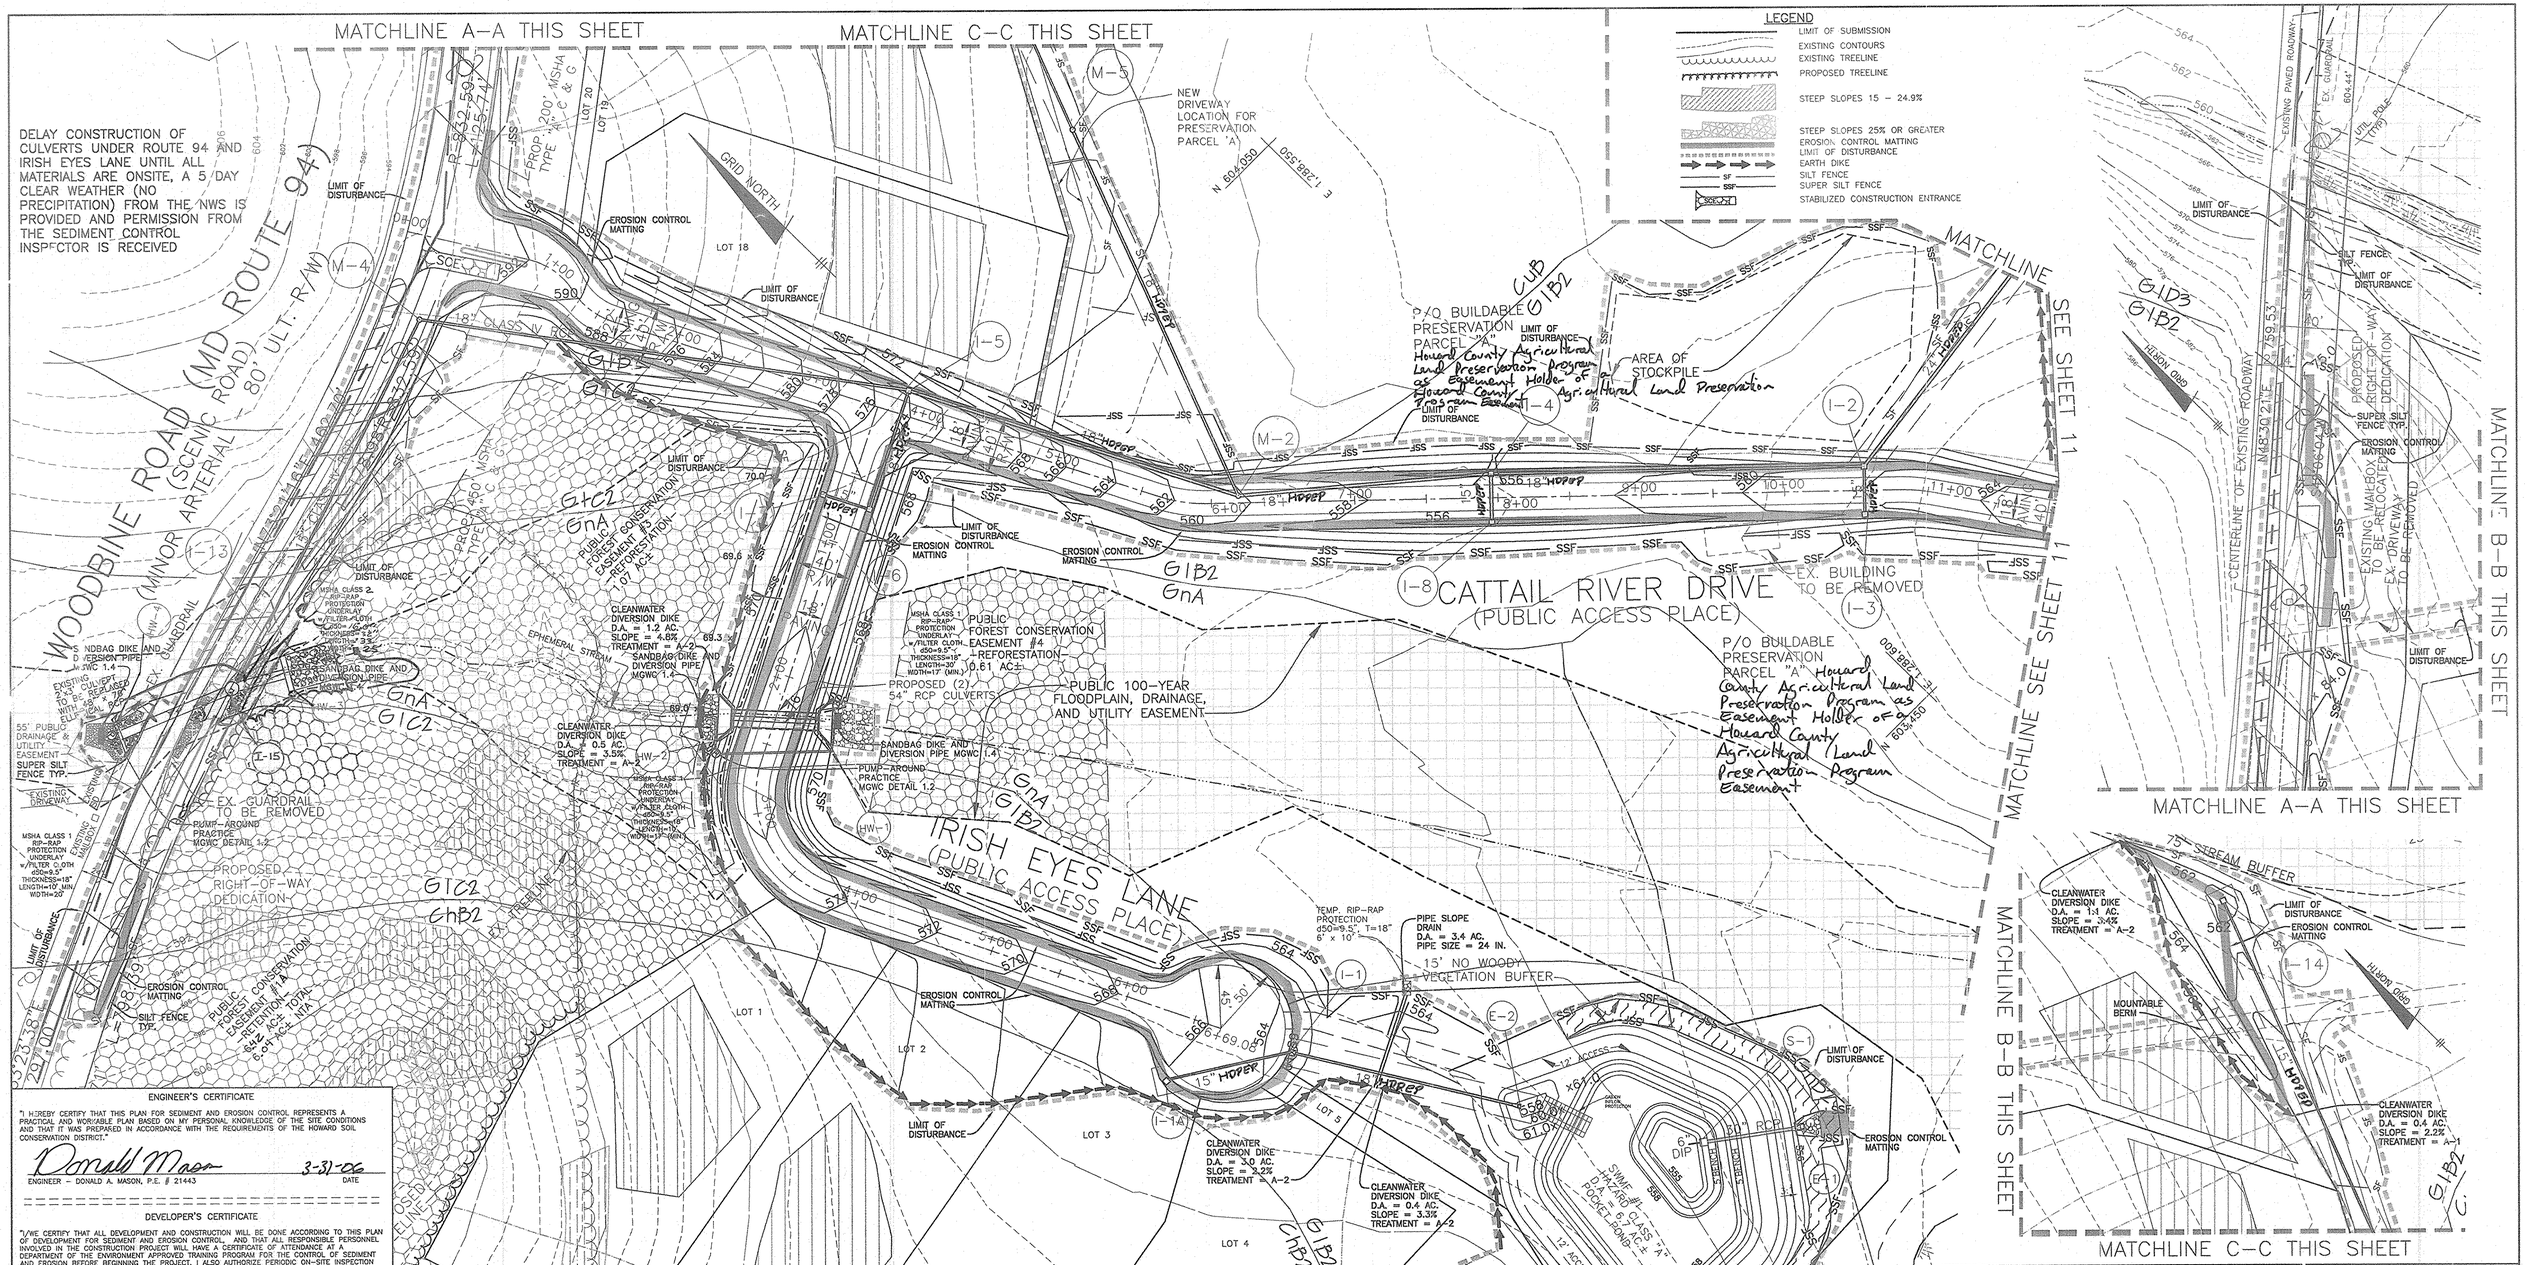


## LEGEND

- LIMIT OF SUBMISSION
- EXISTING CONTOURS
- EXISTING TREELINE
- PROPOSED TREELINE
- STEEP SLOPES 15 – 24.9%
- STEEP SLOPES 25% OR GREATER
- EROSION CONTROL MATTING
- LIMIT OF DISTURBANCE
- EARTH DIKE
- SF — SILT FENCE
- SSF — SUPER SILT FENCE
- STABILIZED CONSTRUCTION ENTRANCE

## ENGINEER'S CERTIFICATE

"I HEREBY CERTIFY THAT THIS PLAN FOR SEDIMENT AND EROSION CONTROL REPRESENTS A PRACTICAL AND WORKABLE PLAN BASED ON MY PERSONAL KNOWLEDGE OF THE SITE CONDITIONS AND THAT IT WAS PREPARED IN ACCORDANCE WITH THE REQUIREMENTS OF THE HOWARD SOIL CONSERVATION DISTRICT."

Donald Mason — 3-31-06
ENGINEER – DONALD A. MASON, P.E. # 21443 — DATE

## DEVELOPER'S CERTIFICATE

"I/WE CERTIFY THAT ALL DEVELOPMENT AND CONSTRUCTION WILL BE DONE ACCORDING TO THIS PLAN OF DEVELOPMENT FOR SEDIMENT AND EROSION CONTROL, AND THAT ALL RESPONSIBLE PERSONNEL INVOLVED IN THE CONSTRUCTION PROJECT WILL HAVE A CERTIFICATE OF ATTENDANCE AT A DEPARTMENT OF THE ENVIRONMENT APPROVED TRAINING PROGRAM FOR THE CONTROL OF SEDIMENT AND EROSION BEFORE BEGINNING THE PROJECT. I ALSO AUTHORIZE PERIODIC ON-SITE INSPECTION BY THE HOWARD SOIL CONSERVATION DISTRICT."

Michael Ryan — 4/4/06
DEVELOPER — DATE

REVIEWED FOR HOWARD SCD AND MEETS TECHNICAL REQUIREMENTS

Jim Myers — 4/11/06
USDA – NATURAL RESOURCES CONSERVATION SERVICE — DATE

THIS DEVELOPMENT PLAN IS APPROVED FOR SOIL EROSION AND SEDIMENT CONTROL BY THE HOWARD SOIL CONSERVATION DISTRICT.

4/11/06
HOWARD SCD — DATE

APPROVED: DEPARTMENT OF PUBLIC WORKS

4-21-06
CHIEF, BUREAU OF HIGHWAYS — DATE

APPROVED: DEPARTMENT OF PLANNING AND ZONING

5/1/06
CHIEF, DIVISION OF LAND DEVELOPMENT — DATE

5/2/06
CHIEF, DEVELOPMENT ENGINEERING DIVISION — DATE

## SOILS LEGEND

| SOIL | NAME | CLASS |
|---|---|---|
| ** Ba | Baile silt loam | D |
| * CuB | Comus silt loam, local alluvium, 3 to 8 percent slopes | B |
| GlB2 | Glenelg loam, 3 to 8 percent slopes, moderately eroded | B |
| GlC2 | Glenelg loam, 8 to 15 percent slopes, moderately eroded | B |
| GlC3 | Glenelg loam, 8 to 15 percent slopes, severely eroded | B |
| GlD3 | Glenelg loam, 15 to 25 percent slopes, severely eroded | B |
| GlD2 | Glenelg loam, 15 to 25 percent slopes, moderately eroded | B |
| * GnA | Glenville silt loam, 0 to 3 percent slopes | C |
| * GnB2 | Glenville silt loam, 3 to 8 percent slopes, moderately eroded | C |
| ** Ha | Hatboro silt loam | D |
| MlC2 | Mt. Airy channery loam, 8 to 15 percent slopes, moderately eroded | A |
| MlC3 | Mt. Airy channery loam, 8 to 15 percent slopes, severely eroded | A |
| MlD2 | Mt. Airy channery loam, 15 to 25 percent slopes, moderately eroded | A |
| MlE | Mt. Airy channery loam, 25 to 45 percent slopes | A |

NOTES:
* Hydric soils and/or contains hydric inclusions
** May contain hydric inclusions
† Generally only within 100-year floodplain areas

BENCHMARK
ENGINEERS ▲ LAND SURVEYORS ▲ PLANNERS
ENGINEERING, INC.
8480 BALTIMORE NATIONAL PIKE ▲ SUITE 418
ELLICOTT CITY, MARYLAND 21043
phone: 410-465-6105 ▲ fax: 410-465-6644
www.bei-civilengineering.com

Donald Mason 3/31/06

OWNER/DEVELOPER:
TRINITY QUALITY HOMES, INC.
3675 PARK AVENUE
SUITE 301
ELLICOTT CITY, MD 21043
410-480-0023

| No. | DATE | REVISION |
|---|---|---|
| 1 | 12/06 | REVISE STREAM DRAIN MATERIAL |
| 2 | 3/9/07 | REVISE HW3 TO HW4 |

PROJECT:
THE CHASE AT STONEY BROOK
LOTS 1–20, PRESERVATION PARCEL "A" AND NON-BUILDABLE PRESERVATION PARCELS "B" THROUGH "D"

LOCATION:
TAX MAP No. 7, BLOCK No. 17, PARCEL No. 133
4th ELECTION DISTRICT
HOWARD COUNTY, MARYLAND

TITLE:
GRADING, SEDIMENT AND EROSION CONTROL PLAN

DATE: MARCH, 2006 — PROJECT NO. 1187

DES: JMC — DRAFT: LAB — CHECK: DAM — SCALE: 1" = 50' — SHEET 10 OF 19

F-05-170

P:\1187\dwg\02651.dwg, SHEET 10, 3/31/2006 2:02:31 PM,

## DETAIL 25 – ROCK OUTLET PROTECTION I

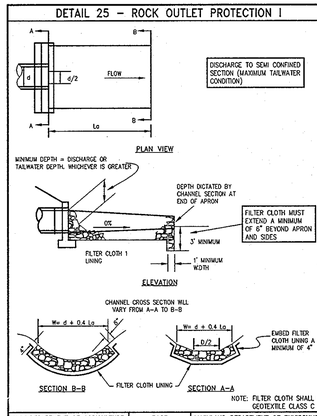


## ROCK OUTLET PROTECTION I

### CONSTRUCTION SPECIFICATIONS

1. The subgrade for the filter, rip-rap, or gabion shall be prepared to the required lines and grades. Any fill required in the subgrade shall be compacted to a density of approximately that of the surrounding undisturbed material.

2. The rock or gravel shall conform to the specified grading limits when installed respectively in the rip-rap or filter.

3. Geotextile shall be protected from punching, cutting, or tearing. Any damage other than on occasional small hole shall be repaired by placing another piece of geotextile over the damaged part or by completely replacing the geotextile. All overlaps whether for repairs or for joining two pieces of geotextile shall be a minimum of one foot.

4. Stone for the rip-rap or gabion outlets may be placed by equipment. They shall be constructed to the full course thickness in one operation and in such a manner as to avoid displacement of underlying materials. The stone for rip-rap or gabion outlets shall be delivered and placed in a manner that will ensure that it is reasonably homogeneous with the smaller stones and spalls filling the voids between the larger stones. Rip-rap shall be placed in a manner to prevent damage to the filter blanket or geotextile. Hand placement will be required to the extent necessary to prevent damage to the permanent works.

5. The stone shall be placed so that it blends in with the existing ground. If the stone is placed too high then the flow will be forced out of the channel and scour adjacent to the stone will occur.

| U.S. DEPARTMENT OF AGRICULTURE SOIL CONSERVATION SERVICE | PAGE F – 16 – 8 | MARYLAND DEPARTMENT OF ENVIRONMENT WATER MANAGEMENT ADMINISTRATION | U.S. DEPARTMENT OF AGRICULTURE SOIL CONSERVATION SERVICE | PAGE F – 16 – 8A | MARYLAND DEPARTMENT OF ENVIRONMENT WATER MANAGEMENT ADMINISTRATION |
|---|---|---|---|---|---|

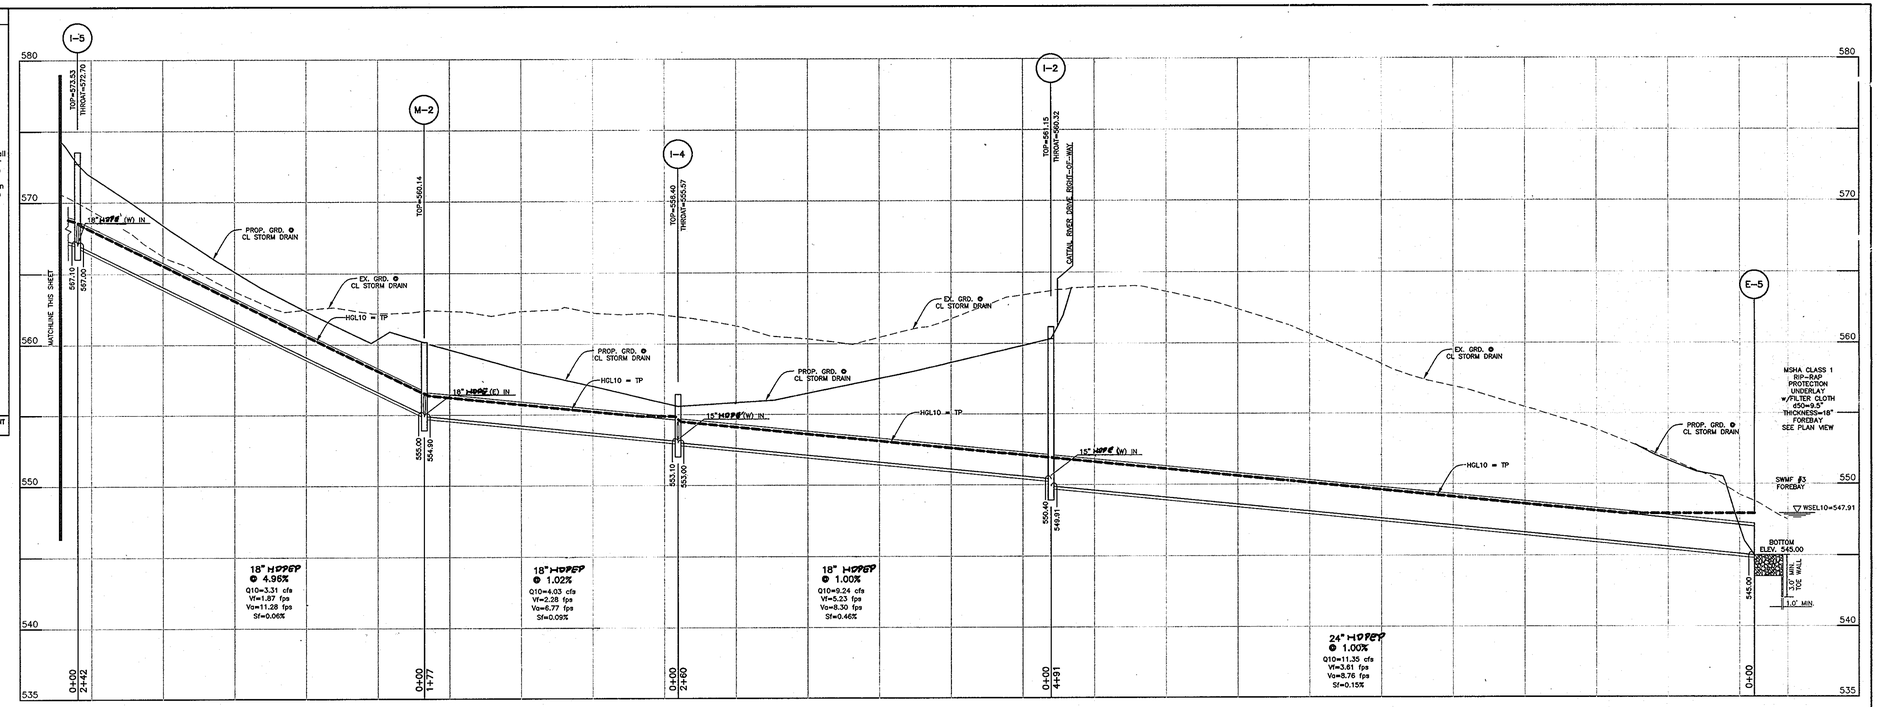


STORM DRAIN RUN E-5 TO I-13
HORIZONTAL SCALE: 1" = 50'
VERTICAL SCALE: 1" = 5'

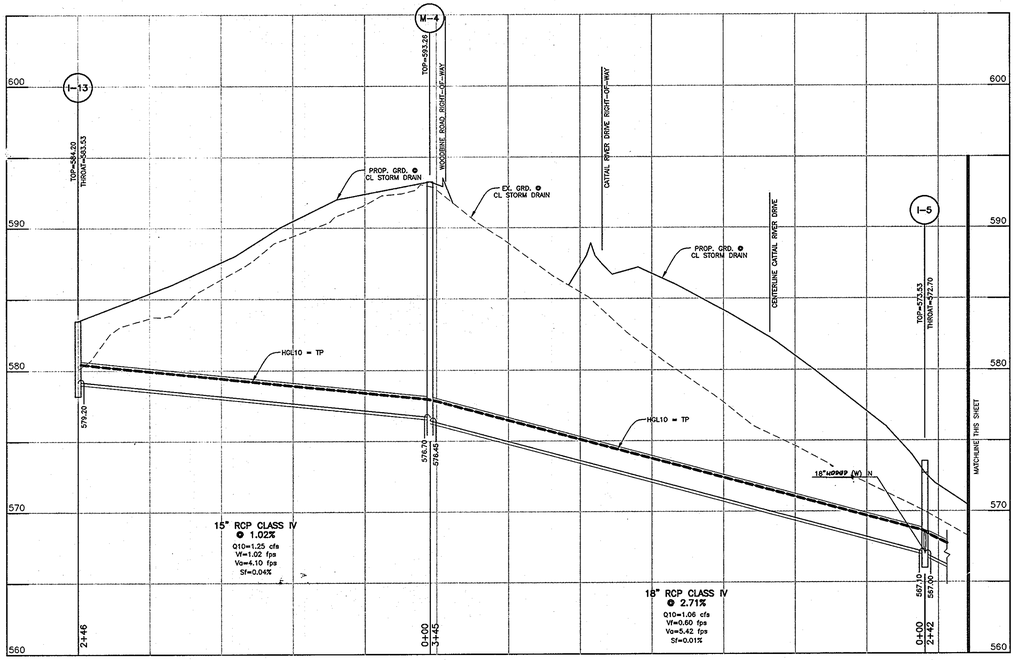


STORM DRAIN RUN E-5 TO I-13
HORIZONTAL SCALE: 1" = 50'
VERTICAL SCALE: 1" = 5'

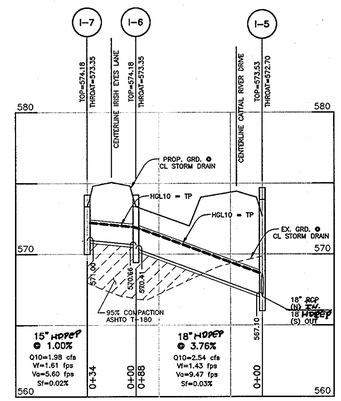


STORM DRAIN RUN I-5 TO I-7
HORIZONTAL SCALE: 1" = 50'
VERTICAL SCALE: 1" = 5'

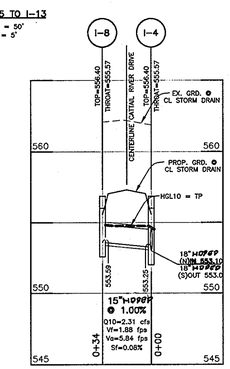


STORM DRAIN RUN I-4 TO I-8
HORIZONTAL SCALE: 1" = 50'
VERTICAL SCALE: 1" = 5'

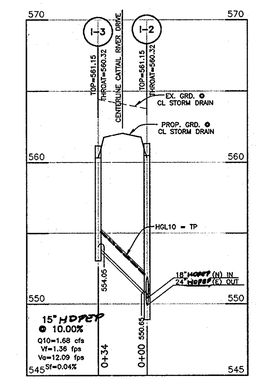


STORM DRAIN RUN I-2 TO I-3
HORIZONTAL SCALE: 1" = 50'
VERTICAL SCALE: 1" = 5'

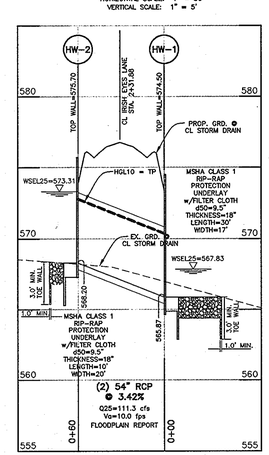


STORM DRAIN RUN HW-1 TO HW-2
HORIZONTAL SCALE: 1" = 50'
VERTICAL SCALE: 1" = 5'

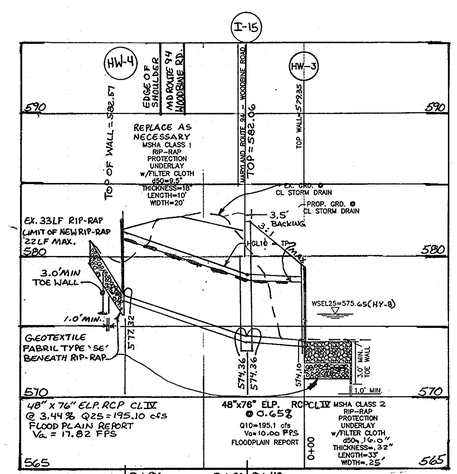


STORM DRAIN RUN HW-3 TO HW-4
HORIZONTAL SCALE: 1" = 50'
VERTICAL SCALE: 1" = 5'

| No. | DATE | REVISION |
|---|---|---|
| 2 | 3/9/07 | REVISE HW-3 TO HW-4 PROFILE TO MATCH MSHA PERMIT |
| 1 | 12/6/06 | REVISE STORM DRAIN MATERIAL |

**BENCHMARK**
ENGINEERS ▲ LAND SURVEYORS ▲ PLANNERS
**ENGINEERING, INC.**
8480 BALTIMORE NATIONAL PIKE ▲ SUITE 418
ELLICOTT CITY, MARYLAND 21043
phone: 410-465-6105 ▲ fax: 410-465-6644
www.bei-civilengineering.com

Donald Mason 3/31/06

OWNER/DEVELOPER:
TRINITY QUALITY HOMES, INC.
3675 PARK AVENUE
SUITE 301
ELLICOTT CITY, MD 21043
410-480-0023

PROJECT:
THE CHASE AT STONEY BROOK
LOTS 1–20, PRESERVATION PARCEL "A" AND NON-BUILDABLE PRESERVATION PARCELS "B" THROUGH "D"

LOCATION:
TAX MAP NO. 7 BLOCK NO. 17 PARCEL NO. 133
4th ELECTION DISTRICT
HOWARD COUNTY, MARYLAND

TITLE:
STORM DRAIN PROFILES

DATE: AUGUST, 2005 / MARCH, 2006
PROJECT NO. 1187
DESIGN: JMC
DRAFT: JMC
SCALE: AS SHOWN
DRAWING 9 OF 19

APPROVED: HOWARD COUNTY DEPARTMENT OF PUBLIC WORKS
CHIEF, BUREAU OF HIGHWAYS — DATE 4-21-06

APPROVED: HOWARD COUNTY DEPT. OF PLANNING AND ZONING
CHIEF, DIVISION OF LAND DEVELOPMENT — DATE 5/12/06
CHIEF, DEVELOPMENT ENGINEERING DIVISION — DATE 5/2/06

F-05-170

P:\1187\dwg\704458_9.dwg, Sheet 9, 3/31/2006 2:20:12 PM,
inx: Oce TDS600 HDI for avizar.w3

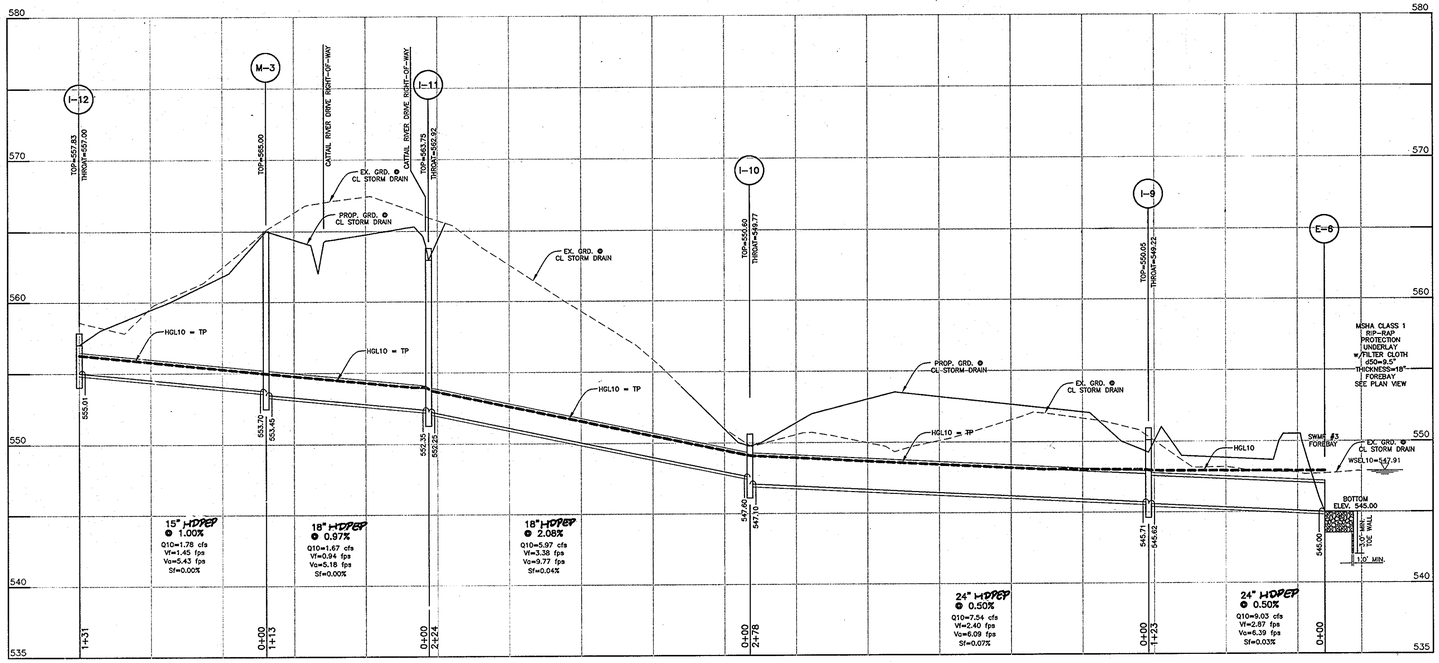


STORM DRAIN RUN E-6 TO I-12
HORIZONTAL SCALE: 1" = 50'
VERTICAL SCALE: 1" = 5'

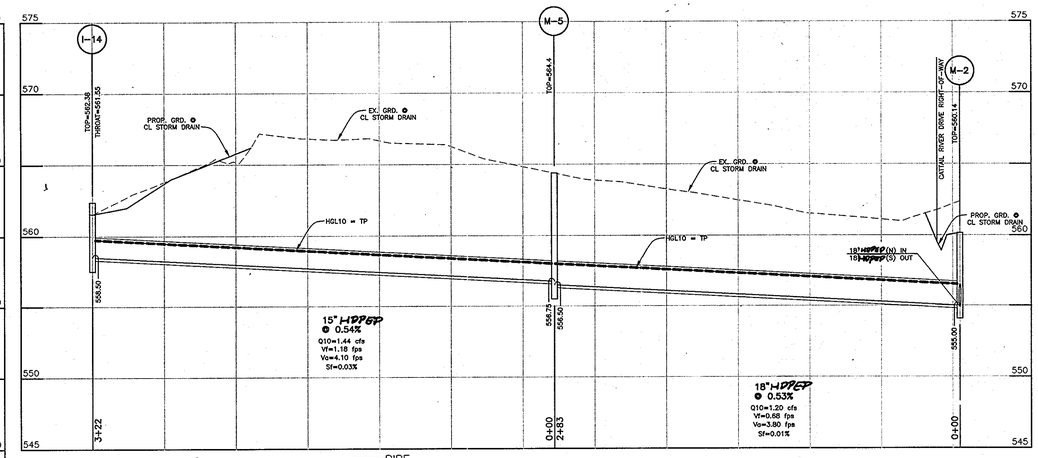


STORM DRAIN RUN M-2 TO I-14
HORIZONTAL SCALE: 1" = 50'
VERTICAL SCALE: 1" = 5'

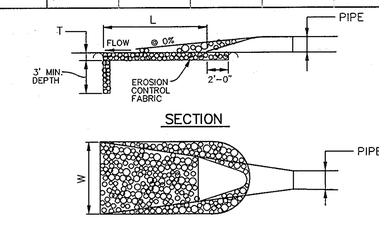


OUTLET PROTECTION DETAIL
NOT TO SCALE

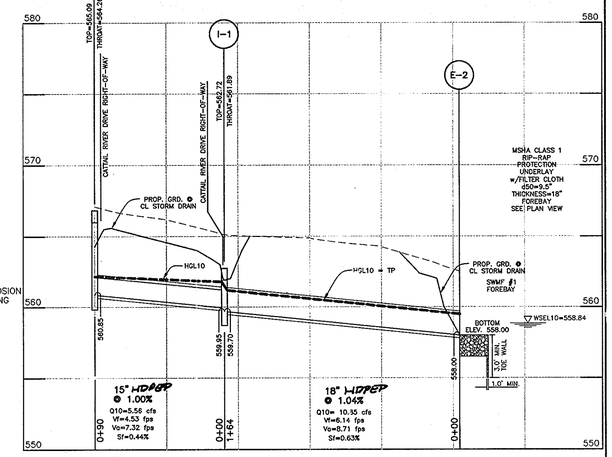


STORM DRAIN RUN E-2 TO I-1A
HORIZONTAL SCALE: 1" = 50'
VERTICAL SCALE: 1" = 5'

## STRUCTURE SCHEDULE

| NO. | TYPE | LOCATION | THROAT INV. | INVERT IN | INVERT OUT | TOP ELEV. | STANDARD | REMARKS |
|---|---|---|---|---|---|---|---|---|
| I-1 | TYPE "D" | STA. 1+49.72 OFF. 8.00' LT. | 561.89 | 559.95 | 559.70 | 562.72 | Ho.Co.STD. SD-4.11 | OPEN 4 SIDES |
| I-1A | TYPE "D" | STA. 2+41.22 OFF. 8.00' LT. | 564.26 | – | 560.85 | 565.09 | Ho.Co.STD. SD-4.11 | OPEN 4 SIDES |
| I-2 | TYPE "D" | STA. 10+55.62 OFF. 17.00' LT. | 560.32 | 550.65/550.40 | 549.91 | 561.15 | Ho.Co.STD. SD-4.11 | OPEN 2 SIDES |
| I-3 | TYPE "D" | STA. 10+55.62 OFF. 17.00' RT. | 560.32 | – | 554.05 | 561.15 | Ho.Co.STD. SD-4.11 | OPEN 2 SIDES |
| I-4 | TYPE "D" | STA. 7+95.30 OFF. 17.00' LT. | 555.57 | 553.25/553.10 | 553.00 | 556.40 | Ho.Co.STD. SD-4.11 | OPEN 2 SIDES |
| I-5 | TYPE "D" | STA. 3+73.35 OFF. 17.50' LT. | 572.70 | 567.10/567.10 | 567.00 | 573.53 | Ho.Co.STD. SD-4.11 | OPEN 2 SIDES |
| I-6 | TYPE "D" | STA. 0+70.69 OFF. 17.00' LT. | 573.35 | 570.66 | 570.41 | 574.18 | Ho.Co.STD. SD-4.11 | OPEN 2 SIDES |
| I-7 | TYPE "D" | STA. 0+70.69 OFF. 17.00' RT. | 573.35 | – | 571.00 | 574.18 | Ho.Co.STD. SD-4.11 | OPEN 2 SIDES |
| I-8 | TYPE "D" | STA. 3+95.30 OFF. 17.00' RT. | 555.57 | – | 553.59 | 556.40 | Ho.Co.STD. SD-4.11 | OPEN 2 SIDES |
| I-9 | TYPE "D" | N 603,582.83 E 1,289,282.13 | 549.22 | 545.71 | 545.62 | 550.05 | Ho.Co.STD. SD-4.11 | OPEN 2 SIDES |
| I-10 | TYPE "D" | N 603,408.33 E 1,289,499.70 | 549.77 | 547.60 | 547.10 | 550.60 | Ho.Co.STD. SD-4.11 | OPEN 2 SIDES |
| I-11 | TYPE "D" | STA. 1+65.74 OFF. 8.00' LT. | 562.92 | 552.35 | 552.25 | 563.75 | Ho.Co.STD. SD-4.11 | OPEN 4 SIDES |
| I-12 | TYPE "D" | N 602,971.22 E 1,289,539.93 | 557.00 | – | 555.01 | 557.83 | Ho.Co.STD. SD-4.11 | OPEN 2 SIDES |
| I-13 | 15' COG | STA. 9+15.30 OFF. 29.27' RT. | 583.33 | – | 579.20 | 584.20 | MD 374.51 | 15' OPENING |
| I-14 | TYPE "D" | N 604,455.39 E 1,288,577.30 | 561.55 | – | 558.50 | 562.38 | Ho.Co.STD. SD-4.11 | OPEN 2 SIDES |
| M-1 | 4'-0" STANDARD | N 602,676.37 E 1,289,007.90 | | 398.92 | 398.82 | 406.60 | Ho.Co.STD. G-5.12 | STANDARD PRECAST MANHOLE |
| M-2 | 4'-0" STANDARD | STA. 6+18.70 OFF. 5.00' LT. | | 555.00/555.00 | 554.90 | 560.14 | Ho.Co.STD. G-5.12 | STANDARD PRECAST MANHOLE |
| M-3 | 4'-0" STANDARD | N 603,078.08 E 1,289,464.88 | | 553.70 | 553.45 | 565.00 | Ho.Co.STD. G-5.12 | STANDARD PRECAST MANHOLE |
| M-4 | 4'-0" STANDARD | STA. 11+56.92 OFF. 27.10' RT. | | 576.70 | 576.45 | 593.26 | MD 383.01 | STANDARD PRECAST MANHOLE |
| M-5 | 4'-0" STANDARD | N 604,155.14 E 1,288,461.68 | | 556.75 | 556.50 | 564.4 | Ho.Co.STD. G-5.12 | STANDARD PRECAST MANHOLE |
| E-1 | TYPICAL CONCRETE | N 603,298.46 E 1,288,320.36 | | – | 554.0 | – | Ho.Co.STD. SD-5.51 | SWM OUTFALL |
| E-2 | 18" METAL | N 603,447.57 E 1,288,193.44 | | – | 558.0 | – | Ho.Co.STD. SD-5.61 | OUTFALL INTO FOREBAY |
| E-3 | TYPICAL CONCRETE | N 602,453.87 E 1,289,192.94 | | – | 534.0 | – | Ho.Co.STD. SD-5.51 | SWM OUTFALL |
| E-4 | TYPICAL CONCRETE | N 603,676.31 E 1,289,300.75 | | – | 540.0 | – | Ho.Co.STD. SD-5.51 | SWM OUTFALL |
| E-5 | 24" METAL | N 603,659.54 E 1,289,168.42 | | – | 545.0 | – | Ho.Co.STD. SD-5.61 | OUTFALL INTO FOREBAY |
| E-6 | 24" METAL | N 603,659.83 E 1,289,186.13 | | – | 545.0 | – | Ho.Co.STD. SD-5.61 | OUTFALL INTO FOREBAY |
| HW-1 | CAST IN PLACE | N 603,986.76 E 1,288,041.43 | | – | 565.87 | 574.5 | Ho.Co.STD. G-5.21 | SEE DETAILS |
| HW-2 | CAST IN PLACE | N 604,032.42 E 1,288,000.00 | | 568.2 | – | 575.7 | Ho.Co.STD. G-5.21 | SEE DETAILS |
| HW-3 | CAST IN PLACE | N 604,274.59 E 1,287,805.02 | | – | 574.10 | 579.35 | -- | MSHA - 355.02 |
| HW-4 | CAST IN PLACE | N 604,327.56 E 1,287,690.88 | | 577.32 | – | 582.57 | -- | MSHA - 355.02 |
| I-15 | 5' COG (96"DIA) | N 604,294.91, E 1287766.71 | 581.70 | 574.36 | 574.36 | 582.37 | MD 374.63 | 5' OPENING, 96" BASE |

1) STRUCTURE TOP ELEVATION AND LOCATION FOR MANHOLES IS AT THE TOP AND CENTER OF RIM.
2) STRUCTURE TOP ELEVATION AND LOCATION FOR INLETS IS AT THE TOP, CENTER FACE OF THE INLET FOR CURB INLETS AND AT THE CENTER TOP FOR YARD INLETS.
3) STRUCTURE TOP ELEVATION AND LOCATION FOR END SECTIONS IS AT THE CONNECTION OF PIPE AND END SECTION AT CENTERLINE.
4) STRUCTURE TOP ELEVATION AND LOCATION FOR HEADWALLS IS AT THE MIDPOINT OF THE FACE OF THE MAIN WALL

## PIPE LENGTH SCHEDULE

| SIZE | TYPE | CLASS | TOTAL LENGTH |
|---|---|---|---|
| 15" | RCP | IV | 322' |
| 18" | RCP | IV | 283' |
| 24" | HDPEP | * | 892' |
| 54" | RCP | IV | 120' |
| 48" x 76" | RCP | IV | 126' |
| 15" | HDPEP | * | 569' |
| 18" | HDPEP | * | 1613' |

* SMOOTH BORE INTERIOR FINISH

## OUTLET PROTECTION SCHEDULE

| STRUCTURE | D-50 | LENGTH | WIDTH | THICKNESS | SHA CLASS |
|---|---|---|---|---|---|
| E-1 | 9.5" | 14' | 17' | 18" | 1 |
| E-2 | 9.5" | FOREBAY | FOREBAY | 18" | 1 |
| E-3 | 9.5" | 14' | 17' | 18" | 1 |
| E-4 | 9.5" | 44' | 20' | 18" | 1 |
| E-5 | 9.5" | FOREBAY | FOREBAY | 18" | 1 |
| E-6 | 9.5" | FOREBAY | FOREBAY | 18" | 1 |

## PIPE SCHEDULE

| RUN | SIZE | LENGTH | TYPE & CLASS |
|---|---|---|---|
| E-2 TO I-1 | 18" | 164' | HDPEP |
| I-1 TO I-1A | 15" | 90' | HDPEP |
| E-5 TO I-2 | 24" | 491' | HDPEP |
| I-2 TO I-4 | 18" | 260' | HDPEP |
| I-4 TO M-2 | 18" | 177' | HDPEP |
| M-2 TO I-5 | 18" | 242' | HDPEP |
| I-5 TO M-4 | 18" | 345' | RCP CLASS IV |
| M-4 TO I-13 | 15" | 246' | RCP CLASS IV |
| M-2 TO M-5 | 18" | 283' | HDPEP |
| M-5 TO I-14 | 15" | 322' | HDPEP |
| I-5 TO I-6 | 18" | 88' | HDPEP |
| I-6 TO I-7 | 15" | 34' | HDPEP |
| I-4 TO I-8 | 15" | 34' | HDPEP |
| I-2 TO I-3 | 15" | 34' | HDPEP |
| E-6 TO I-9 | 24" | 123' | HDPEP |
| I-9 TO I-10 | 24" | 278' | HDPEP |
| I-10 TO I-11 | 18" | 224' | HDPEP |
| I-11 TO M-3 | 18" | 113' | HDPEP |
| M-3 TO I-12 | 15" | 131' | HDPEP |
| HW-1 TO HW-2 | (2) 54" | 60' | RCP CLASS IV |
| HW-3 TO I-15 | 48" x 76" | 40' | RCP CLASS IV |
| I-15 TO HW4 | 48" x 76" | 86' | RCP CLASS IV |




Q10 = 2.91 CFS
V = 2.78 FPS
B = 2'
S = 2.0%
n = 0.030

SWALE #1 SECTION
N.T.S.




Q10 = 2.54 CFS
V = 2.20 FPS
B = 8'
S = 3.0%
n = 0.030

SWALE #2 SECTION
N.T.S.




Q10 = 2.10 CFS
V = 2.54 FPS
B = 4'
S = 3.0%
n = 0.030

SWALE #3 SECTION
N.T.S.




Q10 = 1.83 CFS
V = 2.42 FPS
B = 4'
S = 3.0%
n = 0.030

SWALE #4 SECTION
N.T.S.




Q10 = 3.99 CFS
V = 2.06 FPS
B = 6'
S = 1.1%
n = 0.030

SWALE #5 SECTION
N.T.S.

APPROVED: HOWARD COUNTY DEPARTMENT OF PUBLIC WORKS

CHIEF, BUREAU OF HIGHWAYS — DATE 4-21-06

APPROVED: HOWARD COUNTY DEPT. OF PLANNING AND ZONING

CHIEF, DIVISION OF LAND DEVELOPMENT — DATE 5/2/06

CHIEF, DEVELOPMENT ENGINEERING DIVISION — DATE 5/2/06




CONNECTION FOR HDPEP TO METAL END-SECTION
NOT TO SCALE

| NO. | DATE | REVISION |
|---|---|---|
| 2 | 3/9/07 | REVISE HW3 TO HW4 DESIGN |
| 1 | 12/6/06 | REVISE STORM DRAIN MATERIAL |


BENCHMARK
ENGINEERS ▲ LAND SURVEYORS ▲ PLANNERS
ENGINEERING, INC.
8480 BALTIMORE NATIONAL PIKE ▲ SUITE 418
ELLICOTT CITY, MARYLAND 21043
phone: 410-465-6105 ▲ fax: 410-465-6644
www.bei-civilengineering.com


Donald Mason 3/31/06

OWNER/DEVELOPER:
TRINITY QUALITY HOMES, INC.
3675 PARK AVENUE
SUITE 301
ELLICOTT CITY, MD 21043
410-480-0023

PROJECT:
THE CHASE AT STONEY BROOK
LOTS 1-20, PRESERVATION PARCEL "A" AND NON-BUILDABLE PRESERVATION PARCELS "B" THROUGH "D"

LOCATION:
TAX MAP NO. 7 BLOCK NO. 17 PARCEL NO. 133
4th ELECTION DISTRICT
HOWARD COUNTY, MARYLAND

TITLE:
STORM DRAIN PROFILES

DATE: AUGUST, 2005 / MARCH, 2006 — PROJECT NO. 1187

DESIGN: JMC — DRAFT: JMC — SCALE: AS SHOWN — DRAWING 8 OF 19

F-05-170


P:\1187dwgs\7044SE_9.dwg, Sheet 8, 3/31/2006 2:20:38 PM,
rtm, Oce TDS600 HDI for mylar.pc3

## SOILS LEGEND

| SOIL | NAME | CLASS |
|---|---|---|
| ** Ba | Baile silt loam | D |
| * CuB | Comus silt loam, local alluvium, 3 to 8 percent slopes | B |
| GlB2 | Glenelg loam, 3 to 8 percent slopes, moderately eroded | B |
| GlC2 | Glenelg loam, 8 to 15 percent slopes, moderately eroded | B |
| GlC3 | Glenelg loam, 8 to 15 percent slopes, severely eroded | B |
| GlD3 | Glenelg loam, 15 to 25 percent slopes, severely eroded | B |
| GlD2 | Glenelg loam, 15 to 25 percent slopes, moderately eroded | B |
| * GnA | Glenville silt loam, 0 to 3 percent slopes | C |
| * GnB2 | Glenville silt loam, 3 to 8 percent slopes, moderately eroded | C |
| ** Ha | Hatboro silt loam | D |
| MtC2 | Mt. Airy channery loam, 8 to 15 percent slopes, moderately eroded | A |
| MtC3 | Mt. Airy channery loam, 8 to 15 percent slopes, severely eroded | A |
| MtD2 | Mt. Airy channery loam, 15 to 25 percent slopes, moderately eroded | A |
| MtE | Mt. Airy channery loam, 25 to 45 percent slopes | A |

NOTES:
- * Hydric soils and/or contains hydric inclusions
- ** May contain hydric inclusions
- † Generally only within 100-year floodplain areas

## SWALE DATA

| SWALE NO. | AREA (AC) | SOIL CLASS | ZONING | 'C' FACTOR |
|---|---|---|---|---|
| 1 | 1.84 | B | RC-DEO | 0.18 |
| 2 | 1.48 | A, B | RC-DEO | 0.17 |
| 3 | 1.59 | B | RC-DEO | 0.20 |
| 4 | 1.46 | B | RC-DEO | 0.19 |
| 5 | 3.56 | A, B | RC-DEO | 0.17 |

## STORM DRAIN DATA

| INLET NO. | AREA (AC) | % IMPERVIOUS | SOIL CLASS | ZONING | 'C' FACTOR |
|---|---|---|---|---|---|
| I-1 | 2.60 | 26 | B, C | RC-DEO | 0.28 |
| I-1A | 2.85 | 19 | B, C | RC-DEO | 0.26 |
| I-2 | 0.90 | 38 | B | RC-DEO | 0.37 |
| I-3 | 0.54 | 49 | B | RC-DEO | 0.47 |
| I-4 | 0.43 | 100 | B | RC-DEO | 0.86 |
| I-5 | 0.29 | 81 | B | RC-DEO | 0.71 |
| I-6 | 0.09 | 100 | B, C | RC-DEO | 0.86 |
| I-7 | 0.39 | 74 | B, C | RC-DEO | 0.67 |
| I-8 | 0.48 | 69 | B | RC-DEO | 0.64 |
| I-9 | 1.59 | 17 | B | RC-DEO | 0.20 |
| I-10 | 0.36 | 13 | B | RC-DEO | 0.19 |
| I-11 | 1.54 | 49 | B | RC-DEO | 0.45 |
| I-12 | 2.26 | 20 | A, B | RC-DEO | 0.21 |
| I-13 | 0.22 | 100 | B, C | RC-DEO | 0.86 |
| I-14 | 1.15 | 15 | B | RC-DEO | 0.19 |

## LEGEND

- LIMIT OF WETLANDS
- EXISTING WOODS LINE
- PROPOSED WOODS LINE
- EXISTING STRUCTURE
- EXISTING WELL (EX. WELL)
- PROPOSED SEPTIC FIELD
- 100 YEAR FLOODPLAIN
- FOREST CONSERVATION
- PROP. STREET TREE
- STEEP SLOPES 15–24.9%
- STEEP SLOPES 25% OR GREATER
- PROPOSED SAND MOUND AREA

APPROVED: HOWARD COUNTY DEPARTMENT OF PUBLIC WORKS

William F. [signature] HS — 4-21-06
CHIEF, BUREAU OF HIGHWAYS — DATE

APPROVED: HOWARD COUNTY DEPT. OF PLANNING AND ZONING

Cindy Hamilton JH — 5/2/06
CHIEF, DIVISION OF LAND DEVELOPMENT — DATE

[signature] MK — 5/2/06
CHIEF, DEVELOPMENT ENGINEERING DIVISION — DATE

| NO. | DATE | REVISION |
|---|---|---|
| 2 | 3-9-07 | REVISE HW-3 TO HW-4 DESIGN & FCE #1 |
| 1 | 2/6/06 | REVISE STORM DRAIN MATERIAL |

BENCHMARK
ENGINEERS ▲ LAND SURVEYORS ▲ PLANNERS
ENGINEERING, INC.
8480 BALTIMORE NATIONAL PIKE ▲ SUITE 418
ELLICOTT CITY, MARYLAND 21043
phone: 410-465-6105 ▲ fax: 410-465-6644
www.bei-civilengineering.com

Donald Mason [signature] 3/3/06

OWNER/DEVELOPER:
TRINITY QUALITY HOMES, INC.
3675 PARK AVENUE
SUITE 301
ELLICOTT CITY, MD 21043
410-480-0023

PROJECT:
# THE CHASE AT STONEY BROOK
LOTS 1–20, PRESERVATION PARCEL "A" AND NON-BUILDABLE PRESERVATION PARCELS "B" THROUGH "D"

LOCATION:
TAX MAP No. 7, BLOCK No. 17, PARCEL No. 133
4th ELECTION DISTRICT
HOWARD COUNTY, MARYLAND

TITLE:
## STORM DRAINAGE AREA MAP

DATE: AUGUST, 2005 / MARCH, 2006 — PROJECT NO. 1187
DES: JMC — DRAFT: RPS — CHECK: DAM — SCALE: 1" = 100' — SHEET 7 OF 19

F-05-170

P:\1187\dwg\7025S1.dwg, StormDrainAreaMap, 3/31/2006 2:19:03 PM, jmc, Oce TDS600 HDI for mylar.pc3

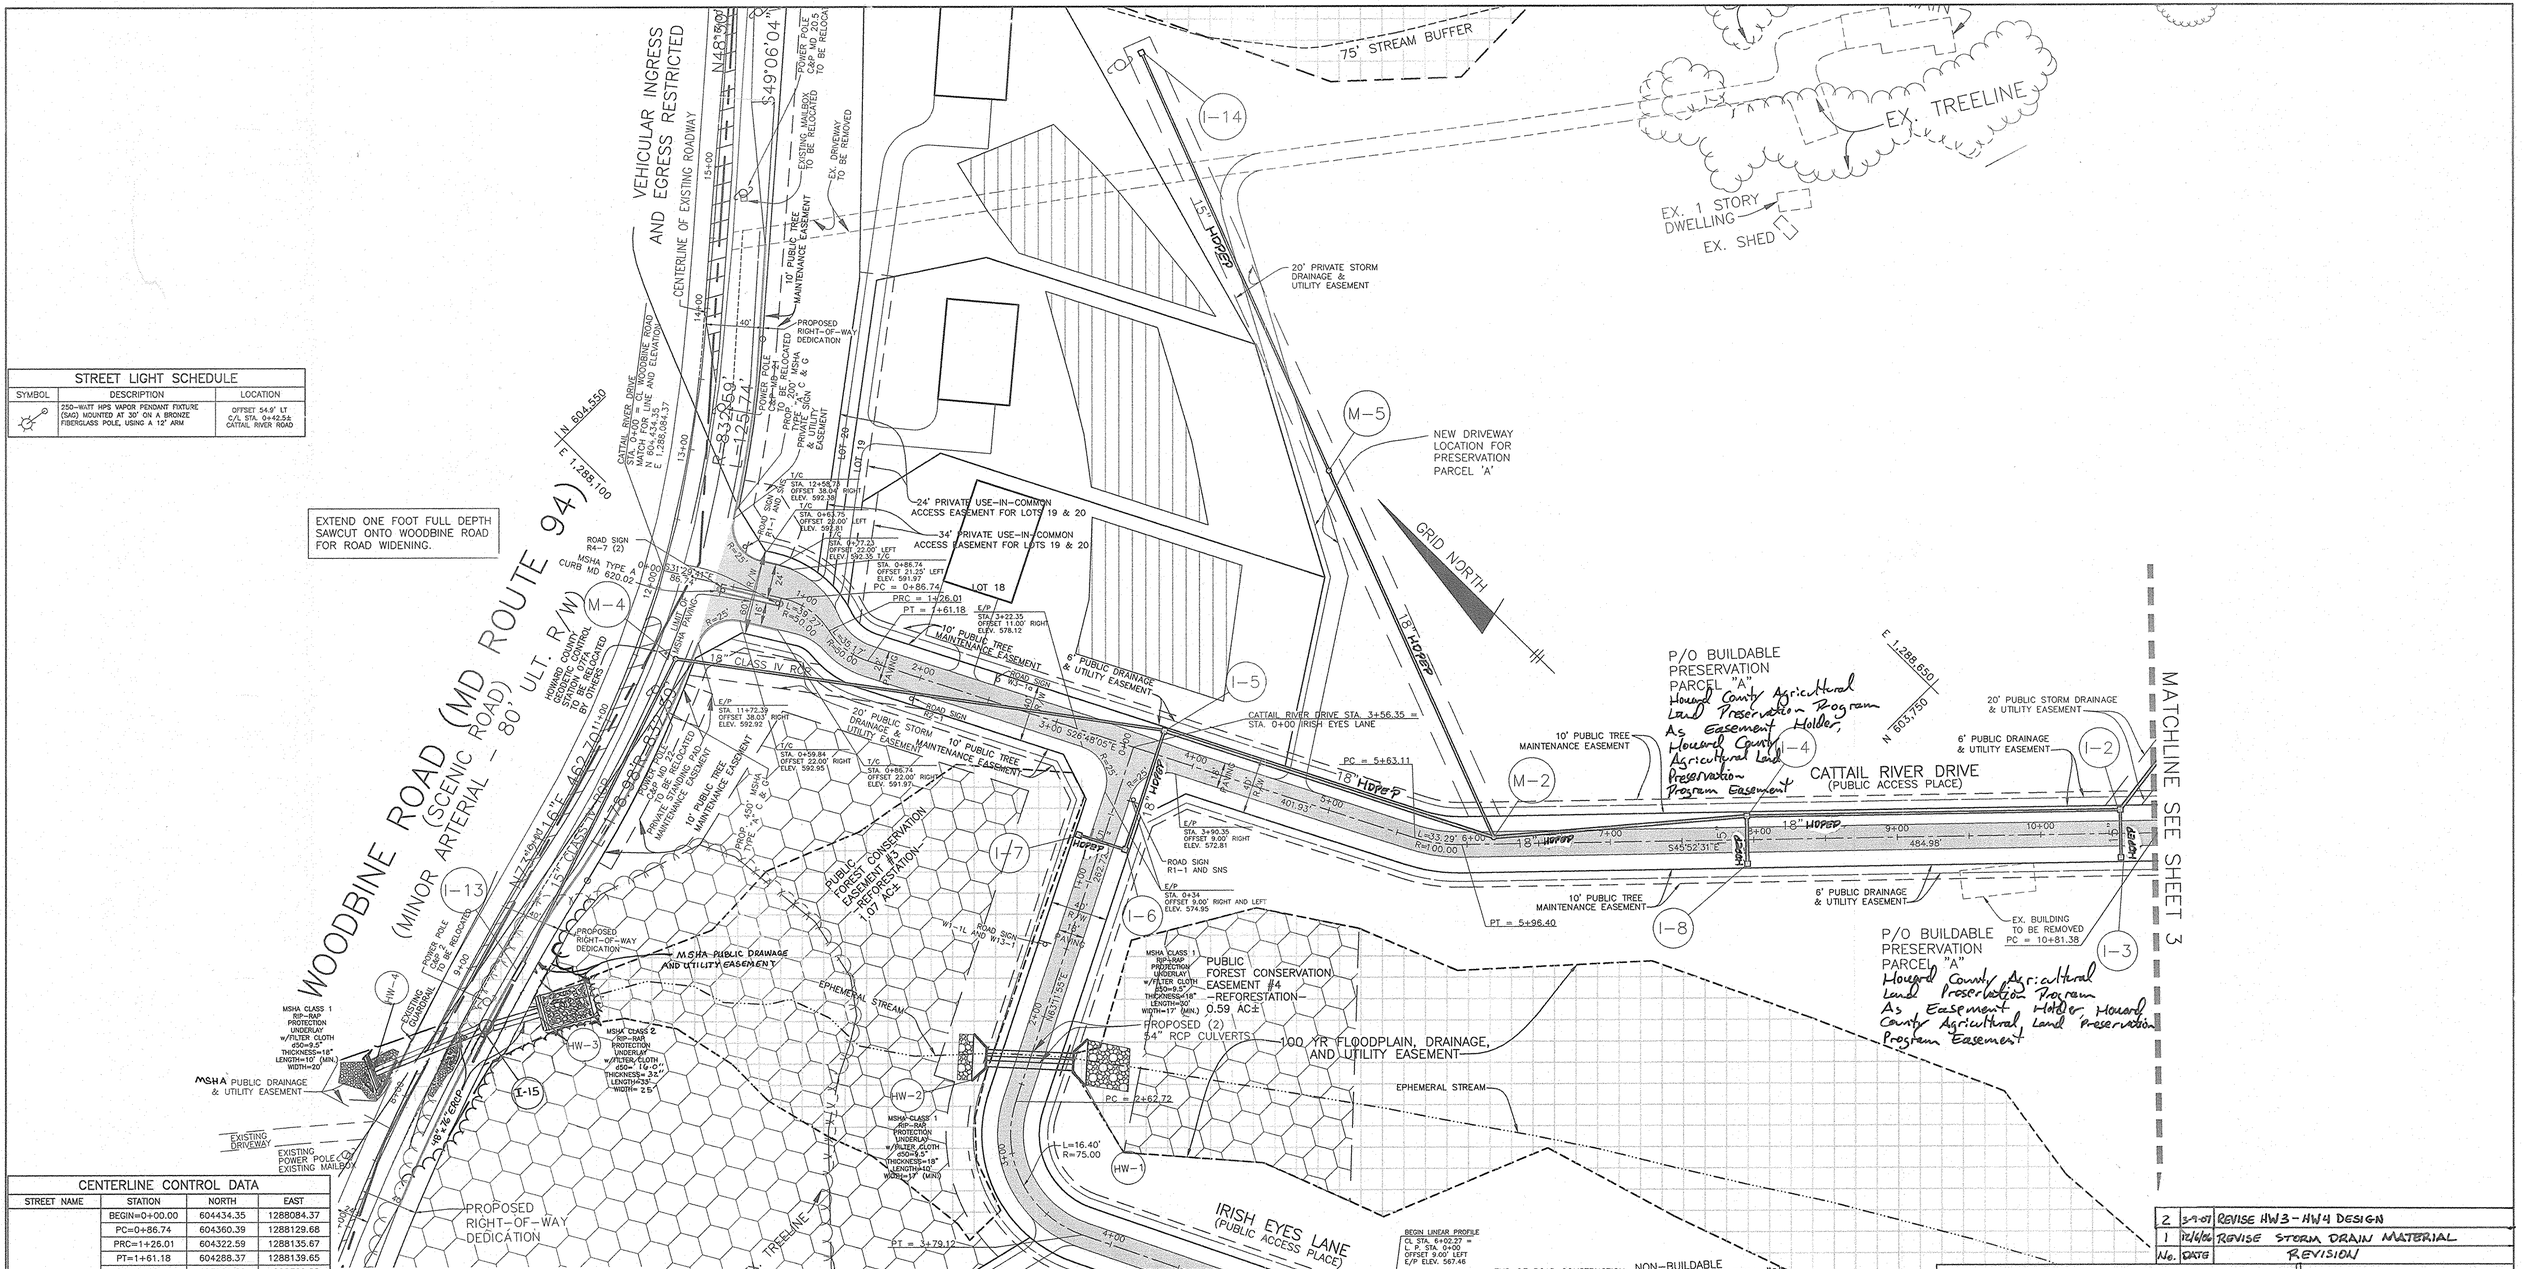


| STREET LIGHT SCHEDULE | | |
|---|---|---|
| SYMBOL | DESCRIPTION | LOCATION |
| | 250-WATT HPS VAPOR PENDANT FIXTURE (SA0) MOUNTED AT 30' ON A BRONZE FIBERGLASS POLE, USING A 12' ARM | OFFSET 54.9' LT C/L STA. 0+42.5± CATTAIL RIVER ROAD |

| CENTERLINE CONTROL DATA | | | |
|---|---|---|---|
| STREET NAME | STATION | NORTH | EAST |
| CATTAIL RIVER DRIVE | BEGIN=0+00.00 | 604434.35 | 1288084.37 |
| | PC=0+86.74 | 604360.39 | 1288129.68 |
| | PRC=1+26.01 | 604322.59 | 1288135.67 |
| | PT=1+61.18 | 604288.37 | 1288139.65 |
| | PC=5+63.11 | 603929.62 | 1288320.88 |
| | PT=5+96.40 | 603902.93 | 1288340.52 |
| | PC=10+81.38 | 603565.28 | 1288688.65 |
| | PT=11+00.78 | 603550.51 | 1288701.18 |
| | PC=12+80.13 | 603403.16 | 1288803.44 |
| | PT=14+98.96 | 603264.31 | 1288969.20 |
| | PC=18+15.00 | 603132.43 | 1289256.42 |
| | PT=18+92.99 | 603119.35 | 1289332.42 |
| | END=20+51.24 | 603160.70 | 1289457.46 |
| IRISH EYES LANE | BEGIN=0+00.00 | 604114.18 | 1288227.65 |
| | PC=2+62.72 | 603995.17 | 1287993.15 |
| | PT=3+79.12 | 603896.22 | 1287959.40 |
| | END=6+69.08 | 603634.99 | 1287959.40 |

| CENTER LINE CURVE DATA | | | | | | | |
|---|---|---|---|---|---|---|---|
| STREET NAME | STATION | RADIUS | LENGTH | DELTA | TANGENT | CHORD | |
| CATTAIL RIVER DRIVE | STA. 0+86.74 TO 1+26.01 | 50.00' | 32.27' | 45°00'00" | 20.71' | N08°59'59"W | 38.27' |
| | STA. 1+26.01 TO 1+61.18 | 50.00' | 35.17' | 40°18'24" | 18.35' | S06°38'53"E | 34.45' |
| | STA. 5+63.11 TO 5+96.40 | 100.00' | 33.29' | 19°04'26" | 16.80' | S36°20'18"E | 33.14' |
| | STA. 10+81.38 TO 11+00.78 | 100.00' | 19.40' | 11°06'58" | 9.73' | N40°19'02"W | 19.37' |
| | STA. 12+80.13 TO 14+98.96 | 410.00' | 218.82' | 30°34'45" | 112.08' | S50°02'56"E | 216.23' |
| | STA. 18+15.00 TO 18+92.99 | 150.00' | 78.00' | 29°47'31" | 39.90' | S80°14'04"E | 77.12' |
| IRISH EYES LANE | STA. 2+62.72 TO 3+79.12 | 75.00' | 116.40' | 88°55'13" | 73.60' | S18°44'19"W | 105.06' |

LEGEND

- LIMIT OF WETLANDS
- EXISTING WOODS LINE
- PROPOSED WOODS LINE
- EXISTING STRUCTURE
- EXISTING WELL (EX. WELL)
- PROPOSED SEPTIC FIELD
- 100 YEAR FLOODPLAIN
- FOREST CONSERVATION
- PROP. STREET TREE
- STEEP SLOPES 15-24.9%
- STEEP SLOPES 25% OR GREATER

APPROVED: HOWARD COUNTY DEPARTMENT OF PUBLIC WORKS

CHIEF, BUREAU OF HIGHWAYS — DATE 4-21-06

APPROVED: HOWARD COUNTY DEPT. OF PLANNING AND ZONING

CHIEF, DIVISION OF LAND DEVELOPMENT — DATE 5/12/06

CHIEF, DEVELOPMENT ENGINEERING DIVISION — DATE 6/2/06

| No. | DATE | REVISION |
|---|---|---|
| 2 | 3-31-06 | REVISE HW3-HW4 DESIGN |
| 1 | 12/6/05 | REVISE STORM DRAIN MATERIAL |

BENCHMARK
ENGINEERS ▲ LAND SURVEYORS ▲ PLANNERS
ENGINEERING, INC.
8480 BALTIMORE NATIONAL PIKE ▲ SUITE 418
ELLICOTT CITY, MARYLAND 21043
phone: 410-465-6105 ▲ fax: 410-465-6644
www.bei-civilengineering.com

Donald Mason 3/31/06

OWNER/DEVELOPER:
TRINITY QUALITY HOMES, INC.
3675 PARK AVENUE
SUITE 301
ELLICOTT CITY, MD 21043
410-480-0023

PROJECT:
THE CHASE AT STONEY BROOK
LOTS 1-20, PRESERVATION PARCEL "A" AND NON-BUILDABLE PRESERVATION PARCELS "B" THROUGH "D"

LOCATION:
TAX MAP No. 7, BLOCK No. 17, PARCEL No. 133
4th ELECTION DISTRICT
HOWARD COUNTY, MARYLAND

TITLE:
ROAD PLANS

DATE: AUGUST, 2005 / MARCH, 2006 — PROJECT NO. 1187

DES: JMC — DRAFT: LAB — CHECK: DAM — SCALE: 1" = 50' — SHEET 2 OF 19

F-05-170

P:\1187\dwg\70172s2_3.dwg, SHEET 2, 3/31/2006 2:07:33 PM,
imc. Oce TDS600 HDI for nvfar.pc3

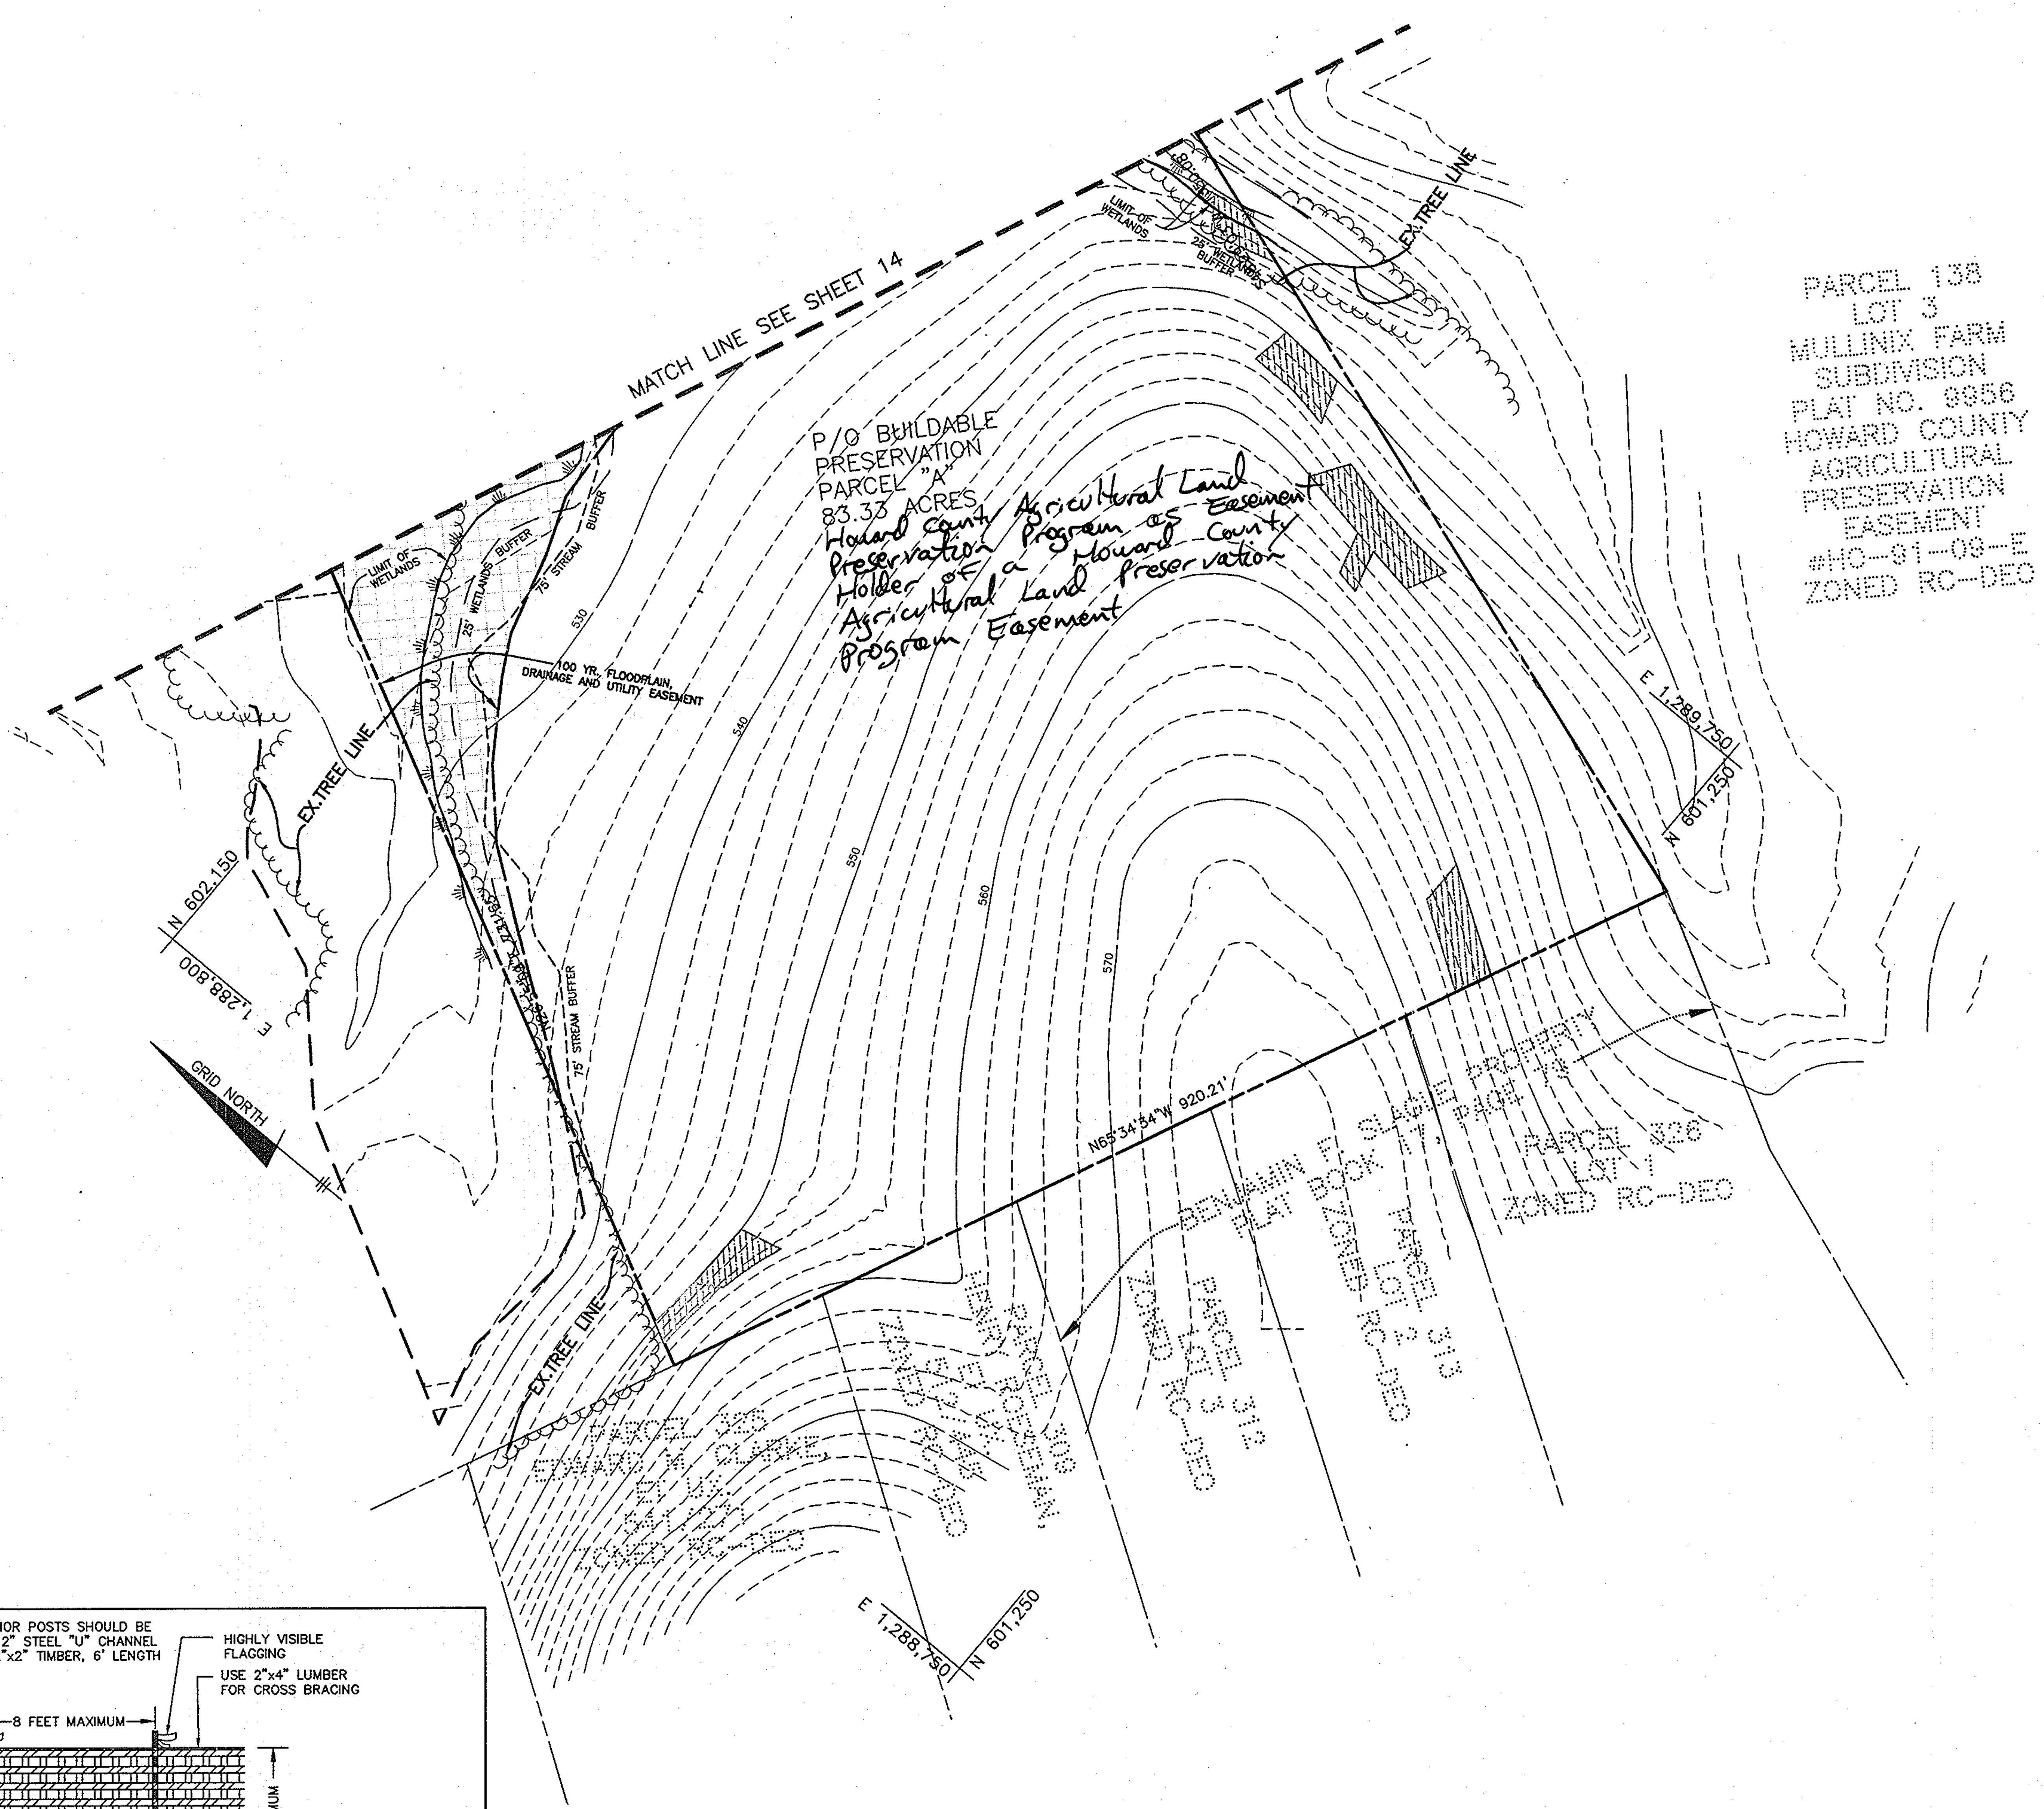


## FOREST CONSERVATION NOTES:

1. ANY FOREST CONSERVATION EASEMENT (FCE) AREA SHOWN HEREON IS SUBJECT TO PROTECTIVE COVENANTS WHICH WILL BE RECORDED IN THE LAND RECORDS OF HOWARD COUNTY WHICH RESTRICT THE DISTURBANCE AND USE OF THESE AREAS.
2. FORESTED AREAS OCCURRING OUTSIDE OF THE FCE SHALL NOT BE CONSIDERED PART OF THE FCE AND SHALL NOT BE SUBJECT TO PROTECTIVE LAND COVENANTS.
3. LIMITS OF DISTURBANCE SHALL BE RESTRICTED TO AREAS OUTSIDE THE LIMIT OF TEMPORARY FENCING OR THE FCE BOUNDARY, WHICHEVER IS GREATER.
4. THERE SHALL BE NO CLEARING, GRADING, CONSTRUCTION OR DISTURBANCE OF VEGETATION IN THE FOREST CONSERVATION EASEMENT, EXCEPT AS PERMITTED BY HOWARD COUNTY DPZ.
5. NO STOCKPILES, PARKING AREAS, EQUIPMENT CLEANING AREAS, ETC. SHALL OCCUR WITHIN AREAS DESIGNATED AS FOREST CONSERVATION EASEMENTS.
6. TEMPORARY FENCING SHALL BE USED TO PROTECT FOREST RESOURCES DURING CONSTRUCTION. THE FENCING SHALL BE PLACED ALONG ALL FCE BOUNDARIES WHICH OCCUR WITHIN 15 FEET OF THE PROPOSED LIMITS.
7. PERMANENT SIGNAGE SHALL BE PLACED 50–100' APART ALONG THE BOUNDARIES OF ALL AREAS INCLUDED IN FOREST CONSERVATION EASEMENTS.
8. FOREST CONSERVATION OBLIGATIONS ARE MET BY 7.54 ACRES OF RETENTION AND 1.68 ACRES OF REFORESTATION ON SITE. FINANCIAL SURETY FOR THE REQUIRED OBLIGATION MUST BE POSTED AS PART OF THE DEVELOPER'S AGREEMENT IN THE AMOUNT OF $102,278.88. THE TOTAL FOREST CONSERVATION OBLIGATION IS 9.22 ACRES.

**NOTE:**

WHIP PLANTINGS SHOULD BE INSTALLED IN A CURVILINEAR PATTERN TO FACILITATE MAINTENANCE BUT AVOID A GRID APPEARANCE. TREE SHELTERS SHOULD BE INSTALLED ON ALL WHIP PLANTINGS.

### FOREST CONSERVATION EASEMENT #3 (1.07 ACRES±)

| QTY.*** | SPECIES | SIZE | SPACING |
|---|---|---|---|
| 40 | Acer rubrum – RED MAPLE | 2-3' WHIP | ** |
| 35 | Robinia pseudoacacia – BLACK LOCUST | 2-3' WHIP | ** |
| 50 | Juglans nigra – BLACK WALNUT | 2-3' WHIP | ** |
| 40 | Juniperus virginiana – RED CEDAR | 2-3' WHIP | ** |
| 50 | Liriodendron tulipifera – POPLAR | 2-3' WHIP | ** |
| 20 | Nysaa sylvatica – BLACK GUM | 2-3' WHIP | ** |
| 50 | Prunus serotina – BLACK CHERRY | 2-3' WHIP | ** |
| 45 | Platanus occidentalis – SYCAMORE | 2-3' WHIP | ** |
| 30 | Quercus rubra – RED OAK | 2-3' WHIP | ** |
| 15 | Sassafras albidum – SASSAFRAS | 2-3' WHIP | ** |
| 375 | TOTAL 375 PLANTINGS REQUIRED | | |

### FOREST CONSERVATION EASEMENT #4 (0.61 ACRES±)

| QTY.*** | SPECIES | SIZE | SPACING |
|---|---|---|---|
| 30 | Acer rubrum – RED MAPLE | 2-3' WHIP | ** |
| 15 | Robinia pseudoacacia – BLACK LOCUST | 2-3' WHIP | ** |
| 24 | Juglans nigra – BLACK WALNUT | 2-3' WHIP | ** |
| 25 | Juniperus virginiana – RED CEDAR | 2-3' WHIP | ** |
| 30 | Liriodendron tulipifera – POPLAR | 2-3' WHIP | ** |
| 10 | Nysaa sylvatica – BLACK GUM | 2-3' WHIP | ** |
| 30 | Prunus serotina – BLACK CHERRY | 2-3' WHIP | ** |
| 25 | Platanus occidentalis – SYCAMORE | 2-3' WHIP | ** |
| 15 | Quercus rubra – RED OAK | 2-3' WHIP | ** |
| 10 | Sassafras albidum – SASSAFRAS | 2-3' WHIP | ** |
| 214 | TOTAL 207 PLANTINGS REQUIRED | | |

**KEY:**

** PLANTINGS TO BE SPACED AN AVERAGE OF 11 FOOT CENTERS – PLANTINGS SHOULD BE INSTALLED AS RANDOM OF AN ARRAINGEMENT AS POSSIBLE WITH GROUPING 3 TO 5 PLANTINGS AS EACH LOCATION.

PER COUNTY REQUIREMENTS, TREE SHELTERS SHOULD BE USED.

*** THE DEVELOPER RESERVE THE OPTION TO USE THE ALTERNATIVE PLANT MATERIAL SIZE AND DENSITY. IF 1" CALIPER TREES ARE USED THE QUANTITY REQUIRED SHALL BE 57.1% OF THE QUANTITY SPECIFIED IN THE ABOVE TABLE, IF 2" CALIPER TREES ARE PLANTED THE QUANTITY SHALL BE 28.6% OF THE QUANTITY SPECIFIED.

### Site Data

| | Areas |
|---|---|
| Gross Area: | 116.79 |
| 100 Year Floodplain: | 23.62 |
| Agricultural Pres. | 83.33 |
| Net Tract Area (NTA): | 33.46 |
| Existing Forest on NTA: | 8.46 |
| Afforestation Threshold: | 6.69 |
| Reforestation Threshold: | 8.37 |
| Forest not retained in FCE: | 0.92 |
| NTA Forest to be Retained in FCE: | 7.54 |

## APPENDIX E
## FOREST CONSERVATION WORKSHEET

ACRES (1/10 acre)

I. BASIC SITE DATA

| | ACRES (1/10 acre) |
|---|---|
| GROSS SITE AREA | 116.79 |
| AREA WITHIN 100 YEAR FLOOD PLAIN | 23.62 |
| AREA OF PRESERVATION PARCEL | 83.33 |
| AREA WITHIN AGRICULTURAL USE OR PRESERVATION PARCEL OUTSIDE OF FLOODPLAIN (IF APPLICABLE) | 59.71 |
| NET TRACT AREA | 33.46 |
| LAND USE CATEGORY (R-RLD, R-RMD, R-S, C/I/O, I) | R-RMD |

II. INFORMATION FOR CALCULATIONS

| | |
|---|---|
| A. NET TRACT AREA | 33.46 |
| B. REFORESTATION THRESHOLD (25% x A) | 8.37 |
| C. AFFORESTATION MINIMUM (20% x A) | 6.69 |
| D. EXISTING FOREST ON NET TRACT AREA | 8.46 |
| E. FOREST AREAS TO BE CLEARED | 0.92 |
| F. FOREST AREAS TO BE RETAINED (RETENTION) | 7.54 |

III. DETERMINING REQUIREMENTS: AFFORESTATION OR REFORESTATION

1. Reforestation

If existing forest areas equal or exceed the afforestation minimum (if D equals or is more than C), and clearing of forest areas is proposed, reforestation requirements may apply.

GO TO SECTION IV

If existing forest areas equal or exceed the afforestation minimum (if D equals or is more than C), and no clearing of existing forest resources is proposed, no reforestation is required. No further calculations are needed.

2. Afforestation

If existing forest areas are less than the afforestation minimum (if D is less than C), afforestation requirements apply.

GO TO SECTION V

NOTE:

1. THIS PROJECT IS USING RURAL CLUSTER OPTION 'C' PER APPENDIX 'L' OF THE FOREST CONSERVATION MANUAL TO CALCULATE ITS FOREST CONSERVATION OBLIGATION.

2. THE 83.33 ACRES EXCLUDED FROM THE THE NET TRACT AREA IS PRESERVATION PARCEL 'A'.

3. There are no specimen trees on this site.

IV. REFORESTATION CALCULATIONS

| | ACRES (1/10 acre) |
|---|---|
| A. NET TRACT AREA | 33.46 |
| B. REFORESTATION THRESHOLD (25% x A) | 8.37 |
| D. EXISTING FOREST ON NET TRACT AREA | 8.46 |
| E. FOREST AREAS TO BE CLEARED | 0.92 |
| F. FOREST AREAS TO BE RETAINED | 7.54 |
| G. FOREST AREAS CLEARED ABOVE REFORESTATION THRESHOLD (D–F, If F equals or is greater than B, Alternate 1) (D–B, if F is less than B, Alternate 2) | 0.09 |
| H. FOREST AREAS CLEARED BELOW REFORESTATION THRESHOLD (B–F, If applicable) | 0.83 |
| I. FOREST AREAS RETAINED ABOVE REFORESTATION THRESHOLD (F–B, Retention Credit, if applicable) | 0 |

SELECT THE ALTERNATE THAT APPLIES:

1. Clearing above the threshold only

If forest areas to be retained equal or are greater than the reforestation threshold (if F equals or is greater than B), the following calculations apply:

| | |
|---|---|
| REFORESTATION FOR CLEARING ABOVE THRESHOLD G x 1/4 | 0.02 |
| CREDIT FOR FOREST AREAS RETAINED ABOVE THRESHOLD I = Retention Credit | 0 |
| TOTAL REFORESTATION REQUIRED (G x 1/4) – I | 0 |

If the total reforestation requirement is equal to or less than 0, no reforestation is required.

2. Clearing below the threshold

If forest areas to be retained are less than the reforestation threshold (if F is less than B), the following calculations apply:

| | |
|---|---|
| REFORESTATION FOR CLEARING ABOVE THRESHOLD G x 1/4 | 0.02 |
| REFORESTATION FOR CLEARING BELOW THRESHOLD H x 2 | 1.66 |
| TOTAL REFORESTATION REQUIRED (G x 1/4) + (H x 2) | 1.68 |

Since clearing occurs below the threshold, no forest retention credit is possible

### FOREST CONSERVATION TABULATION

| DESIGNATION | TYPE | ACREAGE |
|---|---|---|
| #1A | RETENTION | 6.04 NTA |
| #2 | RETENTION | 1.50 |
| #3 | REFORESTATION | 1.07 |
| #4 | REFORESTATION | 0.61 |
| TOTAL: | MIX | 9.24 |

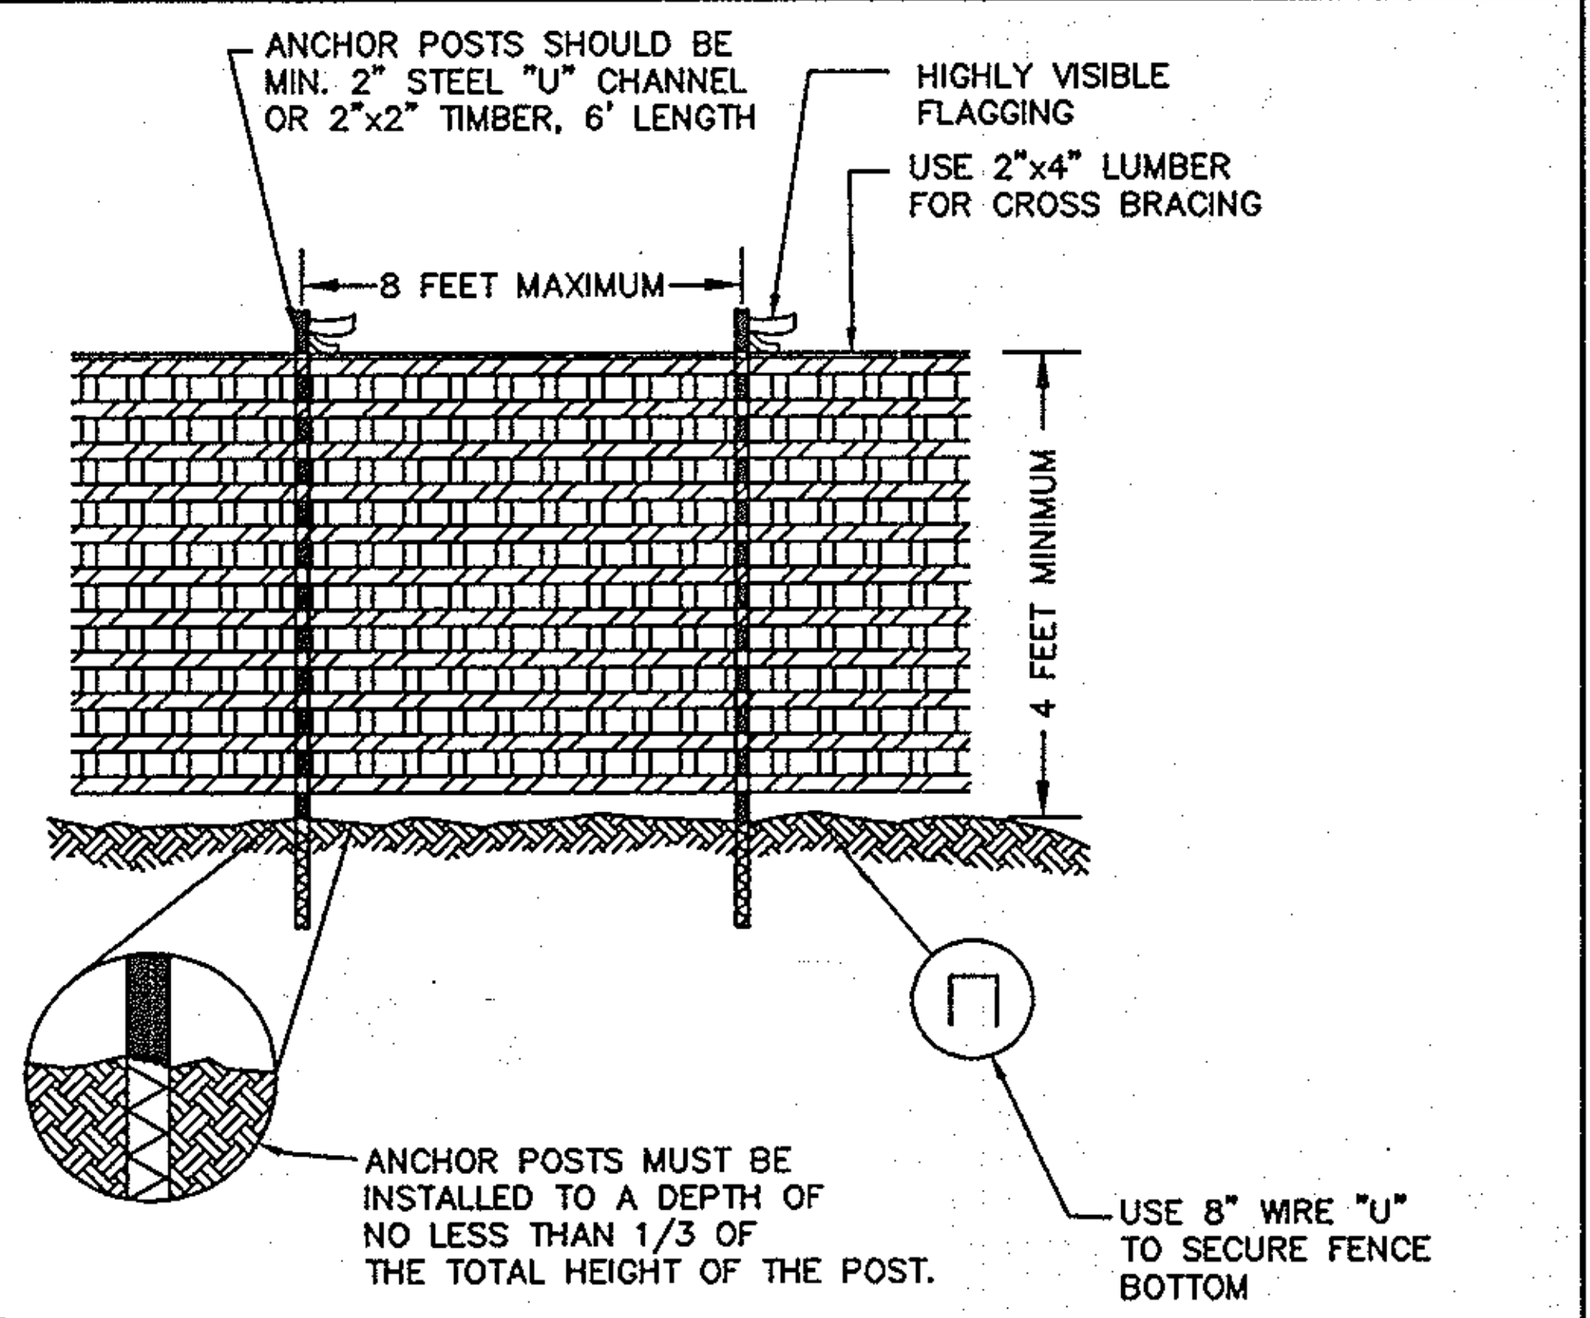


NOTES:
1. BLAZE ORANGE OR BLUE PLASTIC MESH FENCE FOR FOREST PROTECTION DEVICE ONLY.
2. BOUNDARIES OF RETENTION AREA WILL BE ESTABLISHED AS PART OF THE FOREST CONSERVATION PLAN REVIEW PROCESS.
3. BOUNDARIES OF RETENTION AREA SHOULD BE STAKED AND FLAGGED PRIOR TO INSTALLATION.
4. AVOID DAMAGE TO CRITICAL ROOT ZONE. DO NOT DAMAGE OR SEVER LARGE ROOTS WHEN INSTALLING POSTS.
5. PROTECTIVE SIGNS ARE REQUIRED.
6. DEVICE SHOULD BE MAINTAINED THROUGHOUT CONSTRUCTION.

ADAPTED FROM PRINCE GEORGE'S COUNTY, MD. WOODLAND CONSERVATION MANUAL AND FOREST CONSERVATION MANUAL, 1991.

PLASTIC MESH TREE PROTECTION FENCE

FOREST RETENTION AREA
MACHINERY, DUMPING OR STORAGE OF ANY MATERIALS IS
*PROHIBITED*
VIOLATORS ARE SUBJECT TO FINES AS IMPOSED BY THE HOWARD COUNTY FOREST CONSERVATION ACT OF 1992
MIN. 15"
MIN. 11"

SPECIMEN TREE
DO NOT REMOVE
MACHINERY, DUMPING OR STORAGE OF ANY MATERIALS IS
*PROHIBITED*
VIOLATORS ARE SUBJECT TO FINES AS IMPOSED BY THE HOWARD COUNTY FOREST CONSERVATION ACT OF 1992
MIN. 15"
MIN. 11"

Forest Conservation Area
REFORESTATION PROJECT
*Trees For Your Future*
MIN. 15"
MIN. 11"

PROTECTIVE SIGNAGE

APPROVED: HOWARD COUNTY DEPARTMENT OF PUBLIC WORKS
William L. Malone Jr. — CHIEF, BUREAU OF HIGHWAYS — 4-21-06 DATE

APPROVED: HOWARD COUNTY DEPT. OF PLANNING AND ZONING
Cindy Hamilton — CHIEF, DIVISION OF LAND DEVELOPMENT — JA — 5/12/06 DATE
CHIEF, DEVELOPMENT ENGINEERING DIVISION — MK — 5/2/06 DATE

### *SOILS LEGEND*

| SOIL | NAME | CLASS |
|---|---|---|
| ** Ba | Baile silt loam | D |
| * CuB | Comus silt loam, local alluvium, 3 to 8 percent slopes | B |
| GlB2 | Glenelg loam, 3 to 8 percent slopes, moderately eroded | B |
| GlC2 | Glenelg loam, 8 to 15 percent slopes, moderately eroded | B |
| GlC3 | Glenelg loam, 8 to 15 percent slopes, severely eroded | B |
| GlD3 | Glenelg loam, 15 to 25 percent slopes, severely eroded | B |
| GlD2 | Glenelg loam, 15 to 25 percent slopes, moderately eroded | B |
| * GnA | Glenville silt loam, 0 to 3 percent slopes | C |
| * GnB2 | Glenville silt loam, 3 to 8 percent slopes, moderately eroded | C |
| ** Ha | Hatboro silt loam | D |
| MtC2 | Mt. Airy channery loam, 8 to 15 percent slopes, moderately eroded | A |
| MtC3 | Mt. Airy channery loam, 8 to 15 percent slopes, severely eroded | A |
| MtD2 | Mt. Airy channery loam, 15 to 25 percent slopes, moderately eroded | A |
| MtE | Mt. Airy channery loam, 25 to 45 percent slopes | A |

*NOTES:*
* *Hydric soils and/or contains hydric inclusions*
** *May contain hydric inclusions*
† *Generally only within 100–year floodplain areas*

**LEGEND**

EXISTING CONTOURS
PROPOSED CONTORS
EXISTING TREELINE
PROPOSED TREELINE
SOIL DELINEATION LINE
GlB2 SOIL TYPE
FOREST CONSERVATION EASEMENT
STEEP SLOPES 25% OR GREATER
STEEP SLOPES 15 – 24.9 %
FCE FOREST CONSERVATION SIGN
TREE PROTECTION FENCE

Donald Mason 3/31/06

BENCHMARK
ENGINEERS ▲ LAND SURVEYORS ▲ PLANNERS
ENGINEERING, INC.
8480 BALTIMORE NATIONAL PIKE ▲ SUITE 418
ELLICOTT CITY, MARYLAND 21043
phone: 410–465–6105 ▲ fax: 410–465–6644
www.bei–civilengineering.com

| DATE | NO. | REVISION |
|---|---|---|
| 3/9/07 | | REVISE FCE #1 |

OWNER/DEVELOPER:
TRINITY QUALITY HOMES, INC.
3675 PARK AVENUE
SUITE 301
ELLICOTT CITY, MD 21043
410–480–0023

PROJECT:
# THE CHASE AT STONEY BROOK

AREA:
TAX MAP 7 BLOCK 17 PARCEL 133
4 th ELECTION DISTRICT
HOWARD COUNTY, MARYLAND

TITLE:
## FOREST CONSERVATION PLAN

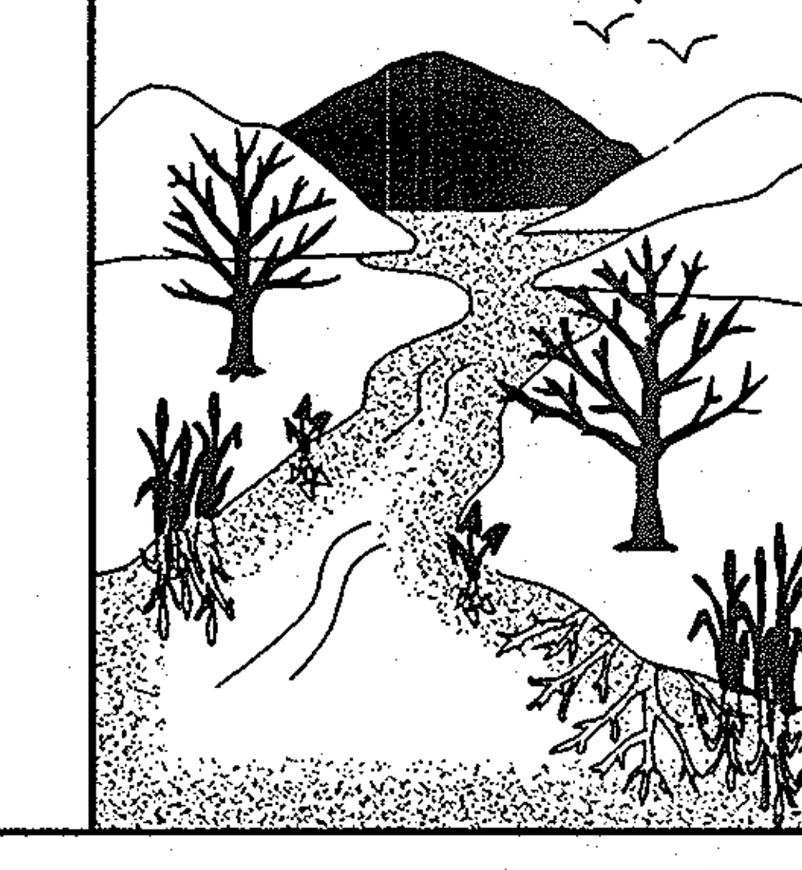

WILDMAN
ENVIRONMENTAL SERVICES
4747 BONNIE BRANCH RD.
ELLICOTT CITY, MD. 21043
PHONE: 410–869–9999
FAX: 410–869–9901

DESIGNED BY: R.B.W.
DRAWN BY: D.B.T./J.E.P.
PROJECT NO. 1025
DATE: MARCH, 2006
SCALE: 1"= 100'
SHEET NO. 15 OF 19

F–05–170

EXTEND ONE FOOT FULL DEPTH SAWCUT ONTO WOODBINE ROAD FOR ROAD WIDENING.

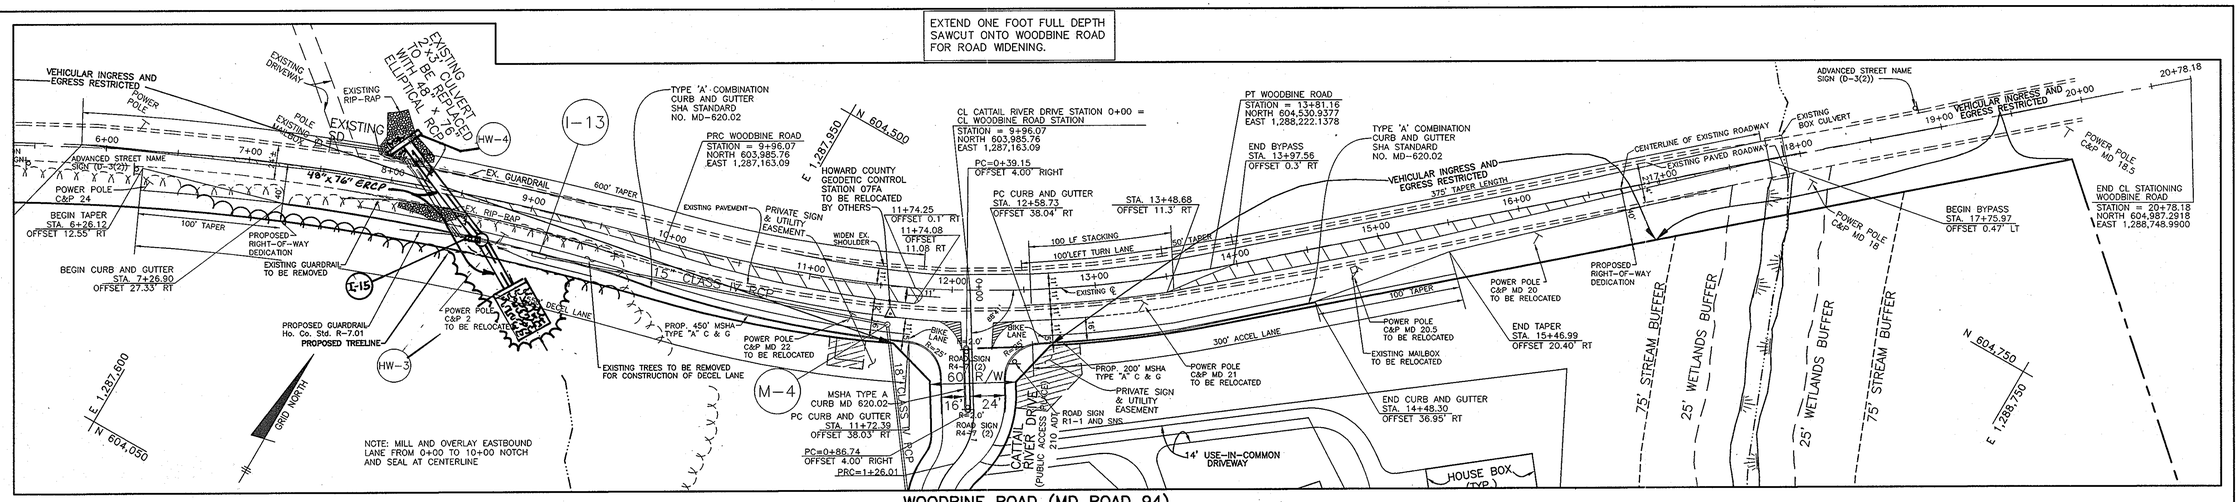


WOODBINE ROAD (MD ROAD 94)
(SCENIC ROAD, MINOR ARTERIAL – 80' ULT. R/W)

## PLAN VIEW

SCALE: 1" = 50'




MSHA PAVING SECTION

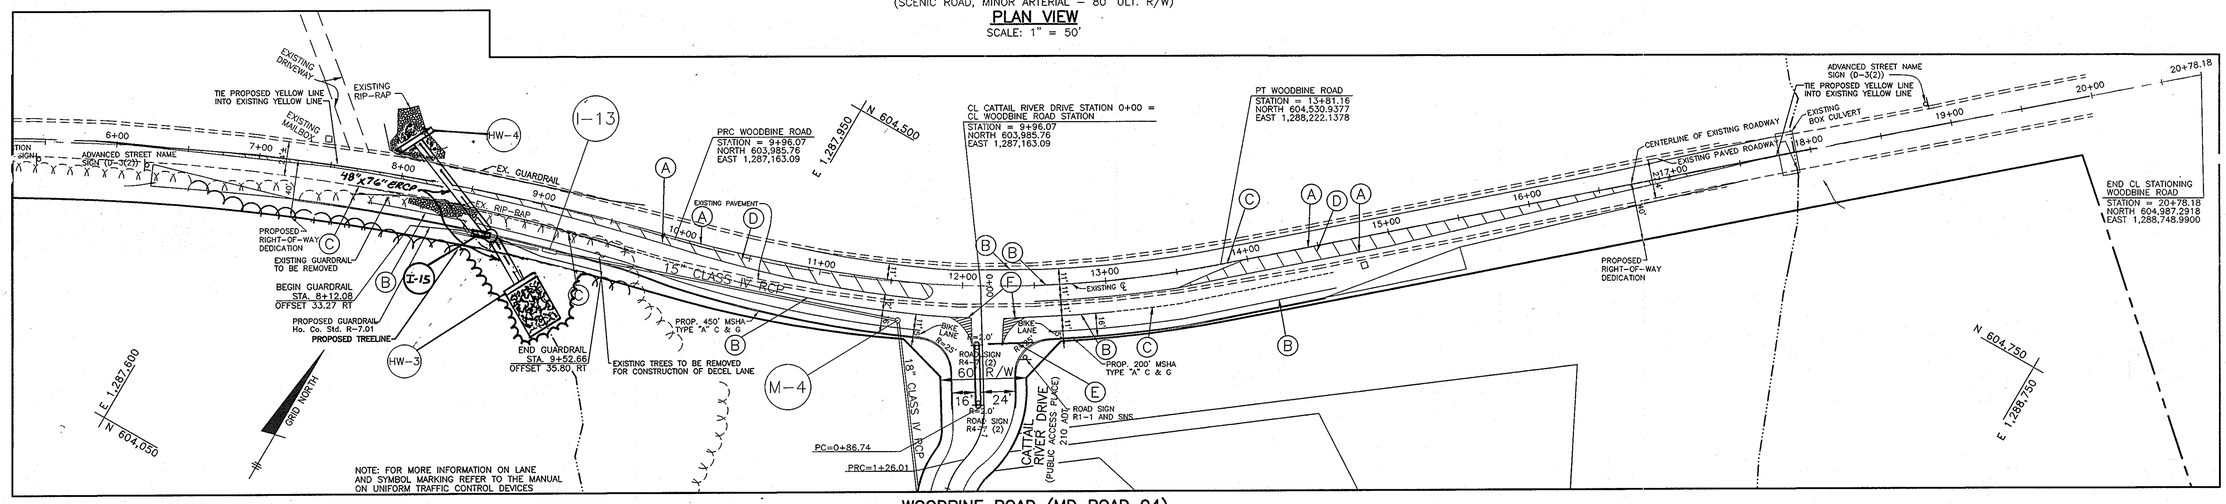


WOODBINE ROAD (MD ROAD 94)
(SCENIC ROAD, MINOR ARTERIAL – 80' ULT. R/W)

## PLAN VIEW – STRIPING AND SIGNAGE

SCALE: 1" = 50'

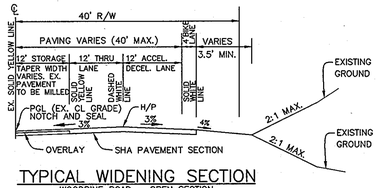


TYPICAL WIDENING SECTION
WOODBINE ROAD – OPEN SECTION
NOT TO SCALE

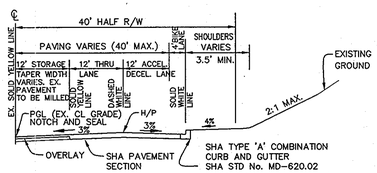


TYPICAL WIDENING SECTION
WOODBINE ROAD – CURB AND GUTTER
NOT TO SCALE

## LINE LEGEND

- (A) DOUBLE YELLOW CENTERLINE 5" WIDE (EACH LINE)
- (B) SOLID WHITE (5" WIDE)
- (C) PUPPY TRACKS (5" WIDE – WHITE) (3' LONG/ 9' GAP)
- (D) HATCH LINES 12" WIDE ON 45° ANGLE EVERY 100' (YELLOW)
- (E) STOP BAR (24" WIDE – WHITE) (THERMPLASTIC)


BENCHMARK
ENGINEERS ▲ LAND SURVEYORS ▲ PLANNERS
ENGINEERING, INC.
8480 BALTIMORE NATIONAL PIKE ▲ SUITE 418
ELLICOTT CITY, MARYLAND 21043
phone: 410-465-6105 ▲ fax: 410-465-6644
www.bei-civilengineering.com


Donald Mann
3/31/06

APPROVED: HOWARD COUNTY DEPARTMENT OF PUBLIC WORKS

William F. Weber Jr. — CHIEF, BUREAU OF HIGHWAYS — DATE 4-21-06

APPROVED: HOWARD COUNTY DEPT. OF PLANNING AND ZONING

Cindy Roma — CHIEF, DIVISION OF LAND DEVELOPMENT — DATE 5/2/06

CHIEF, DEVELOPMENT ENGINEERING DIVISION — DATE 5/2/06

OWNER/DEVELOPER:
TRINITY QUALITY HOMES, INC.
3675 PARK AVENUE
SUITE 301
ELLICOTT CITY, MD 21043
410-480-0023

PROJECT:
THE CHASE AT STONEY BROOK
LOTS 1–20, PRESERVATION PARCEL "A" AND NON-BUILDABLE PRESERVATION PARCELS "B" THROUGH "D"

LOCATION:
TAX MAP NO. 7 BLOCK NO. 17 PARCEL NO. 133
4th ELECTION DISTRICT
HOWARD COUNTY, MARYLAND

TITLE:
WOODBINE ROAD IMPROVEMENT PLAN

| NO. | DATE | REVISION |
|---|---|---|
| 1 | 3-9-07 | REVISE HW3 – HW4 DESIGN |

| | | | | | |
|---|---|---|---|---|---|
| DES: RPS | DRAFT: RPS | CHECK: DAM | DATE: MARCH, 2006 | PROJECT NO. 1187 | |
| | | | SCALE: AS SHOWN | SHEET 4 OF 19 | |

F-05-170

P:\1187\dwg\7017504.dwg, Layout1, 3/31/2006 2:09:15 PM,
imc, Oce TD5600 HDI for mylar.pc3