


CONSTRUCTION SEQUENCE

- 1) Obtain a Grading Permit 1 Week
- 2) Notify The Howard County Bureau of Licenses, Inspections and Permits and Construction Inspection/Surveys Division 24 hours prior to beginning of Grading Procedures
- 3) Install Temporary Sediment Control Measures (S.C.E., S.B.D.) 4 Months
- 4) Perform Onsite Construction 1 Week
- 5) Stabilize all Disturbed areas with Permanent Stabilization Measures 1 Day
- 6) Remove Temporary Sediment Control Measures with the Approval of the Inspector for the Howard County Bureau of Licenses, Inspections and Permits


SEDIMENT CONTROL NOTES

- 1) A minimum of 24 hours notice must be given to the Howard County Office of Inspection and Permits prior to the start of any construction. (092-2437)
- 2) All vegetative and structural practices are to be installed according to the provisions of this plan and are to be in conformance with the 1983 MARYLAND STANDARDS AND SPECIFICATIONS FOR SOIL EROSION AND SEDIMENT CONTROL.
- 3) Following initial soil disturbance or redisturbance, permanent or temporary stabilization shall be completed within 48 calendar days for all perimeter sediment control structures, dikes, perimeter slopes and all slopes greater than 3:1. It shall be done on all other disturbed or graded areas on the project site.
- 4) All sediment traps/basins shown must be fenced and warning signs posted around their perimeter in accordance with Vol. 1, Chapter 22, of the HOWARD COUNTY DESIGN MANUAL, Storm Drainage.
- 5) All disturbed areas must be stabilized within the time period specified above in accordance with the 1983 MARYLAND STANDARDS AND SPECIFICATIONS FOR SOIL EROSION AND SEDIMENT CONTROL for permanent seeding, mulching (Sec. 32.3), temporary seeding (Sec. 30) and mulch alone can only be done when recommended seeding dates do not allow for proper germination and establishment of grasses.
- 6) All sediment control structures are to remain in place and are to be maintained in operative condition until permission for their removal has been obtained from the Howard County Sediment Control Inspector.
- 7) Site Analysis:
 - Total Area of Site: 2.45 Acres
 - Area Disturbed: 2.25 Acres
 - Area to be reseeded or paved: 2.25 Acres
 - Area to be vegetatively stabilized: 0.20 Acres
 - Total Cut: 250 cu. yds.
 - Total Fill: 250 cu. yds.
 - Off-site waste/borrow area location:
- 8) Any sediment control practice which is disturbed by grading activity for placement of utilities must be repaired on the same day of disturbance.
- 9) Additional sediment controls must be provided, if deemed necessary by the Howard County DPM sediment control inspector.
- 10) On all areas with disturbed areas in excess of 2 acres, approval of the inspection agency shall be requested upon completion of seeding with any other earth disturbance or grading. Other building or grading inspection approvals may not be authorized until this initial approval by the inspection agency is made.

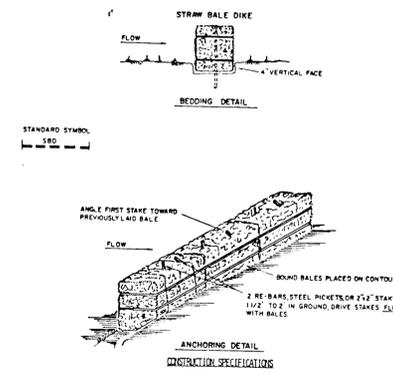

1. BALES SHALL BE PLACED AT THE TOE OF A SLOPE OR ON THE GROUND AND IN A ROW WITH ENDS TIGHTLY ADJUTING THE ADJACENT BALES.
2. EACH BALE SHALL BE EMPLOYED IN THE SOIL A MINIMUM OF (4) INCHES, AND PLACED SO THE BUNDING ARE HORIZONTAL.
3. BALES SHALL BE SECURELY ANCHORED IN PLACE BY EITHER TWO STAKES OR RE-BARS DRIVEN THROUGH THE BALE. THE FIRST STAKE IN EACH BALE SHALL BE DRIVEN TOWARD THE PROPOSED FILL SIDE BY AN ANGLE TO FORCE THE BALES TOGETHER. STAKES SHALL BE DRIVEN FLUSH WITH THE BALE.
4. INSPECTION SHALL BE FREQUENT AND REPAIR REPLACEMENT SHALL BE MADE PROMPTLY AS NEEDED.
5. BALES SHALL BE REMOVED WHEN THEY HAVE SERVED THEIR USEFULNESS SO AS NOT TO BLOCK OR IMPED STORM FLOW OR DRAINAGE.

STABILIZED CONSTRUCTION ENTRANCE not to scale

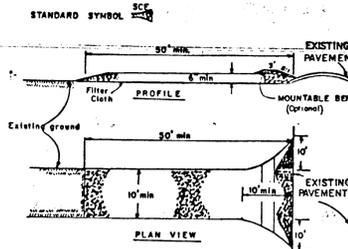

1. Stone Size - No 2" stone, or recycled or recycled concrete equivalent.
2. Length - As required, but not less than 30 feet (except on a single residence lot where a 20 foot minimum length would apply).
3. Thickness - Not less than six (6) inches.
4. Width - Ten (10) foot minimum, but not less than the full width at points where ingress or egress occurs.
5. Filter Cloth - Will be placed over the entire area prior to placing of stone. Filter will not be required on a single family residence lot.
6. Surface Water - All surface water flowing off of disturbed ground construction entrances shall be piped across the entrance. If piping is impractical, a mounded berm with 3:1 slopes will be provided.
7. Maintenance - The entrance shall be maintained in a condition which will prevent tracking or flowing of sediment onto public rights-of-way. This may require periodic top dressing with additional stone as conditions demand and repair and/or cleanup of any measures used to trap sediment. All sediment spilled, dropped, tracked or tracked onto public rights-of-way must be removed immediately.
8. Washing - Washes shall be cleaned to remove sediment prior to entrance onto public rights-of-way. When washing is required, it shall be done on an area stabilized with stone and which drains into an approved sediment trapping device.
9. Periodic inspection and needed maintenance shall be provided after each rain.

PERMANENT SEEDING NOTES

- Apply to graded or cleared areas not subject to immediate further disturbance where a permanent long-lived vegetative cover is needed.
- Seedbed Preparation:** Loosen upper three inches of soil by raking, disking or other acceptable means before seeding.
- Soil Amendments:** In lieu of soil test recommendations, use one of the following schedules:
- 1) Preferred - Apply 2 tons per acre dolomitic limestone (92 lbs/1000 sq ft) and 600 lbs per acre 10-10-10 fertilizer (14 lbs/1000 sq ft) before seeding. Narrow or disc into upper three inches of soil. At time of seeding, apply 400 lbs per acre 30-0-0 ureaform fertilizer (9 lbs/1000 sq ft).
 - 2) Acceptable - Apply 2 tons per acre dolomitic limestone (92 lbs/1000 sq ft) and 1000 lbs per acre 10-10-10 fertilizer (23 lbs/1000 sq ft) before seeding. Narrow or disc into upper three inches of soil.
- Seeding:** For the periods March 1 thru April 30, and August 1 thru October 15, seed with 20 lbs per acre (14 lbs/1000 sq ft) of Kentucky 31 Tall Fescue. For the period May 1 thru July 31, seed with 60 lbs Kentucky 31 Tall Fescue per acre and 2 lbs per acre (1.00 lbs/1000 sq ft) of seeding fertilizer. During the period of October 15 thru February 28, protect site by Option (1) 2 tons per acre of well anchored straw mulch and seed as soon as possible in the spring. Option (2) Use seed. Option (3) Seed with 60 lbs/acre Kentucky 31 Tall Fescue and mulch with 2 tons/acre well anchored straw.
- Mulching:** Apply 1 1/2 to 2 tons per acre (70 to 90 lbs/1000 sq ft) of untreated small grain straw immediately after seeding. Anchor mulch immediately after application using mulch anchoring tool or 218 gal per acre (5 gal/1000 sq ft) of emulsified asphalt on flat areas. On slopes 8 ft or higher, use 348 gal per acre (9 gal/1000 sq ft) for anchoring.
- Maintenance:** Inspect all seeded areas and make needed repairs, replacements and reseedings.
- TEMPORARY SEEDING NOTES**
- Apply to graded or cleared areas likely to be redisturbed where a short-term vegetative cover is needed.
- Seedbed Preparation:** Loosen upper three inches of soil by raking, disking or other acceptable means before seeding.
- Soil Amendments:** Apply 600 lbs per acre 10-10-10 fertilizer (14 lbs/1000 sq ft)
- Seeding:** For periods March 1 thru April 30 and from August 15 thru November 15, seed August 15, seed with 3 lbs per acre of seeding fertilizer (0.07 lbs/1000 sq ft). For the period November 16 thru February 28, protect site by applying 2 tons per acre of well anchored straw mulch and seed as soon as possible in the spring. For the period March 1 thru May 15, seed with 60 lbs Kentucky 31 Tall Fescue per acre and 2 lbs per acre (1.00 lbs/1000 sq ft) of seeding fertilizer. During the period of October 15 thru February 28, protect site by applying 2 tons per acre of well anchored straw mulch and seed as soon as possible in the spring. For the period March 1 thru May 15, seed with 60 lbs Kentucky 31 Tall Fescue per acre and 2 lbs per acre (1.00 lbs/1000 sq ft) of seeding fertilizer. During the period of October 15 thru February 28, protect site by applying 2 tons per acre of well anchored straw mulch and seed as soon as possible in the spring. For the period March 1 thru May 15, seed with 60 lbs Kentucky 31 Tall Fescue per acre and 2 lbs per acre (1.00 lbs/1000 sq ft) of seeding fertilizer. During the period of October 15 thru February 28, protect site by applying 2 tons per acre of well anchored straw mulch and seed as soon as possible in the spring.
- Mulching:** Apply 1 1/2 to 2 tons per acre (70 to 90 lbs/1000 sq ft) of untreated small grain straw immediately after seeding. Anchor mulch immediately after application using mulch anchoring tool or 218 gal per acre (5 gal/1000 sq ft) of emulsified asphalt on flat areas. On slopes 8 ft or higher, use 348 gal per acre (9 gal/1000 sq ft) for anchoring.
- Refer to the 1983 MARYLAND STANDARDS AND SPECIFICATIONS FOR SOIL EROSION AND SEDIMENT CONTROL for rate and methods not covered.

APPROVED: DEPARTMENT OF PUBLIC WORKS
 [Signature] DATE 3-11-86
 CHIEF, BUREAU OF ENGINEERING

APPROVED: OFFICE OF PLANNING & ZONING
 [Signature] DATE 3-11-86
 CHIEF, DIVISION OF LAND DEVELOPMENT & ZONING ADMINISTRATION

REVIEWED FOR HOWARD S.C.D. AND MEETS TECHNICAL REQUIREMENTS.
 [Signature] DATE 3-11-86
 U.S. SOIL CONSERVATION SERVICE

THIS DEVELOPMENT IS APPROVED SOIL EROSION AND SEDIMENT CONTROL BY THE HOWARD SOIL CONSERVATION DISTRICT.
 [Signature] DATE 3/11/86
 SOIL CONSERVATION DISTRICT

DEVELOPER'S CERTIFICATE

I CERTIFY THAT ALL DEVELOPMENT AND CONSTRUCTION WILL BE DONE ACCORDING TO THIS PLAN OF DEVELOPMENT AND PLAN FOR EROSION AND SEDIMENT CONTROL AND THAT ALL RESPONSIBLE PERSONNEL INVOLVED IN THE CONSTRUCTION PROJECT WILL HAVE A CERTIFICATE OF ATTENDANCE AT A DEPARTMENT OF NATURAL RESOURCES APPROVED TRAINING PROGRAM FOR THE CONTROL OF SEDIMENT AND EROSION BEFORE BEGINNING THE PROJECT. I ALSO AUTHORIZE PERIODIC ON-SITE INSPECTIONS BY THE HOWARD SOIL CONSERVATION DISTRICT OR THEIR AUTHORIZED AGENTS, AS ARE DEEMED NECESSARY.

DEVELOPER: [Signature] DATE 11/22/85

ENGINEER'S CERTIFICATE

I CERTIFY THAT THIS PLAN FOR EROSION AND SEDIMENT CONTROL REPRESENTS A PRACTICAL AND WORKABLE PLAN BASED ON PERSONAL KNOWLEDGE OF THE SITE CONDITIONS AND THAT IT WAS PREPARED IN ACCORDANCE WITH THE REQUIREMENTS OF THE HOWARD SOIL CONSERVATION DISTRICT.

ENGINEER: [Signature] DATE 3-5-86



OWNER & DEVELOPER






JOSE C ARROYO M.D.P.A.
 RETIREMENT TRUST
 3748 PLUM TREE CT.
 ELLICOTT CITY, MD 21043

TITLE:	GRADING AND SEDIMENT CONTROL PLAN			
PROJECT:	VIEW TOP ESTATES LOTS 5-8			
LOCATION:	2ND ELECTION DISTRICT	HOWARD	CO., MD.	
SCALE:	1" = 30'	DESIGNED BY:	W.N.	DRAWN BY:
FIELD BOOK:		CHECKED BY:	W.N.	DATE:
PAGE NO.:		JOB NO.:	77230	DRAWING NO.:
				1 OF 2

boender associates inc.
 consulting engineers
 land surveyors
 land planners

COURTHOUSE SQUARE
 3565 ELLICOTT MILLS DRIVE
 ELLICOTT CITY, MD 21043
 (301) 465-7777



#1076

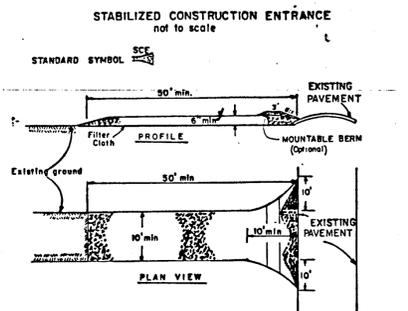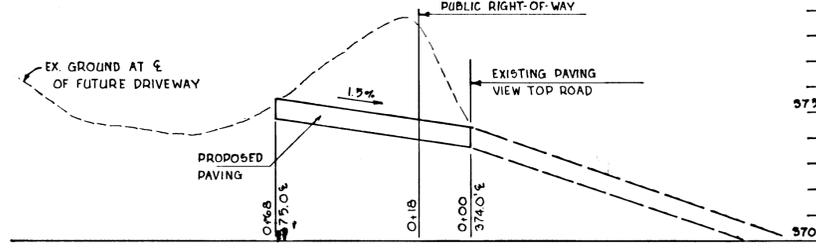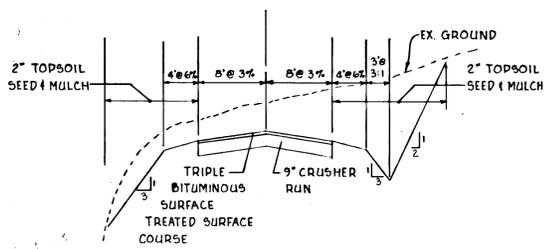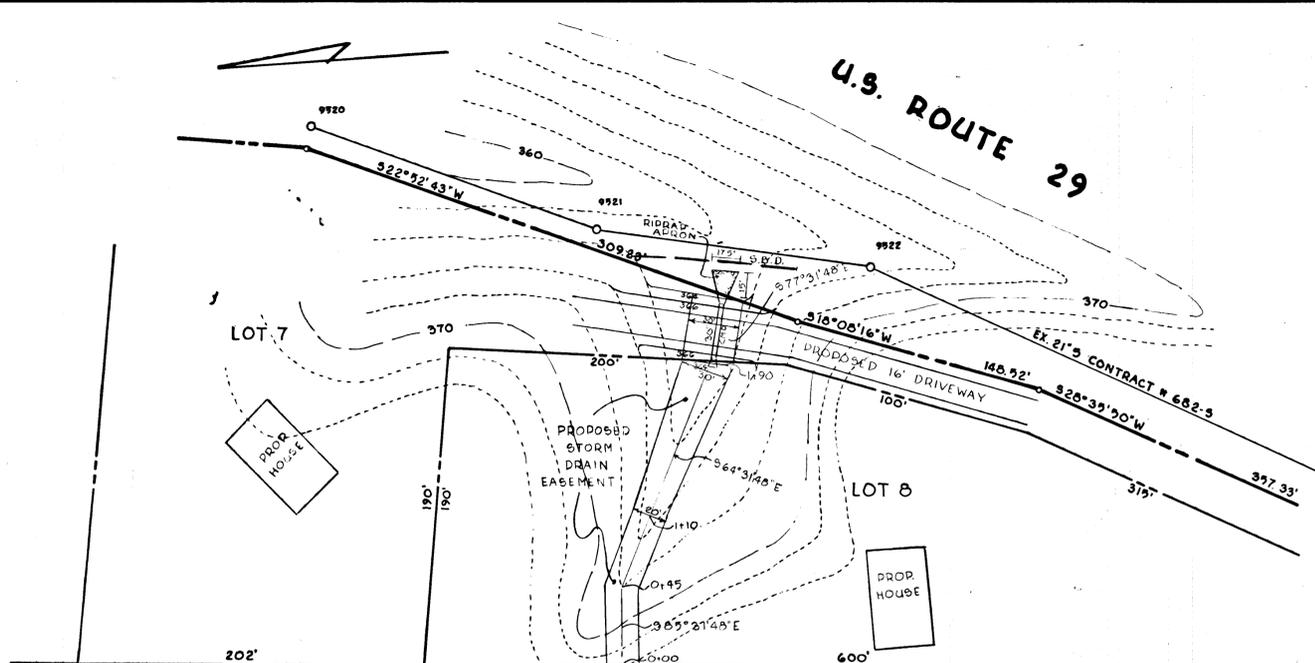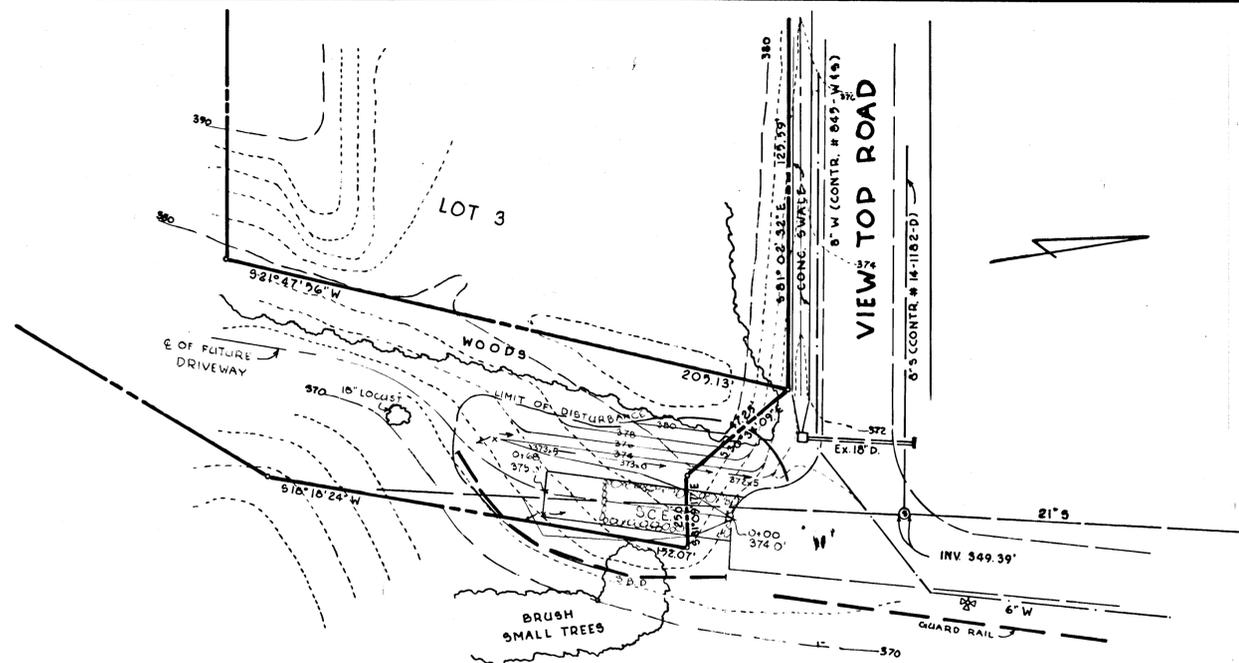


- CONSTRUCTION SPECIFICATIONS**
- Stone Size - 1/2" to 2" stone, or reclaimed or recycled concrete equivalent.
 - Length - As required, but not less than 50 feet (except on a simple residence lot where a 30 foot minimum length would apply).
 - Thickness - Not less than six (6) inches.
 - Width - Ten (10) foot minimum, but not less than the full width at points where impinge or egress occurs.
 - Filter Cloth - Will be placed over the entire area prior to placing of stone. Filter will not be required on a single family residence lot.
 - Surface Water - All surface water flowing or diverted toward construction entrances shall be piped across the entrance. If piping is impractical, a mountable berm with six (6) inches will be permitted.
 - Maintenance - The entrance shall be maintained in a condition which will prevent tracking or flowing of sediment onto public rights-of-way. This may require periodic top dressing with additional stone as conditions demand and repair and/or cleanout of any measures used to trap sediment. All sediment spilled, dropped, washed or tracked onto public rights-of-way must be removed immediately.
 - Washing - Wheels shall be cleaned to remove sediment prior to entrance onto public rights-of-way. When washing is required, it shall be done on an area stabilized with stone and which drains into an approved sediment trapping device.
 - Periodic inspection and needed maintenance shall be provided after each rain.

LOT 6 VIEW TOP PLAT
 LOT 5 ESTATES 5872
 EX 10' STORM DRAIN EASEMENT
 EX 12' D

- CONSTRUCTION SEQUENCE**
- OBTAIN A GRADING PERMIT
 - NOTIFY THE HOWARD COUNTY BUREAU OF LICENSES, INSPECTIONS AND PERMITS AND CONSTRUCTION INSPECTION/SURVEYS DIVISION 24 HOURS PRIOR TO GRADING PROCEDURES.
 - INSTALL TEMPORARY SEDIMENT CONTROL MEASURES (S.C.E. & E.C.)
 - PERFORM ON SITE CONSTRUCTION
 - STABILIZE ALL DISTURBED AREAS WITH PERMANENT STABILIZATION MEASURES.
 - REMOVE TEMPORARY STABILIZATION MEASURES WITH APPROVAL OF THE HOWARD COUNTY BUREAU OF LICENSES, INSPECTIONS AND PERMITS

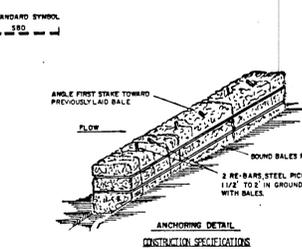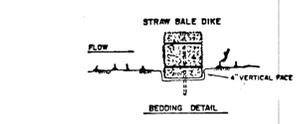

- CONSTRUCTION SPECIFICATIONS**
- Bales shall be placed at the toe of a slope or on the contour and in a row with ends tightly abutting the adjacent bales.
 - Each bale shall be embedded in the soil a minimum of (4) inches, and placed so the binding are horizontal.
 - Bales shall be securely anchored in place by either two stakes or re-bars driven through the bale. The first stake in each bale shall be driven toward the previously laid bale at an angle to force the bales together. Stakes shall be driven flush with the bale.
 - Inspection shall be provided and repair replacement shall be made promptly as needed.
 - Bales shall be removed when they have served their usefulness so as not to block or impede storm flow or drainage.

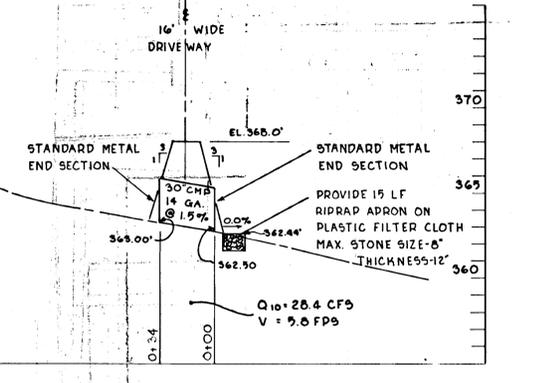

REVIEWED FOR HOWARD S.C.D. AND MEETS TECHNICAL REQUIREMENTS.
 Stephen M. Nelson 3-11-86
 U.S. SOIL CONSERVATION SERVICE DATE



DEVELOPER'S CERTIFICATE
 I CERTIFY THAT ALL DEVELOPMENT AND CONSTRUCTION WILL BE DONE ACCORDING TO THIS PLAN OF DEVELOPMENT AND PLAN FOR EROSION AND SEDIMENT CONTROL AND THAT ALL RESPONSIBLE PERSONNEL INVOLVED IN THE CONSTRUCTION PROJECT WILL HAVE A CERTIFICATE OF ATTENDANCE AT A DEPARTMENT OF NATURAL RESOURCES APPROVED TRAINING PROGRAM FOR THE CONTROL OF SEDIMENT AND EROSION BEFORE BEGINNING THE PROJECT. I ALSO AUTHORIZE PERIODIC ON-SITE INSPECTIONS BY THE HOWARD SOIL CONSERVATION DISTRICT OR THEIR AUTHORIZED AGENTS, AS ARE DEEMED NECESSARY.
 Stephen M. Nelson 3/10/86
 DEVELOPER DATE

PERMANENT SEEDING NOTES
 Apply to graded or cleared areas not subject to immediate further disturbance where a permanent long-lived vegetative cover is needed.
 Seedbed Preparation: Loosen upper three inches of soil by raking, disking or other acceptable means before seeding.
 Soil Amendments: In lieu of soil test recommendations, use one of the following schedules:
 1) Preferred - Apply 2 tons per acre dolomitic limestone (92 lbs/1000 sq ft) and 600 lbs per acre 10-10-10 fertilizer (14 lbs/1000 sq ft) before seeding. Narrow or disc into upper three inches of soil. At time of seeding, apply 100 lbs per acre 30-0-0 ureaform fertilizer (8 lbs/1000 sq ft).
 2) Acceptable - Apply 2 tons per acre dolomitic limestone (92 lbs/1000 sq ft) and 1000 lbs per acre 10-10-10 fertilizer (23 lbs/1000 sq ft) before seeding. Narrow or disc into upper three inches of soil.
 Seeding - For the periods March 1 thru April 30, and August 1 thru October 15, seed with 60 lbs per acre (14 lbs/1000 sq ft) of Kentucky 31 Tall Fescue. For the period May 1 thru July 31, seed with 60 lbs Kentucky 31 Tall Fescue per acre and 2 lbs per acre (.03 lbs/1000 sq ft) of weeping lovegrass. During the period of October 16 thru February 29, protect site by: Option (1) 2 tons per acre of well anchored straw mulch and seed as soon as possible in the spring. Option (2) Use seed. Option (3) Seed with 40 lbs/acre Kentucky 31 Tall Fescue and mulch with 2 tons/acre well anchored straw.
 Mulching - Apply 1 1/2 to 2 tons per acre (70 to 90 lbs/1000 sq ft) of unrotted small grade straw immediately after seeding. Anchor mulch immediately after application using mulch anchoring tool or 2 1/2 gallons per acre (5 gal/1000 sq ft) of modified asphalt on flat areas. On slopes 8 feet or higher, use 348 gallons per acre (8 gal/1000 sq ft) for anchoring.
 Maintenance - Inspect all seeded areas and make needed repairs, replacements and reseedings.

SEDIMENT CONTROL NOTES
 1) A minimum of 24 hours notice must be given to the Howard County Office of Inspection and Permits prior to the start of any construction. (892-2637)
 2) All vegetative and structural practices are to be installed according to the provisions of this plan and are to be in conformance with the 1983 MARYLAND STANDARDS AND SPECIFICATIONS FOR SOIL EROSION AND SEDIMENT CONTROL.
 3) Following initial soil disturbance or redisturbance, permanent or temporary stabilization shall be completed within: a) 7 calendar days for all perimeter sediment control structures, dikes, perimeter slopes and all slopes greater than 3:1, b) 14 days as to all other disturbed or graded areas on the project site.
 4) All sediment traps/basins shown must be fenced and warning signs posted around their perimeter in accordance with Vol. 1, Chapter 12, of the HOWARD COUNTY DESIGN MANUAL, Storm Drainage.
 5) All disturbed areas must be stabilized within the time period specified above in accordance with the 1983 MARYLAND STANDARDS AND SPECIFICATIONS FOR SOIL EROSION AND SEDIMENT CONTROL for permanent seedings (Sec. 53) and (Sec. 54), temporary seedings (Sec. 50) and mulching (Sec. 52). Temporary stabilization with mulch alone can only be done when recommended seeding dates do not allow for proper germination and establishment of grasses.
 6) All sediment control structures are to remain in place and are to be maintained in operative condition until permission for their removal has been obtained from the Howard County Sediment Control Inspector.
 7) Site Analysis:
 Total Area of Site _____ Acres
 Area Disturbed _____ Acres
 Area to be seeded or paved _____ Acres
 Area to be vegetatively stabilized _____ Acres
 Total Cut _____ Cu. yds.
 Total Fill _____ Cu. yds.
 Office waste/borrow area location _____
 8) Any sediment control practice which is disturbed by grading activity for placement of utilities must be repaired on the same day of disturbance.
 9) Additional sediment controls must be provided, if deemed necessary by the Howard County SW sediment control Inspector.
 10) On all sites with disturbed areas in excess of 2 acres, approval of the inspection agency shall be requested upon completion of installation of perimeter erosion and sediment controls, but before proceeding with any other earth disturbance or grading. Other building or grading inspection approvals may not be authorized until this initial approval by the inspection agency is made.




ROAD	CULVERT
3700 S.F.	1100 S.F.
2200 S.F.	1400 S.F.
800 S.F.	200 S.F.
0 S.F.	0 S.F.
0 S.F.	0 S.F.

APPROVED: DEPARTMENT OF PUBLIC WORKS
 Stephen M. Nelson 3-11-86
 CHIEF, BUREAU OF ENGINEERING DATE


APPROVED: OFFICE OF PLANNING & ZONING
 Stephen M. Nelson 3-11-86
 CHIEF, DIVISION OF LAND DEVELOPMENT & ZONING ADMINISTRATION DATE

ENGINEER'S CERTIFICATE
 I CERTIFY THAT THIS PLAN FOR EROSION AND SEDIMENT CONTROL REPRESENTS A PRACTICAL AND WORKABLE PLAN BASED ON PERSONAL KNOWLEDGE OF THE SITE CONDITIONS AND THAT IT WAS PREPARED IN ACCORDANCE WITH THE REQUIREMENTS OF THE HOWARD SOIL CONSERVATION DISTRICT.
 Walter F. Down 3-5-86
 ENGINEER DATE

TITLE: PLAN, PROFILES & DETAILS
 PRIVATE ROAD CONSTRUCTION PLAN
 PROJECT: VIEW TOP ESTATES, LOTS 5-8
 LOCATION: _____ ELECTION DISTRICT _____ HOWARD CO., MD.
 SCALE: NOTED DESIGNED BY: W.N. DRAWN BY: B.G. CHECKED BY: W.N. DATE: OCT 1985
 FIELD BOOK: _____ PAGE NO.: _____ JOB NO.: 77250 DRAWING NO.: _____
 boender associates inc. consulting engineers land surveyors land planners
 COURTHOUSE SQUARE 3585 ELLICOTT MILLS DRIVE ELLICOTT CITY, MD. 21043 (301) 465-7777

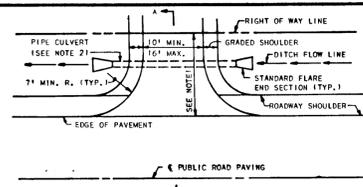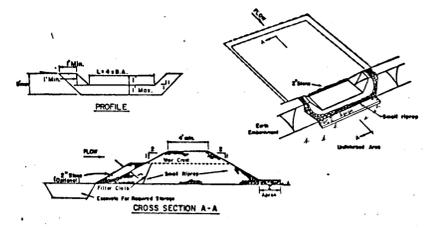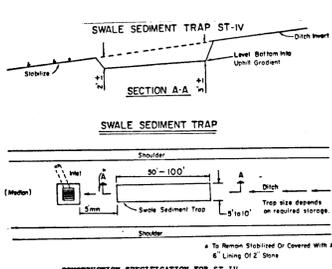

OPEN SECTION- DRIVEWAY ENTRANCE DETAIL

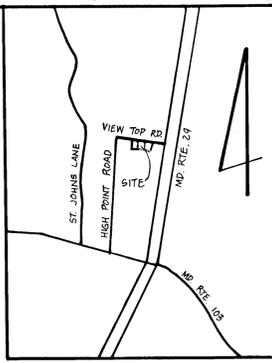


VICINITY MAP
SCALE: 1" = 1200'

- CONSTRUCTION SPECIFICATION FOR ST-IV**
- The swale sediment trap shall be constructed in accordance with the dimensions provided on the design drawings or sized to provide the minimum storage necessary 1800 cubic feet of storage for each acre of drainage area.
 - Sediment shall be removed and trap restored to its original dimensions when the sediment has accumulated to 1/2 the design depth of the trap. Removed sediment shall be deposited in a suitable area and in such a manner that it will not erode.
 - The structure shall be inspected after each rain and repairs made as needed.
 - Construction operations shall be carried out in such a manner that erosion and water pollution shall be minimized.
 - The sediment trap shall be removed and area stabilized when the contributory drainage area has been properly stabilized.
 - The swale sediment trap will be properly backfilled and the swale or ditch reconstructed.

- CONSTRUCTION SPECIFICATIONS FOR ST-3**
- Area under sediment shall be cleared, grubbed and stripped of any vegetation and rock. The soil shall be graded.
 - The fill material for the embankment shall be free of roots and other woody vegetation as well as oversized stones, rocks, organic material or other objectionable material. The embankment shall be compacted by straddling with equipment while it is being constructed.
 - All cut and fill slopes shall be 3:1 or flatter.
 - The stone used in the outlet shall be well-sorted 4"-8" along with a 1" thickness of 2" aggregate placed on the upstream side on the small slope 2:1 covered filter cloth in the trap.
 - The structure shall be removed and trap restored to its original dimensions when the sediment has accumulated to 1/2 the design depth of the trap.
 - The structure shall be inspected after each rain and repairs made as needed.
 - Construction operations shall be carried out in such a manner that erosion and water pollution is minimized.
 - The structure shall be removed and the area stabilized when the drainage area has been properly stabilized.

STONE OUTLET SEDIMENT TRAP

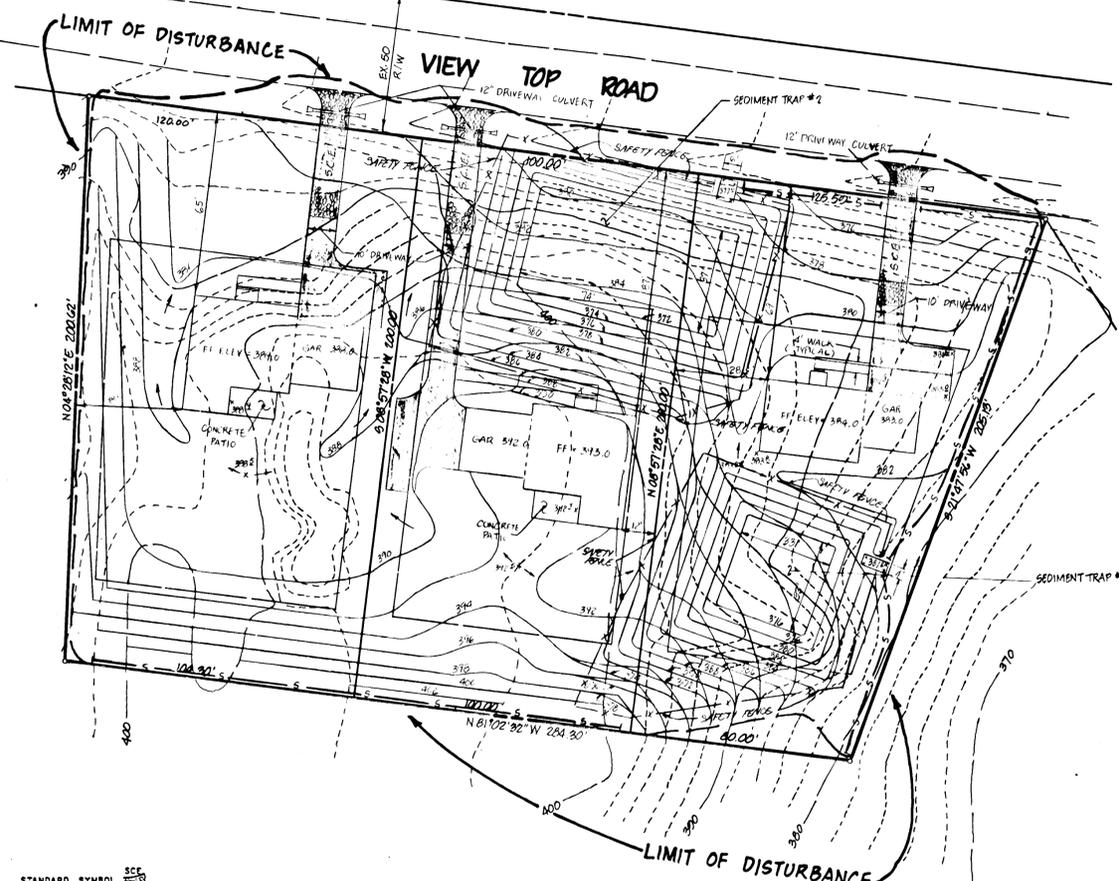

Apply to graded or cleared areas not subject to immediate further disturbance where a permanent long-lived vegetative cover is needed.

Soil Preparation: Loosen upper three inches of soil by raking, discing or other acceptable means before seeding.

Soil Amendments: In lieu of soil test recommendations, use one of the following schedules:

- Preferred - Apply 2 tons per acre dolomitic limestone (92 lbs/1000 square ft) and 400 lbs per acre 10-10-10 fertilizer (14 lbs/1000 sq ft) before seeding. Narrow or disc into upper three inches of soil. At time of seeding, apply 400 lbs per acre 30-0-0 urea-form fertilizer (9 lbs/1000 sq ft).
- Acceptable - Apply 2 tons per acre dolomitic limestone (92 lbs/1000 sq ft) and 1000 lbs per acre 10-10-10 fertilizer (13 lbs/1000 sq ft) before seeding. Narrow or disc into upper three inches of soil.

Seeding: For the periods March 1 thru April 30, and August 1 thru October 15, seed with 50 lbs per acre (1.4 lbs/1000 sq ft) of Kentucky 31 Tall Fescue. For the period May 1 thru July 31, seed with 40 lbs Kentucky 31 Tall Fescue per acre and 2 lbs per acre (0.05 lbs/1000 sq ft) of weeping lovegrass. During the period of October 15 thru February 28, protect site by: Option (1) 2 tons per acre of well-anchored straw mulch and seed as soon as possible in the spring. Option (2) Use seed. Option (3) Seed with 60 lbs/acre Kentucky 31 Tall Fescue and mulch with 2 tons/acre well-anchored straw.



Mulching: Apply 1/2 to 1 ton per acre (70 to 90 lbs/1000 sq ft) of untreated small grain straw immediately after seeding. Anchor mulch immediately after application using mulch anchoring tool or 2 1/2 gallons per acre (3 gal/1000 sq ft) of emulsified asphalt on flat areas. On slopes 2:1 or higher, use 3 1/2 gallons per acre (3 gal/1000 sq ft) for anchoring.

Maintenance: Inspect all seeded areas and make needed repairs, replacements and reseedings.

- A minimum of 24 hours notice must be given to the Howard County Office of Inspection and Permits prior to the start of any construction. (892-1417)
- All vegetative and structural practices are to be installed according to the provisions of this plan and are to be in accordance with the 1983 MARYLAND STANDARDS AND SPECIFICATIONS FOR SOIL EROSION AND SEDIMENT CONTROL.
- Following initial soil disturbance or redisturbance, permanent or temporary stabilization shall be completed within 7 calendar days for all perimeter sediment control structures, dikes, perimeter slopes and all slopes greater than 3:1. 14 days as to all other disturbed or graded areas on the project site.
- All sediment traps/basins shown must be fenced and warning signs posted around their perimeter in accordance with Vol. 1, Chapter 12, of the HOWARD COUNTY DESIGN MANUAL, Storm Drainage.
- All disturbed areas must be stabilized within the time period specified above in accordance with the 1983 MARYLAND STANDARDS AND SPECIFICATIONS FOR SOIL EROSION AND SEDIMENT CONTROL for permanent seeding (Sec. 53) and (Sec. 54), temporary seeding (Sec. 30) and mulching (Sec. 32). Temporary stabilization which is mulch alone can only be done when recommended seeding areas do not allow for proper germination and establishment of grasses.
- All sediment control structures are to remain in place and are to be maintained in operative condition until permission for their removal has been obtained from the Howard County Sediment Control Inspector.
- Site Analysis:
Total Area of Site: 1.446 Acres
Area to be seeded or graded: 0.260 Acres
Area to be vegetatively stabilized: 2.64 Acres
Total Cut: 15,520 Cu. Yds.
Off-site waste/borrow area location
- Any sediment control practice which is disturbed by erosion activity for placement of utilities must be repaired on the same day of disturbance.
- Additional sediment controls must be provided, if deemed necessary by the Howard County DPW sediment control inspector.
- On all sites with disturbed areas in excess of 3 acres, approval of the inspection agency shall be requested upon completion of installation of perimeter erosion and sediment controls, but before proceeding with any other earth disturbance or grading. Other building or grading inspection approvals may not be authorized until this initial approval by the inspection agency is made.


PERMANENT SEEDING NOTES

SEDIMENT CONTROL NOTES

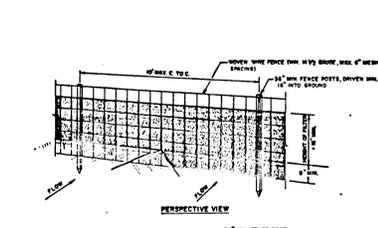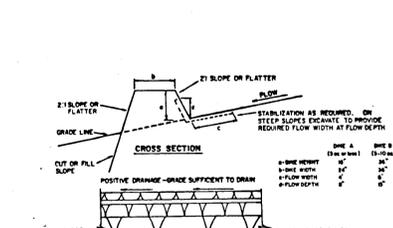

- All dikes shall be compacted by earth-moving equipment.
- All dikes shall have positive drainage to an outlet.
- Top width may be wider and side slopes may be flatter if designed to facilitate crossing by construction traffic.
- Outlet location should be located as needed to utilize a stabilized safe outlet.
- Earth dikes shall have an outlet that functions with a minimum of erosion. Filter cloth shall be covered to a sediment trapping device such as a sediment trap or sediment basin where either the dike channel or the drainage area above the dike are not successfully stabilized.
- Stabilization shall be in accordance with standard specifications for seed and straw mulch or straw mulch if not in seeding season. 50% flow channel, as per the chart below.

- CONSTRUCTION NOTES FOR STABILIZED SILT FENCE**
- MONUMENT BEAMS TO BE FASTENED SECURELY TO FENCE POSTS WITH WIRE TIES OR STAPLES.
 - FILTER CLOTH TO BE FASTENED SECURELY TO MONUMENT BEAMS WITH TIES SPACED EVERY 2' AT TOP AND MID SECTION.
 - MONUMENT SECTIONS OF FILTER CLOTH ALONG EACH OVER THE BEAM SHALL BE OVERLAPPED BY SIX INCHES AND FOLDED.
 - MAINTENANCE SHALL BE PROVIDED AS BEING AND MATERIAL PROVIDED WHEN RAISES DEVELOP IN THE SILT FENCE.

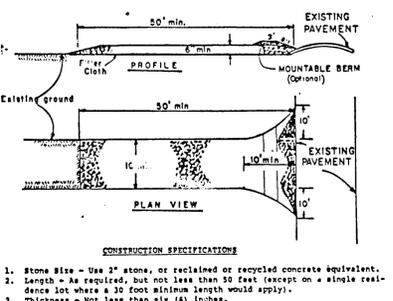

STABILIZED CONSTRUCTION ENTRANCE

SEDIMENT TRAP SCHEDULE

TYPE OF TRAP	TRAP NO.	AREA (AC.)	VOLUME (CF)	BOTTOM SIZE	DEPTH	BOTTOM ELEV.	SPILLWAY ELEV.	C.O. ELEV.	
STONE OUTLET	1	0.58	5339	6820	33" x 33"	4'	376.0	381.0	378.0
STONE OUTLET	2	1.42	16101	19920	57" x 74"	5'	372.0	377.0	374.5

EARTH DIKE

SILT FENCE

REVIEWED FOR HOWARD S.C.D. AND MEETS TECHNICAL REQUIREMENTS.

[Signature] 11-17-86
U.S. SOIL CONSERVATION SERVICE DATE

THIS DEVELOPMENT IS APPROVED SOIL EROSION AND SEDIMENT CONTROL BY THE HOWARD SOIL CONSERVATION DISTRICT.

[Signature] 11-17-86
SOIL CONSERVATION DISTRICT DATE

DEVELOPER'S CERTIFICATE

I CERTIFY THAT ALL DEVELOPMENT AND CONSTRUCTION WILL BE DONE ACCORDING TO THIS PLAN OF DEVELOPMENT AND PLAN FOR EROSION AND SEDIMENT CONTROL AND THAT ALL RESPONSIBLE PERSONNEL INVOLVED IN THE CONSTRUCTION PROJECT WILL HAVE A CERTIFICATE OF ATTENDANCE AT A DEPARTMENT OF NATURAL RESOURCES APPROVED TRAINING PROGRAM FOR THE CONTROL OF SEDIMENT AND EROSION BEFORE BEGINNING THE PROJECT.

AUTHORIZE PERIODIC ON-SITE INSPECTIONS BY THE HOWARD SOIL CONSERVATION DISTRICT OR THEIR AUTHORIZED AGENTS, AS ARE DEEMED NECESSARY.

DEVELOPER: *[Signature]* DATE: 8-3-86

ENGINEER'S CERTIFICATE

I CERTIFY THAT THIS PLAN FOR EROSION AND SEDIMENT CONTROL REPRESENTS A PRACTICAL AND WORKABLE PLAN BASED ON PERSONAL KNOWLEDGE OF THE SITE CONDITIONS AND THAT IT WAS PREPARED IN ACCORDANCE WITH THE REQUIREMENTS OF THE HOWARD SOIL CONSERVATION DISTRICT.

ENGINEER: *[Signature]* DATE: 8-3-86

GENERAL NOTES

- TAX MAP: 24 PARCEL: 308 LOTS 1, 2, 3
- TOPOGRAPHY SHOWN HEREON IS BASED ON A TOPOGRAPHIC SURVEY PREPARED BY BOENDER ASSOCIATES.
- PROPERTY SHOWN HEREON IS BASED ON A PLAT OF RECORD ENTITLED VIEW TOP ESTATES LOTS 1 THRU 4 AND RECORDED AT PLAT BOOK 5872.
- EX. ZONING: R-20

CONSTRUCTION SEQUENCE

- OBTAIN A GRADING PERMIT
- NOTIFY THE HOWARD COUNTY BUREAU OF LICENSES, INSPECTIONS AND PERMITS, AND THE CONSTRUCTION INSPECTION / SURVEYS DIVISION AT LEAST 24 HOURS PRIOR TO GRADING PROCEDURES.
- CLEAR AS NECESSARY TO INSTALL TEMPORARY SEDIMENT CONTROL DEVICES 2 DAYS
- INSTALL SILT FENCE, SEDIMENT TRAPS AND STABILIZED CONSTRUCTION ENTRANCES 1 DAY
- ROUGH GRADE SITE TEMPORARILY STABILIZE ALL STEEP SLOPES 2 WEEKS
- INSTALL EARTH DIKE 1 DAY
- CONSTRUCT UTILITIES. APPLY TEMPORARY STABILIZATION TO ALL AFFECTED AREAS 1 WEEK
- CONSTRUCT BUILDINGS 2 MONTHS
- STABILIZE ALL REMAINING DISTURBED WITH PERMANENT MEASURES 1 WEEK
- WITH APPROVAL OF THE HOWARD COUNTY BUREAU OF LICENSES, INSPECTIONS AND PERMITS, REMOVE ALL TEMPORARY SEDIMENT CONTROL DEVICES 2 DAYS
- APPLY PERMANENT STABILIZATION TO ANY REMAINING DISTURBED AREAS 1 WEEK

DEPARTMENT OF PUBLIC WORKS
HOWARD COUNTY, MARYLAND

[Signature] 12-4-86
DIRECTOR OF PUBLIC WORKS DATE

[Signature] 11-19-86
CHIEF, BUREAU OF ENGINEERING DATE

[Signature] 11-19-86
CHIEF, LAND DEVELOPMENT DIV. DATE

OWNER / DEVELOPER

KNECHT ENTERPRISES
9050 FREDERICK ROAD
ELLICOTT CITY, MD 21043

TITLE: GRADING AND SEDIMENT CONTROL AND TEMPORARY S.W.M. PLAN

PROJECT: VIEW TOP ESTATES - LOTS 1 THRU 3

LOCATION: 2 ND ELECTION DISTRICT TAX MAP: 24 HOWARD COUNTY, MARYLAND

DATE: FEB. 1986 SCALE: 1" = 30' DESIGN BY: J.T.N. DRAWN BY: D.M.P./J.J.B. CHECKED BY: 1 OF 1 DRAWING NO. JOB NO. 86232

boender associates engineers/surveyors/planners
3565 - A COURT SQUARE
ELLICOTT CITY, MARYLAND 21043
301-465-7777

