
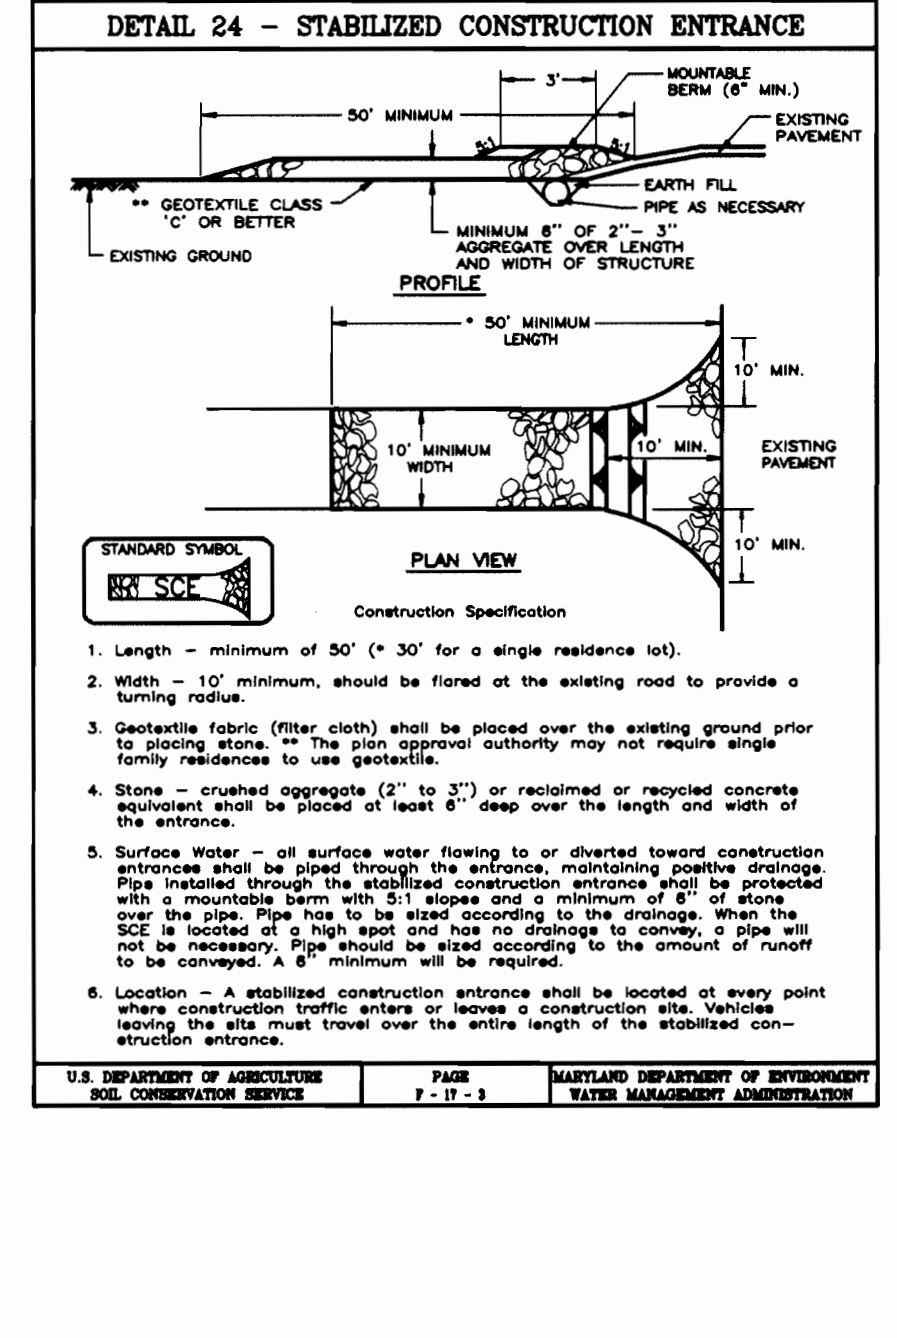
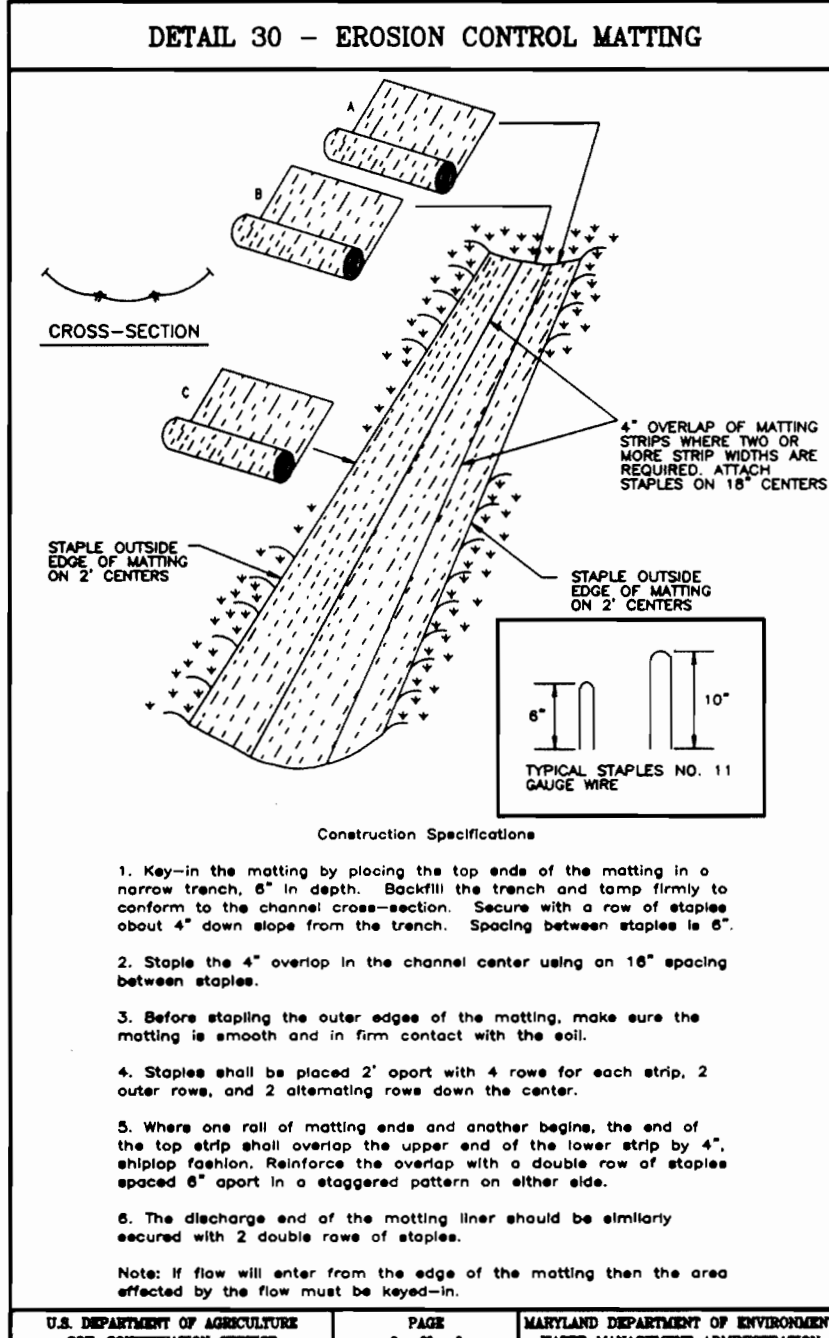
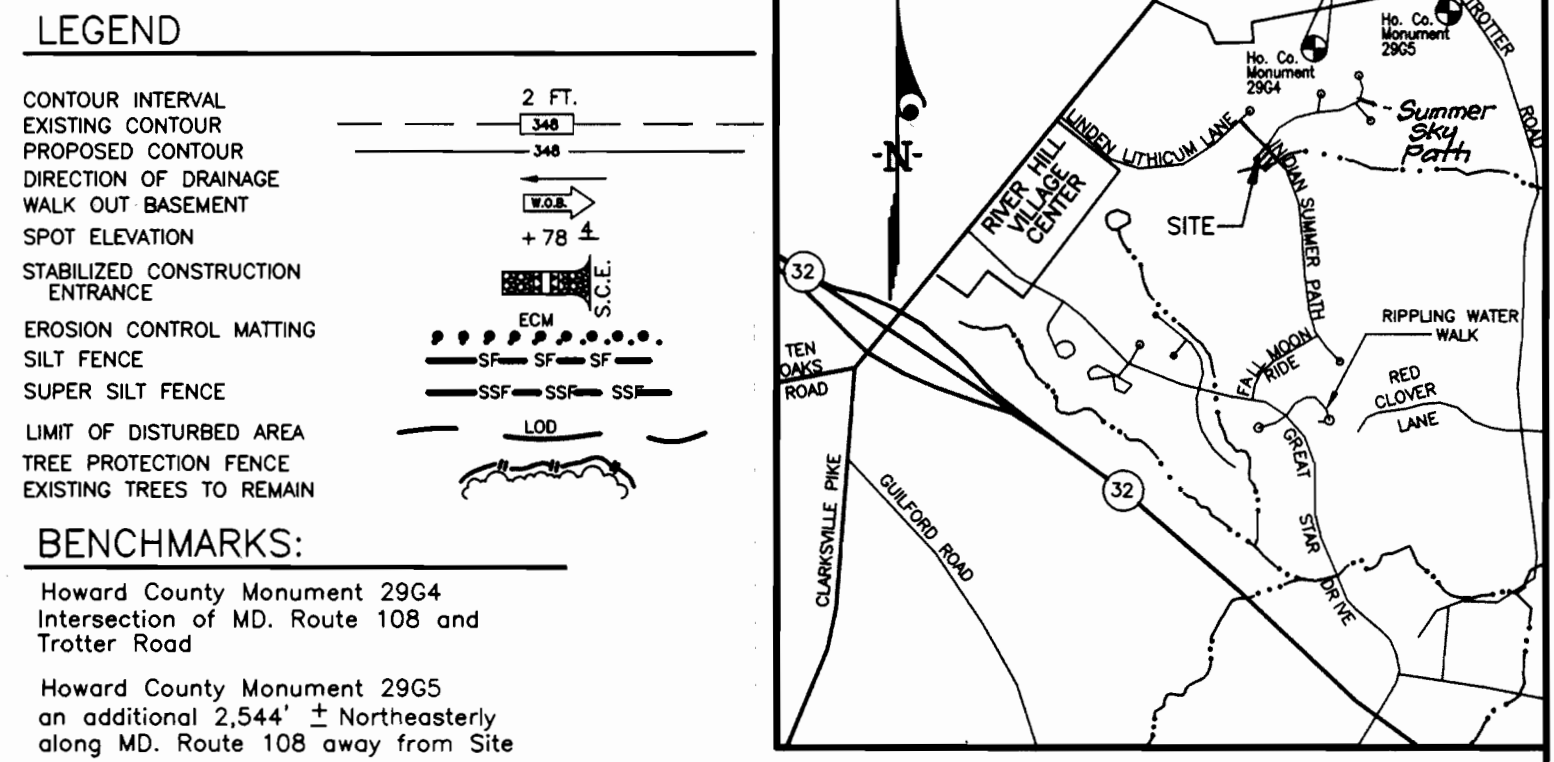


Revisions

No.	Revisions	Date
1	Rev. hse & grd. lot 69, from Gen. Box to T (Rev.) hse.	3-8-01
2	Rev. hse & grd. lot 70, from Gen. Box to Y hse	3-8-01
3	Rev. hse & grd. lot 71, from Gen. Box to T hse	3-8-01

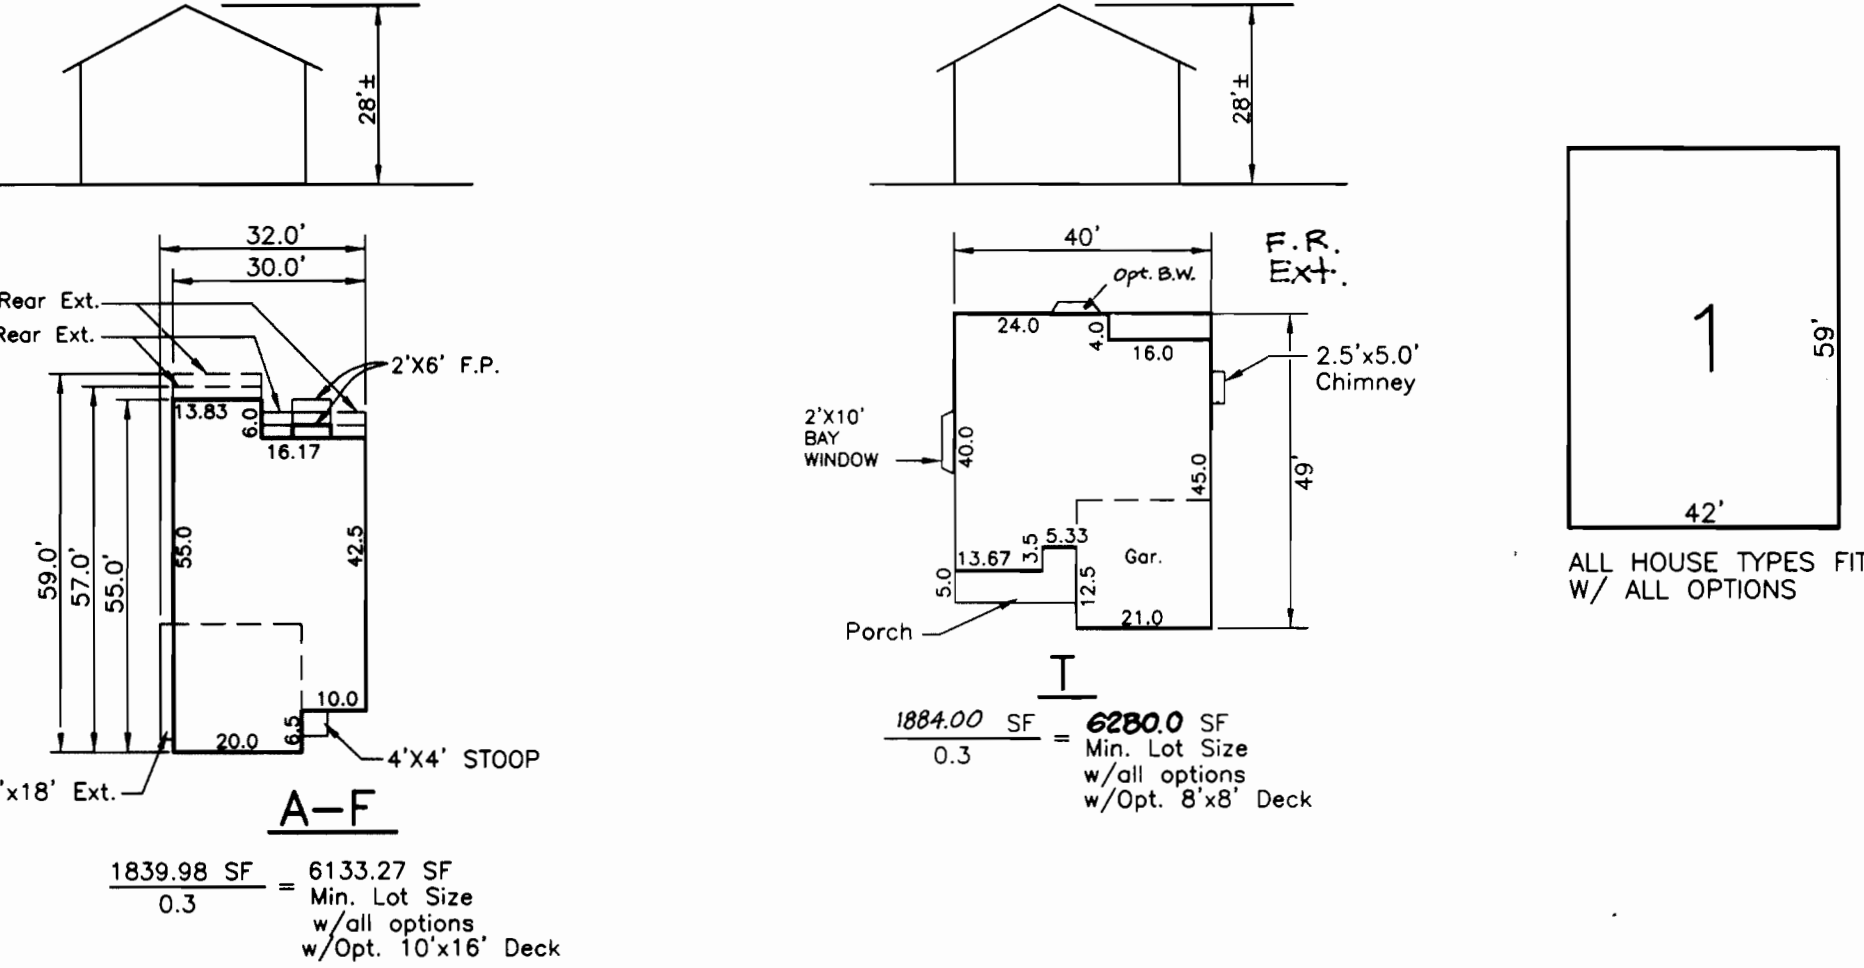

2.1.0 STANDARDS AND SPECIFICATIONS

FOR TOPSOIL

Definition: Topsoil is a soil profile that has been removed from a site and stored in a pile or stockpile for later use.

Source: Topsoil shall be obtained from a source that is approved by the local health department and shall be free of any contaminants, including but not limited to, heavy metals, pesticides, and other toxic substances.

Conditions Where Practices Apply:

- The topsoil to be used shall have a minimum of 4" of topsoil over the subgrade.
- The topsoil shall be free of any contaminants, including but not limited to, heavy metals, pesticides, and other toxic substances.
- The topsoil shall be stored in a pile or stockpile that is protected from erosion and shall be covered with a tarp or other protective material.
- The topsoil shall be applied to the site in a manner that ensures uniform distribution and shall be compacted to a minimum thickness of 4".
- The topsoil shall be applied to the site in a manner that ensures uniform distribution and shall be compacted to a minimum thickness of 4".

Construction and Material Specifications:

- Topsoil removed from the existing site may be used provided that it meets the requirements of this section and is approved by the local health department.
- Topsoil shall be applied to the site in a manner that ensures uniform distribution and shall be compacted to a minimum thickness of 4".
- Topsoil shall be applied to the site in a manner that ensures uniform distribution and shall be compacted to a minimum thickness of 4".

PERMANENT SEEDING NOTES

APPLY TO GRADED OR CLEARED AREAS NOT SUBJECT TO IMMEDIATE FURTHER DISTURBANCE WHERE A PERMANENT LONG-LEIVED VEGETATIVE COVER IS NEEDED.

SEEDING PREPARATION: Loosen upper three inches of soil by raking, grading or other acceptable means before seeding, if not previously done.

SOIL AMENDMENTS: In lieu of soil test recommendations, use one of the following:

- Preferred - Apply 2 tons per acre organic fertilizer (93 lb/1000 sq ft) before seeding. Horser or disc into upper three inches of soil. At the time of seeding, apply 200 lbs per acre of 30-0-0 urea-formal fertilizer (9 lb/1000 sq ft).
- Acceptable - Apply 2 tons per acre organic fertilizer (93 lb/1000 sq ft) and apply 1000 lbs. per acre 10-10-10 fertilizer (23 lb/1000 sq ft) before seeding. Horser or disc into upper three inches of soil.

SEEDING: For the periods March 1 thru April 30 and August 1 thru October 31, use 1 1/2 to 2 tons per acre (70 to 90 lb/1000 sq ft) of uncoated small grain straw immediately after seeding. Another must immediately after application using machine anchoring tool or 210 gallons per acre (5 gal/1000 sq ft) of uncoated small grain straw. On slopes 1:1 and steeper, use 340 gallons per acre (8 gal/1000 sq ft) for anchoring.

MULCHING: Apply 1 1/2 to 2 tons per acre (70 to 90 lb/1000 sq ft) of uncoated small grain straw immediately after seeding. Another must immediately after application using machine anchoring tool or 210 gallons per acre (5 gal/1000 sq ft) of uncoated small grain straw. On slopes 1:1 and steeper, use 340 gallons per acre (8 gal/1000 sq ft) for anchoring.

MAINTENANCE: Seed needed areas and make needed repairs, replacements and reseedings.

SEEDING PREPARATION: Loosen upper three inches of soil by raking, grading or other acceptable means before seeding, if not previously done.

SOIL AMENDMENTS: Apply 900 lbs. per acre 10-10-10 fertilizer (4 lb/1000 sq ft).



SEEDING: For periods March 1 thru April 30 and from August 1 thru November 31, use 1 1/2 to 2 tons per acre (70 to 90 lb/1000 sq ft) of uncoated small grain straw immediately after seeding. Another must immediately after application using machine anchoring tool or 210 gallons per acre (5 gal/1000 sq ft) of uncoated small grain straw. On slopes 1:1 and steeper, use 340 gallons per acre (8 gal/1000 sq ft) for anchoring.

MULCHING: Apply 1 1/2 to 2 tons per acre (70 to 90 lb/1000 sq ft) of uncoated small grain straw immediately after seeding. Another must immediately after application using machine anchoring tool or 210 gallons per acre (5 gal/1000 sq ft) of uncoated small grain straw. On slopes 1:1 and steeper, use 340 gallons per acre (8 gal/1000 sq ft) for anchoring.

MAINTENANCE: Seed needed areas and make needed repairs, replacements and reseedings.

SEDIMENT AND EROSION CONTROL NOTES

- A minimum of 48 hours notice must be given to the Howard County Department of Inspection, Licenses and Permits, and the local health department prior to the start of any construction.
- All vegetation and structural protection are to be installed according to the provisions of the plan and are to be maintained until the construction is complete and the site is stabilized.
- Following initial soil disturbance or re-disturbance, permanent or temporary stabilization shall be installed within 72 hours. If a storm occurs, permanent slopes and all slopes greater than 3:1 shall be stabilized within 72 hours of the storm.
- All sediment traps/basins shall be located and working before any sediment is allowed to pass through them.
- All sediment control structures shall be installed within the time period specified above in accordance with the 1994 MARYLAND STANDARDS AND SPECIFICATIONS FOR SOIL EROSION AND SEDIMENT CONTROL. For permanent structures, and temporary structures, the contractor shall submit a plan for their proper operation and maintenance to the local health department.
- All sediment control structures are to remain in place and are to be inspected in separate condition and permitted to the local health department. If any structure is found to be in need of repair or replacement, the contractor shall be responsible for the cost of such repairs or replacement.
- SITE ANALYSIS:**
 - Total Area of Site: 0.42 Acres
 - Area Disturbed: 0.33 Acres
 - Area to be Re-seeded or Planted: 0.33 Acres
 - Area to be Vegetatively Stabilized: 0.33 Acres
 - Total Topsoil: 1200 Tons
 - Off-site Woody/Bornes Area Location: [Symbol]
- All sediment control structures shall be installed within the time period specified above in accordance with the 1994 MARYLAND STANDARDS AND SPECIFICATIONS FOR SOIL EROSION AND SEDIMENT CONTROL. For permanent structures, and temporary structures, the contractor shall submit a plan for their proper operation and maintenance to the local health department.
- All sediment control structures are to remain in place and are to be inspected in separate condition and permitted to the local health department. If any structure is found to be in need of repair or replacement, the contractor shall be responsible for the cost of such repairs or replacement.
- SITE ANALYSIS:**
 - Total Area of Site: 0.42 Acres
 - Area Disturbed: 0.33 Acres
 - Area to be Re-seeded or Planted: 0.33 Acres
 - Area to be Vegetatively Stabilized: 0.33 Acres
 - Total Topsoil: 1200 Tons
 - Off-site Woody/Bornes Area Location: [Symbol]
- All sediment control structures shall be installed within the time period specified above in accordance with the 1994 MARYLAND STANDARDS AND SPECIFICATIONS FOR SOIL EROSION AND SEDIMENT CONTROL. For permanent structures, and temporary structures, the contractor shall submit a plan for their proper operation and maintenance to the local health department.
- All sediment control structures are to remain in place and are to be inspected in separate condition and permitted to the local health department. If any structure is found to be in need of repair or replacement, the contractor shall be responsible for the cost of such repairs or replacement.

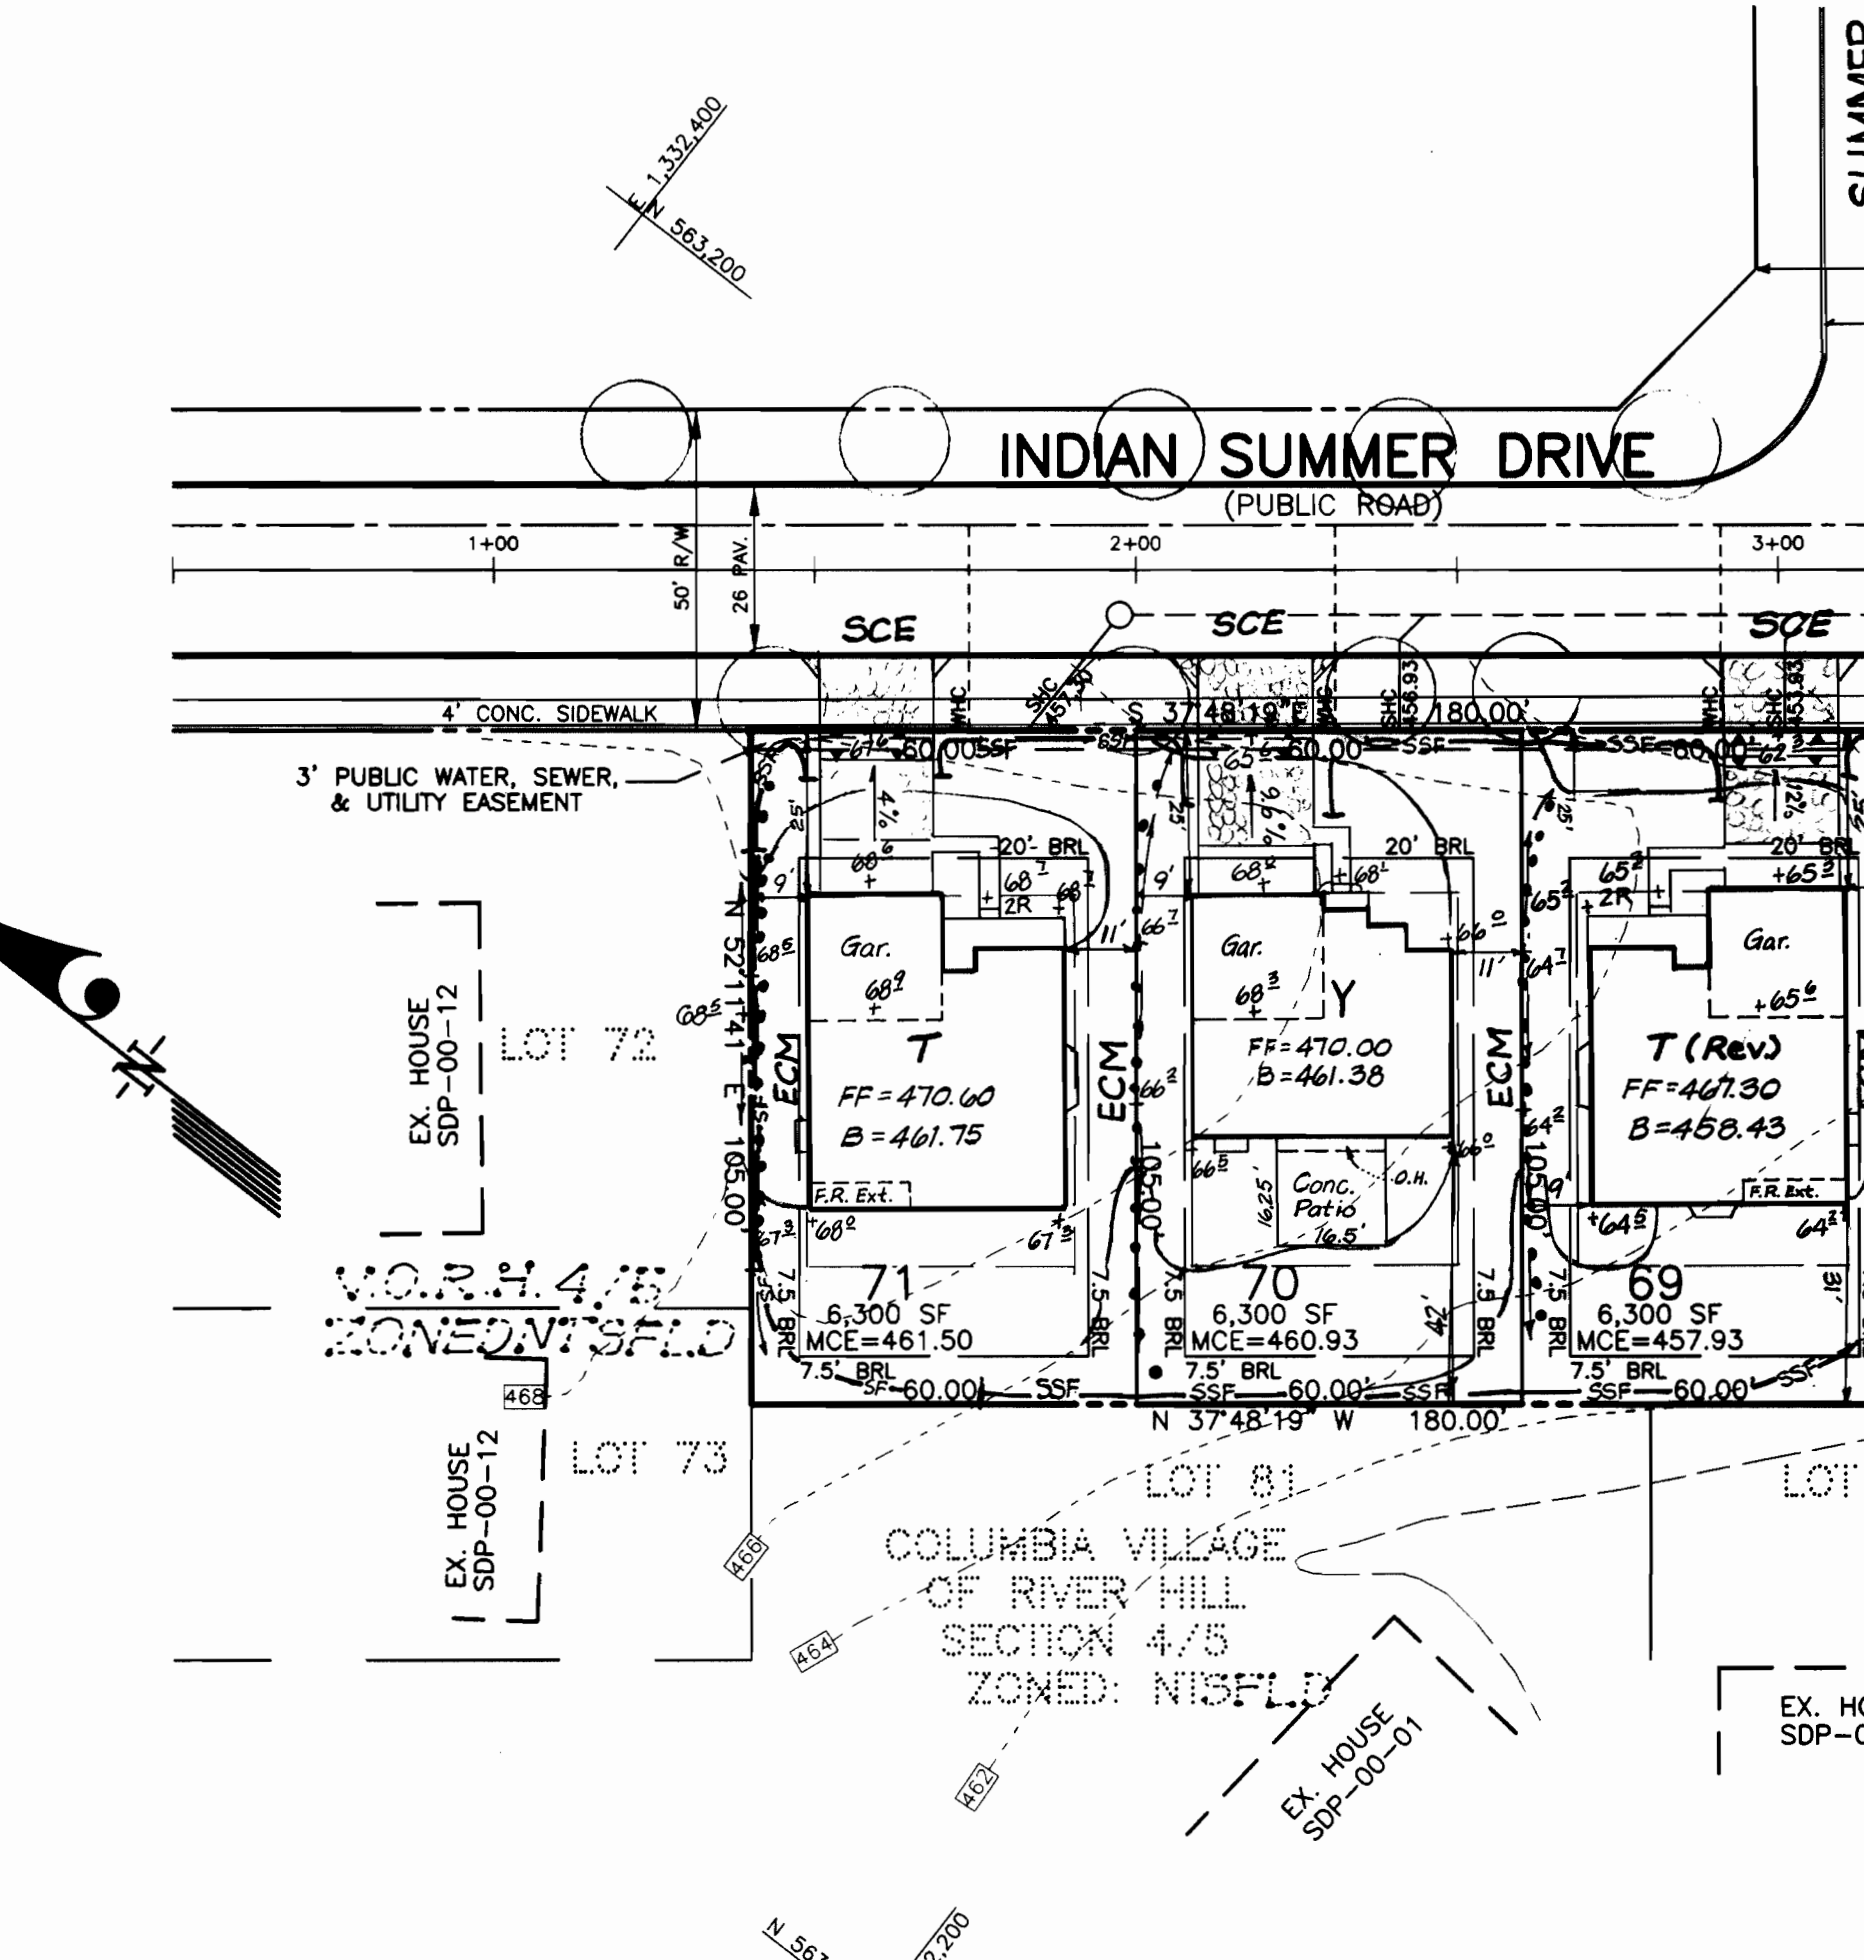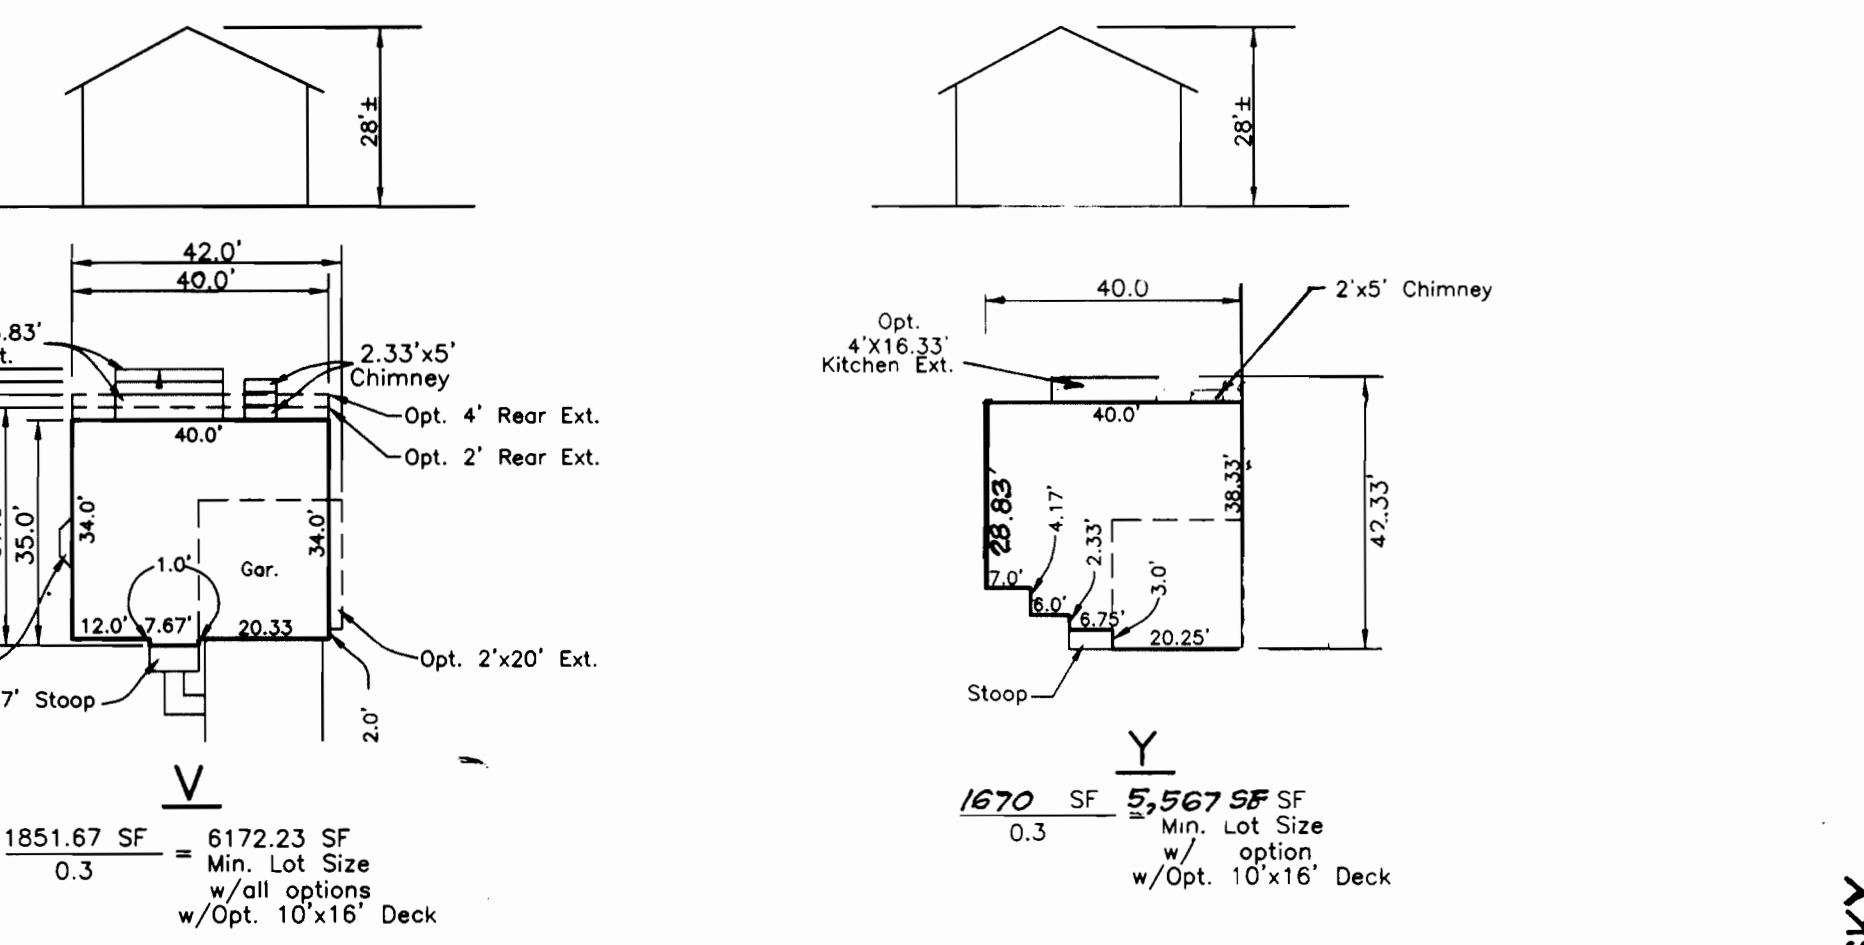

OWNER / DEVELOPER
THE HOWARD RESEARCH AND DEVELOPMENT CORP.
10275 LITTLE PAXTUXENT PARKWAY
COLUMBIA, MARYLAND 21044

SPECIAL NOTES:

This plan is for house siting and lot grading only. Improvements shown within the rights-of-way on this S.D.P. are not to be used for construction. For construction, see approved Road Construction Plans F-96-102 and/or approved Water and Sewer Plans Contract #34-3586-D.

SUBDIVISION NAME	SECTION/AREA	LOTS/PARCELS
VILLAGE OF RIVER HILL	4/5	69 - 71

PLAT NO.	BLOCK NO.	ZONE	TAX MAP NO.	ELECTION DIST.	CENSUS TRACT
12059	1	NTSFLD	35	5th	6055

WATER CODE	SEWER CODE
I-10	665.3000

CLARK · FINEFROCK & SACKETT, INC.
ENGINEERS · PLANNERS · SURVEYORS
7135 MINSTREL WAY · COLUMBIA, MD 21045 · (410) 381-7500 BALT. · (301) 621-8100 WASH.

DESIGNED	SITE DEVELOPMENT, SEDIMENT AND EROSION CONTROL PLAN	SCALE
BAL	LOTS 69 THRU 71	1" = 30'

DRAWN	COLUMBIA VILLAGE OF RIVER HILL	DRAWING
QWL	SECTION 4 AREA 5	1 of 1

CHECKED	FIFTH (5th) ELECTION DISTRICT	JOB NO.
BAL	HOWARD COUNTY, MARYLAND	99-005

DATE	FOR: GOODIER BUILDERS	FILE NO.
12-26-00	10705 CHARTER DRIVE, SUITE 320 COLUMBIA, MARYLAND 21044	99-005X

APPROVED: DEPARTMENT OF PLANNING & ZONING

[Signature] 3/23/01
DATE

[Signature] 3/26/01
DATE

[Signature] 3/30/01
DATE

Reviewed for HOWARD S.C.D.

[Signature] 3/21/01
DATE

[Signature] 3/21/01
DATE

THIS DEVELOPMENT PLAN IS APPROVED FOR EROSION AND SEDIMENT CONTROL BY THE COMMISSIONER OF THE NATURAL RESOURCES ADMINISTRATION.

[Signature] 3/21/01
DATE

DEVELOPER'S/BUILDER'S CERTIFICATE

I/We certify that all development and construction will be done according to this plan of development and plan for sediment and erosion control and that all responsible personnel involved in the construction project will have a Certificate of Attendance at a Department of the Environment Approved Training Program for the Control of Sediment and Erosion before beginning the project. I also authorize periodic on-site inspection by the Howard Soil Conservation District or their authorized agents, as are deemed necessary.

[Signature] 12/26/00
NAME DATE

ENGINEER'S CERTIFICATE

I hereby certify that this plan for Sediment and Erosion Control represents a practical and workable plan based on my personal knowledge of the site conditions and that it was prepared in accordance with the requirements of the Howard Soil Conservation District.



[Signature] 3-13-01
NAME DATE

G. NELSON CLARK
DATE


STATE OF MARYLAND
G. NELSON CLARK
3-13-01

(90)/Drawings/VORH4-5/GOODIER/LOTS69-71

SDP-01-20

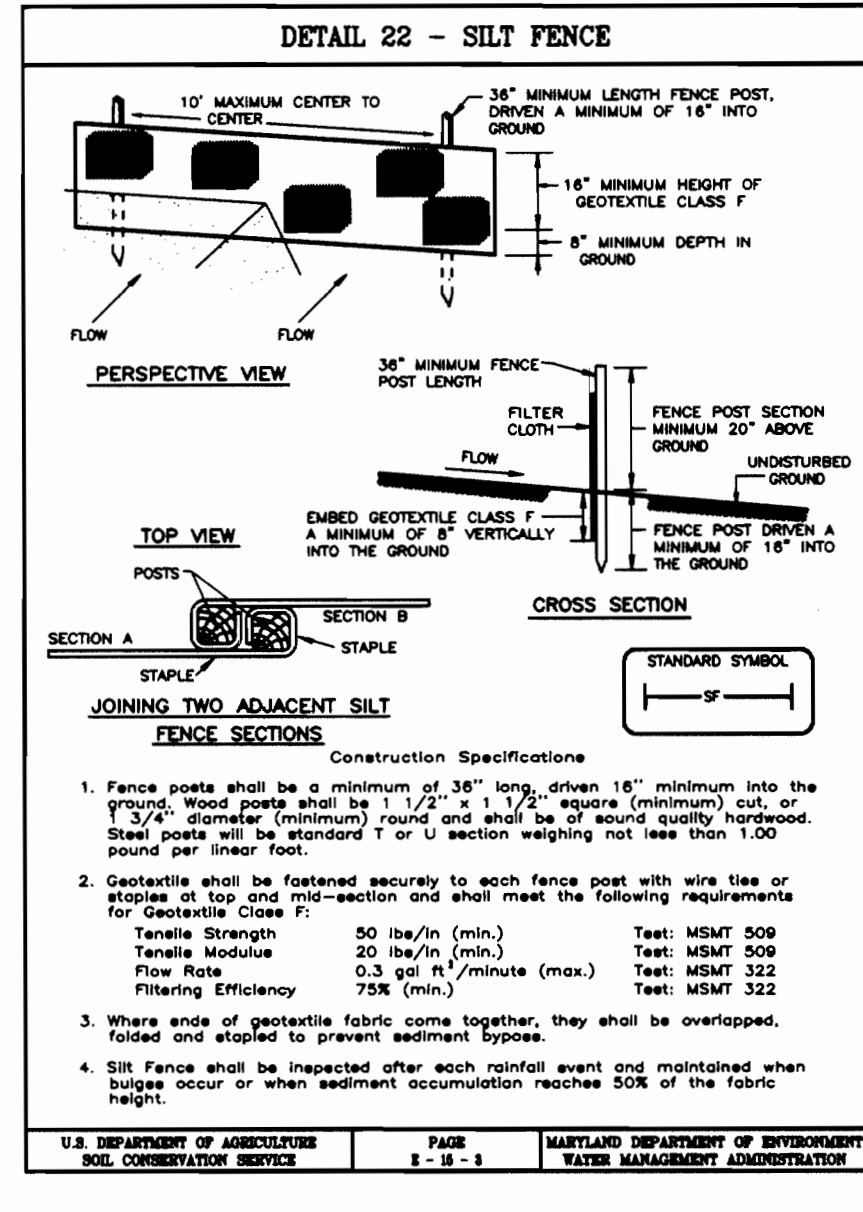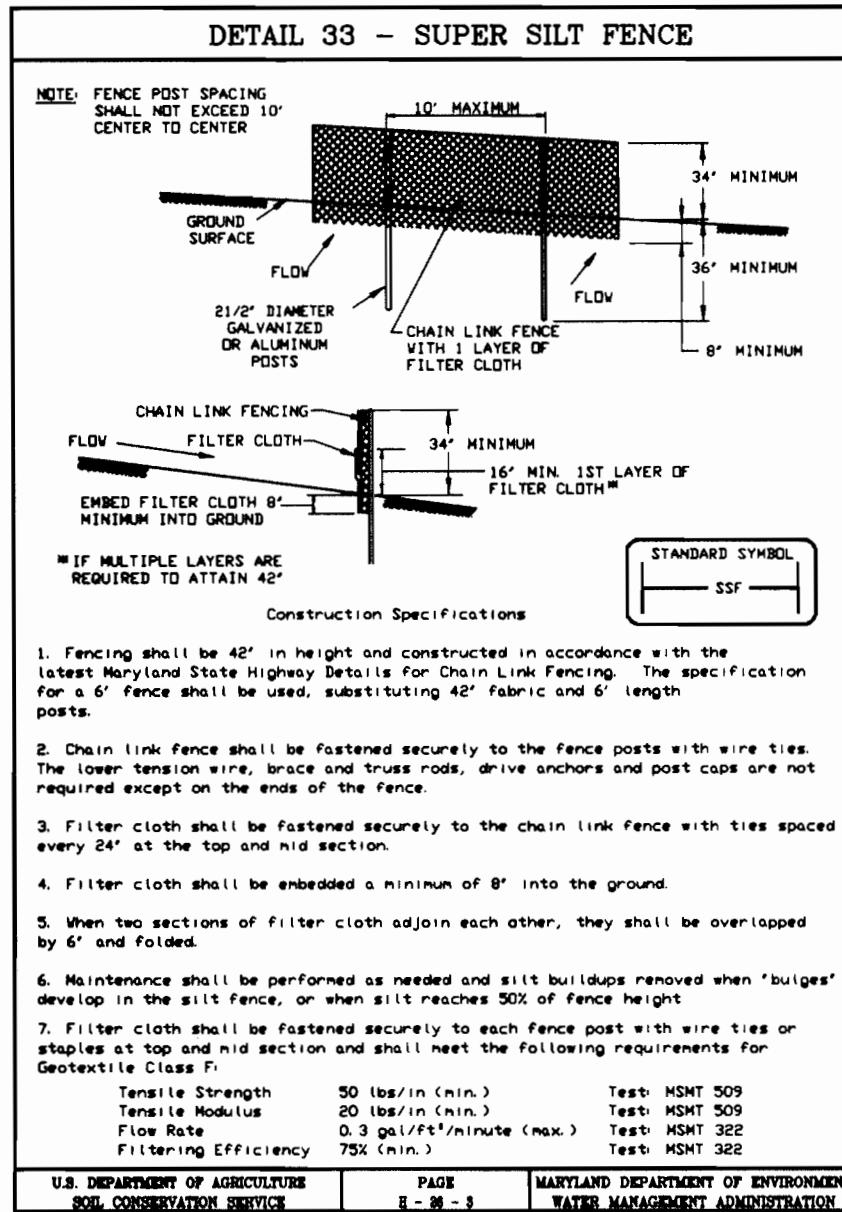

NO.	Revisions	Date
1	Rev hse & grd. lot 69. from Gen. Box to T (Rev) hse.	3-8-01
2	Rev hse & grd. lot 70. from Gen. Box to Y hse	3-8-01
3	Rev hse & grd. lot 71. from Gen. Box to T hse	3-8-01
4	Added 2' O.H. to Y hse typ. & Lot 70	4-18-01

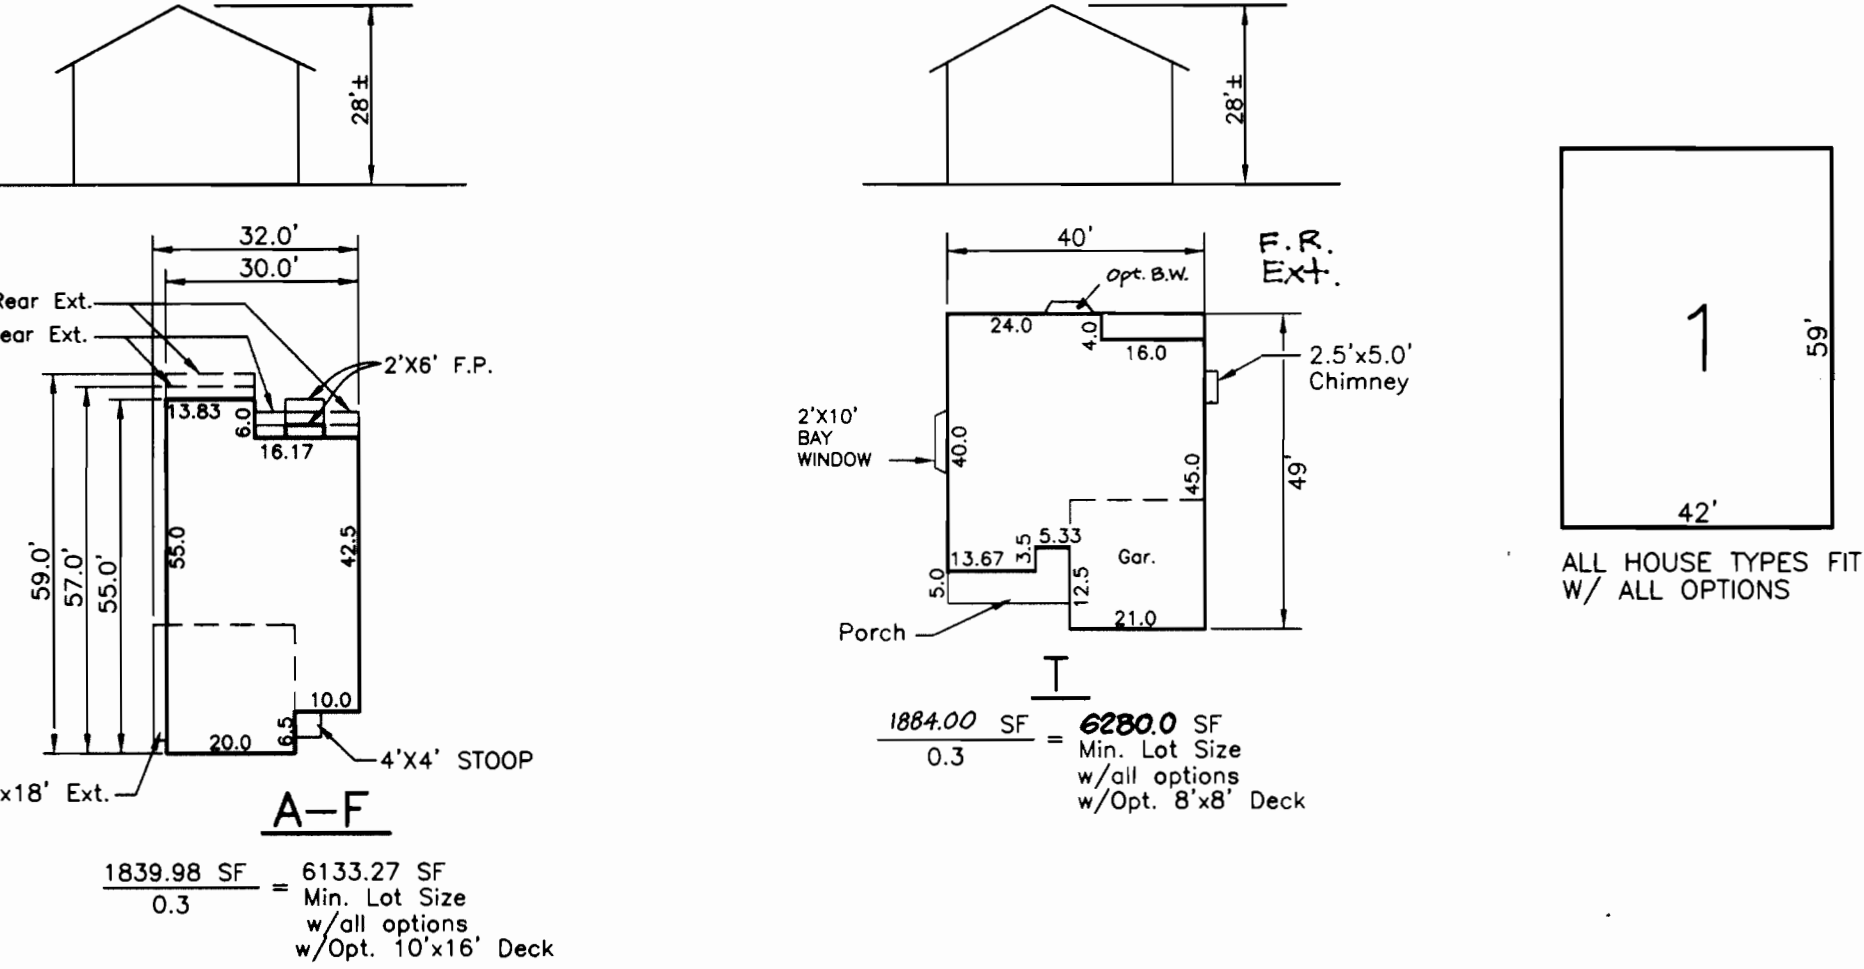

LEGEND

CONTOUR INTERVAL 2 FT.

EXISTING CONTOUR 132

PROPOSED CONTOUR 348

DIRECTION OF DRAINAGE

WALK OUT BASEMENT

SPOT ELEVATION +78.4

STABILIZED CONSTRUCTION ENTRANCE

EROSION CONTROL MATTING

SILT FENCE

SUPER SILT FENCE

LIMIT OF DISTURBED AREA





TREE PROTECTION FENCE

EXISTING TREES TO REMAIN

BENCHMARKS:

Howard County Monument 2964 Intersection of MD. Route 108 and Trotter Road

Howard County Monument 2965 an additional 2,544' ± Northeastly along MD. Route 108 away from Site

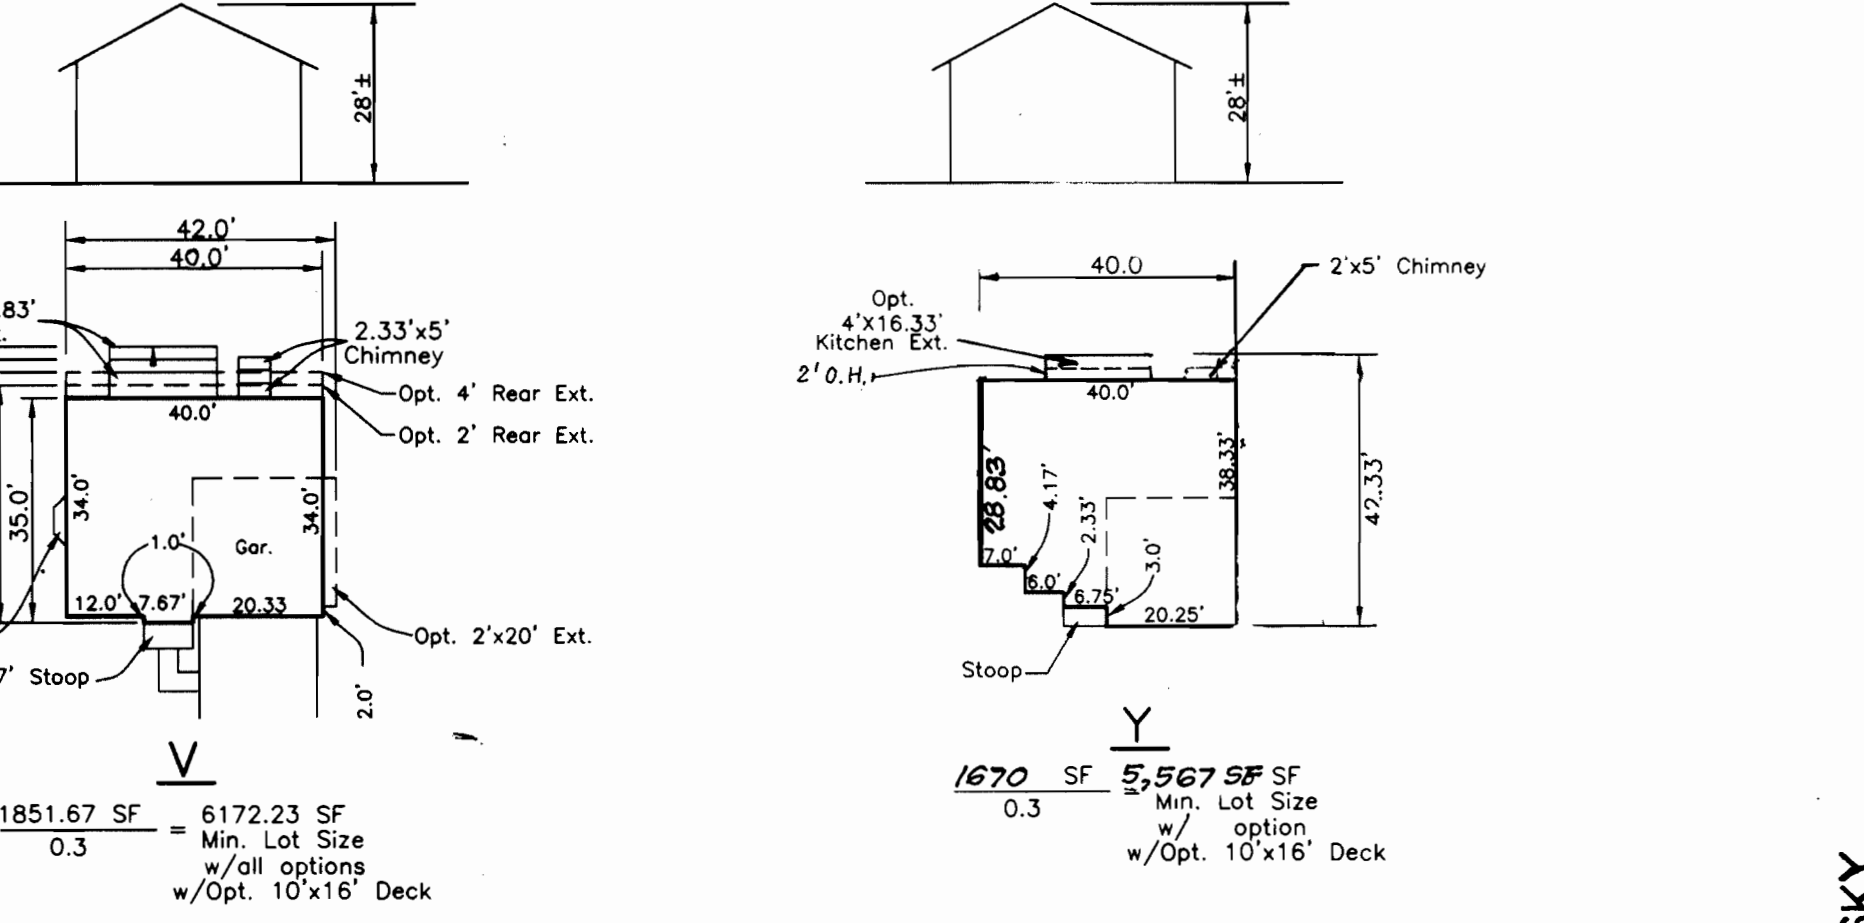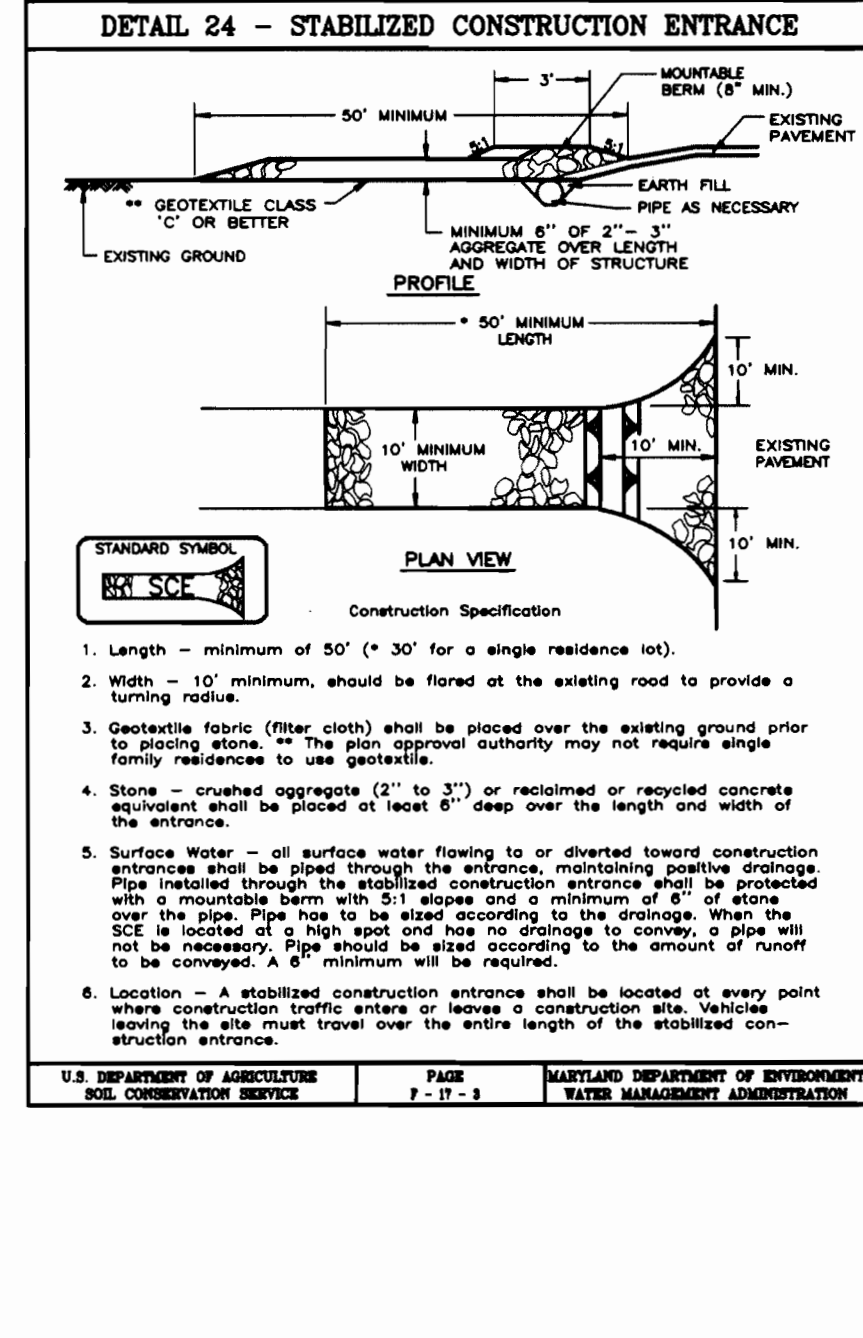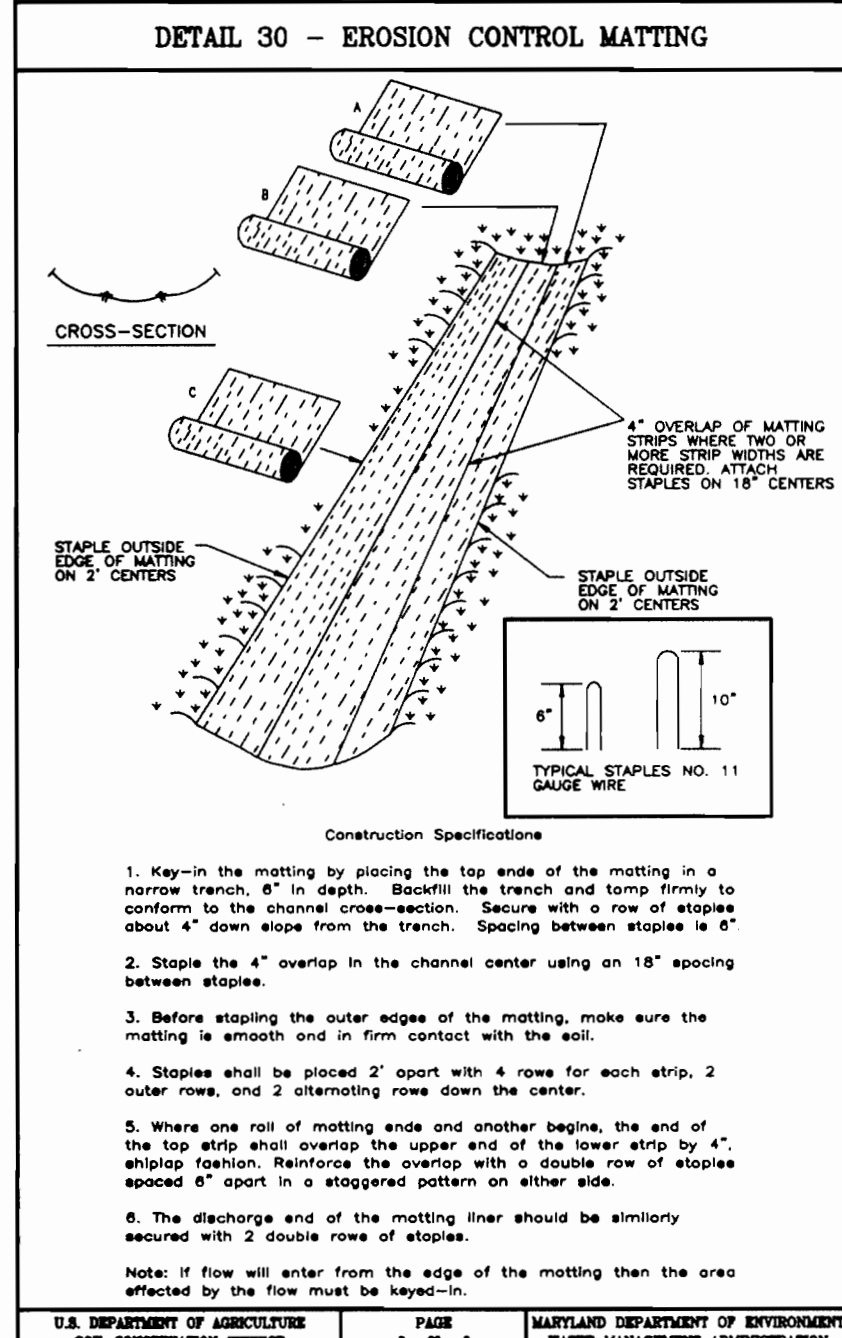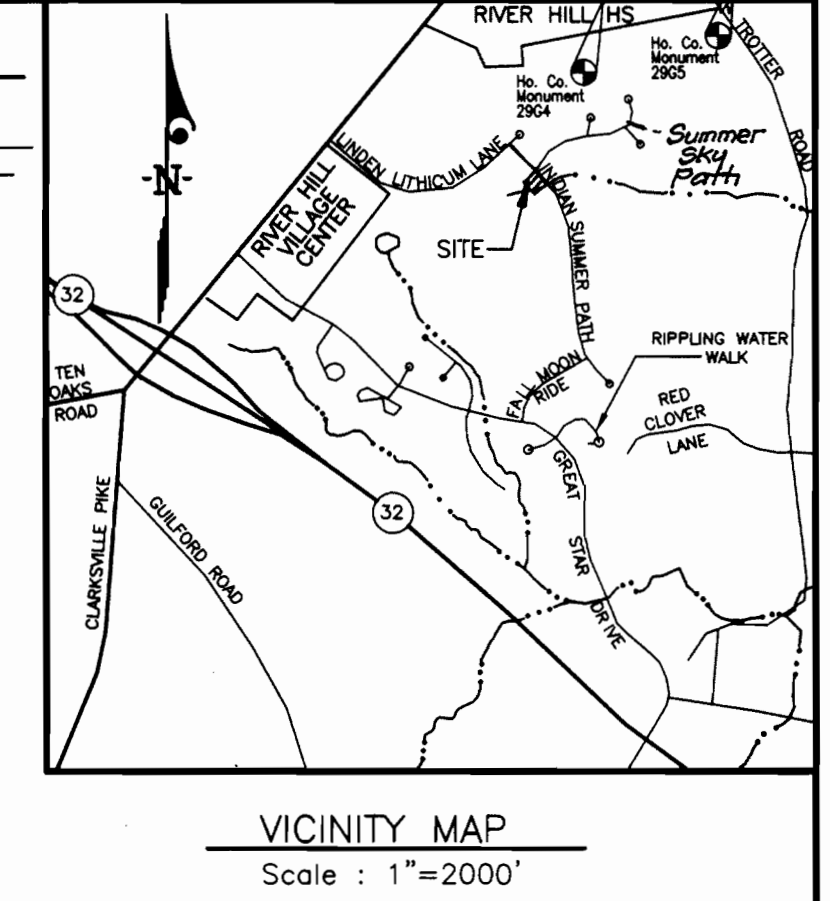

2.1.0 STANDARDS AND SPECIFICATIONS

FOR TOPSOIL

Definition: Placement of topsoil over a prepared subsoil prior to establishment of permanent vegetation.

Purpose: To provide a suitable and medium for vegetation growth. Subsoil of some form for moisture control, low nutrient level, and to provide a suitable medium for plant roots and soil microorganisms.

Conditions Where Practice Applies:

1. This practice is limited to areas having 21" or better slope where:
 - a. The texture of the exposed subsoil/parent material is not silty/clayey.
 - b. The soil material is an alluvial soil that is not subject to erosion and is suitable for the intended use.
 - c. The original soil to be vegetated contains sufficient nutrients to plant growth.
 - d. The soil is not so acidic that treatment with limestone is not feasible.
2. For the purposes of these Standards and Specifications, areas having slopes steeper than 2:1 require special construction and design for adequate stabilization. Areas having slopes steeper than 2:1 shall have the appropriate stabilization on the slope.

Construction and Material Specifications:

1. Topsoil subject from the existing site may be used provided that it meets the standards as set forth in these Standards and Specifications. Topsoil that is not subject to erosion and is suitable for the intended use shall be placed in the construction area. Topsoil that is not subject to erosion and is suitable for the intended use shall be placed in the construction area.
2. Topsoil Specifications - Soil to be used on topsoil must meet the following:
 - a. Topsoil must be free of plants or plant parts such as stems, roots, rhizomes, tubers, corms, or other plant parts.
 - b. Where the subsoil is either highly acidic or composed of heavy stone, topsoil should be spread at the rate of 4-8 tons/acre (200-400 pounds per 1,000 square feet) to be placed on topsoil. Lime shall be applied to a depth of 2-3 inches to neutralize the soil and to provide a suitable medium for plant growth.
 - c. For areas having disturbed areas under 5 acres:
 - i. Place topsoil (if required) and apply seed amendments as specified in 2.1.0 Vegetative Stabilization.
 - ii. Vegetative Stabilization Methods and Specifications.

PERMANENT SEEDING NOTES

APPLY TO GRADED OR CLEARED AREAS NOT SUBJECT TO IMMEDIATE FURTHER DISTURBANCE WHERE A PERMANENT LONG-LEIVED VEGETATIVE COVER IS NEEDED:

SEEDING PREPARATION: Loosen upper three inches of soil by raking, digging or other acceptable means before seeding. If not previously loosened, topsoil shall be placed on the area before seeding.

SOIL AMENDMENTS: In lieu of soil test recommendations, use one of the following schedules:

- 1) Preferred - Apply 2 tons per acre dolomitic limestone (92 lbs./1000 sq. ft.) and 800 lbs. per acre 10-10-10 fertilizer (14 lbs./1000 sq. ft.) before seeding. Horser or disc into upper three inches of soil. At the time of seeding, apply 1 lb. per acre 30-0-0 urea-form fertilizer (9 lbs./1000 sq. ft.).
- 2) Acceptable - Apply 2 tons per acre dolomitic limestone (92 lbs./1000 sq. ft.) and apply 1000 lbs. per acre 10-10-10 fertilizer (23 lbs./1000 sq. ft.) before seeding. Horser or disc into upper three inches of soil.

SEEDING: For the periods March 1 thru April 30, and August 1 thru October 15, seed with 90 lbs./acre (2.25 tons/acre) of seed. For the periods May 1 thru July 31, seed with 60 lbs./acre (1.5 tons/acre) of seed. For the periods October 16 thru February 28, protect site by applying 2 tons per acre well conditioned straw mulch and seed as soon as possible in the spring. Option (2) Use seed Option (3) Seed with 90 lbs/acre per acre of well conditioned straw mulch and seed as soon as possible in the spring, or use seed.

MULCHING: Apply 1 1/2 to 2 tons per acre (70 to 90 lbs./1000 sq. ft.) of unrotted straw straw immediately after seeding. Another mulch immediately after application using much conditioning loam or 2 lbs. per acre (4 lbs./1000 sq. ft.) of unrotted straw mulch on all areas 8 feet or higher, use 348 gallons per acre (8 gal./1000 sq. ft.) for mulching.

SOIL AMENDMENTS: Apply 800 lbs. per acre 10-10-10 fertilizer (14 lbs./1000 sq. ft.).

SEEDING: For the periods March 1 thru April 30, and August 1 thru November 15, seed with 1 1/2 tons/acre (37.5 lbs./1000 sq. ft.) of unrotted straw straw immediately after seeding. Another mulch immediately after application using much conditioning loam or 2 lbs. per acre (4 lbs./1000 sq. ft.) of unrotted straw mulch on all areas 8 feet or higher, use 348 gallons per acre (8 gal./1000 sq. ft.) for mulching.

MULCHING: Apply 1 1/2 to 2 tons per acre (70 to 90 lbs./1000 sq. ft.) of unrotted straw straw immediately after seeding. Another mulch immediately after application using much conditioning loam or 2 lbs. per acre (4 lbs./1000 sq. ft.) of unrotted straw mulch on all areas 8 feet or higher, use 348 gallons per acre (8 gal./1000 sq. ft.) for mulching.

REFER TO THE 1994 MARYLAND STANDARDS AND SPECIFICATIONS FOR SOIL EROSION AND SEDIMENT CONTROL FOR RATE AND METHODS NOT COVERED.


SEDIMENT AND EROSION CONTROL NOTES

1. A minimum of 48 hours notice must be given to the Howard County Department of Inspection, Licensing and Permits, Environmental Control Division prior to the start of any construction activity.
2. All vegetative and structural protection shall be installed according to the provisions of the plan and this specification. FOR SOIL EROSION AND SEDIMENT CONTROL, and reference thereto.
3. Temporary stabilization shall be completed within the following schedule:
 - a) 14 days on or after disturbance of any area greater than 1/4 acre.
 - b) 30 days on or after disturbance of any area greater than 1/2 acre.
 - c) 60 days on or after disturbance of any area greater than 1 acre.
4. All sediment traps/basins shall be located and silted and silted and silted around the perimeter of construction with 1/2" diameter 7' of the Howard County Department of Inspection, Licensing and Permits.
5. All sediment control structures are to remain in place and are to be maintained in operative condition and permission for their removal has been obtained from the Howard County Department of Inspection, Licensing and Permits.
6. All sediment control structures are to remain in place and are to be maintained in operative condition and permission for their removal has been obtained from the Howard County Department of Inspection, Licensing and Permits.
7. SITE ANALYSIS:

Total Area of Site:	643 Acres
Area Disturbed:	2.8 Acres
Area to be seeded or planted:	2.8 Acres
Area to be vegetatively stabilized:	3.3 Acres
Total:	6.1 Acres
8. An additional control practice which is determined by grading agency for placement of utilities must be reported on the same plan.
9. Additional sediment control must be provided, if deemed necessary, to prevent erosion during the construction project.
10. On all sites with disturbed areas in excess of 2 acres, approval of installation of perimeter control and sediment control, but before proceeding with any construction activity, the grading agency shall submit a plan for the installation of perimeter control and sediment control to the Howard County Department of Inspection, Licensing and Permits.
11. Temporary for the construction of utilities shall be located and stabilized within one working day, or to be limited to three plus lengths.
12. The total amount of silt fence = 170 LF
13. The total amount of silt fence = 348 LF
14. It is the responsibility of the contractor to identify the sediment control inspector of the site and it is the grading permit number at the time of construction.

CONSTRUCTION SEQUENCE:

1. Obtain grading permit.
2. Install sediment control.
3. Install sediment control and erosion control devices and stabilize.
4. Complete for foundations, rough grade and temporary stabilization.
5. Final grade, install Erosion Control Matting and stabilize in accordance with specifications.
6. Upon approval of the sediment control inspector, remove sediment control devices and stabilize.
7. Delay construction of houses on lots.

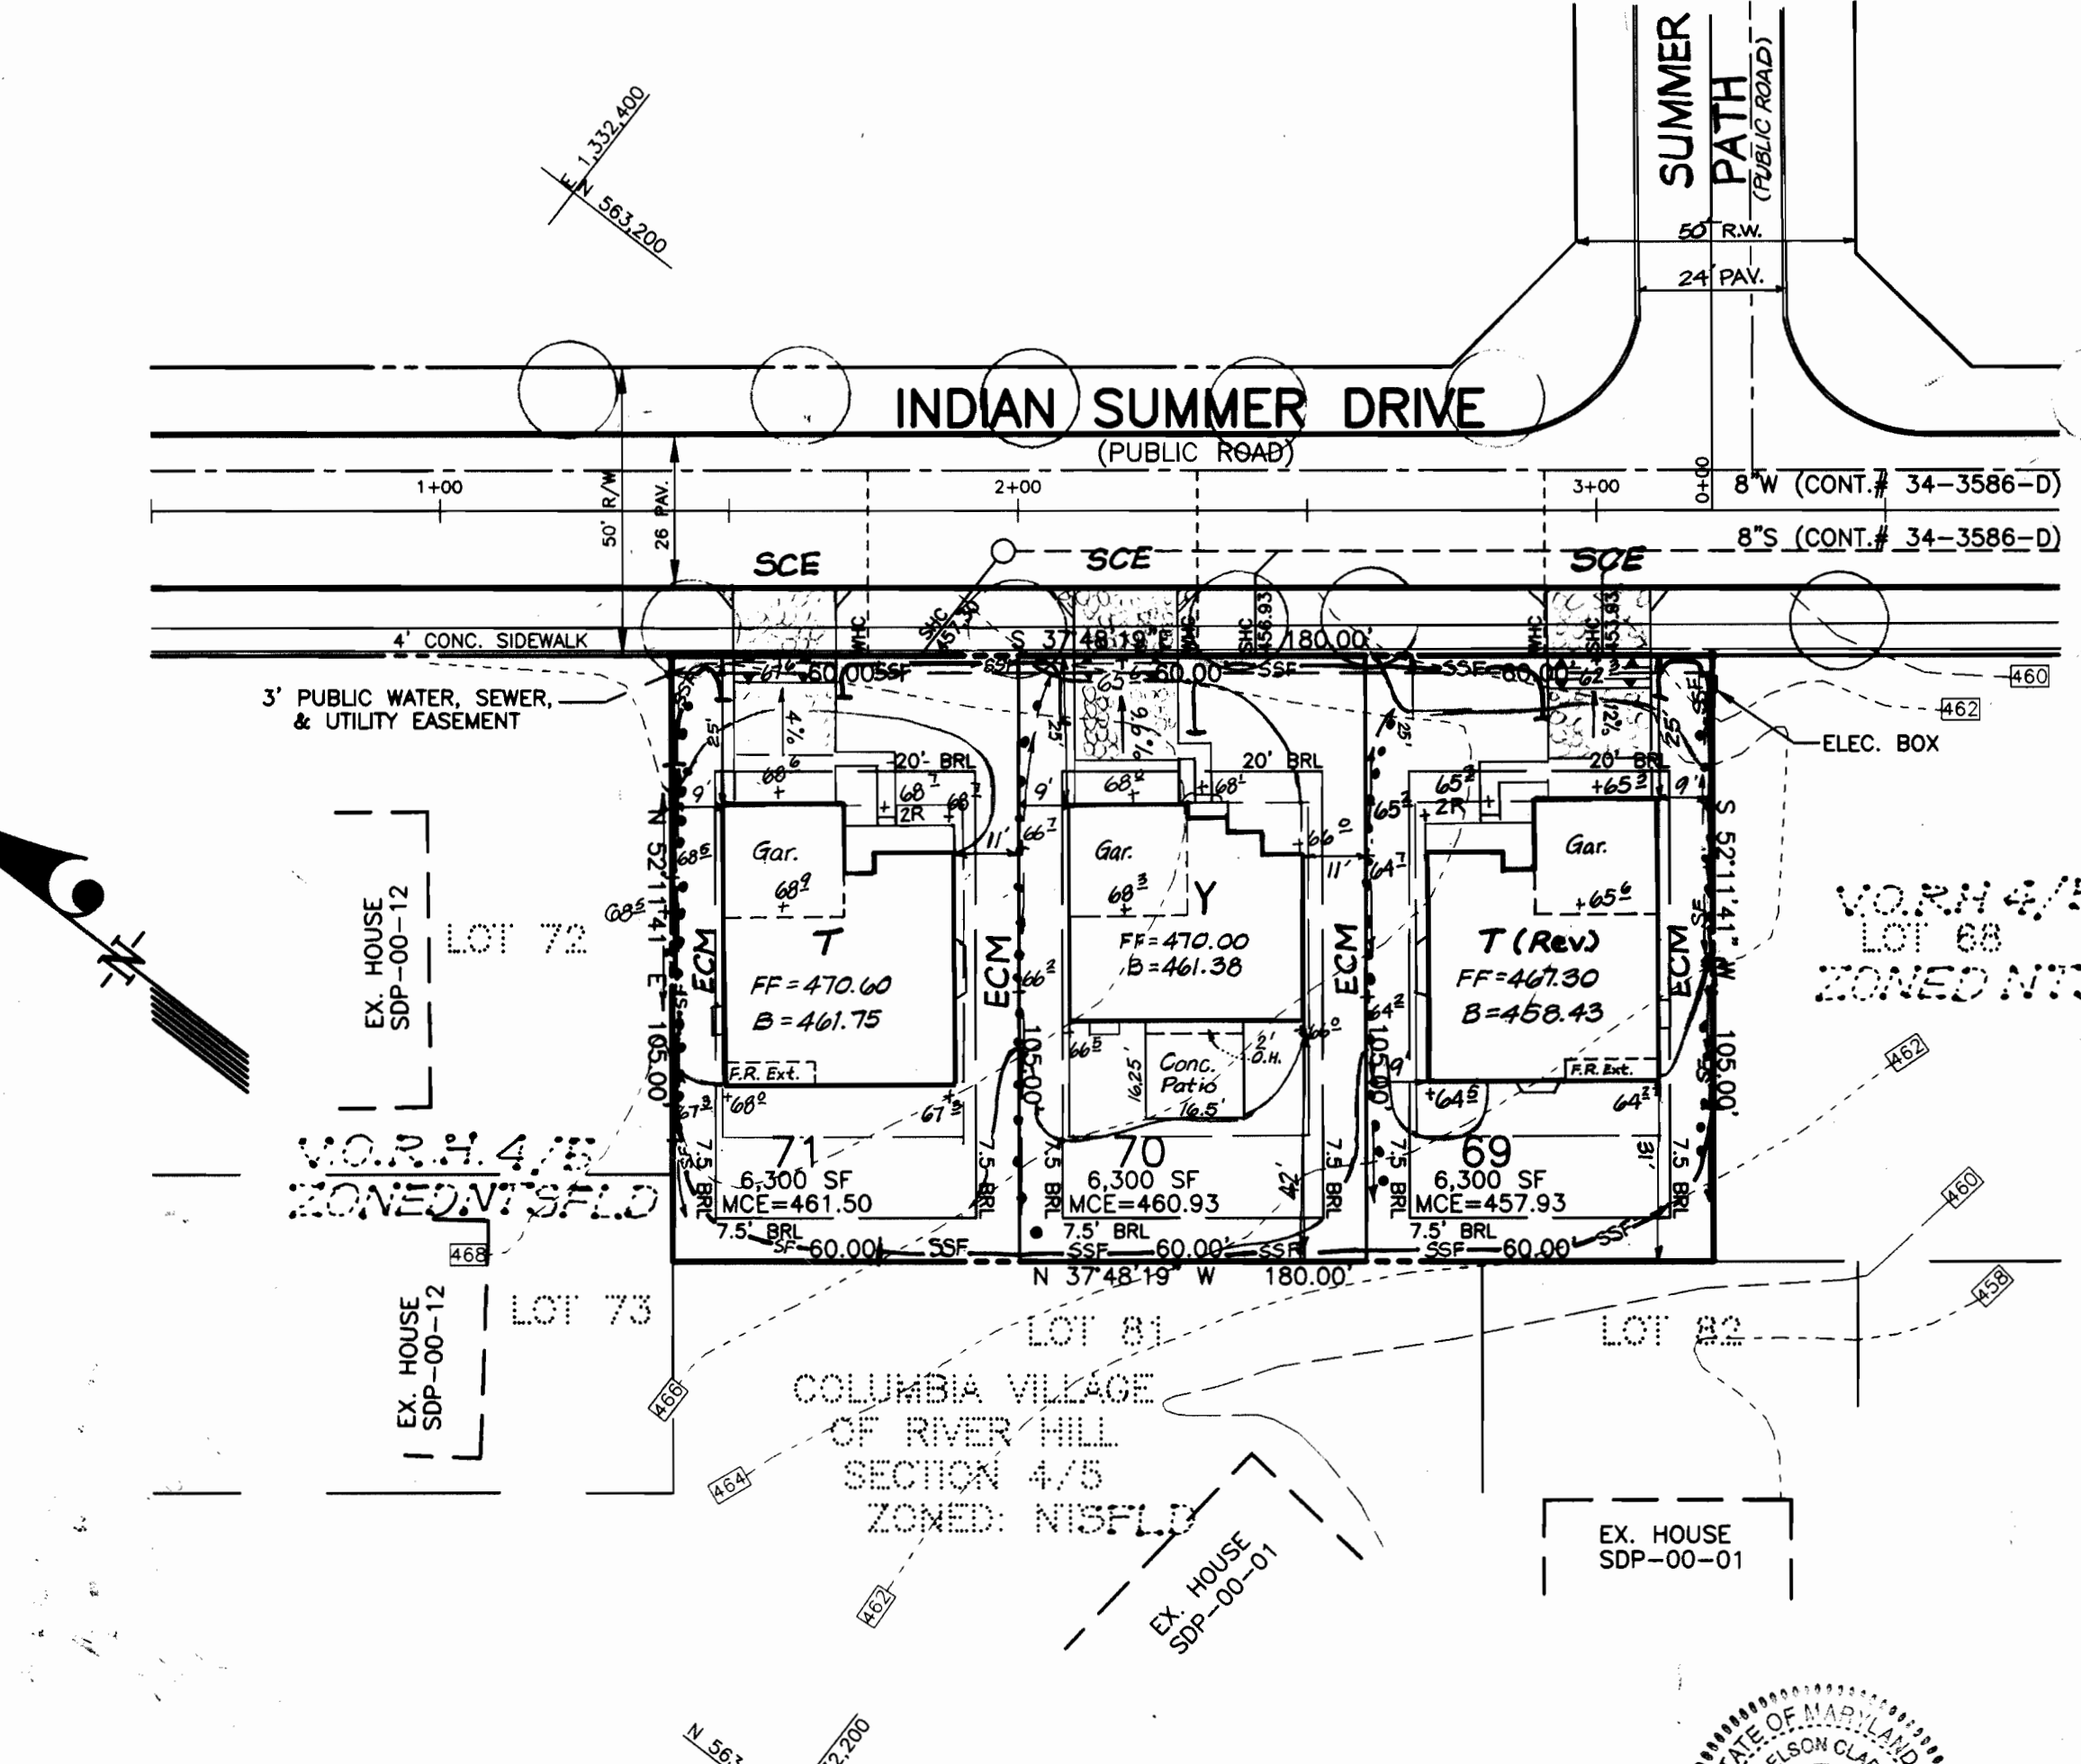

ADDRESS	CHART
LOT NO.	STREET NAME
69	INDIAN SUMMER DRIVE
70	INDIAN SUMMER DRIVE
71	INDIAN SUMMER DRIVE

OWNER / DEVELOPER

THE HOWARD RESEARCH AND DEVELOPMENT CORP.
10275 LITTLE PAXTUNTER PARKWAY
COLUMBIA, MARYLAND 21044

APPROVED: DEPARTMENT OF PLANNING & ZONING

CHIEF, DEVELOPMENT ENGINEERING DIVISION

CHIEF, DIVISION OF LAND DEVELOPMENT

DATE: 3/23/01

DATE: 3/26/01

DATE: 3/30/01

Reviewed for HOWARD S.C.D. on 3/21/01

Signature: [Signature]

U.S. Natural Resources Conservation Service

THIS DEVELOPMENT PLAN IS APPROVED FOR SOIL EROSION AND SEDIMENT CONTROL BY THE HOWARD COUNTY DEPARTMENT OF INSPECTION, LICENSING AND PERMITS on 3/21/01

Approved

DEVELOPER'S/BUILDER'S CERTIFICATE

"I/We certify that all development and construction will be done according to this plan of development and plan for sediment and erosion control and that all responsible personnel involved in the construction project will have a Certificate of Attendance at a Department of the Environment Approved Training Program for the Control of Sediment and Erosion before beginning the project. I also authorize periodic on-site inspection by the Howard County Department of Inspection, Licensing and Permits, or their authorized agents, as are deemed necessary."

Robert C. Goodier 12/26/00

ENGINEER'S CERTIFICATE

I hereby certify that this plan for Sediment and Erosion Control represents a practical and workable plan based on my personal knowledge of the site conditions and that it was prepared in accordance with the requirements of the Howard Soil Conservation District.

G. Nelson Clark 3-13-01

SPECIAL NOTES:

This plan is for house siting and lot grading only. Improvements shown within the rights-of-way on this S.D.P. are not to be used for construction. For construction, see approved Road Construction Plans F-96-102 and/or approved Water and Sewer Plans Contract #34-3586-D.

SUBDIVISION NAME	SECTION/AREA	LOTS/PARCELS
VILLAGE OF RIVER HILL	4/5	69 - 71

PLAT NO.	BLOCK NO.	ZONE	TAX MAP NO.	ELECTION DIST.	CENSUS TRACT
12850	1	NTSFLD	35	5th	6055

WATER CODE	SEWER CODE
I-10	6653000

CLARK · FINEFROCK & SACKETT, INC.

ENGINEERS · PLANNERS · SURVEYORS

7135 MINSTREL WAY · COLUMBIA, MD 21045 · (410) 381-7500 BALT. · (301) 621-8100 WASH.

DESIGNED	SITE DEVELOPMENT, SEDIMENT AND EROSION CONTROL PLAN	SCALE
BAL	LOTS 69 THRU 71	1" = 30'

DRAWN	COLUMBIA VILLAGE OF RIVER HILL	DRAWING
QWL	SECTION 4 AREA 5	1 of 1

CHECKED	FIFTH (5th) ELECTION DISTRICT HOWARD COUNTY, MARYLAND	JOB NO.
BAL		99-005

DATE	FOR: GOODIER BUILDERS 10705 CHARTER DRIVE, SUITE 320 COLUMBIA, MARYLAND 21044	FILE NO.
12-26-00		99-005X