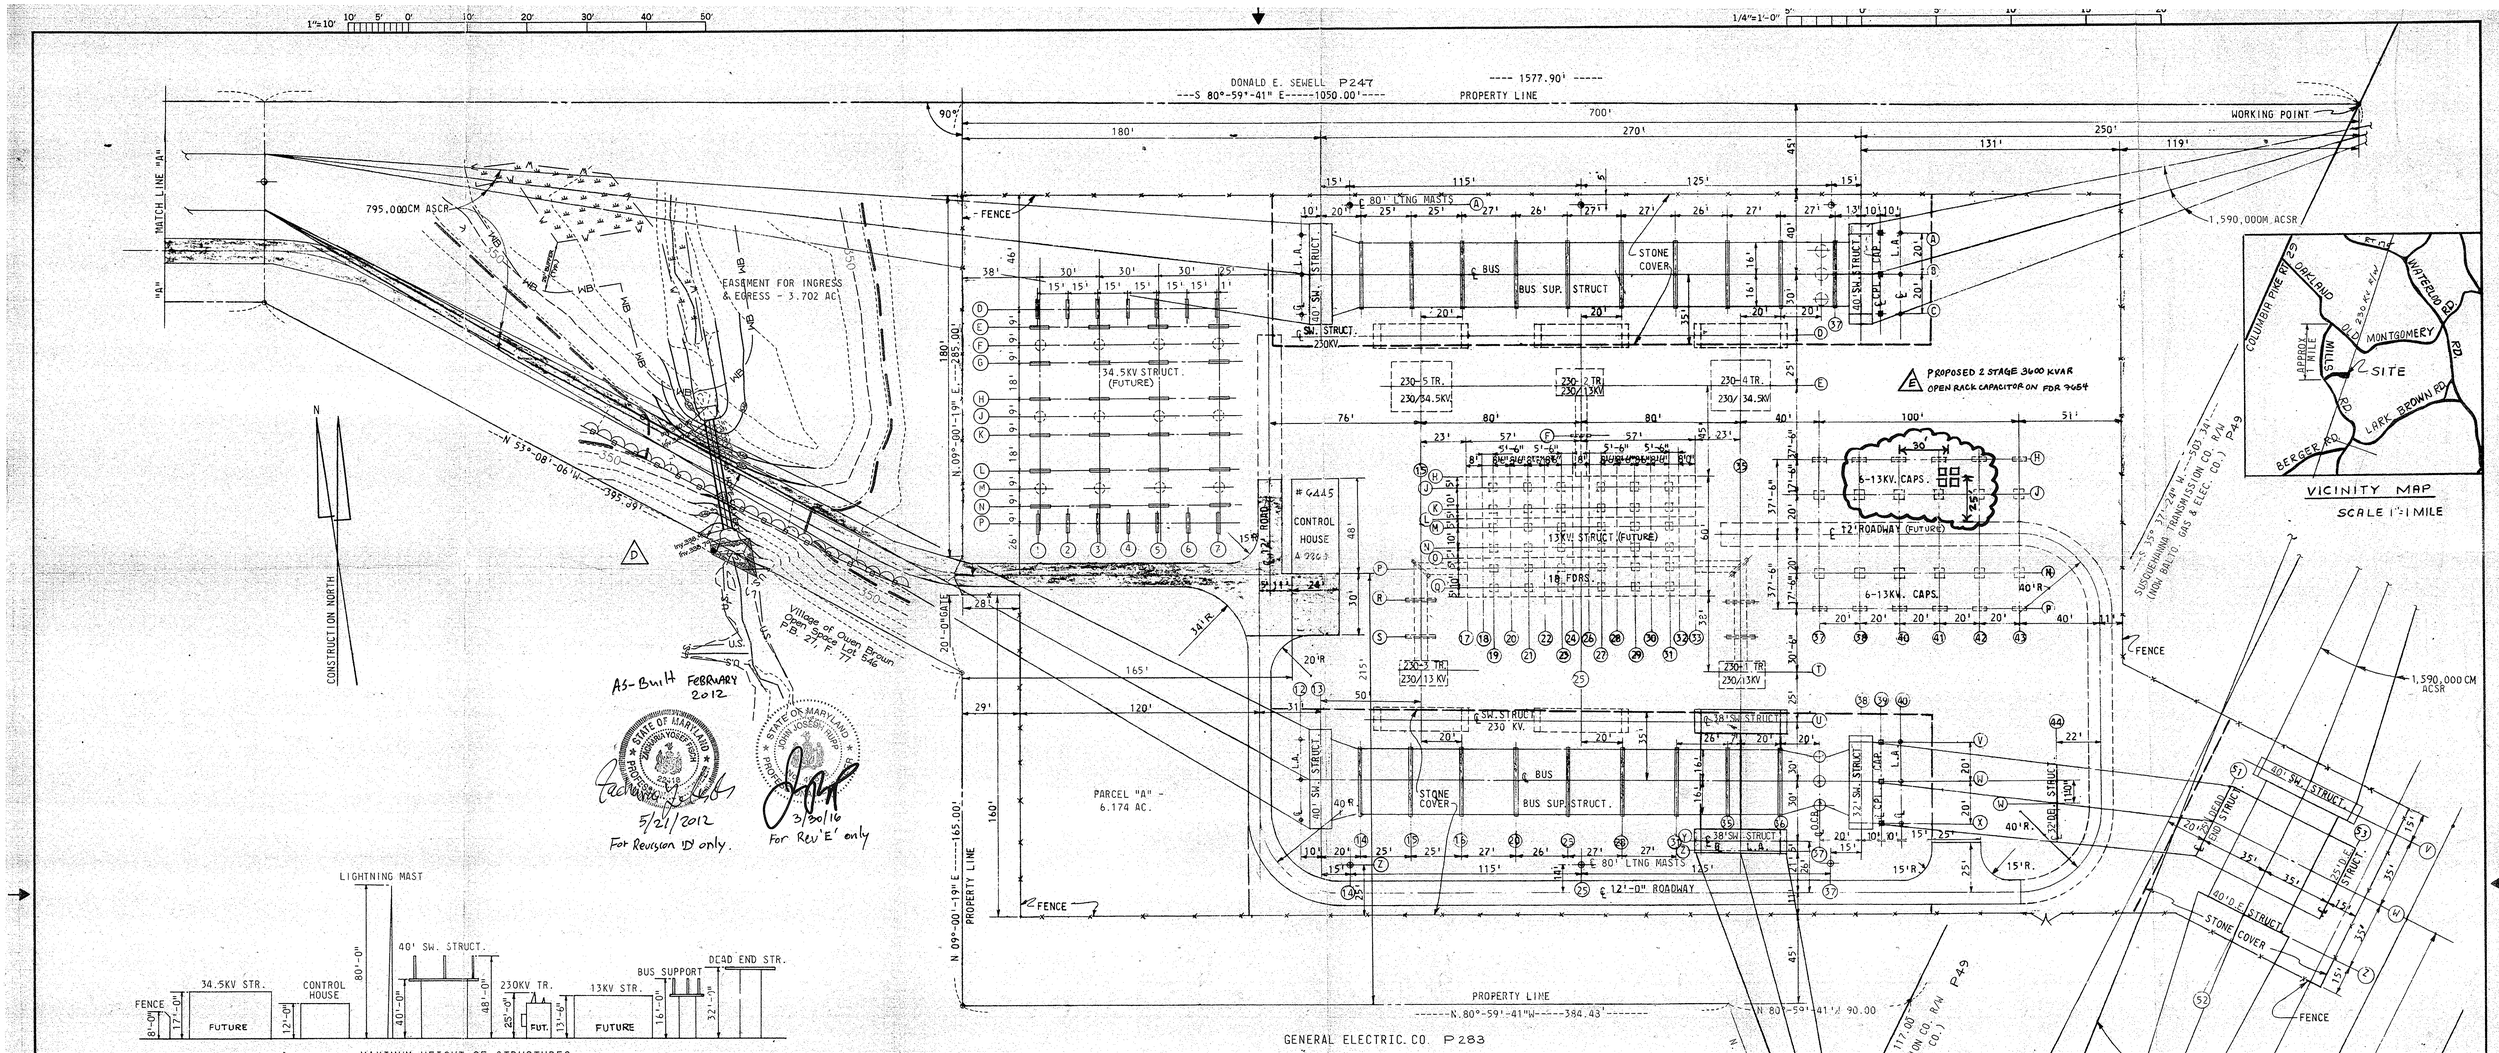

ROADWAYS: COMPACT SUBGRADES TO 95% DENSITY AS DETERMINED BY ASTM D-1557-66T WITH VIBRATORY COMPACTION EQUIPMENT. INSTALL 8" OF CR467 CRUSHED STONE BASE IN TWO LIFTS AND COMPACT EACH LIFT WITH 10 TON ROLLER. INSTALL 2" BITUMINOUS BINDER COURSE (P-2 GRADATION). INSTALL 1" BITUMINOUS CONCRETE SURFACE (PC-1-61 GRADATION).SHADED PORTION ONLY TO BE PAVED. REMAINDER TO BE BASE COURSE ONLY.

NOTES:

1. COLUMBIA BALTO. GAS & ELEC. SUBSTATION OAKLAND MILLS ROAD RECORDED IN PLAT BOOK 19 FOLIO 99 (PH.91) MAY 27,1970 AND PLAT BOOK 18 FOLIO 74 MAY 28,1970 TAX MAP NO.36-P.283.
2. THIS PARCEL OF LAND IS LOCATED IN ELECTION DISTRICT #6 HOWARD COUNTY AND CONTAINS 6.174 AC.±
3. ZONING: N.T.
4. SEE DRAWING 59-616-E FOR SOIL EROSION AND SEDIMENT CONTROL.
5. FOR 48" CULVERT REPLACEMENT, MDE PERMIT ISSUED #201260156/12-NT-0036

APPROVED: FOR PUBLIC SEWER SYSTEMS, FOR PUBLIC WATER SYSTEMS
HOWARD COUNTY HEALTH DEPARTMENT
HOWARD COUNTY HEALTH OFFICER

APPROVED: HOWARD COUNTY OFFICE OF PLANNING AND ZONING
PLANNING DIRECTOR
CHIEF ENGINEER, DIVISION OF LAND DEVELOPMENT

APPROVED: STORM DRAIN SYSTEMS AND ROADS
HOWARD COUNTY DEPARTMENT OF PUBLIC WORKS
DIRECTOR
CHIEF OF BUREAU OF HIGHWAYS

REV.	DATE	DESCRIPTION	APPROVAL
A	1-14-70	ADDED G.E.CO. TAP	
B	4-21-70	ROTATED 34.5KV STRUCT. 90°	
C	7-2-70	ADDITIONS FOR SITE DEV. APPL.	
D	5/3/12	ADD 48" CULVERT, REPLACED DUE TO FAILURE OF EX. CULVERT.	
E	3/30/16	PROPOSED 2 STAGE 3600 KVAR OPEN RACK CAPACITOR ON FDR 7654	

ENGINEERING
CIVIL
MECH.
ELEC. E.W.J 1/30/70
CHIEF ENG.
MANAGER

DESIGN & DRAFTING
DESIGNED
DRAWN
CHECKED
APPROVED 6-26-69

SITE PLAN
230/34.5/13KV 3Φ 60~ SERVICE
OUTDOOR SUBSTATION
COLUMBIA

BALTIMORE GAS AND ELECTRIC COMPANY
ELECTRIC ENGINEERING DEPARTMENT

REPROD. FROM DWG. 59-602-E
DATED 3-3-69
SCALE 1"=30'
DWG. NO. 59-609-E
REV. D

30X

SDP 70-05-C