




**B.M.**  
 HOWARD COUNTY TRAVERSE  
 STATION 1742001-R  
 ELEV. 226.095  
 N. 447.109 860  
 E. 848.133 484  
 REBAR 2" BELOW SURFACE  
 ON SOUTH SIDE OF U.S.  
 RTE. 1

**NOTES:**  
 1. TOTAL AREA OF PROPERTY IS 2.4 ACRES.  
 2. 1.1 AC ZONED AREA IS 457 ACRES.  
 3. 1.3 ZONED AREA IS 2.62 ACRES (0.21 ACRES BEING PART OF STATE ROAD R/W FOR U.S. RTE. 1)

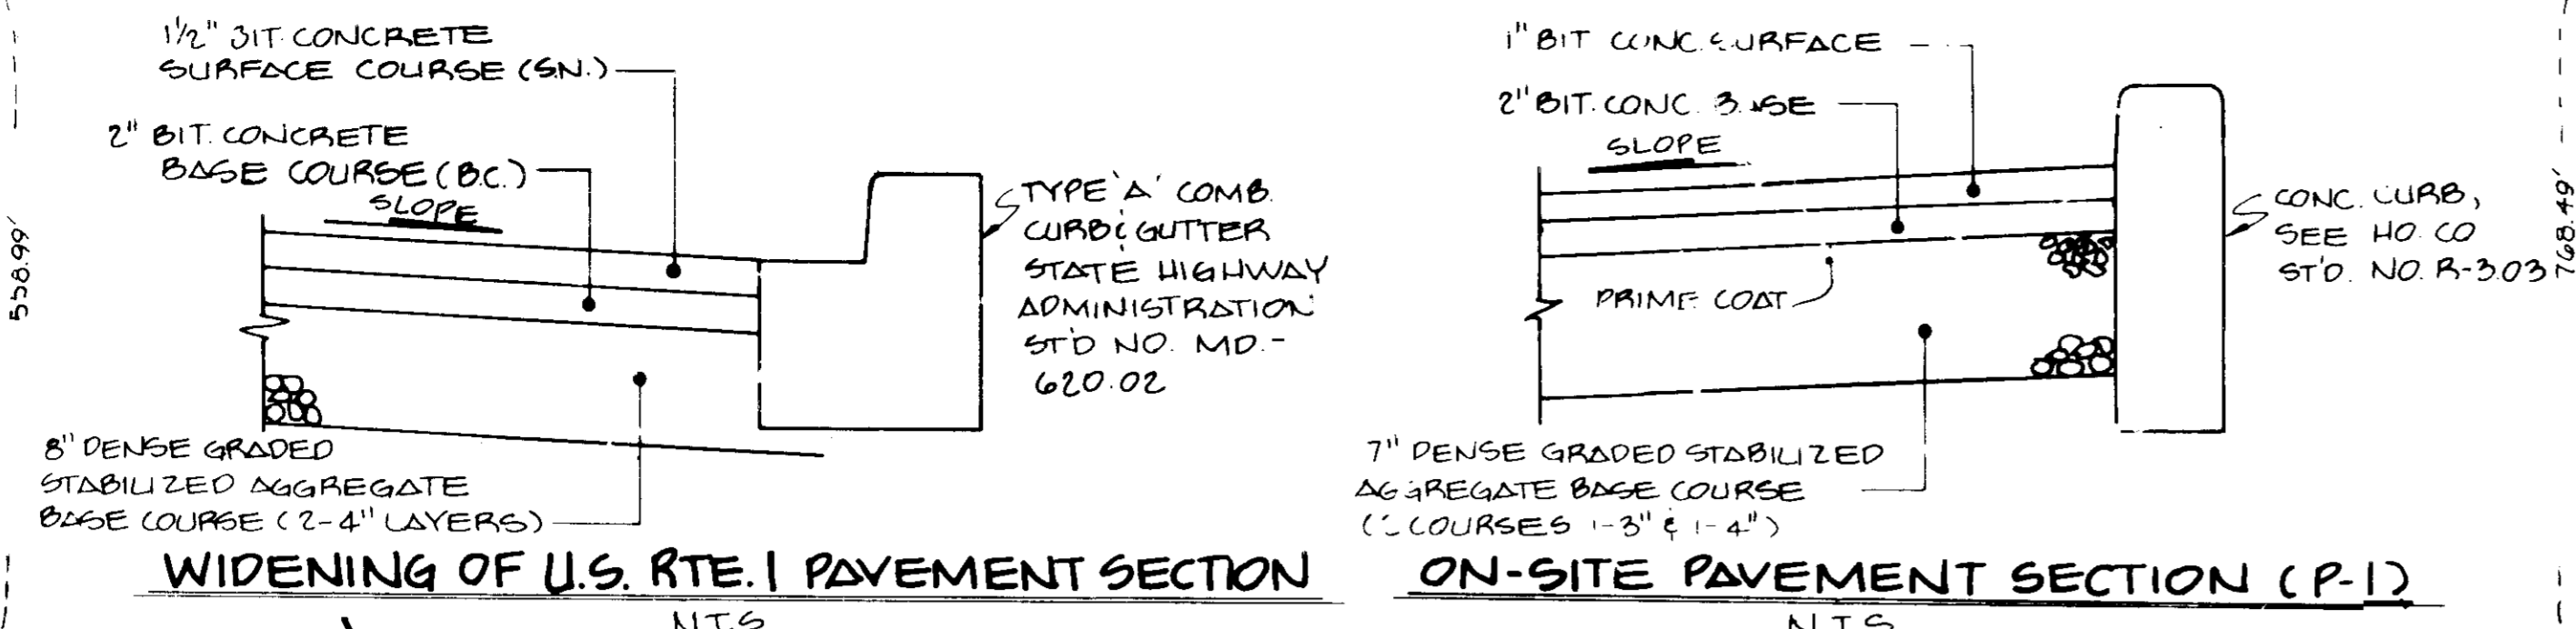

**WIDENING OF U.S. RTE. 1 PAVEMENT SECTION**      **ON-SITE PAVEMENT SECTION (P-1)**

9-30-86  
 Approved: *Stephen J. ...* Date: 10/9/86  
 Howard B.C.D.  
**ZONED RSC**  
 N/F LAND OF AN. & N.E. WALLACE 116/589

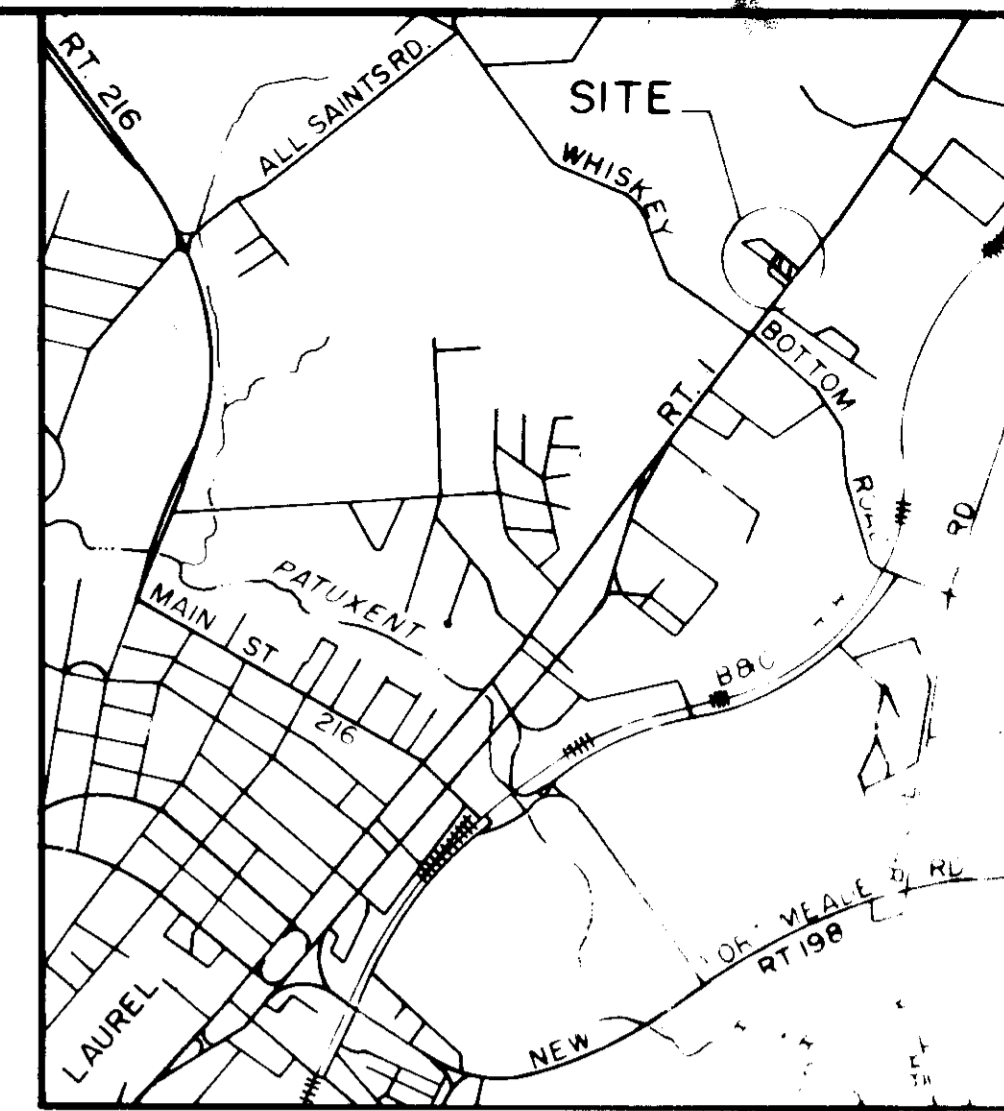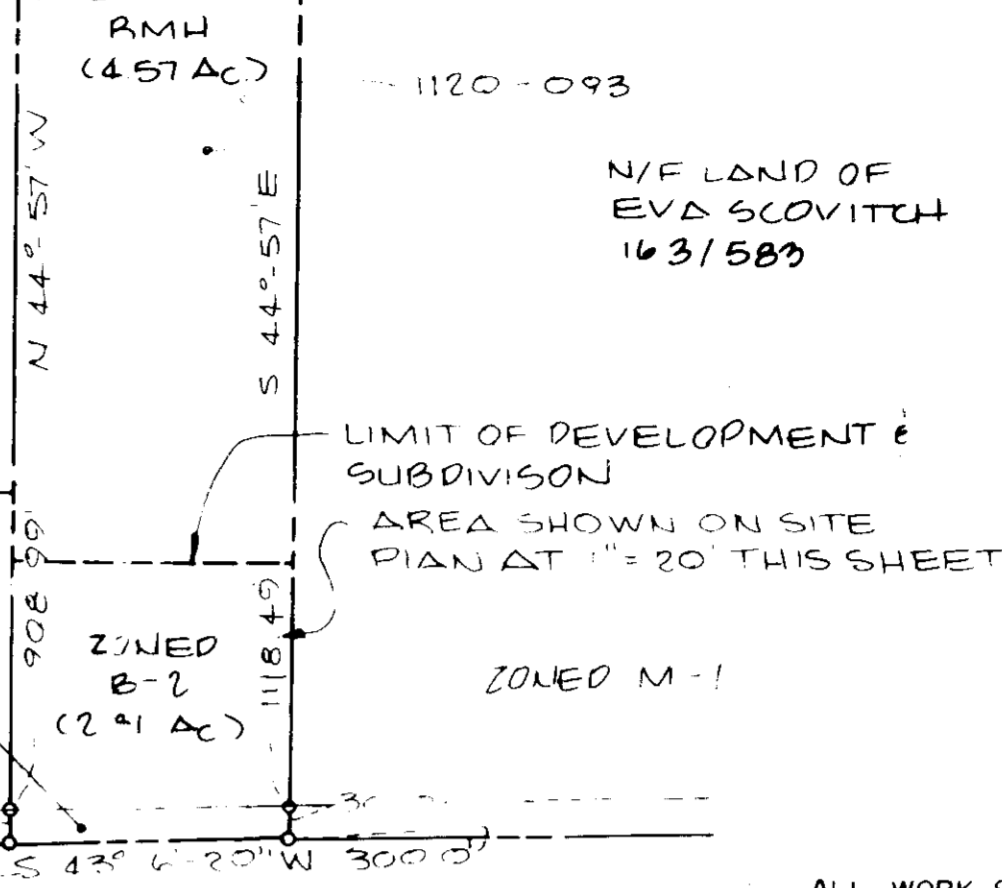

**LOCATION MAP**  
 SCALE 1" = 2000'

**GENERAL NOTES**

- ALL WORK SHALL BE IN ACCORDANCE WITH HOWARD COUNTY STANDARD SPECIFICATIONS AND DETAILS FOR CONSTRUCTION (REFER TO HOWARD MANUAL, VOLUME III) AS AMENDED TO DATE, EXCEPT AS OTHERWISE NOTED WORK WITHIN THE STATE HIGHWAY RIGHT OF WAY SHALL BE IN ACCORDANCE WITH THE MSHA PERMIT NO.
- EXISTING UNDERGROUND UTILITIES ARE SHOWN FROM THE BEST AVAILABLE INFORMATION, BUT NO GUARANTEE CAN BE GIVEN OF THEIR DEPTH OR COMPLETENESS, NOR FOR ANY CONCLUSIONS DRAWN THEREFROM. THE USER SHALL VERIFY ALL UTILITIES TO HIS SATISFACTION.
- NOTIFICATIONS BEFORE STARTING CONSTRUCTION
 

DAYS NOTICE	AGENCY
5 DAYS	MD STATE HIGHWAY 531-5533
3 DAYS	MISS UTILITY 1-559-0100 COLLECT
5 DAYS	BALTO. GAS & ELEC, ELEC. DISTRIBUTION
5 DAYS	BALTO. GAS & ELEC, GAS DISTRIBUTION
5 DAYS	C & P TELEPHONE CO 725-9976
2 DAYS	HOWARD CO. CONSTRUCTION INSPECTION SURVEY DIVISION 792-7272
- PLACE 2" TOPSOIL, SEED AND MULCH ON ALL DISTURBED AREAS, OTHERWISE TREATED.
- TOPOGRAPHIC SURVEY FIELD RUN MAY 1984.
- SEE MARYLAND BUILDING CODE FOR HANDICAPPED DETAIL - HANDICAP RAMP & FACILITIES. SEE SHEET 404 & 405.
- ALL EXTERIOR LIGHTING SHALL BE DIRECTED/REFLECTED AWAY FROM ADJACENT RESIDENTIALLY ZONED PROPERTIES AND PUBLIC RIGHT OF WAY.

**NOTES:**

- INTERIOR GREEN SPACE 8% MIN. PARKING 24 SPACES. GREEN SPACE PROVIDED 11,692 SQ. FT. (6.47%)
  - WATER & SEWER HOUSE CONNECTION BY OTHERS ON MECHANICAL PLAN
  - PROVIDE PAVEMENT MARKINGS AS SHOWN (WHITE 4" SOLID LINE)
  - ACCESS FOR HANDICAP PERSON IS DIRECT INTO COVERED WALKWAYS (NO STEPS)
  - ADJUST EXISTING UTILITIES DISTURBED BY NEW CONSTRUCTION
  - GREEN AREA INCLUDING INTERIOR LANDSCAPED AREA B-2 AREA 105,127.2 SQ. FT. GREEN AREA REQ'D 21,025 SQ. FT. (20%) GREEN AREA PROVIDED 29,917 SQ. FT. (22.7%) PROPOSED BUILDING 14,004 SQ. FT. (16%) BUILDING 14,004 SQ. FT. (16%)
- TEMP S.W.M. TRAP NO. 1**  
 DRAINAGE AREA = 3.44 ACRES  
 VOLUME REQUIRED = 6,192 CU. FT.  
 VOLUME PROVIDED = 13,530 CU. FT.  
 TOP OF TRAP ELEV. = 223.5  
 BOTTOM OF TRAP ELEV. = 216.60  
 CLEAN OUT OF TRAP ELEV. = 218.60  
 TRAP BOTTOM SIZE = 38" x 30"  
 PIPE OUTLET STRUCTURE = L-31'-0"  
 SEE SHEET NO. 3 FOR DETAILS  
 PREST. ELEV. 221.60
- ENGINEER'S CERTIFICATE**  
 I certify that this plan for erosion and sediment control represents a practical and workable plan based on my personal knowledge of the site conditions and that it was prepared in accordance with the requirements of the Howard Soil Conservation District."

**ENGINEER'S CERTIFICATE**


I certify that this plan for erosion and sediment control represents a practical and workable plan based on my personal knowledge of the site conditions and that it was prepared in accordance with the requirements of the Howard Soil Conservation District."

*James P. ...*  
 JAMES P. ...  
 #9954  
 9/30/86

**OWNER/DEVELOPER**  
**AMINA LTD PARTNERSHIP**  
 4401 DUSTIN ROAD  
 BURTONSVILLE, MD. 20814  
 RESIDENT AGENT: Mirza Hussain Ali Baig  
 Phone: (301) 716-0666

**LEGEND**

- 24 --- EXISTING CONTOURS
- 24 --- PROPOSED CONTOURS
- S.B.D. --- STRAW BALE DIKE
- F.A. --- FLOW ARROW
- S.O.P. --- STONE OUTLET STRUCTURE
- C.I.P.D. --- CURB INLET PROTECTION
- S.I.P.D. --- SWALE INLET PROTECTION
- E.A.D. --- EARTH DIKE
- B.B.D. --- BITUMINOUS BUMP DIKE
- S. --- SILT FENCE
- S.C.E. --- STABILIZED CONSTRUCTION ENTRANCE
- 15" PCMP --- PERFORATED CORRUGATED METAL STORM DRAINAGE INFILTRATOR

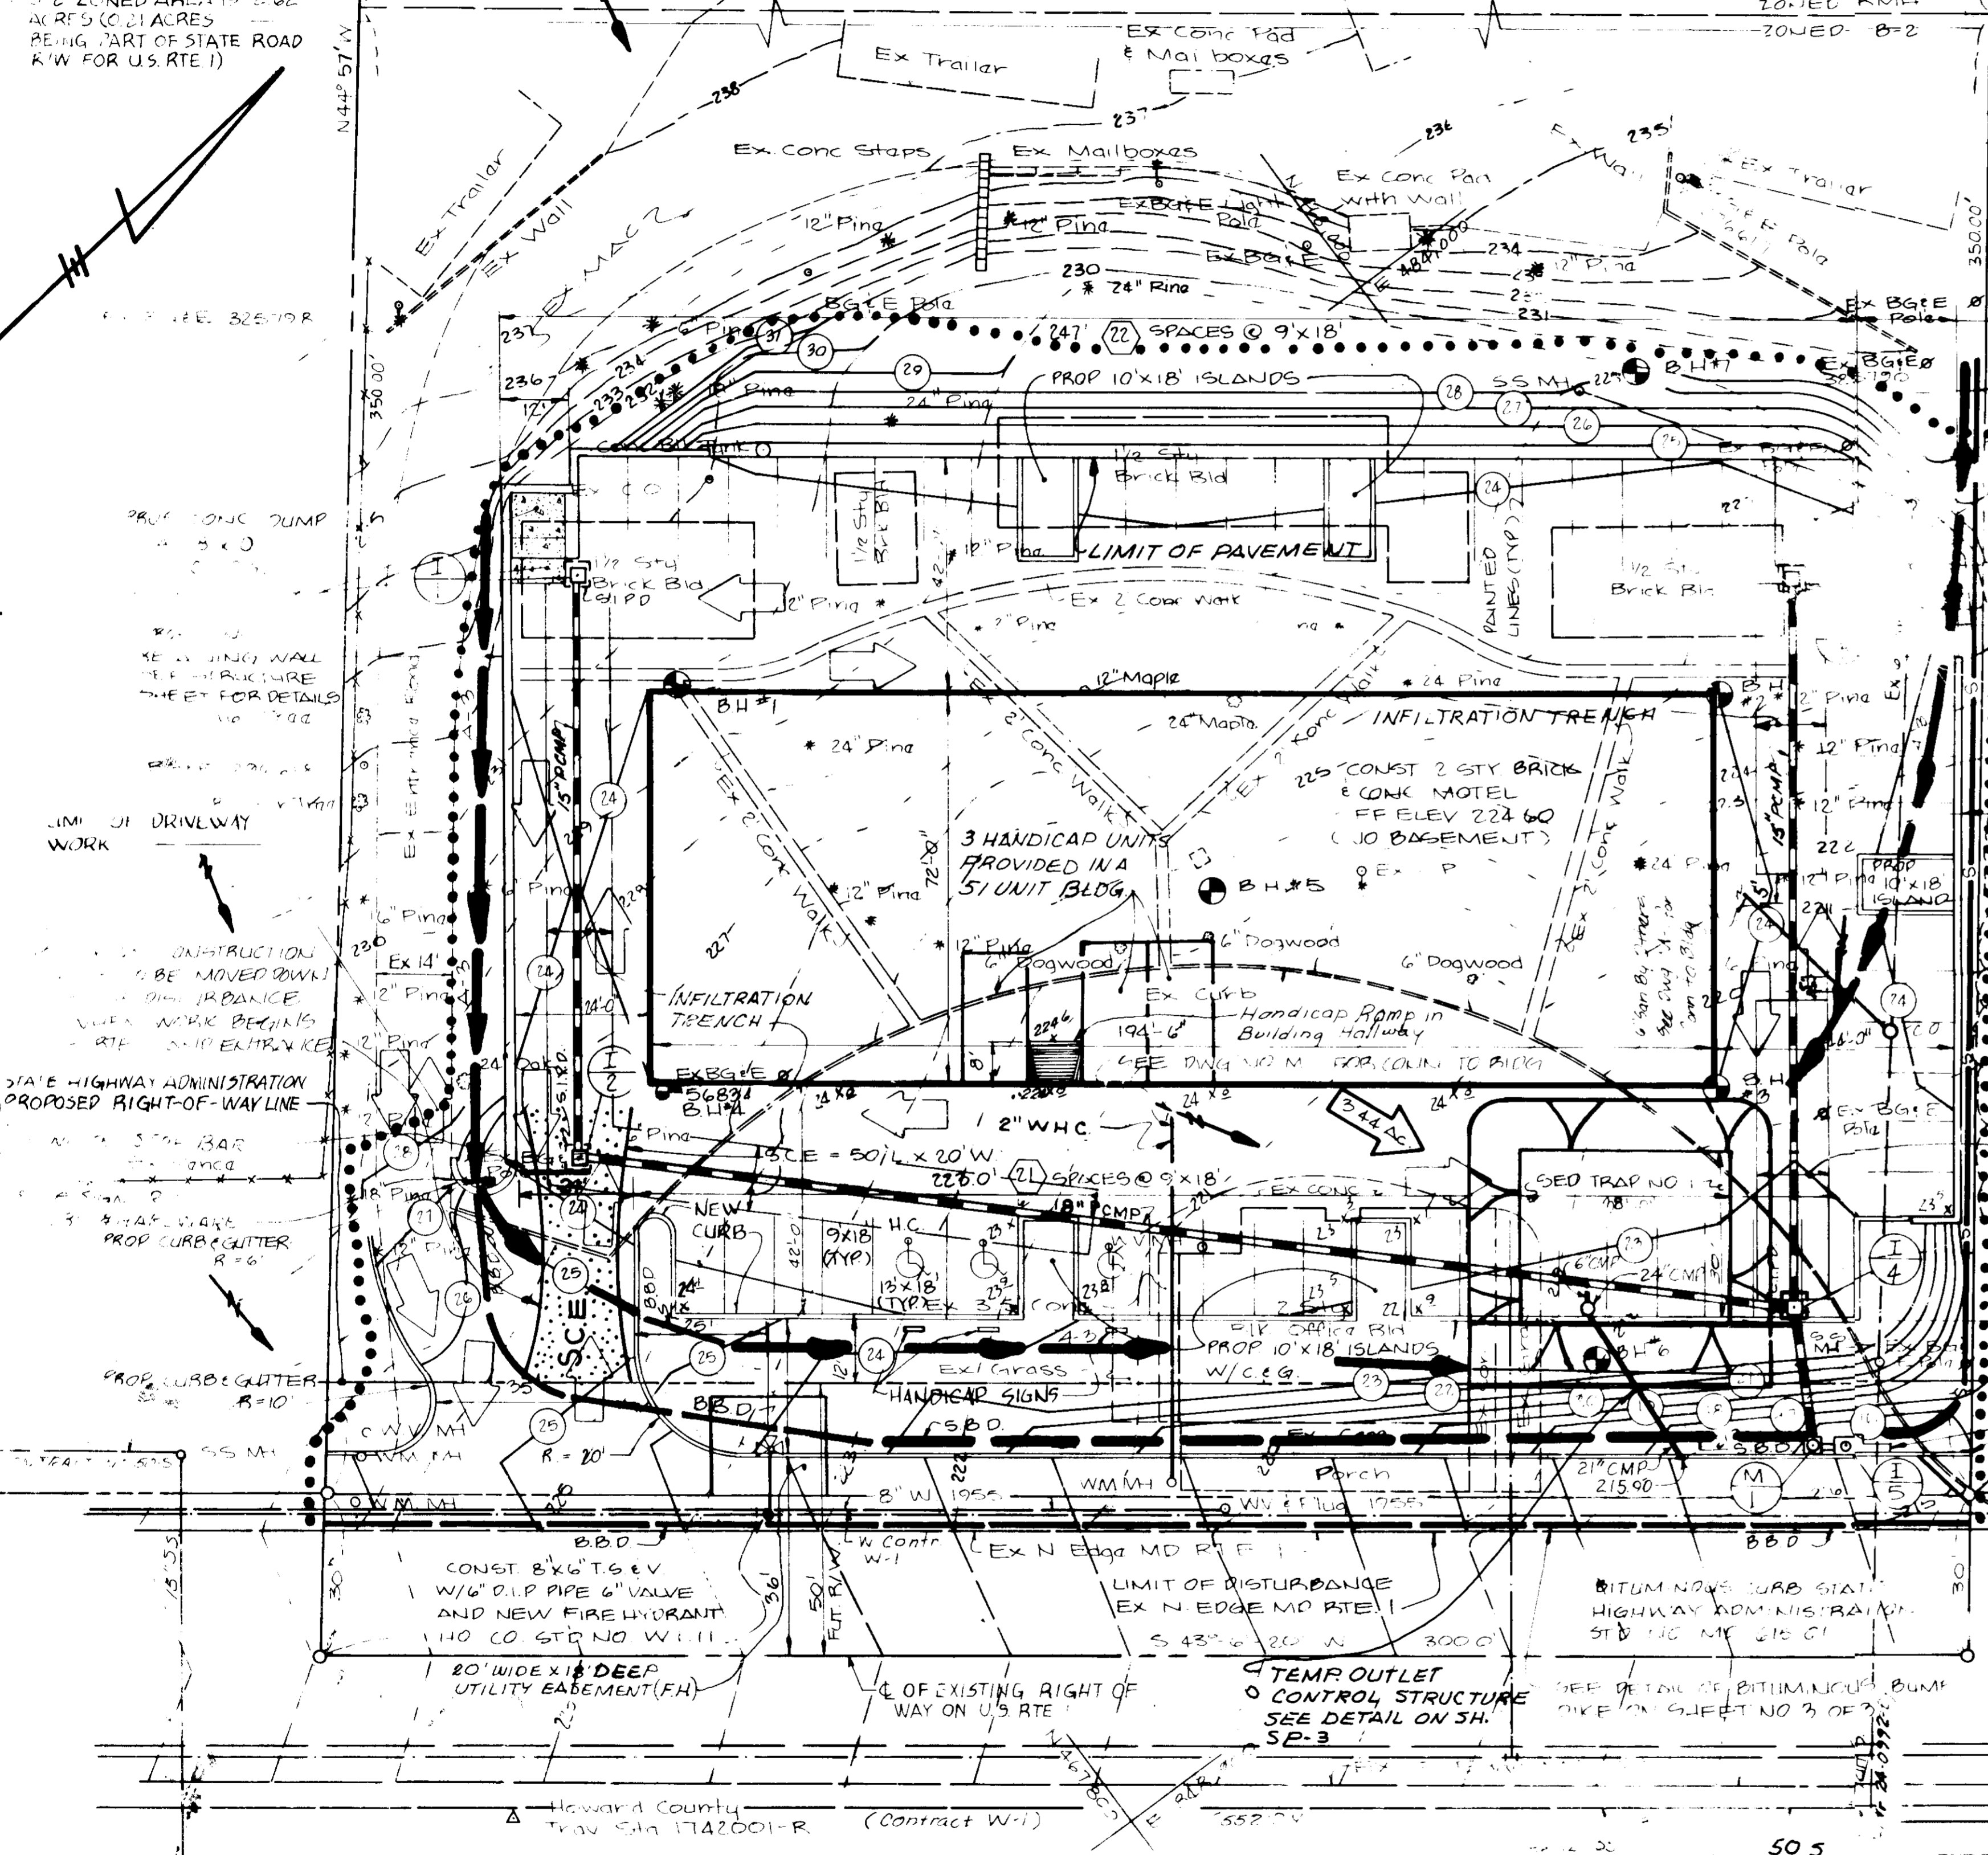

ADDRESS CHART		SUBDIVISION NAME		SECT./AREA/LOT/PARCEL #	
LOT NUMBER	STREET ADDRESS	ECONO-LODGE LAUREL		P 435	
P 435	9750 U.S. RTE. 1 (WASHINGTON BLVD.)	PLAT # OR L/F	BLOCK #	TAX/ZONE MAP	ELEC. DIST. (CENTR. TR.)
		610/316	23	50147	6TH 6063
		WATER CODE		SEWER CODE	
		004		7100800	




Drawn By:	DATE:	REVISIONS
Designed By:	6/30/86	GENERAL BY KPA
Checked By:		

APPROVED: FOR PUBLIC WATER AND PUBLIC SEWERAGE SYSTEM  
 HOWARD COUNTY HEALTH DEPARTMENT  
*James P. ...* 10-16-86  
 COUNTY HEALTH OFFICER  
 APPROVED: HOWARD COUNTY OFFICE OF PLANNING & ZONING  
*James P. ...* 10-20-86  
 DIRECTOR  
 DIVISION OF LAND DEVELOPMENT AND ZONING ADMINISTRATION

APPROVED: *James P. ...* 10-16-86  
 DIRECTOR  
 CHIEF BUREAU OF ENGINEERING  
 DATE: 10-16-86

SCALE: 1" = 20'  
**SEDIMENT CONTROL AND SITE PLAN**  
**ECONO-LODGE LAUREL**  
 9750 BALTIMORE WASHINGTON BOULEVARD  
 LAUREL, MD. 20810  
 HOWARD COUNTY  
 TAX MAP NO. 47 PARCEL NO. 435 6TH ELECTION DISTRICT  
 KPA PROJECT NO. 84-59 467-1645




DATE: 9-27-86  
 10/9/86  
 SHEET NO. SP-1  
 1 OF 4

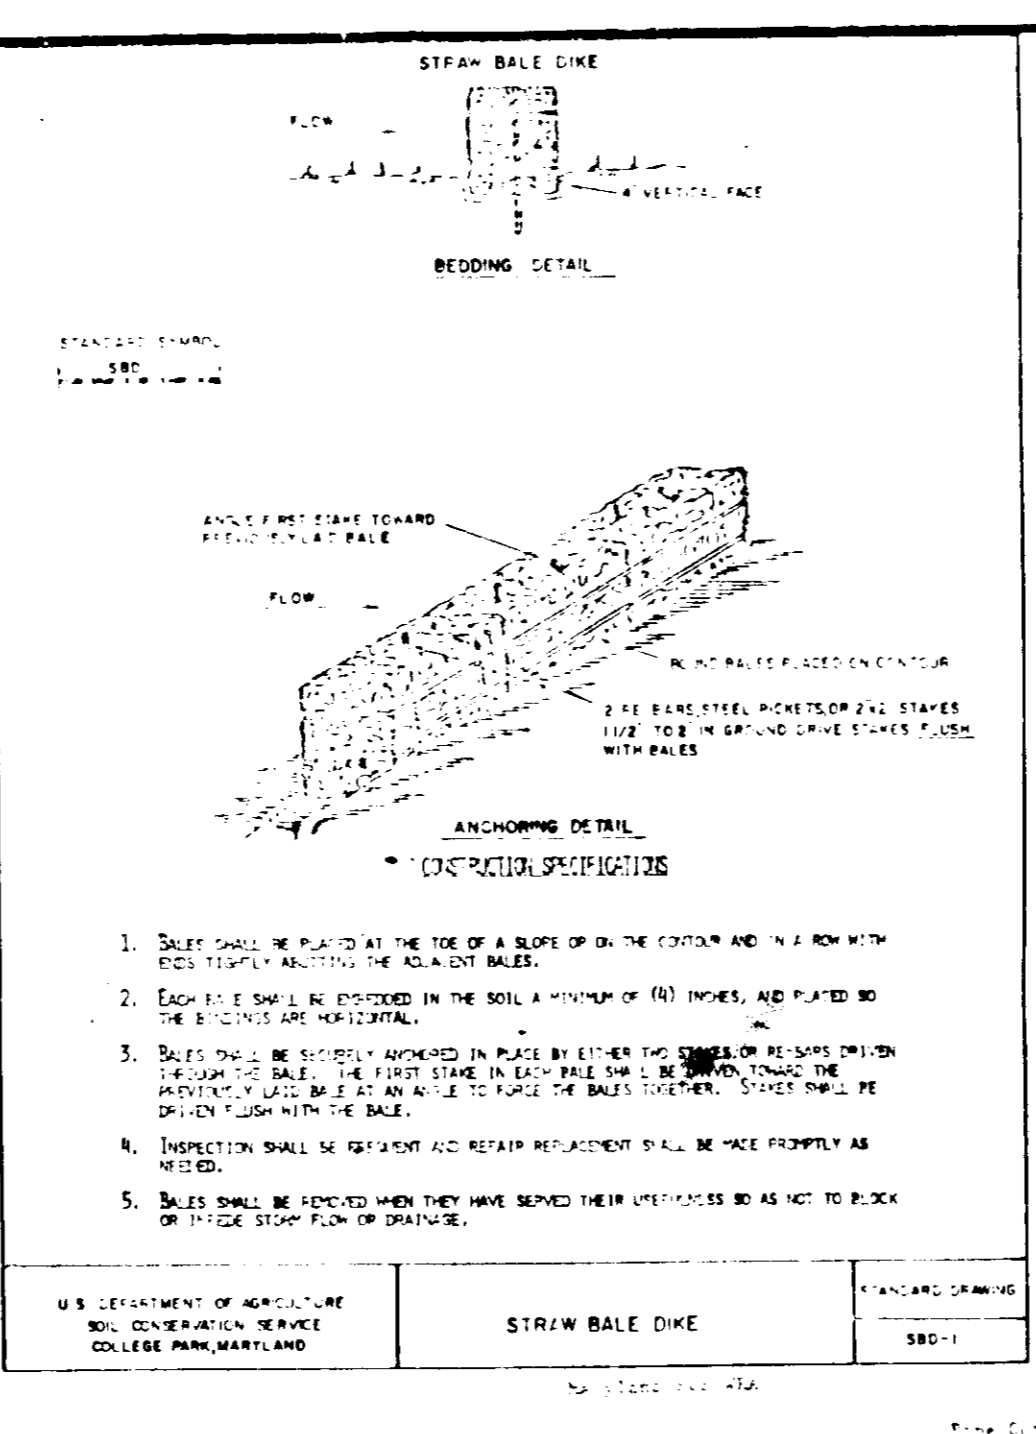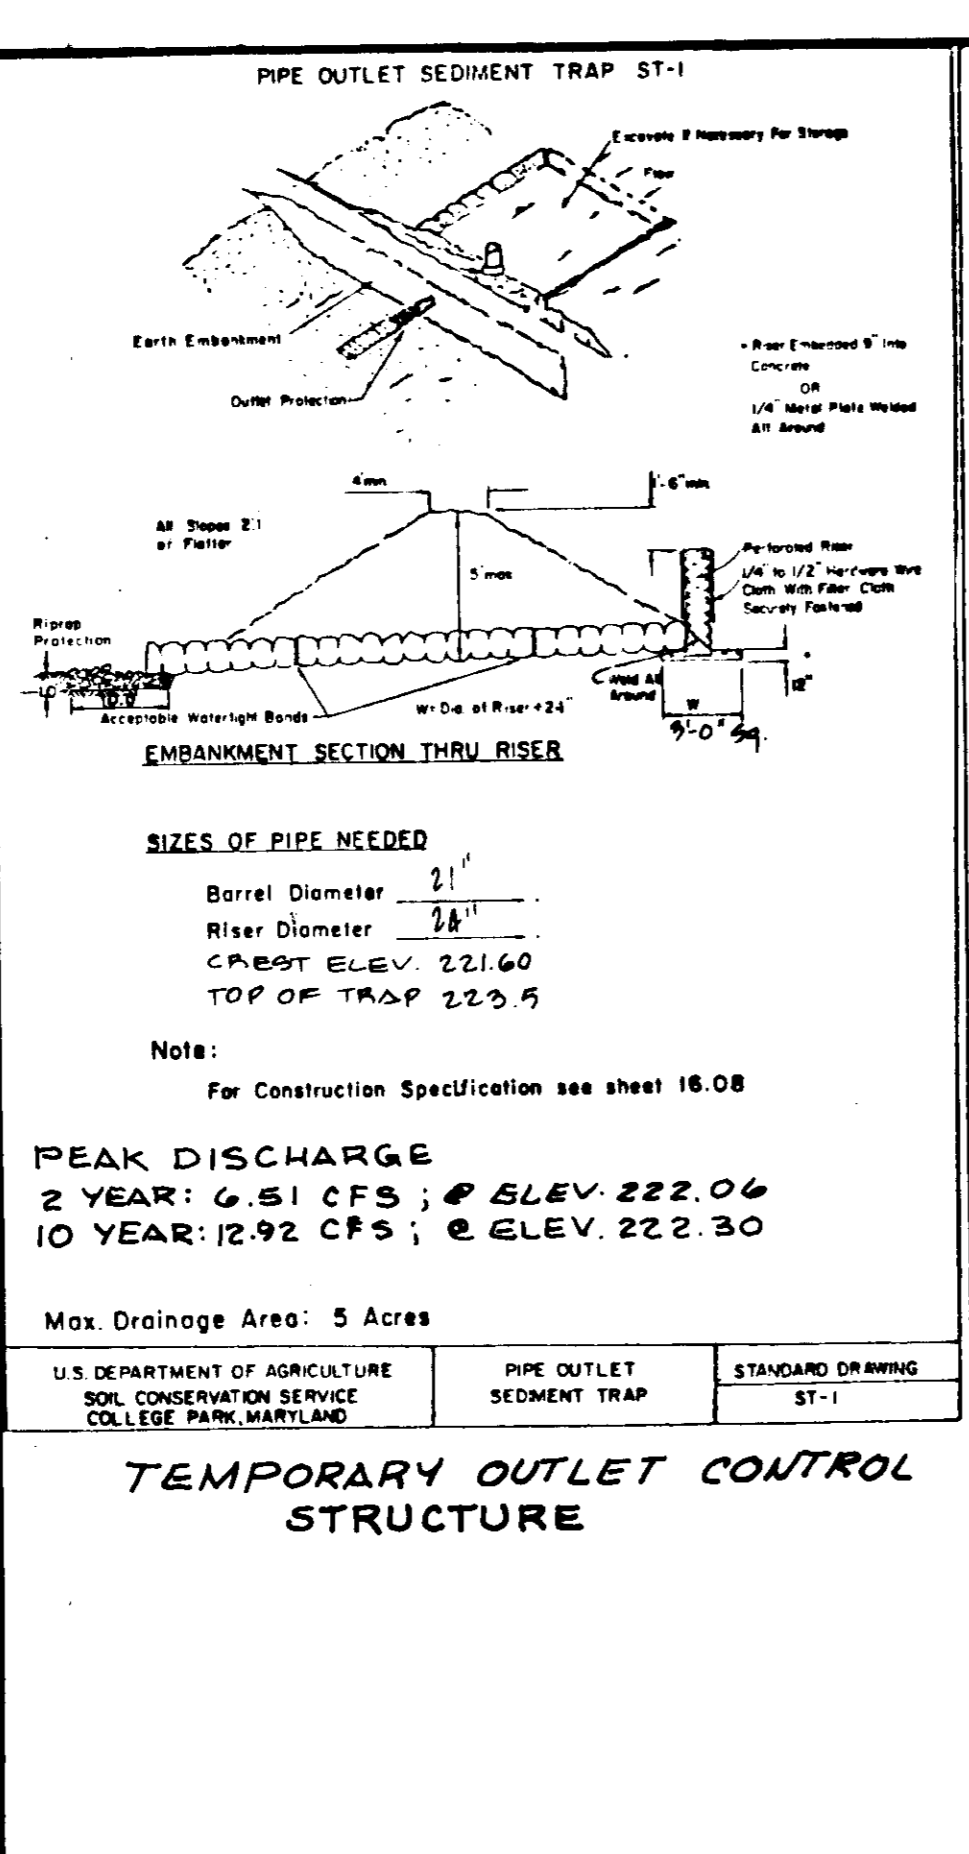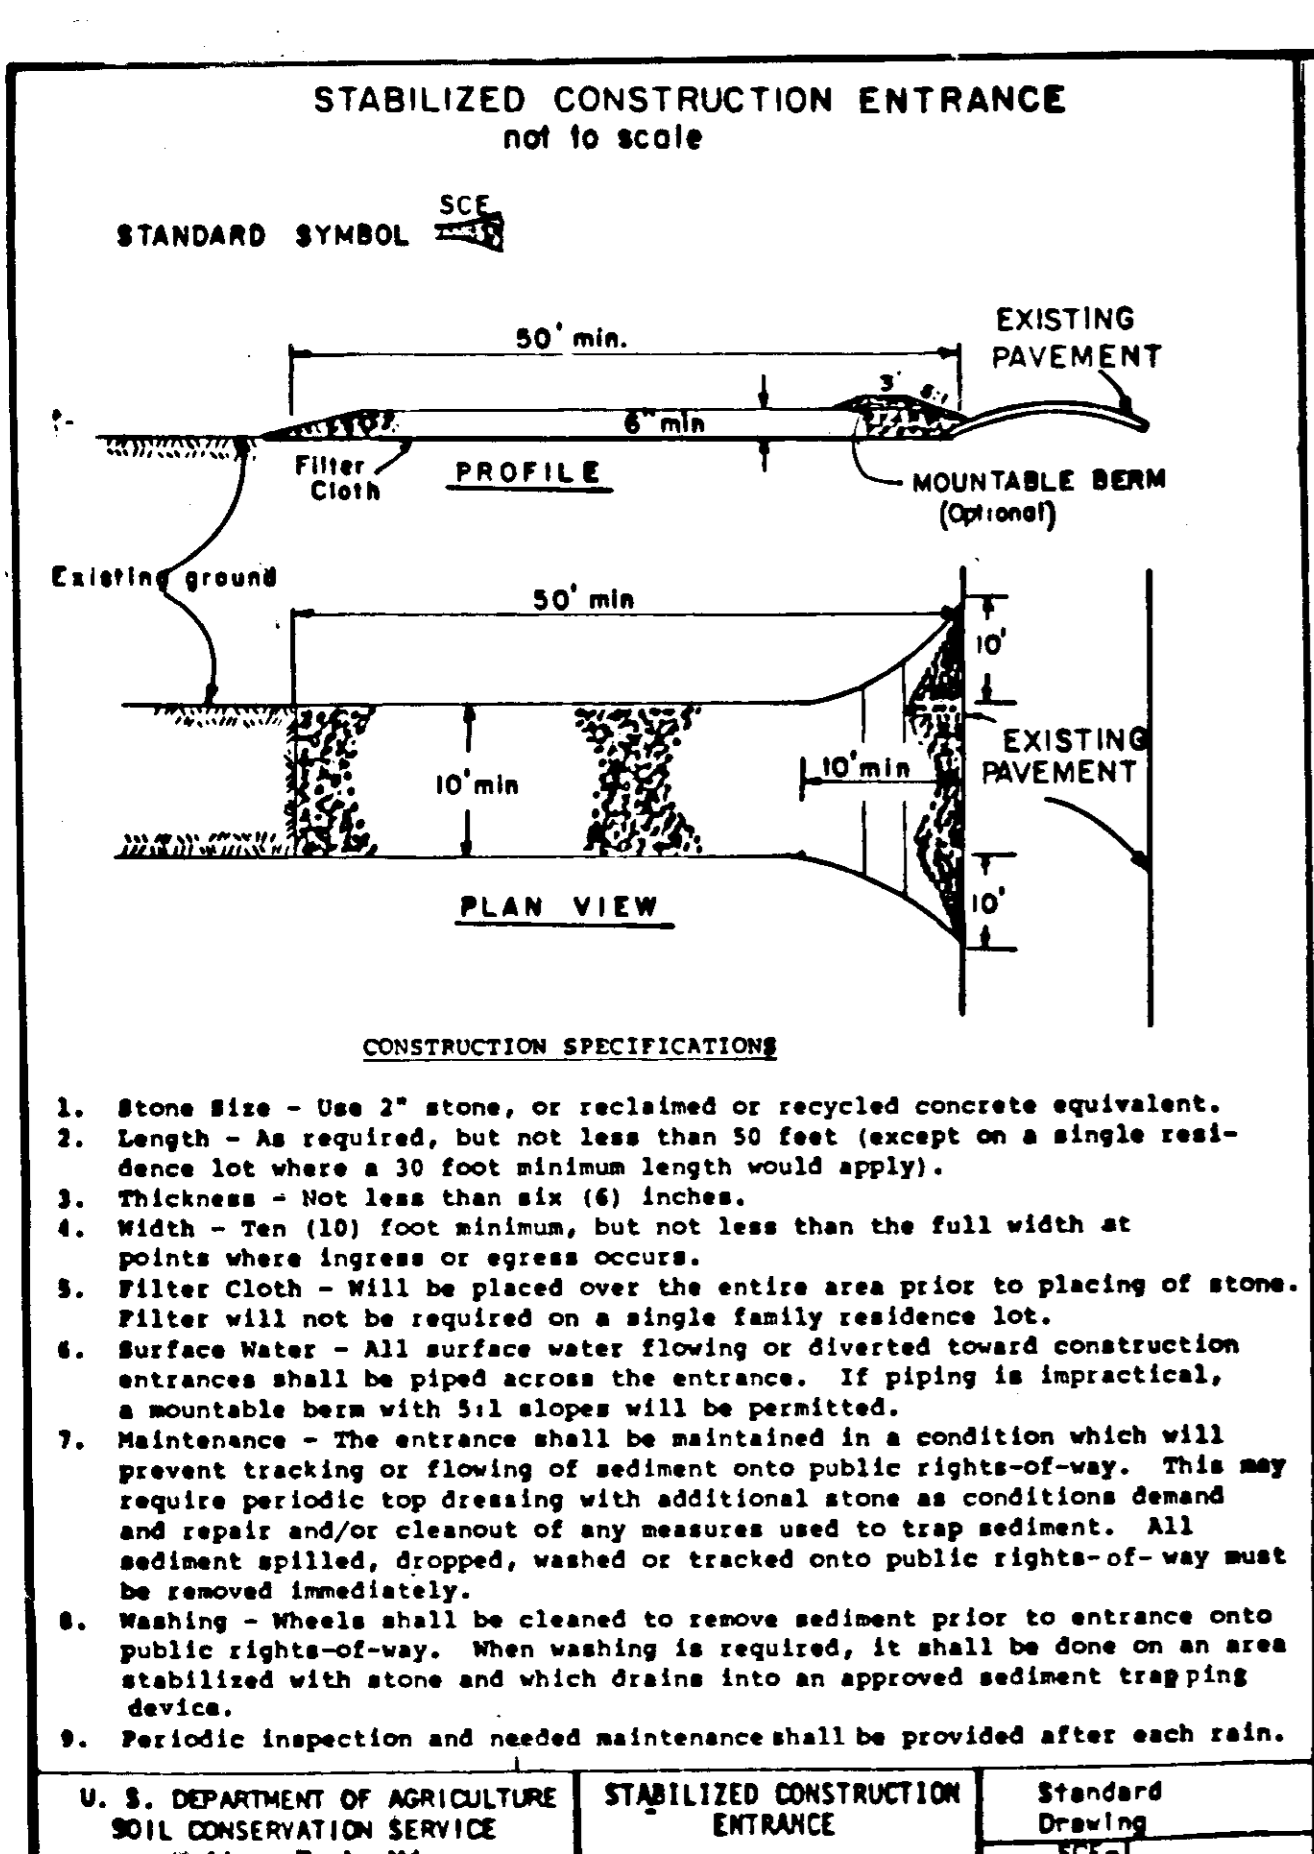

Reviewed for \_\_\_\_\_ Name \_\_\_\_\_ and meets Technical Requirements. \_\_\_\_\_ Date 10/7/86 U.S. Soil Conservation Service  
**APPROVED DIVISION OF LAND DEVELOPMENT & ZONING ADMINISTRATION HOWARD COUNTY, MARYLAND DATE 9-30-86**

- SEDIMENT AND EROSION CONTROL GENERAL NOTES**
- All work must comply with 1983 Maryland Standards and Specifications for Soil Erosion and Sediment Control...  
2. The Contractor must filter run-off, and control sediment all within the site...  
3. Tentative Plan and Schedule shown below have been approved...  
4. The developer is responsible for the acquisition of any easement...  
5. Before starting work give HCCI/SD Inspector a copy of Final Approved Plan and Schedule...  
6. Location adjustments shall be made as field conditions require...  
7. The Contractor is responsible for ensuring that all sediment control devices are functional on a day to day basis...  
8. As work progresses cut and fill slopes shall be harrowed, or tracked with a created bulldozer to create rations, to minimize erosion...  
9. Temporary stockpiles must be surrounded by straw bales...  
10. Get written approval from HCCI/SD of waste and borrow areas...  
11. Following initial soil disturbance or redistribution, permanent or temporary stabilization shall be completed within 31 calendar days...  
12. Complete final surfaces (pavements, lawns, turf, etc.)...  
13. Topsoil, permanent seeding and mulching...  
14. Disc soil to 3 inch depth, and fine grade...  
15. Disc soil to 3 inch depth, and fine grade...  
16. Mulch stabilization: Place at any time...  
17. Sequence of Construction: a) Obtain permits, meet HCCI/SD Inspector on site...


- 17(Cont) 2 weeks
- 1 Week c) Construct straw bale dike, earth dike, stabilized construction entrance and bituminous bump dike...
  - 2 Weeks d) Bring site up to grade stabilizing all slopes and mountable beam...
  - 3 Weeks e) Build curb and gutter along the east edge of parking lot...
  - 1 Month f) Construct foundation of building and wall above proposed grade...
  - 2 Weeks g) Construct drainage and infiltration system as follows: 1) 1-1 to 1-2 2) 1-2 to Sediment trap
  - 4 Weeks h) Construct curb and gutter and retaining wall along north and west parking lot...
  - 2 Weeks i) Construct drainage and infiltration system as follows: 1) 1-3 to 1-4 2) 1-4 to 1-5 3) remainder of 1-2 to 1-4
  - 2 Weeks j) Place subgrade material, pave remainder of parking lot and open inlets No. 1-3 and 1-4...
  - 2 Days k) Build temporary bituminous bump dike along Maryland Route 0.S. 1, moving sediment control entrance to limit of disturbance line...
  - 3 Weeks l) Construct curb and gutter along U.S. 1 and at entrance to site. Remove existing paving and place new subgrade material and pave U.S. 1 and initial entrance into site...
  - 1 Week m) Stabilize all remaining slopes and clean up site.
  - 5 Months n) Complete construction on new building.

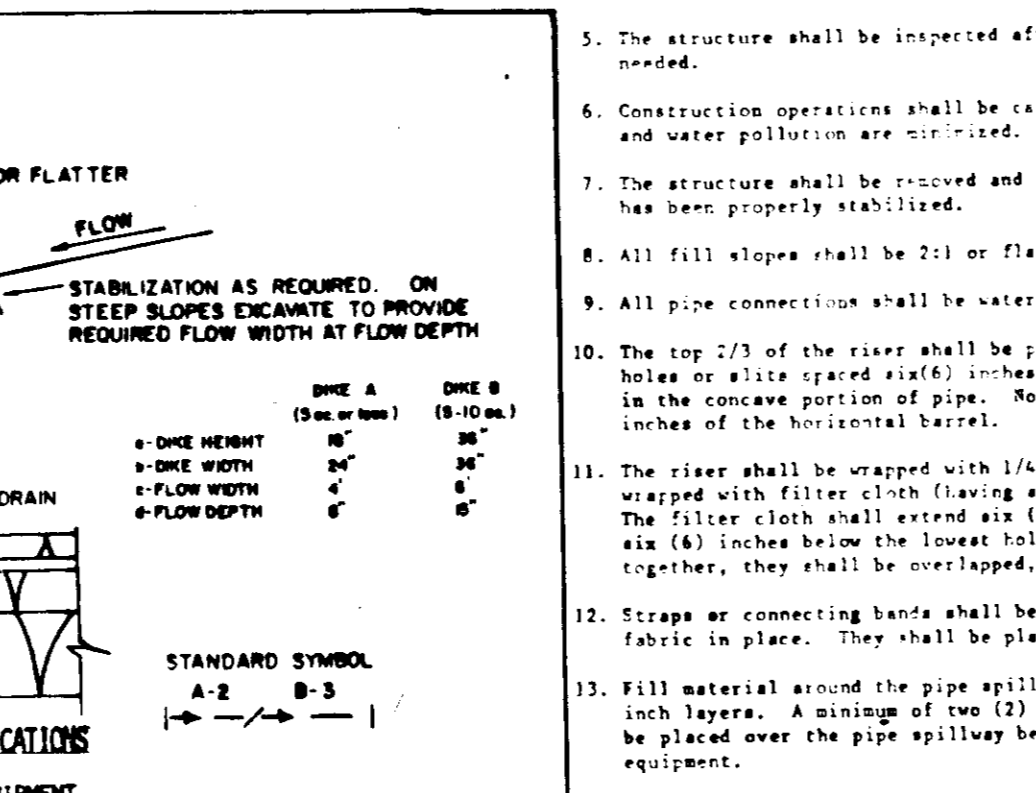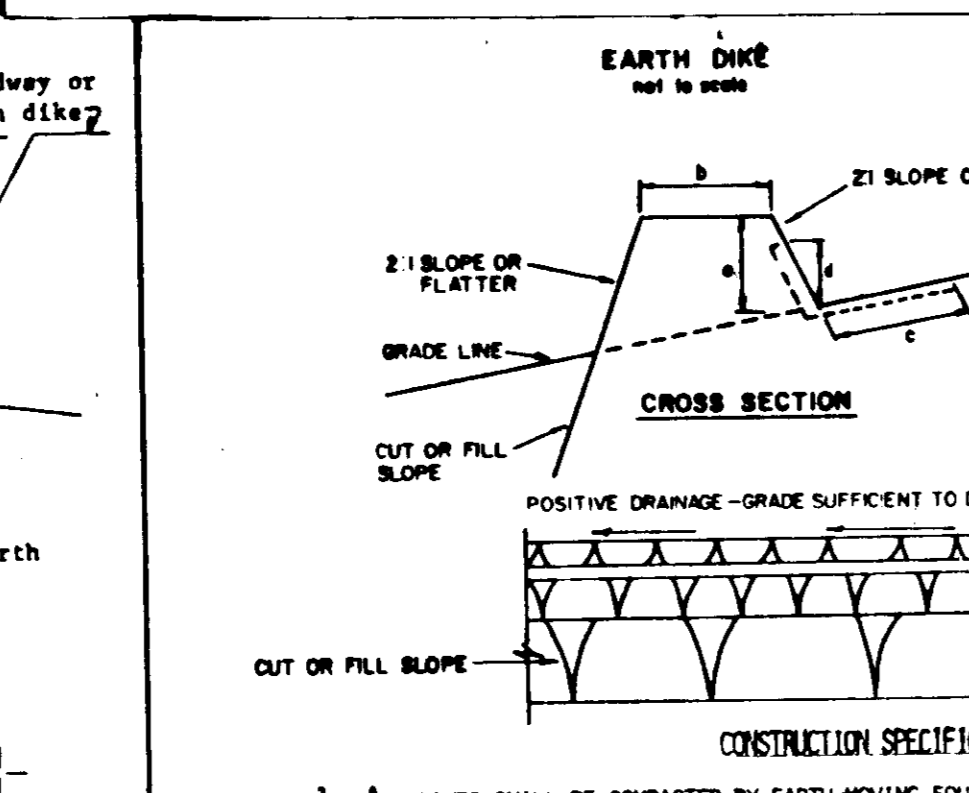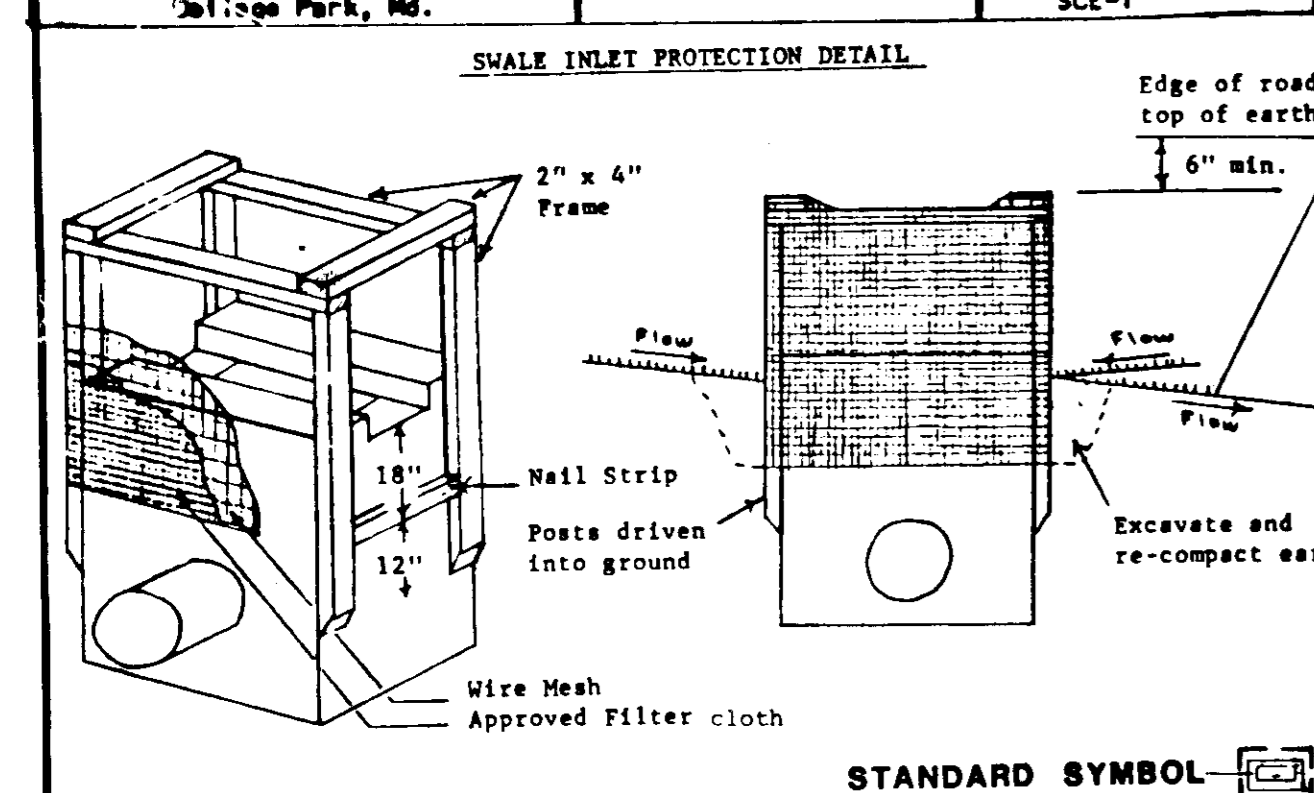

1. Area under and adjacent shall be graded and compacted...  
2. The fill material for the embankment shall be free of roots...  
3. Volume of sediment storage shall be 1800 cubic feet per acre...  
4. Sediment trap shall be constructed and installed to the original design...  
5. The structure shall be inspected after each rain and repairs made as needed...  
6. Construction operations shall be carried out in such a manner that erosion and water pollution are minimized...  
7. The structure shall be removed and area stabilized when the drainage area has been properly stabilized...  
8. All fill slopes shall be 2:1 or flatter...  
9. All pipe connections shall be watertight...  
10. The top 2/3 of the riser shall be perforated with one (1) inch diameter holes...  
11. The riser shall be wrapped with 1/4 to 1/2 inch hardware cloth...  
12. Straps or connecting bands shall be used to hold the filter cloth and wire fabric in place...  
13. Fill material around the pipe spillway shall be hand compacted...  
14. The riser shall be anchored with either a concrete base or steel plate...

Developers Certification  
"I/We certify that all development and construction will be done according to this plan, and that any responsible personnel involved in the construction project will have a Certificate of Attendance at a Department of Natural Resources Approved Training Program for the Control of Sediment and Erosion before beginning the project."  
OWNER/DEVELOPER  
AMINA LTD PARTNERSHIP  
4401 DUSTY RD  
BURLINGTON, MD 20666  
Phone: (301) 776-0666  
M. Hussein Ali (As Agent) Date 9/30/86  
Professional Engineer No. 49954


**ENGINEER'S CERTIFICATE**  
I certify that this plan for erosion and sediment control represents a practical and workable plan based on my personal knowledge of the site conditions and that it was prepared in accordance with the requirements of the Howard Soil Conservation District.  
James P. Beul  
Professional Engineer No. 49954  
Date 9/30/86

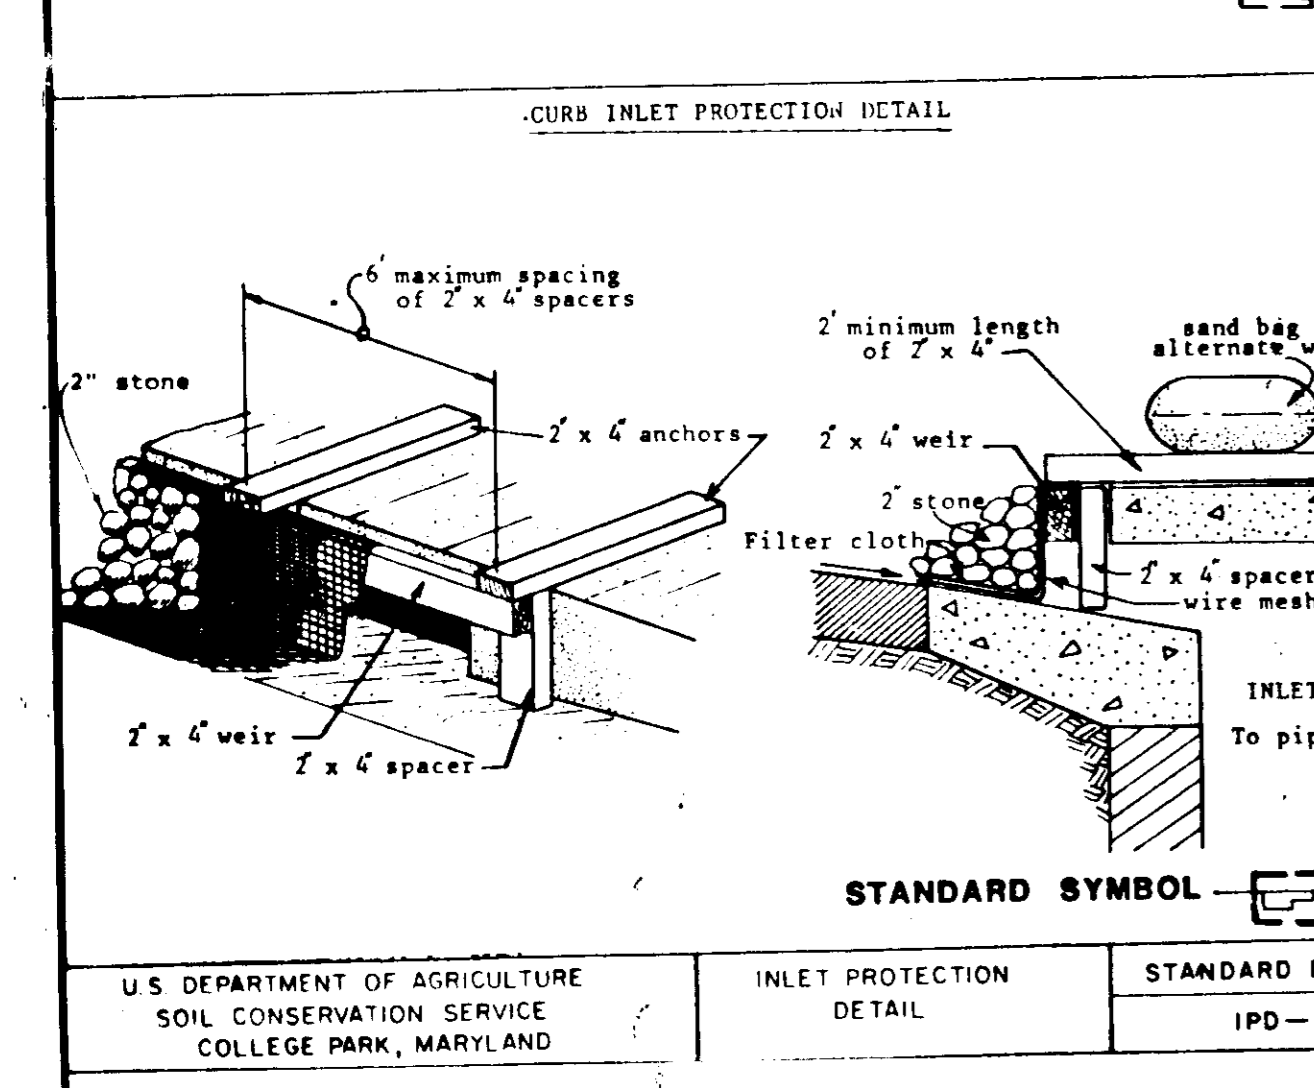

**FLUM CHANNEL STABILIZATION**

TYPE OF TREATMENT	CHANNEL SIZE	DYKE A	DYKE B
1	5-3.0m	SEED AND STRAW MULCH	SEED AND STRAW MULCH
2	3.1-5.0m	SEED AND STRAW MULCH	SEED USING LITE or EXCELSEIL; SOID; 2" STONE
3	5.1-8.0m	SEED WITH LITE, or SOID; 2" STONE	LINED RIP-RAP 4-8"
4	8.1-20m	LINED RIP-RAP 4-8"	ENGINEERING DESIGN

A. Stone to be 2 inch stone, or recycled concrete equivalent...  
B. RIP-RAP to be 4-8 inches in a layer at least 8 inches thickness...  
C. APPROVED EQUIVALENTS CAN BE SUBSTITUTED FOR ANY OF THE ABOVE MATERIALS.  
7. PERIODIC INSPECTION AND REQUIRED MAINTENANCE MUST BE PROVIDED AFTER EACH RAIN EVENT.

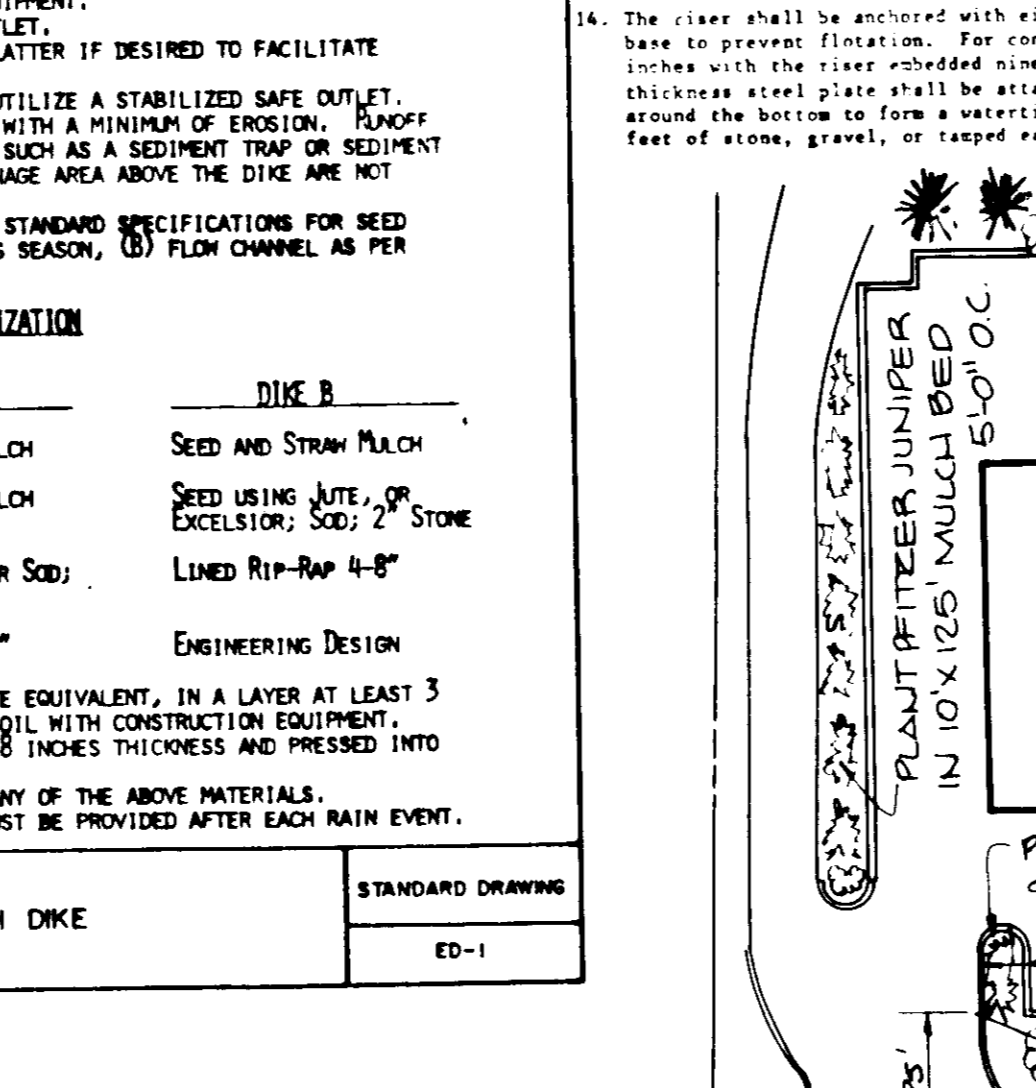

**PLANT SCHEDULE**

NO	COMMON NAME	PLANTICAL NAME	CAL.	HIGHT
8	RED MAPLE	ACER RUBUM	2-2 1/2	8'-0"
9	AMUR MAPLE	ACER GINNALA	1 1/2-2	6'-0"
17	CALIF. PRIVIT HEDGE	PRIVIT LIGUSTRUM	18"-24"	2'-4"
17	PFITZER JUNIPER	PFITZER JUNIPER	2-2 1/2	12'-14"
17	WHITE PINE	PINUS STROBUS	-	7'-0"



**LEGEND**

- RED MAPLE
- AMUR MAPLE
- CALIF. PRIVIT HEDGE
- PFITZER JUNIPER
- WHITE PINE


**SITE ANALYSIS:** TOTAL AREA OF SIZE 7.19 AC. AREA DISTURBED 1.43 AC. AREA TO BE ROOFED OR PAVED 0.90 AC. AREA TO BE VEGETATIVELY STABILIZED 0.53 AC.

CUT 3920 YDS  
FILL 1,798 YDS

Drawn By: _____	DATE: 11-21-84	REVISIONS: GENERAL BY KPA	APPROVED: JOYCE BOYLES 10/16/86 COUNTY HEALTH OFFICER	APPROVED: _____ 10-31-86 DIRECTOR	SCALE: Kennedy, porter & associates consulting engineers baltimore, maryland	SCALE: LANDSCAPING PLAN & SEDIMENT CONTROL DETAILS ECONO-LOGE LAUREL	DATE: 9-27-84
Designed By: _____	DATE: 6/30/86		APPROVED: _____ 10/20/86 DIRECTOR	APPROVED: _____ 10-15-86 CHIEF BUREAU OF ENGINEERING	Reviewed For: _____ Name _____ and meets Technical Requirements Date _____ Signature _____ U.S. Soil Conservation Service	79750 BALTIMORE WASHINGTON BOULEVARD LAUREL, MD 20810 HOWARD COUNTY TAX MAP NO. 47 PARCEL NO. 435 6TH DISTRICT	SHEET NO. SP-3 OF 4
Checked By: _____	DATE: _____		APPROVED: _____ 10/20/86 CHIEF DIVISION OF LAND DEVELOPMENT AND ZONING ADMINISTRATION		K.P.A. PROJECT NO. 84-069 467-1645		SDP-87-05

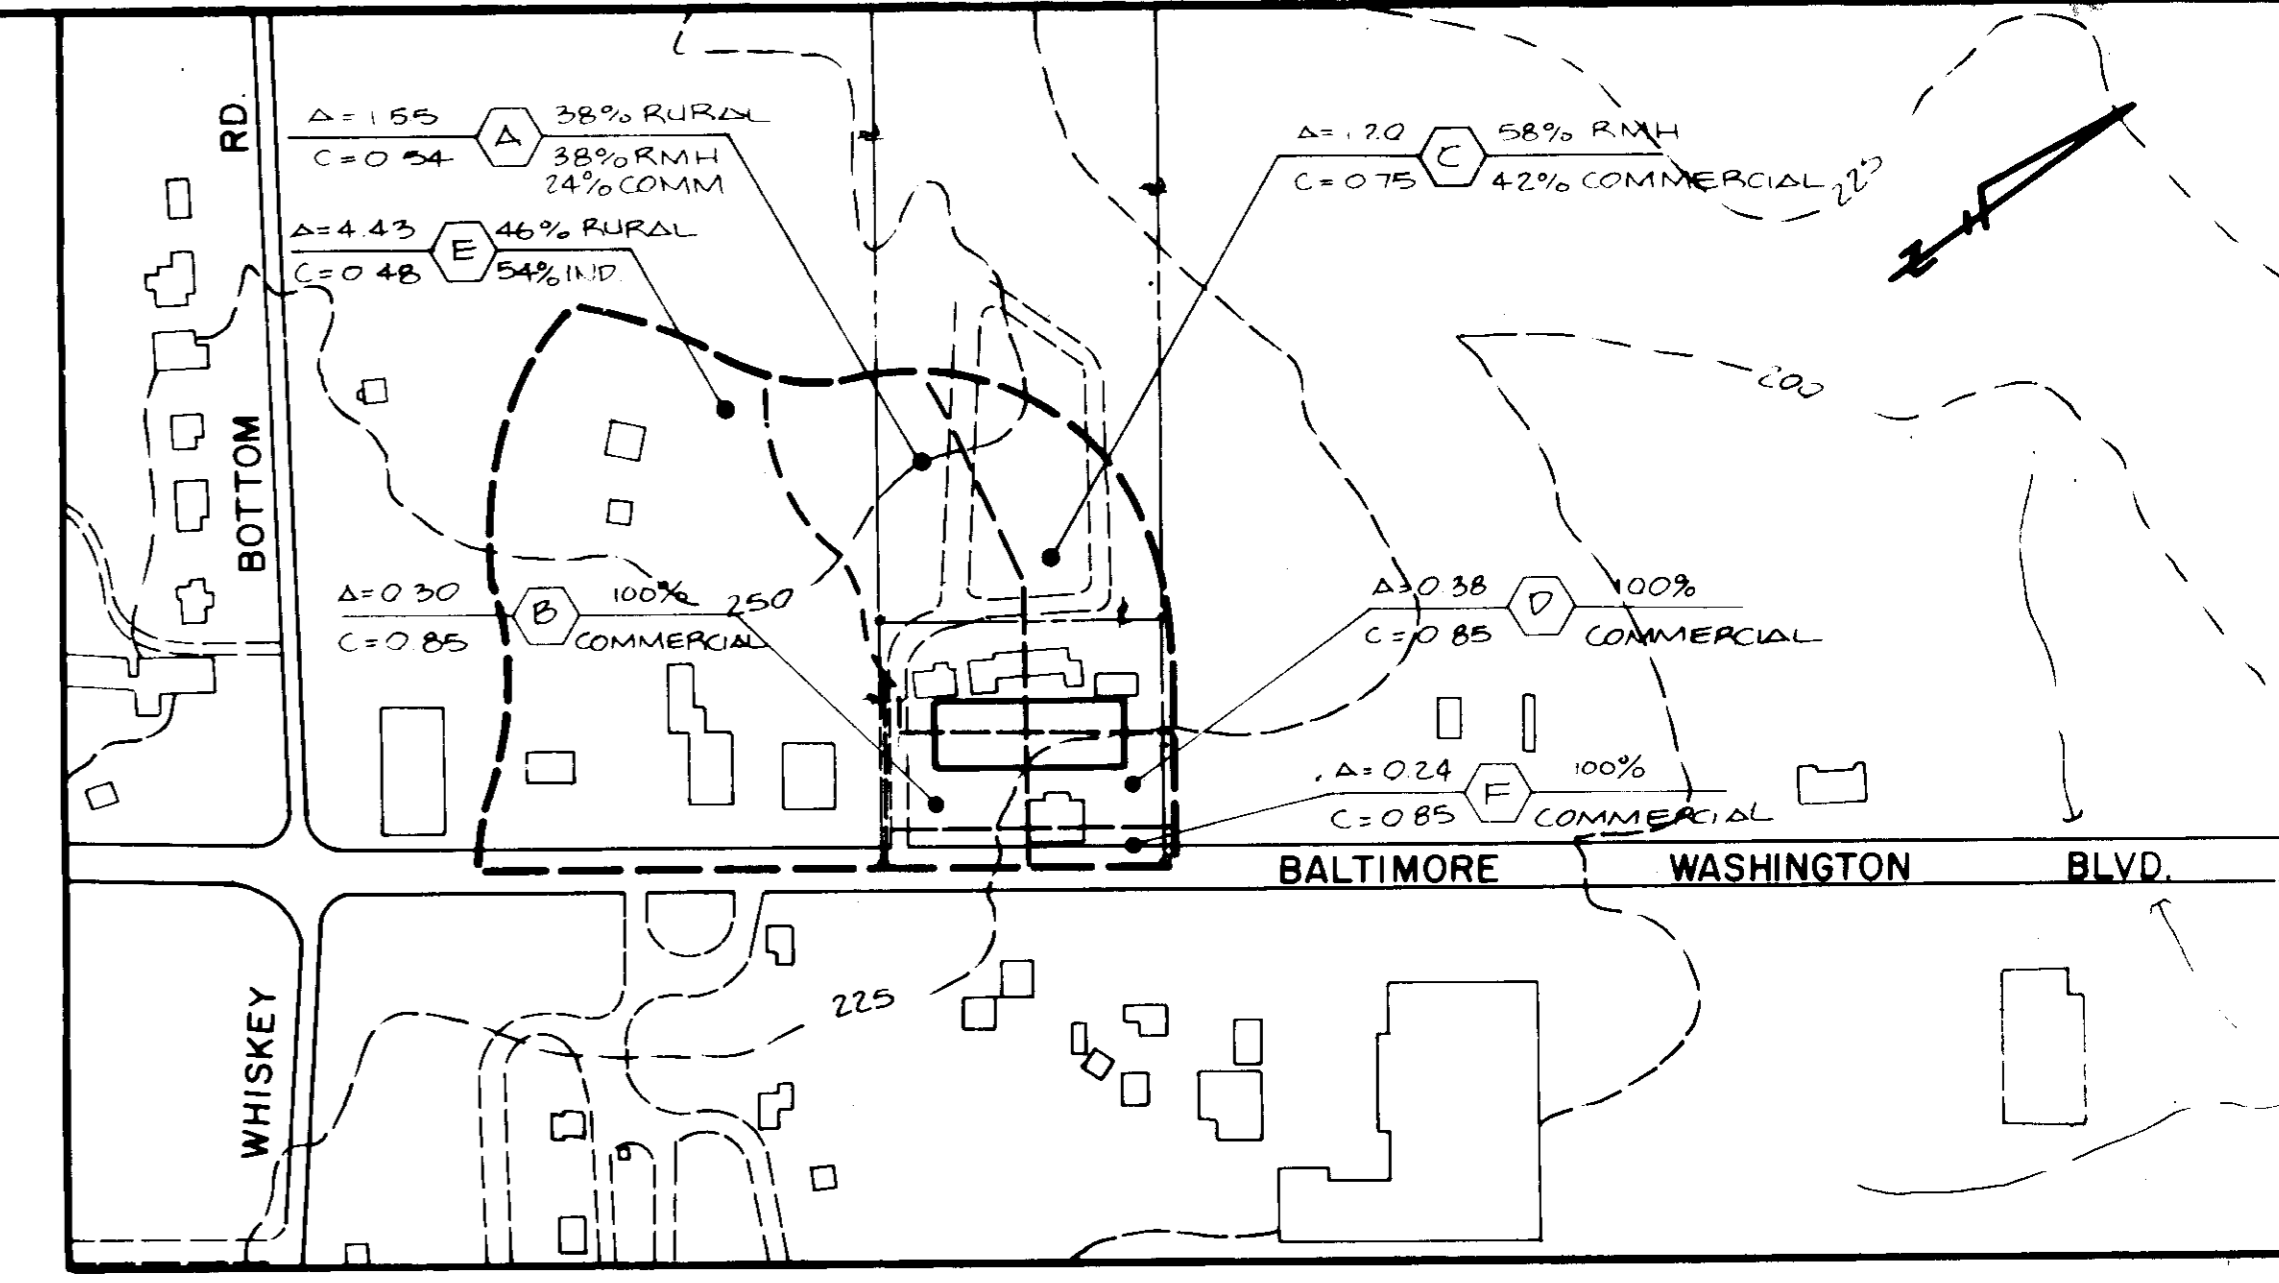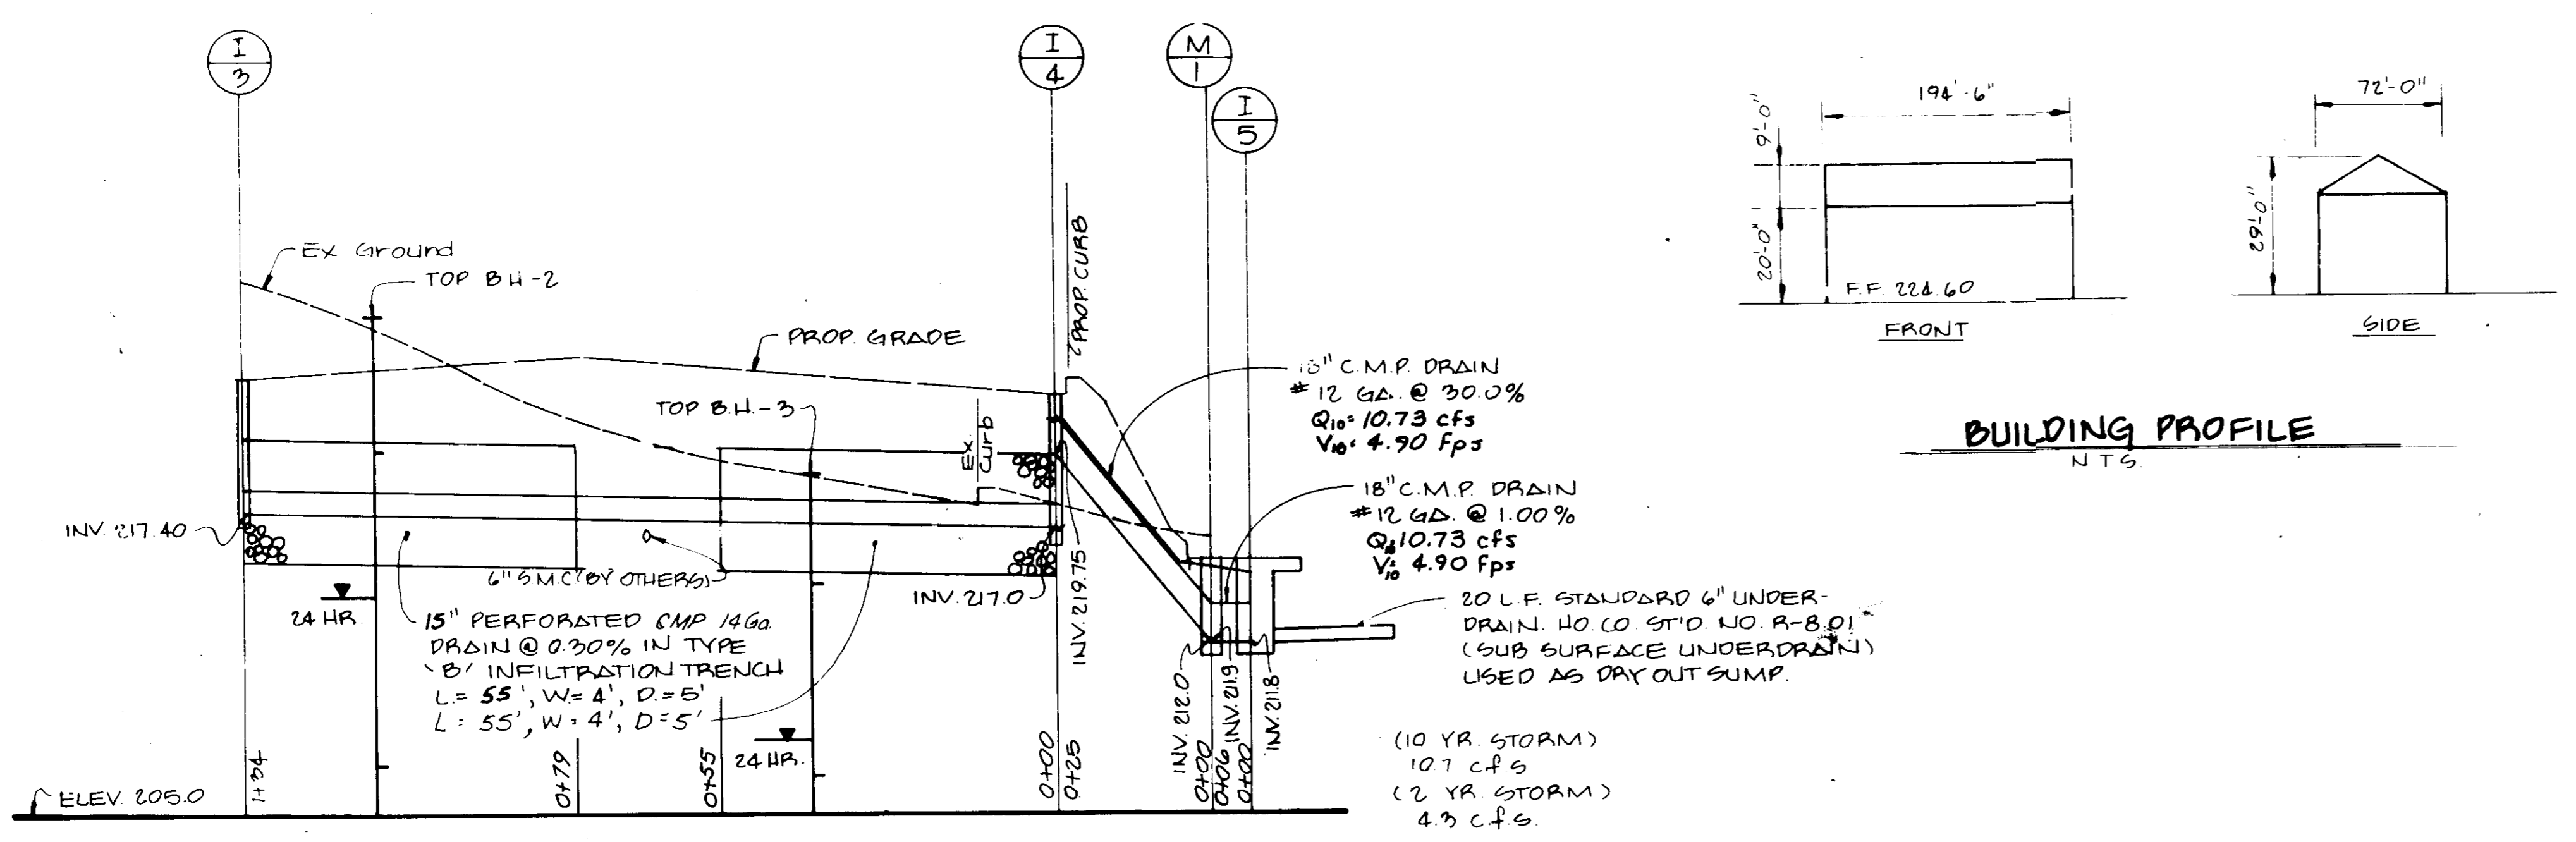

**DRAINAGE AREA MAP**  
SCALE: 1"=200'

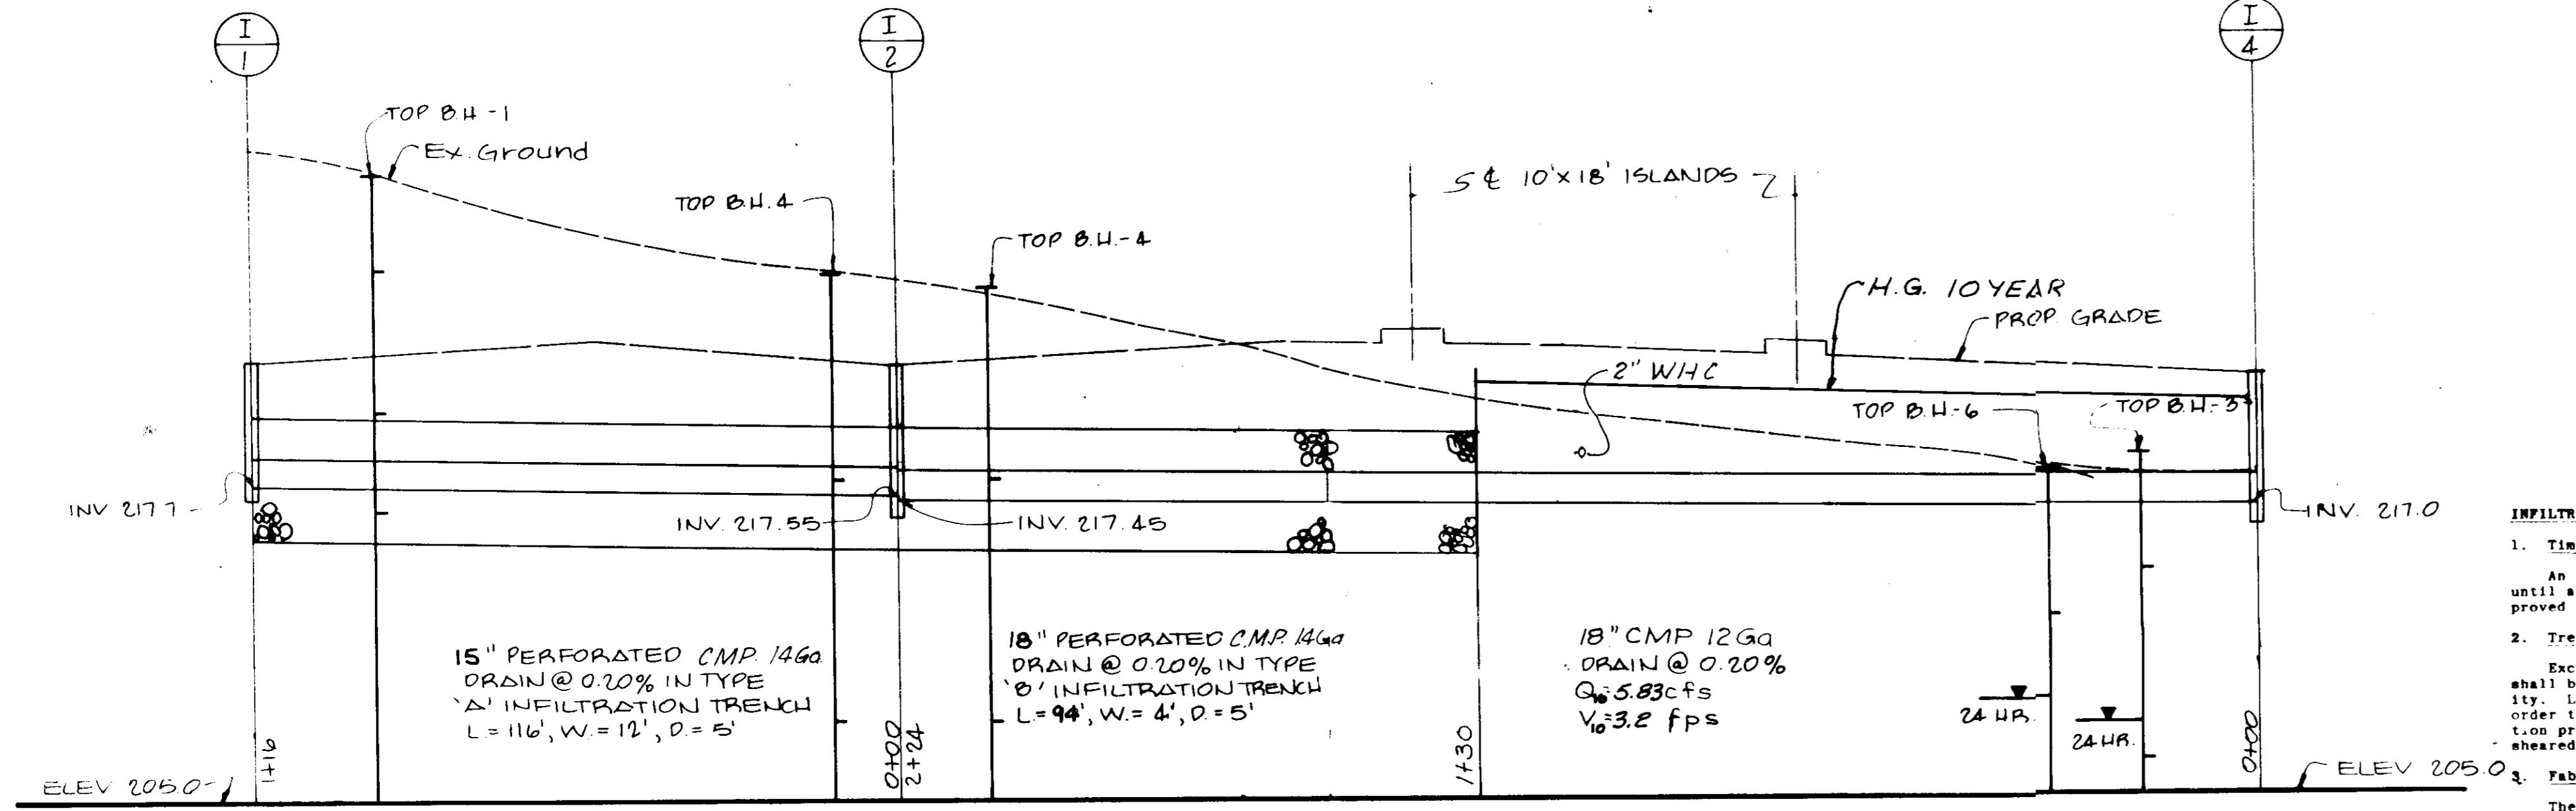

**STORM DRAINAGE PROFILES**  
SCALE: 1"=20' HOR, 1"=5' VERT.



STRUCTURE SCHEDULE						
NO	TYPE	INVERT IN	INVERT OUT	TOP ELEVATION UPPER	TOP ELEVATION LOWER	REMARKS
I-1	5' INLET W/RET.GRATE	217.70	217.70	223.20	223.20	STD S.D.-4.22 & S.D.-4.93 * ON SITE
I-2	5' INLET W/RET.GRATE	217.55	217.45	223.05	223.05	STD S.D.-4.22 & S.D.-4.93 * ON SITE
I-3	5' INLET W/RET.GRATE	217.40	217.40	223.10	223.10	STD S.D.-4.22 & S.D.-4.93 * ON SITE
I-4	'A-B' INLET	217.00	219.75	222.20	222.20	STD S.D.-4.01 * ON SITE
M-1	STD. SHALLOW M.I.	212.00	211.90	215.7	215.70	MSHA STD. MD 383.00
I-5	STD. 10' COG. INLET	211.80	-	215.6	215.50	MSHA STD. MD 374.31

\* HOWARD COUNTY STANDARD DETAILS

PIPE SCHEDULE		
SIZE	TYPE	LENGTH
15"	PERFORATED CMP	220'
15"	CMP 14 Gd	28'
18"	C.M.P. #12 GA	160'
18"	PERFORATED CMP	24'

**INFILTRATION PIPE TRENCH CONSTRUCTION SPECIFICATIONS**


- Timing**  
An infiltration trench shall not be constructed or placed in service until all of the contributing drainage area has been stabilized and approved by the responsible inspector.
- Trench Preparation**  
Excavate the trench to the design dimensions. Excavated materials shall be placed away from the trench sides to enhance trench wall stability. Large tree roots must be trimmed flush with the trench sides in order to prevent fabric puncturing or tearing during subsequent installation procedures. The side walls of the trench shall be roughened where abraded and sealed by heavy equipment.
- Fabric Laydown**  
The filter fabric roll must be cut to the proper width prior to installation. The cut width must include a 6-inch overlap to conform to trench perimeter irregularities and for a 6-inch overlap. Place the fabric roll over the trench and unroll a sufficient length to allow placement of the fabric down into the trench. Stones or other anchoring objects should be placed on the fabric at the edge of the trench to keep the lined trench open during windy periods. When overlaps are required between rolls, the upstream roll should lap a minimum of 2 feet over the downstream roll in order to provide a shingled effect. The overlap ensures fabric continuity or to ensure that the fabric conforms to the excavation surface during aggregate placement and compaction.
- Stone Aggregate Placement and Compaction**  
The stone aggregate should be placed in lifts and compacted using plate compactors. As a rule of thumb, a maximum loose lift thickness of 12 inches is recommended. The compaction process ensures a fabric conformity to the excavation sides, thereby reducing the potential for soil piping, fabric clogging, and settlement problems. Drainage pipe shall be placed in the trench at the plan elevation.
- Overlapping and Covering**  
Following the stone aggregate placement, the filter fabric shall be folded over the stone aggregate to form a 6" minimum longitudinal lap. The desired fill soil or stone aggregate shall be placed over the lap at sufficient intervals to maintain the lap during subsequent backfilling.
- Contamination**  
Care shall be exercised to prevent natural or fill soils from intermixing with the stone aggregate. All contaminated stone aggregate shall be removed and replaced with uncontaminated stone aggregate.
- voids Behind Fabric**  
voids can be created between the fabric and excavation sides and shall be avoided. Removing boulders or other obstacles from the trench walls is one source of such voids. Natural soils should be placed in these voids at the most convenient time during construction to ensure fabric conformity to the excavation sides. Soil piping, fabric clogging, and possible surface subsidence will be avoided by this remedial process.
- Unstable Excavation Sides**  
Vertically excavated walls may be difficult to maintain in areas where the soil moisture is high or where soft cohesive or cohesionless soils predominate. These conditions may require laying back of the side slopes to maintain stability; trapezoidal rather than rectangular cross sections may result.
- Buffer**  
A vegetative buffer of at least 20 feet (wider, if possible) shall be used to intercept surface runoff from all impervious areas. Where no buffer exists, use a temporary straw bale dike.
- Traffic Control**  
Heavy equipment and traffic shall be restricted from travelling over the infiltration area to minimize compaction of the soil.
- Maintenance**  
Infiltration trenches are designed to minimize maintenance, but the performance and longevity of these structures is not well documented. Consequently, monitoring is required for the infiltration inlet structures.  
The inlets shall be monitored periodically. For the first year after completion of construction, the inlets should be monitored on a quarterly basis and after every large storm. It is recommended that a log book be maintained indicating the date at which the facility dewaters after large storms and the depth of water in the inlet for each observation. Once the performance characteristics of the structure have been verified, the monitoring schedule can be reduced to an annual basis, unless the performance data indicate that a more frequent schedule is required.  
Sediment build-up in the surface inlet should be monitored on the same schedule as the observation well. Sediment deposited shall not be allowed to build up to the point where it will reduce the rate of infiltration into the trench.

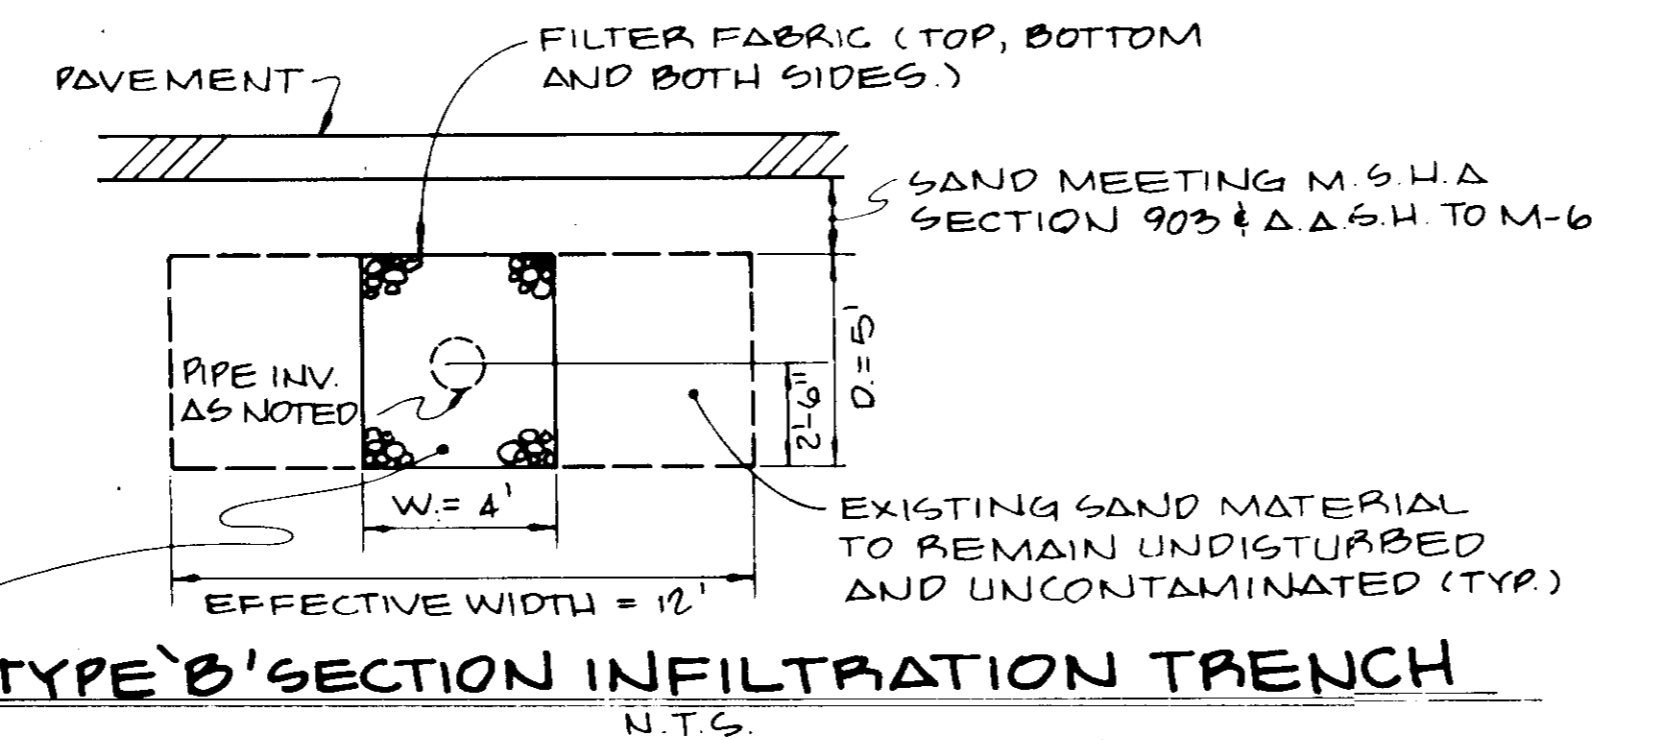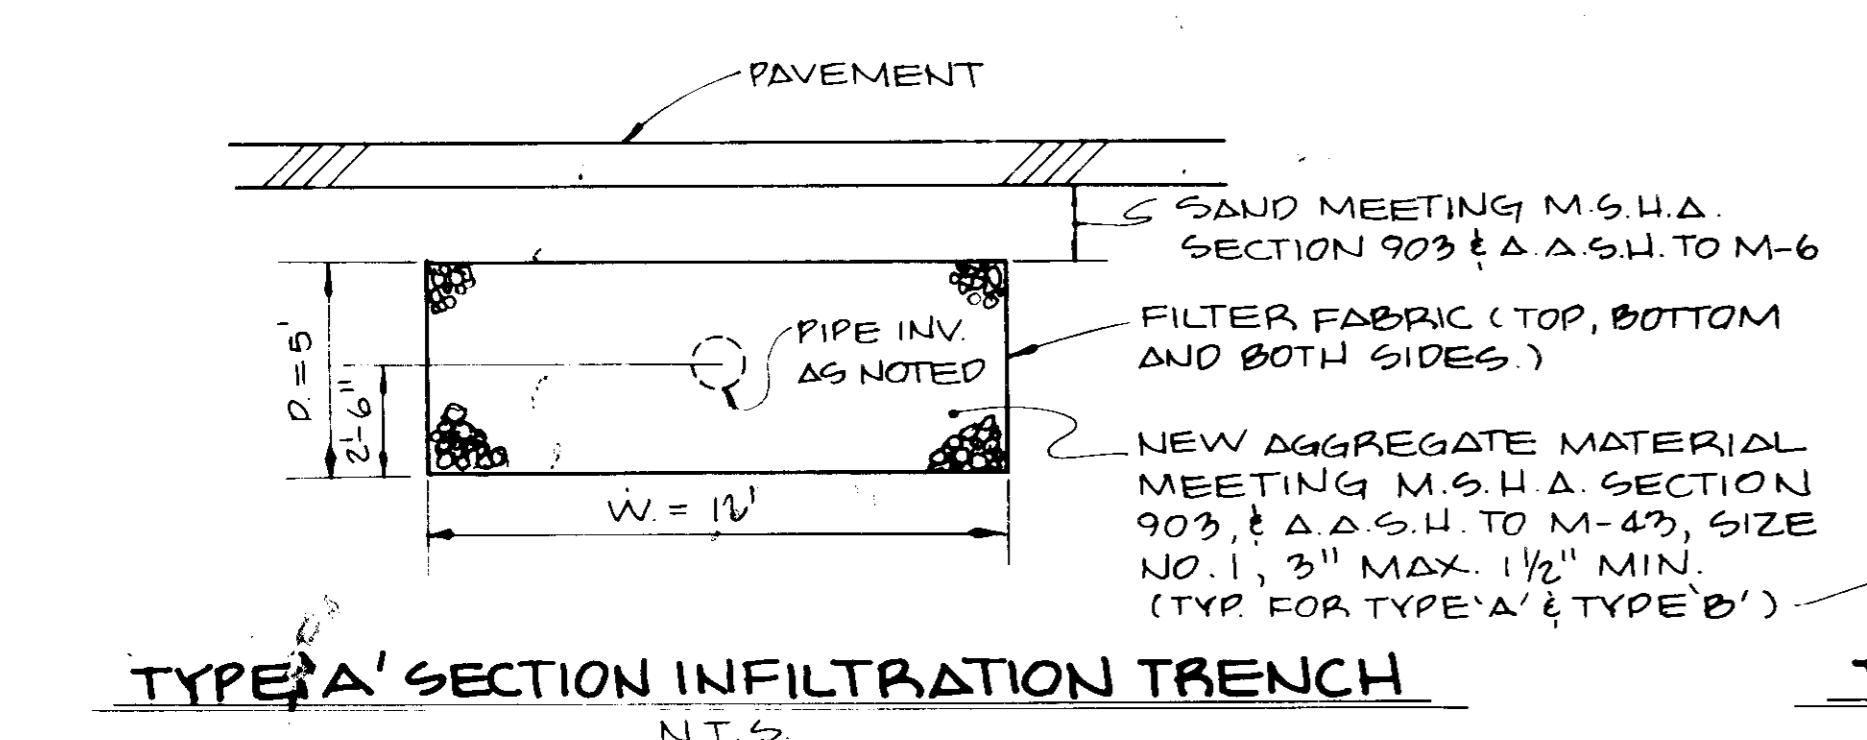

**OWNER/DEVELOPER**  
AMINA LTD PARTNERSHIP  
4401 Dustin Road  
Burtonsville, Md. 20866  
Resident Agent: Mirza Hussain Ali Baig  
Phone: (301) 776-0666


**ENGINEER'S CERTIFICATE**  
I certify that this plan for erosion and sediment control represents a practical and workable plan based on my personal knowledge of the site conditions and that it was prepared in accordance with the requirements of the Howard Soil Conservation District.  
*James P. Beal*  
JAMES P. BEAL 0954  
9/30/86

Drawn By: <i>JMB</i>	DATE: 11-21-84	REVISIONS: GENERAL BY KPA	APPROVED: FOR PUBLIC WATER AND PUBLIC SEWERAGE SYSTEM HOWARD COUNTY HEALTH DEPARTMENT <i>James P. Beal</i> 10-16-85 COUNTY HEALTH OFFICER	APPROVED: FOR PUBLIC WATER AND PUBLIC SEWERAGE STORM DRAINAGE SYSTEMS & PUBLIC ROADS HOWARD COUNTY DEPARTMENT OF PUBLIC WORKS <i>James P. Beal</i> 10-16-85 DIRECTOR	Kennedy, porter & associates consulting engineers baltimore, maryland 2319 MARYLAND AVE. BALTIMORE, MARYLAND 21218 K.P.A. PROJECT NO. 84-069 467-1645	SCALE: AS NOTED	<b>DRAINAGE &amp; MISCELLANEOUS DETAILS</b> ECONO-LODGE LAUREL 9750 BALTIMORE WASHINGTON BOULEVARD LAUREL, MD 20810 HOWARD COUNTY TAX MAP NO.47 PARCEL NO. 435 6TH DISTRICT	DATE: 9-27-84 Rev 9/30/86 SHEET NO. SP-2 2 OF 4
----------------------	----------------	---------------------------	---	--	--	-----------------	--	--

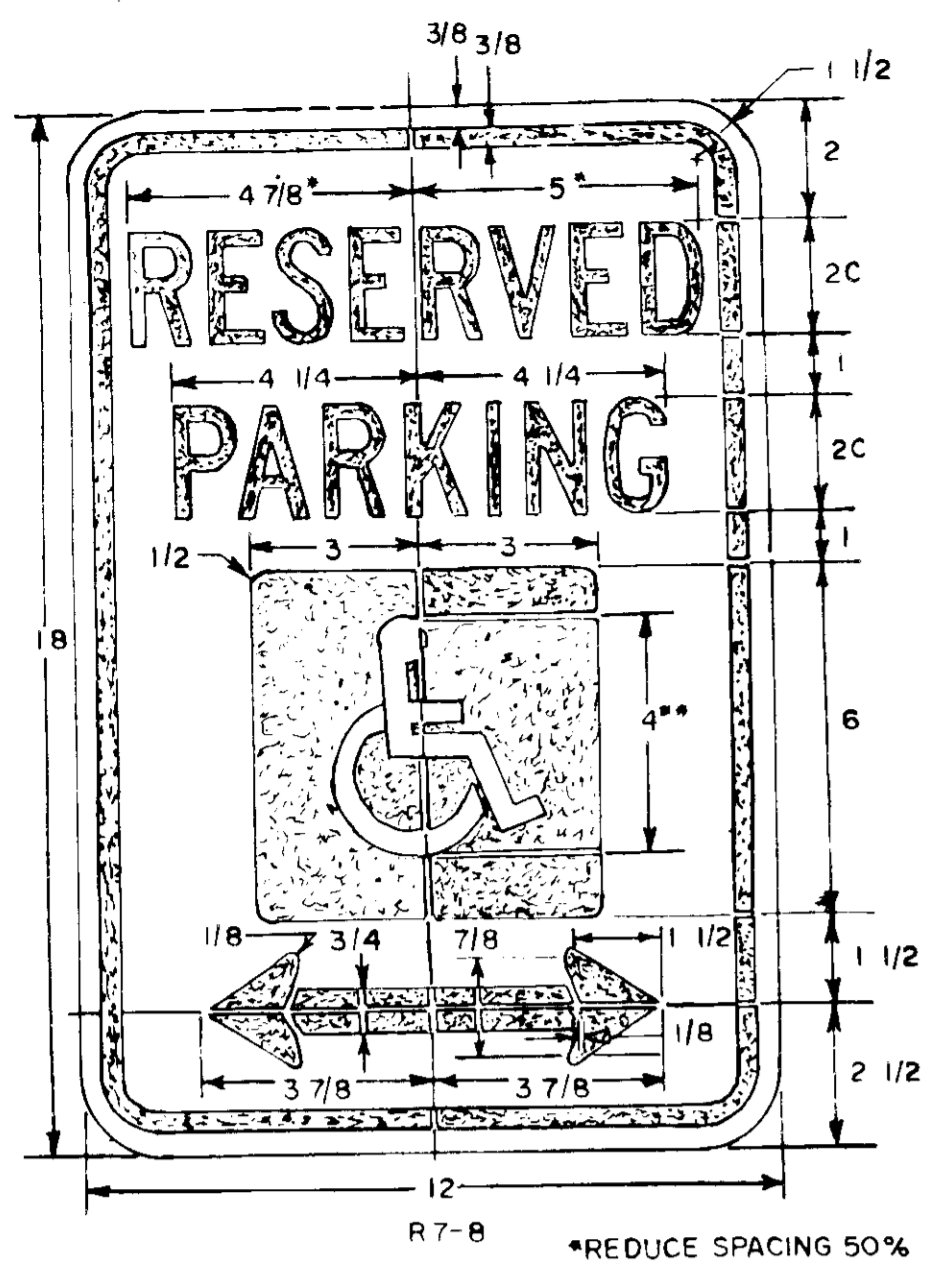


COLORS  
LEGEND AND BORDER - GREEN  
WHITE SYMBOL ON BLUE BACKGROUND  
BACKGROUND - WHITE

**A HANDICAP SIGN**  
N.T.S.

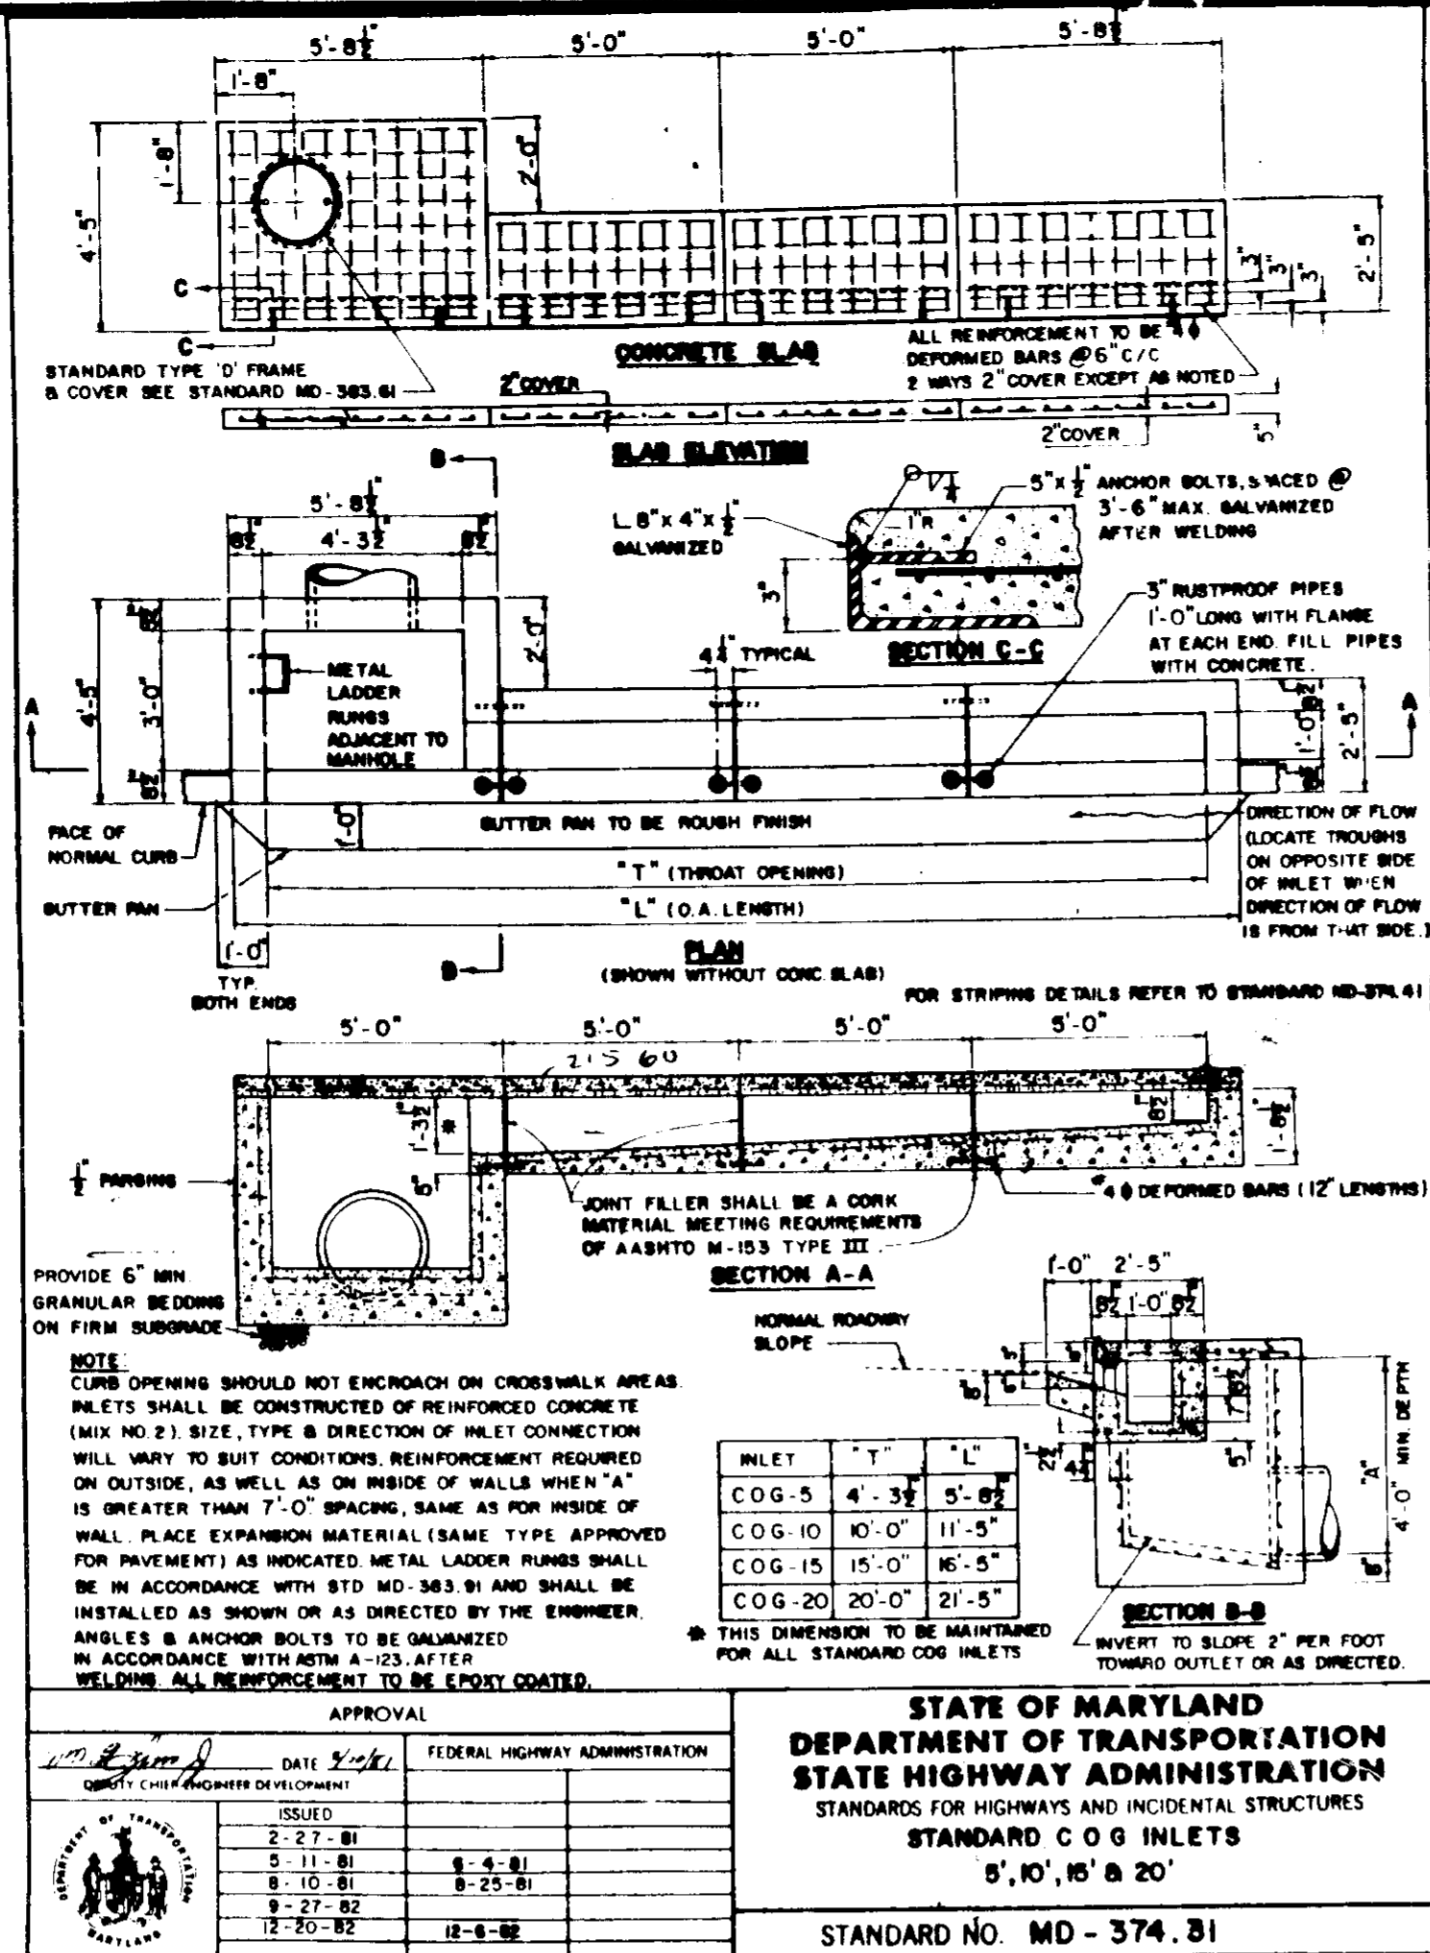

1. SIGN TO UTILIZE AN ALUMINUM BLANK 6" x 12" x 0.080 INCH THICK WITH TWO (2) SINGLE POST MOUNTING HOLES.  
2. THE TEXT AND BORDER SHALL BE STANDARD GREEN TO MATCH THAT ON R7-8 AND THE BACKGROUND SHALL BE REFLECTIVE WHITE. TEXT SHALL BE IN 3" CHARACTERS.

**B VIOLATION SIGN NOTATION**  
N.T.S.

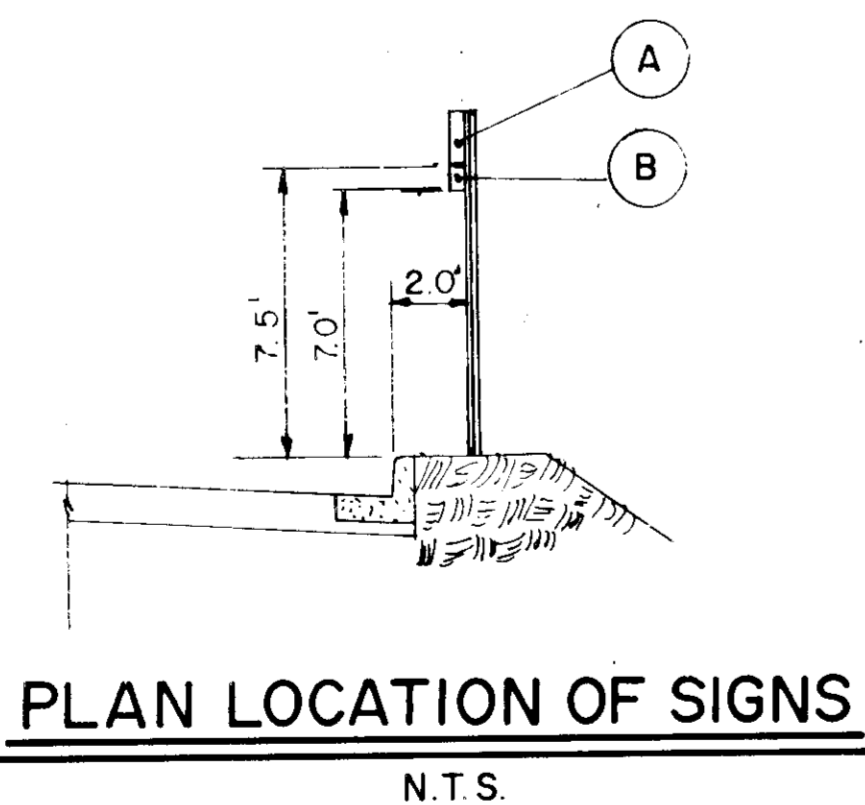

APPROVED  
DIVISION OF LAND DEVELOPMENT  
ZONING ADMINISTRATION  
HOWARD COUNTY MARYLAND  
DATE 9-30-86

Drawn By:	DATE	REVISIONS	APPROVED FOR PUBLIC WATER AND PUBLIC SEWERAGE SYSTEM. HOWARD COUNTY HEALTH DEPARTMENT DATE 10-16-86	APPROVED FOR PUBLIC WATER AND PUBLIC SEWERAGE STORM DRAINAGE SYSTEMS & PUBLIC HEALTH. HOWARD COUNTY DEPARTMENT OF PUBLIC WORKS DATE 10-15-86	Kennedy, Porter & Associates Consulting Engineers Baltimore, Maryland 2319 MARYLAND AVENUE BALTIMORE, MARYLAND 21218 K. P. A. PROJECT NO. 84-069 (301) 467-1645	SCALE:	MISCELLANEOUS DETAILS ECONO-LODGE LAUREL 9750 BALTIMORE WASHINGTON BOULEVARD LAUREL, MD. 20810 HOWARD COUNTY	DATE: 9-30-86 Rev. 9/30/86
Designed By:			APPROVED: HOWARD COUNTY OFFICER OF PLANNING & ZONING DATE 10-20-86	DIRECTOR DATE 10-15-86			TAX MAP NO. 47 PARCEL NO. 435 6TH ELECTION DISTRICT	SHEET NO. SP-4 4 OF 4
Checked By:			DIRECTOR DATE 10-20-86	CHIEF BUREAU OF ENGINEERING				SDP-87-05