

SEEDING NOTES

Apply to graded or cleared areas not subject to immediate further disturbance where a permanent long-lived vegetative cover is needed, if not previously loosened.

Seeded Preparation Loosen upper three inches of soil by raking, disking or other acceptable means before seeding.

Soil Amendments In lieu of soil test recommendations, use one of the following schedules:

- 1) Preferred - Apply 2 tons per acre dolomitic limestone (92 lbs/1000 square ft) and 600 lbs per acre 10-10-10 fertilizer (14 lbs/1000 sq ft) before seeding. Narrow or disc into upper three inches of soil. At time of seeding, apply 400 lbs per acre 30-0-0 ureaform fertilizer (9 lbs/1000 sq ft).
- 2) Acceptable - Apply 2 tons per acre dolomitic limestone (92 lbs/1000 sq ft) and 1000 lbs per acre 10-10-10 fertilizer (23 lbs/1000 sq ft) before seeding. Narrow or disc into upper three inches of soil.

Seeding - For the periods March 1 thru April 30, and August 1 thru October 15, seed with 60 lbs per acre (14 lbs/1000 sq ft) of Kentucky 31 Tall Fescue. For the period May 1 thru July 31, seed with 60 lbs Kentucky 31 Tall Fescue per acre and 2 lbs per acre (.05 lbs/1000 sq ft) of weeping lovegrass. During the period of October 16 thru February 28, protect site by Option (1) 2 tons per acre of well anchored straw mulch and seed as soon as possible in the spring. Option (2) Use sod. Option (3) Seed with 60 lbs/acre Kentucky 31 Tall Fescue and mulch with 2 tons/acre well anchored straw.

Mulching - Apply 1 1/2 to 2 tons per acre (70 to 90 lbs/1000 sq ft) of unrotted small grain straw immediately after seeding. Anchor mulch immediately after application using mulch anchoring tool or 218 gallons per acre (8 gal/1000 sq ft) of emulsified asphalt on flat areas. On slopes 8 feet or higher, use 348 gallons per acre (8 gal/1000 sq ft) for anchoring.

Maintenance - Inspect all seeded areas and make needed repairs, replacements and reseedings.

TEMPORARY SEEDING NOTES

Apply to graded or cleared areas likely to be redisturbed where a short-term vegetative cover is needed.

Seeded Preparation Loosen upper three inches of soil by raking, disking or other acceptable means before seeding, if not previously loosened.

Soil Amendments Apply 600 lbs per acre 10-10-10 fertilizer (14 lbs/1000 sq ft).

Seeding - For periods March 1 thru April 30, and from August 15 thru November 15, seed with 25 bushel per acre of annual ryegrass (2 lbs/1000 sq ft). For the period May 1 thru August 14, seed with 3 lbs per acre of weeping lovegrass (0.07 lbs/1000 sq ft). From November 16 thru February 28, protect site by apply 2 tons per acre of well anchored straw mulch and seed as soon as possible in the spring, or use sod.

Mulching - Apply 1 1/2 to 2 tons per acre (70 to 90 lbs/1000 sq ft) of unrotted small grain straw immediately after seeding. Anchor mulch immediately after application using mulch anchoring tool or 218 gal per acre (8 gal/1000 sq ft) of emulsified asphalt on flat areas. On slopes, 8 ft or higher, use 348 gal per acre (8 gal/1000 sq ft) for anchoring.


Refer to the 1983 MARYLAND STANDARDS AND SPECIFICATIONS FOR SOIL EROSION AND SEDIMENT CONTROL for rate and methods not covered.

SEDIMENT CONTROL NOTES

- 1) A minimum of 24 hours notice must be given to the Howard County Office of Inspection and Permits prior to the start of any construction. (992-2437)
- 2) All vegetation and structural practices are to be installed according to the provisions of this plan and are to be in conformance with the 1983 MARYLAND STANDARDS AND SPECIFICATIONS FOR SOIL EROSION AND SEDIMENT CONTROL.
- 3) Following initial soil disturbance or redisturbance, permanent or temporary stabilization shall be completed within 30 calendar days for all permanent sediment control structures, dikes, perimeter slopes and all slopes greater than 3:1, 14 days as to all other disturbed or graded areas on the project site.
- 4) All sediment traps/basins shown must be fenced and warning signs posted around their perimeter in accordance with Vol. 1, Chapter 12 of the HOWARD COUNTY DESIGN MANUAL, Storm Drainage.
- 5) All disturbed areas must be stabilized within the time period specified above in accordance with the 1983 MARYLAND STANDARDS AND SPECIFICATIONS FOR SOIL EROSION AND SEDIMENT CONTROL for permanent easements (Sec. 51) sod (Sec. 54), temporary seeding (Sec. 50) and mulching (Sec. 52). Temporary stabilization with mulch alone can only be done when recommended seeding dates do not allow for proper germination and establishment of grasses.
- 6) All sediment control structures are to be placed in place and are to be maintained in operative condition until permission for their removal has been obtained from the Howard County Sediment Control Inspector.
- 7) Site Analysis:
 - Total Area of Site: 0.081 Acres
 - Area Disturbed: 0.267 Acres
 - Area to be seeded or paved: 0.127 Acres
 - Area to be vegetatively stabilized: 0.240 Acres
 - Total Cut: 444.0 Cu. Yds
 - Total Fill: 242.0 Cu. Yds
 - Off-site waste/borrow area location: N/A
- 8) Any sediment control practice which is disturbed by grading activity for placement of utilities must be repaired on the same day of disturbance.
- 9) Additional sediment control must be provided, if deemed necessary by the Howard County Sediment Control Inspector.
- 10) On all sites with disturbed areas in excess of 2 acres, approval of the inspection agency shall be requested upon completion of installation of perimeter erosion and sediment controls, but before proceeding with any other earth disturbance or grading. Other building or grading inspection approvals may not be authorized until this initial approval by the inspection agency is made.
- 11) If houses are to be constructed on "hold" basis, at random, Single Lot Sediment Control as shown below shall be implemented, N/A.
- 12) All pipes to be blocked at the end of each day (see detail below) N/A.
- 13) The total amount of straw bale dikes/silt fence equals 230 LF.

CONSTRUCTION SEQUENCE:


Activity	No. of Days
A. Obtain Grading Permit and Install Sediment and Erosion Control Devices and Stabilize.	7
B. Excavate for foundations and Rough Grade & temporarily stabilize.	14
C. Construct Structures, Sidewalks and Driveways.	60
D. Final Grade and stabilize in accordance with Stds & Specs.	14
E. Upon approval of the sediment control inspector remove sediment and erosion controls and stabilize.	14

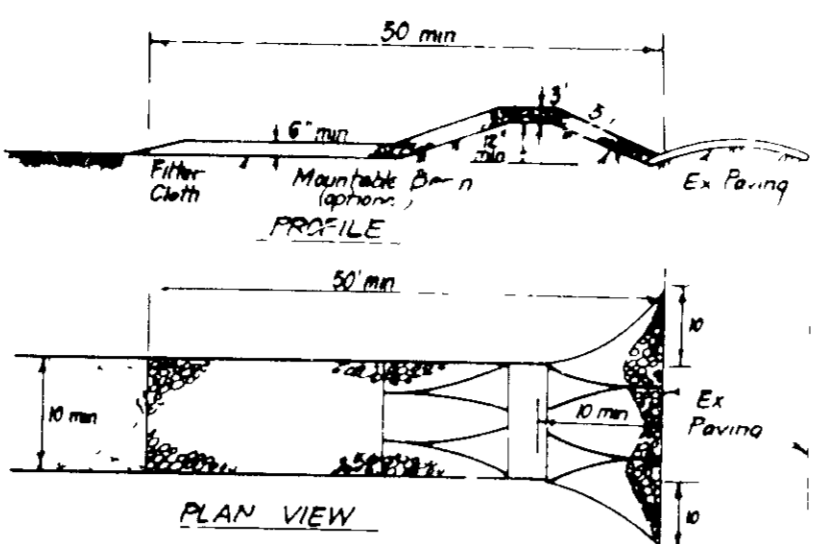

CONSTRUCTION SPECIFICATIONS

1. Stone Size - Use 2" stone, or recycled concrete equivalent.
2. Length - As required, but not less than 50 feet (except on a simple residence lot where a 30 foot minimum length would apply).
3. Thickness - Not less than six (6) inches.
4. Width - Ten (10) feet minimum, but not less than the full width of points where ingress or egress occurs.
5. Filter Cloth - Will be required over the entire area prior to placing of stone. Filter will not be required on simple family residential.
6. Surface Water - All surface water flowing or diverted toward construction entrances shall be piped across the entrance. If piping is impractical, a manhole basin with a 5% slope will be permitted.
7. Maintenance - The entrance shall be maintained in a condition which will prevent tracking or flowing of sediment onto public rights-of-way. This may require periodic top dressing with additional stone for sand/stone damaged and repair and/or cleaning of any measure used to trap sediment. All sediment applied, dressed, washed or tracked onto public rights-of-way must be removed immediately.
8. Washing - Wheels shall be cleaned to remove sediment prior to entrance onto public rights-of-way. When washing is required, it shall be done on an area stabilized with straw or which drains into an approved sediment trapping device.
9. Periodic inspection and needed maintenance shall be provided after each rain.


STABILIZED CONSTRUCTION ENTRANCE (SCE)

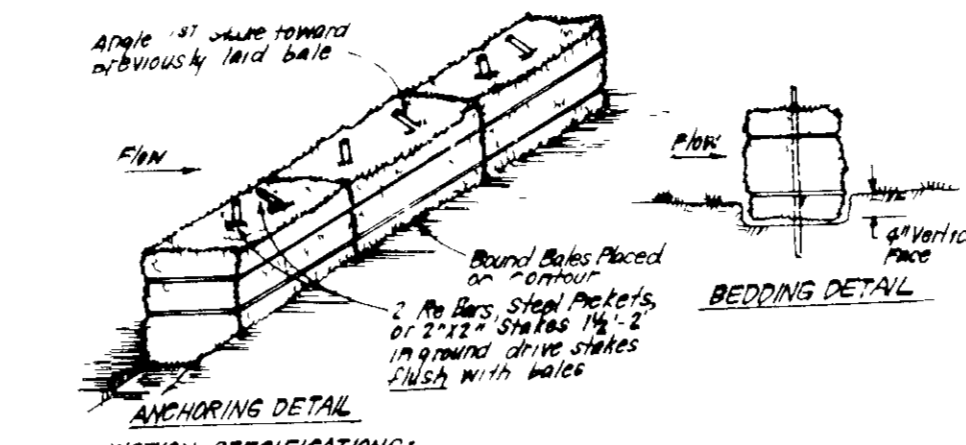


CONSTRUCTION SPECIFICATIONS

1. Bales shall be placed on the top of a slope or on the contour and in a row with ends tightly meeting the adjacent bales.
2. Each bale shall be embedded in the soil a min. of 4" and placed so the bindings are horizontal.
3. Bales shall be securely anchored in place by either 2 stakes or 12 bars driven thru the bale. The 12 bars in each bale shall be driven toward the previously laid bale at an angle to force the bales together. Stakes shall be driven 18" into the soil.
4. Repairs shall be frequent and repair requirements shall be made promptly as needed.
5. Bales shall be removed when they have served their usefulness so as not to block or impede storm flow or drainage.


STRAW BALE DIKE DETAIL (SBD)

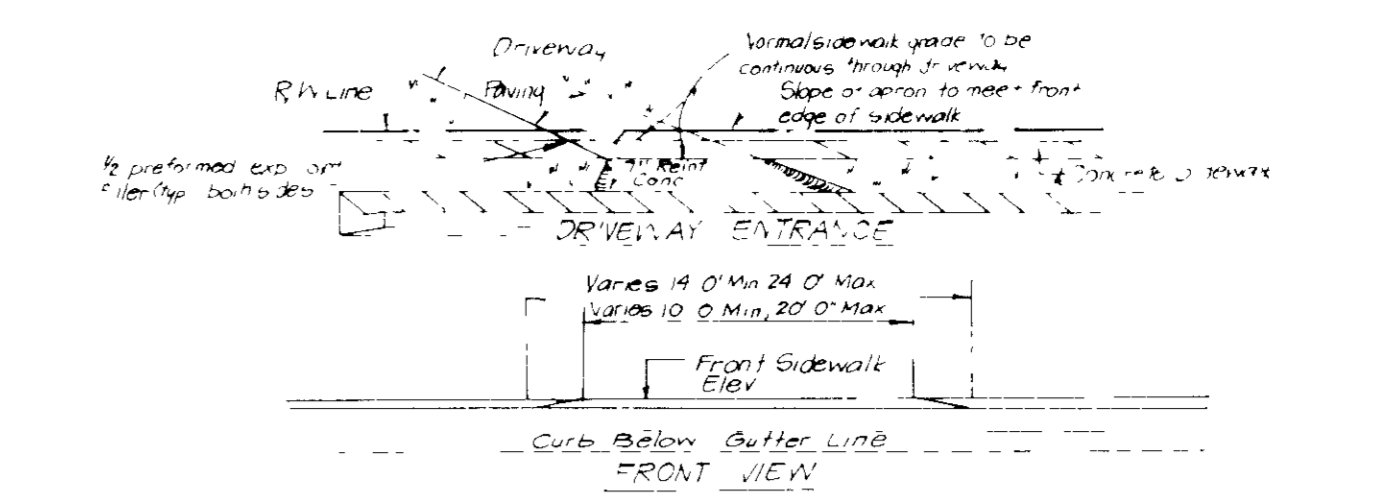

DRIVEWAY ABUTTING CLOSED SECTION WITH MODIFIED CURB, GUTTER & SIDEWALK

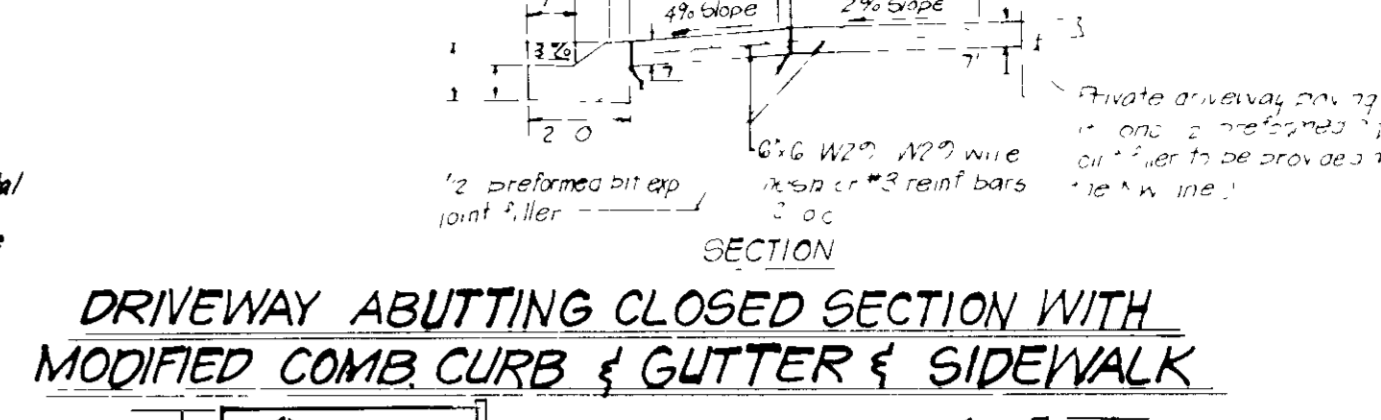

TYPICAL HOUSES

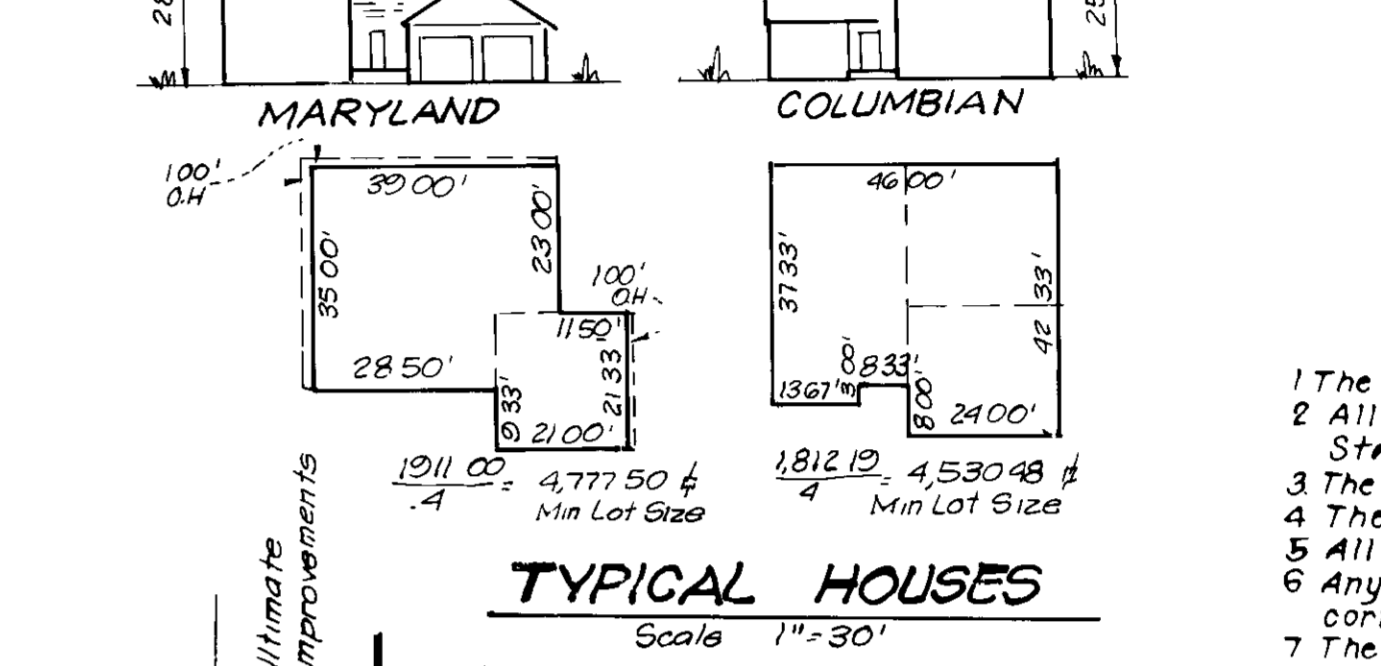

GENERAL NOTES


1. The land included in this plan is zoned R-6-C.
2. All coordinates shown hereon are based on the Maryland State Grid System.
3. The area covered in this plan is located on Tax Map # 35.
4. The total area included in this plan is 0.081 acres.
5. All roadways are public and existing.
6. Any damage to County owned rights-of-way shall be connected at the developer's expense.
7. The total number of lots included in this plan is 2.
8. Total Lot Coverage is 40%.
9. SWM facilities have been constructed for this site under plan # F-88-55.

LEGEND

- 1 Contour Interval
- 2 Existing Contour
- 3 Proposed Contour
- 4 Spot Elevation
- 5 Direction of drainage
- 6 Existing trees to be saved
- 7 Straw Bale Dike/Silt Fence
- 8 Stabilized Construction Entrance

ADDRESS CHART

Lot #	Street	Address
281	10806	Hilltop Lane
282	10802	Hilltop Lane

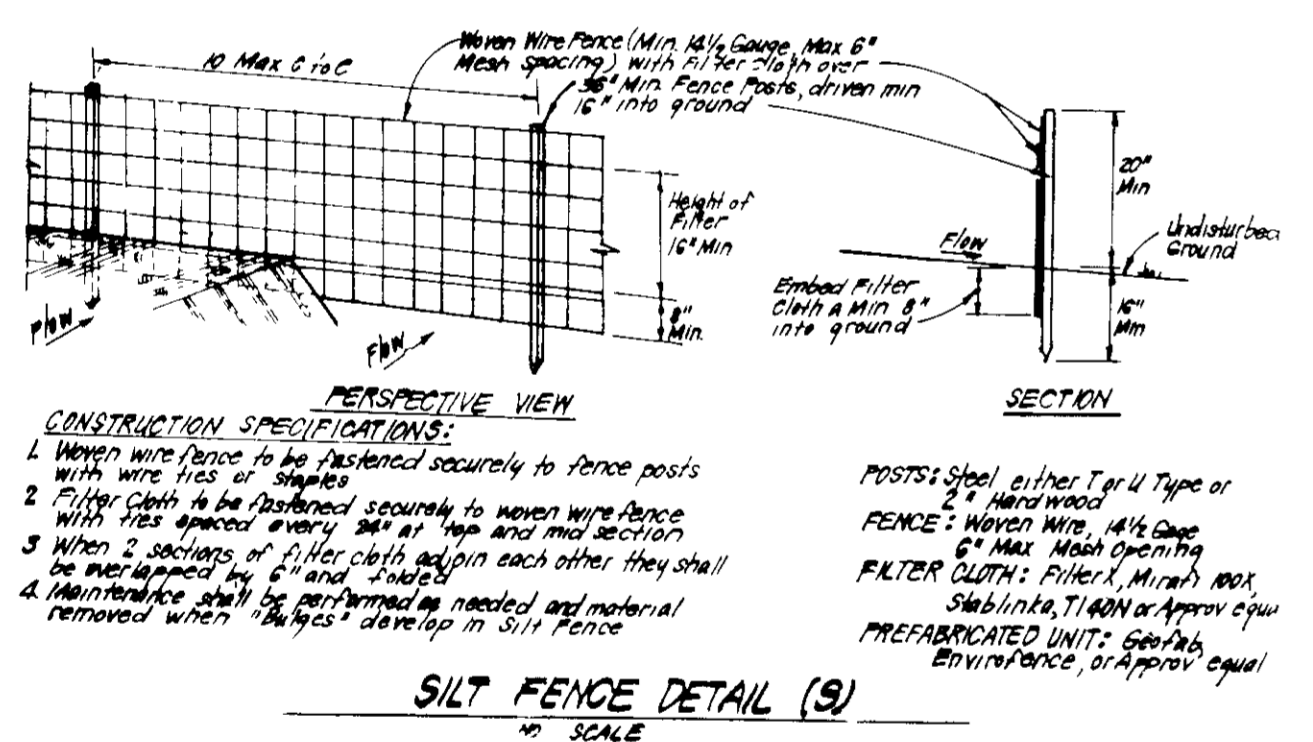

SILT FENCE DETAIL (S)

- CONSTRUCTION SPECIFICATIONS:**
1. Woven wire fabric to be installed securely to fence posts with wire ties or staples.
 2. Posts shall be 2 1/2" diameter, galvanized steel, with a 6" high cap. Posts shall be spaced every 10' along the section.
 3. When 2 sections of fabric cloth are put on each other, they shall be overlapped by 6" and stapled.
 4. Maintenance shall be performed as needed and material removed when "piles" develop in silt fence.
- POSTS:** Steel, either 1 1/2" Type or 2 1/2" diameter.
- FENCE:** Woven Wire, 14 1/4 Gauge.
- FACTORY CUT:** Filter, 1/4" mesh, 100% efficiency, 14 1/4" mesh, 100% efficiency.
- PREFABRICATED UNIT:** Geotextile, 100% efficiency, 14 1/4" mesh, 100% efficiency.

APPROVED FOR PUBLIC WATER AND PUBLIC SEWERAGE SYSTEMS
HOWARD COUNTY HEALTH DEPARTMENT

DATE: 2-4-88

APPROVED HOWARD COUNTY OFFICE OF PLANNING & ZONING

DATE: 2-19-88

APPROVED FOR PUBLIC WATER AND PUBLIC SEWERAGE STORM DRAINAGE SYSTEMS AND PUBLIC ROADS
HOWARD COUNTY DEPARTMENT OF PUBLIC WORKS

DATE: 2-12-88

CHIEF BUREAU OF ENGINEERING

APPROVED

DATE: 12-2-87

HOWARD COUNTY

DATE: 1-29-88

THIS DEVELOPMENT PLAN IS APPROVED FOR SOIL EROSION AND SEDIMENT CONTROL BY THE HOWARD COUNTY CONSERVATION SERVICE.

DEVELOPER'S/BUILDER'S CERTIFICATE


I hereby certify that this plan for Erosion and Sediment Control represents a practical and workable plan and on my personal knowledge of the site and that it was prepared in accordance with the requirements of the Howard County Conservation District.

Signature: G. Nelson Clark Date: 10-29-87

ENGINEER'S CERTIFICATE

I hereby certify that this plan for Erosion and Sediment Control represents a practical and workable plan and on my personal knowledge of the site and that it was prepared in accordance with the requirements of the Howard County Conservation District.

Signature: G. Nelson Clark Date: 10-29-87

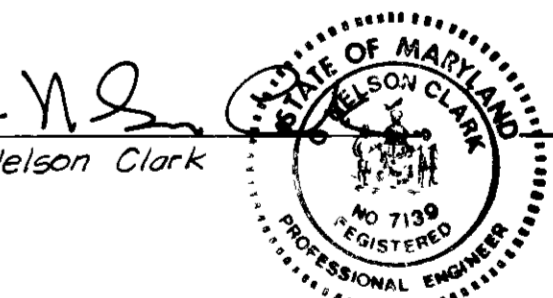

SUBDIVISION NAME	SECT./AREA	LOTS/PARCEL		
CEAR ACRES	2.4.3	281, 282		
PLAT or L.F. BLOCK #	ZONE	TAX/ZONE	HA/ELC/DIST	CENSUS TR.
753-2	R-6C	35	5th	0053.01
WATER CODE	SEWER CODE			
CB	5327300			

CLARK • FINEFROCK & SACKETT, INC
ENGINEERS • PLANNERS • SURVEYORS

SITE DEVELOPMENT AND SEDIMENT AND EROSION CONTROL PLAN
LOTS 281 & 282
CEAR ACRES

SECTION THREE
5TH ELECTION DISTRICT
HOWARD COUNTY, MARYLAND

FOR: CONSOLIDATED HOME BUILDERS, INC
8050 ROUTE 108
COLUMBIA, MARYLAND 21045

DATE: 10-28-87

SCALE: 1" = 30'

JLS
G.S.
VHL
JLS

JOB NO: 87-128

FILE NO: 87-128X

SDP-88-90