


**SHEET INDEX**

1	TITLE SHEET
2	SITE DEVELOPMENT PLAN
3	GEOMETRY PLAN
4	GRADING, SEDIMENT CONTROL PLAN, DRAINAGE AREA MAP
5	STORM DRAIN PROFILES
6	PROFILES & STRUCTURE SCHEDULE
7	STORM DRAIN PROFILES
8	ROOF DRAIN PROFILES
9	DETAILS & NOTES
10	DETAILS & NOTES
11	SWM PROFILES & DETAILS
12	WATER QUALITY NOTES & DETAILS
13	LANDSCAPE PLAN
14	LANDSCAPE SCHEDULES AND DETAILS
15	NORTH AND SOUTH WALL PLANS
16	NORTH WALL PROFILE AND SECTION
17	SOUTH WALL PROFILE FROM STA. 0+00 TO STA. 0+94
18	SOUTH WALL PROFILE FROM STA. 0+94 TO STA. 2+60
19	SOUTH WALL PROFILE FROM STA. 2+60 TO STA. 3+68
20	SOUTH WALL PROFILE FROM STA. 3+68 TO STA. 6+19
21	SOUTH WALL SECTION A-A AND SECTION B-B
22	SOUTH WALL SECTION C-C AND SECTION D-D
23	NORTHERN TIERED WALL PLAN, PROFILE AND SECTION DRAWINGS
24	STORMWATER MANAGEMENT DETAILS & NOTES
25	DETAIL SHEET

# SITE DEVELOPMENT PLAN OF MEADOWRIDGE BUSINESS PARK PARCEL G-2

## 1st ELECTION DISTRICT HOWARD COUNTY, MARYLAND

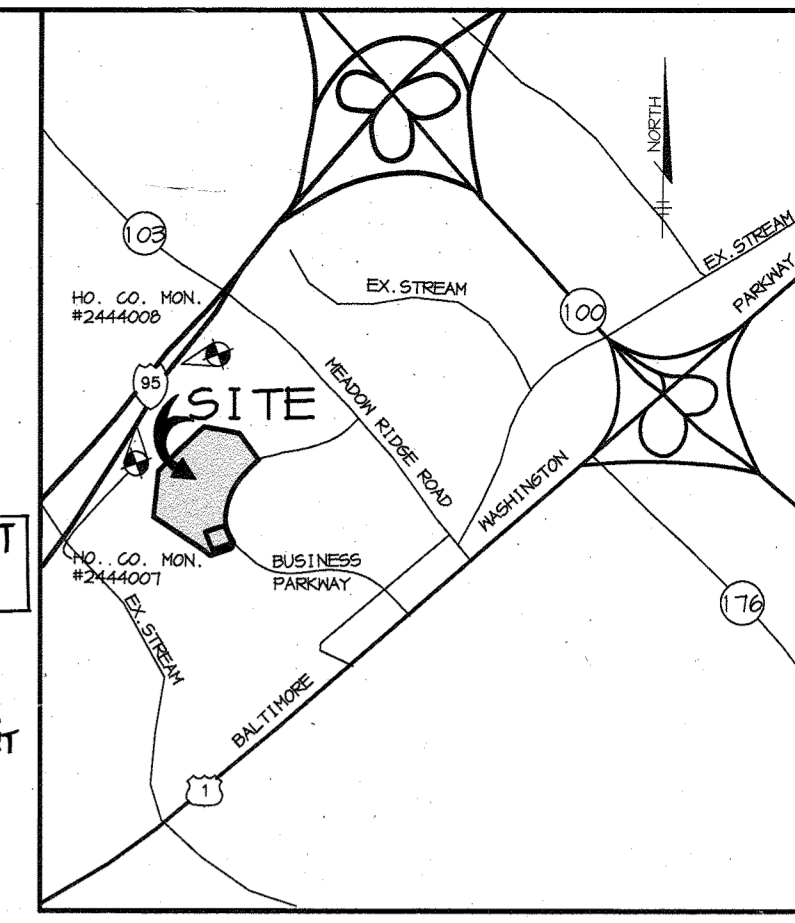

**VICINITY MAP**  
SCALE: 1"=2000'

COPYRIGHT ADC THE MAY PEOPLE  
PERMITTED USE NO. 20844205

**AS-BUILT CONTROL BENCHMARKS**

- ✓ HO. CO. SURVEY CONTROL STATION: 2444007  
N 493, 871 E 063, 851  
ELEV. 252.125
- ✓ HO. CO. SURVEY CONTROL STATION: 2444008  
N 493, 163 E 063, 337  
ELEV. 245.810

08/23/21 **ADD EQUIPMENT PADS, DUMPSTERS, ADA COMPLIANT SIDEWALK, AND GENERATOR FENCE**

**THE CUMULATIVE LOD OF 4,573 SQ. FT. IS EXEMPT FROM PROVIDING STORMWATER MANAGEMENT. ANY FUTURE INCREASES IN THE LOD OVER 5,000 SQ. FT. WILL REQUIRE STORMWATER MANAGEMENT BE ADDRESSED FOR THE INCREASE.**

**SITE DATA:**

1. GROSS SITE AREA:	852,905 SQ. FT. / 19.58 ACRES
2. ZONING:	M-1 - LIGHT MANUFACTURING DISTRICT
3. LAND USE:	DISTRIBUTION WAREHOUSE
4. GROSS FLOOR AREA:	303,100 SQ. FT. / 6.96 ACRES
	WAREHOUSE 285,600 SQ. FT. OFFICE 16,500 SQ. FT.
5. MAXIMUM ALLOWABLE HEIGHT (\$123-D):	
	"STRUCTURE WITH MINIMUM SETBACK" - 50 FT. "STRUCTURE WITH AN ADDITIONAL 1 FT IN HEIGHT FOR EVERY 2 FT OF SETBACK ABOVE THE MINIMUM" - 100 FT
6. PARKING COMPUTATION:	
	REQUIRED (§ 132-D): (75) PARKING SPACES PER 1,000 SQ. FT. GROSS FLOOR AREA (33) PARKING SPACES PER 1,000 SQ. FT. GROSS OFFICE AREA TOTAL = 270 PARKING SPACES REQUIRED
	PROVIDED: STANDARD HANDICAPPED PARKING SPACES 9 SPACES VAN ACCESSIBLE HANDICAPPED PARKING SPACES 4 SPACES REGULAR PARKING SPACES 329 SPACES PARKING SPACES TO BE REMOVED 21 SPACES TOTAL PARKING SPACES PROVIDED 321 SPACES



**SITE TABULATION**

TOTAL AREA	19,580 AC. (852,923 SF)
TOTAL DISTURBED AREA	18.70 AC.
CURRENT ZONING	M-1
PROPOSED USE	WAREHOUSE BUILDINGS (SINGLE STORY, NO MEZZANINES)
BUILDING # 3 COVERAGE	82,400 SQ. FT.
BUILDING # 4 COVERAGE	220,800 SQ. FT.
<b>REQUIRED PARKING</b>	
BUILDING # 3 COVERAGE	20% OFFICE @ 0.3 SP/1000 = 55 SP.
	80% WAREHOUSE @ 0.5 SP/1000 = 33 SP.
BUILDING # 4 COVERAGE	220,800 SQ. FT. @ 0.5 SP/1000 = 111 SP.
	TOTAL REQUIRED 199 SP.
<b>PROPOSED PARKING</b>	321 SPACES (INCLUDES 14 HC SPACES)


**GENERAL NOTES**

- ALL CONSTRUCTION SHALL BE IN ACCORDANCE WITH THE LATEST STANDARDS AND SPECIFICATIONS OF HOWARD COUNTY PLUS MSHA STANDARDS AND SPECIFICATIONS, IF APPLICABLE.
- THE CONTRACTOR SHALL NOTIFY THE DEPARTMENT OF PUBLIC WORKS/BUREAU OF ENGINEERING/CONSTRUCTION INSPECTION DIVISION AT (410) 313-1880 AT LEAST FIVE (5) WORKING DAYS PRIOR TO THE START OF WORK.
- THE CONTRACTOR SHALL NOTIFY "MISS UTILITY" AT 1-800-257-TTTT AT LEAST 48 HOURS PRIOR TO ANY EXCAVATION WORK BEING DONE.
- TRAFFIC CONTROL DEVICES, MARKINGS, AND SIGNING SHALL BE IN ACCORDANCE WITH THE LATEST EDITION OF THE MANUAL ON UNIFORM TRAFFIC CONTROL DEVICES (MUTCD). ALL STREET AND REGULATORY SIGNS SHALL BE IN PLACE PRIOR TO THE PLACEMENT OF ANY ASPHALT.
- ALL PLAN DIMENSIONS ARE TO FACE OF CURB UNLESS OTHERWISE NOTED.
- THE EXISTING TOPOGRAPHY IS TAKEN FROM AERIAL SURVEY WITH MAXIMUM TWO FOOT CONTOUR INTERVALS PREPARED BY KINGS AERIAL MAPPING CO. DATED (JULY, 1998).
- THE COORDINATES SHOWN HEREON ARE BASED UPON THE HOWARD COUNTY GEODETIC CONTROL WHICH IS BASED UPON THE MARYLAND STATE PLANE COORDINATE SYSTEM. HOWARD COUNTY MONUMENT NOS. 2444007 AND 2444008 WERE USED FOR THIS PROJECT.
- WATER IS PUBLIC. CONTRACT NO. - 14-3706-D
- SEWER IS PUBLIC. CONTRACT NO. - 14-1946-D, DRAINAGE AREA PATAPASCO.
- APPROXIMATE LOCATION OF EXISTING UTILITIES ARE SHOWN. THE CONTRACTOR SHALL TAKE ALL NECESSARY PRECAUTIONS TO PROTECT THE EXISTING UTILITIES AND MAINTAIN UNINTERRUPTED SERVICE. ANY DAMAGE INCURRED DUE TO CONTRACTOR'S OPERATION SHALL BE REPAIRED IMMEDIATELY AT THE CONTRACTOR'S EXPENSE. EXISTING UTILITIES ARE SHOWN BASED ON THE BEST AVAILABLE INFORMATION.
- A 100-YEAR FLOODPLAIN STUDY IS NOT REQUIRED FOR THIS PROJECT.
- NO WETLANDS EXIST ON THIS SITE.
- A TRAFFIC STUDY FOR AFPO REQUIREMENTS WAS PREPARED BY THE TRAFFIC GROUP, INC. DATED JUNE, 1994.
- A NOISE STUDY FOR THIS PROJECT IS NOT REQUIRED.
- A GEOTECHNICAL STUDY FOR THIS PROJECT IS NOT REQUIRED.
- STORMWATER QUALITY AND QUANTITY MANAGEMENT IS PROVIDED FOR THE DEVELOPMENT BY REGIONAL RETENTION FACILITY PER - F-84-163 & ON-SITE DETENTION FACILITY WITH BAYS/SAVERS FOR WATER QUALITY.
- SUBJECT PROPERTY ZONED M-1 PER 10-18-93 COMPREHENSIVE ZONING PLAN.
- ALL ELEVATIONS SHOWN ARE BASED ON THE U.S.C. AND G.S. MEAN SEA LEVEL DATUM, 1929.
- SEE DEPARTMENT OF PLANNING AND ZONING FILE NO'S: F-84-163, NP-91-82, NP-94-78, F-91-144, F-95-10 & SDP-96-83.
- THE CONTRACTOR SHALL TEST PIT EXISTING UTILITIES AT LEAST (5) DAYS BEFORE STARTING WORK SHOWN ON THESE DRAWINGS.
- CONTRACTOR IS SOLELY RESPONSIBLE FOR CONSTRUCTION MEANS, METHODS, TECHNIQUES, SEQUENCES, PROCEDURES, AND SAFETY PRECAUTIONS AND PROGRAMS.
- PIPE SHALL NOT BE INSTALLED BY THE CONTRACTOR UNTIL THE LENGTH CALLED FOR AT EACH STATION HAS BEEN APPROVED BY THE ENGINEER IN THE FIELD.
- NO PIPE SHALL BE LAID UNTIL LINES OF EXCAVATION HAVE BEEN BROUGHT WITHIN 6" OF FINISHED GRADE.
- ALL STORM DRAIN PIPE BEDDINGS SHALL BE CLASS 'C' AS SHOWN IN FIG. 11.4, VOLUME 1 OF HOWARD COUNTY DESIGN MANUAL UNLESS OTHERWISE NOTED.
- ALL INLETS SHALL BE CONSTRUCTED IN ACCORDANCE WITH HOWARD COUNTY STANDARDS.
- ALL PIPE ELEVATIONS SHOWN ARE INVERT ELEVATIONS.
- PROFILES STATIONS SHALL BE ADJUSTED AS NECESSARY TO CONFORM TO PLAN DIMENSIONS.
- ALL FILL AREAS WITHIN ROADWAY AND UNDER STRUCTURES TO BE COMPACTED TO A MINIMUM OF 95% COMPACTION OF AASHTO T180.
- AS THIS PROJECT WAS SUBJECT TO FINAL PLANS AND MASS GRADING PLANS PRIOR TO THE FOREST CONSERVATION ACT 16.1202(b)(1)(111), THERE ARE NO FOREST CONSERVATION REQUIREMENTS FOR THIS DEVELOPMENT.

08/23/2021  
FOR REV. #8 ONLY  
WHITNEY, BAILEY, COX & MAGNANI, LLC

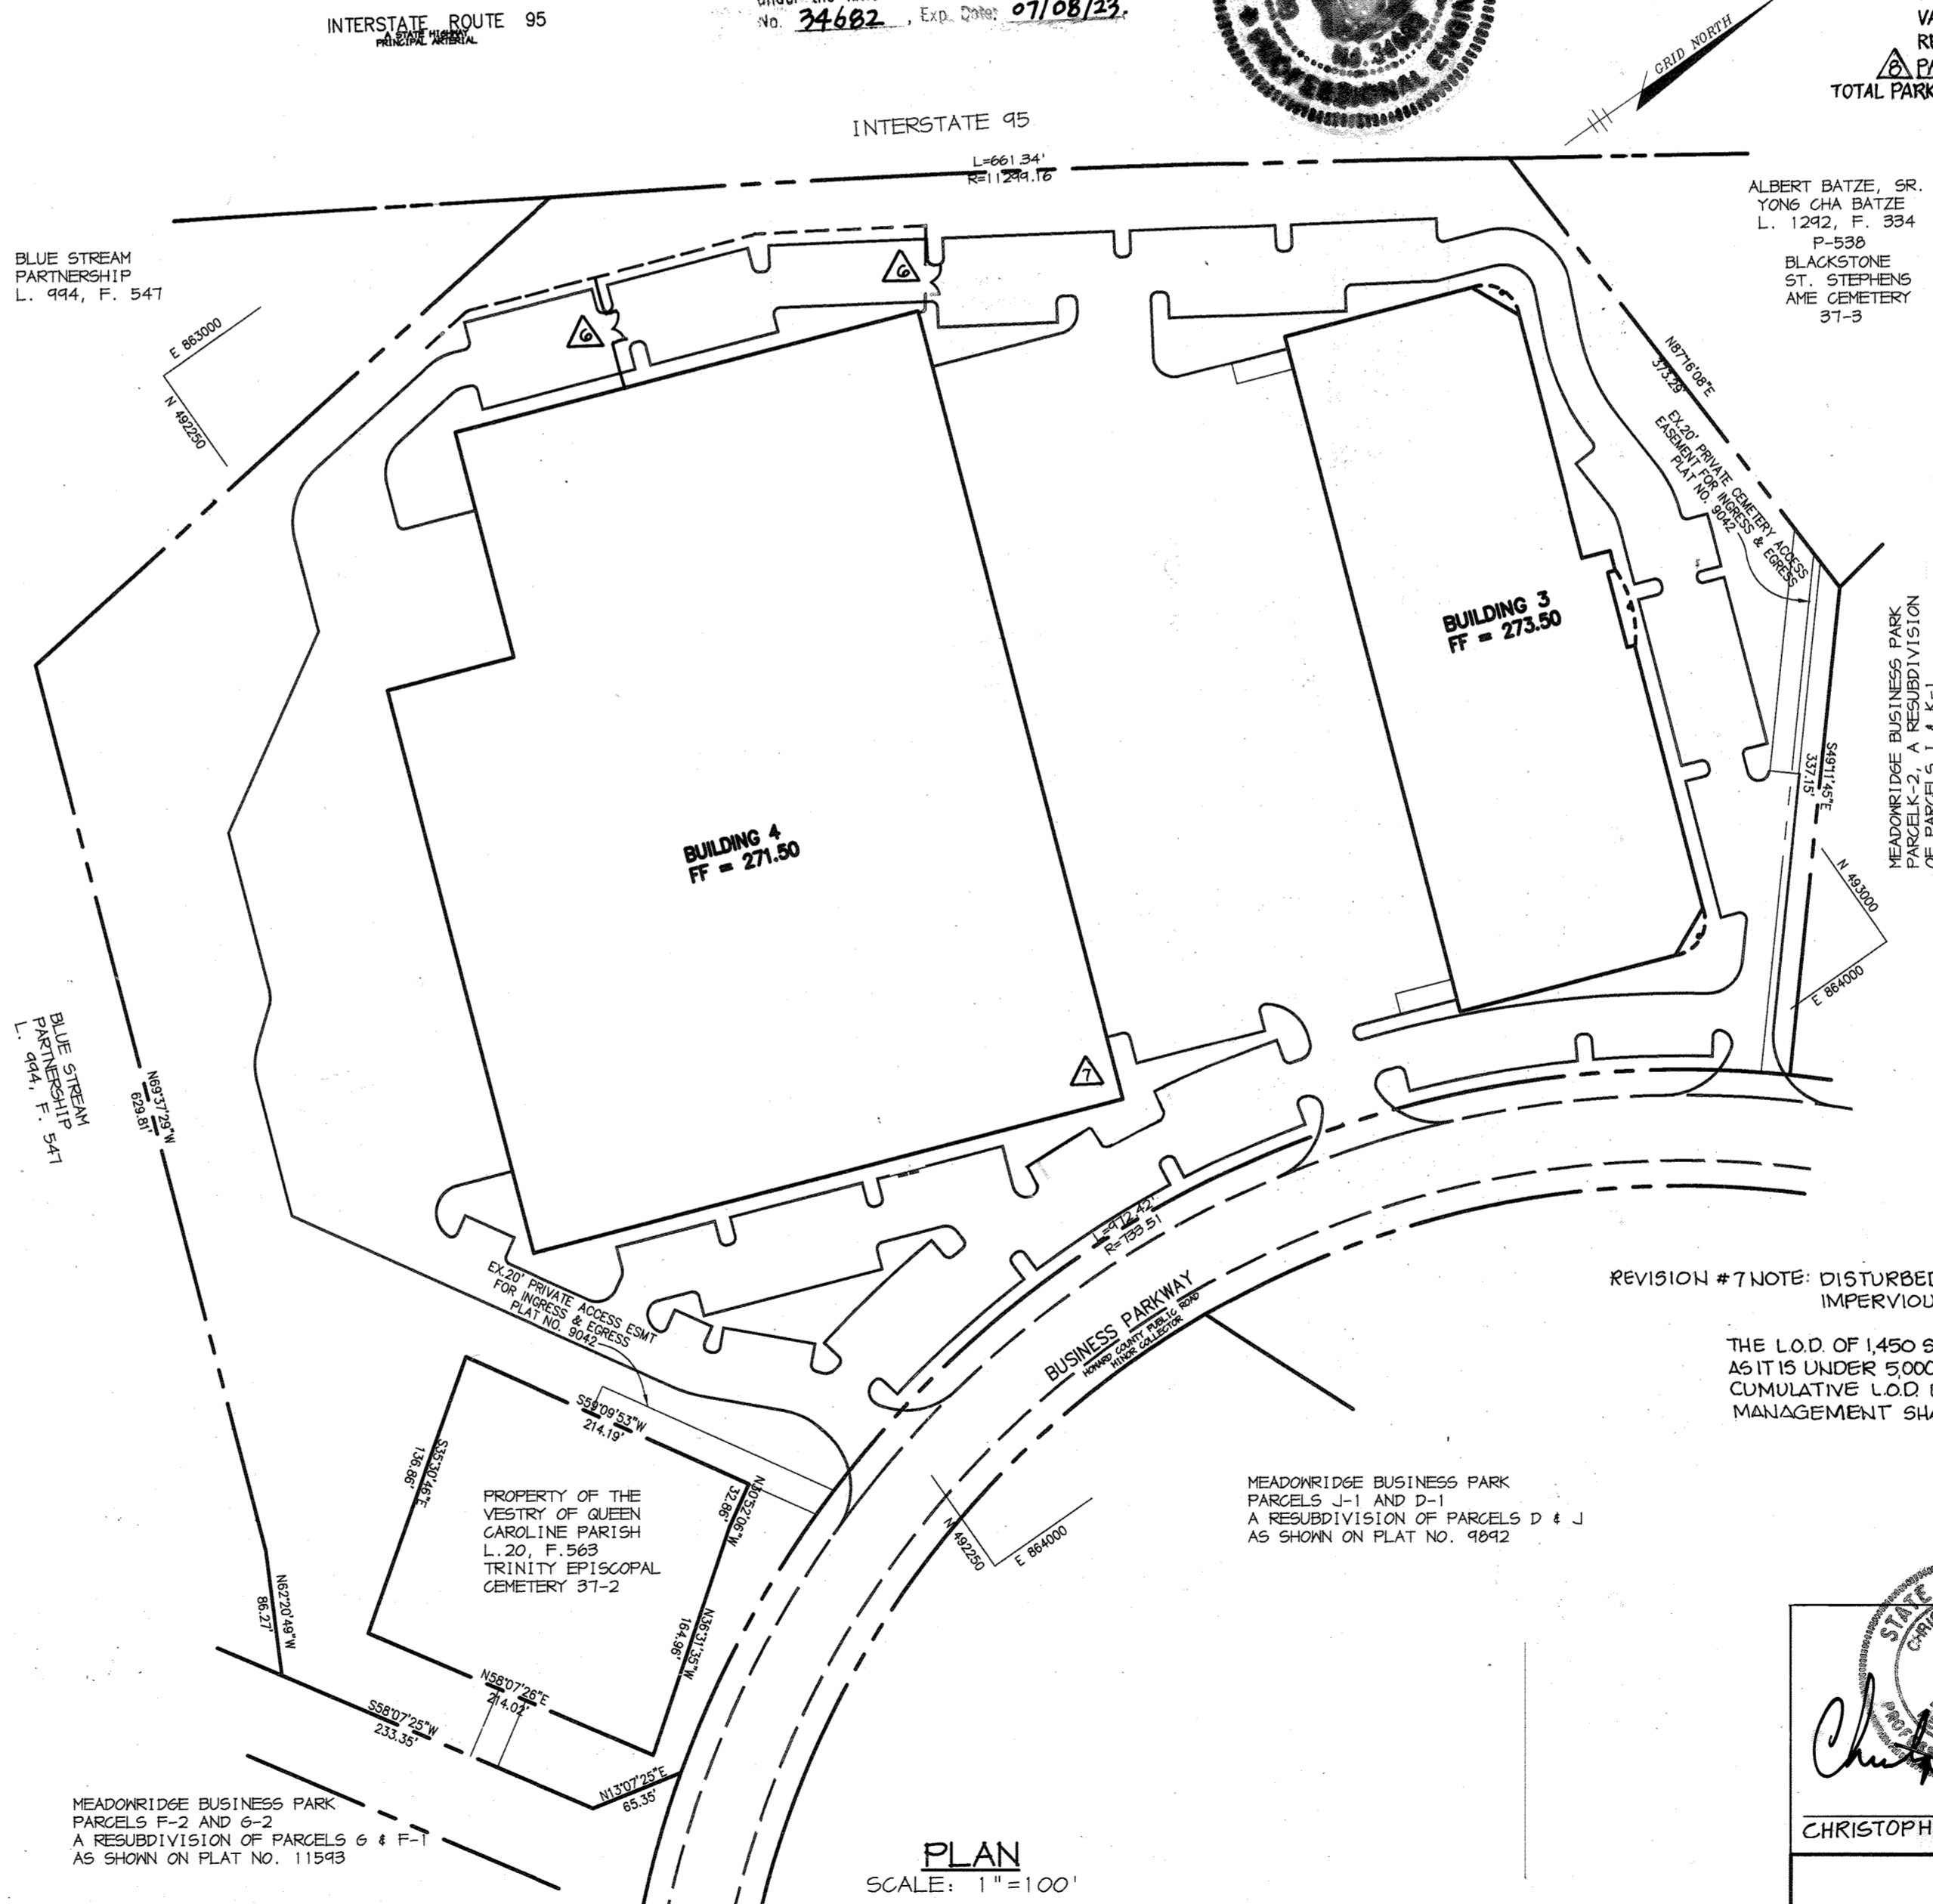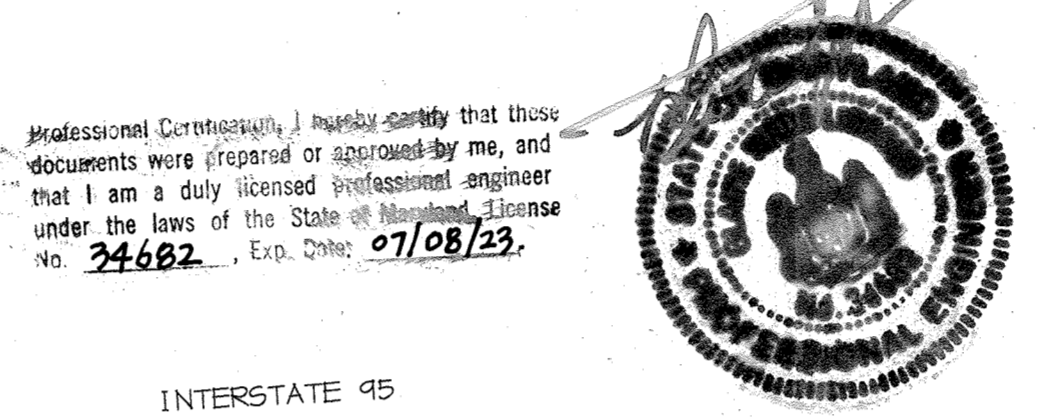

REDLINE DESIGN PROFESSIONAL  
(9/28/20 REVISIONS)  
NJB ENGINEERING, INC.  
310 GLENHAGLES COURT, SUITE 311  
TOWSON, MARYLAND 21286  
(410) 892-7691

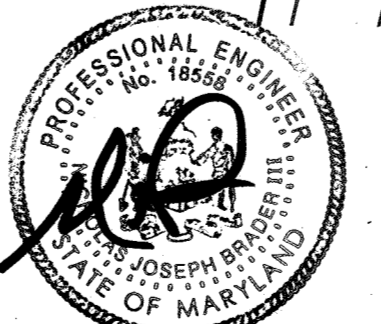

NICHOLAS J. BRADER III  
PROFESSIONAL ENGINEER  
MD. LICENSE # 0556  
9/28/20  
FOR REV. #6 & #7  
NJB ENGINEERING, INC.

ADD ENTRANCES & ACCESSIBLE SPACES SOUTHWEST CORNER BUILDING #4	3/23/21	NJB
REMOVE GATE AND PART OF EXISTING FENCE; RELOCATE GATE IN NEW FENCE	9/28/20	NJB

**ADDRESS CHART**

LOT NUMBER	STREET ADDRESS
BUILDING 3	6670 BUSINESS PARKWAY
BUILDING 4	6680 BUSINESS PARKWAY

APPROVED: HOWARD COUNTY DEPARTMENT OF PLANNING AND ZONING.

<i>Christopher J. Reid</i>	10/19/22
DIRECTOR	DATE
<i>Christopher J. Reid</i>	10/18/22
CHIEF, DEVELOPMENT ENGINEERING DIVISION	DATE
<i>Christopher J. Reid</i>	10/18/22
CHIEF, DIVISION OF LAND DEVELOPMENT	DATE

OWNER/DEVELOPER

PROLOGIS DEVELOPMENT SERVICES INCORPORATED  
5200 EISENHOWER AVENUE, SECOND FLOOR  
ALEXANDRIA, VIRGINIA 22304  
(703)751-9292

PROJECT: MEADOWRIDGE BUSINESS PARK  
PARCEL G-2  
2 WAREHOUSE BUILDINGS

AREA

TAX MAP NO. 37 ZONED M-1 PARCEL G-2  
1st ELECTION DISTRICT  
HOWARD COUNTY, MARYLAND

TITLE: TITLE SHEET







**RIEMER MUEGGE & ASSOCIATES INC.**  
ENGINEERING • ENVIRONMENTAL SERVICES • PLANNING • SURVEYING  
6818 Centre Park Drive, Columbia, MD 21045  
tel 410.997.8900 fax 410.997.9282

DATE	DESIGNED BY: CJR
	DRAWN BY: DAM
	PROJECT NO.: 97320/PARCEL G SDP1.DWG
	DATE: OCTOBER 11, 1999
	SCALE: AS SHOWN
	DRAWING NO. 1 OF 25

M:\97320\PARCEL\_GSDP1.DWG Thu Oct 07 09:30:13 1999 RIEMER MUEGGE & ASSOCIATES, INC.



**LEGEND**




- CONCRETE 
- P-1 PAVING 
- P-3 PAVING 
- STD-REV  STANDARD CURB - REVERSE CURB
- SITE LIGHT (SINGLE) - SEE NOTE 1 
- STREET LIGHT (SINGLE) - SEE NOTE 2 

Professional Certification. I hereby certify that these documents were prepared or approved by me, and that I am a duly licensed professional engineer under the laws of the State of Maryland, License No. 34682. Exp. Date: 07/08/23.



3/28/20 FOR REV#5 + #7  
 NUB ENGINEERING, INC.  
 PROFESSIONAL ENGINEER  
 ALBERT GATZEL, SR.  
 YONG CHA GATZEL  
 L. 1292, F. 334  
 P-538  
 BLACKSTONE  
 ST. STEPHENS  
 A.M.E. CEMETERY  
 37-3

- NOTES:**
- SITE LIGHTS TO BE 400 WATT METAL HALIDE VERTICAL LAMPS ON SHOEBOXES ON 2'-6" BASE WITH 30' ROUND TAPERED POLE FINISHED IN DARK BRONZE.
  - STREET LIGHTS TO BE 250 WATT HPS VAPOR PENDANT FIXTURE (CUTOFF) MOUNTED AT 30' ON A BRONZE FIBERGLASS POLE USING 12' ARM, ARM RADIAL TO FILLET.
  - ALL EXTERIOR LIGHTING SHALL CONFORM TO ZONING REGULATIONS SECTION 134.
  - ALL CURB RADI ARE 5' UNLESS OTHERWISE LABELED.
  - ALL DIMENSIONS ARE TO FACE OF CURB OR BUILDING UNLESS OTHERWISE LABELED.
  - \* LIMITS OF STD/REV CURB AND GUTTER.
  - SEE SHEET 3 FOR ALL SITE AND BUILDING DIMENSIONS.
  - ON JULY 29, 1999, THE PLANNING BOARD APPROVED THE PROPOSED DESIGN FOR THIS SITE ADJOINING THE BLACKSTONE CEMETERY AND THE TRINITY EPISCOPAL CEMETERY IN ACCORDANCE WITH SECTION 16.1304 (E).  
 SEE RETAINING WALL ELEVATIONS, SECTIONS & DETAILS ON SHEETS 15-23.

- 08/23/21  ADD EQUIPMENT PADS, DUMPSTERS, ADA COMPLIANT SIDEWALK, AND GENERATOR FENCE
- 3/23/21  ADD ENTRANCES AND ACCESSIBLE SPACES AT SOUTHEAST CORNER BUILDING #4
- 3/28/20  REMOVE GATE AND PART OF EXISTING FENCE, RELOCATE GATE IN NEW FENCE

Professional Certification. I hereby certify that these documents were prepared or approved by me, and that I am a duly licensed professional engineer under the laws of the State of Maryland.  
 License No. 16597, Exp. Date: 01/15/25  
 RICHARDSON ENGINEERING, LLC  
 FOR REV. #4 ONLY  
 6/15 REV #5 ONLY  
 GUARD SHACK

CERTIFICATE  
 Christopher J. Reid 2-13-01  
 CHRISTOPHER J. REID #19949 DATE

DATE	NO.	REVISION
3/17/15	4	ADDITIONAL CHAIN LINK FENCE & GATES
4-10-00		DELETED OUTSIDE METER VAULT, ADDED INSIDE METER - BLDG 4
APPROVED: HOWARD COUNTY DEPARTMENT OF PLANNING AND ZONING.		
		DIRECTOR 10/19/99 DATE
		CHIEF, DEVELOPMENT ENGINEERING DIVISION 10/19/99 DATE
		CHIEF, DIVISION OF LAND DEVELOPMENT 10/19/99 DATE
4-10-00		REVISE RETAINING WALL
11-08-99		REV. SANITARY SEWER TO BLDG. 4 AND FIRE LINE LOCATION
DATE	NO.	REVISION

OWNER/DEVELOPER  
 PROLOGIS DEVELOPMENT SERVICES INCORPORATED  
 5200 EISENHOWER AVENUE, SECOND FLOOR  
 ALEXANDRIA, VIRGINIA 22304  
 (703)751-9292


PROJECT MEADOWRIDGE BUSINESS PARK  
 PARCEL G-2  
 2 WAREHOUSE BUILDINGS

AREA TAX MAP NO. 37 ZONED M-1 PARCEL G-2  
 1st ELECTION DISTRICT  
 HOWARD COUNTY, MARYLAND

TITLE **SITE DEVELOPMENT PLAN**


**RIEMER MUEGGE & ASSOCIATES INC.**  
 ENGINEERING • ENVIRONMENTAL SERVICES • PLANNING • SURVEYING  
 8818 Centre Park Drive, Columbia, MD 21045  
 tel 410.997.8800 fax 410.997.9282

DATE	DESIGNED BY :
	CJR
DATE	DRAWN BY :
	DAM
DATE	PROJECT NO. :
	97320/PARCEL_G_SDP2.DWG
DATE	DATE :
	OCTOBER 11, 1999
DATE	SCALE :
	1" = 50'
DATE	DRAWING NO. :
	2 OF 25

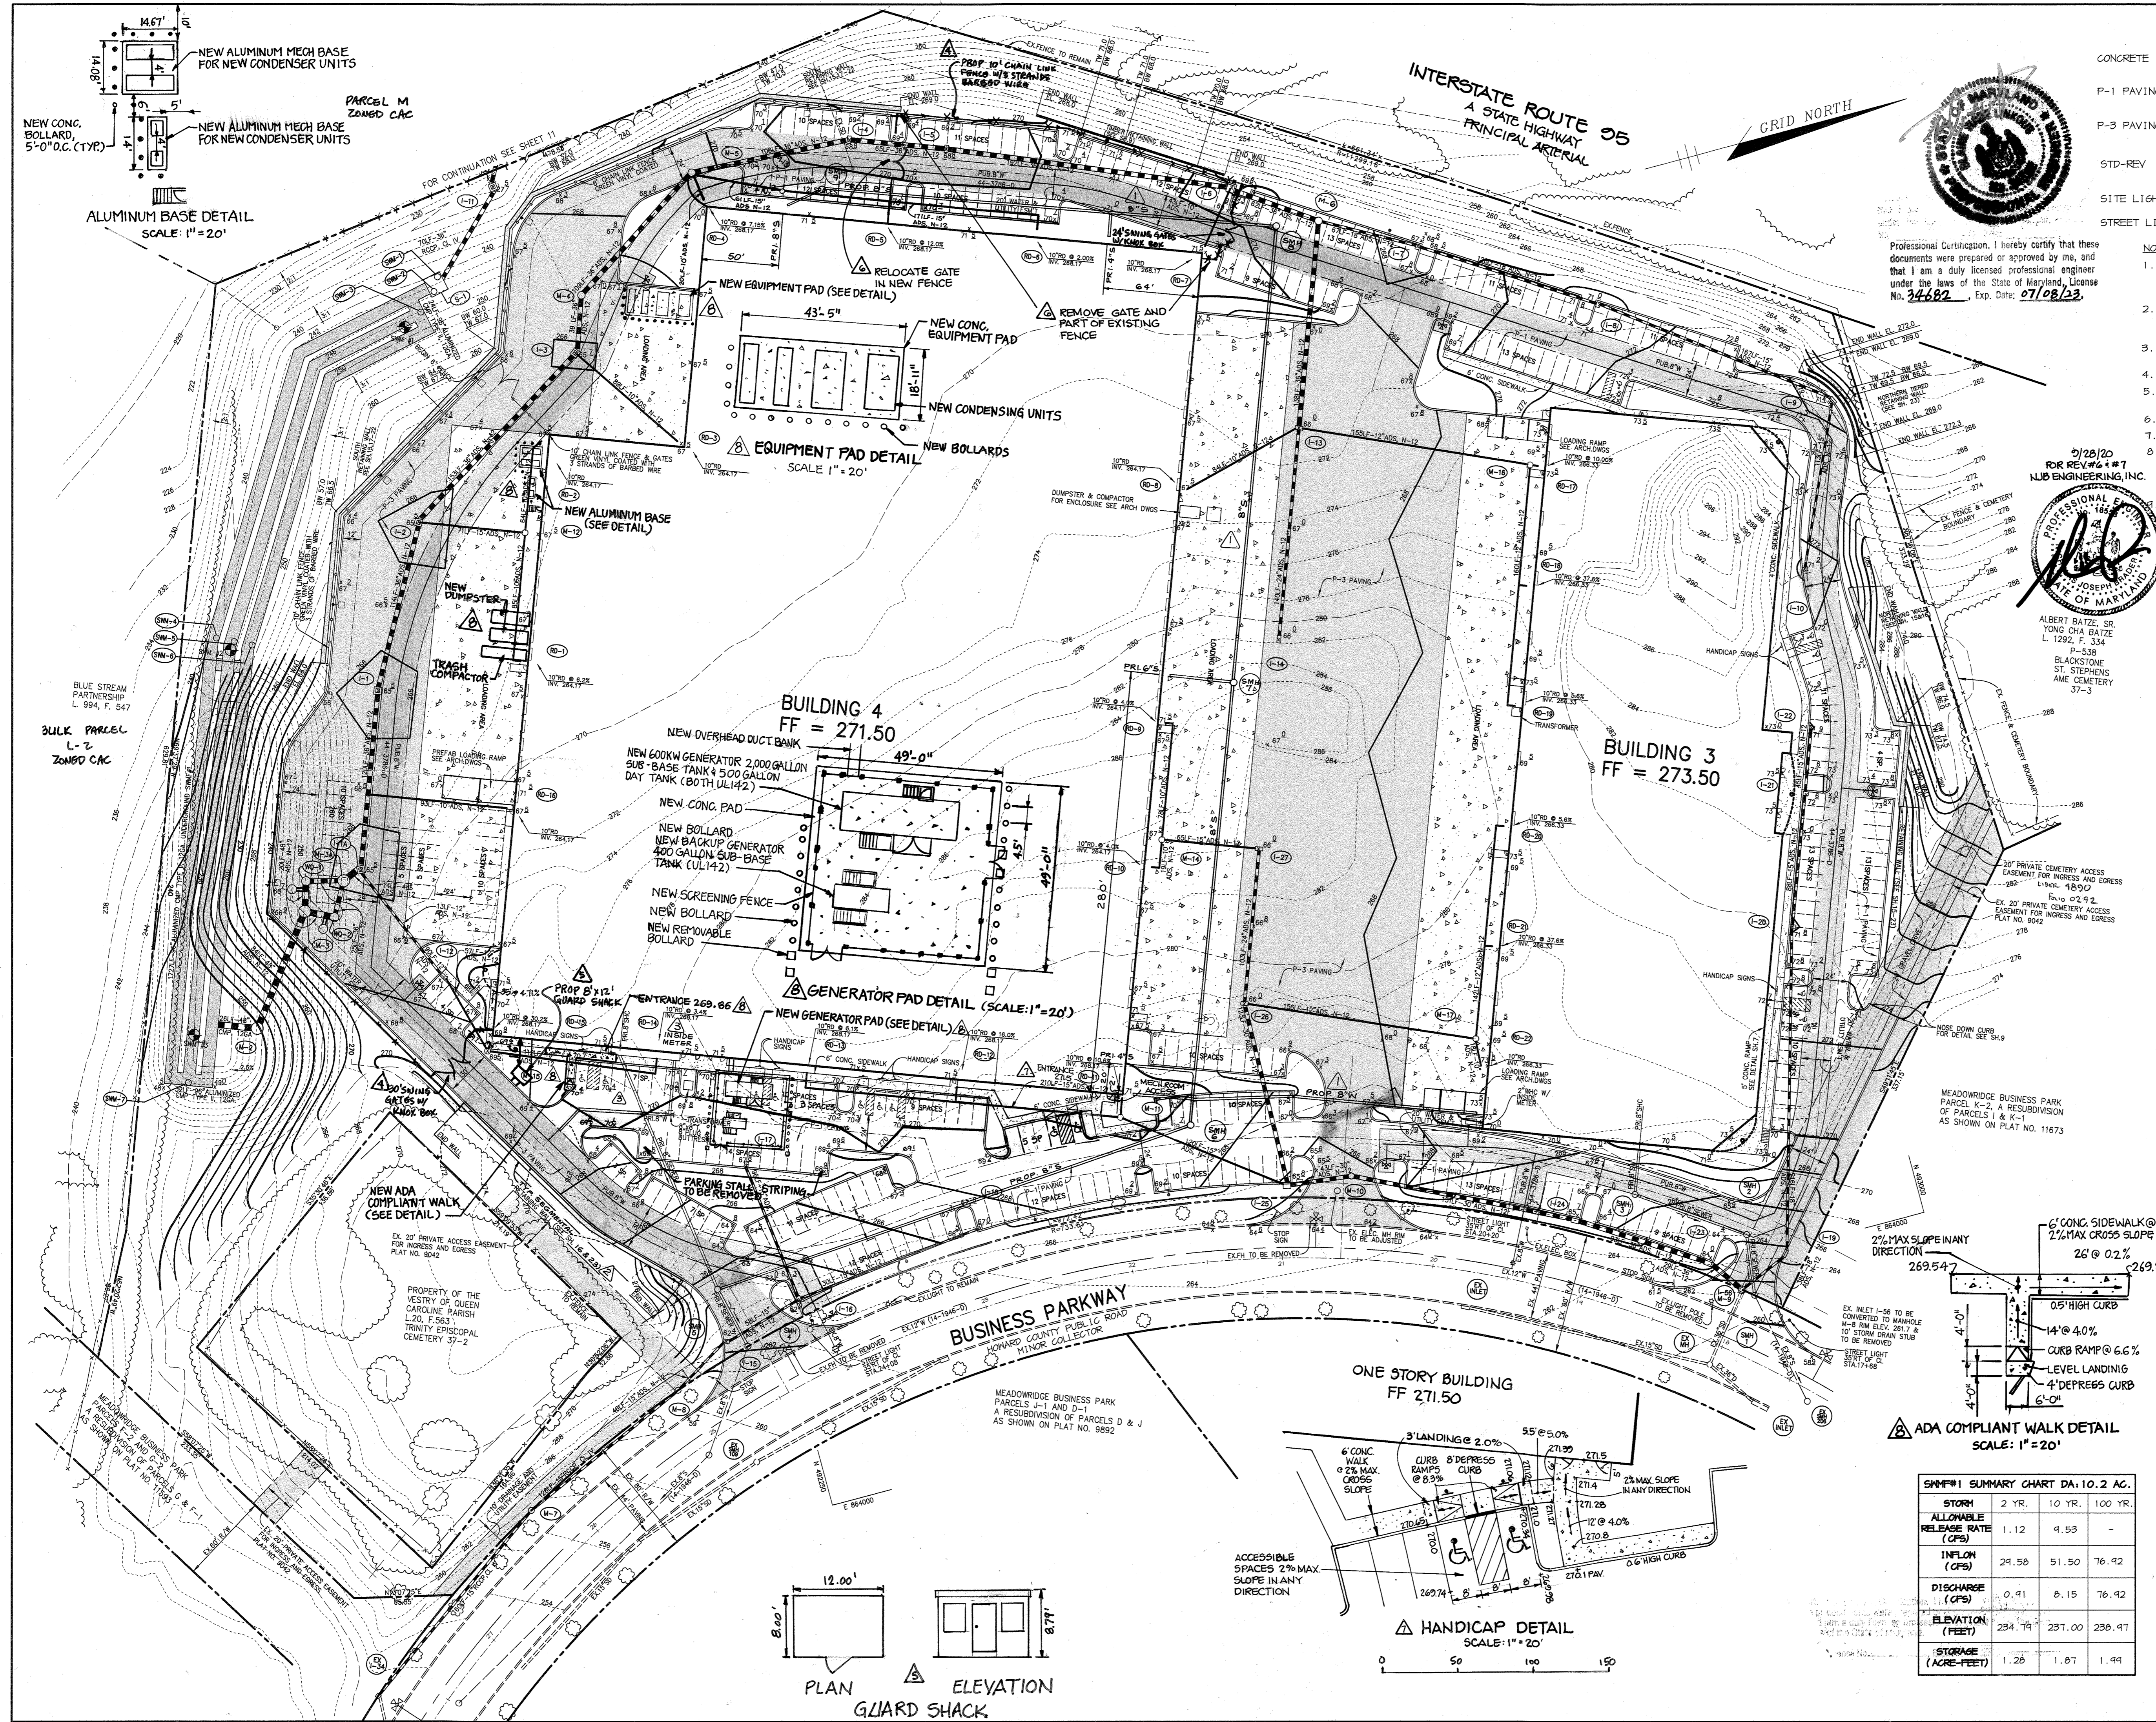

M:\97320\PARCEL\_G\_SDP2.DWG Thu Oct 07 09:40:55 1999 RIEMER MUEGGE & ASSOCIATES, INC.



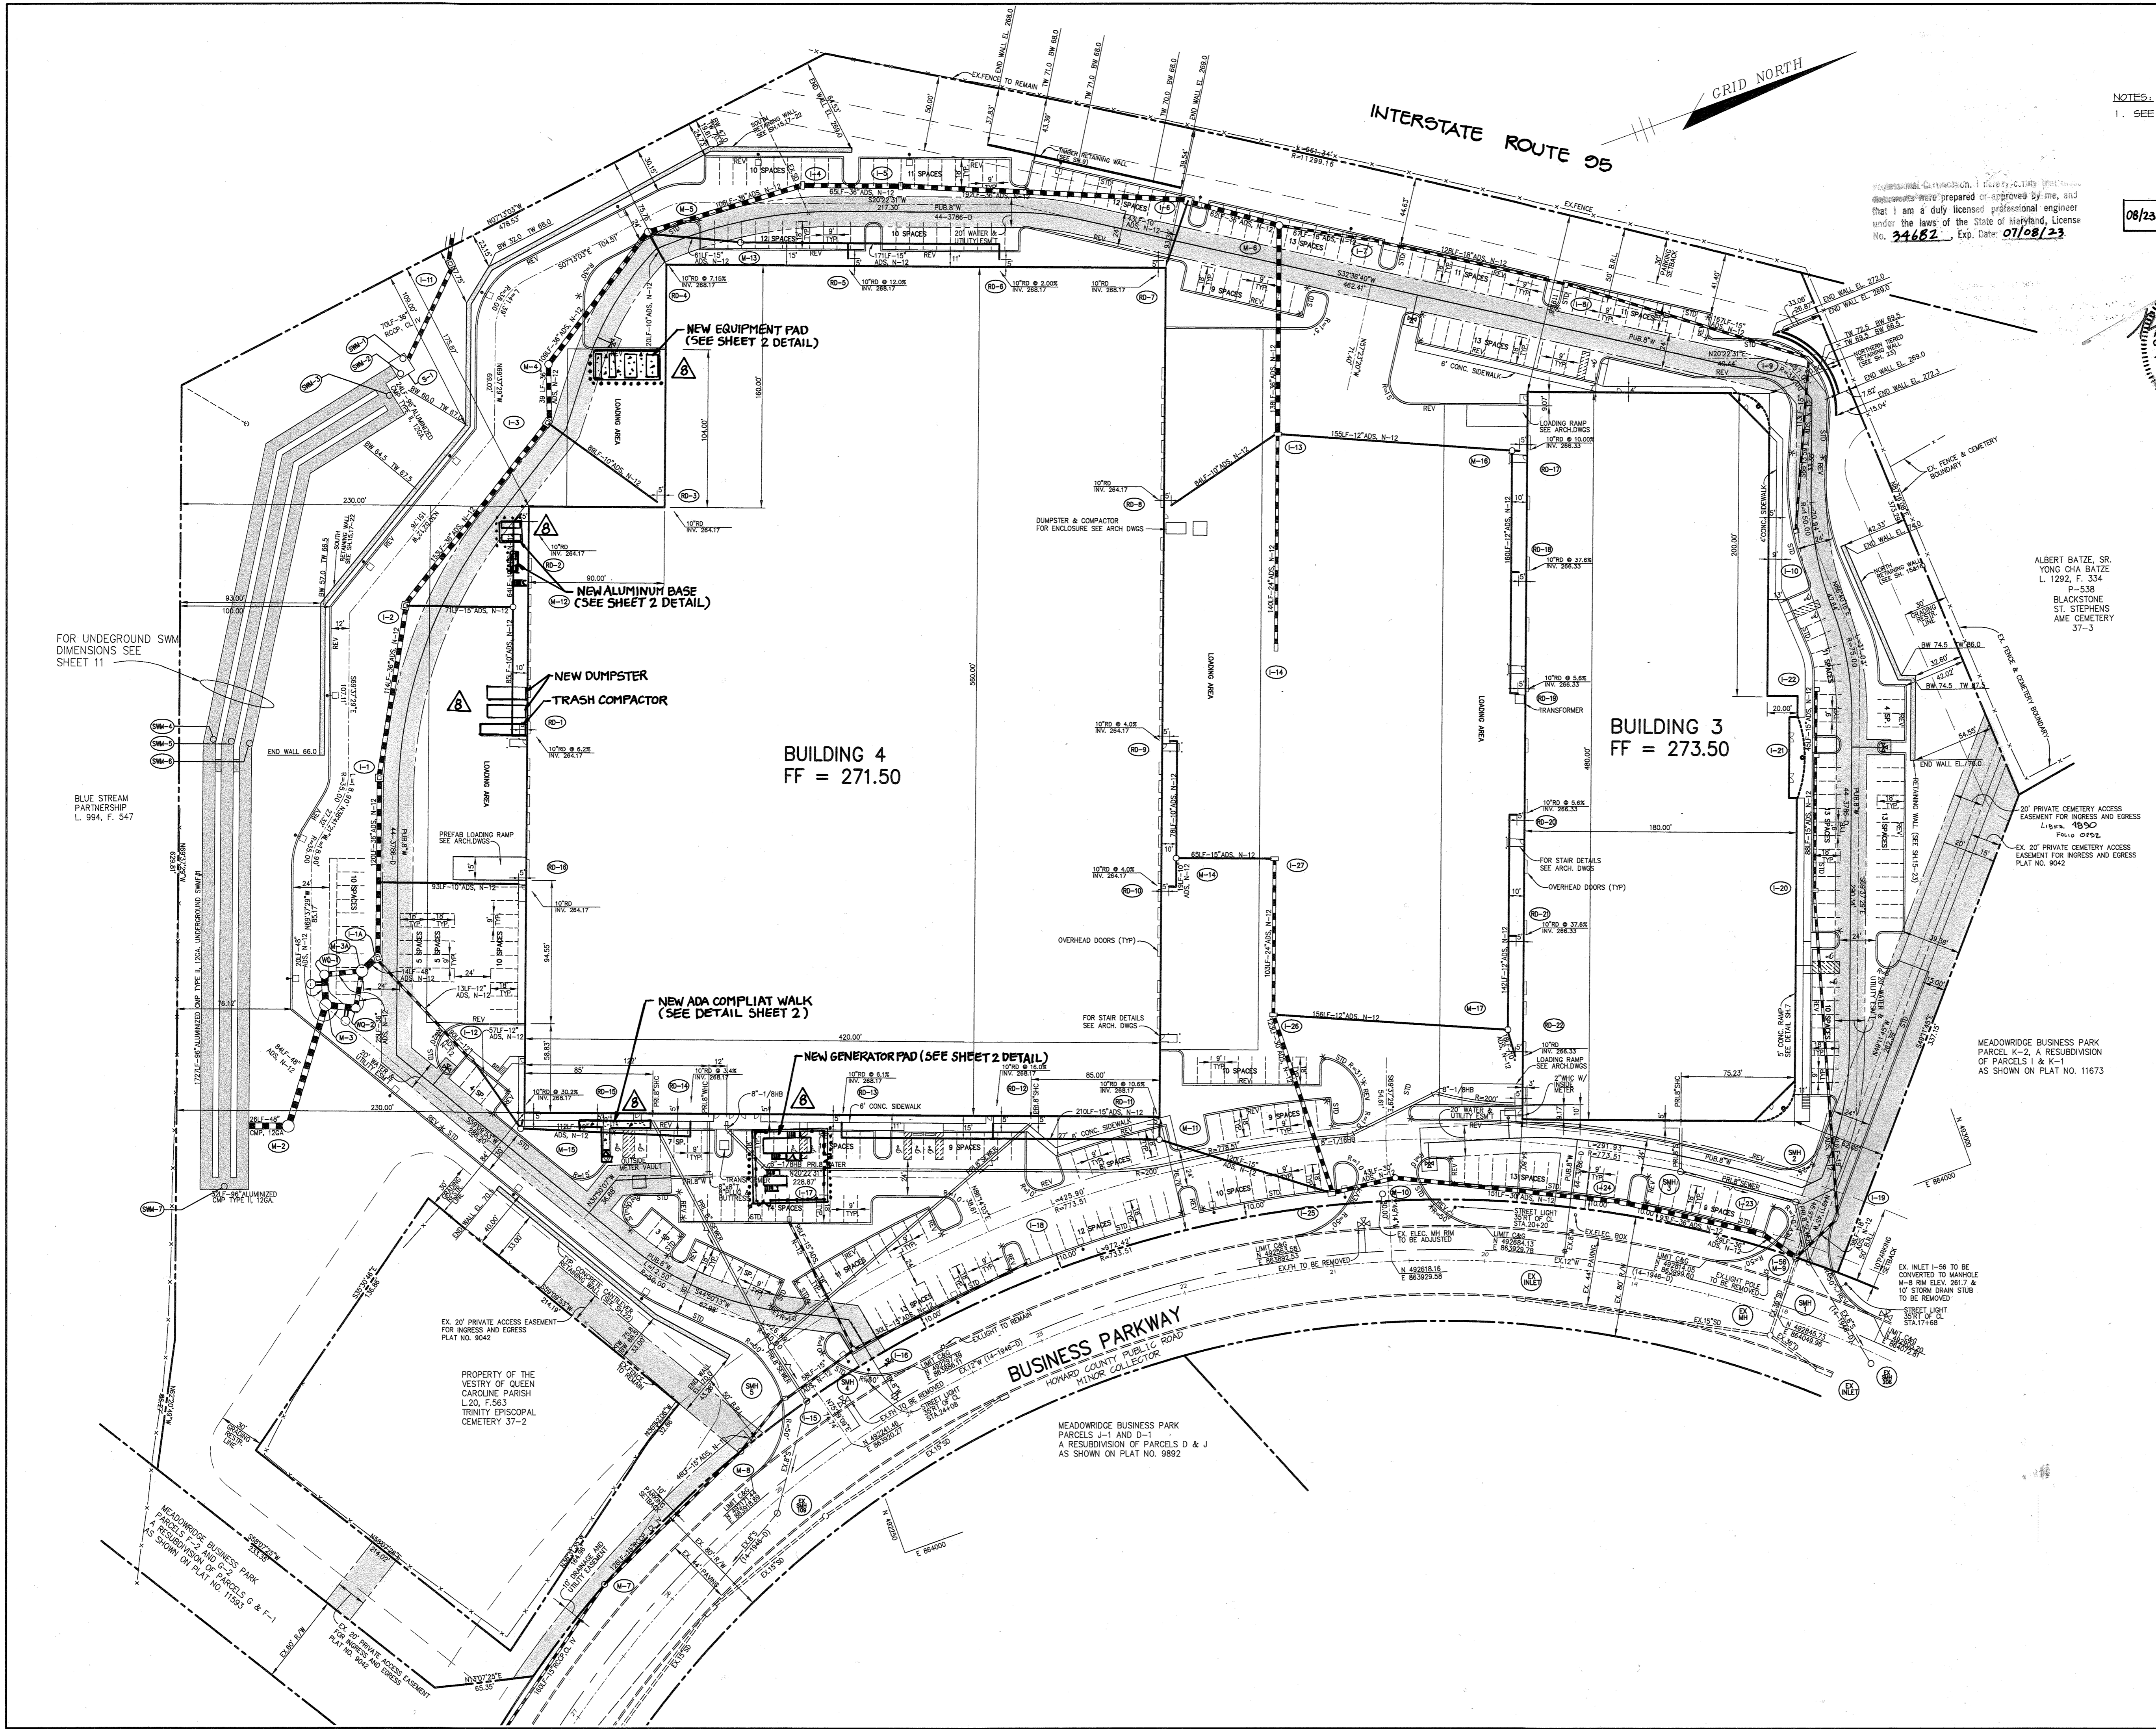

NOTES:  
1. SEE RETAINING WALL DETAILS ON SHEETS 15-23.

08/23/21 ADD EQUIPMENT PADS, DUMPSTERS, ADA COMPLIANT SIDEWALK, AND GENERATOR FENCE



ALBERT BATZE, SR.  
YUNG CHA BATZE  
L. 1292, F. 334  
P-538  
BLACKSTONE  
ST. STEPHENS  
AME CEMETERY  
37-3

MEADOWRIDGE BUSINESS PARK  
PARCEL K-2, A RESUBDIVISION  
OF PARCELS K-1 & K-1  
AS SHOWN ON PLAT NO. 11673

APPROVED: HOWARD COUNTY DEPARTMENT OF PLANNING AND ZONING.

*Howard County* 10/19/99 DATE  
DIRECTOR  
*Carol Hamlett* 10/18/99 DATE  
CHIEF, DEVELOPMENT ENGINEERING DIVISION  
CHIEF, DIVISION OF LAND DEVELOPMENT

DATE NO. REVISION

OWNER/DEVELOPER  
PROLOGIS DEVELOPMENT SERVICES INCORPORATED  
5200 EISENHOWER AVENUE, SECOND FLOOR  
ALEXANDRIA, VIRGINIA 22304  
(703)751-9292

PROJECT MEADOWRIDGE BUSINESS PARK  
PARCEL G-2  
2 WAREHOUSE BUILDINGS

AREA TAX MAP NO. 37 ZONED M-1 PARCEL G-2  
1st ELECTION DISTRICT  
HOWARD COUNTY, MARYLAND

TITLE  
**GEOMETRY PLAN**


**RIEMER MUEGGE & ASSOCIATES INC.**  
ENGINEERING • ENVIRONMENTAL SERVICES • PLANNING • SURVEYING  
8818 Centre Park Drive, Columbia, MD 21045  
tel 410.997.8900 fax 410.997.9282

DATE  
  
DESIGNED BY: CJR  
DRAWN BY: DAM  
PROJECT NO.: 97320/PARCEL G SDP3.DWG  
DATE: OCTOBER 11, 1999  
SCALE: 1" = 50'  
DRAWING NO. 3 OF 25

SDP-99-168

M:\97320\PARCEL\_G\SDP3.DWG Thu Oct 07 09:43:55 1999 RIEMER MUEGGE & ASSOCIATES, INC.



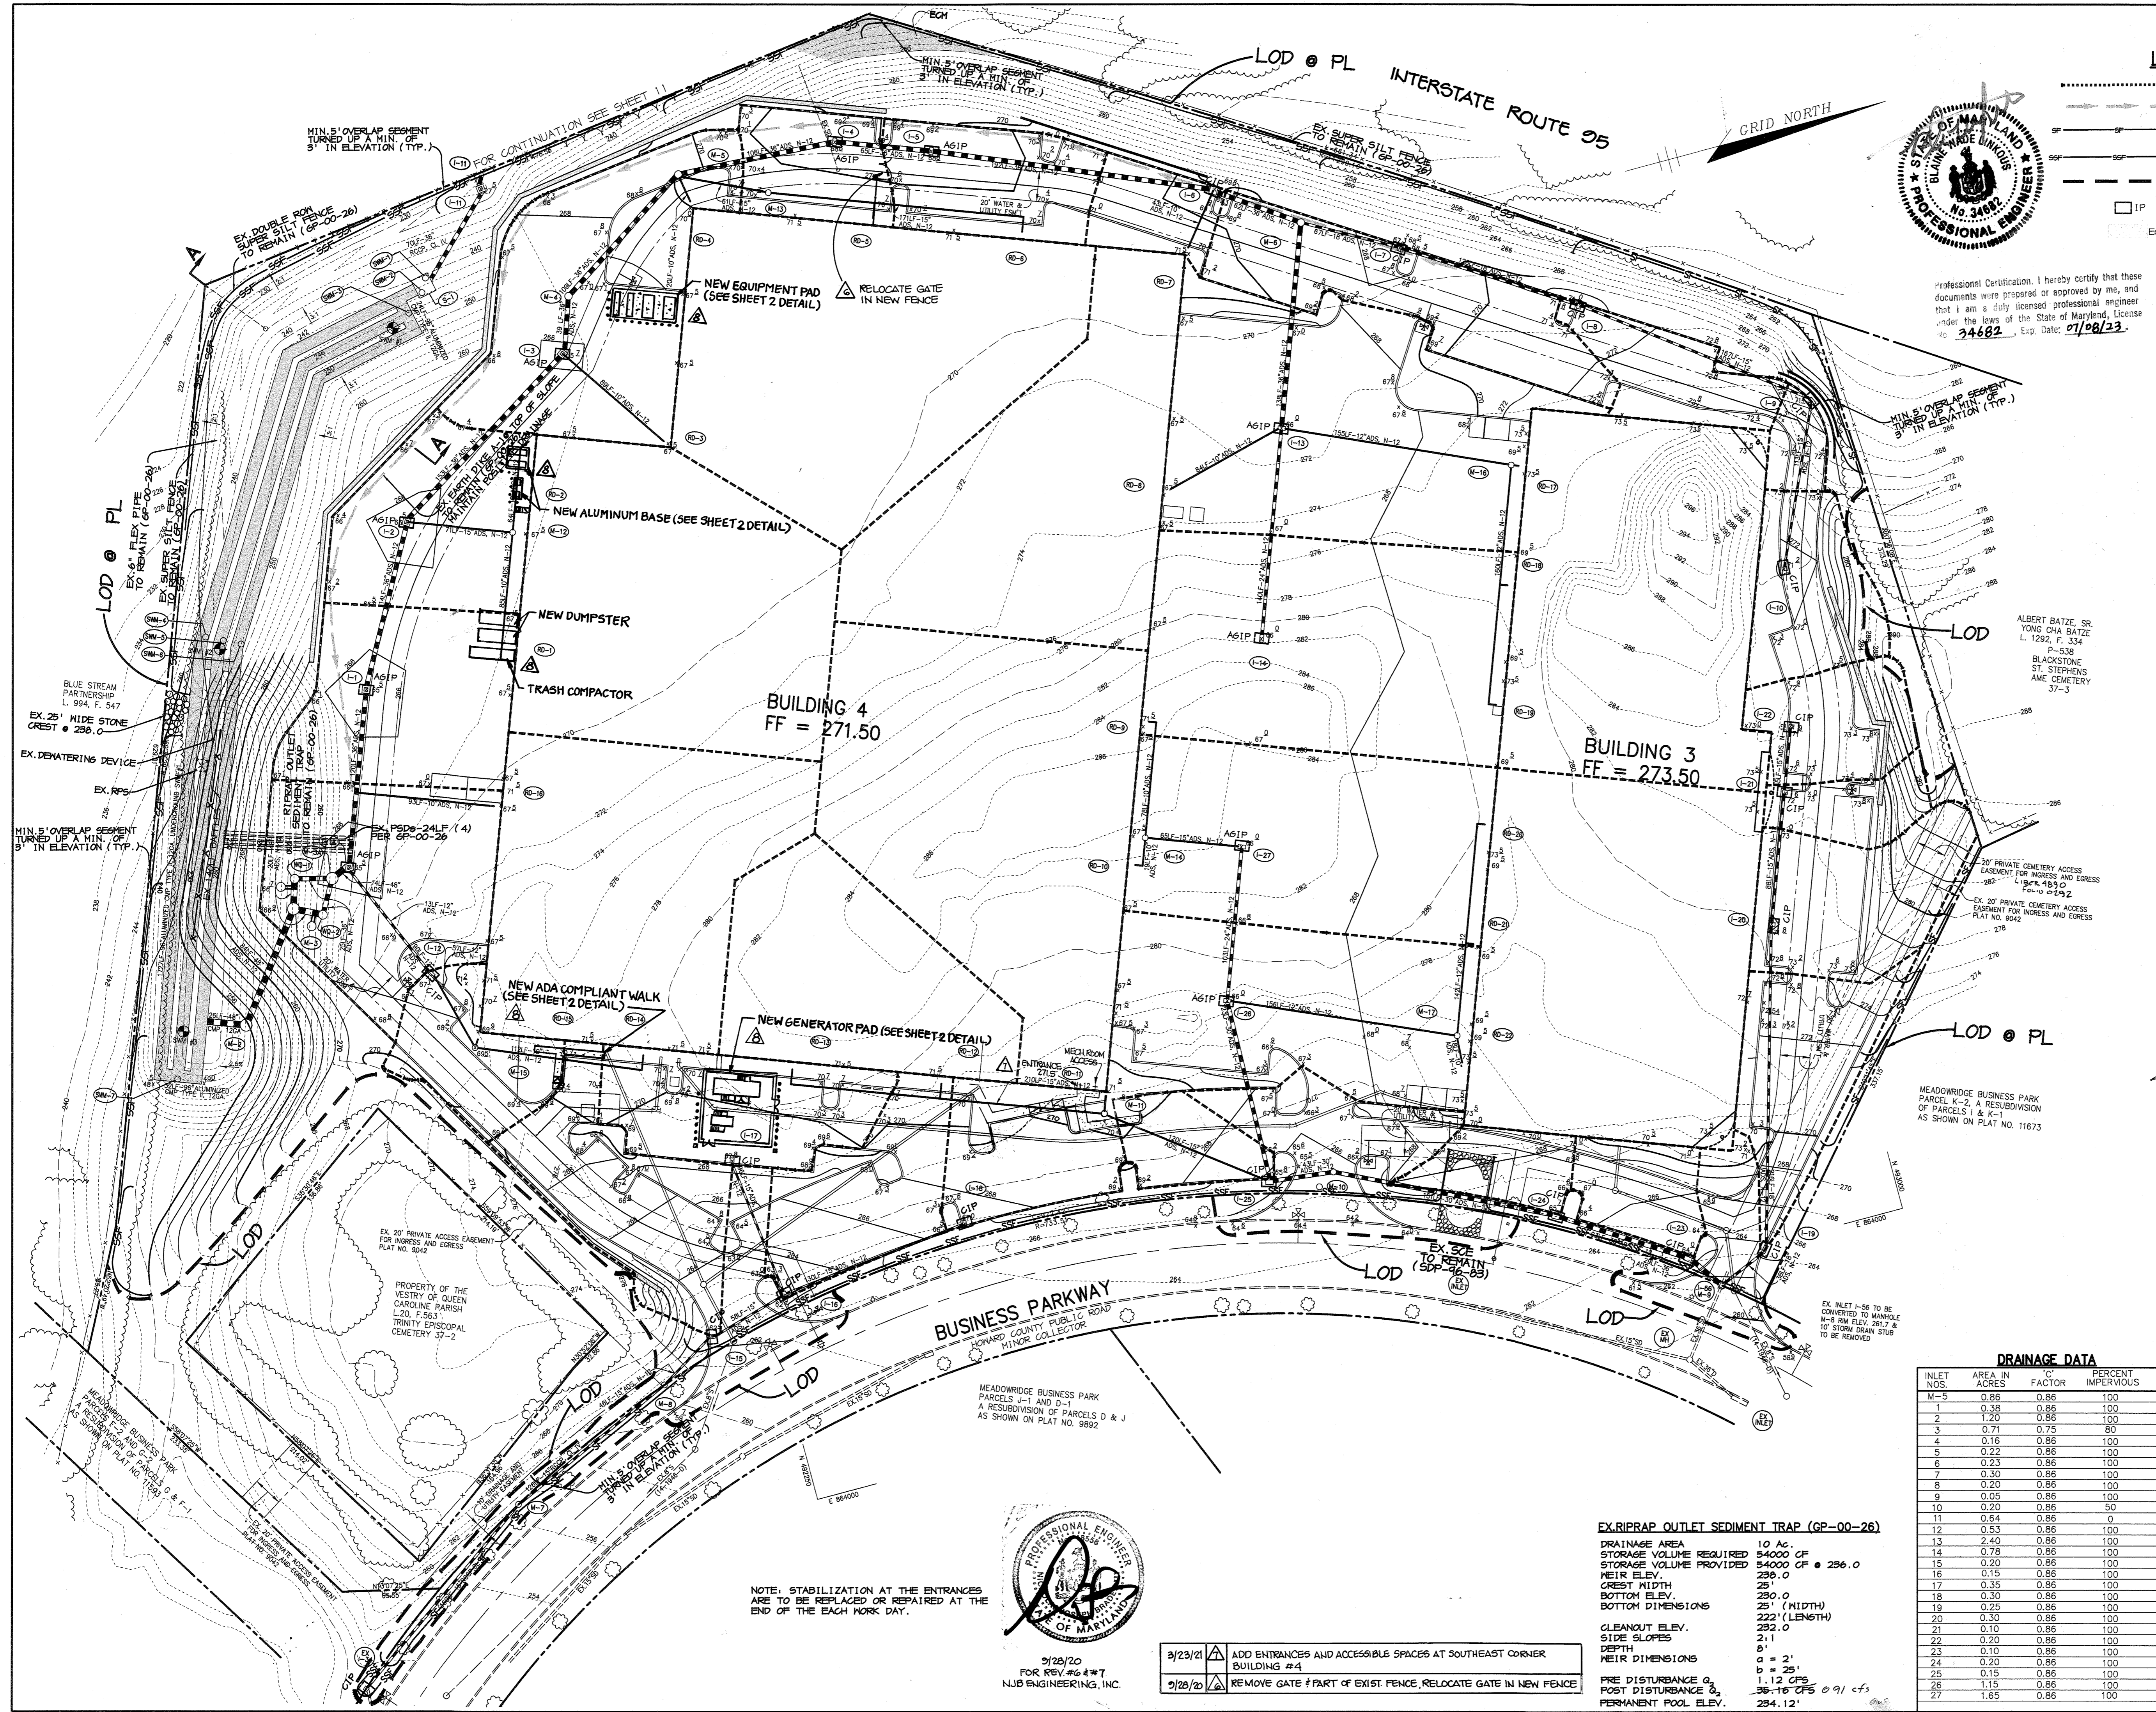

**LEGEND**

- ..... DRAINAGE AREA DIVIDE
- EX. EARTH DIKE A-1 UNDER GP-00-26
- SILT FENCE
- SUPER SILT FENCE
- LIMIT OF DISTURBANCE
- IP INLET PROTECTION
- ECM EROSION CONTROL MAT



Professional Certification. I hereby certify that these documents were prepared or approved by me, and that I am a duly licensed professional engineer under the laws of the State of Maryland, License No. 34682, Exp. Date: 07/08/23.

09/23/21 ADD ENTRANCES AND ACCESSIBLE SPACES AT SOUTHEAST CORNER BUILDING #4  
 09/28/20 REMOVE GATE # PART OF EXIST. FENCE, RELOCATE GATE IN NEW FENCE

BY THE DEVELOPER :  
 I/WE CERTIFY THAT ALL DEVELOPMENT AND CONSTRUCTION WILL BE DONE ACCORDING TO THIS PLAN, AND THAT ANY RESPONSIBLE PERSONNEL INVOLVED IN THE CONSTRUCTION PROJECT WILL HAVE A CERTIFICATE OF ATTENDANCE AT A DEPARTMENT OF THE ENVIRONMENT APPROVED TRAINING PROGRAM FOR THE CONTROL OF SEDIMENT AND EROSION BEFORE BEGINNING THE PROJECT. I ALSO AUTHORIZE PERIODIC ON-SITE INSPECTIONS BY THE HOWARD SOIL CONSERVATION DISTRICT.

*Joseph Kelly*  
 DEVELOPER 10-11-99 DATE

BY THE ENGINEER :  
 I CERTIFY THAT THIS PLAN FOR EROSION AND SEDIMENT CONTROL REPRESENTS A PRACTICAL AND WORKABLE PLAN BASED ON MY PERSONAL KNOWLEDGE OF THE SITE CONDITIONS AND THAT IT WAS PREPARED IN ACCORDANCE WITH THE REQUIREMENTS OF THE HOWARD SOIL CONSERVATION DISTRICT.

*Albert Batze, Sr.*  
 ENGINEER 10-11-99 DATE

THESE PLANS HAVE BEEN REVIEWED FOR THE HOWARD SOIL CONSERVATION DISTRICT AND MEET THE TECHNICAL REQUIREMENTS FOR SOIL EROSION AND SEDIMENT CONTROL.

*Cheryl Simms/GS*  
 NATURAL RESOURCES CONSERVATION SERVICE 10/10/99 DATE

THIS DEVELOPMENT PLAN IS APPROVED FOR SOIL EROSION AND SEDIMENT CONTROL BY THE HOWARD SOIL CONSERVATION DISTRICT.

*John A. Smith*  
 HOWARD SOIL CONSERVATION DISTRICT 10/10/99 DATE

APPROVED : HOWARD COUNTY DEPARTMENT OF PLANNING AND ZONING.  
*Joseph Smith*  
 DIRECTOR 10/10/99 DATE

*Arthur E. Muegge*  
 CHIEF, DEVELOPMENT ENGINEERING DIVISION 10/10/99 DATE

*Archie Hamilton*  
 CHIEF, DIVISION OF LAND DEVELOPMENT 10/10/99 DATE

DATE	NO.	REVISION

OWNER/DEVELOPER  
 PROLOGIS DEVELOPMENT SERVICES INCORPORATED  
 5200 EISENHOWER AVENUE, SECOND FLOOR  
 ALEXANDRIA, VIRGINIA 22304  
 (703)751-9292

PROJECT MEADOWRIDGE BUSINESS PARK  
 PARCEL G-2  
 2 WAREHOUSE BUILDINGS

AREA TAX MAP NO. 37 ZONED M-1 PARCEL G-2  
 1st ELECTION DISTRICT  
 HOWARD COUNTY, MARYLAND

TITLE GRADING, SEDIMENT CONTROL  
 PLAN & DRAINAGE AREA MAP

RIEMER MUEGGE & ASSOCIATES INC.  
 ENGINEERING • ENVIRONMENTAL SERVICES • PLANNING • SURVEYING  
 8818 Centre Park Drive, Columbia, MD 21045  
 tel 410.997.8800 fax 410.997.9282


DATE  
 DESIGNED BY : CJR  
 DRAWN BY: DAM  
 PROJECT NO : 97320/PARCEL\_G  
 SDP4.DWG  
 DATE : OCTOBER 11, 1999  
 SCALE : 1" = 50'  
 DRAWING NO. 4 OF 25

**DRAINAGE DATA**

INLET NOS.	AREA IN ACRES	% IMPERVIOUS	PERCENT IMPERVIOUS
M-5	0.86	0.86	100
1	0.38	0.86	100
2	1.20	0.86	100
3	0.71	0.75	80
4	0.16	0.86	100
5	0.22	0.86	100
6	0.23	0.86	100
7	0.30	0.86	100
8	0.20	0.86	100
9	0.05	0.86	100
10	0.20	0.86	50
11	0.64	0.86	0
12	0.53	0.86	100
13	2.40	0.86	100
14	0.78	0.86	100
15	0.20	0.86	100
16	0.15	0.86	100
17	0.35	0.86	100
18	0.30	0.86	100
19	0.25	0.86	100
20	0.30	0.86	100
21	0.10	0.86	100
22	0.20	0.86	100
23	0.10	0.86	100
24	0.20	0.86	100
25	0.15	0.86	100
26	1.15	0.86	100
27	1.85	0.86	100

EX. RIPRAP OUTLET SEDIMENT TRAP (GP-00-26)  
 DRAINAGE AREA 10 AC.  
 STORAGE VOLUME REQUIRED 54000 CF  
 STORAGE VOLUME PROVIDED 54000 CF @ 236.0  
 WEIR ELEV. 236.0  
 CREST WIDTH 236.0  
 BOTTOM ELEV. 230.0  
 BOTTOM DIMENSIONS 25' (WIDTH) 222' (LENGTH)  
 CLEANOUT ELEV. 232.0  
 SIDE SLOPES 2:1  
 DEPTH 0  
 WEIR DIMENSIONS a = 2' b = 25'  
 PRE DISTURBANCE Q<sub>s</sub> 1.12 CFS  
 POST DISTURBANCE Q<sub>s</sub> 38-16 CFS @ 0.91 cfs  
 PERMANENT POOL ELEV. 234.12'


NOTE: STABILIZATION AT THE ENTRANCES ARE TO BE REPLACED OR REPAIRED AT THE END OF THE EACH WORK DAY.

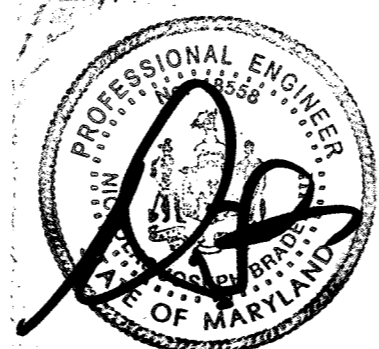

09/23/21 ADD ENTRANCES AND ACCESSIBLE SPACES AT SOUTHEAST CORNER BUILDING #4  
 09/28/20 REMOVE GATE # PART OF EXIST. FENCE, RELOCATE GATE IN NEW FENCE


09/28/20 FOR REV. #6 & #7 NUB ENGINEERING, INC.



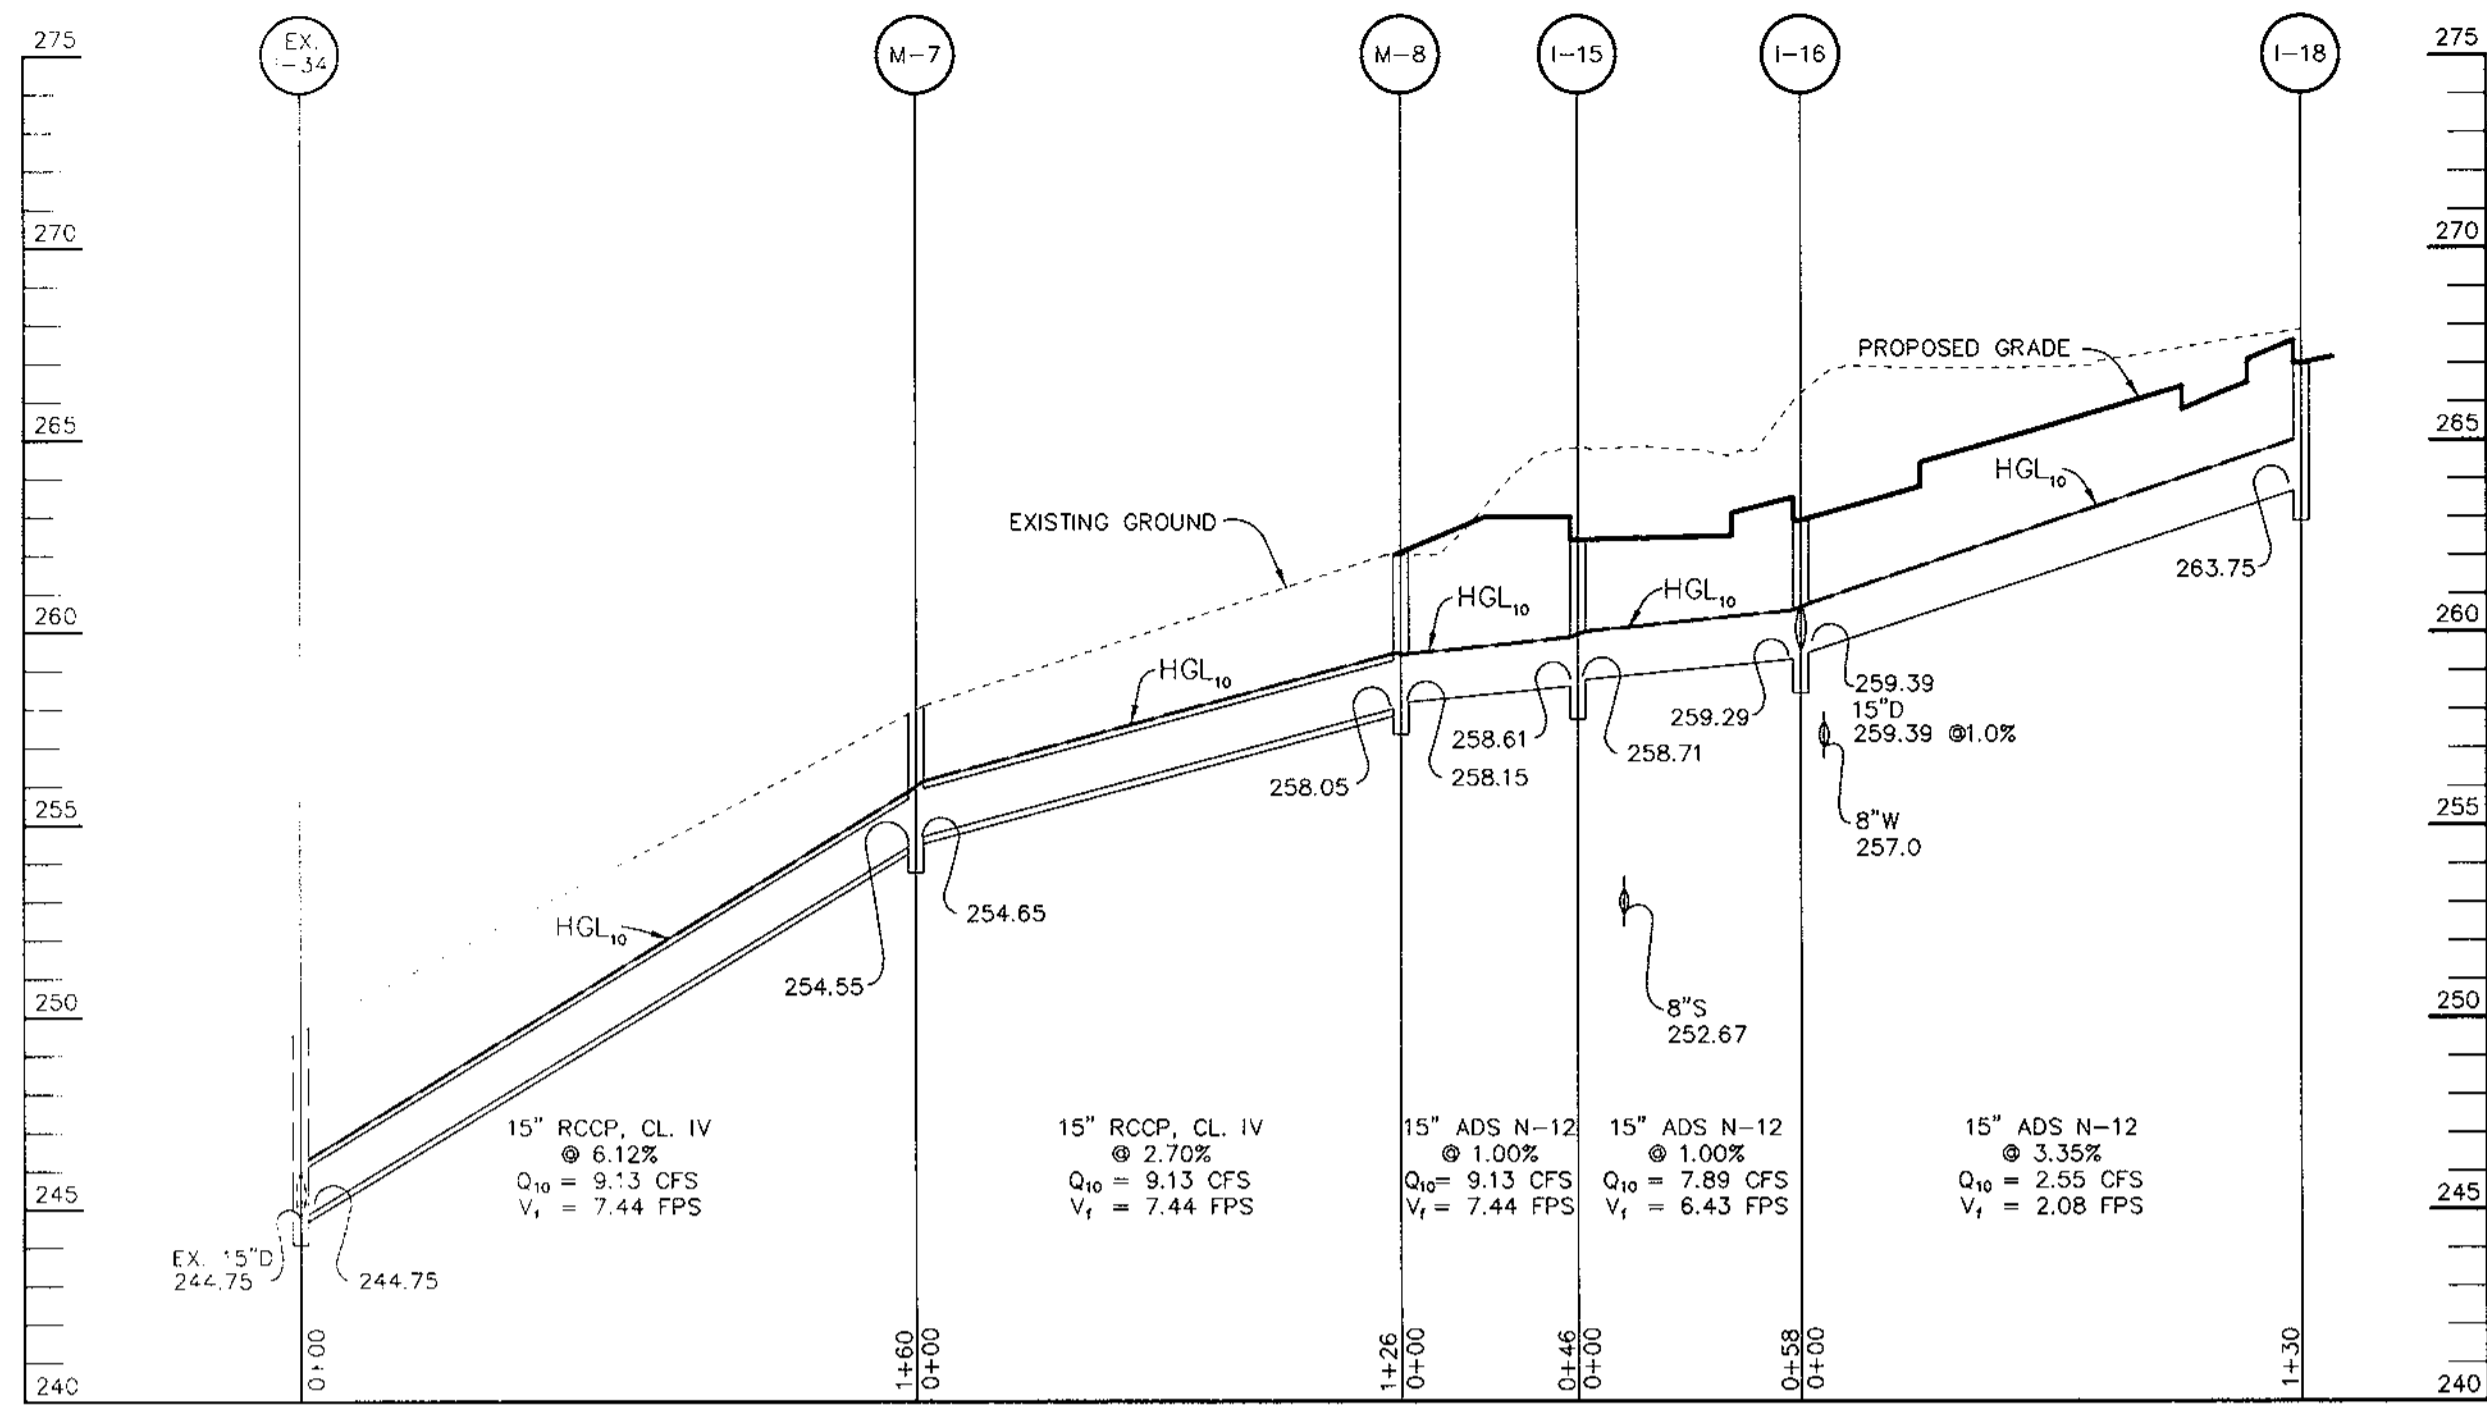


**STORM DRAIN PROFILE**

SCALE:  
HOR.-1"=50'  
VERT.-1"=5'

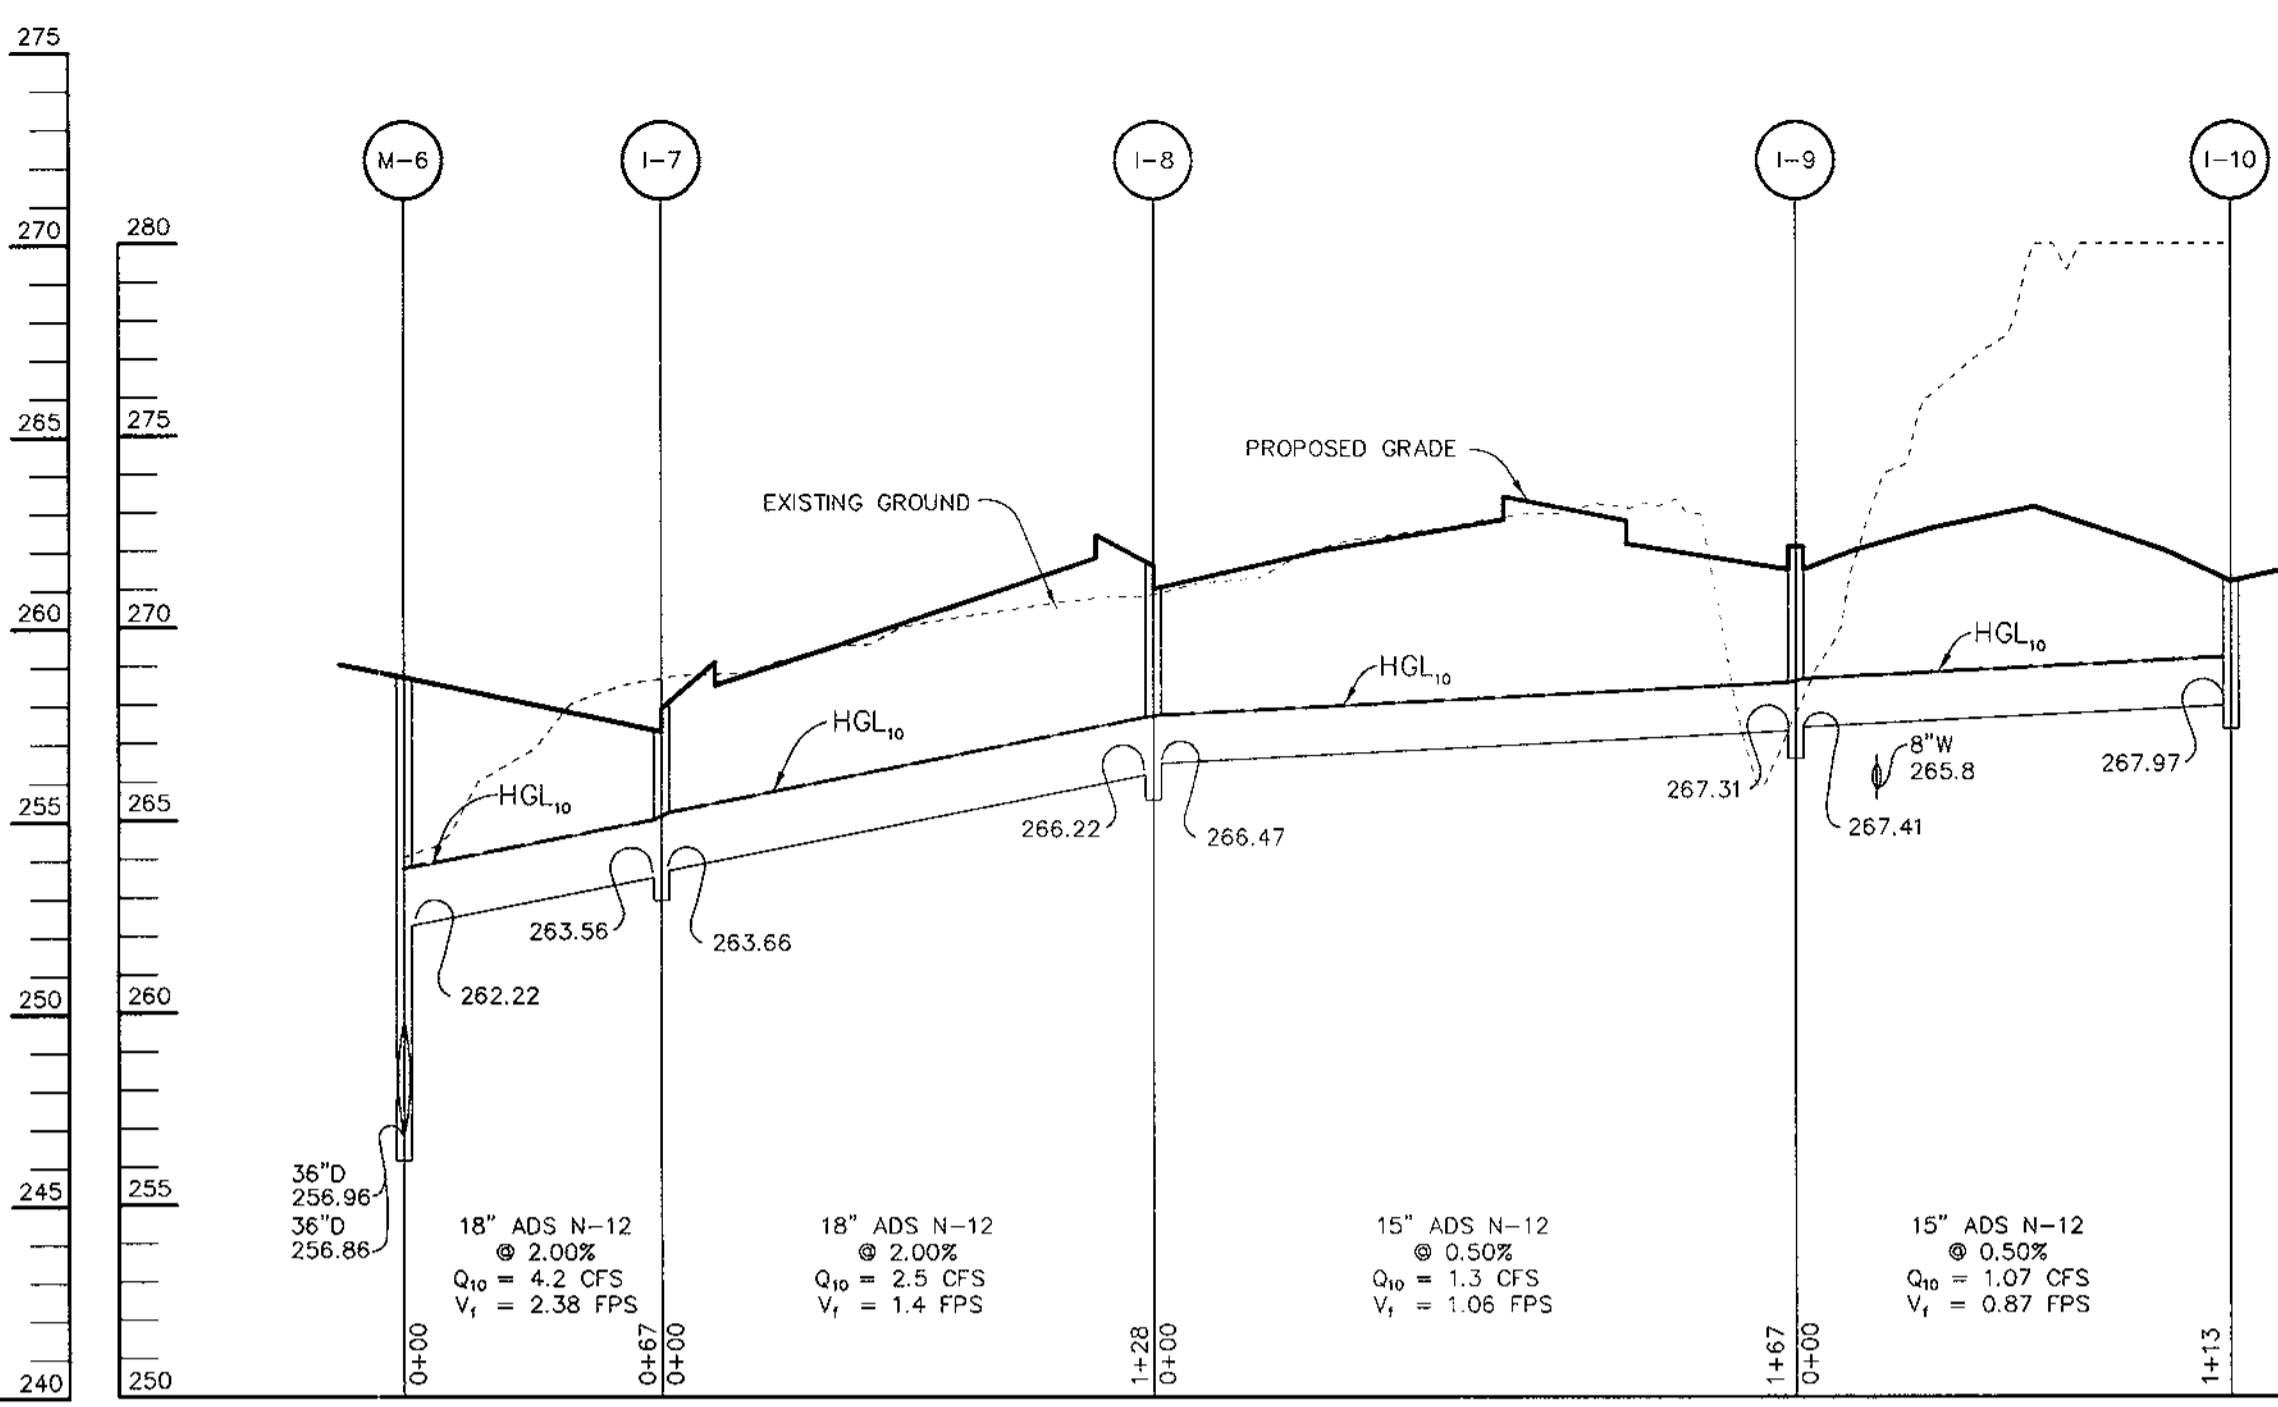


**STORM DRAIN PROFILE**

SCALE:  
HOR.-1"=50'  
VERT.-1"=5'

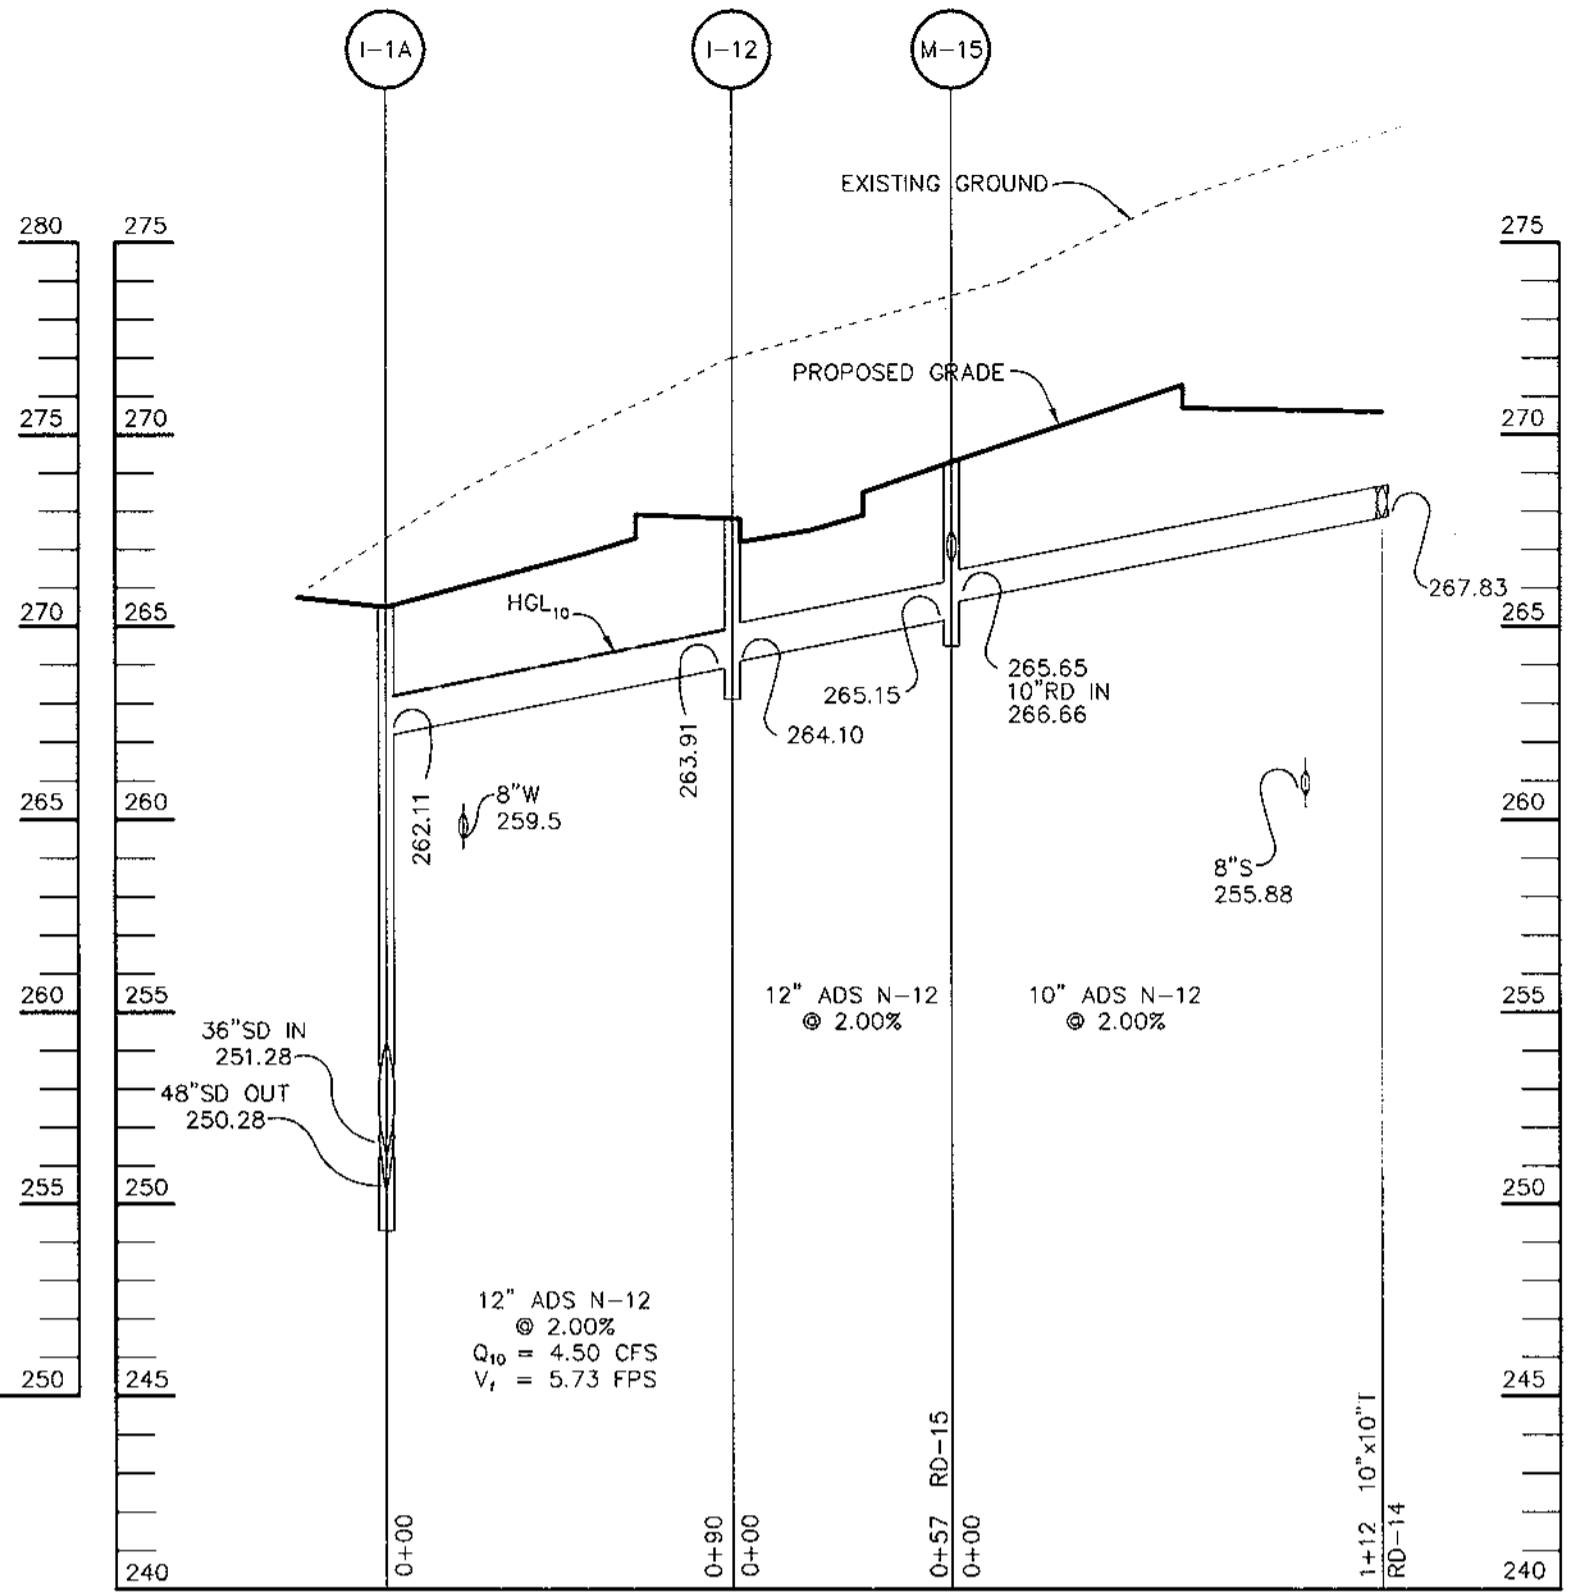


**STORM DRAIN PROFILE**

SCALE:  
HOR.-1"=50'  
VERT.-1"=5'

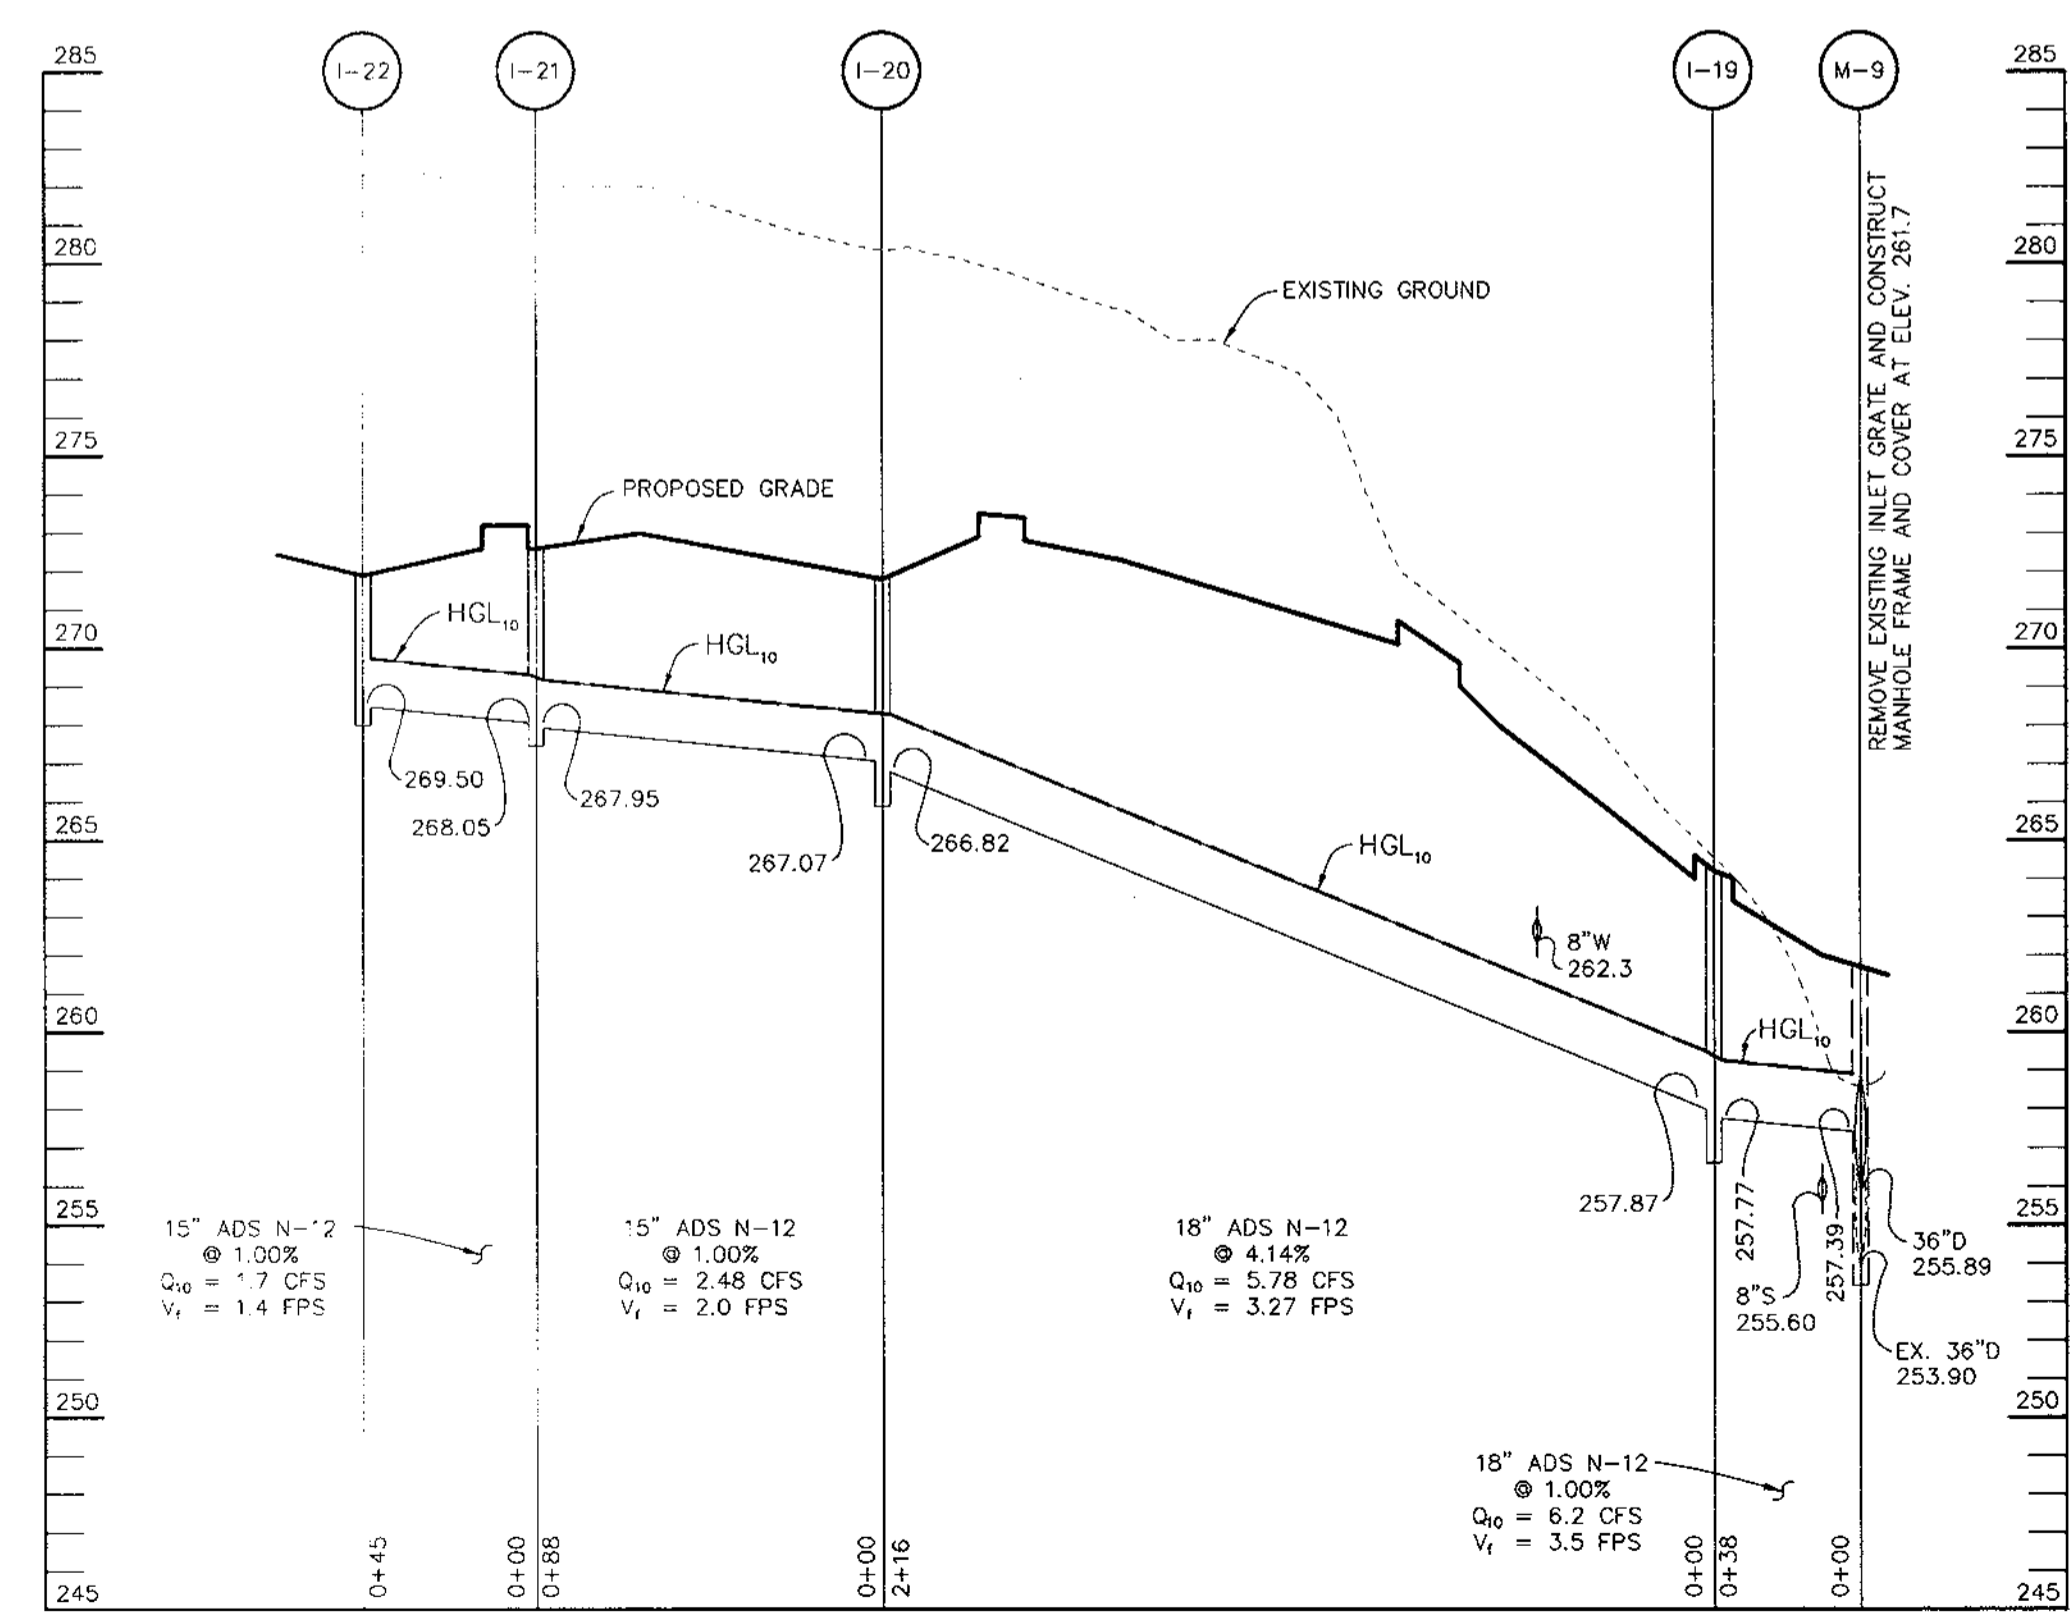

**STORM DRAIN PROFILE**

SCALE:  
HOR.-1"=50'  
VERT.-1"=5'

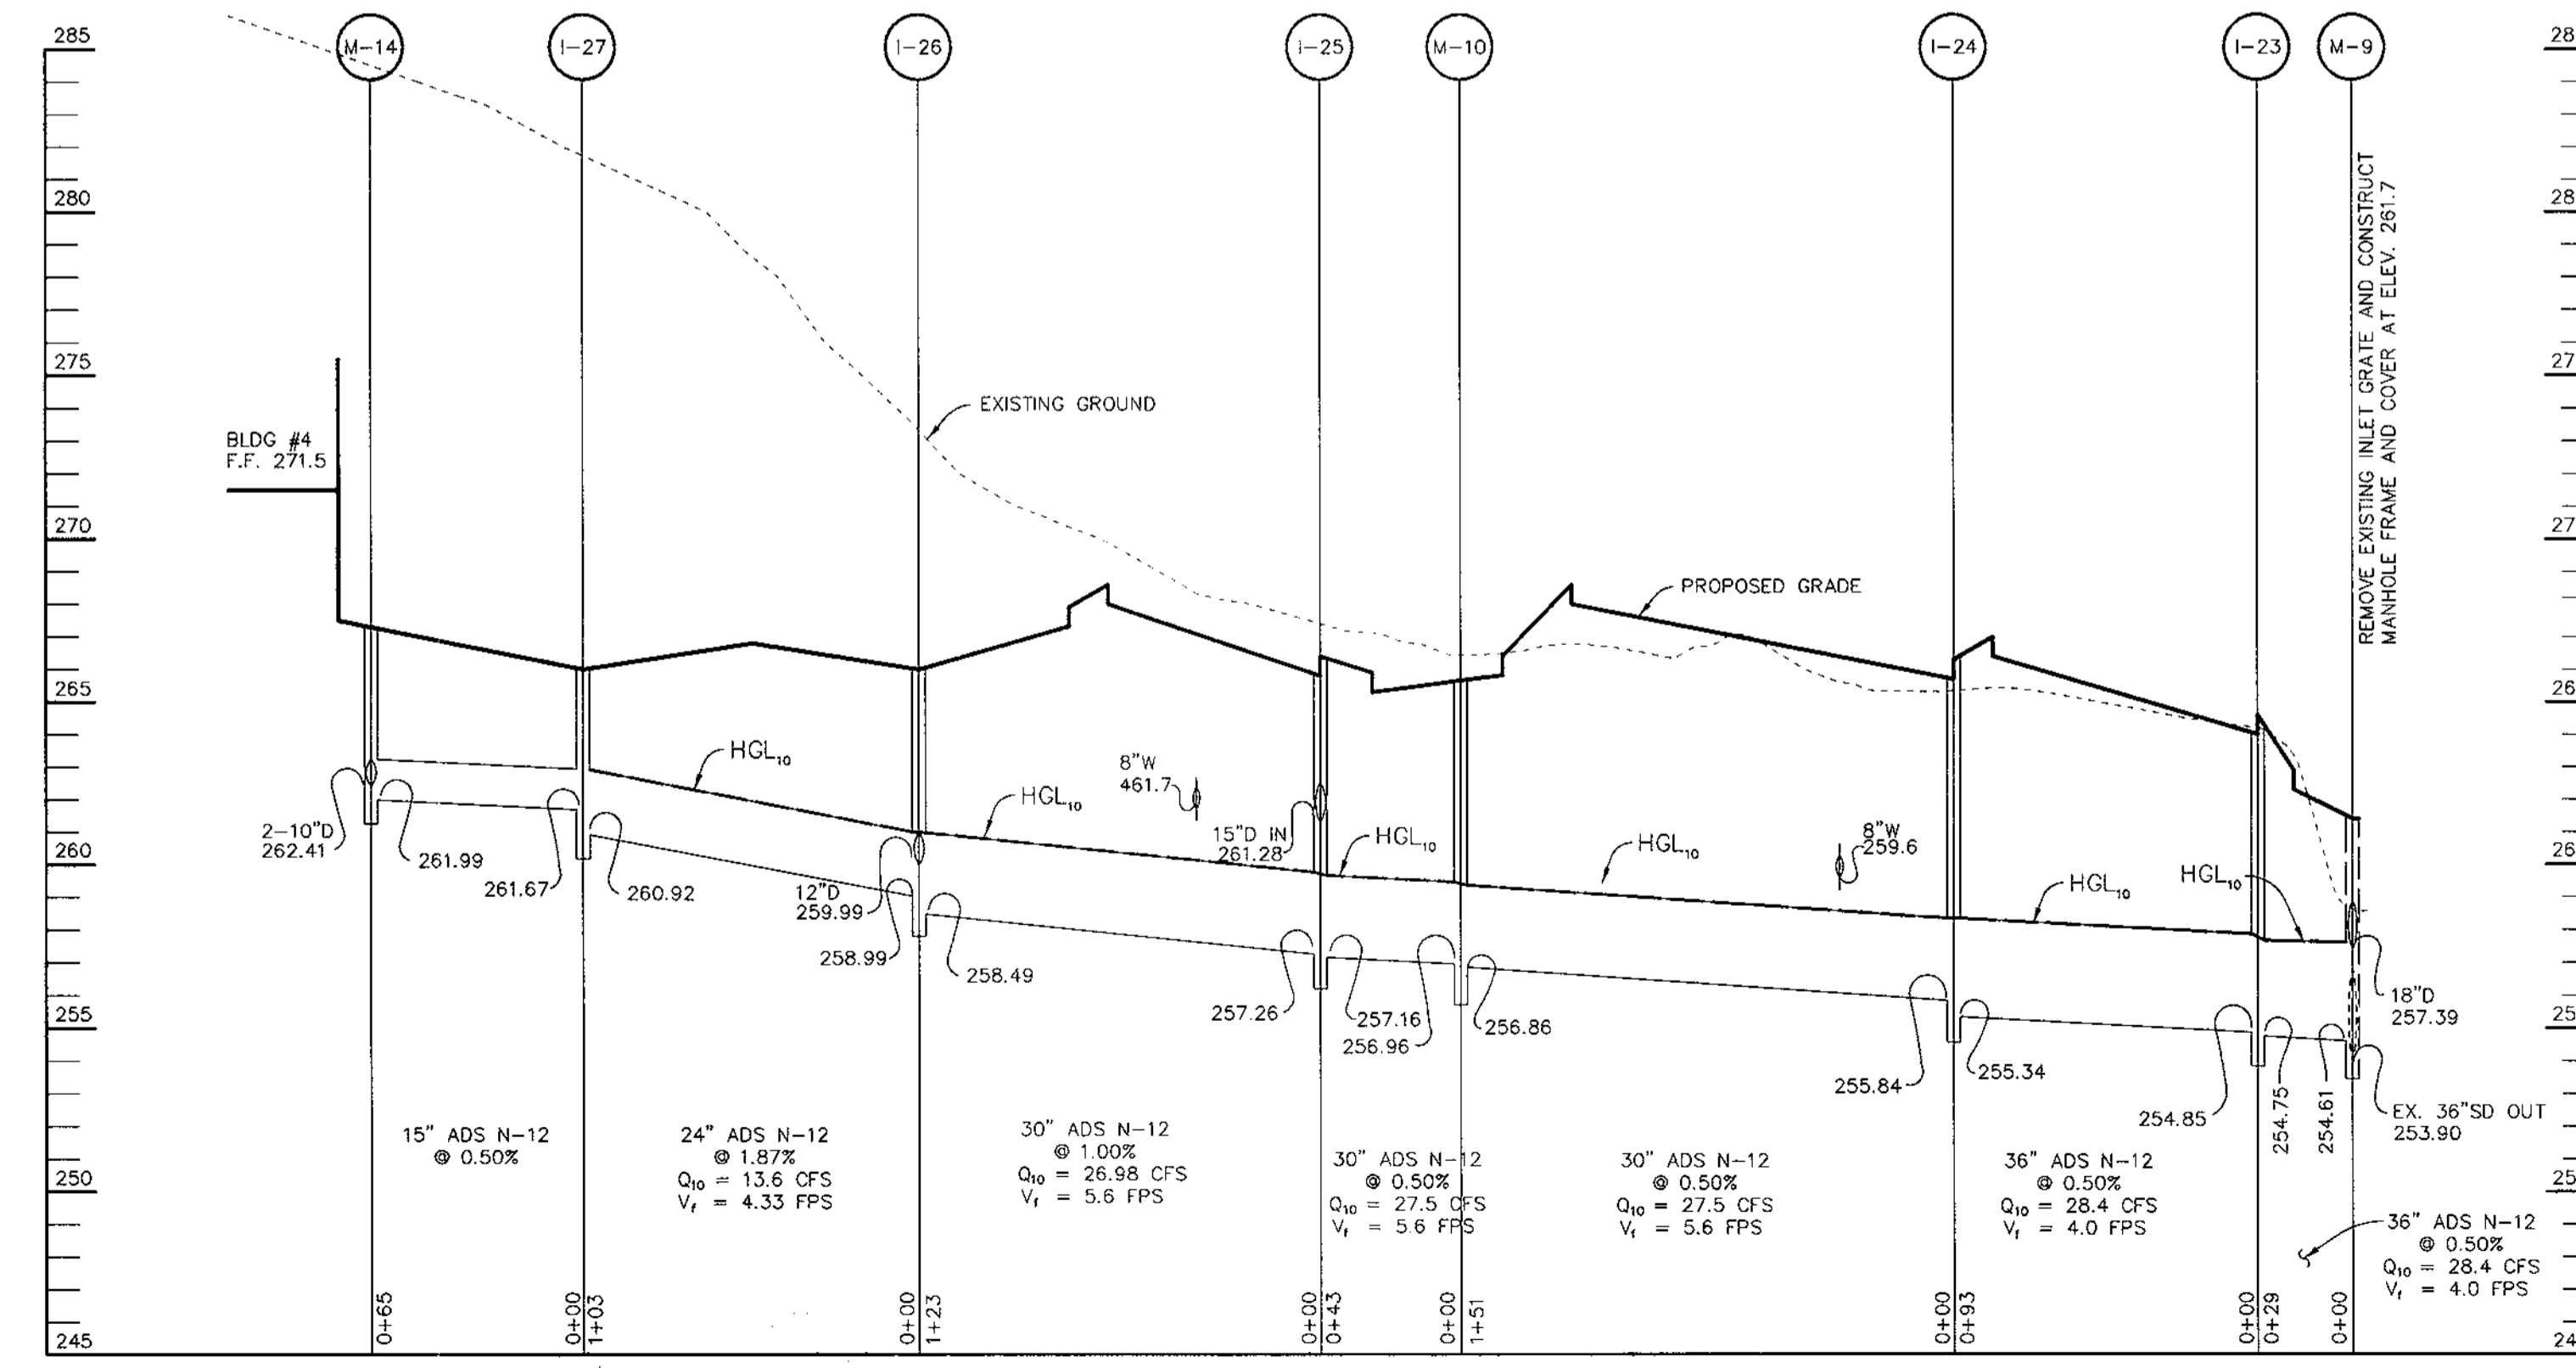

**STORM DRAIN PROFILE**

SCALE:  
HOR.-1"=50'  
VERT.-1"=5'

APPROVED: HOWARD COUNTY DEPARTMENT OF PLANNING AND ZONING.  
 DIRECTOR: [Signature] DATE: 10/12/99  
 CHIEF, DEVELOPMENT ENGINEERING DIVISION: [Signature] DATE: 10/12/99  
 CHIEF, DIVISION OF LAND DEVELOPMENT: [Signature] DATE: 10/15/99

DATE	REVISION
OWNER/DEVELOPER	
PROLOGIS DEVELOPMENT SERVICES INCORPORATED 5200 EISENHOWER AVENUE, SECOND FLOOR ALEXANDRIA, VIRGINIA 22304 (703)751-9292	
PROJECT: MEADOWRIDGE BUSINESS PARK PARCEL G-2 2 WAREHOUSE BUILDINGS	
AREA: TAX MAP NO. 37 ZONED M-1 PARCEL G-2 1st ELECTION DISTRICT HOWARD COUNTY, MARYLAND	
TITLE: STORM DRAIN PROFILES	

**RIEMER MUEGGE & ASSOCIATES INC.**  
 ENGINEERING • ENVIRONMENTAL SERVICES • PLANNING • SURVEYING  
 8818 Centre Park Drive, Columbia, MD 21045  
 Tel 410.997.8800 Fax 410.997.9282


DATE: \_\_\_\_\_  
 DESIGNED BY: CJR  
 DRAWN BY: DAM  
 PROJECT NO: 97320/PARCEL G SDPS.DWG  
 DATE: OCTOBER 11, 1999  
 SCALE: AS SHOWN  
 DRAWING NO. 5 OF 25



**STRUCTURE SCHEDULE**


STRUCTURE	TYPE	LOCATION	INV. IN	INV. OUT	TOP	DIMENSIONS SEE NOTE 5	REMARKS
I-1	S	N 492,098 E 863,401	259.70 (15") 251.98 (36")	251.88 (36")	265.5 GRATE	5'L x 5'W	HOCO STD. DETAIL SD 4.22
I-2	S	N 492,153 E 863,300	257.31 (15") 252.65 (36")	252.55 (36")	265.5 GRATE	5'L x 5'W	HOCO STD. DETAIL SD 4.22
I-3	S	N 492,282 E 863,218	262.59 (10") 253.51 (36")	253.41 (36")	265.7 GRATE	5'L x 5'W	HOCO STD. DETAIL SD 4.22
I-4	S	N 492,494 E 863,129	255.07 (36")	254.97 (36")	268.8 GRATE	5'L x 2'7"W	HOCO STD. DETAIL SD 4.22
I-5	S	N 492,555 E 863,152	255.49 (36")	255.39 (36")	268.8 GRATE	5'L x 2'7"W	HOCO STD. DETAIL SD 4.22
I-6	S COMB	N 492,731.79 E 863,223.85	265.87 (10") 256.55 (36")	256.45 (36")	269.9 TC	5'L x 5'W	HOCO STD. DETAIL SD 4.32
I-7	S COMB	N 492,841.48 E 863,294.02	263.66 (18")	263.56 (18")	267.9 TC	3'5"L x 2'7"W	HOCO STD. DETAIL SD 4.32
I-8	S COMB	N 492,947.26 E 863,361.70	266.47 (15")	266.22 (18")	271.6 TC	3'5"L x 2'7"W	HOCO STD. DETAIL SD 4.32
I-9	A-5	N 493,079.49 E 863,465.31	267.41 (15")	267.31 (15")	272.0 TC	5'L x 2'6"W	HOCO STD. DETAIL SD 4.01
I-10	S COMB	N 493,032.27 E 863,567.63	-	267.97 (15")	271.8 TC	3'5"L x 2'7"W	HOCO STD. DETAIL SD 4.32
I-11	D	N 492,258 E 863,098	220.00 (30")	217.27 (30")	227.5	5'L x 5'W	HOCO STD. DETAIL SD 4.11
I-12	A-5	N 492,090.03 E 863,595.71	264.10 (12")	263.91 (12")	267.7 TC	5'L x 2'6"W	HOCO STD. DETAIL SD 4.01
I-13	DOUBLE S	N 492,733 E 863,391	262.39 (10") 258.65 (24")	257.65 (36")	266.0 GRATE	5'6 1/2'L x 2'7 1/2"W	HOCO STD. DETAIL SD 4.23
I-14	DOUBLE S	N 492,685 E 863,523	-	261.87 (24")	266.0 GRATE	5'6 1/2'L x 2'7 1/2"W	HOCO STD. DETAIL SD 4.23
I-15	S COMB	N 492,208.63 E 863,876.89	258.71 (15")	258.61 (15")	263.0 TC	3'5"L x 2'7"W	HOCO STD. DETAIL SD 4.32
I-16	S COMB	N 492,264.39 E 863,863.71	259.39 (15") 259.39 (15")	259.29 (15")	263.5 TC	3'5"L x 2'7"W	HOCO STD. DETAIL SD 4.32
I-17	S COMB	N 492,252.56 E 863,768.75	-	263.42 (15")	268.4 TC	3'5"L x 2'7"W	HOCO STD. DETAIL SD 4.32
I-18	S COMB	N 492,392.39 E 863,848.94	-	263.75 (15")	267.6 TC	3'5"L x 2'7"W	HOCO STD. DETAIL SD 4.32
I-19	A-5	N 492,903.18 E 864,001.77	257.87 (18")	257.77 (18")	264.2 TC	5'L x 3'6"W	HOCO STD. DETAIL SD 4.01
I-20	S COMB	N 492,963.44 E 863,794.20	267.07 (15")	266.82 (18")	272.4 TC	3'5"L x 2'7"W	HOCO STD. DETAIL SD 4.32
I-21	S COMB	N 492,994.32 E 863,711.04	268.05 (15")	267.95 (15")	273.2 TC	3'5"L x 2'7"W	HOCO STD. DETAIL SD 4.32
I-22	S COMB	N 493,009.58 E 863,670.00	-	269.50 (15")	272.5 TC	3'5"L x 2'7"W	HOCO STD. DETAIL SD 4.32
I-23	A-5	N 492,854.21 E 863,993.47	254.85 (36")	254.75 (36")	264.6 TC	5'L x 4'W	HOCO STD. DETAIL SD 4.01
I-24	A-5	N 492,776.07 E 863,943.15	255.84 (30")	255.34 (36")	266.3 TC	5'L x 4'W	HOCO STD. DETAIL SD 4.01
I-25	A-5	N 492,596.68 E 863,871.61	261.28 (15") 257.25 (30")	257.16 (30")	266.4 TC	5'L x 4'W	HOCO STD. DETAIL SD 4.01
I-26	DOUBLE S	N 492,600 E 863,750	259.99 (12") 258.99 (24")	258.49 (30")	266.0 GRATE	5'6 1/2'L x 2'7 1/2"W	HOCO STD. DETAIL SD 4.23
I-27	DOUBLE S	N 492,636 E 863,653	261.67 (15")	260.92 (24")	266.0 GRATE	5'6 1/2'L x 2'7 1/2"W	HOCO STD. DETAIL SD 4.23
I-1A	S	N 492,056 E 863,512	262.11 (12") 251.28 (36")	250.28 (48")	265.5 GRATE	6'L x 5'W	HOCO STD. DETAIL SD 4.22
M-1	SHALLOW MANHOLE	N 492,351 E 862,921	216.27 (30")	216.17 (30")	222.5	4'0" x 4'0"	MSHA STD. DETAIL MD 383.00
M-2	8" MH	N 491,963 E 863,596	244.10(48")	233.90 (48")	250.0	8"0"DIAMETER	MSHA STD. DETAIL MD-384.09
M-3	8" MH	N 492,013 E 863,529	249.24 (48") 249.24 (48")	249.14 (48")	266.5	8"0"DIAMETER BRICK	MSHA STD. DETAIL MD-384.09 SEE SHEET 25 FOR SPLITTER WALL
M-4	5" MH	N 492,296 E 863,182	253.80 (36")	253.70 (36")	266.7	5"0"DIAMETER	HOCO STD. DETAIL G 5.13
M-5	5" MH	N 492,388 E 863,123	265.32 (15") 254.44 (36")	254.34 (36")	269.5	5"0"DIAMETER	HOCO STD. DETAIL G 5.13
M-6	5" MH	N 492,781 E 863,262	262.22 (18") 256.96 (36")	256.86 (36")	268.9	5"0"DIAMETER	HOCO STD. DETAIL G 5.13
M-7	4" MH	N 492,056 E 863,951	254.65 (15")	254.55 (15")	258.0	4"0"DIAMETER	HOCO STD. DETAIL G 5.12
M-8	4" MH	N 492,171 E 863,900	258.15 (15")	258.05 (15")	261.8	4"0"DIAMETER	HOCO STD. DETAIL G 5.12
M-9	5" MH	N 492,870 E 864,018	257.39 (18") 254.61 (36")	253.90 (36")	261.7	5"0"DIAMETER	HOCO STD. DETAIL G 5.13
M-10	5" MH	N 492,639 E 863,879	256.96 (30")	256.86 (30")	265.5	5"0"DIAMETER	HOCO STD. DETAIL G 5.13
M-11	4" MH	N 492,501 E 863,801	267.11 (10") 265.27 (15")	265.12 (15")	270.5	4"0"DIAMETER	HOCO STD. DETAIL G 5.12
M-12	4" MH	N 492,219 E 863,324	262.29 (10") 262.29 (10")	261.74 (15")	267.3	4"0"DIAMETER	HOCO STD. DETAIL G 5.12
M-13	4" MH	N 492,443 E 863,150	266.26 (15")	265.63 (15")	270.7	4"0"DIAMETER	HOCO STD. DETAIL G 5.12
M-14	4" MH	N 492,575 E 863,631	262.41 (10") 262.41 (10")	261.99 (15")	267.3	4"0"DIAMETER	HOCO STD. DETAIL G 5.12
M-15	4" MH	N 492,107 E 863,850	268.66 (10") 265.65 (10")	265.15 (12")	269.3	4"0"DIAMETER	HOCO STD. DETAIL G 5.12
M-16	4" MH	N 492,875 E 863,454	265.83 (10") 262.85 (12")	262.75 (12")	269.3	4"0"DIAMETER	HOCO STD. DETAIL G 5.12
M-17	4" MH	N 492,742 E 863,812	265.18 (10") 263.21 (12")	263.11 (12")	269.3	4"0"DIAMETER	HOCO STD. DETAIL G 5.12
M-3A	8" MH	N 492,043 E 863,516	256.21 (48") 249.86	249.96 (36") 249.96 (36")	265.45	8"0"DIAMETER	MSHA STD. DETAIL MD-384.09
S-1	-	N 492,204 E 863,150	230.00 (96")	228.50 (30")	241.0	-	SEE SHEET 24
WQ-1	5K	N 492,019 E 863,512	✓249.84 (36")	✓249.34 (48")	265.75 266.24	72" DIA. x 72" DIA.	BAYSAVER SYSTEM SEE SHEET 12
WQ-2	5K	N 492,031 E 863,538	✓249.84 (36")	✓249.34 (48")	266.84	72" DIA. x 72" DIA.	BAYSAVER SYSTEM SEE SHEET 12
E-1	30" END SECTION	N 492,286 E 862, 854	215.70 (30")	-	-	30" DIAMETER	MSHA STD. DETAIL MD 368.01
SMH 8	4" MH	N 492,763 E 863,256	260.53 (8")	260.43 (8")	269.5	4"0" DIAMETER	HOCO STD. DETAIL G 5-12
SMH 9	4" MH	N 492,467 E 863,193	263.67 (8")	263.57 (8")	270.4	4"0" DIAMETER	HOCO STD. DETAIL G 5-12
SMH 1	4" MH	N 492,877 E 864,024	255.50 (8")	249.70 (8")	261.7	4"0" DIAMETER	HOCO STD. DETAIL G 5.12
SMH 2	4" MH	N 492,883 E 863,984	256.00 (8")	255.90 (8")	264.3	4"0" DIAMETER	HOCO STD. DETAIL G 5.12
SMH 3	4" MH	N 492,818 E 863,939	256.89 (8")	256.79 (8")	266.5	4"0" DIAMETER	HOCO STD. DETAIL G 5.12
SMH 4	4" MH	N 492,223 E 863,884	252.20 (8")	252.10 (8")	262.2	4"0" DIAMETER	HOCO STD. DETAIL G 5.12
SMH 5	4" MH	N 492,213 E 863,842	254.32 (8") 254.32 (8")	254.22 (8")	263.6	4"0" DIAMETER	HOCO STD. DETAIL G 5.12
SMH 6	4" MH	N 492,545 E 863,817	257.35 (8") 258.82 (8")	257.25 (8")	269.4	4"0" DIAMETER	HOCO STD. DETAIL G 5-12
SMH 7	4" MH	N 492,647 E 863,594	258.55 (8") 258.55 (8")	258.45 (8")	266.8	4"0" DIAMETER	HOCO STD. DETAIL G 5-12
SWM 1	3" MH	SEE SHEET 11	229.40	228.70	241.82	3"0" DIAMETER	SEE SHEET 24
SWM 2	3" MH	SEE SHEET 11	-	-	243.53 244.3	3"0" DIAMETER	SEE SHEET 24
SWM 3	3" MH	SEE SHEET 11	229.73	229.71	246.88 246.5	3"0" DIAMETER	SEE SHEET 24
SWM 4	3" MH	SEE SHEET 11	229.45	229.38	242.16 240.9	3"0" DIAMETER	SEE SHEET 24
SWM 5	3" MH	SEE SHEET 11	230.00	229.92	247.47 241.8	3"0" DIAMETER	SEE SHEET 24
SWM 6	3" MH	SEE SHEET 11	229.89	229.85	252.29 246.5	3"0" DIAMETER	SEE SHEET 24
SWM 7	3" MH	SEE SHEET 11	-	-	248.8	3"0" DIAMETER	SEE SHEET 24

NOTES: 1. LOCATION OF S INLETS, WD FACILITIES AND MANHOLES IS AT CENTER OF TOP COVER.  
2. FOR "A" AND "S" COMB INLETS LOCATION IS GIVEN AT CENTER OF THROAT OPENING AT FACE OF CURB.  
3. FOR END SECTIONS AND HEADWALLS THE LOCATION IS CENTER OF THROAT OPENING AT FACE OF STRUCTURE.  
4. TOP ELEVATION IS TOP OF CURB/GRATE/RIM.  
5. DIMENSIONS ARE GIVEN AS INSIDE DIMENSIONS.

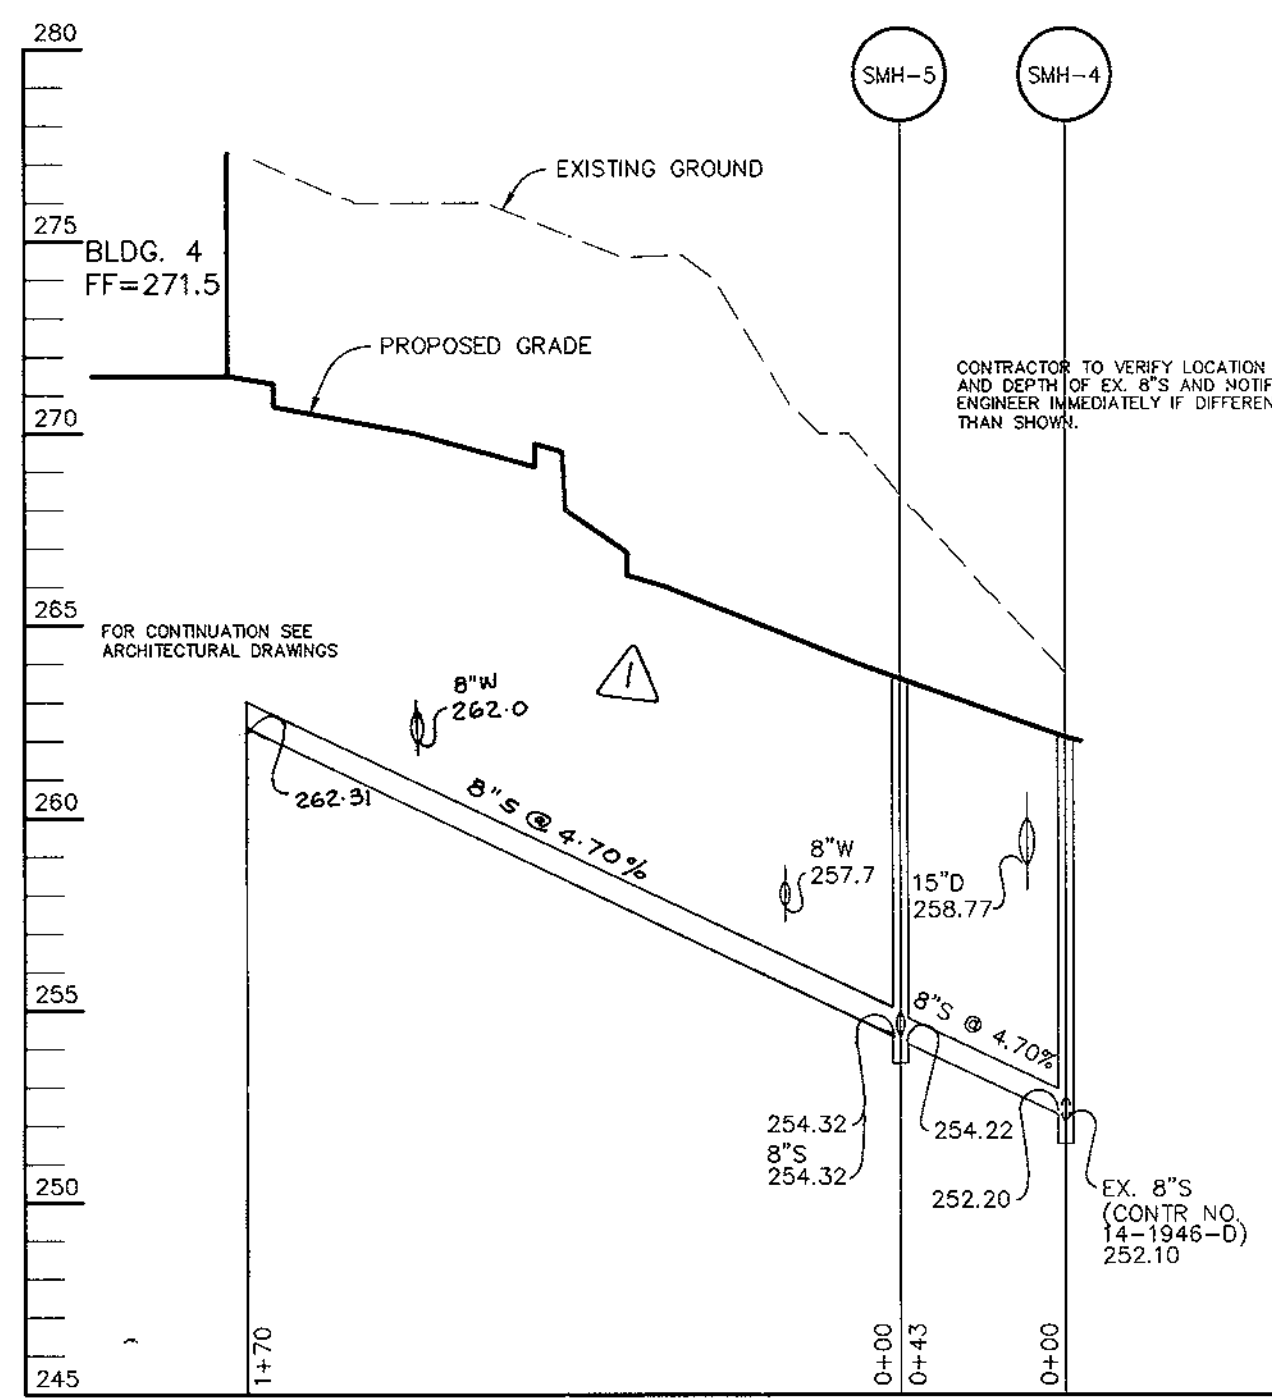


**SEWER PROFILE**

SCALE: HOR. - 1"=50' VERT. - 1"=5'

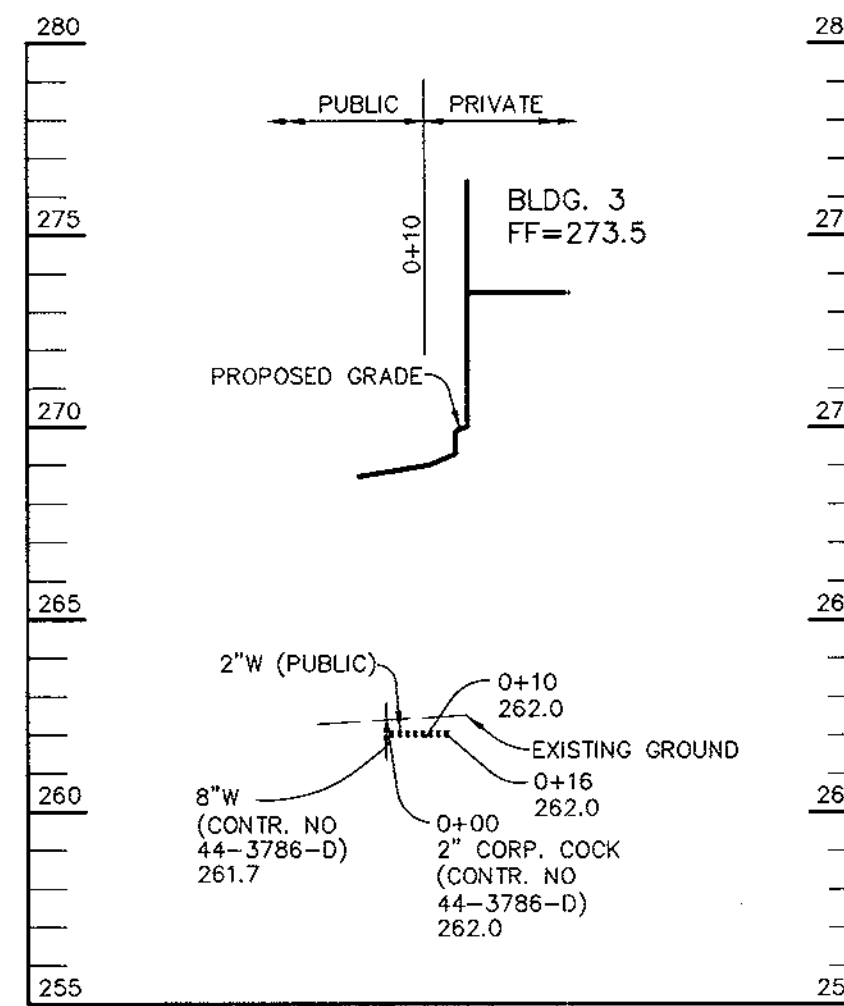


**WATER PROFILE**

SCALE: HOR. - 1"=50' VERT. - 1"=5'

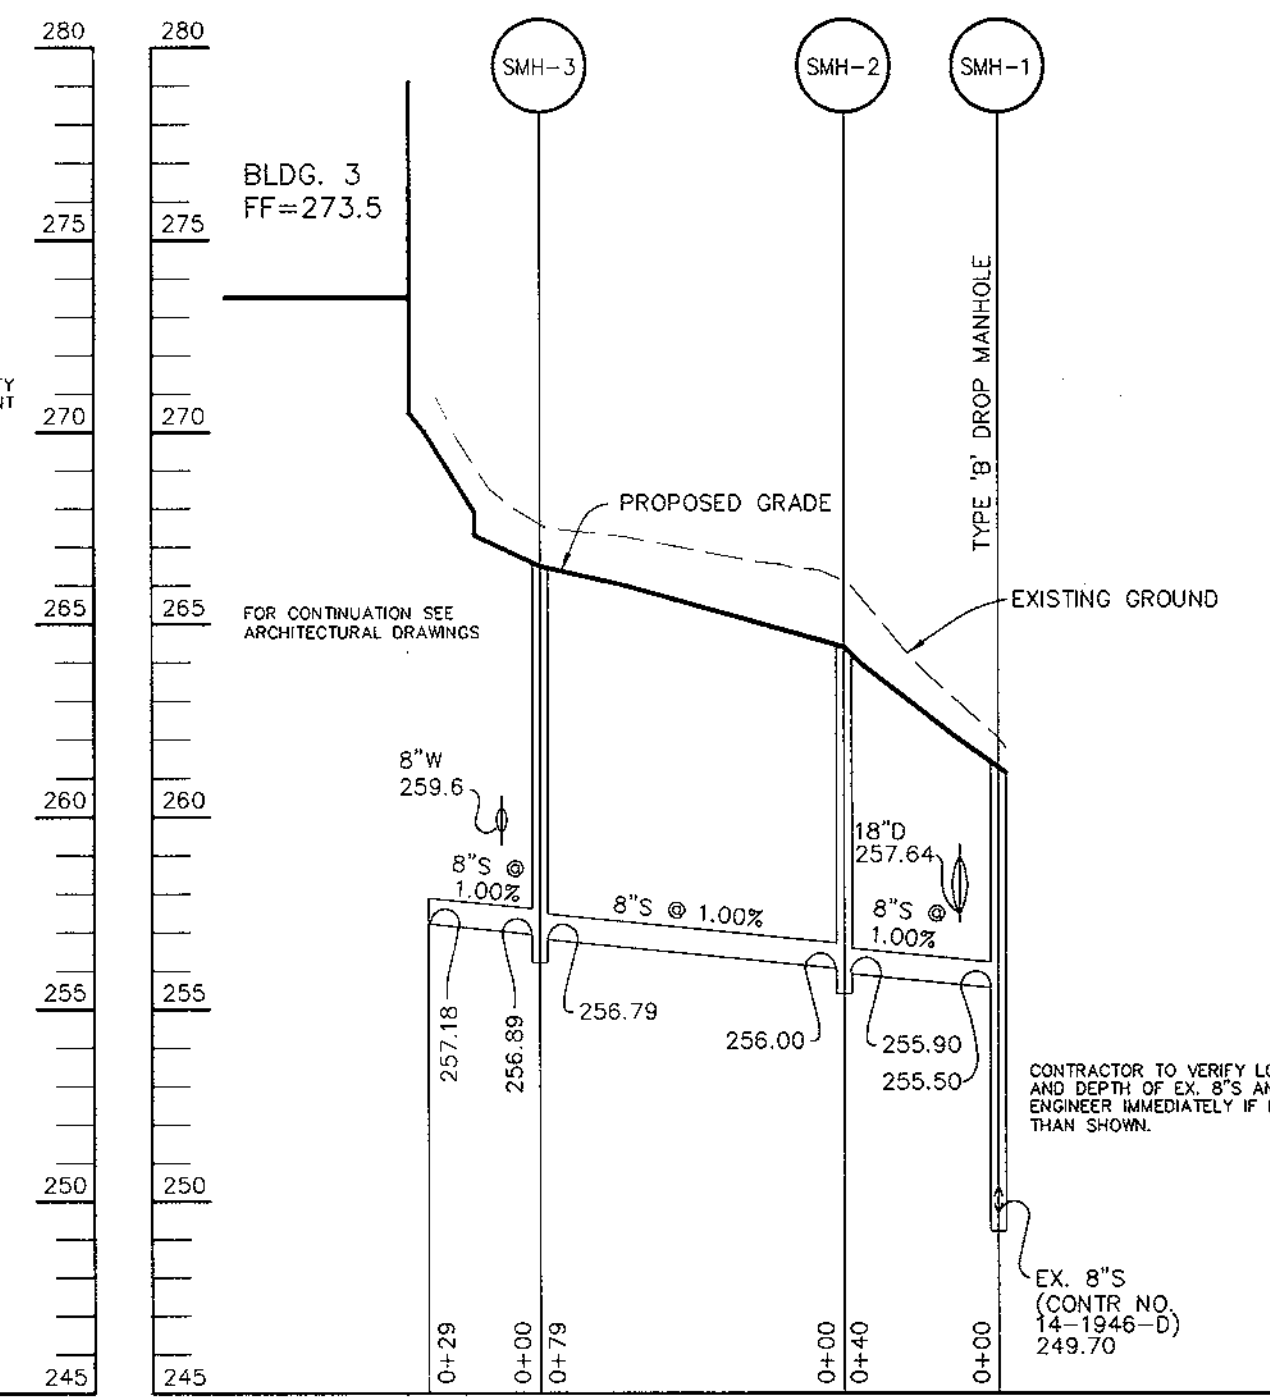


**SEWER PROFILE**

SCALE: HOR. - 1"=50' VERT. - 1"=5'

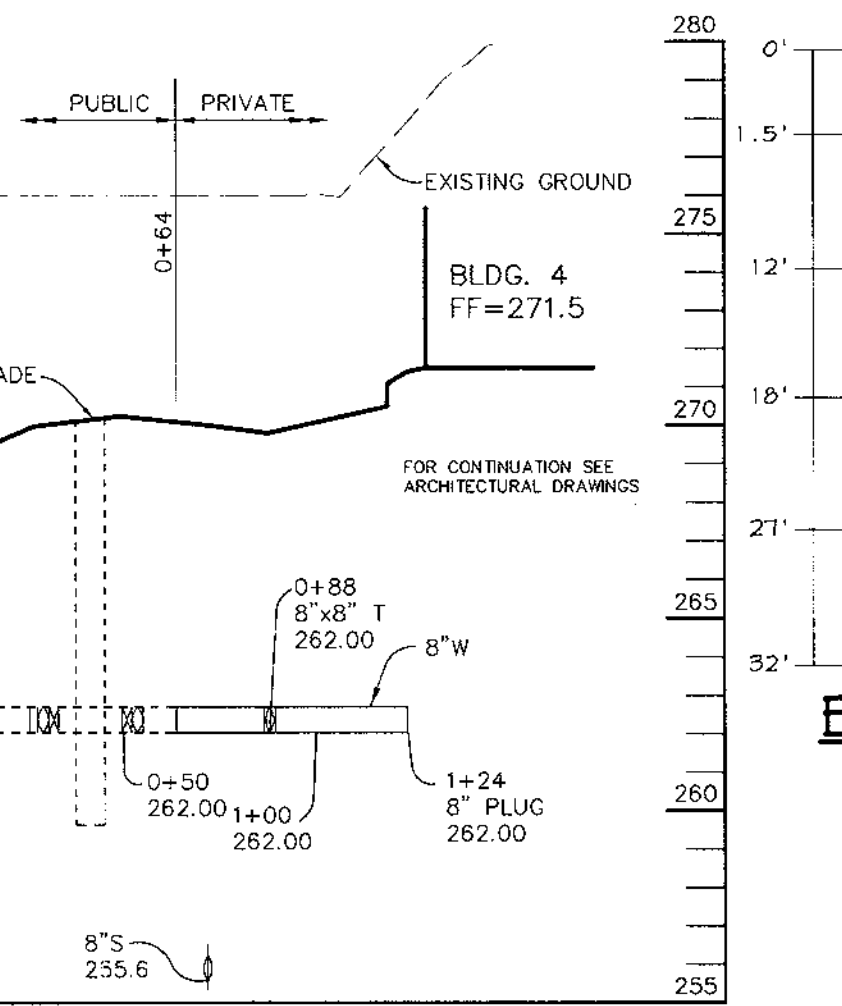


**WATER PROFILE**

SCALE: HOR. - 1"=50' VERT. - 1"=5'

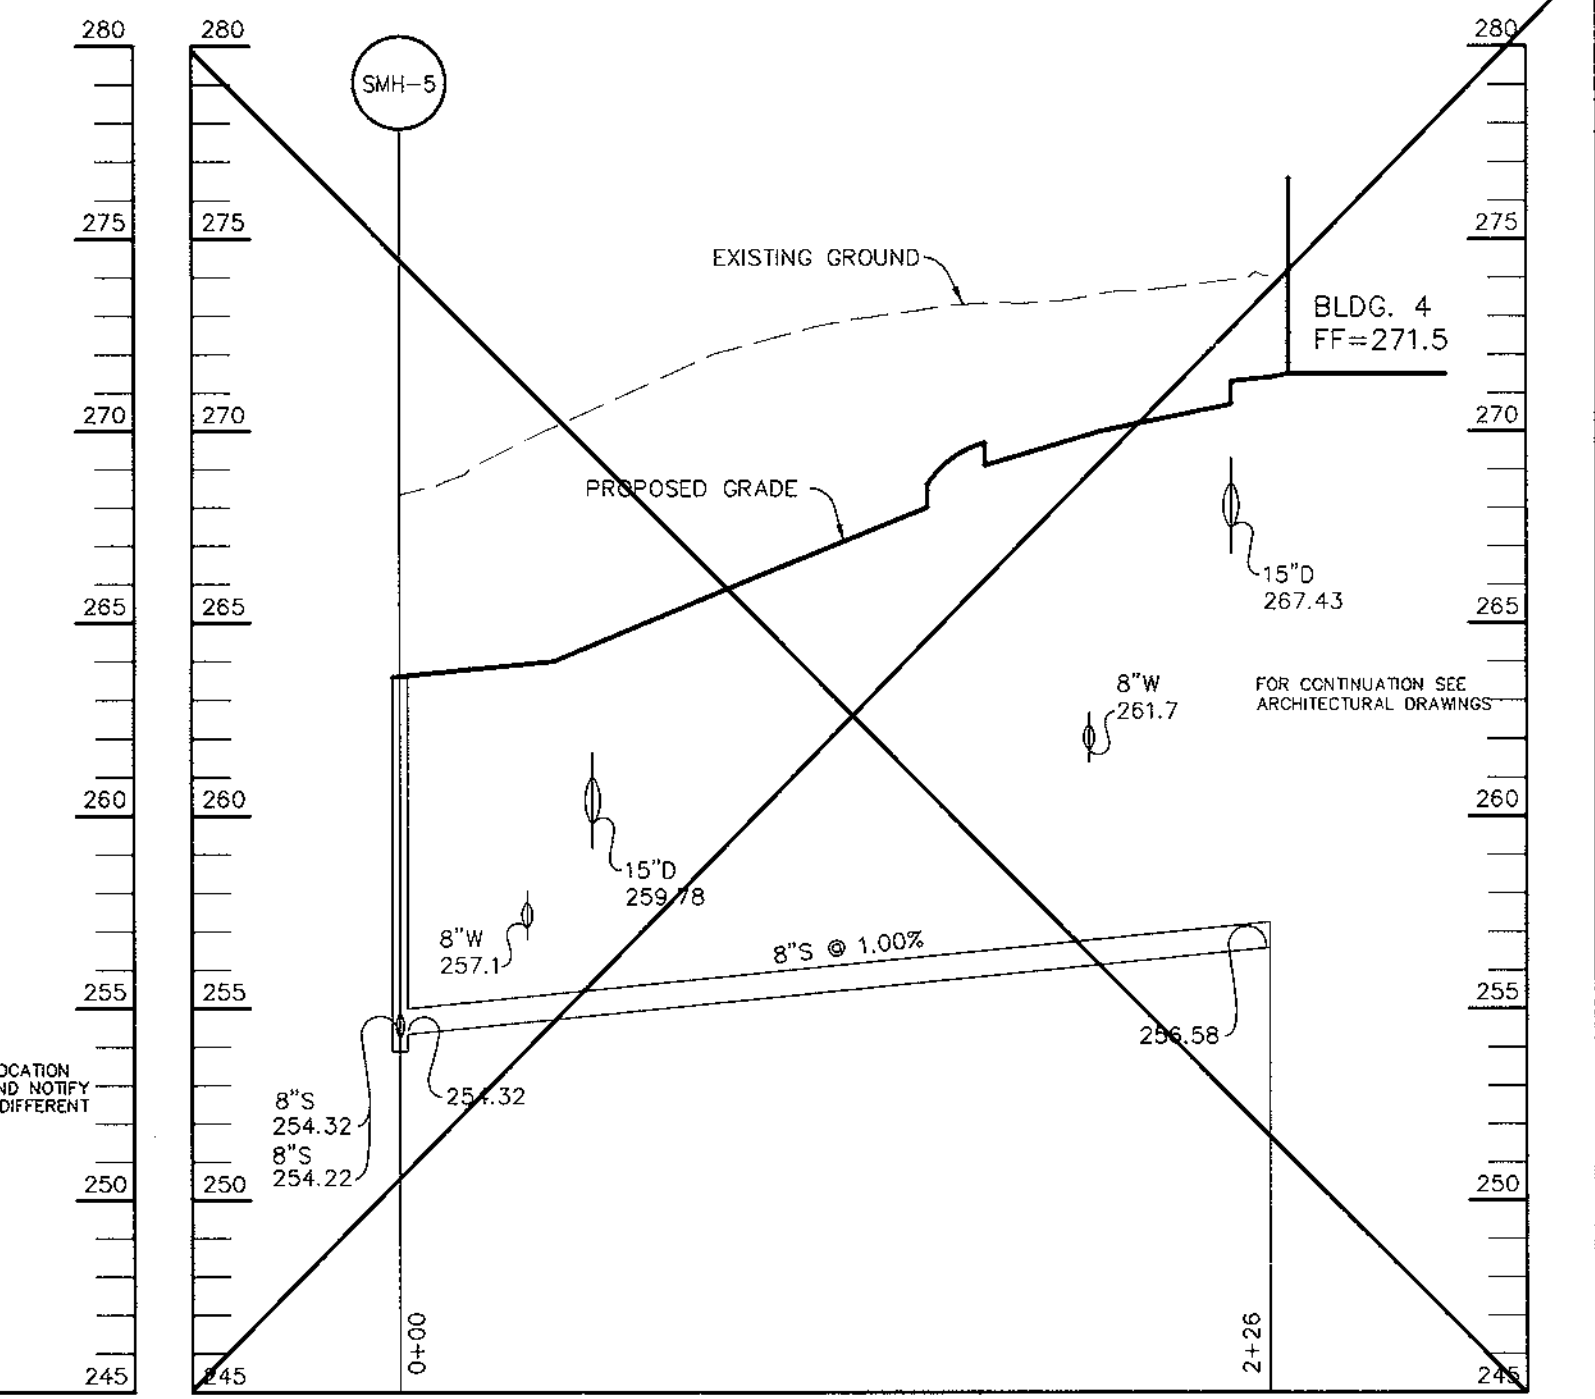

**SEWER PROFILE**


SCALE: HOR. - 1"=50' VERT. - 1"=5'

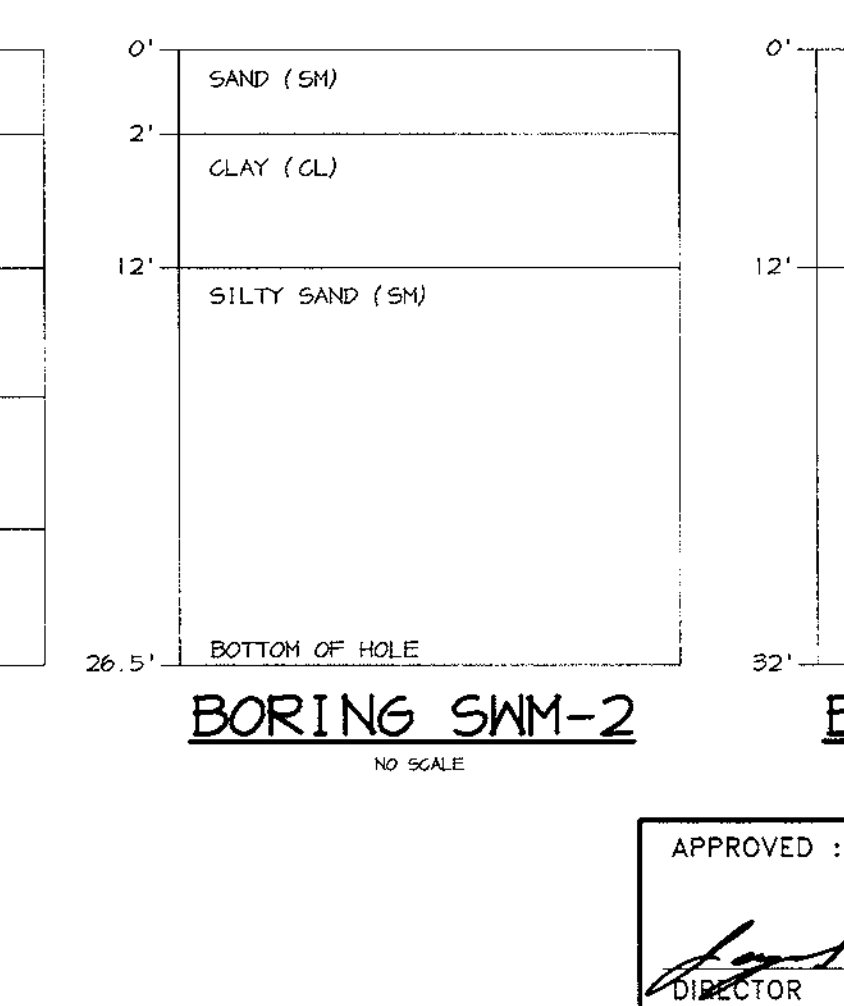

**BORING SWM-1**

**BORING SWM-2**

**BORING SWM-3**

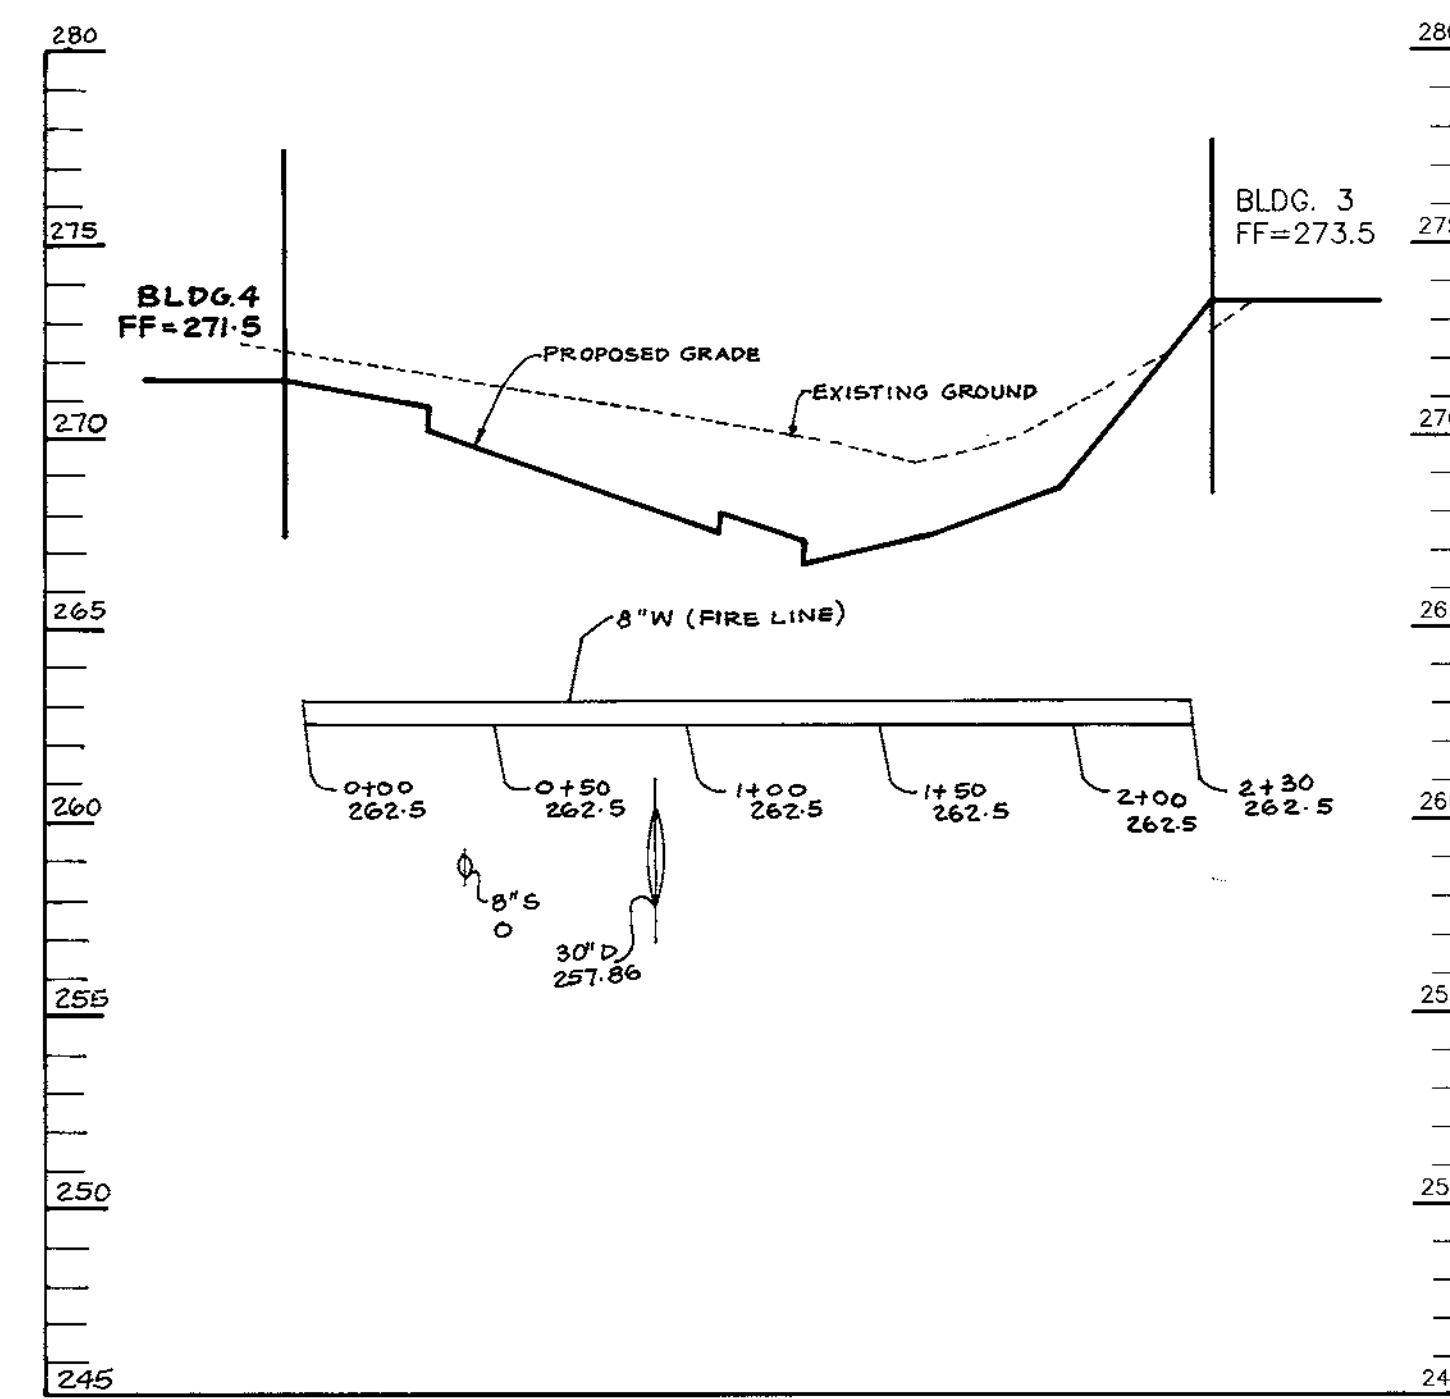

**WATER PROFILE (FIRE LINE)**

SCALE: HOR. - 1"=50' VERT. - 1"=5'

APPROVED: HOWARD COUNTY DEPARTMENT OF PLANNING AND ZONING.  
DIRECTOR: [Signature] DATE: 10/19/99  
CHIEF, DEVELOPMENT ENGINEERING DIVISION: [Signature] DATE: 10/17/99  
CHIEF, DIVISION OF LAND DEVELOPMENT: [Signature] DATE: 10/19/99

11-08-99 MODIFIED SEWER AND WATER PROFILES  
DATE NO. REVISION

OWNER/DEVELOPER  
PROLOGIS DEVELOPMENT SERVICES INCORPORATED  
5200 EISENHOWER AVENUE, SECOND FLOOR  
ALEXANDRIA, VIRGINIA 22304  
(703)751-9292

PROJECT: MEADOWRIDGE BUSINESS PARK  
PARCEL G-2  
2 WAREHOUSE BUILDINGS


AREA: TAX MAP NO. 37 ZONED M-1 PARCEL G-2  
1st ELECTION DISTRICT  
HOWARD COUNTY, MARYLAND

TITLE: PROFILES AND STRUCTURE SCHEDULE

RIEMER MUEGGE & ASSOCIATES INC.  
ENGINEERING • ENVIRONMENTAL SERVICES • PLANNING • SURVEYING  
8818 Centre Park Drive, Columbia, MD 21045  
tel 410.997.8800 fax 410.997.9292


DESIGNED BY: CJR  
DRAWN BY: DAM  
PROJECT NO.: 97320/PARCEL\_G SDP6.DWG  
DATE: OCTOBER 11, 1999  
SCALE: AS SHOWN  
DRAWING NO.: 6 OF 25

STATE OF MARYLAND  
COUNTY OF HOWARD  
PROFESSIONAL ENGINEER  
CHRISTOPHER J. REID #19949  
2-13-01  
DATE

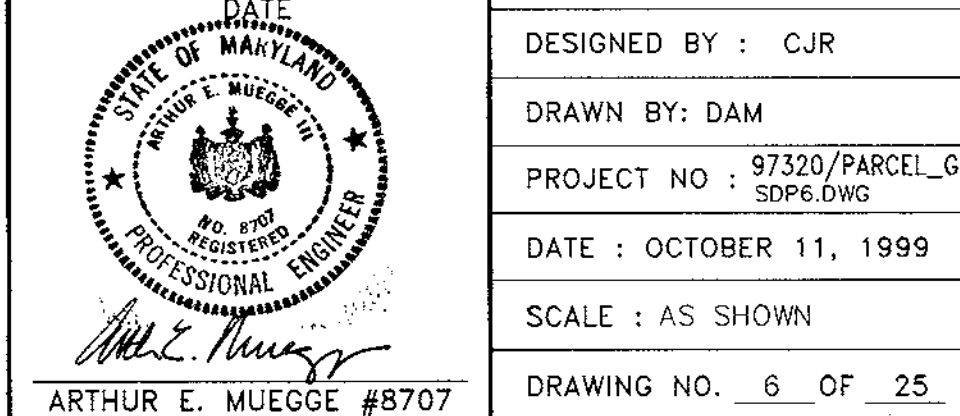






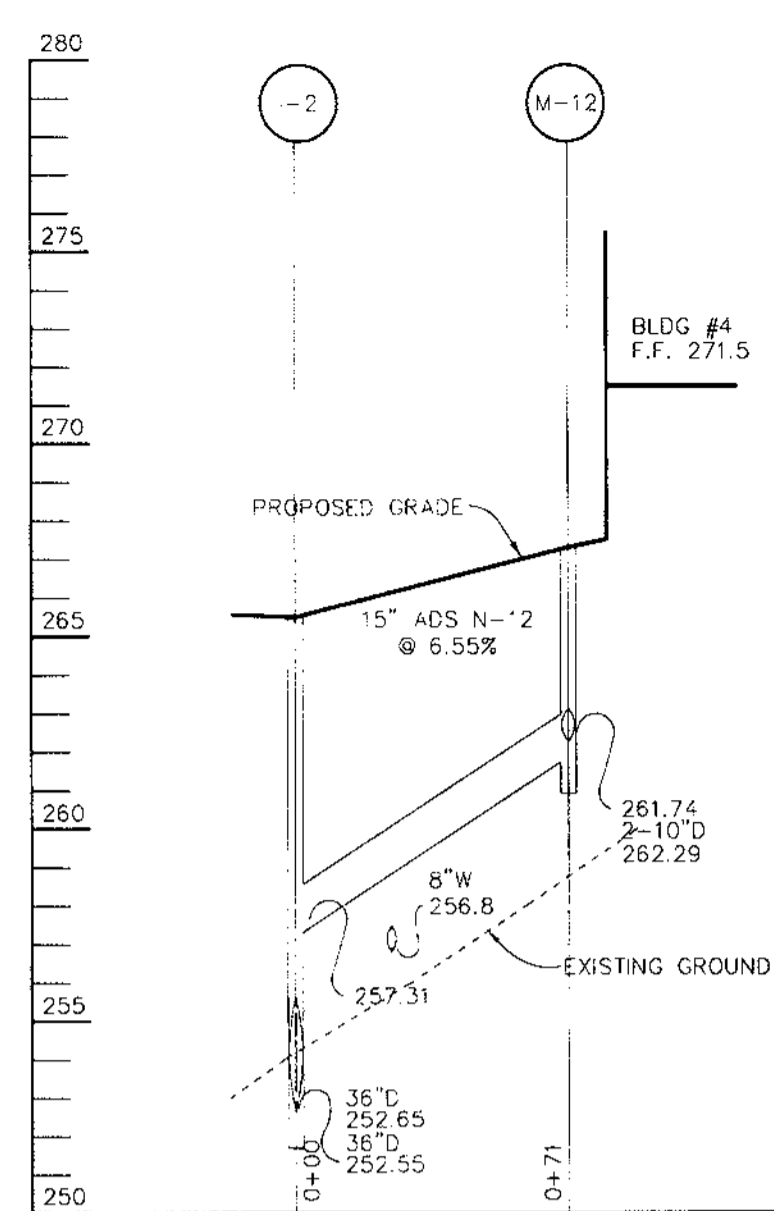


ROOF DRAIN PROFILE

SCALE :  
HOR.-1"=50'  
VERT.-1"=5'

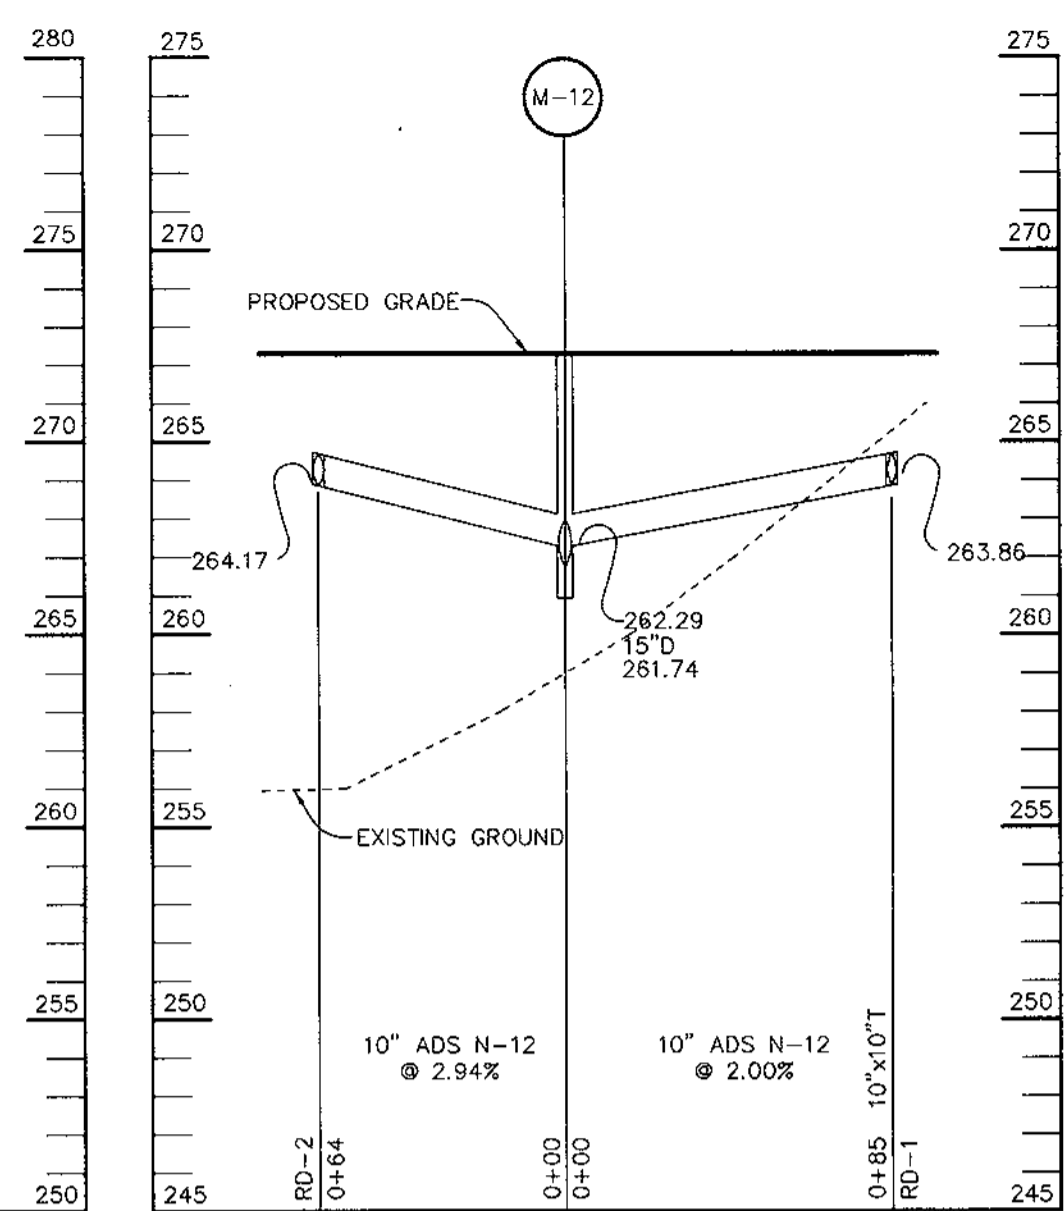


ROOF DRAIN PROFILE

SCALE :  
HOR.-1"=50'  
VERT.-1"=5'

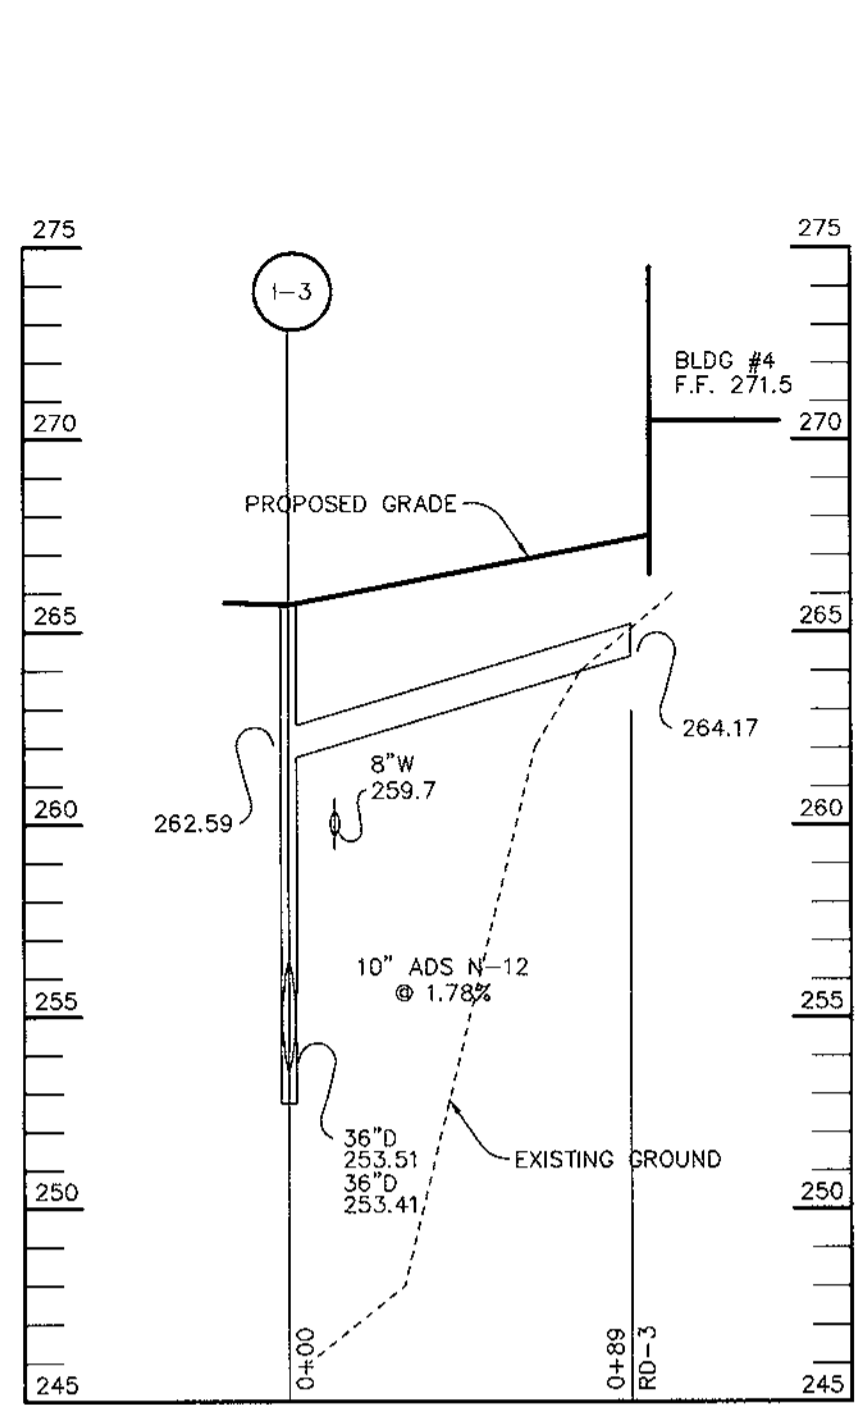


ROOF DRAIN PROFILE

SCALE :  
HOR.-1"=50'  
VERT.-1"=5'

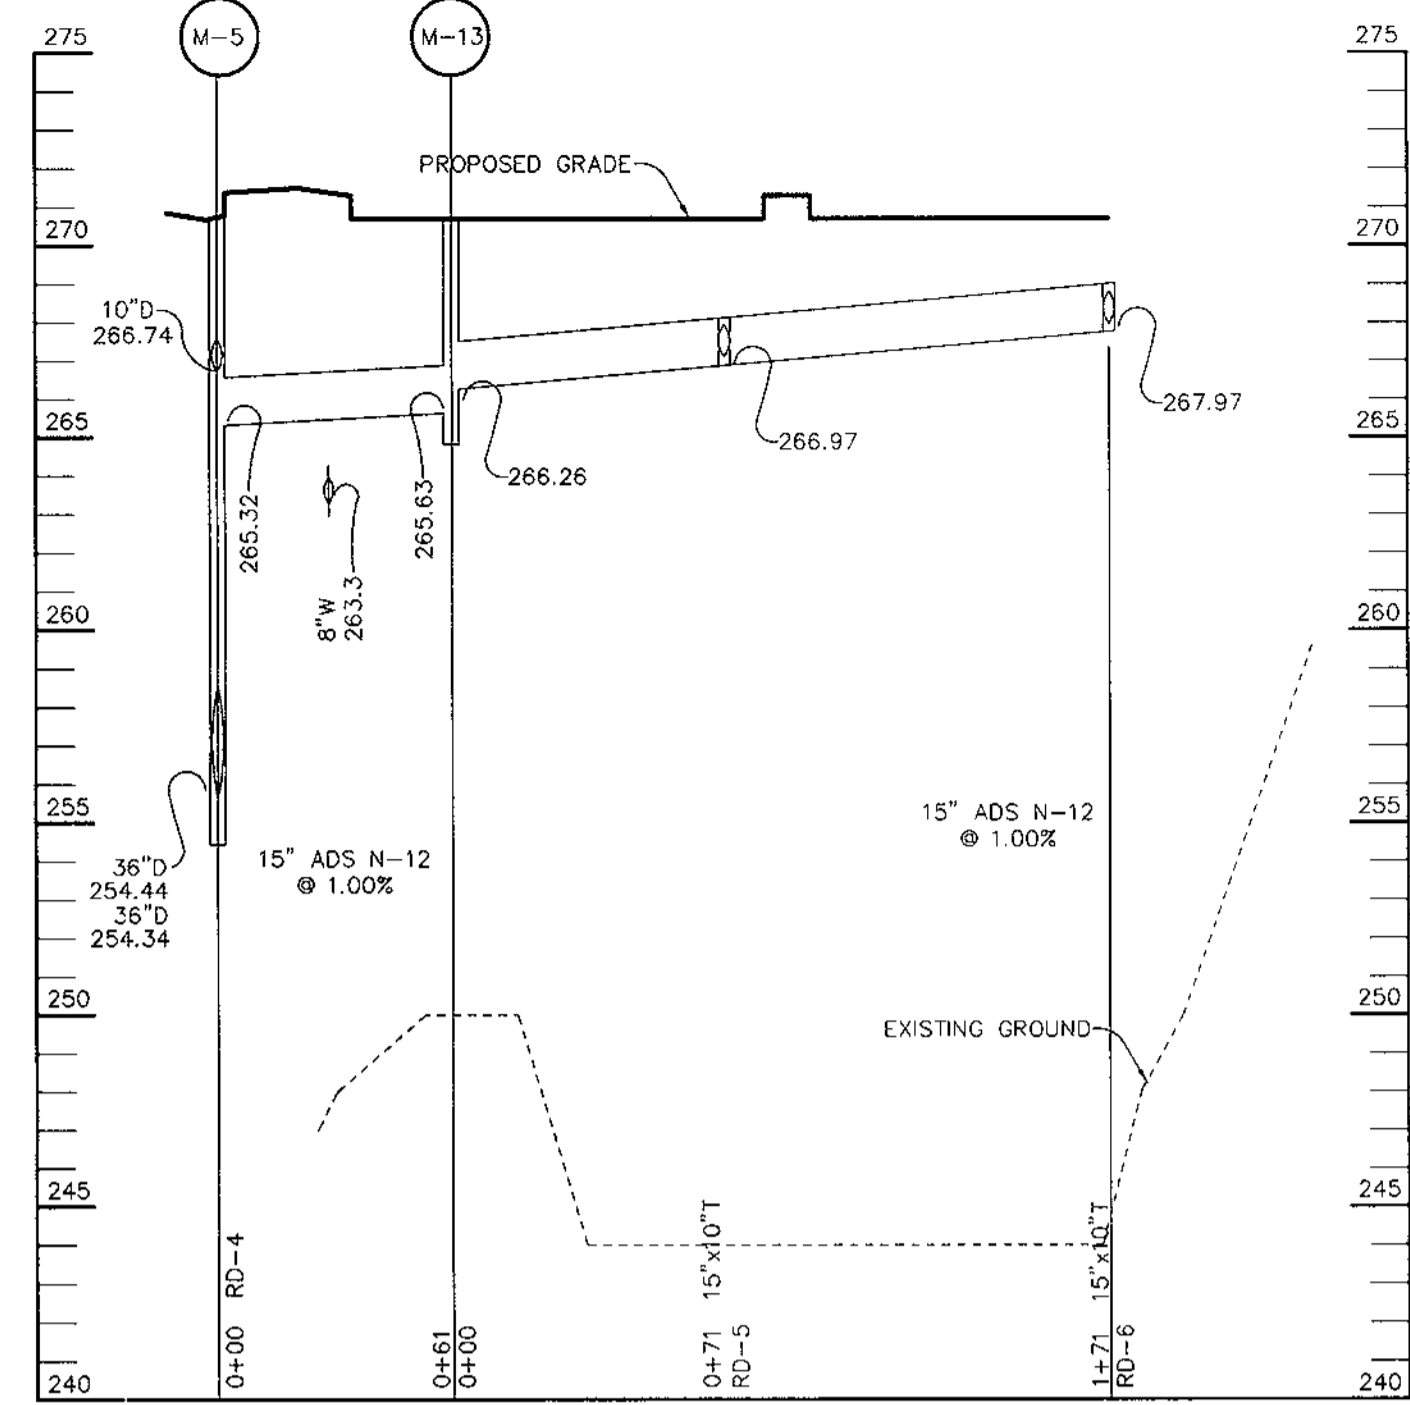


ROOF DRAIN PROFILE

SCALE :  
HOR.-1"=50'  
VERT.-1"=5'

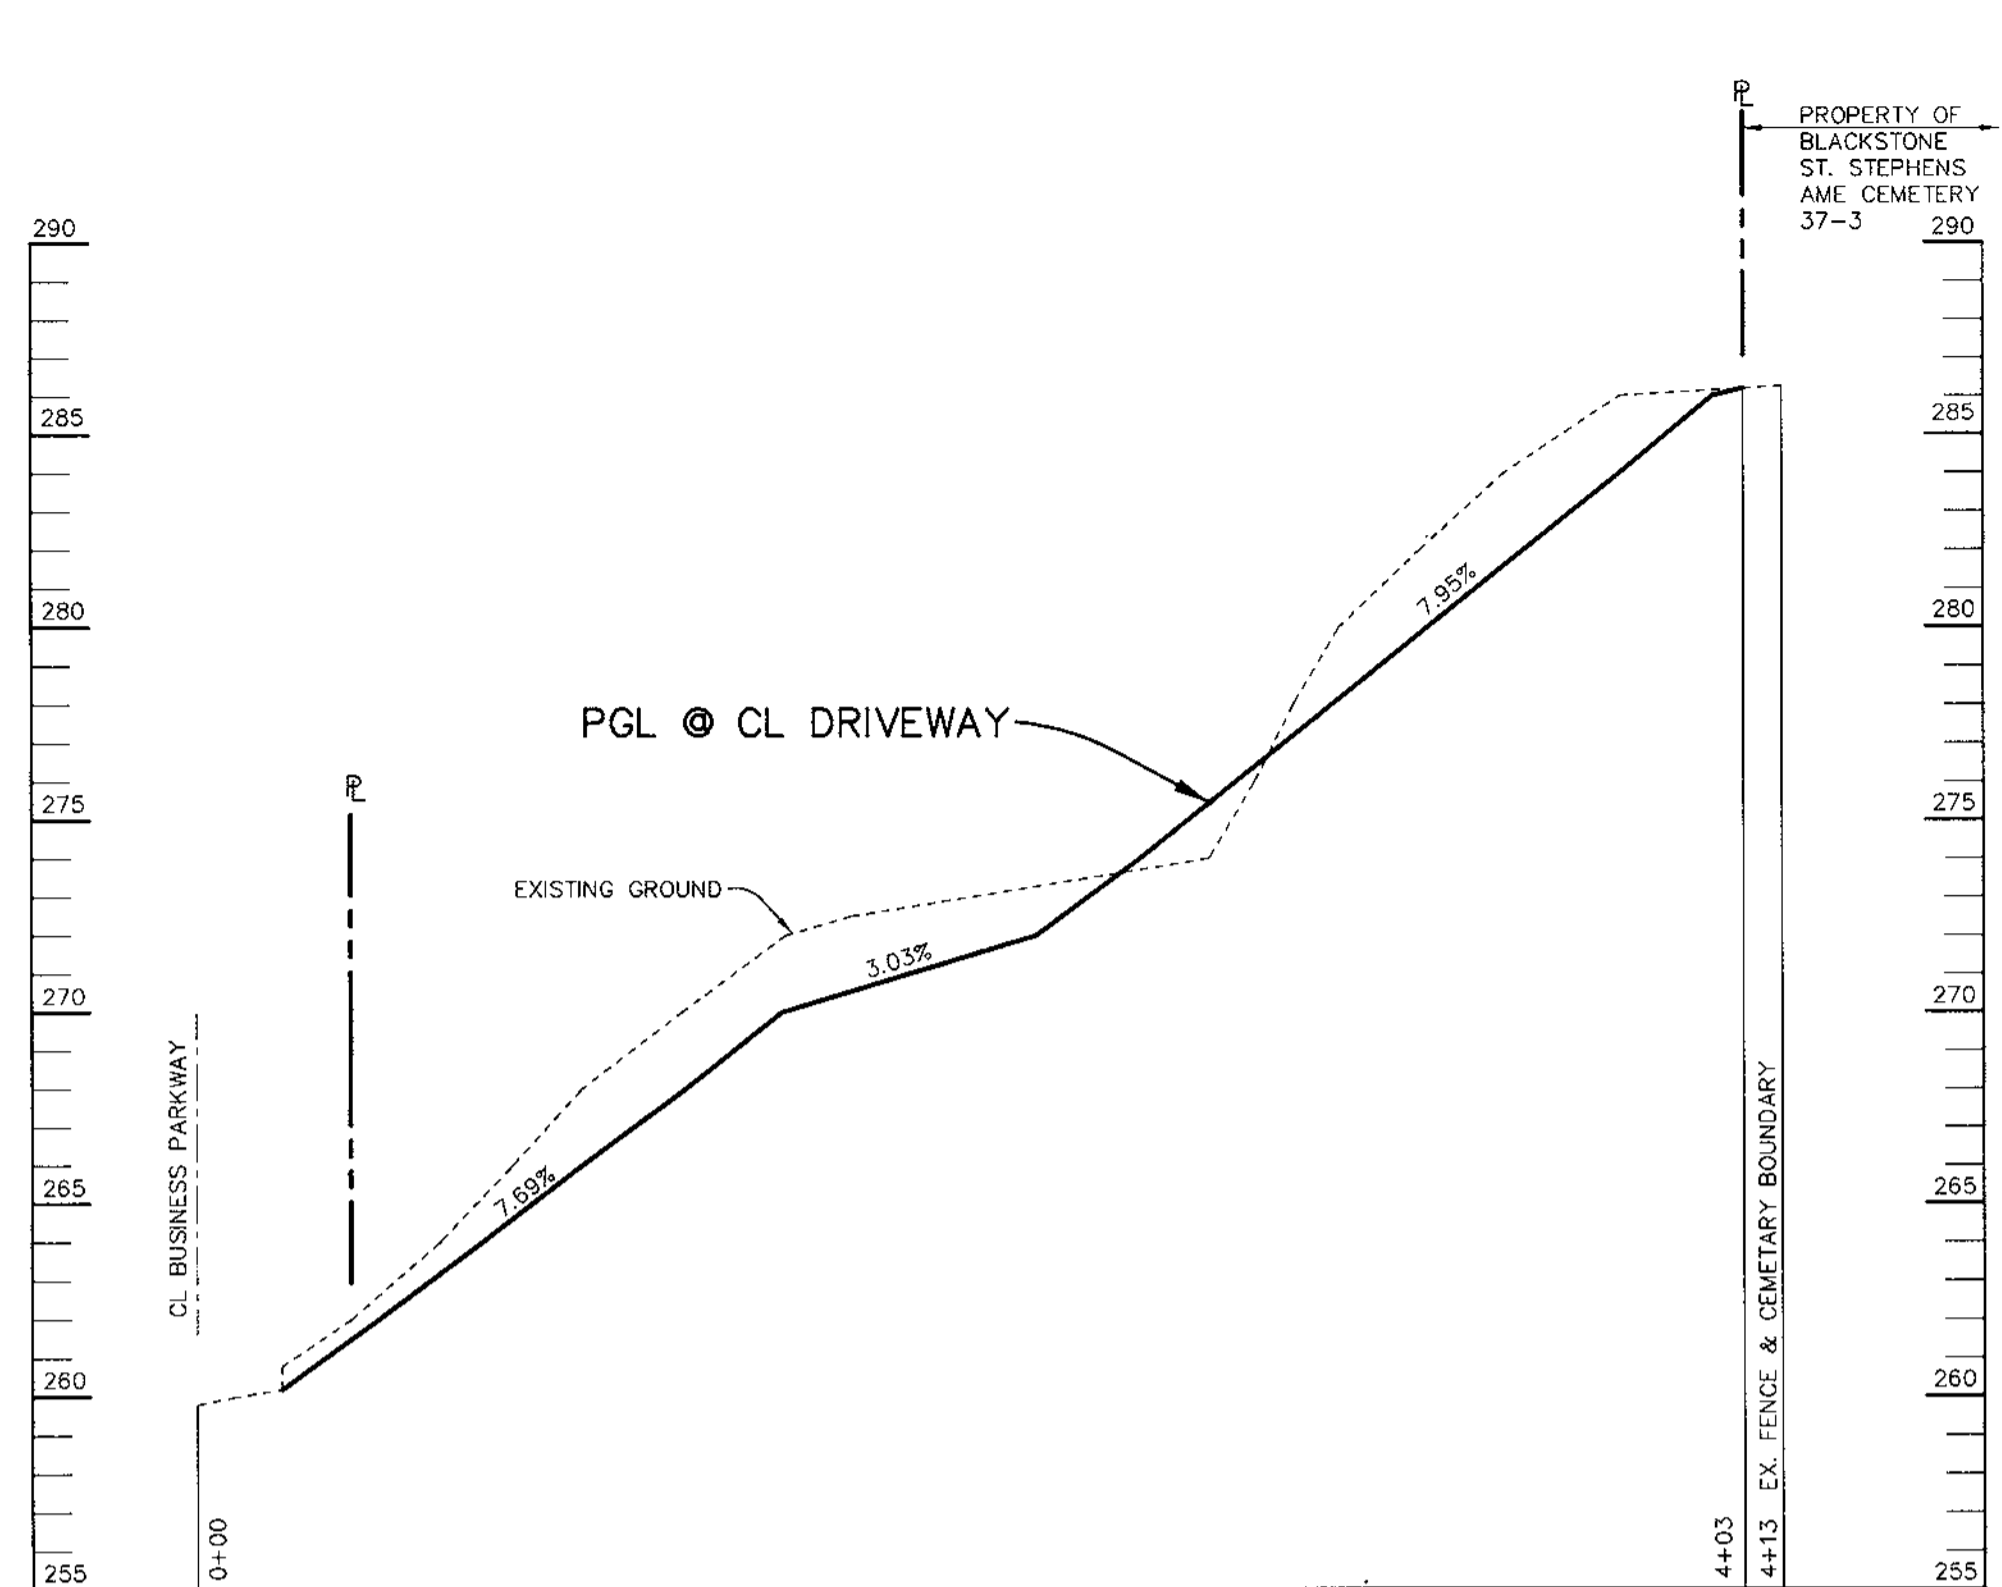


CEMETERY DRIVEWAY PROFILE

SCALE :  
HOR.-1"=50'  
VERT.-1"=5'

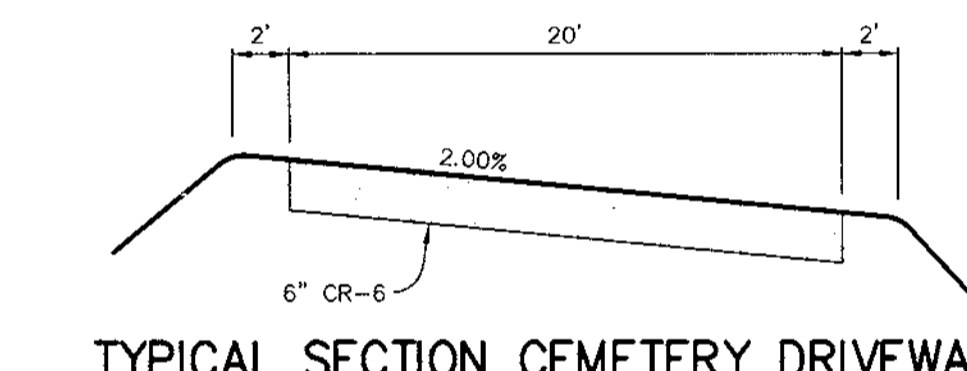


TYPICAL SECTION CEMETERY DRIVEWAY

NO SCALE

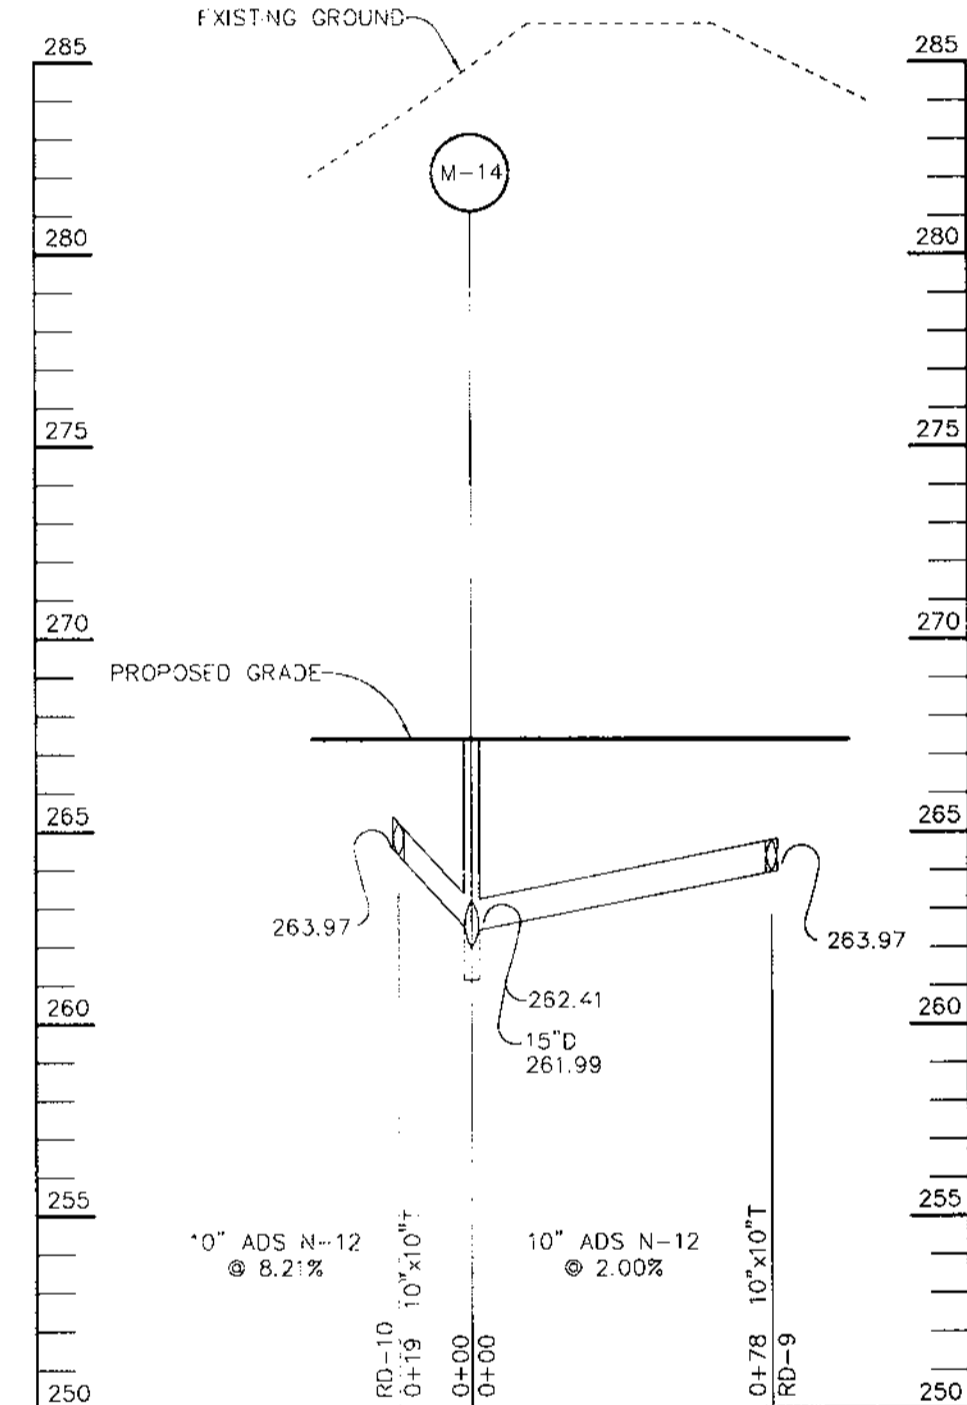


ROOF DRAIN PROFILE

SCALE :  
HOR.-1"=50'  
VERT.-1"=5'

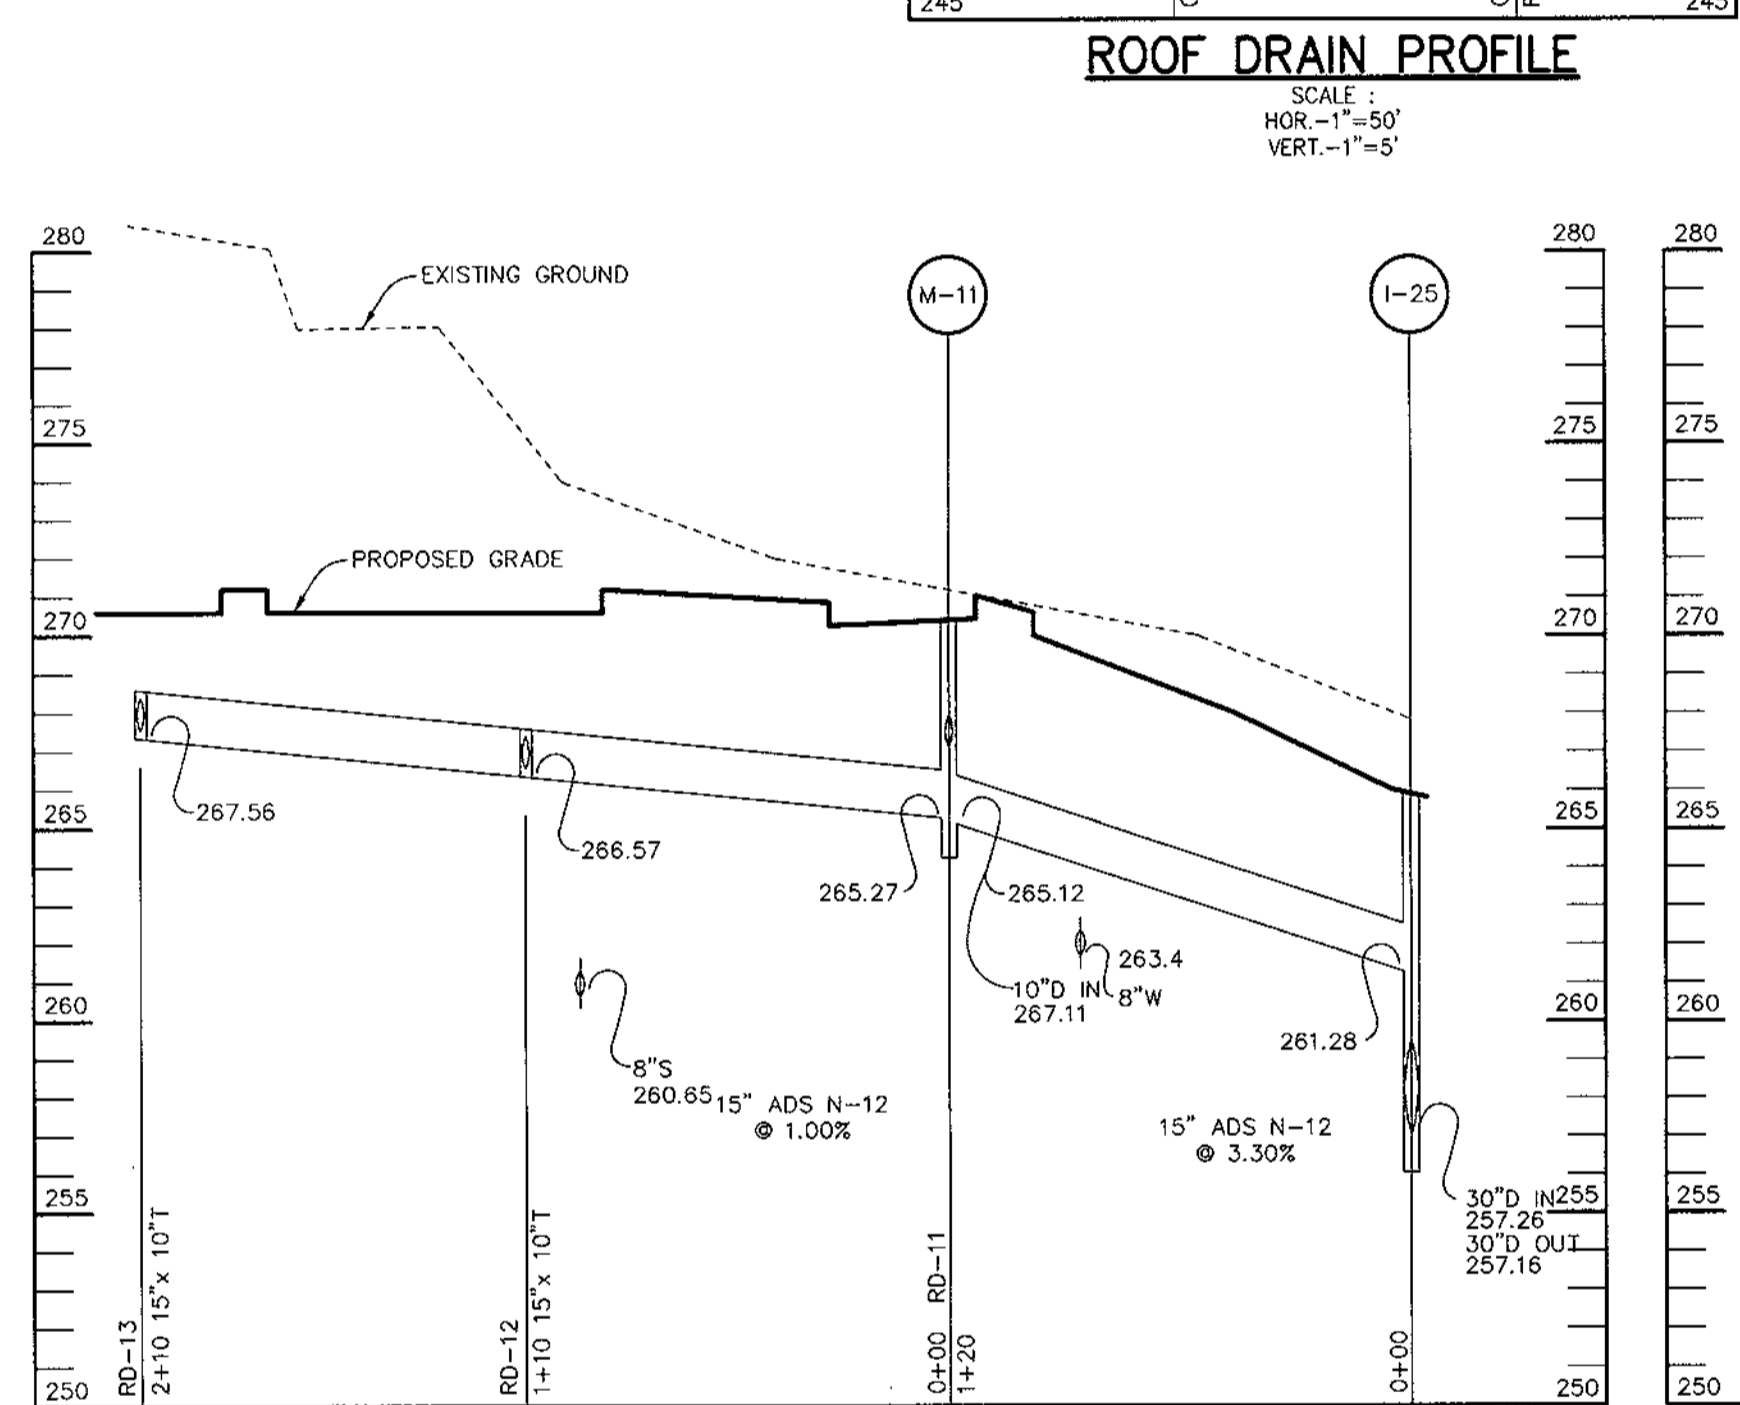


ROOF DRAIN PROFILE

SCALE :  
HOR.-1"=50'  
VERT.-1"=5'

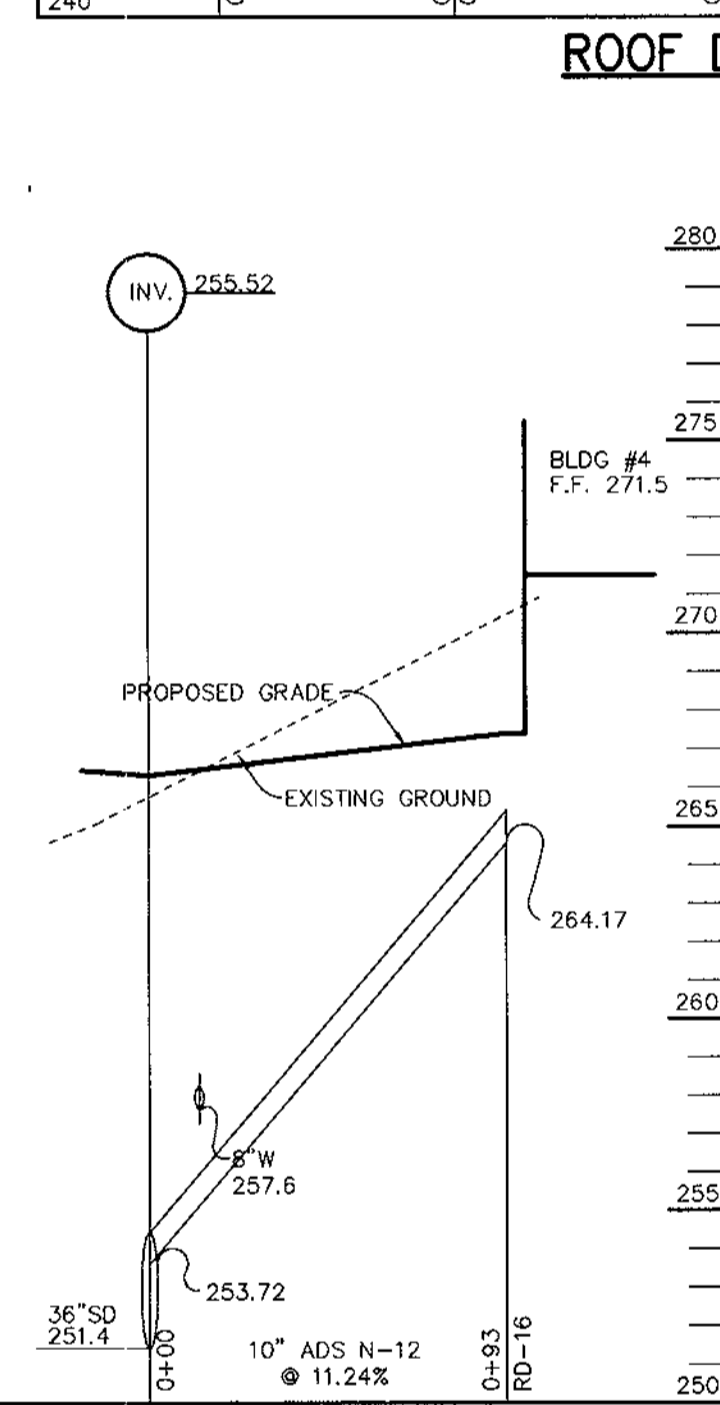


ROOF DRAIN PROFILE

SCALE :  
HOR.-1"=50'  
VERT.-1"=5'

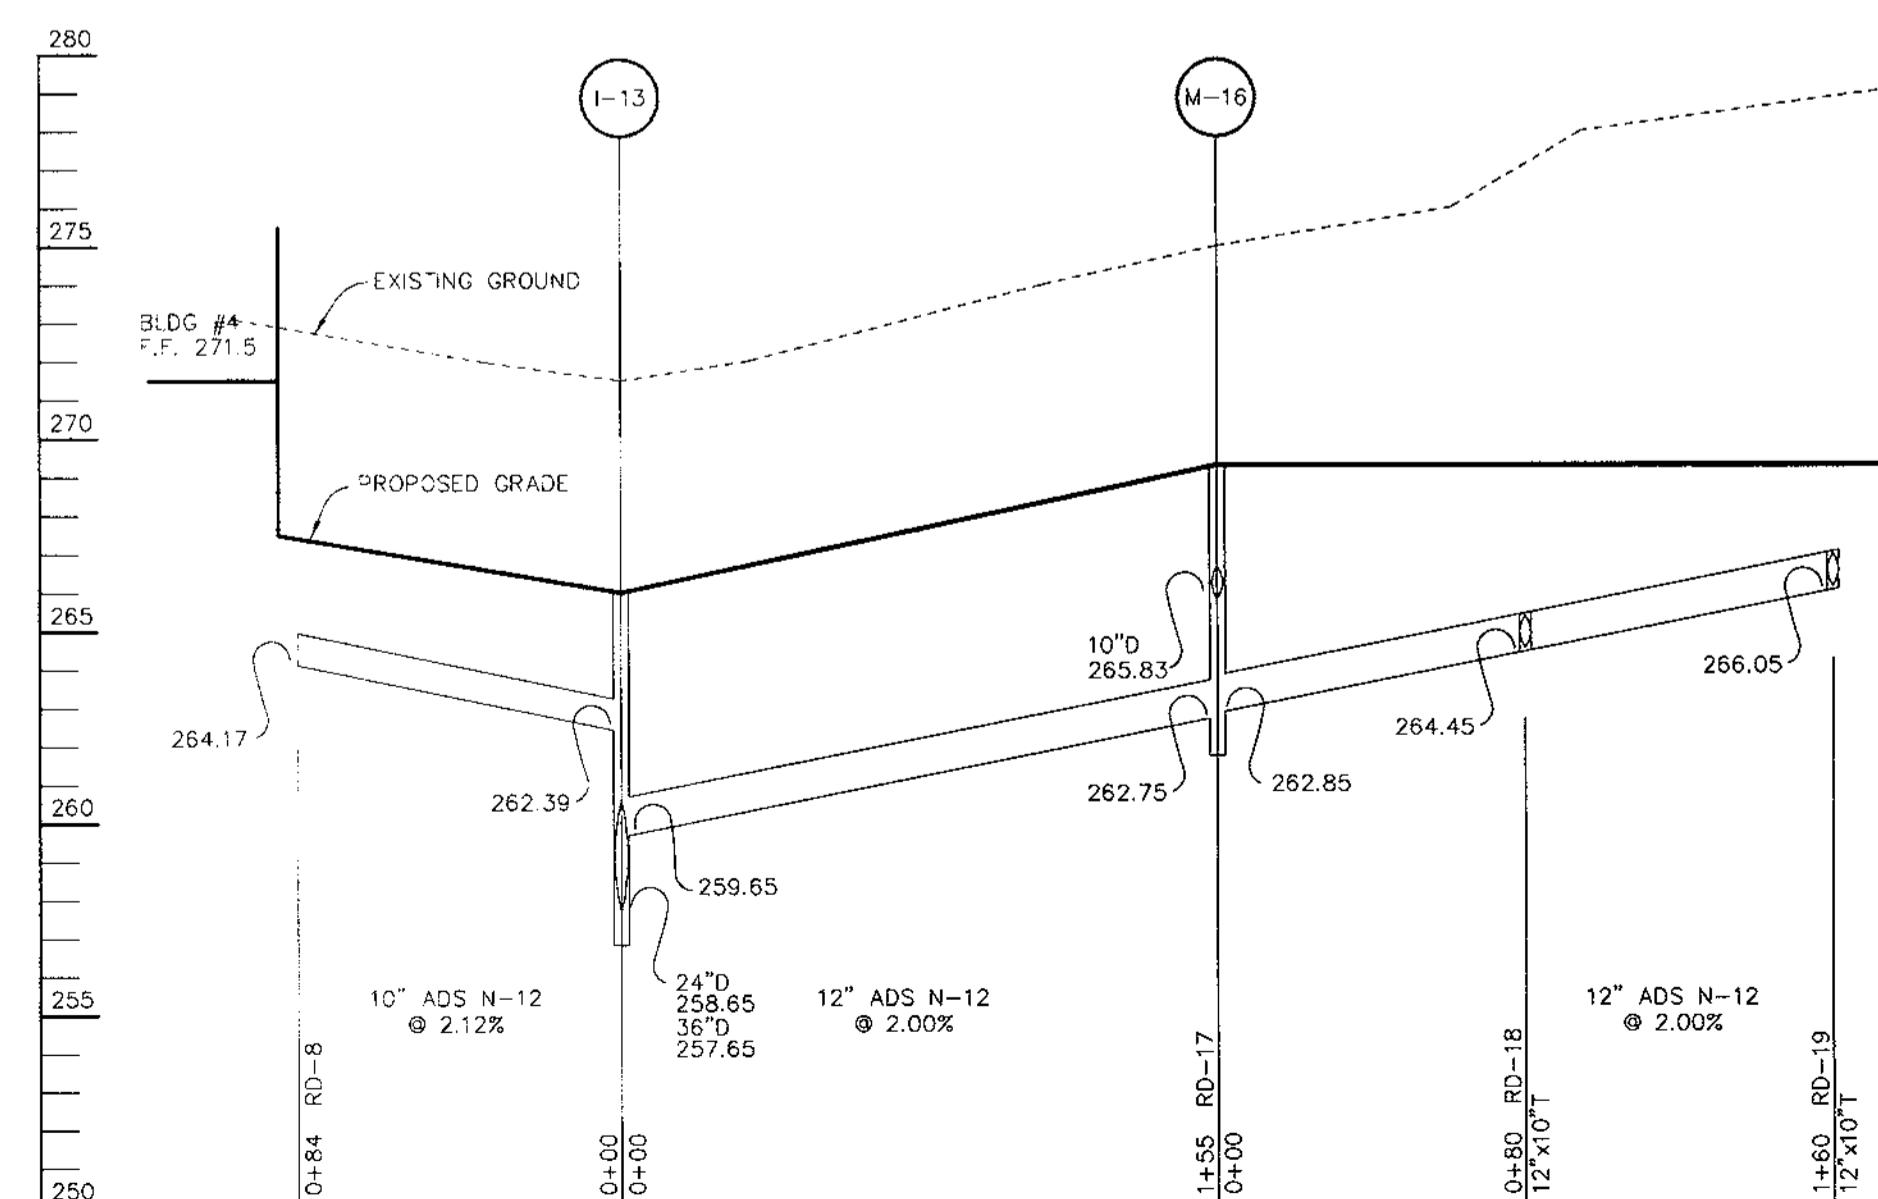


ROOF DRAIN PROFILE

SCALE :  
HOR.-1"=50'  
VERT.-1"=5'

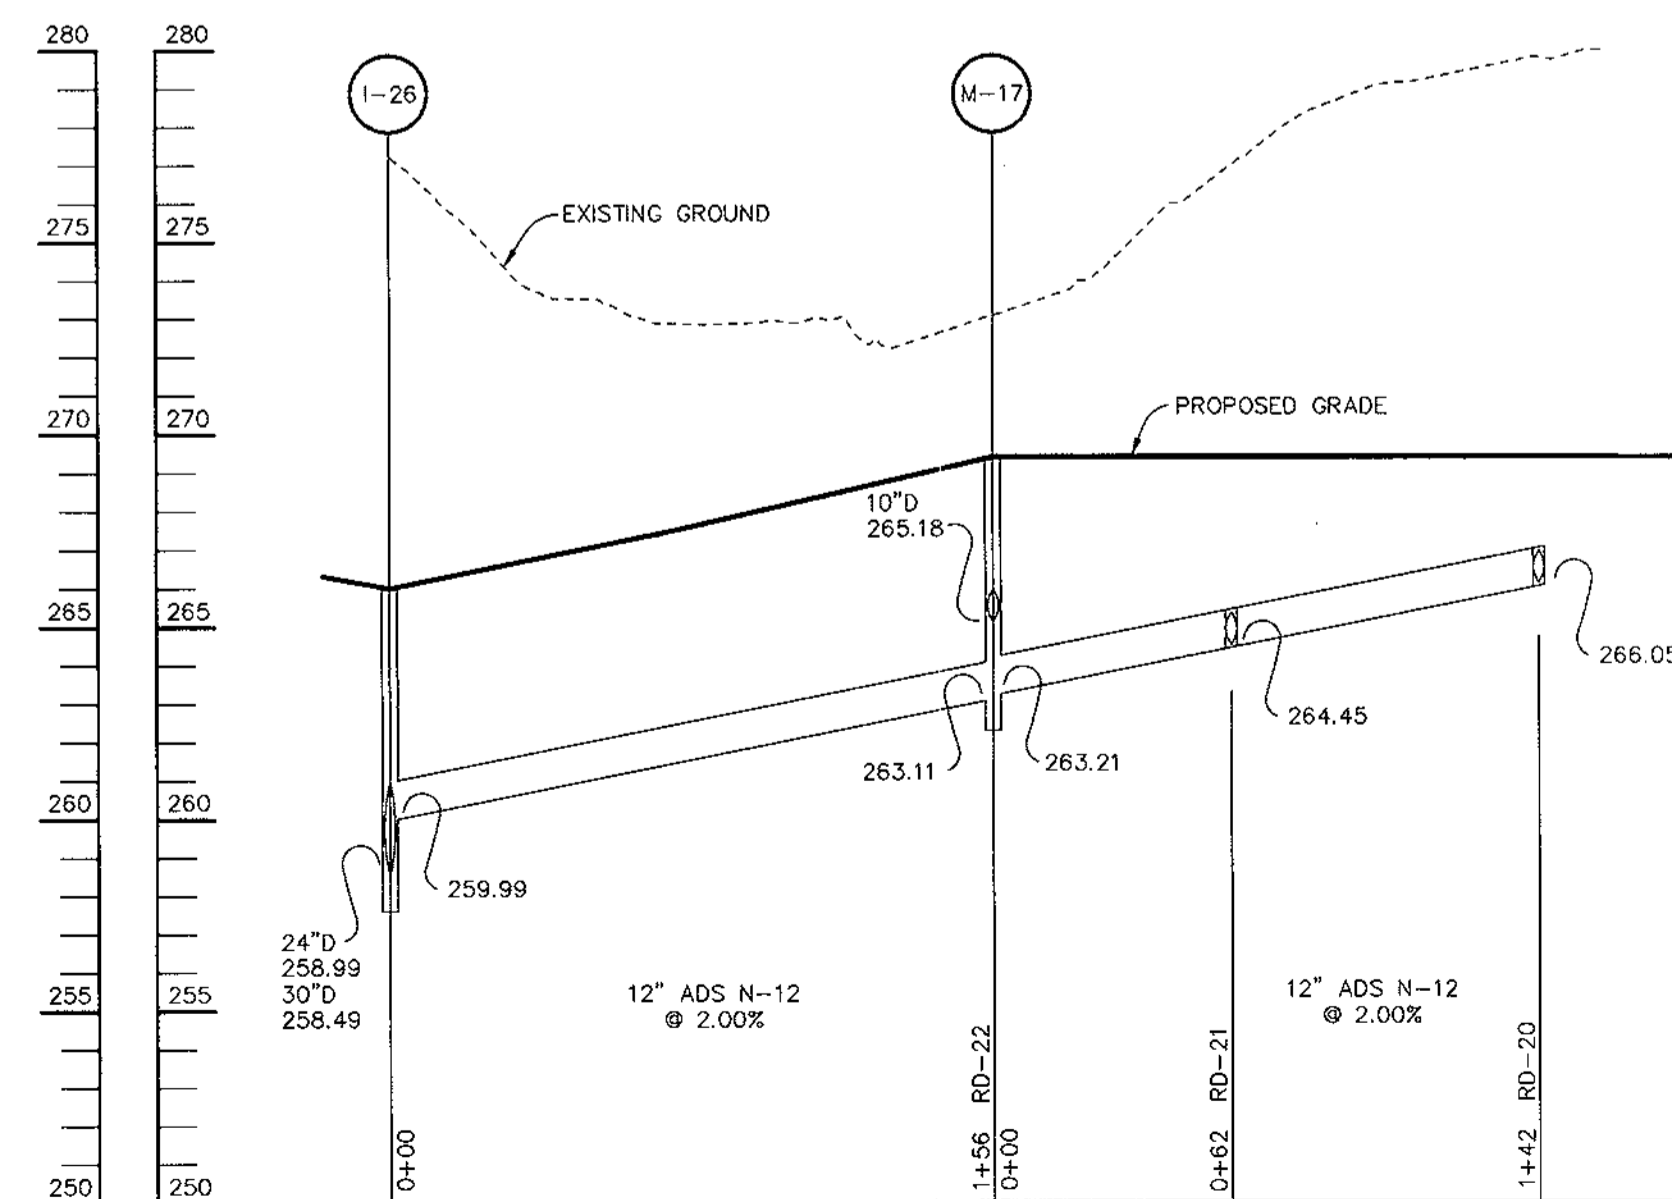


ROOF DRAIN PROFILE

SCALE :  
HOR.-1"=50'  
VERT.-1"=5'

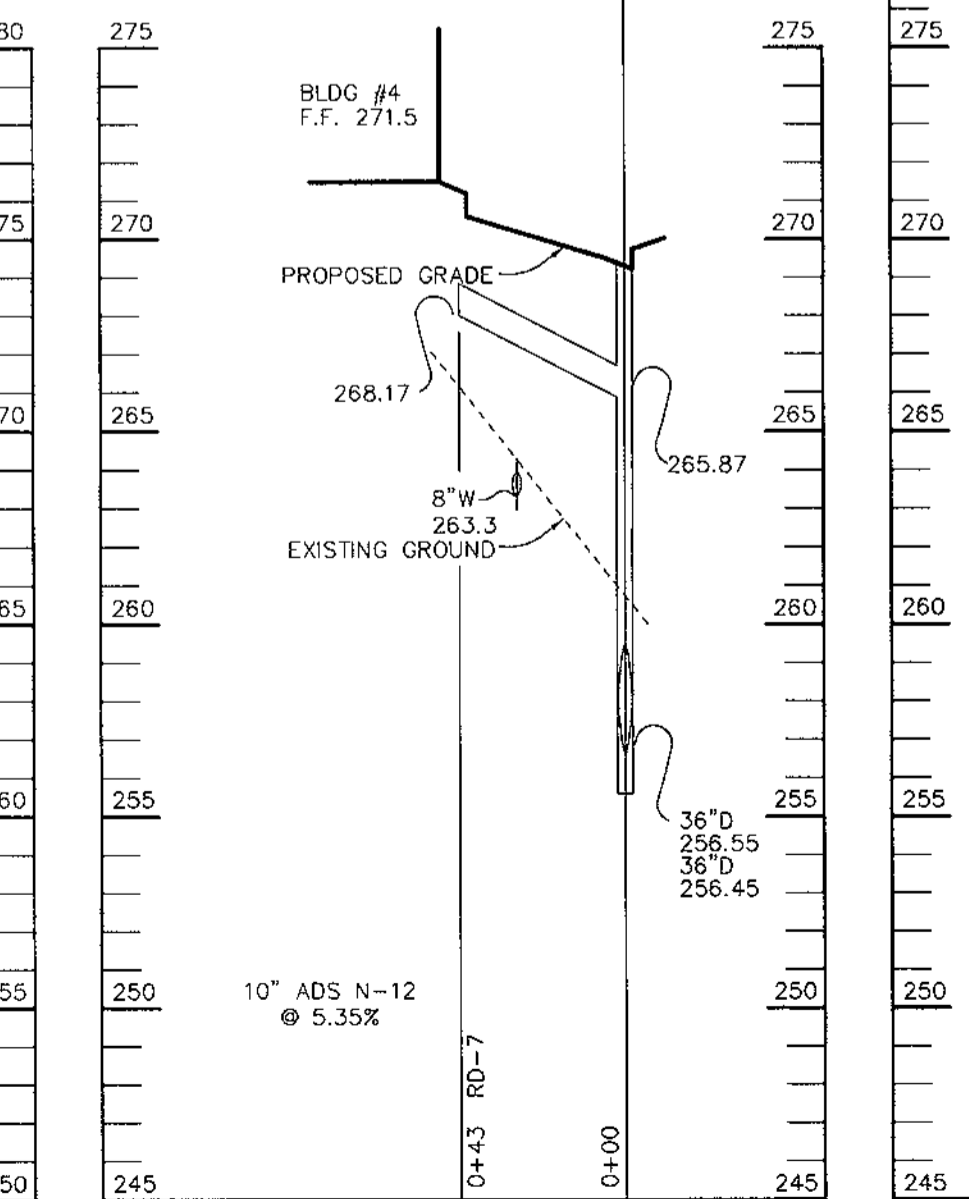

ROOF DRAIN PROFILE

SCALE :  
HOR.-1"=50'  
VERT.-1"=5'

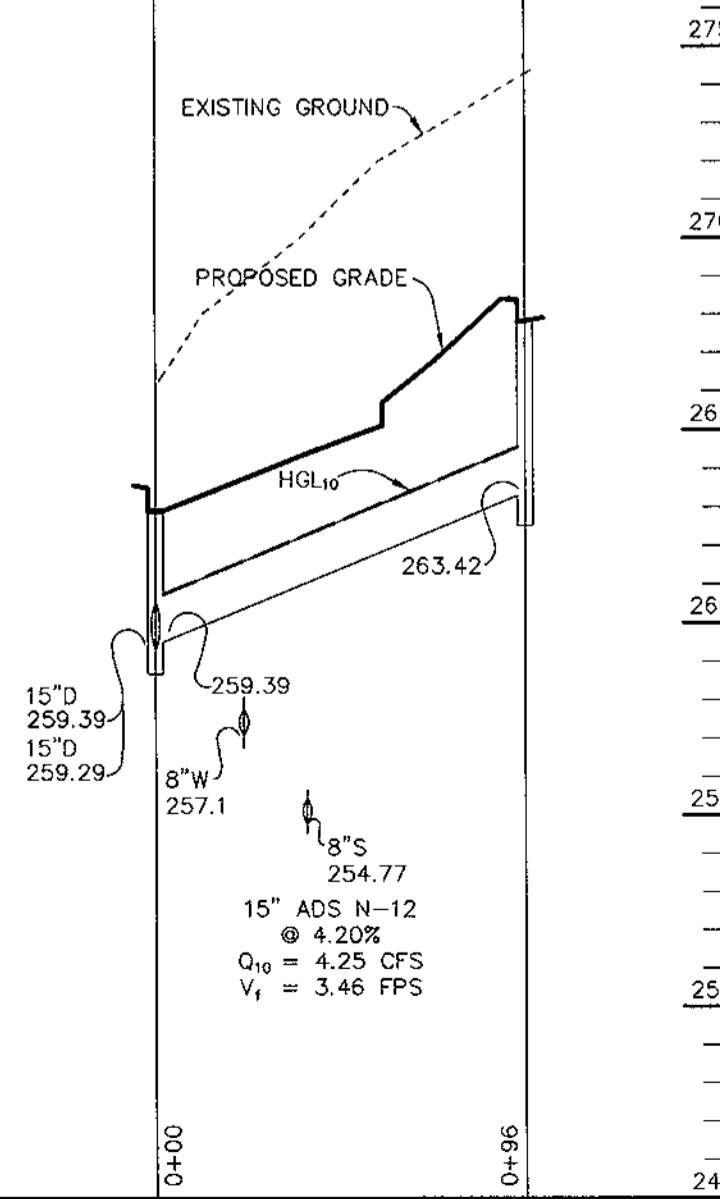

STORM DRAIN PROFILE

SCALE :  
HOR.-1"=50'  
VERT.-1"=5'

APPROVED : HOWARD COUNTY DEPARTMENT OF PLANNING AND ZONING.

*[Signature]* 10/12/99  
DIRECTOR DATE

*[Signature]* 10/12/99  
CHIEF, DEVELOPMENT ENGINEERING DIVISION DATE

*[Signature]* 10/15/99  
CHIEF, DIVISION OF LAND DEVELOPMENT DATE

DATE	NO.	REVISION

OWNER/DEVELOPER  
PROLOGIS DEVELOPMENT SERVICES INCORPORATED  
5200 EISENHOWER AVENUE, SECOND FLOOR  
ALEXANDRIA, VIRGINIA 22304  
(703)751-9292

PROJECT MEADOWRIDGE BUSINESS PARK  
PARCEL G-2  
2 WAREHOUSE BUILDINGS

AREA TAX MAP NO. 37 ZONED M-1 PARCEL G-2  
1st ELECTION DISTRICT  
HOWARD COUNTY, MARYLAND

TITLE ROOF DRAIN PROFILES

**RIEMER MUEGGE & ASSOCIATES INC.**  
ENGINEERING • ENVIRONMENTAL SERVICES • PLANNING • SURVEYING  
8818 Centre Park Drive, Columbia, MD 21045  
tel 410.997.8900 fax 410.997.9282

DESIGNED BY : CJR  
DRAWN BY : DAM  
PROJECT NO : 97320/PARCEL\_G  
SDP12.DWG  
DATE : OCTOBER 11, 1999  
SCALE : AS SHOWN  
DRAWING NO. 8 OF 25

DATE  
STATE OF MARYLAND  
ARTHUR E. MUEGGE #8707



**TEMPORARY SEEDING NOTES**

Apply to graded or cleared areas likely to be redistributed where a short-term vegetative cover is needed.

**Seeding Preparation:** Loosen upper three inches of soil by raking, discing or other acceptable means before seeding. If not previously loosened.

**Soil Amendments:** Apply 600 lbs. per acre 10-10-10 fertilizer (14 lbs. per 1000 sq. ft.).

**Seeding:** For periods March 1 thru April 30 and from August 15 thru November 15, seed with 2-1/2 bushels per acre of annual ryegrass (3.2 lbs. per 1000 sq. ft.). For the period May 1 thru August 14, seed with 3 lbs. per acre of creeping lovegrass (0.07 lbs. per 1000 sq. ft.). For the period November 16 thru February 26, protect site by applying 2 tons per acre of well-anchored straw mulch and seed as soon as possible in the spring, or use sod.

**Mulching:** Apply 1-1/2 to 2 tons per acre (70 to 90 lbs. per 1000 sq. ft.) of untreated small grain straw immediately after seeding. Anchor mulch immediately after application using mulch anchoring tool or 2 1/2 gal. per acre (5 gal. per 1000 sq. ft.) of emulsified asphalt on flat areas. On slopes, 8 ft. or higher, use 3 1/2 gal. per acre (8 gal. per 1000 sq. ft.) for anchoring.

Refer to the 1983 MARYLAND STANDARDS AND SPECIFICATIONS FOR SOIL EROSION AND SEDIMENT CONTROL for rate and methods not covered.

**PERMANENT SEEDING NOTES**

Apply to graded or cleared areas not subject to immediate further disturbance where a permanent long-lived vegetative cover is needed.

**Seeding Preparation:** Loosen upper three inches of soil by raking, discing or other acceptable means before seeding. If not previously loosened.

**Soil Amendments:** In lieu of soil test recommendations, use one of the following schedules:

1. Preferred - Apply 2 tons per acre dolomitic limestone (42 lbs. per 1000 sq. ft.) and 600 lbs. per acre 10-10-10 fertilizer (14 lbs. per 1000 sq. ft.) before seeding. Harrow or disc into upper three inches of soil. At time of seeding, apply 400 lbs. per acre 30-0-0 ureaform fertilizer (4 lbs. per 1000 sq. ft.).
2. Acceptable - Apply 2 tons per acre dolomitic limestone (42 lbs. per 1000 sq. ft.) and 1000 lbs. per acre 10-10-10 fertilizer (23 lbs. per 1000 sq. ft.) before seeding. Harrow or disc into upper three inches of soil.

**Seeding:** For the period March 1 thru April 30 and from August 1 thru October 15, seed with 60 lbs. per acre (1.4 lbs. per 1000 sq. ft.) of Kentucky 31 Tall Fescue per acre and 2 lbs. per acre (0.05 lbs. per 1000 sq. ft.) of creeping lovegrass. During the period October 16 thru February 26, protect site by one of the following options:

1. 2 tons per acre of well-anchored mulch straw and seed as soon as possible in the spring
2. Use sod.
3. Seed with 60 lbs. per acre Kentucky 31 Tall Fescue and mulch with 2 tons per acre well-anchored straw.

**Mulching:** Apply 1-1/2 to 2 tons per acre (70 to 90 lbs. per 1000 sq. ft.) of untreated small grain straw immediately after seeding. Anchor mulch immediately after application using mulch anchoring tool or 2 1/2 gal. per acre (5 gal. per 1000 sq. ft.) of emulsified asphalt on flat areas. On slopes, 8 ft. or higher, use 3 1/2 gal. per acre (8 gal. per 1000 sq. ft.) for anchoring.

**Maintenance:** Inspect all seeded areas and make needed repairs, replacements and reseeding.

**STANDARD SEDIMENT CONTROL NOTES**

1. A MINIMUM OF 48 HOURS NOTICE MUST BE GIVEN TO THE HOWARD COUNTY DEPARTMENT OF INSPECTIONS, LICENSES AND PERMITS, SEDIMENT CONTROL DIVISION PRIOR TO THE START OF ANY CONSTRUCTION (315-1855).
2. ALL VEGETATIVE AND STRUCTURAL PRACTICES ARE TO BE INSTALLED ACCORDING TO THE PROVISIONS OF THIS PLAN AND ARE TO BE IN CONFORMANCE WITH THE 1984 MARYLAND STANDARDS AND SPECIFICATIONS FOR SOIL EROSION AND SEDIMENT CONTROL AND REVISIONS THERETO.
3. FOLLOWING INITIAL SOIL DISTURBANCE OR RE-DISTURBANCE, PERMANENT OR TEMPORARY STABILIZATION SHALL BE COMPLETED WITHIN: A) CALENDAR DATES FOR ALL PERIMETER SEDIMENT CONTROL STRUCTURES, DIKES, PERIMETER SLOPES, AND ALL SLOPES STEEPER THAN 3:1; B) 14 DAYS AS TO ALL OTHER DISTURBED OR GRADED AREAS ON THE PROJECT SITE.
4. ALL SEDIMENT TRAPS/BASINS SHALL BE FENCED AND WARNING SIGNS POSTED AROUND THE PERIMETER IN ACCORDANCE WITH VOL. 1, CHAPTER 1, OF THE HOWARD COUNTY DESIGN MANUAL, STORM DRAINAGE.
5. ALL DISTURBED AREAS MUST BE STABILIZED WITHIN THE TIME PERIOD SPECIFIED ABOVE IN ACCORDANCE WITH THE 1984 MARYLAND STANDARDS AND SPECIFICATIONS FOR SOIL EROSION AND SEDIMENT CONTROL FOR PERMANENT SEEDING, SOIL TEMPORARY SEEDING, AND MULCHING (SEC. 6.). TEMPORARY STABILIZATION WITH MULCH ALONE SHALL ONLY BE DONE WHEN RECOMMENDED SEEDING DATES DO NOT ALLOW FOR PROPER GERMINATION AND ESTABLISHED OF GRASSES.
6. ALL SEDIMENT CONTROL STRUCTURES ARE TO REMAIN IN PLACE AND ARE TO BE MAINTAINED IN OPERATIVE CONDITION UNTIL PERMISSION FOR THEIR REMOVAL HAS BEEN OBTAINED FROM THE HOWARD COUNTY SEDIMENT CONTROL INSPECTOR.
7. SITE ANALYSIS.
  - TOTAL AREA OF SITE: 19.58 ACRES
  - AREA DISTURBED: 18.70 ACRES
  - AREA TO BE ROOFED OR PAVED: 14.20 ACRES
  - AREA TO BE VEGETATIVELY STABILIZED: 4.00 ACRES
  - TOTAL CUT: 40,000 CU. YARDS
  - TOTAL FILL: 40,000 CU. YARDS
  - OFFSITE WASTE AREA LOCATION TO HAVE ACTIVE GRADINGS PERMIT
8. ANY SEDIMENT CONTROL PRACTICE WHICH IS DISTURBED BY GRADINGS ACTIVITY FOR PLACEMENT OF UTILITIES MUST BE REPAIRED ON THE SAME DAY OF DISTURBANCE.
9. ADDITIONAL SEDIMENT CONTROLS MUST BE PROVIDED, IF DEEMED NECESSARY BY THE HOWARD COUNTY SEDIMENT CONTROL INSPECTOR.
10. ON ALL SITES WITH DISTURBED AREAS IN EXCESS OF 2 ACRES, APPROVAL OF THE INSPECTION AGENCY SHALL BE REQUESTED UPON COMPLETION OF INSTALLATION OF PERIMETER EROSION AND SEDIMENT CONTROLS, BUT BEFORE PROCEEDING WITH ANY OTHER EARTH DISTURBANCE OR GRADINGS. OTHER BUILDING OR GRADING INSPECTION APPROVALS MAY NOT BE AUTHORIZED UNTIL THIS INITIAL APPROVAL BY THE INSPECTION AGENCY IS MADE.
11. TRENCHES FOR THE CONSTRUCTION OF UTILITIES IS LIMITED TO THREE PIPE LENGTHS OR THAT WHICH SHALL BE BACK-FILLED AND STABILIZED WITHIN ONE WORKING DAY, WHICHEVER IS SHORTER.
12. SITE GRADINGS WILL BE INSTALLED ONLY AFTER ALL PERIMETER SEDIMENT CONTROL MEASURES HAVE BEEN INSTALLED AND ARE IN A FUNCTIONING CONDITION.
13. SEDIMENT WILL BE REMOVED FROM TRAPS WHEN ITS DEPTH REACHES CLEAN OUT ELEVATION SHOWN ON THE PLANS.
14. CUT AND FILL QUANTITIES PROVIDED UNDER SITE ANALYSIS DO NOT REPRESENT BID QUANTITIES. THESE QUANTITIES DO NOT DISTINGUISH BETWEEN TOPSOIL, STRUCTURAL FILL OR EMBANKMENT MATERIAL, NOR DO THEY REFLECT CONSIDERATION OF UNDERCUTTING OR REMOVAL OF UNSUITABLE MATERIAL. THE CONTRACTOR SHALL FAMILIARIZE HIMSELF WITH SITE CONDITIONS WHICH MAY AFFECT THE WORK.

**21.0 STANDARD AND SPECIFICATIONS FOR TOPSOIL**

**DEFINITION**

Placement of topsoil over a prepared subsoil prior to establishment of permanent vegetation.

**PURPOSE**

To provide a suitable soil medium for vegetative growth. Soils of concern have low moisture content, low nutrient levels, low pH, materials toxic to plants, and/or unacceptable soil gradation.

**CONDITIONS WHERE PRACTICE APPLIES**

1. This practice is limited to areas having 2:1 or flatter slopes where:
  - a. The texture of the exposed subsoil/parent material is not adequate to produce vegetative growth.
  - b. The soil material is so shallow that the rooting zone is not deep enough to support plants or furnish continuing supplies of moisture and plant nutrients.
  - c. The original soil to be vegetated contains material toxic to plant growth.
  - d. The soil is so acidic that treatment with limestone is not feasible.
11. For the purpose of these Standards and Specifications, areas having slopes steeper than 2:1 require special consideration and design for adequate stabilization. Areas having slopes steeper than 2:1 shall have the appropriate stabilization shown on the plans.

**CONSTRUCTION AND MATERIAL SPECIFICATIONS**

1. Topsoil salvaged from the existing site may be used provided that it meets the standards as set forth in these specifications. Typically, the depth of topsoil to be salvaged for a given soil type can be found in the representative soil profile section in the soil survey published by USNR-555 in cooperation with Maryland Agricultural Experimentation Station.

11. Topsoil Specifications - Soil to be used as topsoil must meet the following:

1. Topsoil shall be a loam, sandy loam, clay loam, silt loam, sandy clay loam, loamy sand, other soils may be used if recommended by an agronomist or soil scientist and approved by the appropriate approval authority. Regardless, topsoil shall not be a mixture of contrasting textured subsoils and shall contain: less than 2% by volume of cinders, stones, slag, coarse fragments, gravel, sticks, roots, trash, or other materials larger than 1 1/2" in diameter.
11. Topsoil must be free of plants or plant parts such as bermuda grass, quackgrass, Johnsongrass, nutsedge, poison ivy, thistle, or others as specified.
111. Where subsoil is either highly acidic or composed of heavy clays, ground limestone shall be spread at the rate of 4-8 tons/acre (200-400 pounds per 1,000 square feet) prior to the placement of topsoil. Limestone shall be distributed uniformly over designated areas and worked into the soil in conjunction with tillage operations as described in the following procedures.

For sites having disturbed areas over 5 acres:

1. Place topsoil (if required) and apply soil amendments as specified in 20.0 Vegetative Stabilization - Section 1 - Vegetative Stabilization Methods and Materials.
11. For sites having disturbed areas over 5 acres:
  - a. On soil meeting topsoil specifications, obtain test results dictating fertilizer and lime amendments required to bring the soil into compliance with the following:
    - i. pH for topsoil shall be between 6.0 and 7.5. If the tested soil demonstrates a pH of less than 6.0, sufficient lime shall be prescribed to raise the pH to 6.0 or higher.
    - ii. Organic content of topsoil shall be not less than 1.5 percent by weight.
    - iii. Topsoil having soluble salt content greater than 500 parts per million shall not be used.
    - iv. No sod or seed shall be placed on soil which has been treated with soil sterilants or chemicals used for weed control until sufficient time has elapsed (14 days min.) to permit dissipation of phytotoxic materials.

Note: Topsoil substitutes to amendments, as recommended by a qualified agronomist or soil scientist and approved by the appropriate approval authority may be used in lieu of natural topsoil.

11. Place topsoil (if required) and apply soil amendments as specified in 20.0 Vegetative Stabilization - Section 1 - Vegetative Stabilization Methods and Materials.

V. Topsoil Application

1. When topsoiling, maintain needed erosion and sediment control practices such as diversions, Grade Stabilization Structures, Earth Dikes, Slope Silt Fence and Sediment Traps and Basins.
11. Grades on the areas to be topsoiled, which have been previously established, shall be maintained, albeit 4" - 8" higher in elevation.

11. Topsoil shall be uniformly distributed in a 4" - 8" layer and lightly compacted to a minimum thickness of 4". Spreading shall be performed in such a manner that seeding or seedling can proceed with a minimum of additional soil preparation and tillage. Any irregularities in the surface resulting from topsoiling or other operations shall be corrected in order to prevent the formation of depressions or water pockets.

11. Topsoil shall not be placed while the topsoil or subsoil is in a frozen or muddy condition, when the subsoil is excessively wet, or in a condition that may otherwise be detrimental to proper grading and seeded preparation.

- VI. Alternative for Permanent Seeding - Instead of applying the full amount of lime and commercial fertilizer, composted sludge and amendments may be applied as specified below:
  - a. Composted sludge material for use as a soil conditioner for sites having disturbed areas over 5 acres shall be tested to prescribe amendments and for site having disturbed areas under 5 acres shall conform to the following requirements:
    - i. Composted sludge shall be supplied by, or originate from, a person or persons that are permitted (at the time of acquisition of the compost) by the Maryland Department of the Environment under COMAR 26.04.06.
    - ii. Composted sludge shall contain at least 1 percent nitrogen, 1.5 percent phosphorus, and 0.2 percent potassium and have a pH of 7.0 to 8.0. If compost does not meet these requirements, the appropriate consultants must be added to meet the requirements prior to use.
    - iii. Composted sludge shall be applied at a rate of 1 ton/1,000 square feet.
    - iv. Composted sludge shall be amended with a potassium fertilizer applied at the rate of 4 lb/1,000 square feet, and 1/3 the normal time application rate.


References: Guideline Specifications, Soil Preparation and Seeding, HD-VA, Pub. #1, Cooperative Extension Service, University of Maryland and Virginia Polytechnic Institute, Revised 1973.

**SEQUENCE OF CONSTRUCTION**

1. OBTAIN NEW GRADINGS PERMIT.
2. REPAIR AS NECESSARY CONTROLS UNDER GP-00-26.
3. INSTALL SUPER SILT FENCE AND SILT FENCE. (2 DAYS)
4. ROUGH GRADE SITE AND COMMENCE BUILDINGS CONSTRUCTION.
5. AS SUBGRADES ARE ESTABLISHED, INSTALL STORMS 1-19 TO 1-22, 1-19 TO 1-27 AND EX. 1-34 TO 1-17 & 18. INSTALL WATER AND SEWER UTILITIES. (2 WEEKS)
6. INSTALL CURB AND GUTTER THEN PAVE. (1 MONTH)
7. APPLY TOPSOIL AND STABILIZE ALL DISTURBED AREAS IN ACCORDANCE WITH THE PERMANENT SEEDING NOTES. (3 DAYS)
8. INSTALL LIGHTS, LANDSCAPING, SIGNAGE AND SIDEWALKS. (2 WEEKS)
9. UPON PERMISSION OF DILP SEDIMENT CONTROL INSPECTOR, CLEAN STORM DRAIN INLETS AND FLUSH OUT PIPES, REMOVE EX. R.O.S.T. (GP-00-26) AND CONSTRUCT UNDERGROUND SWM AND REMAINING STORM DRAINS. (2 WEEKS)
10. UPON PERMISSION OF DILP SEDIMENT CONTROL INSPECTOR, REMOVE ALL REMAINING SEDIMENT CONTROL DEVICES, STABILIZE REMAINING DISTURBED AREAS IN ACCORDANCE WITH PERMANENT SEEDING NOTES. (1 DAY)


**STRUCTURE CS-1 NOTES**

1. ALL CONSTRUCTION SHALL MEET THE HOWARD CO. STANDARDS AND SPECIFICATIONS.
2. CONCRETE STRENGTH TO BE 4,000 PSI MIN. AT 28 DAYS.
3. REINFORCEMENT SHALL BE CLEAN AND FREE OF RUST AND MEET ASTM-615 GRADE 60.
4. ALL REINFORCEMENT SHALL HAVE 2" MINIMUM COVER EXCEPT BASE WHICH SHALL BE 3".
5. CONTRACTOR SHALL SUBMIT SHOP DRAWINGS TO THE ENGINEER FOR REVIEW PRIOR TO FABRICATION.
6. THE STRUCTURE FOUNDATION SHALL BE APPROVED BY THE GEOTECHNICAL ENGINEER.
7. THIS STRUCTURE SHALL BE CAST-IN-PLACE. CONTRACTOR TO PROVIDE WATERTIGHT CONNECTION TO ALUMINIZED 46" STEEL PIPE.
8. GALVANIZE TRASH RACK AFTER FABRICATION AND PAINT TWO COATS OF BATTLESHIP GRAY.
9. ALL ALUMINIZED PIPE IN CONTACT WITH CONCRETE SHALL BE COATED WITH BITUMINOUS COATINGS.

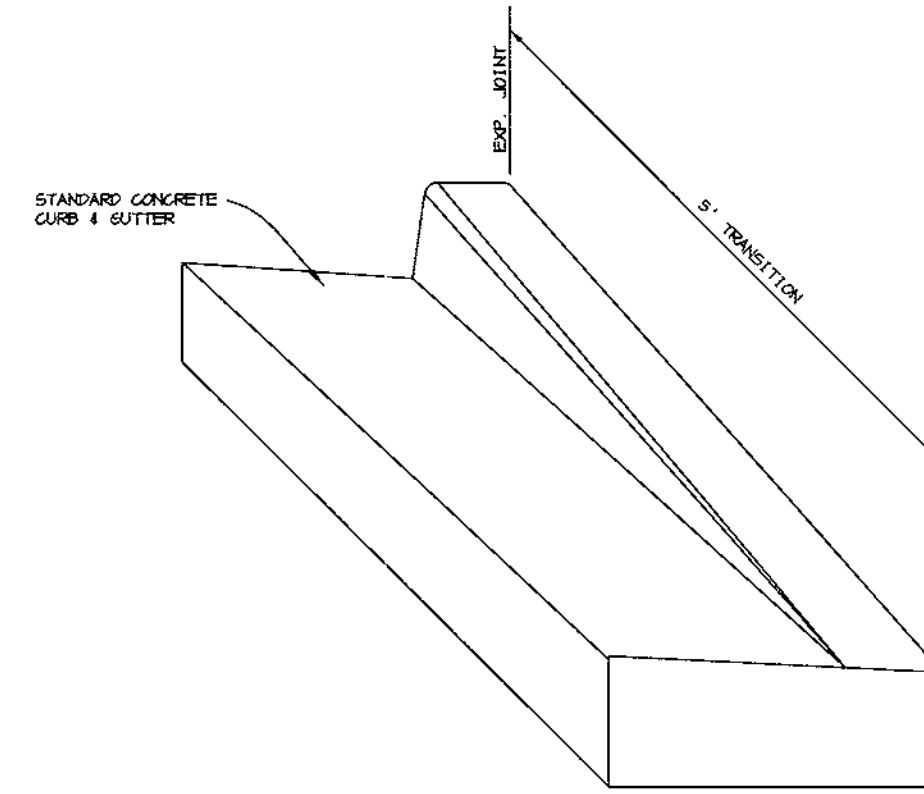

**NOSE DOWN CURB DETAIL**

NO SCALE

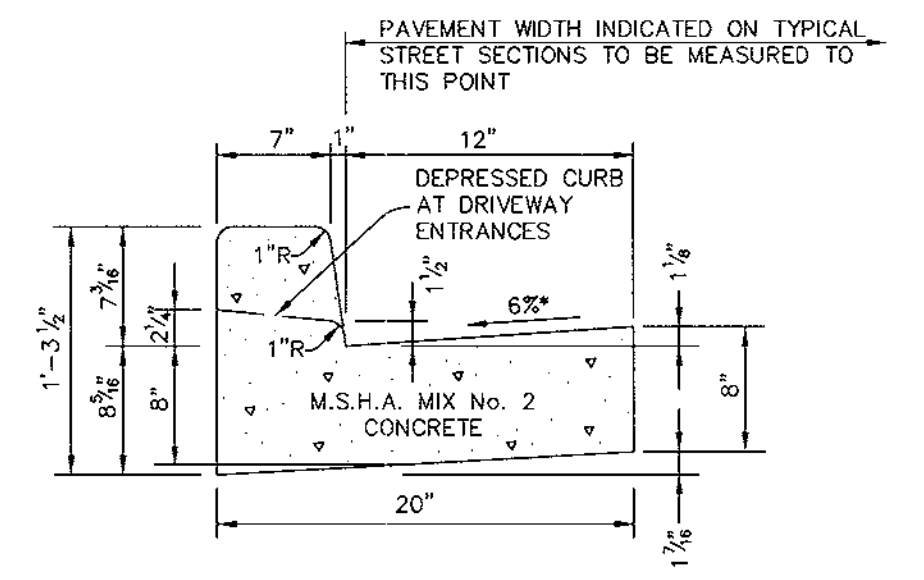

**REVERSE 7" COMBINATION CURB AND GUTTER**

NO SCALE

**STANDARD 7" COMBINATION CURB AND GUTTER**

NO SCALE

**OPERATION AND MAINTENANCE SCHEDULE FOR PRIVATELY OWNED AND MAINTAINED UNDERGROUND STORMWATER MANAGEMENT FACILITY**


1. Underground structures will require periodic inspection and cleaning to maintain operation and function. Owners will have the underground structures inspected yearly or as required by Howard County, utilizing the underground units inspection/monitoring form. Inspections can be done by using a clear Plexiglas tube (sludge judge) to extract a water column sample. When sediment depths exceed 5" then cleaning of the structures is required.
2. Underground facility structures must be checked and cleaned immediately after petroleum spills. Contact appropriate regulatory agencies.
3. Maintenance of underground structures should be done by a vacuum truck which will remove the water, sediment, debris, floating hydrocarbons, and other materials in the unit. The proper cleaning and disposal of the removed materials and liquid must be followed.
4. Inlet and outlet pipes must be checked for any obstructions and if any obstructions are found they must be removed. Structural parts of the underground facility will be repaired as needed.
5. Owner shall retain and make underground facility inspection/monitoring forms available to Howard County officials upon their request.

**CORRUGATED METAL PIPE BACKFILL AND BEDDING SPECIFICATIONS**

- 1.0 BACKFILL
  - 1.1 BACKFILL MATERIAL SHALL BE A WELL GRADED GRANULAR MATERIAL AND SHALL BE IN ACCORDANCE WITH THE HOWARD COUNTY STANDARD SPECIFICATIONS FOR FILL UNDER ROADS.
  - 1.2 HIGHLY PLASTIC SILTS, HIGHLY PLASTIC CLAYS, ORGANIC SILTS, ORGANIC CLAYS, AND PEATS SHALL NOT BE USED AS BACKFILL MATERIALS.
  - 1.3 BACKFILL SHALL BE PLACED SYMMETRICALLY ON EACH SIDE OF THE STRUCTURE IN 6" TO 8" LOOSE LAYERS TO 1 FOOT ABOVE THE TOP OF THE PIPE. EACH LAYER IS TO BE COMPACTED TO 95% OF THE MAXIMUM DRY DENSITY. ALL COMPACTION SHALL BE AASHTO T-99-C.
- 2.0 BEDDING
  - 2.1 THE PIPE SHALL BE PLACED TO UNIFORM GRADE AND LINE TO ENSURE GOOD VERTICAL ALIGNMENT AND TO AVOID EXCESSIVE STRESSES AT PIPE JOINTS. THE BEDDING SHALL BE FREE OF ROCK FORMATIONS, PROTRUDING STONES, FROZEN LUMPS, ROOTS, AND OTHER FOREIGN MATERIAL. THE BEDDING FOUNDATION MUST BE A STABLE, WELL GRADED GRANULAR MATERIAL. ANY SUBGRADE THAT HAS INADEQUATE BEARING CAPABILITY MUST BE REMOVED AND REPLACED WITH A COMPACTED SELECT FILL APPROVED BY THE ENGINEER.
  - 2.2 BEDDING MATERIALS SHALL BE NO. 57 STONE PER MSHA SPECIFICATIONS OR AN APPROVED EQUAL. SEE BEDDING DETAIL SHEET 10.
  - 2.3 THE SELECT FILL SHALL BE AASHTO A-2-4. SEE DETAIL SHEET 10.
- 3.0 MATERIALS
  - 3.1 PIPE - ALUMINIZED STEEL PIPE, TYPE 11, 12 GA. THIS PIPE AND FITTINGS SHALL CONFORM TO THE REQUIREMENTS OF AASHTO 3.1 SPECIFICATIONS M-274 WITH WATERTIGHT COUPLING BANDS OR FLANGES. ANY ALUMINUM COATINGS DAMAGED OR OTHERWISE REMOVED SHALL BE REPLACED WITH COLD APPLIED BITUMINOUS COATING COMPOUND.
  - 3.2 WATERTIGHT CONNECTIONS WILL BE HUGGARBAND-12" WIDE MINIMUM WITH SINGLE BAR AND STRAP CONNECTORS AND O-RING GASKETS.

**RETAINING WALL DETAIL**

NO SCALE

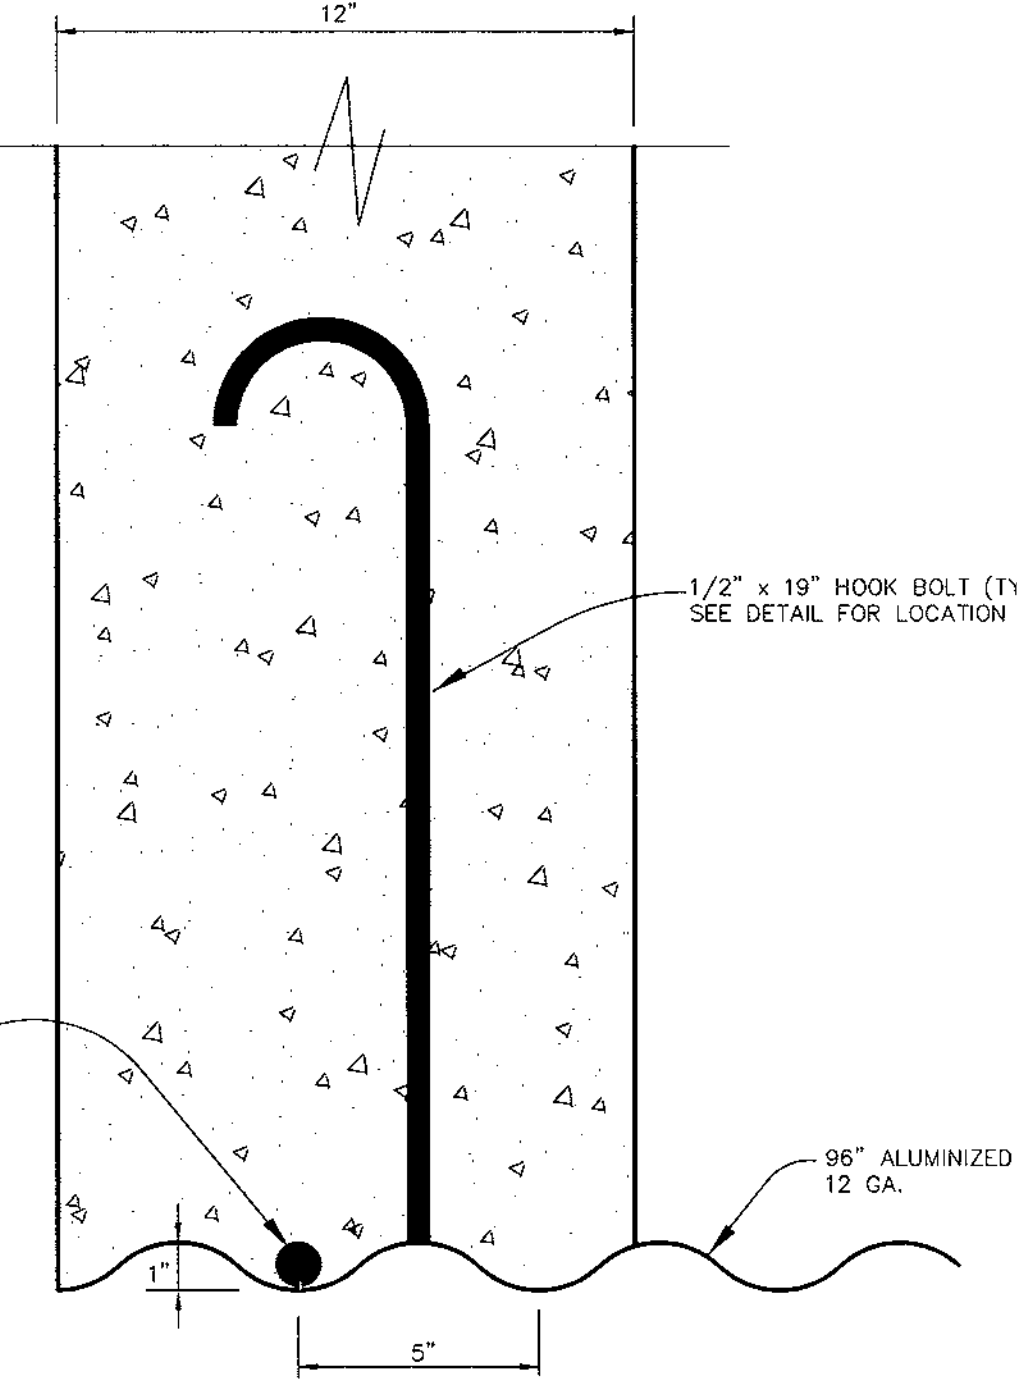


**WATERTIGHT CONNECTION FOR CS-1**


SCALE: 1" = 4"

**30.0 - DUST CONTROL**

<b>DEFINITION</b>	CONTROLLING DUST BLOWING AND MOVEMENT ON CONSTRUCTION SITES AND ROADS.
<b>PURPOSE</b>	TO PREVENT BLOWING AND MOVEMENT OF DUST FROM EXPOSED SOIL SURFACES, REDUCE ON AND OFF-SITE DAMAGE, HEALTH HAZARDS, AND IMPROVE TRAFFIC SAFETY.
<b>CONDITIONS WHERE PRACTICE APPLIES</b>	THIS PRACTICE IS APPLICABLE TO AREAS SUBJECT TO DUST BLOWING AND MOVEMENT WHERE ON OFF-SITE DAMAGE IS LIKELY WITHOUT TREATMENT.
<b>REGULATIONS</b>	
<b>TEMPORARY METHODS</b>	<ol style="list-style-type: none"> <li>1. MULCHES - SEE STANDARDS FOR VEGETATIVE STABILIZATION WITH MULCHES ONLY. MULCH SHOULD BE CRIMPED OR TACKED TO PREVENT BLOWING.</li> <li>2. VEGETATIVE COVER - SEE STANDARDS FOR TEMPORARY VEGETATIVE COVER.</li> <li>3. TILLAGE - TO ROUGHEN SURFACE AND BRING CLDS TO THE SURFACE. THIS IS AN EMERGENCY MEASURE WHICH SHOULD BE USED BEFORE BLOWING STARTS. BLOW PLOWING OR MOWING SIZE OF SITE. CHisel-TYPE PLOWS SPACED ABOUT 12' SPACING, SPRING-TOOTHED HARROWS, AND SIMILAR PLOWS ARE EXAMPLES OF EQUIPMENT WHICH MAY PRODUCE THE DESIRED EFFECT.</li> <li>4. IRRIGATION - THIS IS GENERALLY DONE AS AN EMERGENCY TREATMENT. SITE IS SPRINKLED WITH WATER UNTIL THE SURFACE IS MOIST. REPEAT AS NEEDED, AT NO TIME SHOULD THE SITE BE IRRIGATED TO THE POINT THAT RUNOFF BEGINS TO FLOW.</li> <li>5. BARRIERS - SOLID BOARD FENCES, SILT FENCES, SNOW FENCES, BURAP FENCES, STRAW BALES, AND SIMILAR MATERIAL CAN BE USED TO CONTROL AIR CURRENTS AND SOIL BLOWING. BARRIERS PLACED AT RIGHT ANGLES TO PREVAILING CURRENTS AT INTERVALS OF ABOUT 100 FEET. THEIR HEIGHT IS EFFECTIVE IN CONTROLLING SOIL BLOWING.</li> <li>6. CALCIUM CHLORIDE - APPLY AT RATES THAT WILL KEEP SURFACE MOIST. MAY NEED REAPPLICATION.</li> </ol>
<b>PERMANENT METHODS</b>	<ol style="list-style-type: none"> <li>1. PERMANENT VEGETATION - SEE STANDARDS FOR PERMANENT VEGETATIVE COVER, AND PERMANENT STABILIZATION WITH SOIL. EXISTING TREES OR LARGE SHRUBS MAY AFFORD VALUABLE PROTECTION IF LEFT IN PLACE.</li> <li>2. TOPSOILING - COVERING WITH LESS ERODIBLE SOIL MATERIALS. SEE STANDARDS FOR TOPSOILING.</li> <li>3. STONE - COVER SURFACE WITH CRUSHED STONE OR COARSE GRAVEL.</li> </ol>
<b>REFERENCES</b>	<ol style="list-style-type: none"> <li>1. AGRICULTURE HANDBOOK 346. WIND EROSION FORCES IN THE UNITED STATES AND THEIR USES IN PREDICTING SOIL LOSS.</li> <li>2. AGRICULTURE INFORMATION BULLETIN 354. HOW TO CONTROL WIND EROSION. USDA-ARS.</li> </ol>
U.S. DEPARTMENT OF AGRICULTURE SOIL CONSERVATION SERVICE	PAGE 4 - 28 - 1 MARYLAND DEPARTMENT OF ENVIRONMENT WATER MANAGEMENT ADMINISTRATION

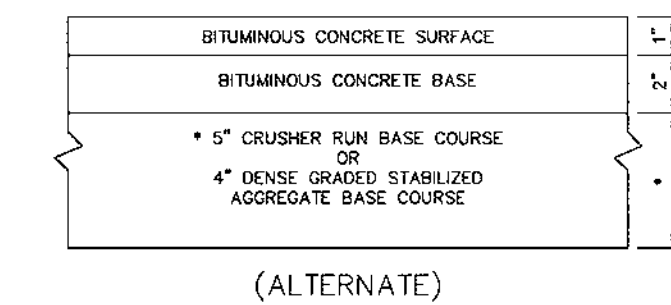


(ALTERNATE)

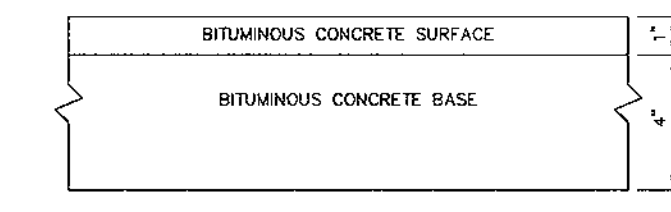


HOWARD COUNTY DESIGN MANUAL VOLUME IV - STANDARD SPECIFICATIONS AND DETAILS FOR CONSTRUCTION (DRAWING R-2.01)

**P-1 PAVING**

NO SCALE

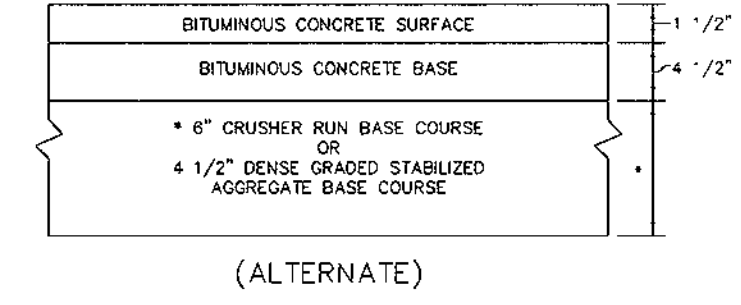

(ALTERNATE)

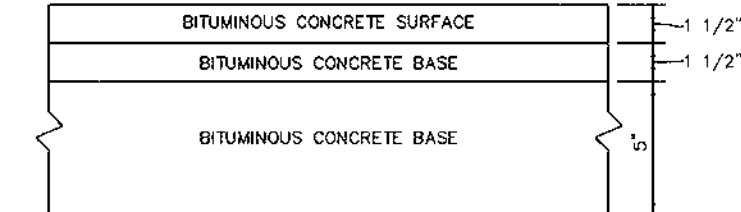

HOWARD COUNTY DESIGN MANUAL VOLUME IV - STANDARD SPECIFICATIONS AND DETAILS FOR CONSTRUCTION (DRAWING R-2.01)

**P-3 PAVING**

NO SCALE

BY THE DEVELOPER :

I/WE CERTIFY THAT ALL DEVELOPMENT AND CONSTRUCTION WILL BE DONE ACCORDING TO THIS PLAN, AND THAT ANY RESPONSIBLE PERSONNEL INVOLVED IN THE CONSTRUCTION PROJECT WILL HAVE A CERTIFICATE OF ATTENDANCE AT A DEPARTMENT OF THE ENVIRONMENT APPROVED TRAINING PROGRAM FOR THE CONTROL OF SEDIMENT AND EROSION BEFORE BEGINNING THE PROJECT. I ALSO AUTHORIZE PERIODIC ON-SITE INSPECTIONS BY THE HOWARD SOIL CONSERVATION DISTRICT.

*Joseph Hite*  
DEVELOPER 10-11-99  
DATE

BY THE ENGINEER :

I CERTIFY THAT THIS PLAN FOR EROSION AND SEDIMENT CONTROL REPRESENTS A PRACTICAL AND WORKABLE PLAN BASED ON MY PERSONAL KNOWLEDGE OF THE SITE CONDITIONS AND THAT IT WAS PREPARED IN ACCORDANCE WITH THE REQUIREMENTS OF THE HOWARD SOIL CONSERVATION DISTRICT.

*Arthur E. Muegge*  
ENGINEER 10-11-99  
DATE

THESE PLANS HAVE BEEN REVIEWED FOR THE HOWARD SOIL CONSERVATION DISTRICT AND THE TECHNICAL REQUIREMENTS FOR SOIL EROSION AND SEDIMENT CONTROL.

*Cheryl Sumner, Esq.*  
NATURAL RESOURCES CONSERVATION SERVICE 10/10/99  
DATE

THIS DEVELOPMENT PLAN IS APPROVED FOR SOIL EROSION AND SEDIMENT CONTROL BY THE HOWARD SOIL CONSERVATION DISTRICT.

*Arthur E. Muegge*  
HOWARD SOIL CONSERVATION DISTRICT 10/10/99  
DATE

APPROVED : HOWARD COUNTY DEPARTMENT OF PLANNING AND ZONING.

*Joseph Hite*  
DIRECTOR 10/10/99  
DATE

*Arthur E. Muegge*  
CHIEF, DEVELOPMENT ENGINEERING DIVISION 10/10/99  
DATE

*Arthur E. Muegge*  
CHIEF, DIVISION OF LAND DEVELOPMENT 10/10/99  
DATE

OWNER/DEVELOPER  
PROLOGIS DEVELOPMENT SERVICES INCORPORATED  
5200 EISENHOWER AVENUE, SECOND FLOOR  
ALEXANDRIA, VIRGINIA 22304  
(703)751-9292


PROJECT  
MEADOWRIDGE BUSINESS PARK  
PARCEL G-2  
2 WAREHOUSE BUILDINGS

AREA  
TAX MAP NO. 37 ZONED M-1 PARCEL G-2  
1st ELECTION DISTRICT  
HOWARD COUNTY, MARYLAND















**DETAILS & NOTES**

**RIEMER MUEGGE & ASSOCIATES INC.**  
ENGINEERING • ENVIRONMENTAL SERVICES • PLANNING • SURVEYING  
8618 Centra Park Drive, Columbia, MD 21045  
tel 410.997.8600 fax 410.997.9282

DESIGNED BY : CJR  
DRAWN BY: DAM  
PROJECT NO : 97320/PARCEL\_G SDP-DMS  
DATE : OCTOBER 11, 1999  
SCALE : AS SHOWN  
DRAWING NO. 9 OF 25

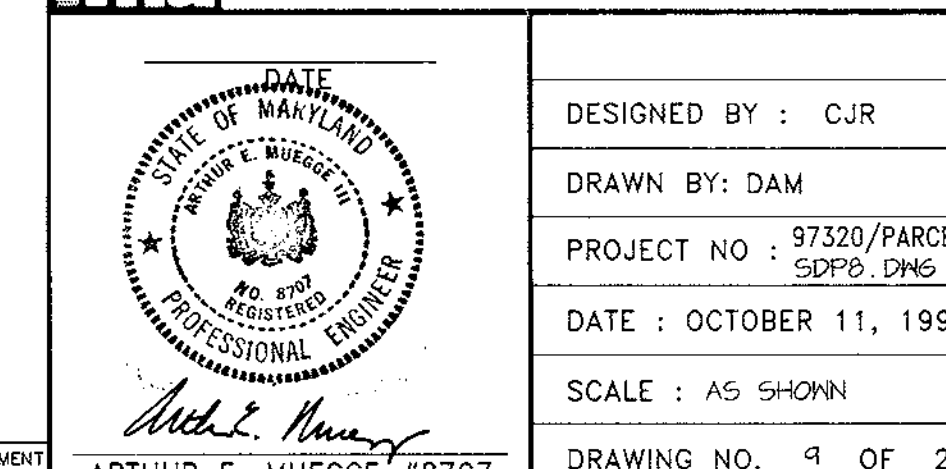



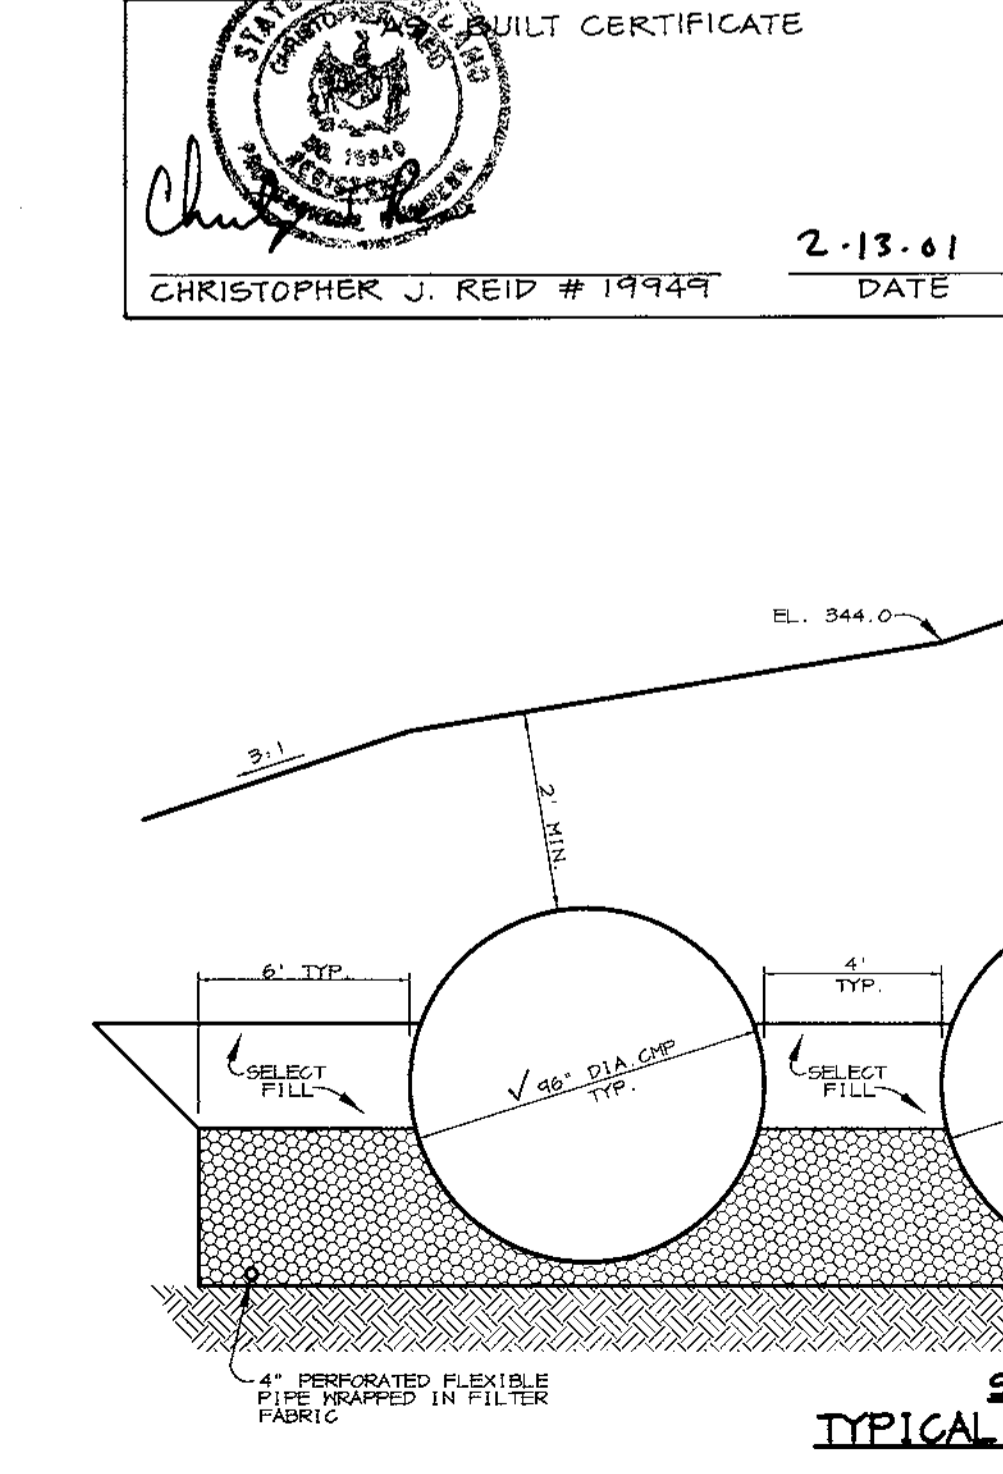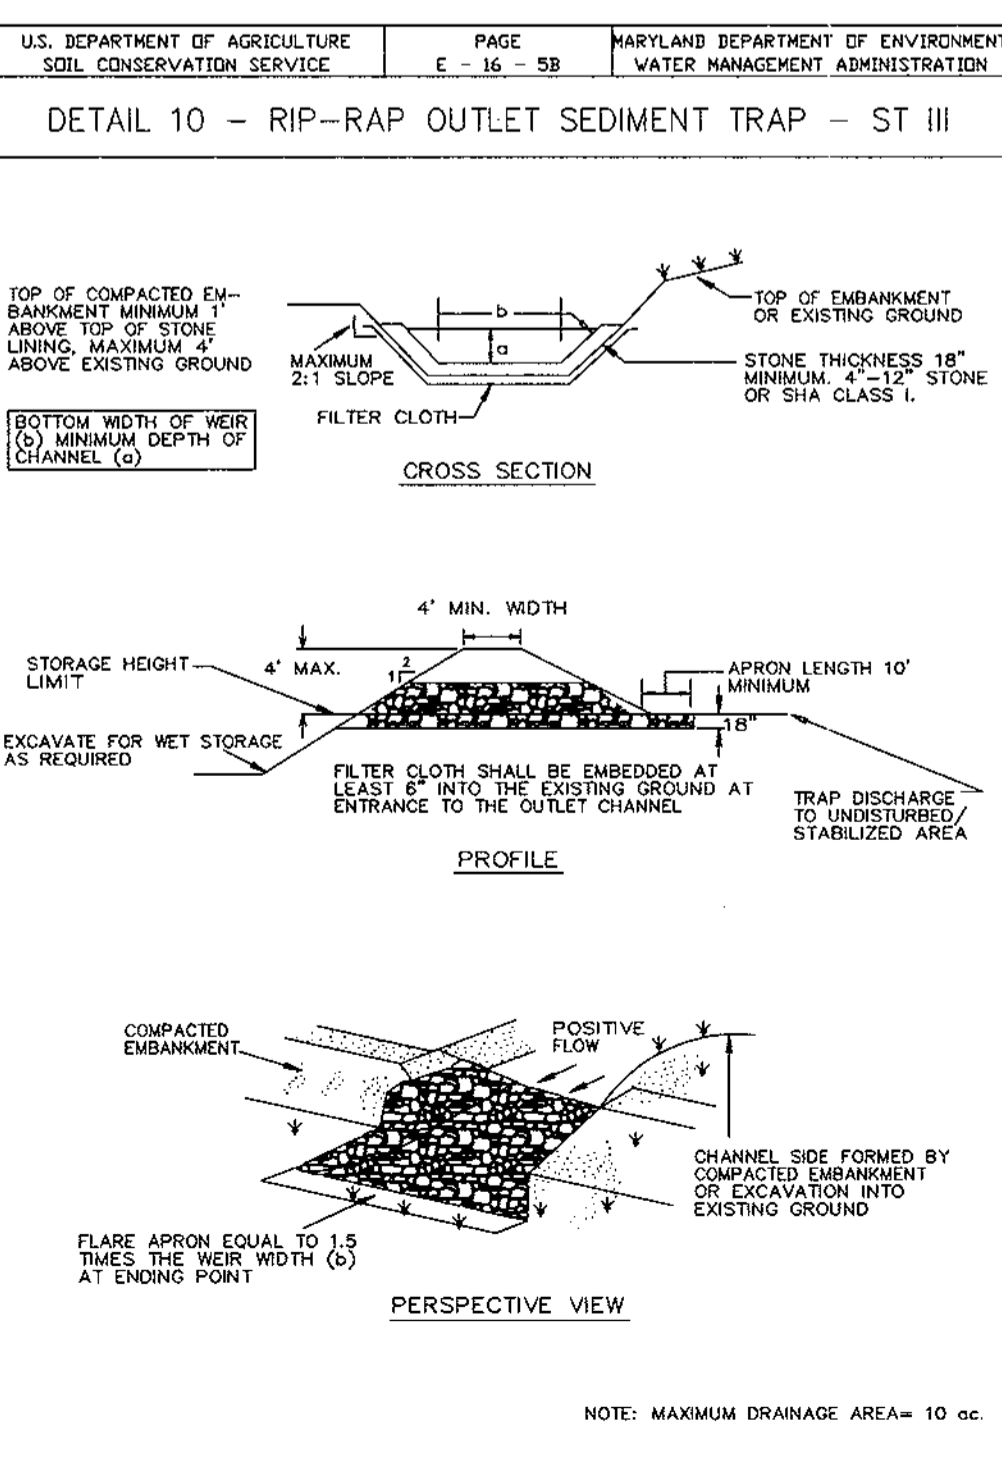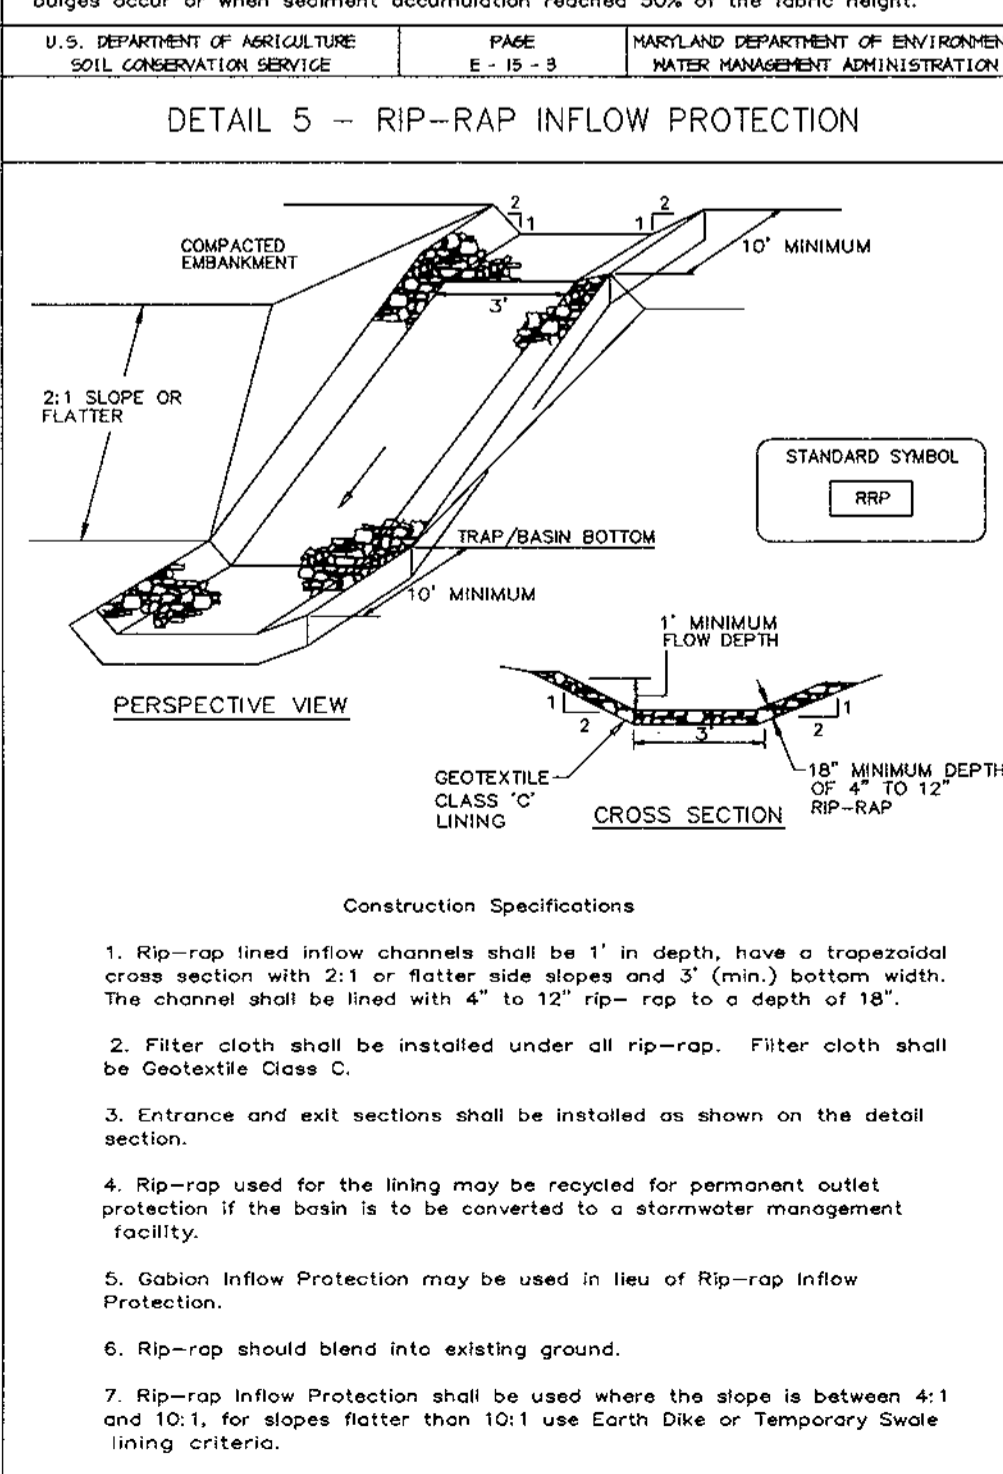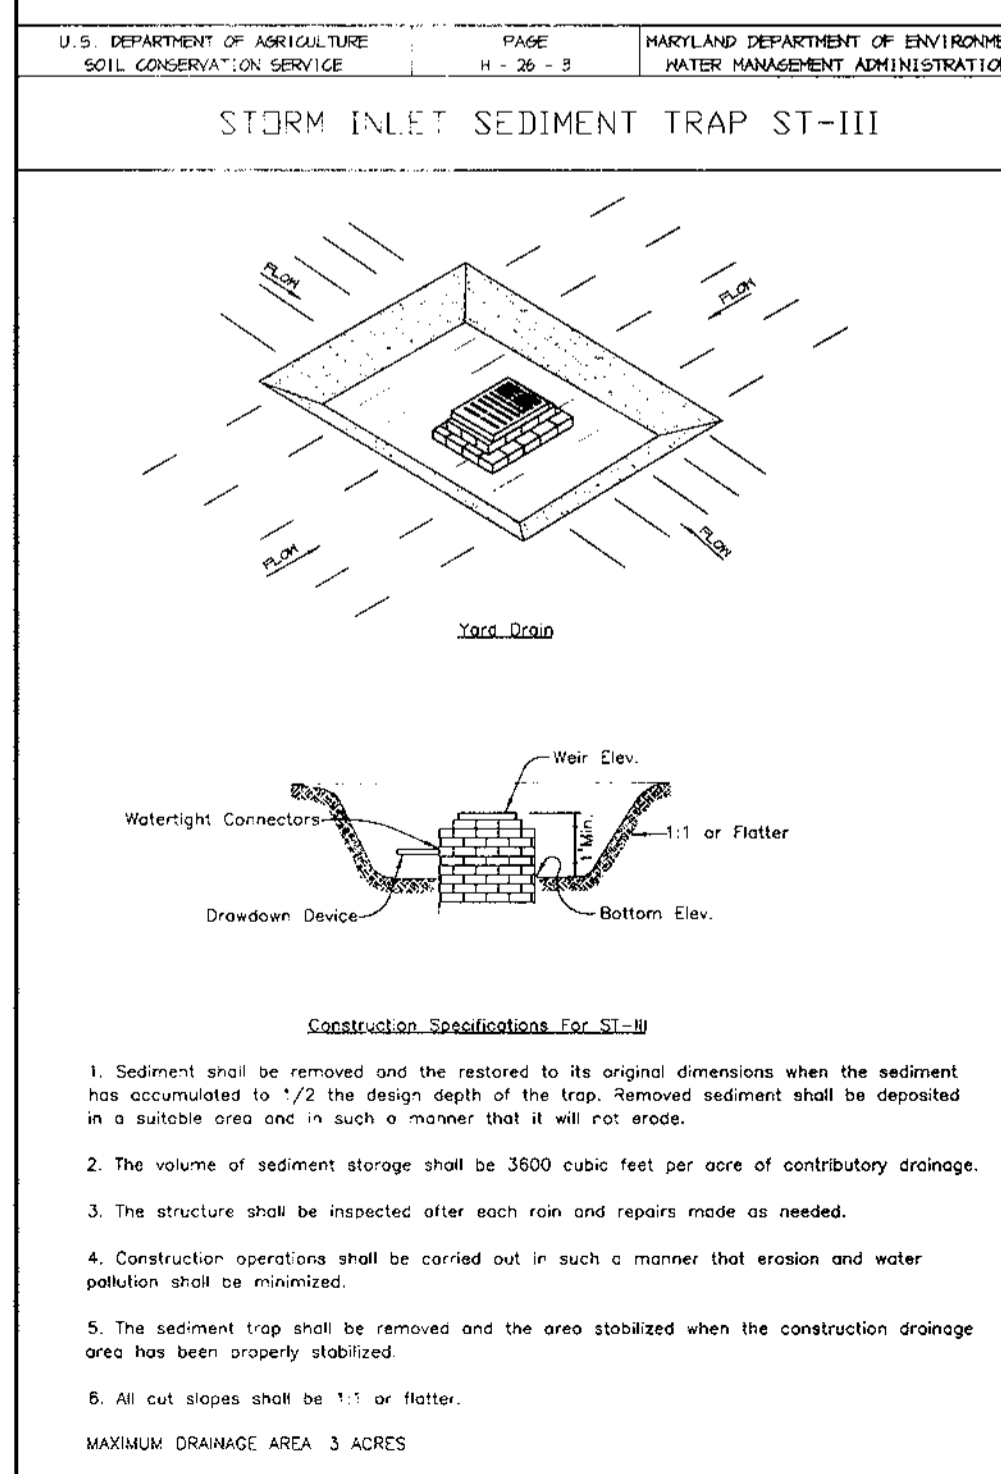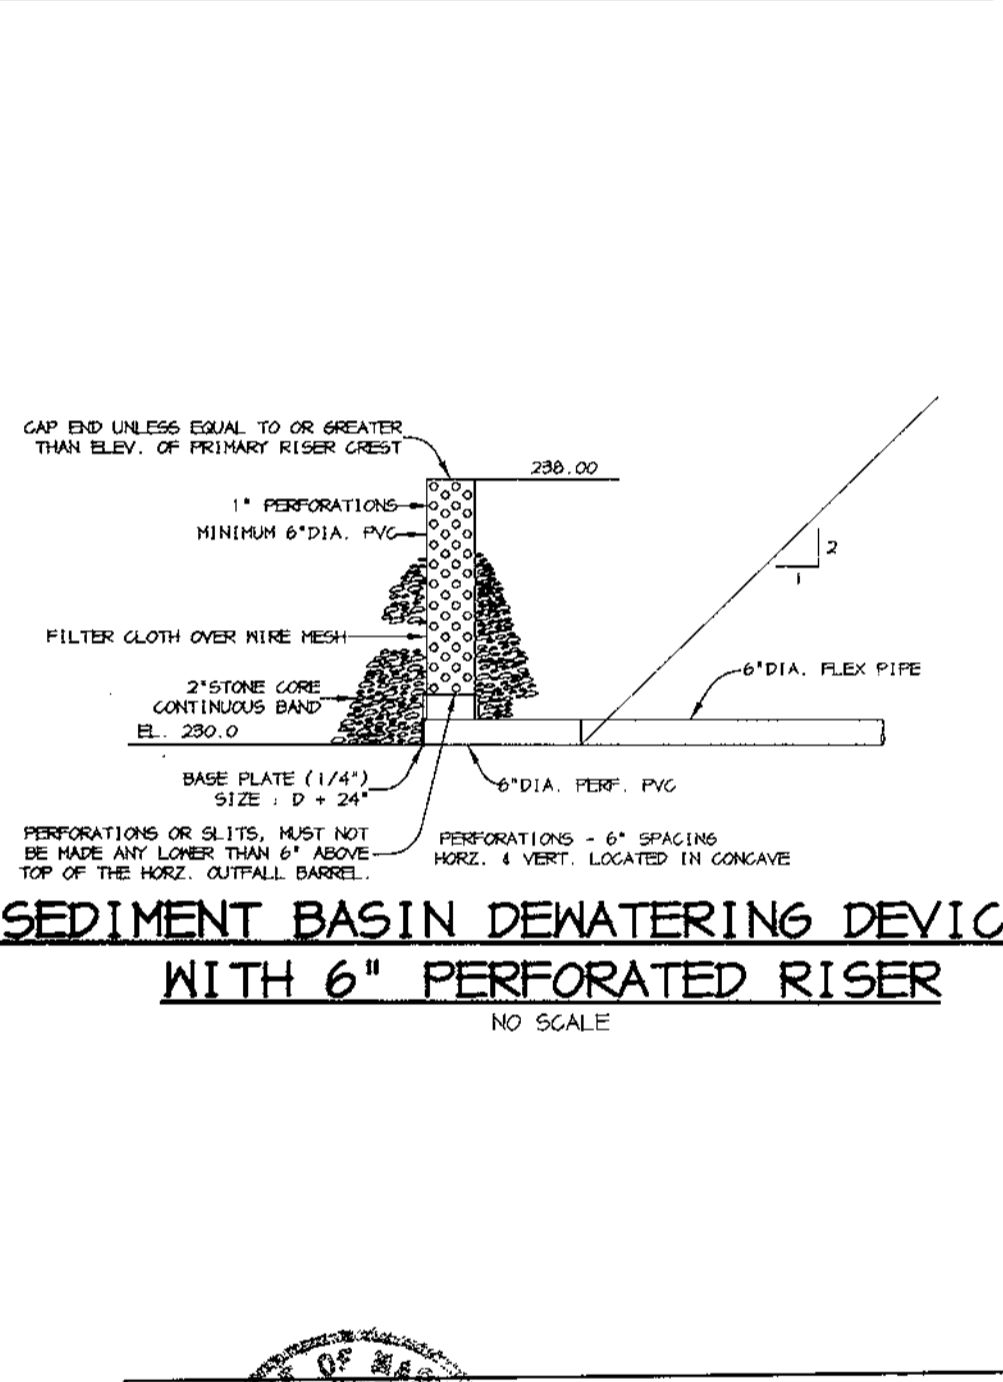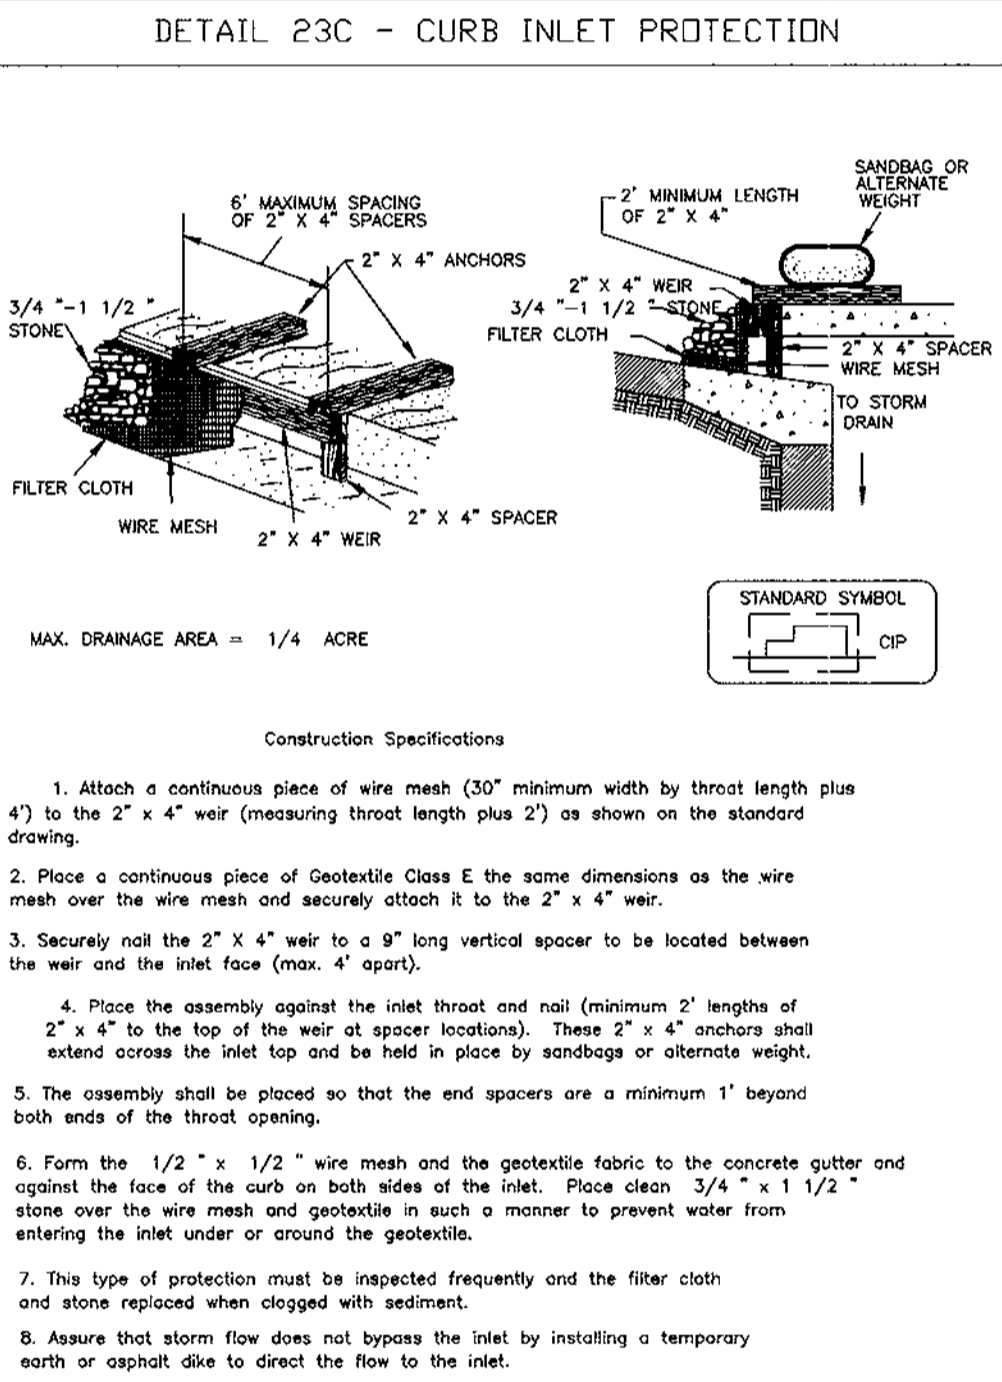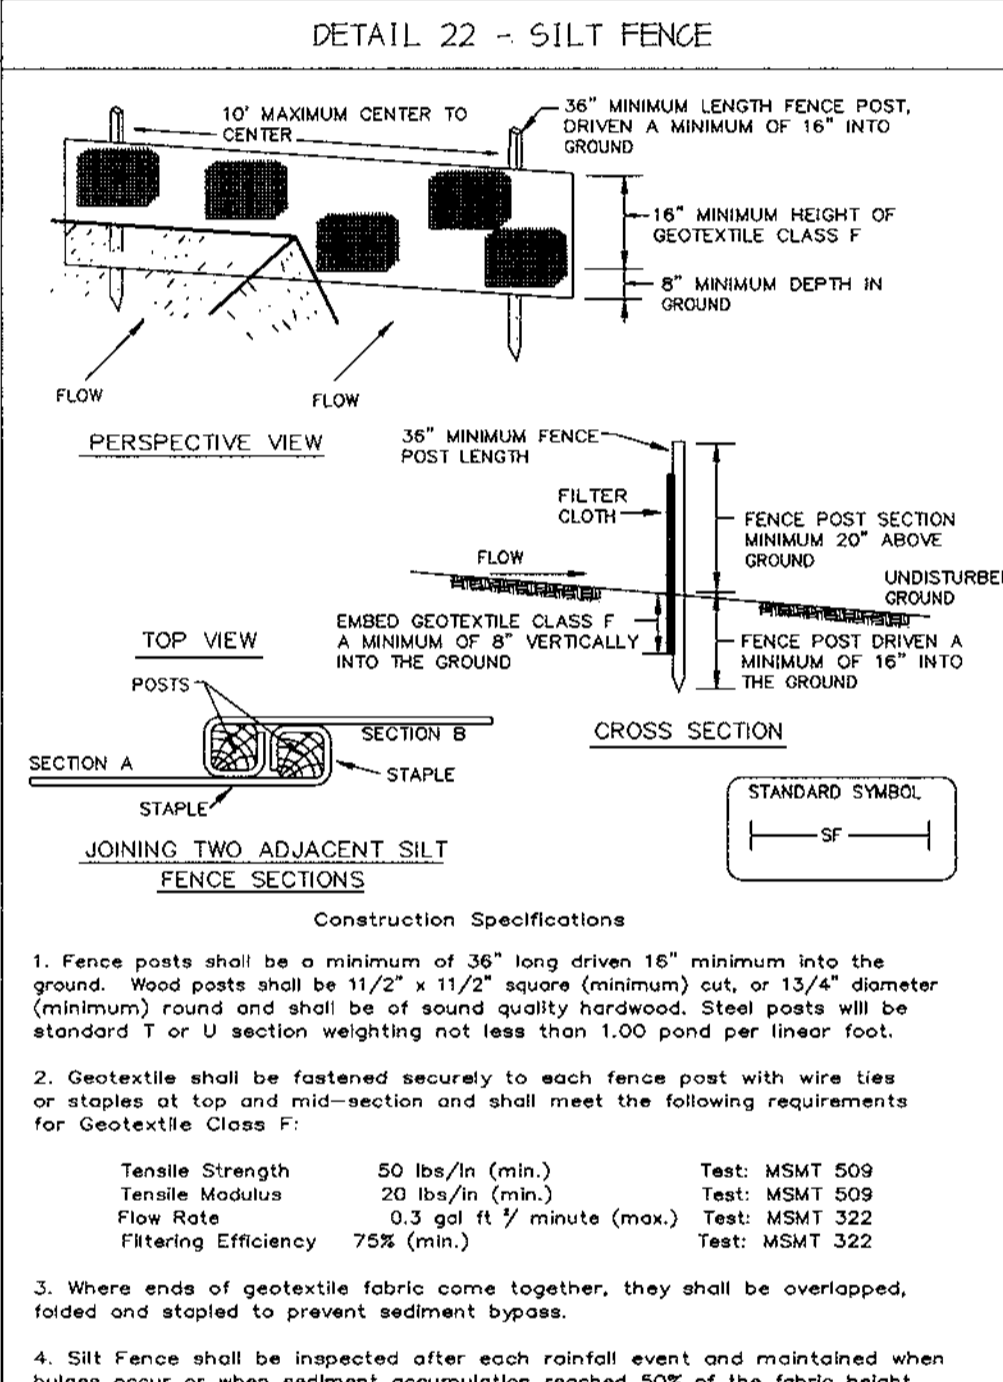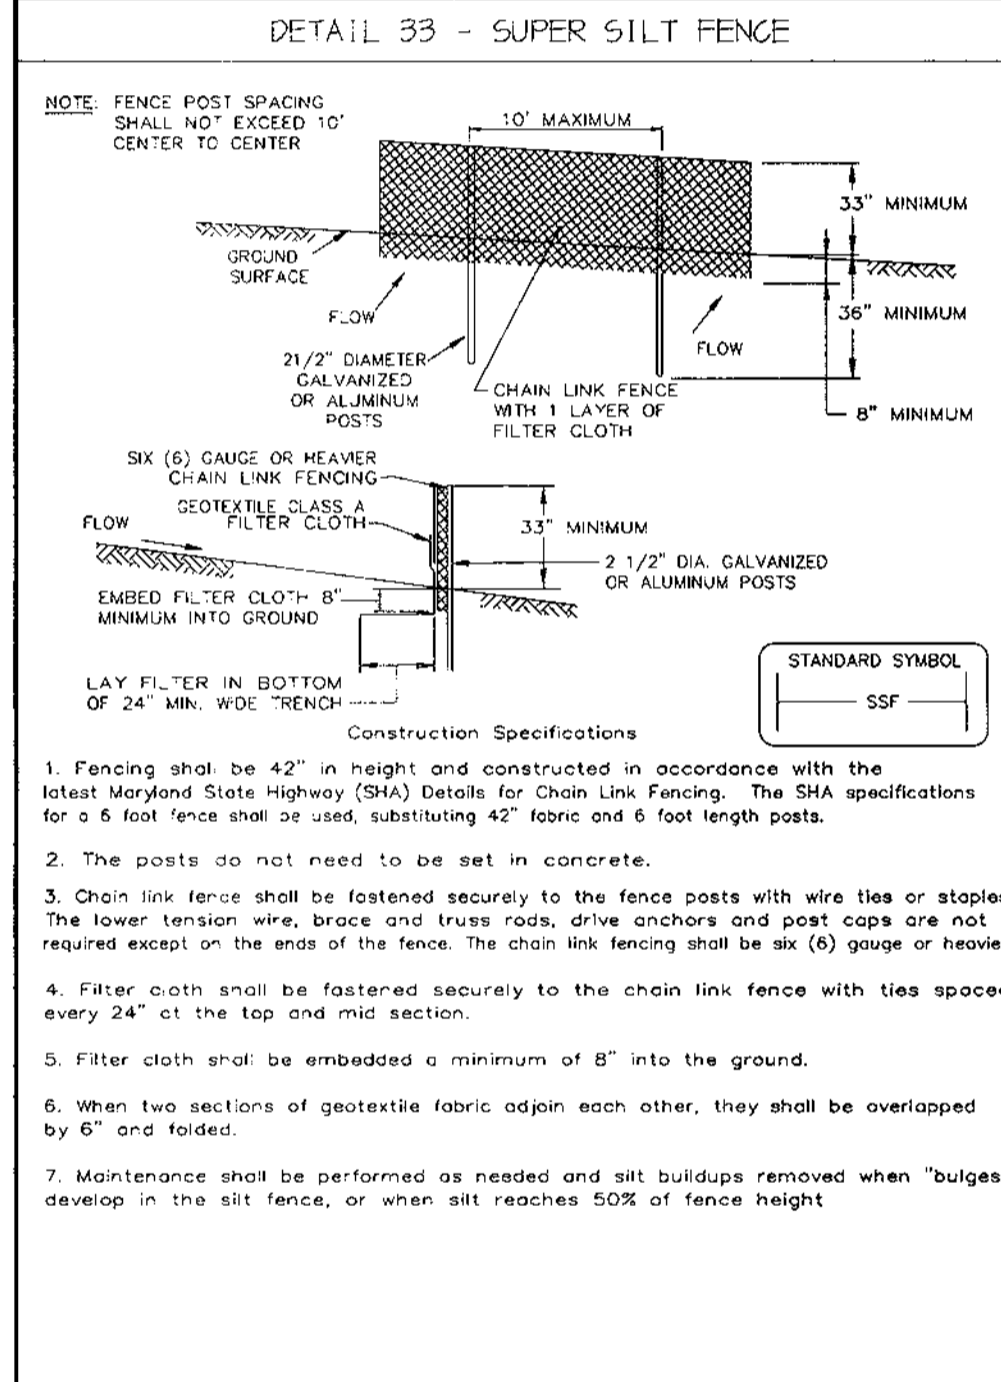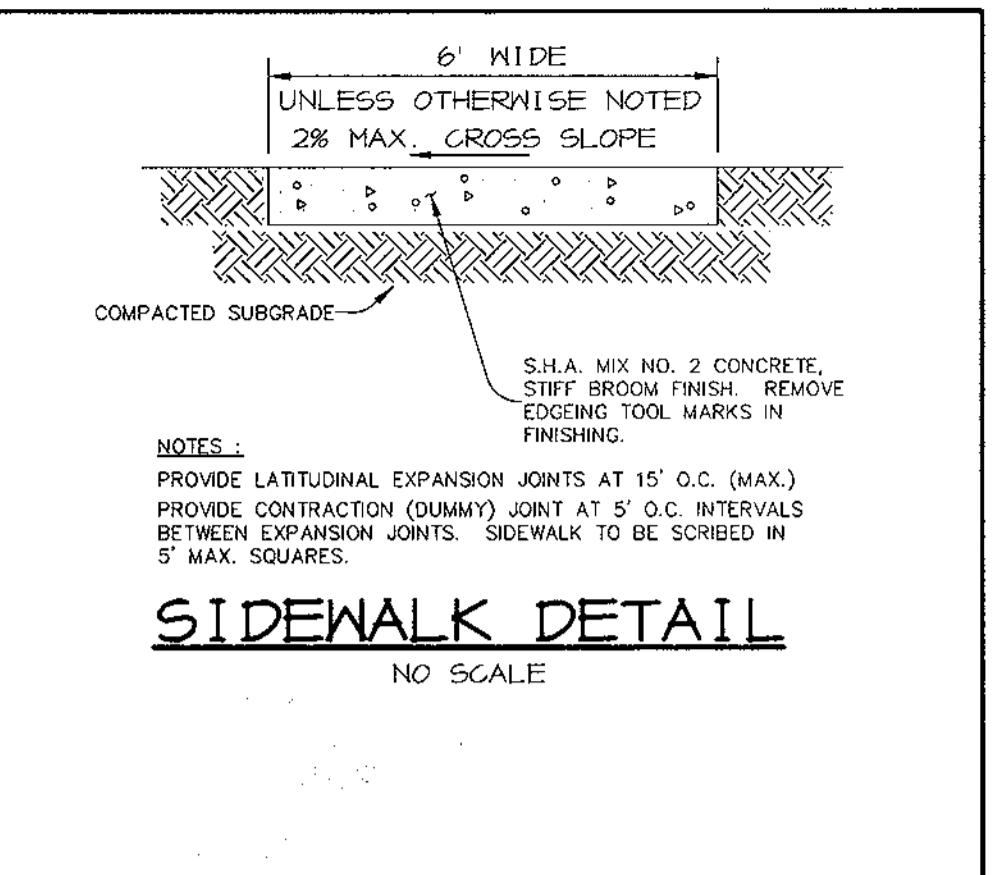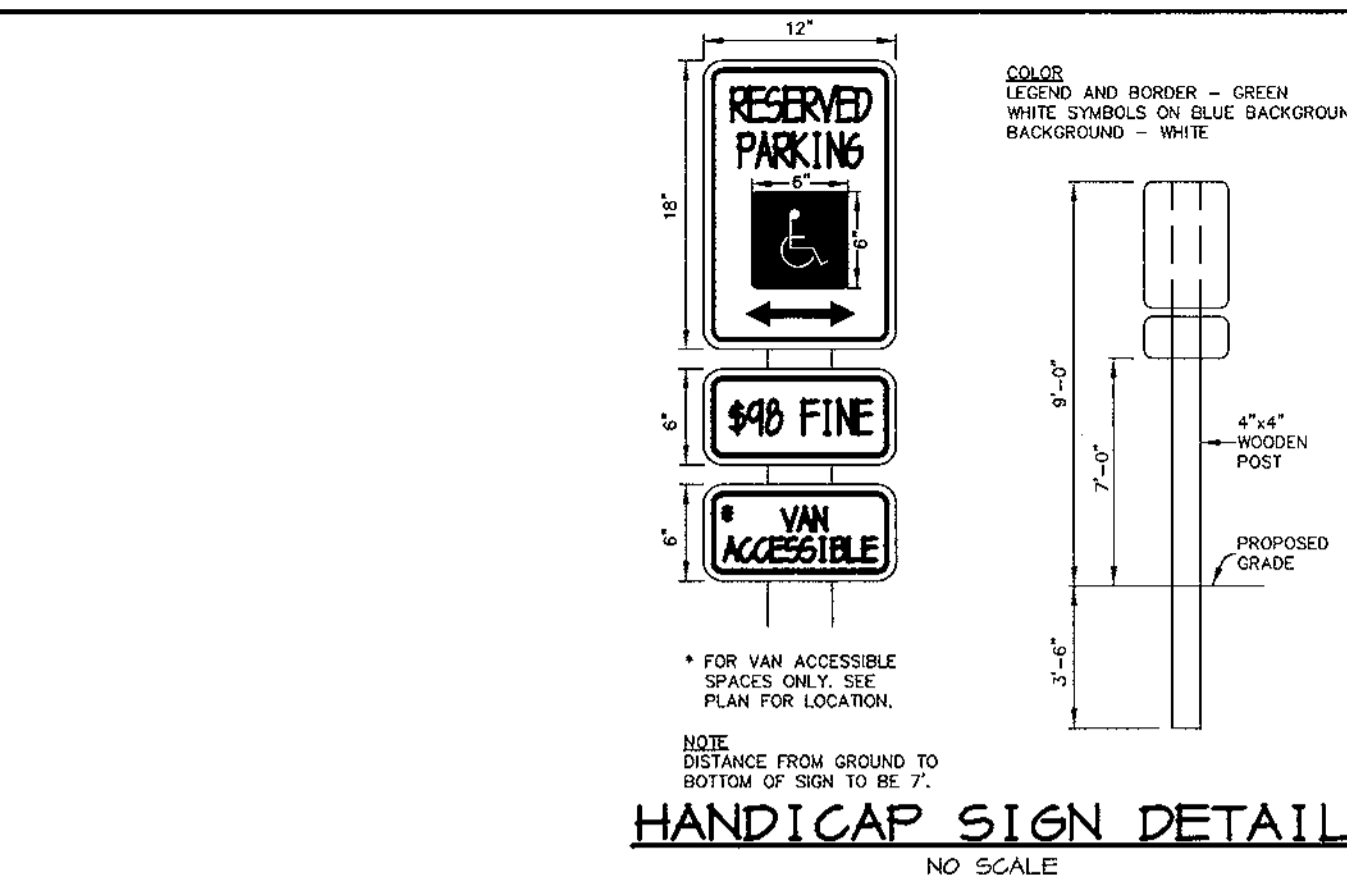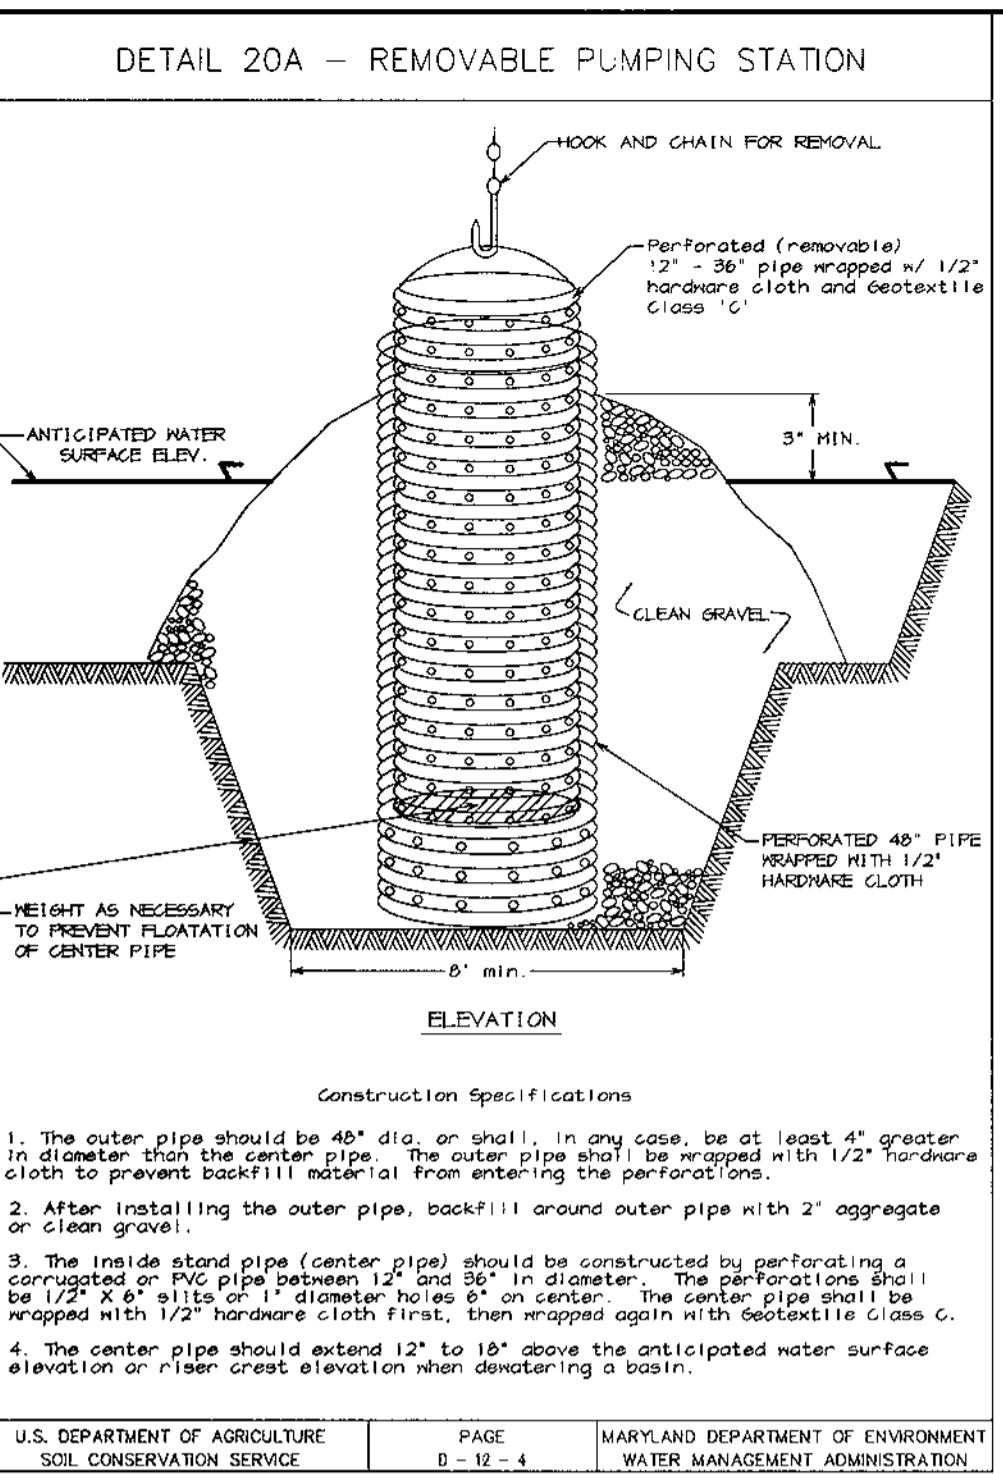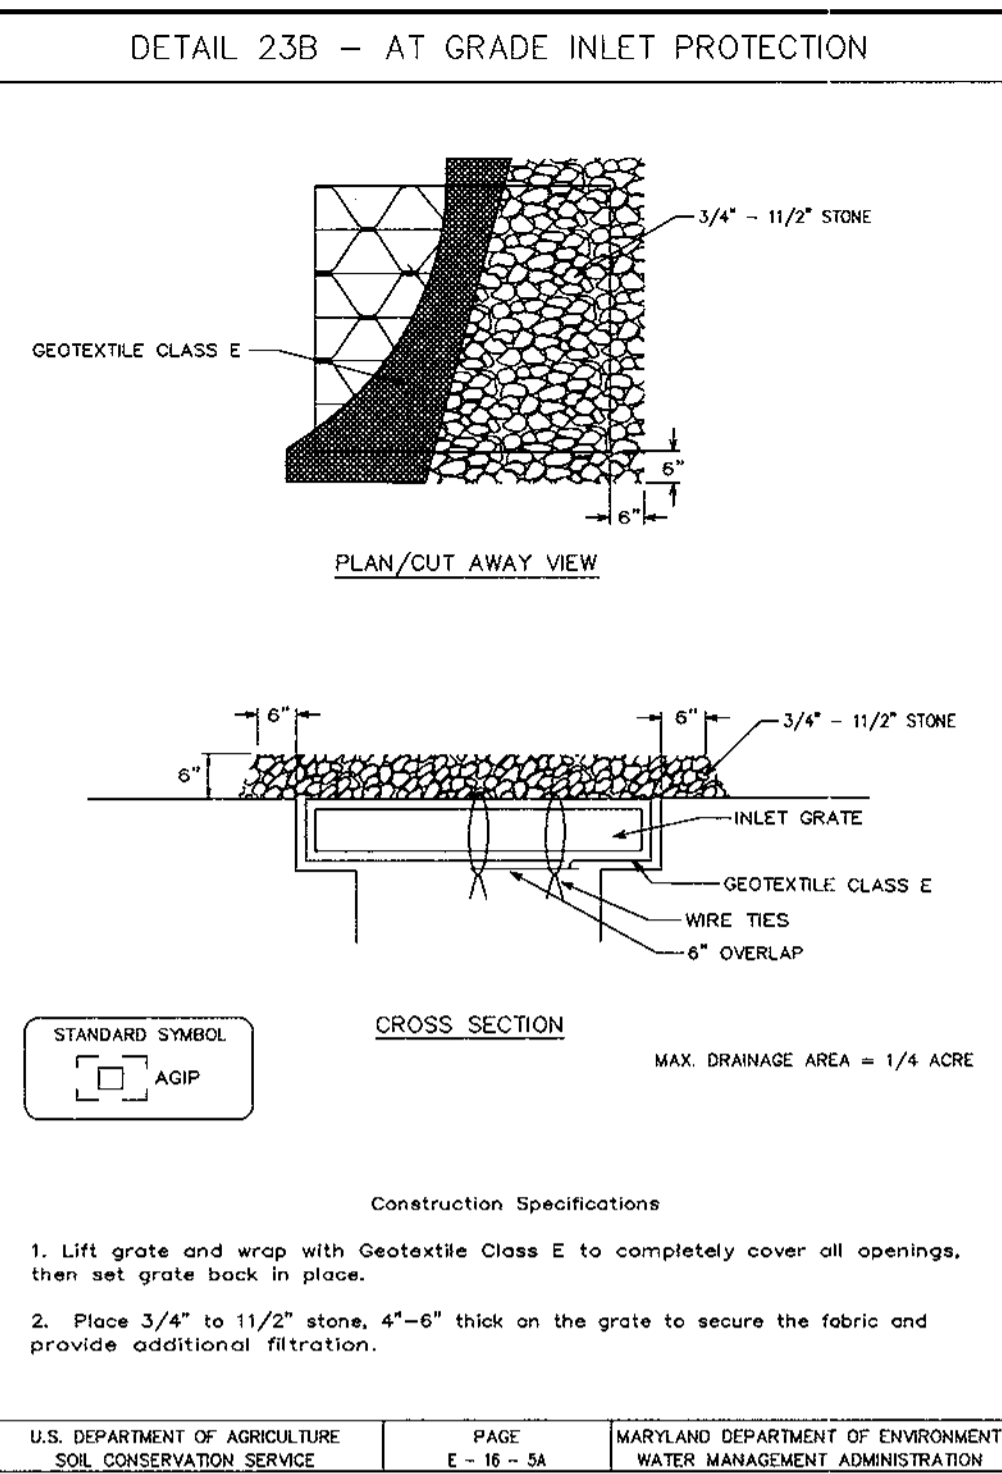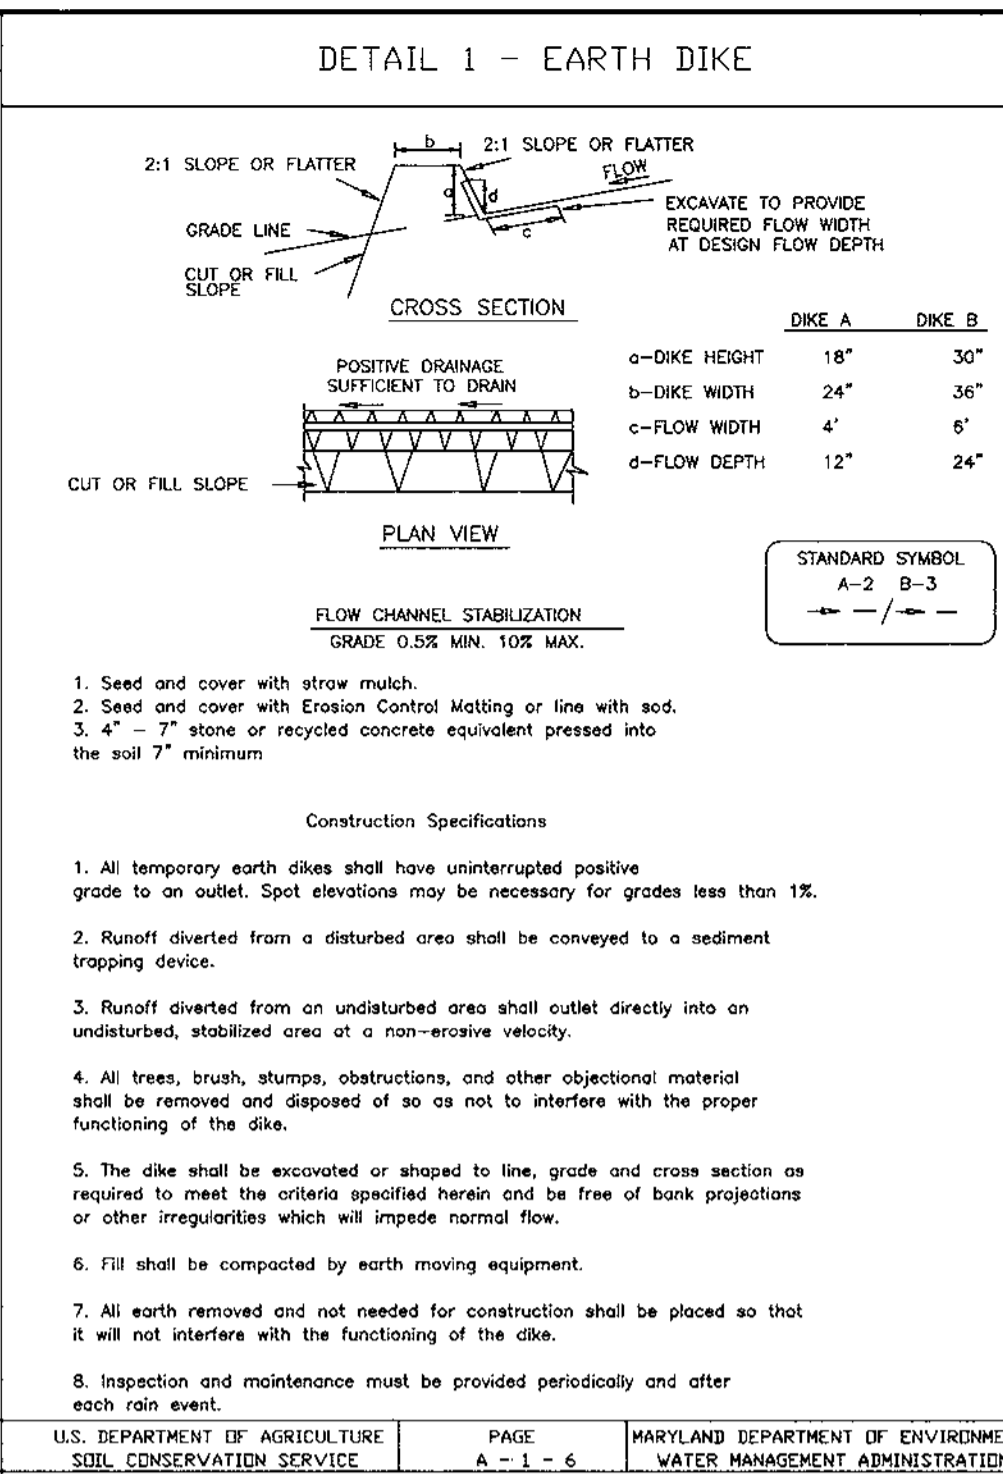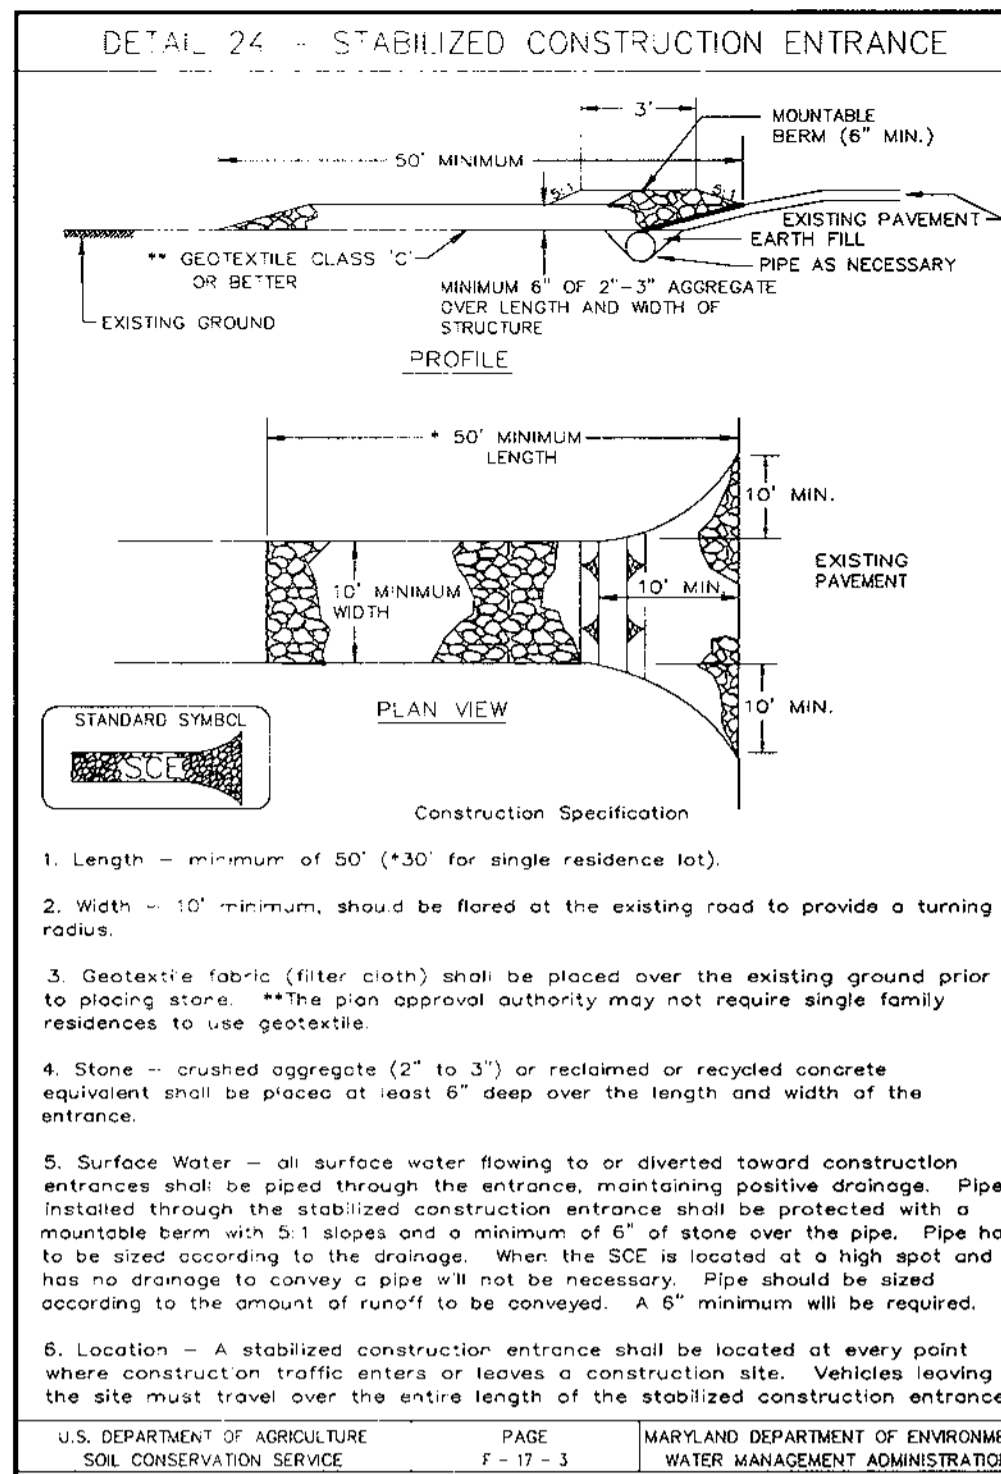

**CONCRETE FLUME AND RIPRAP OUTLET PROTECTION DETAIL**

**CONSTRUCTION SPECIFICATIONS**

NOTE: Q<sub>10</sub> = V<sub>10</sub> DEPTH CALCULATED AT END OF RIPRAP OUTLET CHANNEL.

STRUCTURE	MEAN STONE DIA.	LENGTH (L)	WIDTH (W)	THICKNESS (T)	Q <sub>10</sub>	V	DEPTH
E-1	9.5"	25'	18"	14"	32.71	6.66	1.54

BY THE DEVELOPER:

I/WE CERTIFY THAT ALL DEVELOPMENT AND CONSTRUCTION WILL BE DONE ACCORDING TO THIS PLAN, AND THAT ANY RESPONSIBLE PERSONNEL INVOLVED IN THE CONSTRUCTION PROJECT WILL HAVE A CERTIFICATE OF ATTENDANCE AT A DEPARTMENT OF THE ENVIRONMENT APPROVED TRAINING PROGRAM FOR THE CONTROL OF SEDIMENT AND EROSION BEFORE BEGINNING THE PROJECT. I ALSO AUTHORIZE PERIODIC ON-SITE INSPECTIONS BY THE HOWARD SOIL CONSERVATION DISTRICT.

*Walter Muegge* DEVELOPER DATE 10-11-99

BY THE ENGINEER:

I CERTIFY THAT THIS PLAN FOR EROSION AND SEDIMENT CONTROL REPRESENTS A PRACTICAL AND WORKABLE PLAN BASED ON MY PERSONAL KNOWLEDGE OF THE SITE CONDITIONS AND THAT IT WAS PREPARED IN ACCORDANCE WITH THE REQUIREMENTS OF THE HOWARD SOIL CONSERVATION DISTRICT.

*Arthur E. Muegge* ENGINEER DATE 10-11-99

THESE PLANS HAVE BEEN REVIEWED FOR THE HOWARD SOIL CONSERVATION DISTRICT AND MEET THE TECHNICAL REQUIREMENTS FOR SOIL EROSION AND SEDIMENT CONTROL.

*Cheryl Simons* NATURAL RESOURCES CONSERVATION SERVICE DATE 10/14/99

THIS DEVELOPMENT PLAN IS APPROVED FOR SOIL EROSION AND SEDIMENT CONTROL BY THE HOWARD SOIL CONSERVATION DISTRICT.

*John A. ...* HOWARD SOIL CONSERVATION DISTRICT DATE 10/14/99

APPROVED: HOWARD COUNTY DEPARTMENT OF PLANNING AND ZONING.

*Joseph R. ...* DIRECTOR DATE 10/15/99

*Wanda ...* CHIEF, DEVELOPMENT ENGINEERING DIVISION DATE 10/15/99

*Wanda ...* CHIEF, DIVISION OF LAND DEVELOPMENT DATE 10/15/99

U.S. DEPARTMENT OF AGRICULTURE SOIL CONSERVATION SERVICE PAGE 26-5 MARYLAND DEPARTMENT OF ENVIRONMENT WATER MANAGEMENT ADMINISTRATION

U.S. DEPARTMENT OF AGRICULTURE SOIL CONSERVATION SERVICE PAGE 15-3 MARYLAND DEPARTMENT OF ENVIRONMENT WATER MANAGEMENT ADMINISTRATION


U.S. DEPARTMENT OF AGRICULTURE SOIL CONSERVATION SERVICE PAGE 16-5B MARYLAND DEPARTMENT OF ENVIRONMENT WATER MANAGEMENT ADMINISTRATION

U.S. DEPARTMENT OF AGRICULTURE SOIL CONSERVATION SERVICE PAGE 12-4 MARYLAND DEPARTMENT OF ENVIRONMENT WATER MANAGEMENT ADMINISTRATION

**CONCRETE FLUME AND RIPRAP OUTLET PROTECTION DETAIL**

**CONSTRUCTION SPECIFICATIONS**

- THE SUBGRADE FOR THE FILTER, RIP-RAP, OR GABION SHALL BE PREPARED TO THE REQUIRED LINES AND GRADES. ANY FILL REQUIRED IN THE SUBGRADE SHALL BE COMPACTED TO A DENSITY OF APPROXIMATELY THAT OF THE SURROUNDING UNDISTURBED MATERIAL.
- THE ROCK OR GRAVEL SHALL CONFORM TO THE SPECIFIED GRADING LIMITS WHEN INSTALLED RESPECTIVELY IN THE RIP-RAP OR FILTER.
- GEOTEXTILE CLASS C, OR BETTER SHALL BE PROTECTED FROM PUNCHING, CUTTING, OR TEARING. ANY DAMAGE OTHER THAN AN OCCASIONAL SMALL HOLE SHALL BE REPAIRED BY PLACING ANOTHER PIECE OF GEOTEXTILE FABRIC OVER THE DAMAGED AREA. WHETHER FOR REPAIRS OR FOR JOINING TWO PIECES OF GEOTEXTILE FABRIC SHALL BE A MINIMUM OF ONE FOOT.
- STONE FOR THE RIP-RAP OR GABION OUTLETS MAY BE PLACED BY EQUIPMENT. THEY SHALL BE CONSTRUCTED TO THE FULL COURSE THICKNESS IN ONE OPERATION AND IN SUCH A MANNER AS TO AVOID DISPLACEMENT OF UNDERLYING MATERIALS. THE STONE FOR RIP-RAP OR GABION OUTLETS SHALL BE DELIVERED AND PLACED IN A MANNER THAT WILL ENSURE THAT IT IS REASONABLY HOMOGENEOUS WITH THE SMALLER STONES AND SPALLS FILLING THE VOIDS BETWEEN THE LARGER STONES. RIP-RAP SHALL BE PLACED IN A MANNER TO PREVENT DAMAGE TO THE FILTER BLANKET OR GEOTEXTILE FABRIC. HAND PLACEMENT WILL BE REQUIRED TO THE EXTENT NECESSARY TO PREVENT DAMAGE TO THE PERMANENT WORKS.
- THE STONE SHALL BE PLACED SO THAT IT BLENDS IN WITH THE EXISTING GROUND. IF THE STONE IS PLACED TOO HIGH THEN THE FLOW WILL BE FORCED OUT OF THE CHANNEL AND SCOUR ADJACENT TO THE STONE WILL OCCUR.

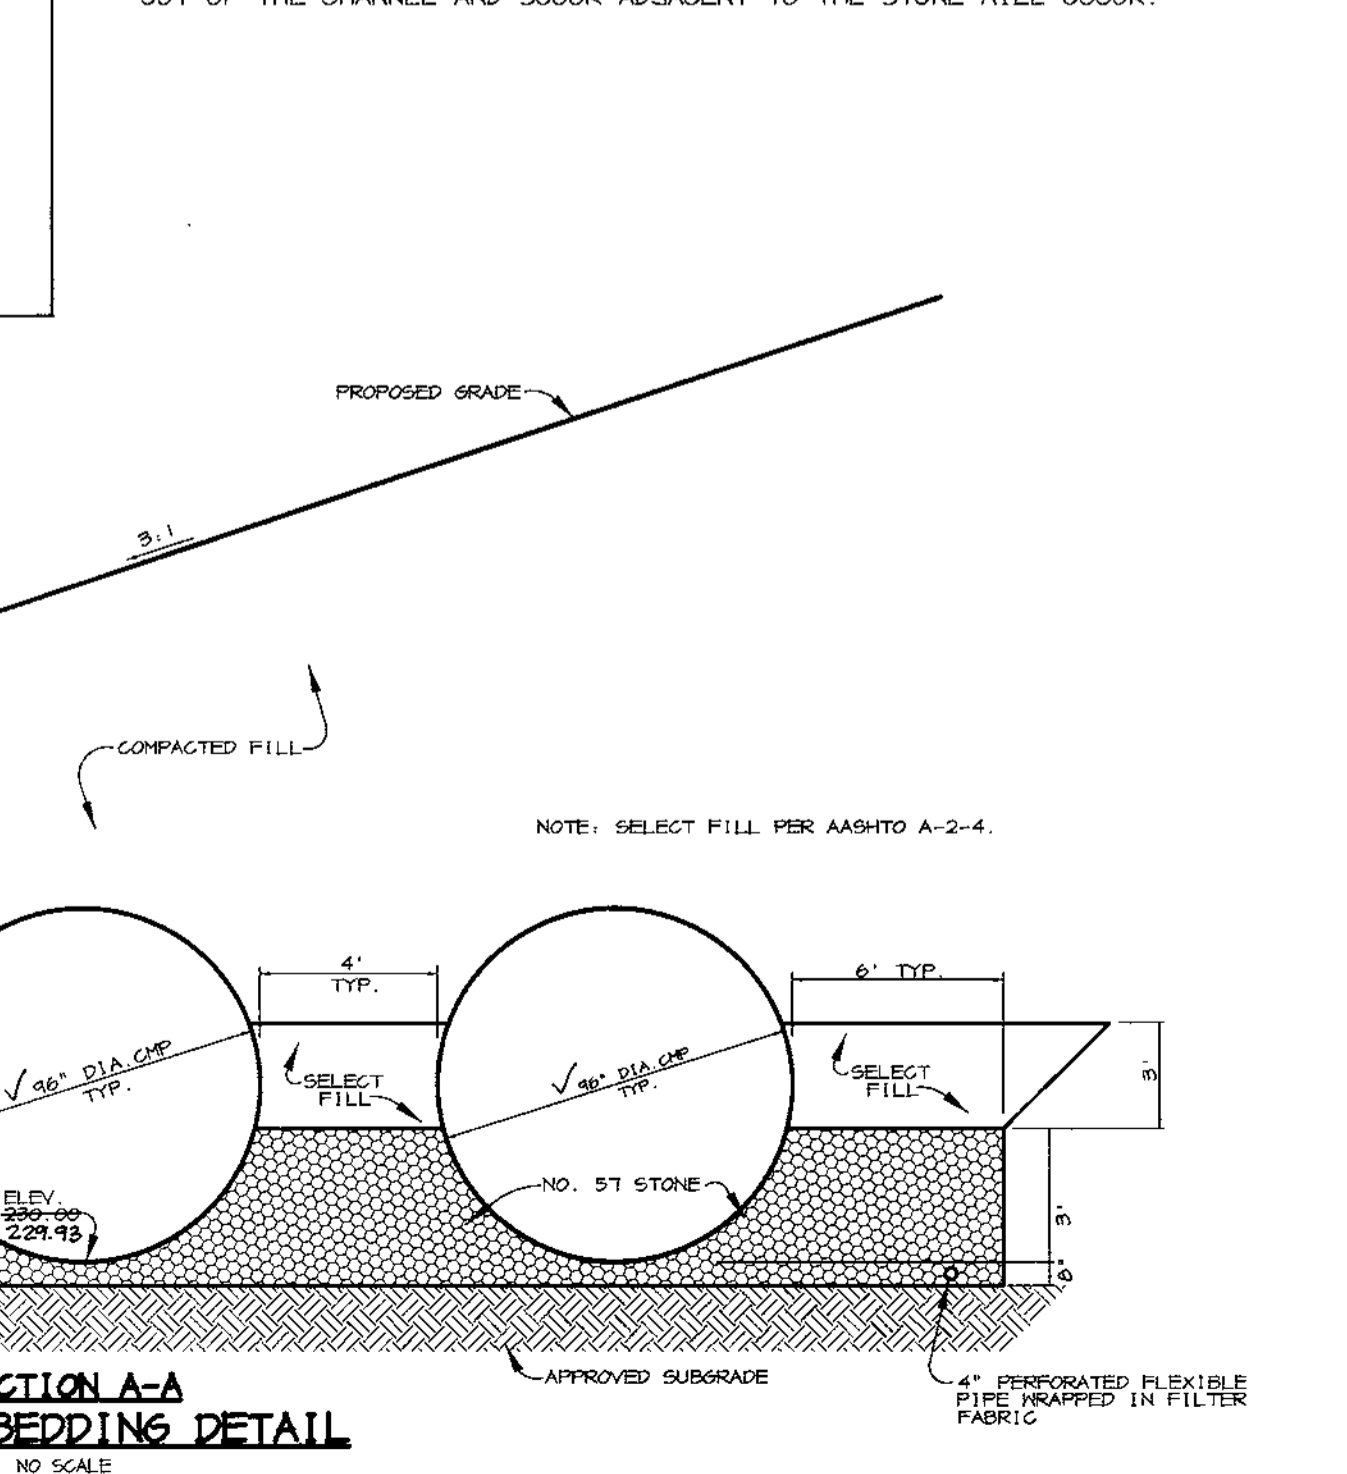

**CONCRETE FLUME AND RIPRAP OUTLET PROTECTION DETAIL**

**CONSTRUCTION SPECIFICATIONS**

- THE SUBGRADE FOR THE FILTER, RIP-RAP, OR GABION SHALL BE PREPARED TO THE REQUIRED LINES AND GRADES. ANY FILL REQUIRED IN THE SUBGRADE SHALL BE COMPACTED TO A DENSITY OF APPROXIMATELY THAT OF THE SURROUNDING UNDISTURBED MATERIAL.
- THE ROCK OR GRAVEL SHALL CONFORM TO THE SPECIFIED GRADING LIMITS WHEN INSTALLED RESPECTIVELY IN THE RIP-RAP OR FILTER.
- GEOTEXTILE CLASS C, OR BETTER SHALL BE PROTECTED FROM PUNCHING, CUTTING, OR TEARING. ANY DAMAGE OTHER THAN AN OCCASIONAL SMALL HOLE SHALL BE REPAIRED BY PLACING ANOTHER PIECE OF GEOTEXTILE FABRIC OVER THE DAMAGED AREA. WHETHER FOR REPAIRS OR FOR JOINING TWO PIECES OF GEOTEXTILE FABRIC SHALL BE A MINIMUM OF ONE FOOT.
- STONE FOR THE RIP-RAP OR GABION OUTLETS MAY BE PLACED BY EQUIPMENT. THEY SHALL BE CONSTRUCTED TO THE FULL COURSE THICKNESS IN ONE OPERATION AND IN SUCH A MANNER AS TO AVOID DISPLACEMENT OF UNDERLYING MATERIALS. THE STONE FOR RIP-RAP OR GABION OUTLETS SHALL BE DELIVERED AND PLACED IN A MANNER THAT WILL ENSURE THAT IT IS REASONABLY HOMOGENEOUS WITH THE SMALLER STONES AND SPALLS FILLING THE VOIDS BETWEEN THE LARGER STONES. RIP-RAP SHALL BE PLACED IN A MANNER TO PREVENT DAMAGE TO THE FILTER BLANKET OR GEOTEXTILE FABRIC. HAND PLACEMENT WILL BE REQUIRED TO THE EXTENT NECESSARY TO PREVENT DAMAGE TO THE PERMANENT WORKS.
- THE STONE SHALL BE PLACED SO THAT IT BLENDS IN WITH THE EXISTING GROUND. IF THE STONE IS PLACED TOO HIGH THEN THE FLOW WILL BE FORCED OUT OF THE CHANNEL AND SCOUR ADJACENT TO THE STONE WILL OCCUR.

OWNER/DEVELOPER

PROLOGIS DEVELOPMENT SERVICES INCORPORATED  
5200 EISENHOWER AVENUE, SECOND FLOOR  
ALEXANDRIA, VIRGINIA 22304  
(703)751-9292

PROJECT MEADOWRIDGE BUSINESS PARK  
PARCEL G-2  
2 WAREHOUSE BUILDINGS

AREA TAX MAP NO. 37 ZONED M-1 PARCEL G-2  
1ST ELECTION DISTRICT  
HOWARD COUNTY, MARYLAND

TITLE DETAILS & NOTES

RIEMER MUEGGE & ASSOCIATES INC  
ENGINEERING • ENVIRONMENTAL SERVICES • PLANNING • SURVEYING  
8818 Centre Park Drive, Columbia, MD 21045  
tel 410.987.8900 fax 410.987.9282


DATE DESIGNED BY: CJR  
DRAWN BY: DAM  
PROJECT NO.: 97320/PARCEL\_G SDP-99.DWG  
DATE: OCTOBER 11, 1999  
SCALE: 1" = 50'  
DRAWING NO.: 10 OF 25

ARTHUR E. MUEGGE #8707




GRID NORTH

INTERSTATE ROUTE 95  
STATE HIGHWAY  
PRINCIPAL ARTERIAL

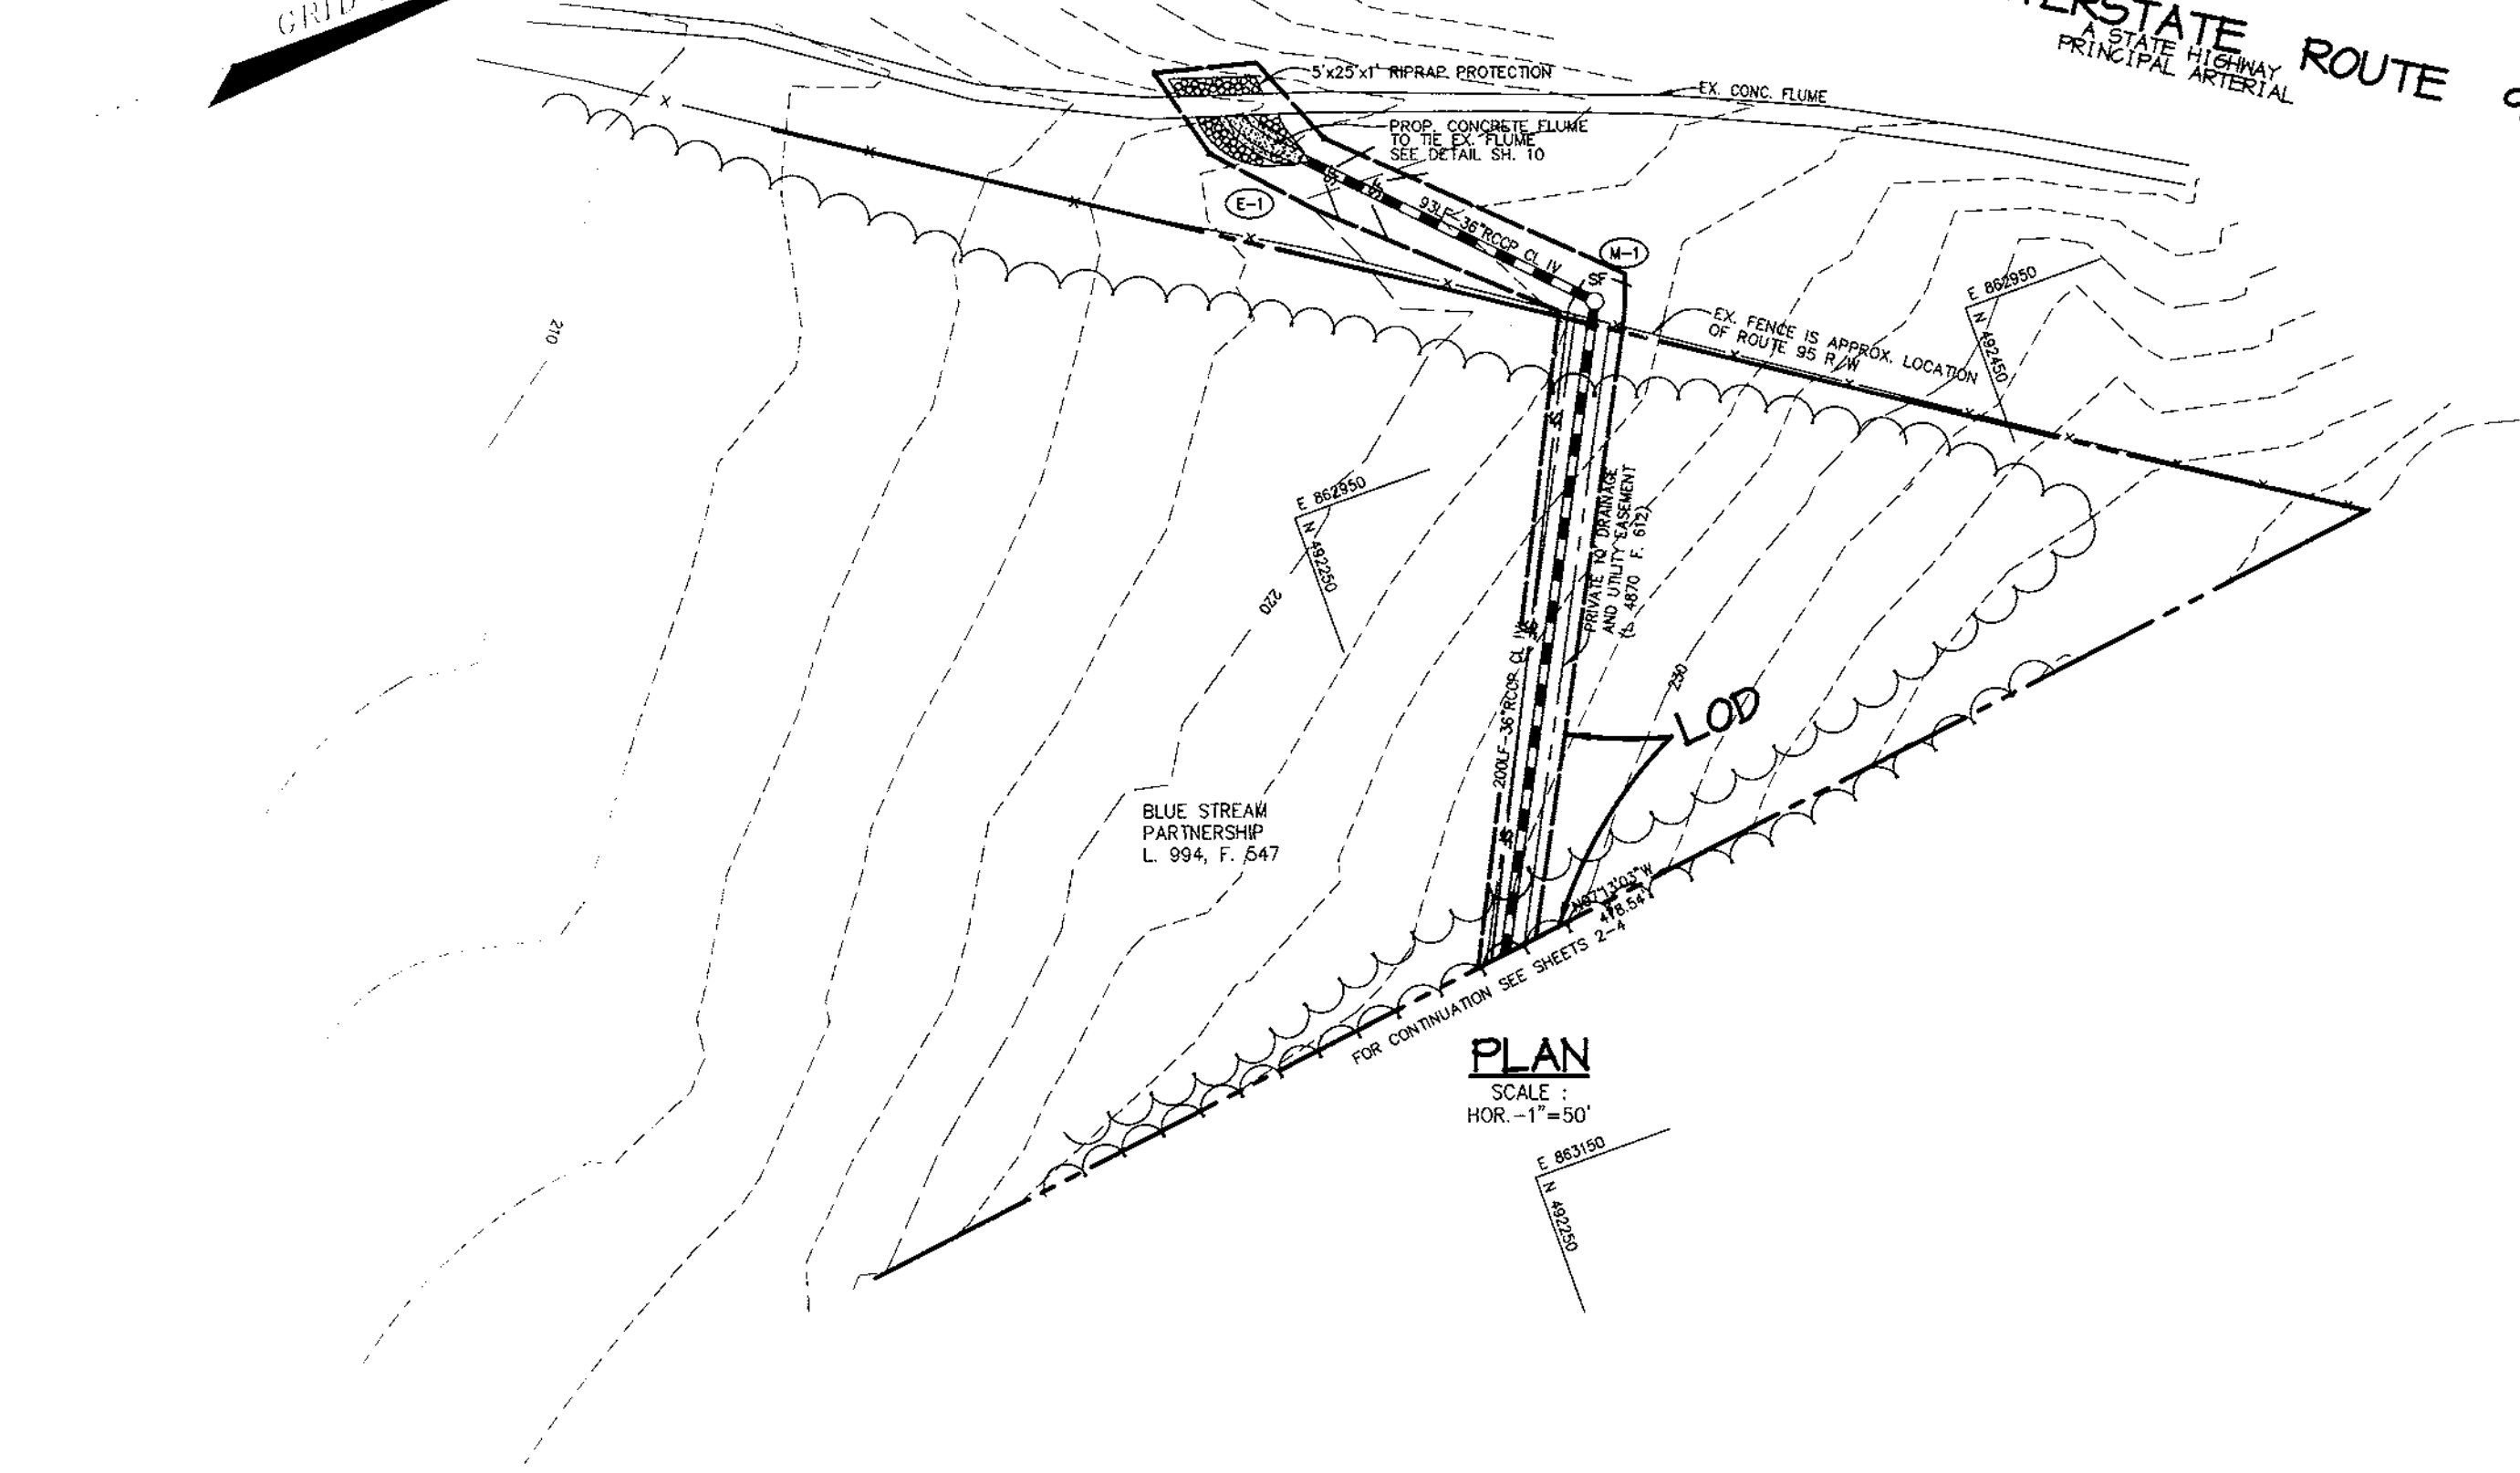


PLAN  
SCALE:  
HOR. - 1" = 50'

- NOTES:
1. SEE GEOMETRY PLAN (THIS SHEET) FOR LOCATION OF BENDS AND MANIFOLDS.
  2. GIVEN PIPE LENGTHS DO NOT INCLUDE THE MANIFOLDS AT EACH END.

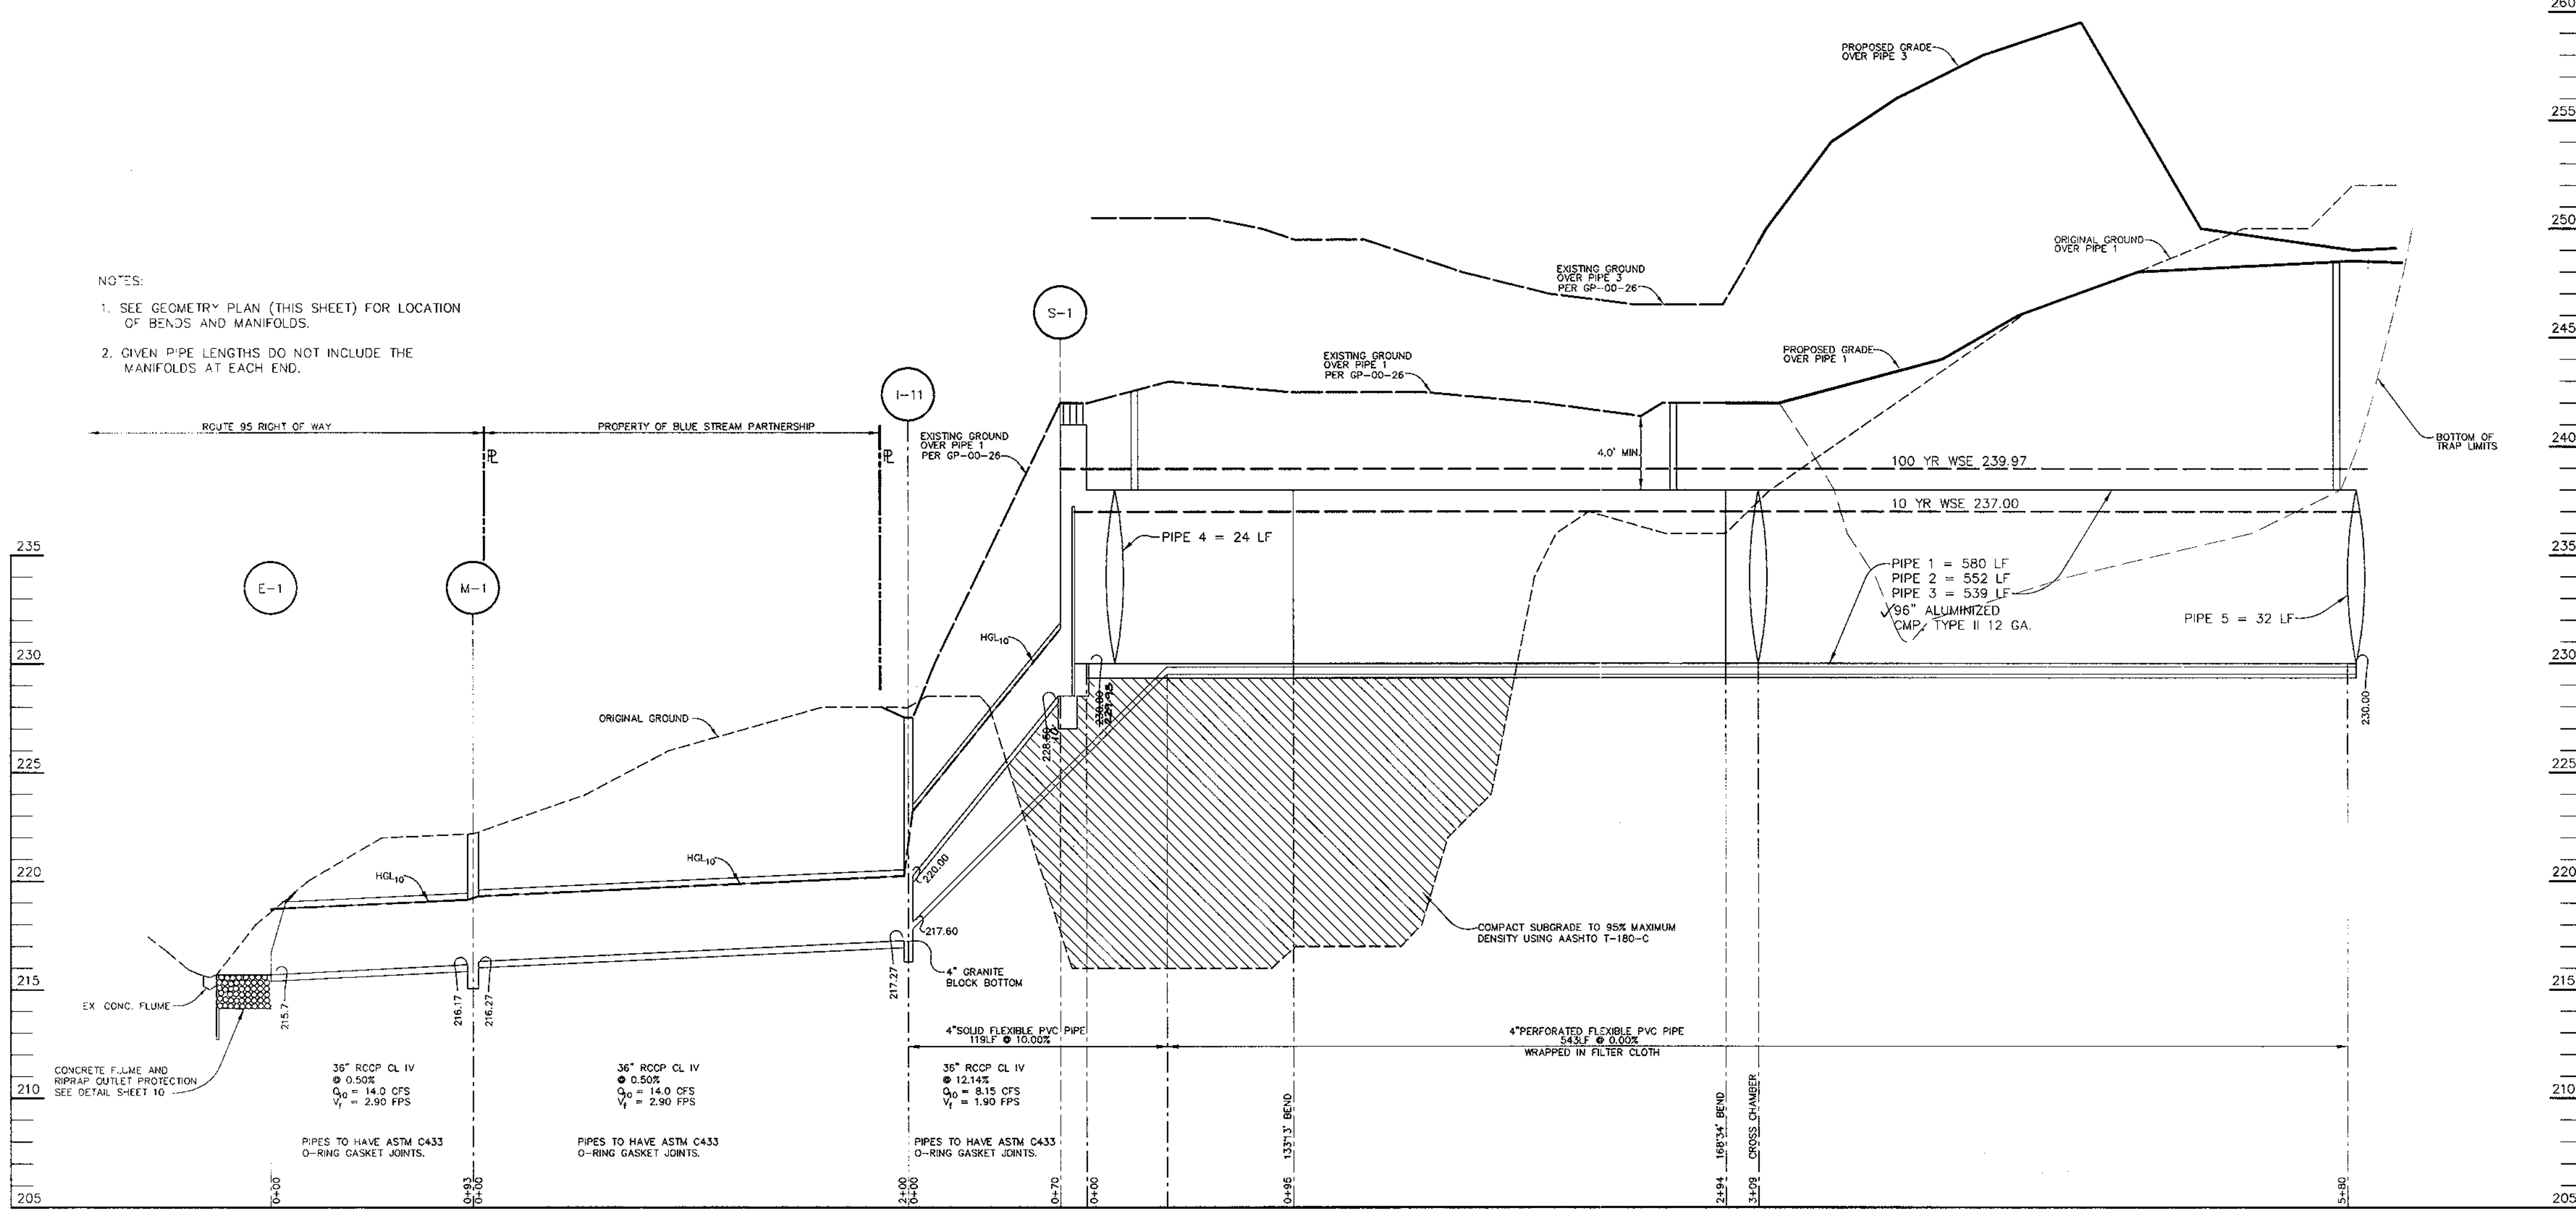

PROFILE THRU PRINCIPAL SPILLWAY  
SCALE:  
HOR. - 1" = 50'  
VERT. - 1" = 5'

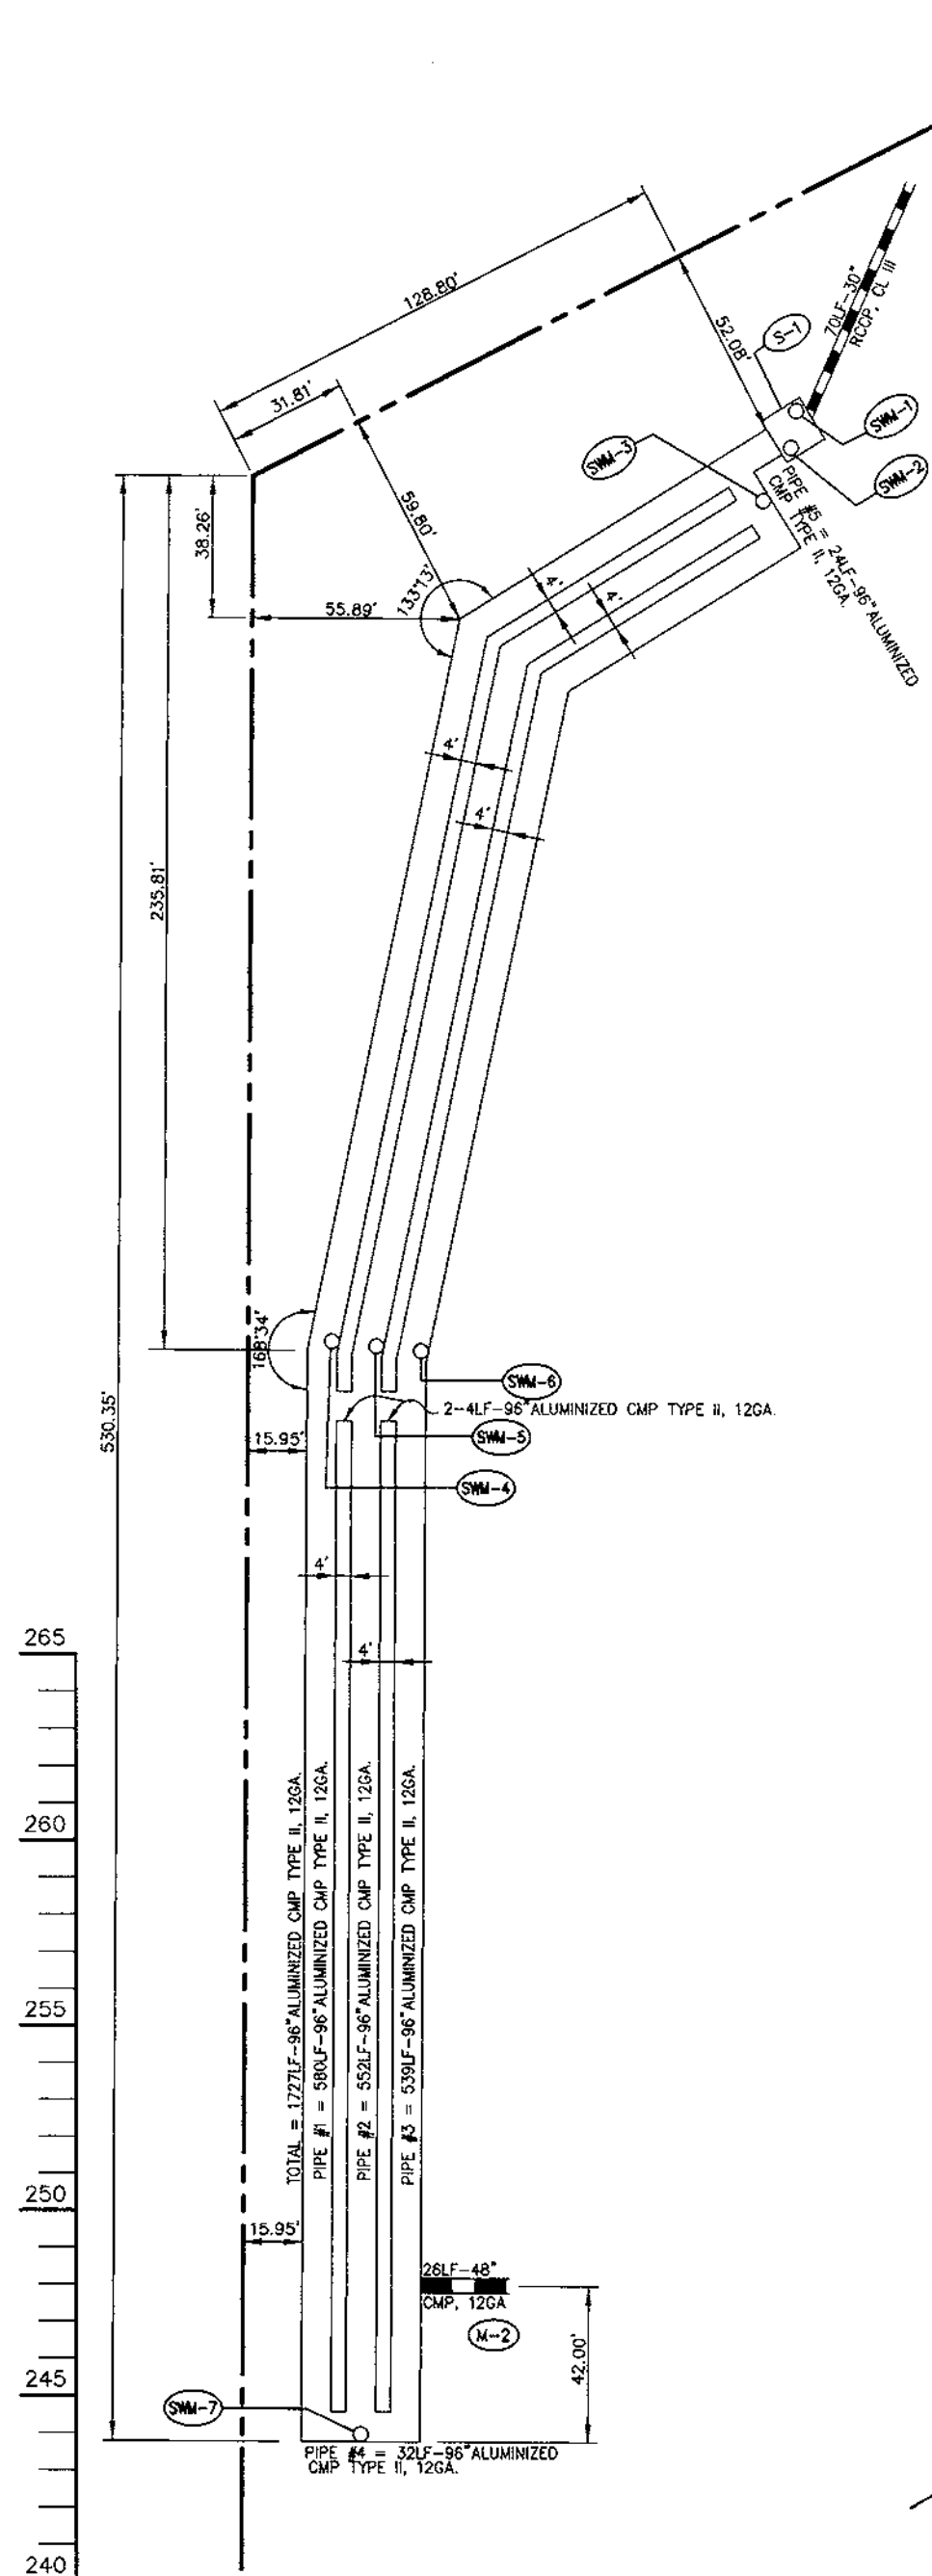

SWMF#1 GEOMETRY PLAN  
SCALE: 1" = 50'

AS-BUILT CERTIFICATE

*Christopher J. Reid*  
CHRISTOPHER J. REID # 19949  
DATE 2-13-01

BY THE DEVELOPER :

I/WE CERTIFY THAT ALL DEVELOPMENT AND CONSTRUCTION WILL BE DONE ACCORDING TO THIS PLAN, AND THAT ANY RESPONSIBLE PERSONNEL INVOLVED IN THE CONSTRUCTION PROJECT WILL HAVE A CERTIFICATE OF ATTENDANCE AT A DEPARTMENT OF THE ENVIRONMENT APPROVED TRAINING PROGRAM FOR THE CONTROL OF SEDIMENT AND EROSION BEFORE BEGINNING THE PROJECT. I ALSO AUTHORIZE PERIODIC ON-SITE INSPECTIONS BY THE HOWARD SOIL CONSERVATION DISTRICT.

*Joseph Pletty*  
DEVELOPER 10-11-99  
DATE

BY THE ENGINEER :

I CERTIFY THAT THIS PLAN FOR EROSION AND SEDIMENT CONTROL REPRESENTS A PRACTICAL AND WORKABLE PLAN BASED ON MY PERSONAL KNOWLEDGE OF THE SITE CONDITIONS AND THAT IT WAS PREPARED IN ACCORDANCE WITH THE REQUIREMENTS OF THE HOWARD SOIL CONSERVATION DISTRICT.

*Arthur E. Muegge*  
ENGINEER 10-11-99  
DATE

THESE PLANS HAVE BEEN REVIEWED FOR THE HOWARD SOIL CONSERVATION DISTRICT AND MEET THE TECHNICAL REQUIREMENTS FOR SOIL EROSION AND SEDIMENT CONTROL.

*Carol Samuels*  
NATURAL RESOURCES CONSERVATION SERVICE 10/16/99  
DATE

THIS DEVELOPMENT PLAN IS APPROVED FOR SOIL EROSION AND SEDIMENT CONTROL BY THE HOWARD SOIL CONSERVATION DISTRICT.

*John A. ...*  
HOWARD SOIL CONSERVATION DISTRICT 10/19/99  
DATE

APPROVED : HOWARD COUNTY DEPARTMENT OF PLANNING AND ZONING.

*Joseph ...*  
DIRECTOR 10/19/99  
DATE

*...*  
CHIEF, DEVELOPMENT ENGINEERING DIVISION 10/15/99  
DATE

*...*  
CHIEF, DIVISION OF LAND DEVELOPMENT 10/15/99  
DATE

DATE	NO.	REVISION

OWNER/DEVELOPER

PROLOGIS DEVELOPMENT SERVICES INCORPORATED  
5200 EISENHOWER AVENUE, SECOND FLOOR  
ALEXANDRIA, VIRGINIA 22304  
(703)751-9292

PROJECT MEADOWRIDGE BUSINESS PARK  
PARCEL G-2  
2 WAREHOUSE BUILDINGS

AREA TAX MAP NO. 37 ZONED M-1 PARCEL G-2  
1st ELECTION DISTRICT  
HOWARD COUNTY, MARYLAND


TITLE STORMWATER MANAGEMENT  
DETAILS & NOTES

RIEMER MUEGGE & ASSOCIATES INC  
ENGINEERING • ENVIRONMENTAL SERVICES • PLANNING • SURVEYING  
8818 Centre Park Drive, Columbia, MD 21045  
tel 410.997.8900 fax 410.997.9282

DESIGNED BY : CJR  
DRAWN BY : DAM  
PROJECT NO : 97320/PARCEL\_G  
SDF10.DWG  
DATE : OCTOBER 11, 1999  
SCALE : 1" = 50'  
DRAWING NO. 11 OF 25


MA 197300/PARCEL\_G/SDF10.DWG Thu Oct 07 10:39:01 1999 RIEMER MUEGGE & ASSOCIATES, INC.



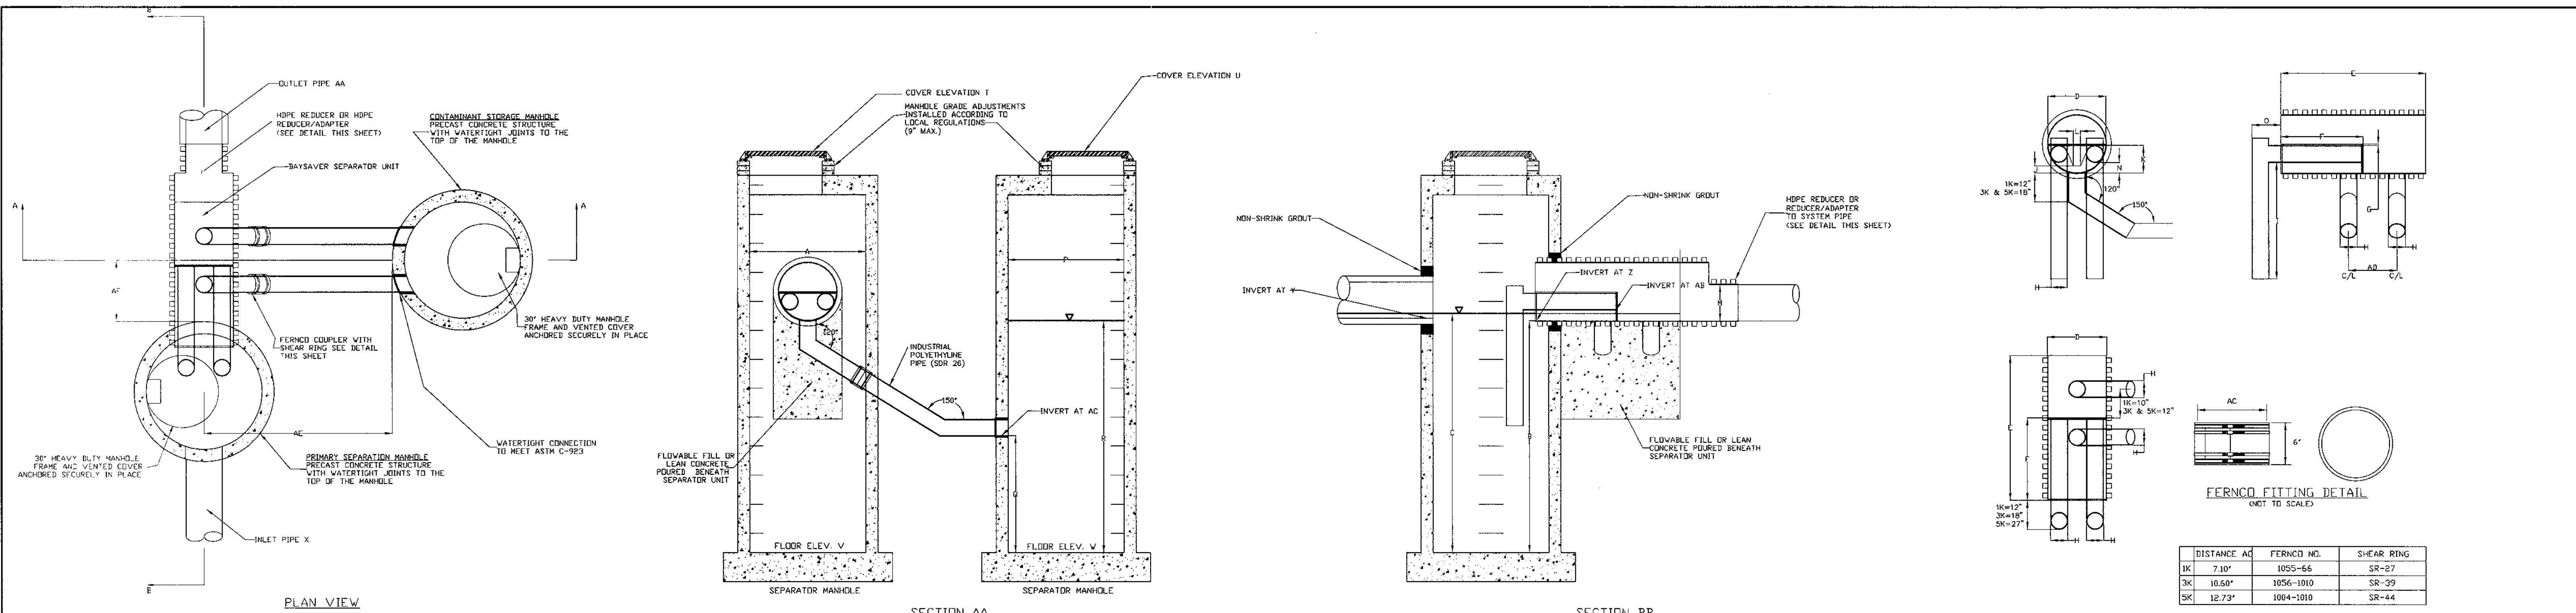


DISTANCE AC	FERNO NO.	SHEAR RING
1K	710'	1055-66 SR-27
3K	10.60'	1056-1010 SR-39
5K	12.73'	1004-1010 SR-44

**HDPE-HDPE REDUCER DETAIL**

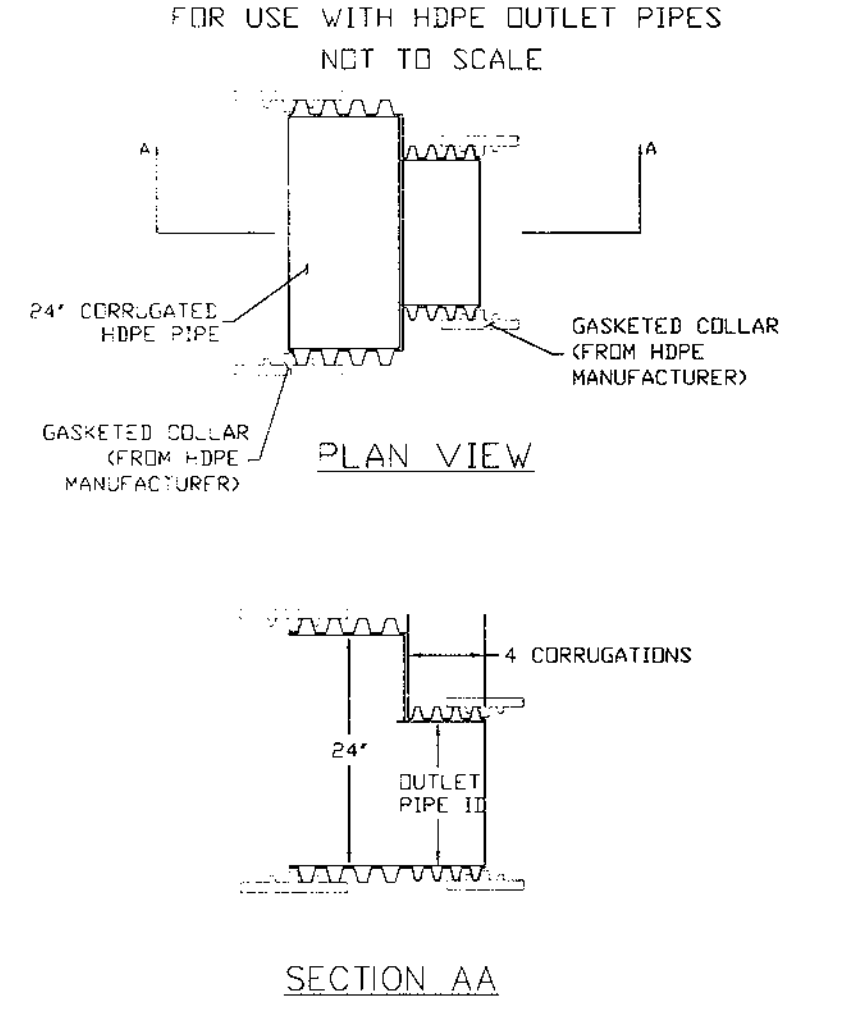

**REDUCER/ADAPTER DETAIL**

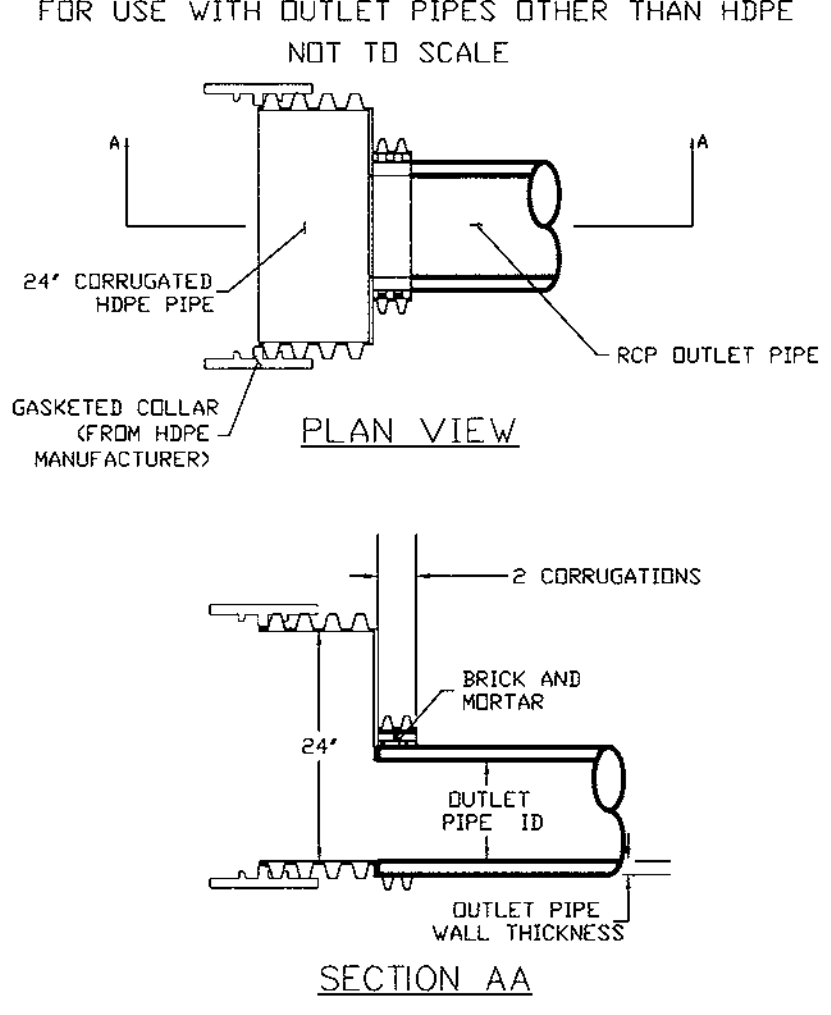

**SEQUENCE OF CONSTRUCTION AND INSPECTOR'S CHECK-OFF LIST FOR DUAL MANHOLE SEPARATORS**

Stage (X = Approval Required)	Developer's/Engineer Approval		Inspector		Geotechnical Engineer	
	Initials	Date	Initials	Date	Initials	Date
1. Pre-Construction Meeting.	X		X		X	
2. Install Manholes and associated storm drainage. a. Obtain approval of subgrade from Geotechnical Engineer. (Subgrade to have a minimum of 95% compaction)					X	
b. Installation of precast base, lower tank and lower piping.	X		X			
c. Backfill and min. 95% compaction around lower tank and lower piping.					X	
d. Installation of precast middle section(s) with separator unit and remaining piping.	X		X			
e. Installation of precast top slab.	X		X			
f. Installation of adjustment rings and frame and cover.	X		X			
g. Installation of flowable fill or concrete backfill.					X	
3. Backfilling operation and compaction.					X	
4. Site is permanently stabilized. Sediment control measures removed and all sediment and debris removed from dual manhole separators.			X			
5. Final inspection.			X			

**GENERAL CONSTRUCTION NOTES**

- ALL WORK MUST BE DONE WITH REGARD FOR THE SAFETY OF THE CONSTRUCTION CREW.
- ALL WORK AND MATERIALS MUST COMPLY WITH APPLICABLE STATE AND LOCAL REGULATIONS.
- KNOW THE LOCATION AND DEPTH OF ANY UNDERGROUND UTILITIES BEFORE EXCAVATION BEGINS.

**NOTE:**  
BAYSAVERS ARE TO BE INSTALLED WITH THE STORM DRAIN SYSTEM AND WILL FUNCTION AS SECONDARY SEDIMENT CONTROL DEVICES. UPON COMPLETION OF SITE STABILIZATION, EACH BAYSAYER SYSTEM SHALL BE FLUSHED CLEAN & THE MANHOLES CLEANED OUT AND REFILLED WITH CLEAN WATER.

**NOTE:** DIMENSIONAL SHOP DRAWINGS ARE TO BE APPROVED BY THE DESIGN ENGINEER

**BAYSAYER MAINTENANCE**

- BAYSAYER SYSTEMS MUST BE INSPECTED AND MAINTAINED PERIODICALLY. INSPECTION IS MADE BY CHECKING THE DEPTH OF SEDIMENT IN EACH MANHOLE WITH A GRADE STICK OR SIMILAR DEVICE. MAINTENANCE IS REQUIRED WHEN THE SEDIMENT DEPTH IN EITHER MANHOLE EXCEEDS 2 FEET. MINIMUM INSPECTION IS REQUIRED TWICE A YEAR TO MAINTAIN OPERATION AND FUNCTION OF BAYSAYER.
- MAINTENANCE CONSISTS OF THE FOLLOWING:
- CONTAMINANT STORAGE MANHOLE**
    - REMOVE THE ENTIRE VOLUME OF THE CONTAMINATED WATER BY VACUUM TRUCK.
    - CLEAN THE MANHOLE WALLS AND FLUSH OUT THE MANHOLE USING A HIGH PRESSURE HOSE AND REMOVE FLUSHING WATER BY VACUUM TRUCK. MAKE CERTAIN MANHOLE IS CLEAN.
  - PRIMARY SEPARATION MANHOLE**
    - USING A SUBMERSIBLE PUMP, PUMP THE CLEAN WATER FROM THE CENTER OF THE MANHOLE DIRECTLY INTO THE EMPTY STORAGE MANHOLE UNTIL THE WATER LEVEL FALLS TO 1 FOOT ABOVE THE SEDIMENT LAYER.
    - REMOVE THE SETTLED SEDIMENT AND REMAINING WATER BY VACUUM TRUCK.
    - CLEAN THE MANHOLE WALLS AND FLUSH OUT THE MANHOLE USING A HIGH PRESSURE HOSE AND REMOVE FLUSHING WATER BY VACUUM TRUCK. MAKE CERTAIN MANHOLE IS CLEAN.
    - CONTAMINATED MATERIAL REMOVED FROM THE MANHOLES MUST BE DISPOSED OF RESPONSIBLY AND LEGALLY BY THE OPERATOR OF THE VACUUM TRUCK.

**BAYSAYER INSTALLATION INSTRUCTIONS**

- EXCAVATION MUST PROVIDE ADEQUATE SPACE TO CONNECT INLET AND OUTLET PIPES TO SEPARATOR MANHOLE AND BAYSAYER UNIT. INSTALL PRECAST DROP STRUCTURES ON SOLID GROUND AS VERIFIED BY A GEOTECHNICAL ENGINEER.
- VERIFY THE SUBGRADE ELEVATION AGAINST THE MANHOLE DIMENSIONS AND CONNECTING STORM DRAIN INVERTS.
- MAKING SURE THE BASES ARE LEVEL AND THE STORAGE MANHOLE OPENINGS ARE ALIGNED WITH THE SEPARATOR UNIT. INSTALL RUBBER GASKETS ON BASE UNITS AND COAT WITH LUBRICATING GREASE. INSTALL ADDITIONAL MANHOLE SECTIONS AS REQUIRED. SEAL LIFT HOLES WITH NON-SHRINK GROUT.
- BACKFILL BASE SECTIONS OF MANHOLES TO INVERT OF STORAGE MANHOLE CONNECTING PIPES. USING APPROVED BACKFILL MATERIAL, BACKFILL AND COMPACT IN 8 INCH LIFTS. BACKFILL AND COMPACT SHOULD BE MONITORED BY A GEOTECHNICAL ENGINEER.
- INSTALL BAYSAYER SEPARATOR UNIT AND CONNECTING PIPES. SEAL ALL CONNECTING JOINTS AND INSTALL SEPARATOR UNIT/STORM DRAIN JOINT EXCESS LENGTH OFF CONNECTING PIPES INSIDE STORAGE MANHOLE.
- BACKFILL SEPARATOR UNIT AND CONNECTING AREAS NOT ACCESSIBLE TO COMPACTOR EQUIPMENT MUST BE BACKFILLED WITH LEAN CONCRETE OR FLOWABLE FILL.
- INSTALL AND SET MANHOLE COVER GRADE ADJUSTMENT RINGS AS NECESSARY.
- INSTALL AND SET MANHOLE FRAME AND COVER UNITS.

**BAYSAYER SYSTEM DIMENSIONS**

DESCRIPTION	SEPARATOR MANHOLE DIMENSIONS		
	1K SYSTEM	3K SYSTEM	5K SYSTEM
A PRIMARY MANHOLE DIAMETER	48"	60"	96"
B MANHOLE DEPTH BELOW INLET	8' - 0"	8' - 0"	8' - 0"
C MINIMUM FLUID DEPTH	8' - 3"	8' - 4 1/2"	8' - 6"
STANDARD SEPARATOR UNIT DIMENSIONS			
D SEPARATOR UNIT ID	24"	36"	48"
E SEPARATOR UNIT LENGTH	69"	80.2"	78"
F BYPASS PLATE LENGTH	34"	45"	45"
G WEIR/BYPASS PLATE THICKNESS	3/4"	3/4"	3/4"
H ELBOW AND CONNECTING PIPE OD	7.25"	10.75"	12.75"
I ELBOW LENGTH	48"	48"	48"
J WEIR HEIGHT ABOVE INVERT	3"	4"	6"
K BYPASS PLATE HEIGHT ABOVE INVERT	12"	18"	24"
L WIDTH OF WEIR AT BASE	3"	4 1/2"	6"
M OUTLET PIPE DIAMETER	M	M	M
N ELBOW INVERT HEIGHT ABOVE UNIT INVERT	4 1/2"	7 1/2"	11"
O ELBOW PIPE OVERHANG	18"	18"	24"
STORAGE MANHOLE DIMENSIONS			
P STORAGE MANHOLE DIAMETER	48"	60"	96"
Q MANHOLE DEPTH BELOW INLET/OUTLET	48"	48"	48"
R FLUID DEPTH	8' - 0"	8' - 0"	8' - 0"
S TOTAL STORAGE VOLUME	800 CF	300 CF	450 CF
SYSTEM DIMENSIONS AND ELEVATIONS			
T SEPARATOR MANHOLE COVER ELEVATION	T	T	T
U STORAGE MANHOLE COVER ELEVATION	U	U	U
V SEPARATOR MANHOLE FLOOR ELEVATION	V	V	V
W STORAGE MANHOLE FLOOR ELEVATION	W	W	W
X INLET PIPE ID AND MATERIAL	X1 X2	X1 X2	X1 X2
Y INLET PIPE INVERT	Y1 Y2	Y1 Y2	Y1 Y2
Z SEPARATOR UNIT INVERT	Z	Z	Z
AA OUTLET PIPE ID AND MATERIAL	AA	AA	AA
AB ELBOW INVERT ELEVATION	AB	AB	AB
AC CONNECTING PIPE INVERT ELEVATION	AC	AC	AC
AD CONNECTION PIPE SPACING	20"	24"	24"
AE STORAGE MANHOLE SIDE OFFSET	72 ± 6"	72 ± 6"	72 ± 6"
AF STORAGE MANHOLE DOWNSTREAM OFFSET	23"	31"	25"

APPROVED: HOWARD COUNTY DEPARTMENT OF PLANNING AND ZONING.  
 Director: *Howard County* 10/10/99  
 Chief, Development Engineering Division: *Clinda Hanania* 10/15/99  
 Chief, Division of Land Development: *Clinda Hanania* 10/15/99



DATE NO. REVISION  
 OWNER/DEVELOPER  
 PROLOGIS DEVELOPMENT SERVICES INCORPORATED  
 5200 EISENHOWER AVENUE, SECOND FLOOR  
 ALEXANDRIA, VIRGINIA 22304  
 (703)751-9292  
 PROJECT MEADOWRIDGE BUSINESS PARK  
 PARCEL G-2  
 2 WAREHOUSE BUILDINGS  
 AREA TAX MAP NO. 37 ZONED M-1 PARCEL G-2  
 1st ELECTION DISTRICT  
 HOWARD COUNTY, MARYLAND  
 TITLE WATER QUALITY NOTES AND DETAILS

Project: MEADOWRIDGE BUS. Designer: RIEMER MUEGGE  
 Address: BUSINESS PKWY. Contact: CHRIS REID  
 ELKRIDGE, MD. Phone: 410-997-8900  
 21227 Fax: 410-997-9282  
 Delivery Date: \_\_\_\_\_  
 Owner: PROLOGIS Contractor: \_\_\_\_\_  
 Contact: MAYNE KLOTZ Address: \_\_\_\_\_  
 Address: ALEXANDRIA, VA 22034 Contact: \_\_\_\_\_  
 Phone: \_\_\_\_\_  
 Fax: \_\_\_\_\_

Project: MEADOWRIDGE BUS. Designer: RIEMER MUEGGE  
 Address: BUSINESS PKWY. Contact: CHRIS REID  
 ELKRIDGE, MD. Phone: 410-997-8900  
 21227 Fax: 410-997-9282  
 Delivery Date: \_\_\_\_\_  
 Owner: PROLOGIS Contractor: \_\_\_\_\_  
 Contact: MAYNE KLOTZ Address: \_\_\_\_\_  
 Address: ALEXANDRIA, VA 22034 Contact: \_\_\_\_\_  
 Phone: \_\_\_\_\_  
 Fax: \_\_\_\_\_

**OPERATION AND MAINTENANCE SCHEDULE FOR BAYSAYER UNITS**

- Baysaver structures will require periodic inspection and cleaning to maintain operation and function. Owners will have the Baysaver unit inspected yearly or as required by Howard County, utilizing the Baysaver units Inspection/Monitoring Form. Inspections can be done by using a clear Plexiglas tube ("sludge judge") to extract a water column sample. When sediment depths exceed the specified level (Table 6 of Technical Manual) then cleaning of the unit is required.
- Baysaver structures must be checked and cleaned immediately after petroleum spills. Contact appropriate regulatory agencies.
- Maintenance of Baysaver units should be done by a vacuum truck which will remove the water, sediment, debris, floating hydrocarbons, and other materials in the unit. The proper cleaning and disposal of the removed materials and liquid must be followed.
- Inlet and outlet pipes must be checked for any obstructions and if any obstructions are found they must be removed. Structural parts of the Baysaver will be repaired as needed.
- Owner shall retain and make Baysaver units Inspection/Monitoring Forms available to Howard County officials upon their request.

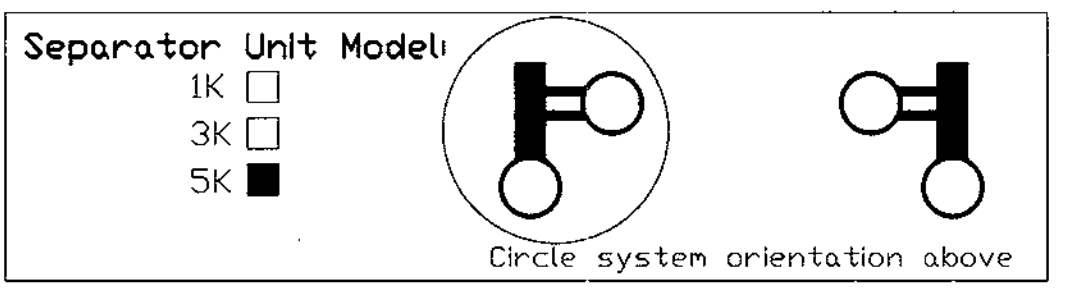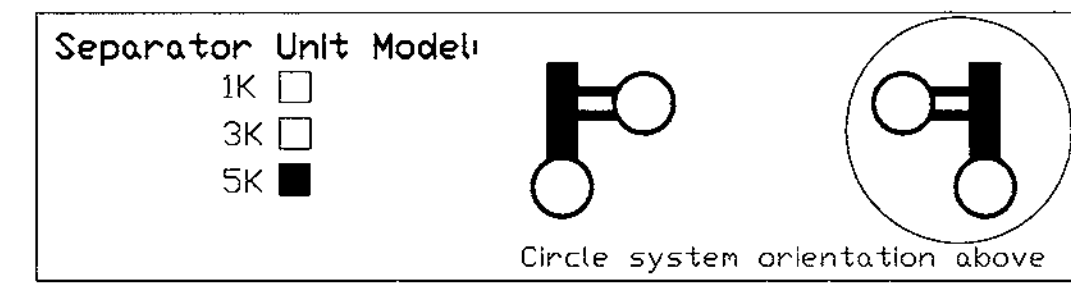

**Manhole Specifications:**  
 Primary Manhole Diameter: 12 inches  
 Storage Manhole Diameter: 12 inches  
 Floor Elevations:  
 Primary Manhole 241.34 ✓  
 Storage Manhole 241.34 ✓  
 Primary Manhole Inverts:  
 Separator Unit 251.28 ✓  
 Inlet Pipe(s) 249.84 ✓  
 Please show orientation (including angle), size and material of inlet pipes above.  
 Cover Elevations:  
 Primary Manhole 266.6  
 Storage Manhole 266.9  
 WQ-2/WQ-2A


**Manhole Specifications:**  
 Primary Manhole Diameter: 12 inches  
 Storage Manhole Diameter: 12 inches  
 Floor Elevations:  
 Primary Manhole 241.34 ✓  
 Storage Manhole 241.34 ✓  
 Primary Manhole Inverts:  
 Separator Unit 251.28 ✓  
 Inlet Pipe(s) 249.84 ✓  
 Please show orientation (including angle), size and material of inlet pipes above.  
 Cover Elevations:  
 Primary Manhole 266.3  
 Storage Manhole 266.5  
 WQ-1/WQ-1A

STATE OF MARYLAND  
 PROFESSIONAL ENGINEER  
 CHRISTOPHER J. REID # 19949  
 2.13.01  
 DATE

Baysaver Separator Unit	Baysaver Manhole Sizes (prim. x stor.)	Maximum Treatment (cfs)*1	Maximum Treatment (gpm)*1	Impervious Area (acres)
1K Baysaver Separator	48x48	2.4	1076	1.2
	48x60	2.4	1076	1.4
	60x60	2.4	1076	1.5
3K Baysaver Separator	60x60	7.2	3231	3.6
	60x72	7.2	3231	4.1
	60x84	7.2	3231	4.4
	72x72	7.2	3231	4.6
5K Baysaver Separator	72x72	11.1	4981	5.5
	72x84	11.1	4981	6.3
	84x84	11.1	4981	7.5

RIEMER MUEGGE & ASSOCIATES INC  
 ENGINEERING • ENVIRONMENTAL SERVICES • PLANNING • SURVEYING  
 8818 Centre Park Drive, Columbia, MD 21045  
 tel 410.997.8900 fax 410.997.9282  
 DATE DESIGNED BY: CJR  
 DRAWN BY: DAM  
 PROJECT NO: 97320/PARCEL\_G SDF11.DWG  
 DATE: OCTOBER 11, 1999  
 SCALE: AS SHOWN  
 DRAWING NO. 12 OF 25



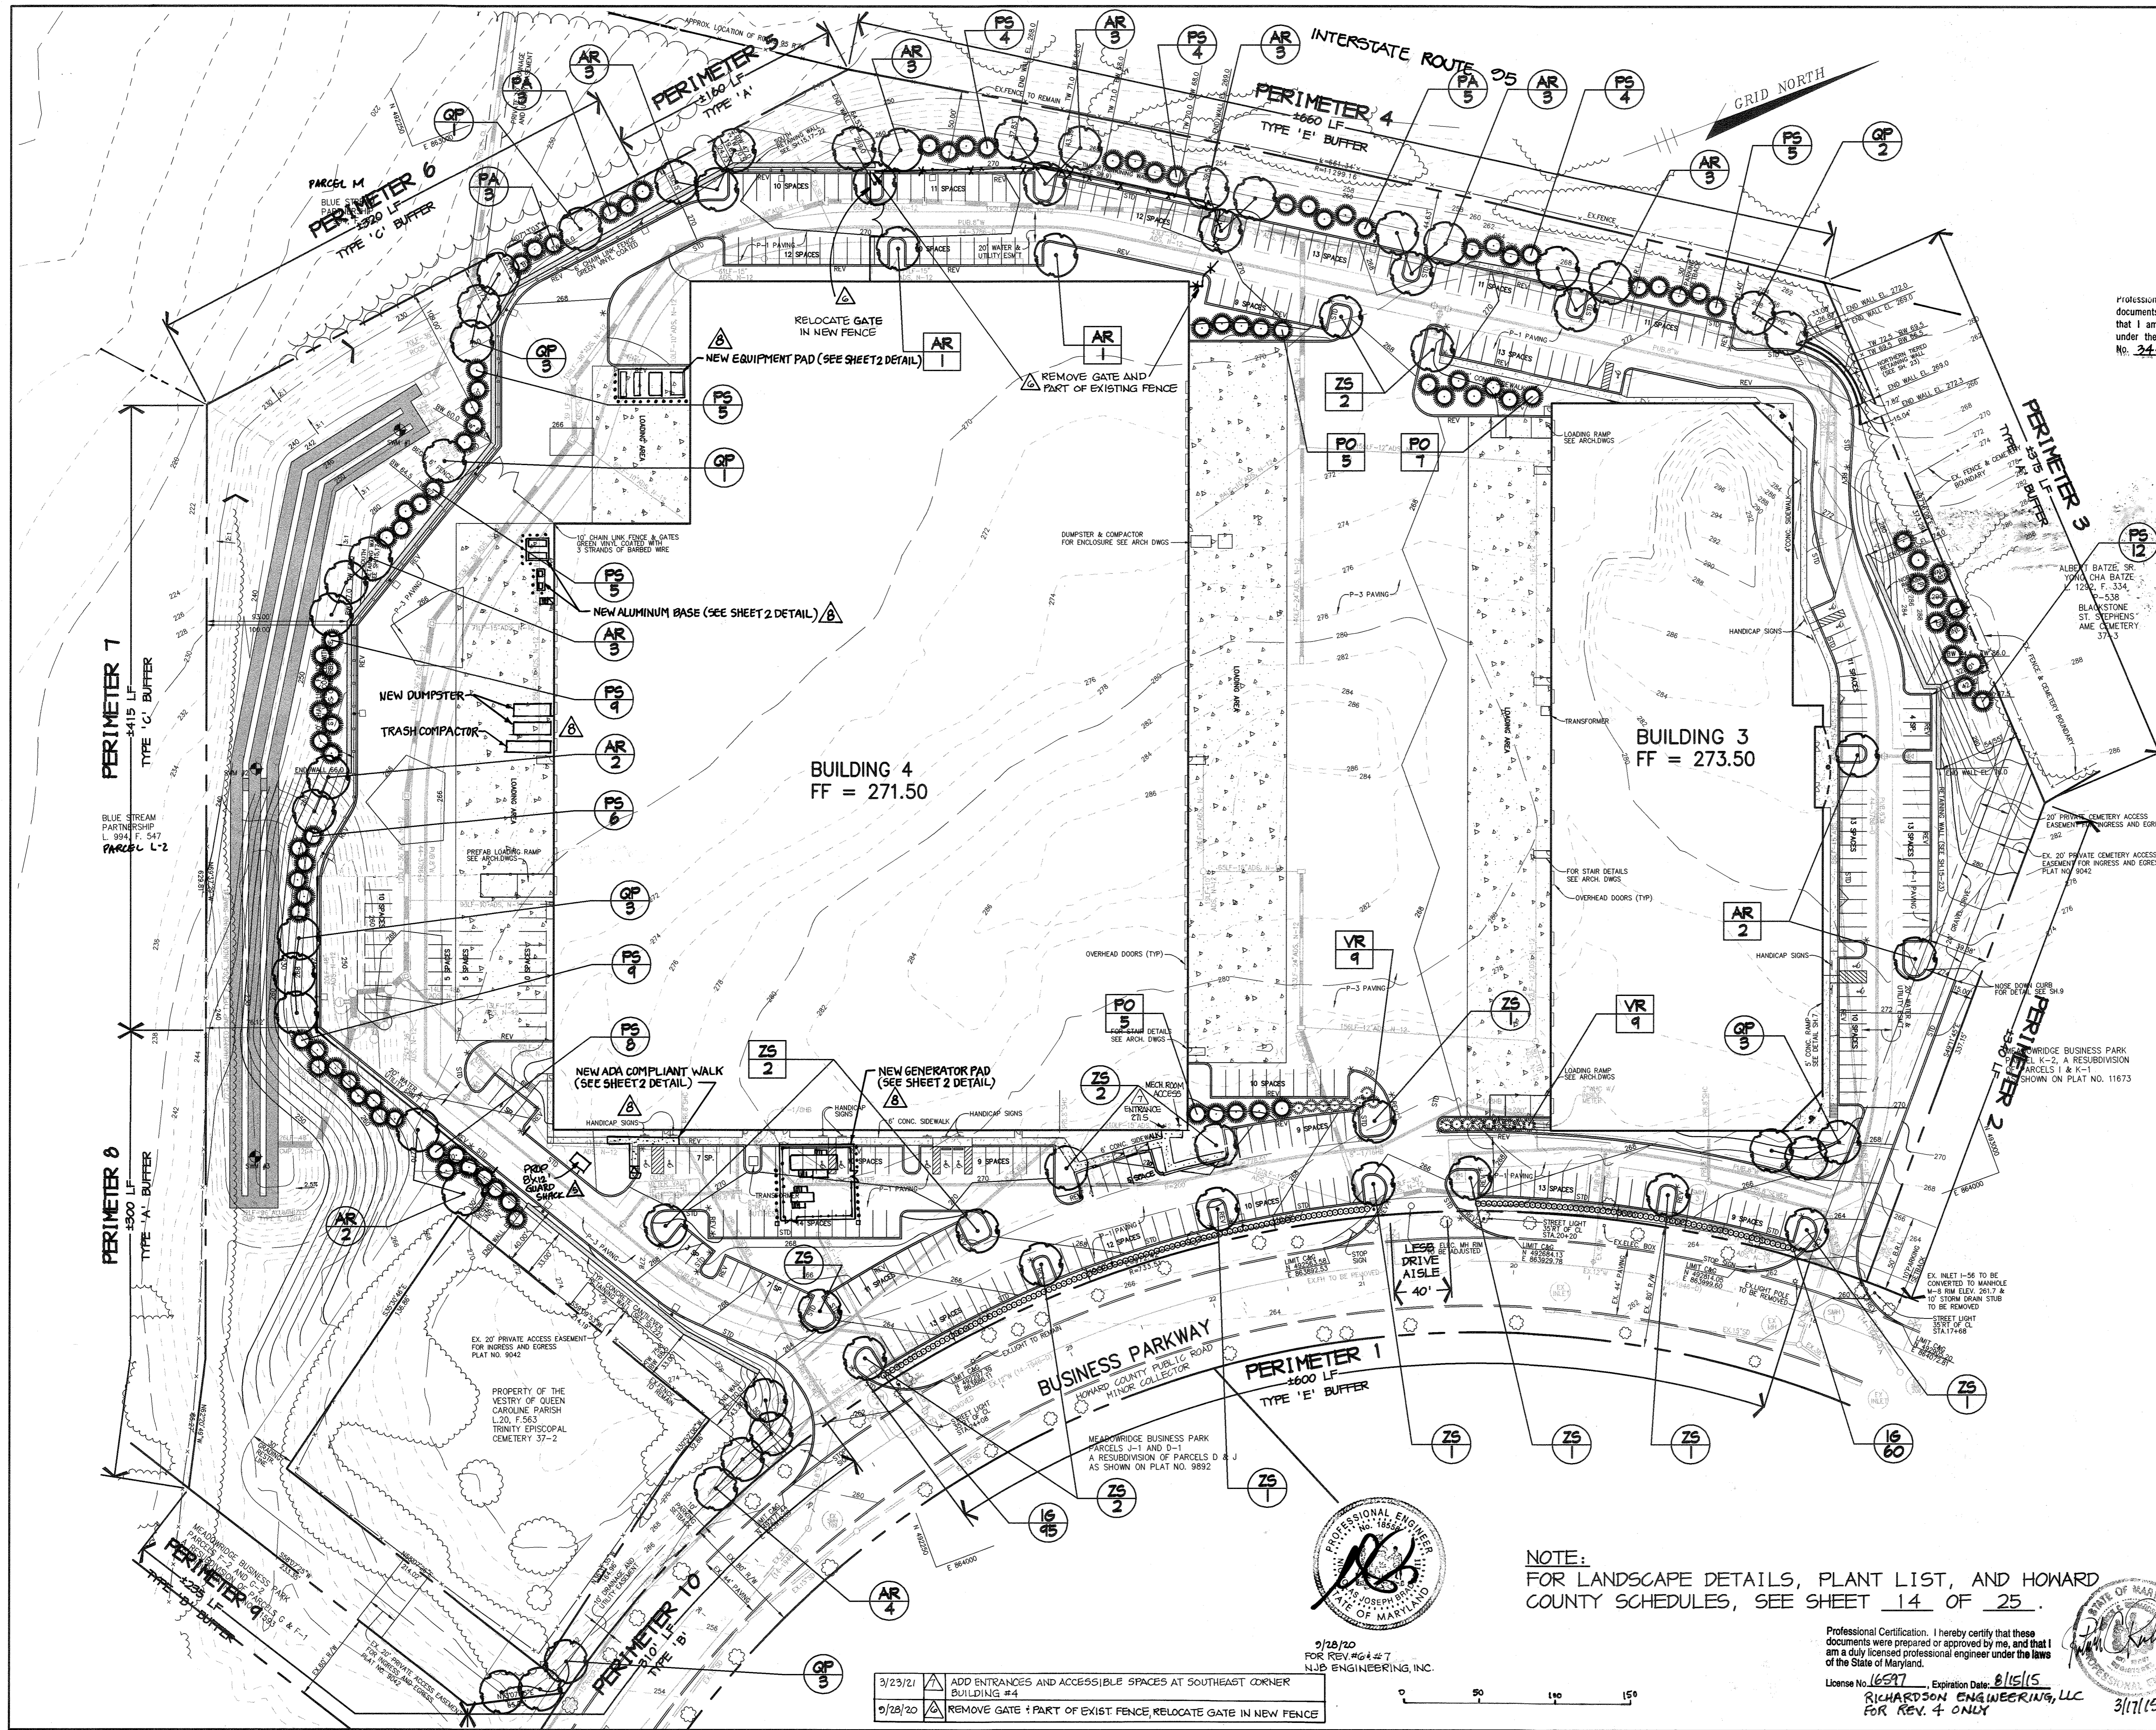

Professional documents prepared or approved by me, the documents were prepared or approved by me, and that I am a duly licensed professional engineer under the laws of the State of Maryland, License No. 34682, Exp. Date: 07/08/23.



08/23/21 ADD EQUIPMENT PADS, DUMPSTERS, ADA COMPLIANT SIDEWALK, AND GENERATOR FENCE

- XX PERIMETER LANDSCAPE REQUIREMENT
- XX PARKING LOT LANDSCAPE REQUIREMENT

PLANTING LEGEND	
PROP. SHADE TREE	
PROP. ORNAMENTAL TREE	
PROP. EVERGREEN TREE	
PROP. EVERGREEN SHRUB	
PROP. DECIDUOUS SHRUB	
EXISTING SHADE TREE	

APPROVED: HOWARD COUNTY DEPARTMENT OF PLANNING AND ZONING.
<i>John S. Smith</i> 10/19/99 DIRECTOR DATE
<i>Cindy Hamilton</i> 10/15/99 CHIEF, DEVELOPMENT ENGINEERING DIVISION DATE
<i>Cindy Hamilton</i> 10/15/99 CHIEF, DIVISION OF LAND DEVELOPMENT DATE
6/19/15 5 GUARD SHACK
3/17/15 4 ADDITIONAL CHAINLINK FENCE AND GATES
DATE NO. REVISION
OWNER/DEVELOPER
PROLOGIS DEVELOPMENT SERVICES INCORPORATED 5200 EISENHOWER AVENUE, SECOND FLOOR ALEXANDRIA, VIRGINIA 22304 (703)751-9292
PROJECT MEADOWRIDGE BUSINESS PARK PARCEL G-2 2 WAREHOUSE BUILDINGS
AREA TAX MAP NO. 37 ZONED M-1 PARCEL G-2 1st ELECTION DISTRICT HOWARD COUNTY, MARYLAND
TITLE LANDSCAPE PLAN

**RIEMER MUEGGE & ASSOCIATES INC.**  
ENGINEERING • ENVIRONMENTAL SERVICES • PLANNING • SURVEYING  
8818 Centre Park Drive, Columbia, MD 21045  
tel 410.997.8900 fax 410.997.9282

10.11.99 DATE	DESIGNED BY: DTD
	DRAWN BY: A.J.L.
	PROJECT NO.: 97320/PARCEL G LSCP.DWG
	DATE: OCTOBER 11, 1999
	SCALE: 1" = 50'
	DRAWING NO.: 13 OF 25

NOTE:  
FOR LANDSCAPE DETAILS, PLANT LIST, AND HOWARD COUNTY SCHEDULES, SEE SHEET 14 OF 25.



0/28/20 FOR REV.#6 & #7  
NJE ENGINEERING, INC.

- 3/23/21 ADD ENTRANCES AND ACCESSIBLE SPACES AT SOUTHEAST CORNER BUILDING #4
- 0/28/20 REMOVE GATE + PART OF EXIST FENCE, RELOCATE GATE IN NEW FENCE



PERIMETER	ADJACENT TO PARCELS IN THE SAME DEVELOPMENT							ADJACENT TO ROADWAYS		
	2	3	5	6	7	8	9	1	4	10
LANDSCAPE TYPE	A	A	A	C	C	A	B	E	E	B
LINEAR FEET OF ROADWAY FRONTAGE/ PERIMETER	± 340'	± 375'	± 160'	± 320'	± 415'	± 300'	± 235'	± 600'	± 660'	± 310'
CREDIT FOR EXISTING VEGETATION (YES, NO, LINEAR FEET) (DESCRIBE BELOW IF NEEDED)	NO	NO	NO	NO	NO	YES ± 200'	YES ± 235'	NO	NO	YES ± 110'
CREDIT FOR WALL, FENCE OR BERM (YES, NO, LINEAR FEET) (DESCRIBE BELOW IF NEEDED)	NO	NO	NO	NO	NO	NO	NO	NO	NO	NO
NUMBER OF PLANTS REQUIRED										
SHADE TREES		①/60' = 6	①/60' = 3	①/40' = 8	①/40' = 10	①/60' = 2	①/50' = 5	①/40' = 15	①/40' = 17	①/50' = 4
EVERGREEN TREES	* N/A	-	-	①/20' = 16	①/20' = 21	-	①/40' = 6	-	-	①/40' = 5
SHRUBS	-	-	-	-	-	-	-	①/4' = 150	①/4' = 165	-
NUMBER OF PLANTS PROVIDED										
SHADE TREES	-	-	3	8	7	-	* N/A	15	17	7
EVERGREEN TREES	-	12	-	16	20	-	-	-	18	-
SMALL FLOWERING TREES	-	-	-	-	-	-	-	-	-	-
SHRUBS	-	-	-	-	-	-	-	155	-	-

**\* SCHEDULE 'A' NOTES:**

**PERIMETER 2**

NO LANDSCAPE REQUIREMENTS ARE GENERATED ALONG PERIMETER 2 DUE TO INTERNAL PROPERTY LINES BETWEEN PARCELS OF THE MEADOWRIDGE BUSINESS PARK

**PERIMETER 9**

ACCORDING TO PAGE 24 OF THE Ho. Co. LANDSCAPE MANUAL, UPTO 100% OF THE PLANTING REQUIREMENT MAY BE MET BY PRESERVING EXISTING VEGETATION

**SCHEDULE 'A' - SUBSTITUTION NOTES:**

**PERIMETER 3:**

(12) EVERGREEN TREES WERE SUBSTITUTED FOR (6) SHADE TREES

**PERIMETER 4:**

(14) EVERGREEN TREES WERE SUBSTITUTED FOR (165) SHRUBS

**PERIMETER 7:**


(7) EVERGREEN TREES WERE SUBSTITUTED FOR (3) SHADE TREES

**PERIMETER 8:**

(4) EVERGREEN TREES WERE SUBSTITUTED FOR (2) SHADE TREES


**PERIMETER 10:**

(3) SHADE TREES WERE SUBSTITUTED FOR (5) EVERGREEN TREES

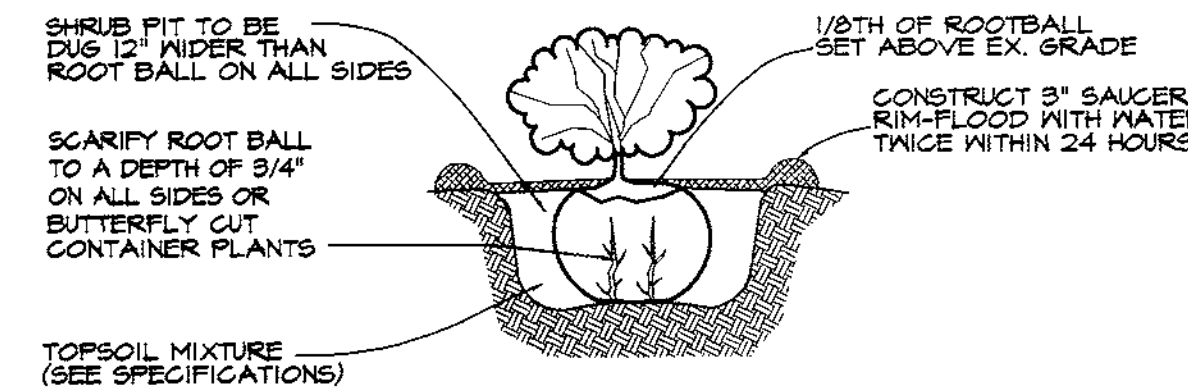


NOTE: ALL CONTAINERS OR BURLAP SHALL BE REMOVED BEFORE INSTALLATION.  
**SHRUB PLANTING DETAIL**  
NOT TO SCALE

SCHEDULE B - PARKING LOT INTERNAL LANDSCAPING	
PARKING LOT	1
NUMBER OF PARKING SPACES	340
NUMBER OF SHADE TREES REQUIRED (1/20 SPACES)	17
NUMBER OF TREES PROVIDED	
SHADE TREES	8
OTHER TREES (2:1 SUBSTITUTION)	17
SHRUBS (10:1 SUBSTITUTION)	18
NUMBER OF ISLANDS REQUIRED	17
NUMBER OF ISLANDS PROVIDED	29
* 200 SF PLANTING AREA / ISLAND	

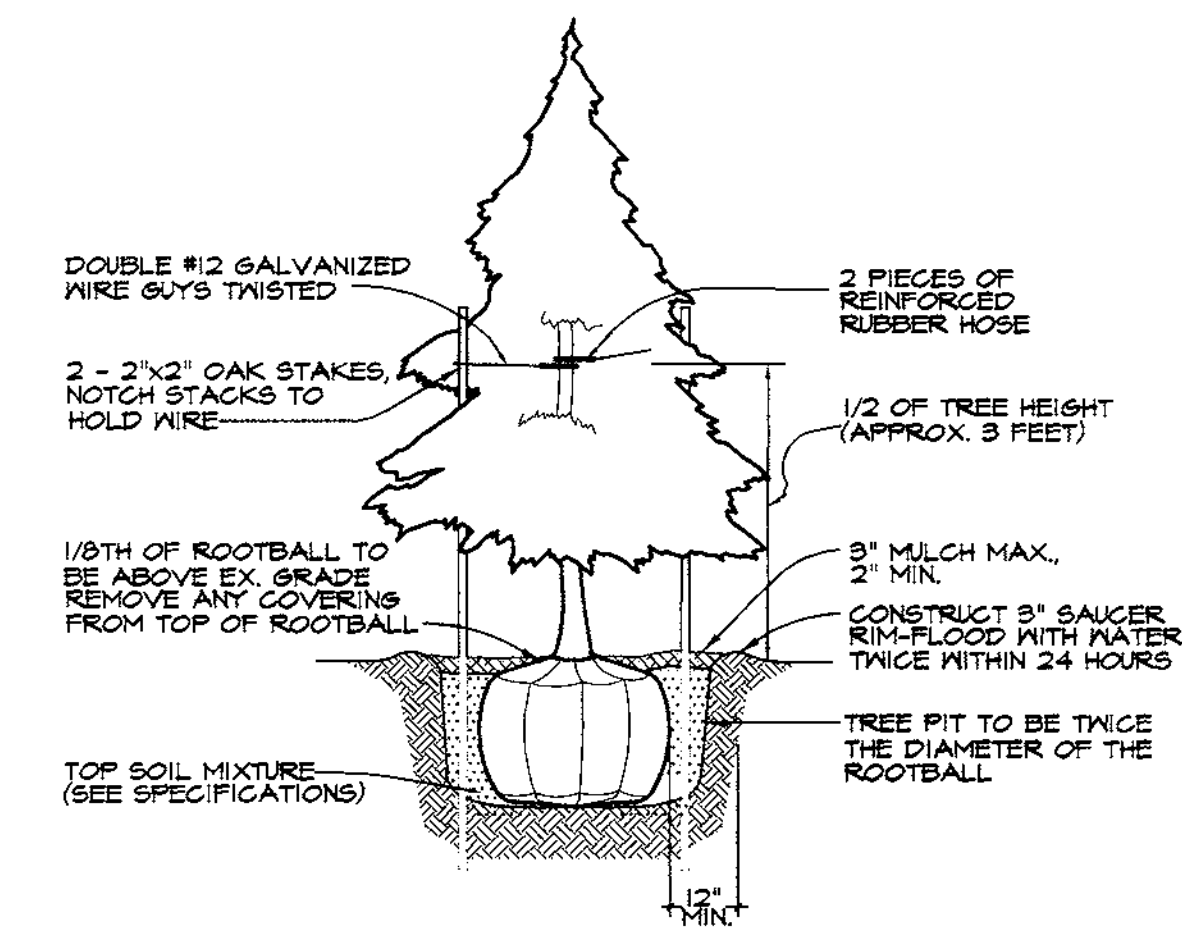

**EVERGREEN PLANTING DETAIL**  
NOT TO SCALE

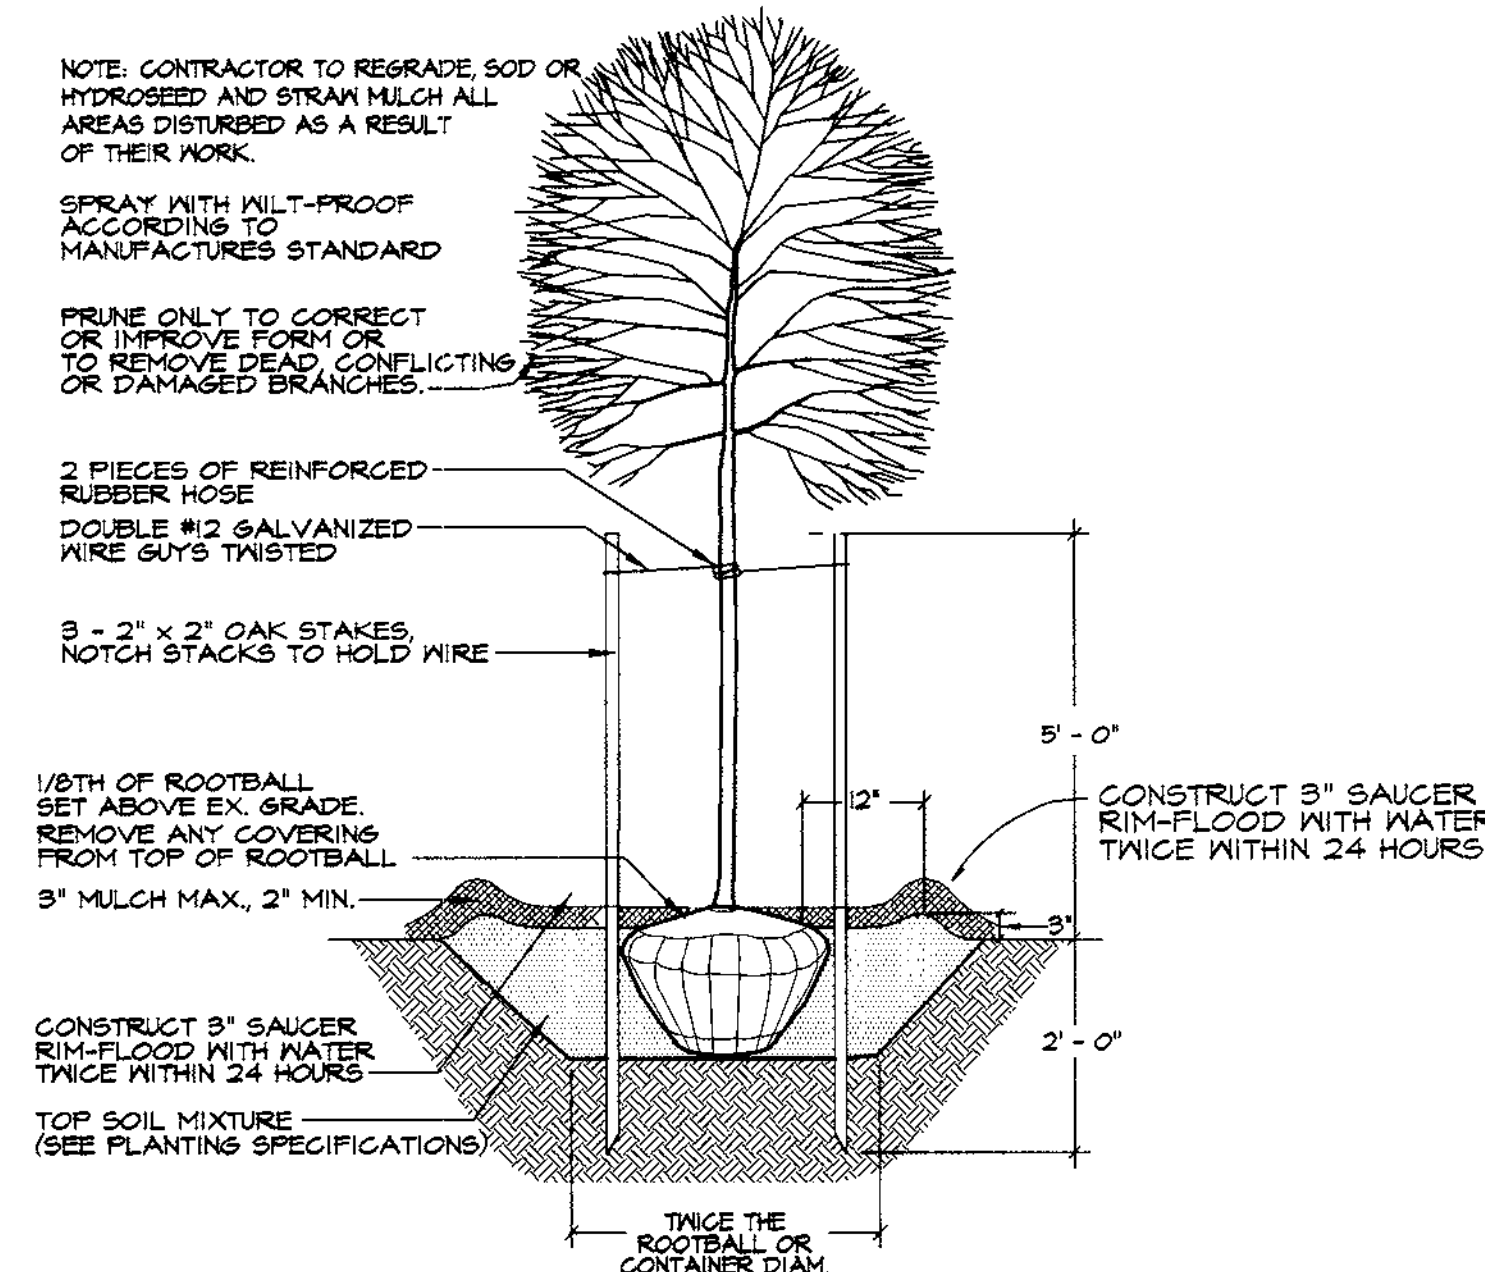

**B&B TREE PLANTING DETAIL**  
NOT TO SCALE

**NOTES:**

- THIS PLAN HAS BEEN PREPARED IN ACCORDANCE WITH THE PROVISIONS OF SECTION 16.124 OF THE HOWARD COUNTY CODE.
- FINANCIAL SURETY FOR THE REQUIRED LANDSCAPING MUST BE POSTED AS PART OF THE DEVELOPERS AGREEMENT IN THE AMOUNT OF \$ 49,250.00.
- THIS PLAN IS FOR LANDSCAPING PURPOSES ONLY.
- CONTRACTOR IS SOLELY RESPONSIBLE FOR CONSTRUCTION MEANS, METHODS, TECHNIQUES, SEQUENCES, PROCEDURES, AND SAFETY PRECAUTIONS AND PROGRAMS.

**DEVELOPER'S/BUILDER'S CERTIFICATE:**

I/WE CERTIFY THAT THE LANDSCAPING SHOWN ON THIS PLAN WILL BE DONE ACCORDING TO THE PLAN, SECTION 16.124 OF THE HOWARD COUNTY CODE AND THE HOWARD COUNTY LANDSCAPE MANUAL. I/WE FURTHER CERTIFY THAT UPON COMPLETION A CERTIFICATION OF LANDSCAPE INSTALLATION, ACCOMPANIED BY AN EXECUTED ONE YEAR GUARANTEE OF PLANT MATERIALS, WILL BE SUBMITTED TO THE DEPARTMENT OF PLANNING AND ZONING.

NAME: *David T. Dows* DATE: 10.11.99

PLANT LIST					
SYMBOL	QTY.	SCIENTIFIC/ COMMON NAME	SIZE	ROOT	SPACING
AR	33	ACER RUBRUM OCTOBER GLORY OCTOBER GLORY RED MAPLE	2 1/2" - 3" CAL	B4B	PLANT AS SHOWN
OP	16	QUERCUS PALUSTRIS PIN OAK	2 1/2" - 3" CAL	B4B	PLANT AS SHOWN
ZS	15	ZELKOVA SERRATA 'GREEN VASE' GREEN VASE ZELKOVA	2 1/2" - 3" CAL	B4B	PLANT AS SHOWN
PA	11	PICEA ABIES NORWAY SPRUCE	6' - 8' HT.	B4B	PLANT 12'-15' O.C.
PO	17	PICEA OMORICA SERBIAN SPRUCE	6' - 8' HT.	B4B	PLANT 12'-15' O.C.
PS	71	PINUS STROBUS EASTERN WHITE PINE	6' - 8' HT.	B4B	PLANT AS SHOWN
IG	155	ILEX GLABRA 'SHAMROCK' SHAMROCK INKBERRY	2 1/2" - 3" HT.	CONT.	PLANT 3' O.C.
VR	18	VIBURNUM RHYTIDOPHYLLUM LEATHERLEAF VIBURNUM	2 1/2" - 3" HT.	CONT.	PLANT 5'-6' O.C.

APPROVED: HOWARD COUNTY DEPARTMENT OF PLANNING AND ZONING.

*Howard B. Smith* 10/19/99  
DIRECTOR DATE

*Chris Hammit* 10/15/99  
CHIEF, DEVELOPMENT ENGINEERING DIVISION DATE

*Chris Hammit* 10/15/99  
CHIEF, DIVISION OF LAND DEVELOPMENT DATE

DATE NO. REVISION

OWNER/DEVELOPER

PROLOGIS DEVELOPMENT SERVICES INCORPORATED  
5200 EISENHOWER AVENUE, SECOND FLOOR  
ALEXANDRIA, VIRGINIA 22304  
(703)751-9292

PROJECT MEADOWRIDGE BUSINESS PARK  
PARCEL G-2  
2 WAREHOUSE BUILDINGS

AREA TAX MAP NO. 37 ZONED M-1 PARCEL G-2  
1st ELECTION DISTRICT  
HOWARD COUNTY, MARYLAND

TITLE LANDSCAPE SCHEDULES AND DETAILS

**RIEMER MUEGGE & ASSOCIATES INC.**  
ENGINEERING • ENVIRONMENTAL SERVICES • PLANNING • SURVEYING  
8819 Centre Park Drive, Columbia, MD 21045  
tel 410.987.8800 fax 410.987.8282

10.11.99 DATE

DESIGNED BY: DTD

DRAWN BY: A.L.L.

PROJECT NO: 97320/PARCEL G  
LSCF2.DWG


DATE: OCTOBER 11, 1999

SCALE: 1" = 50'

DRAWING NO. 14 OF 25


DAVID T. DOWS #830



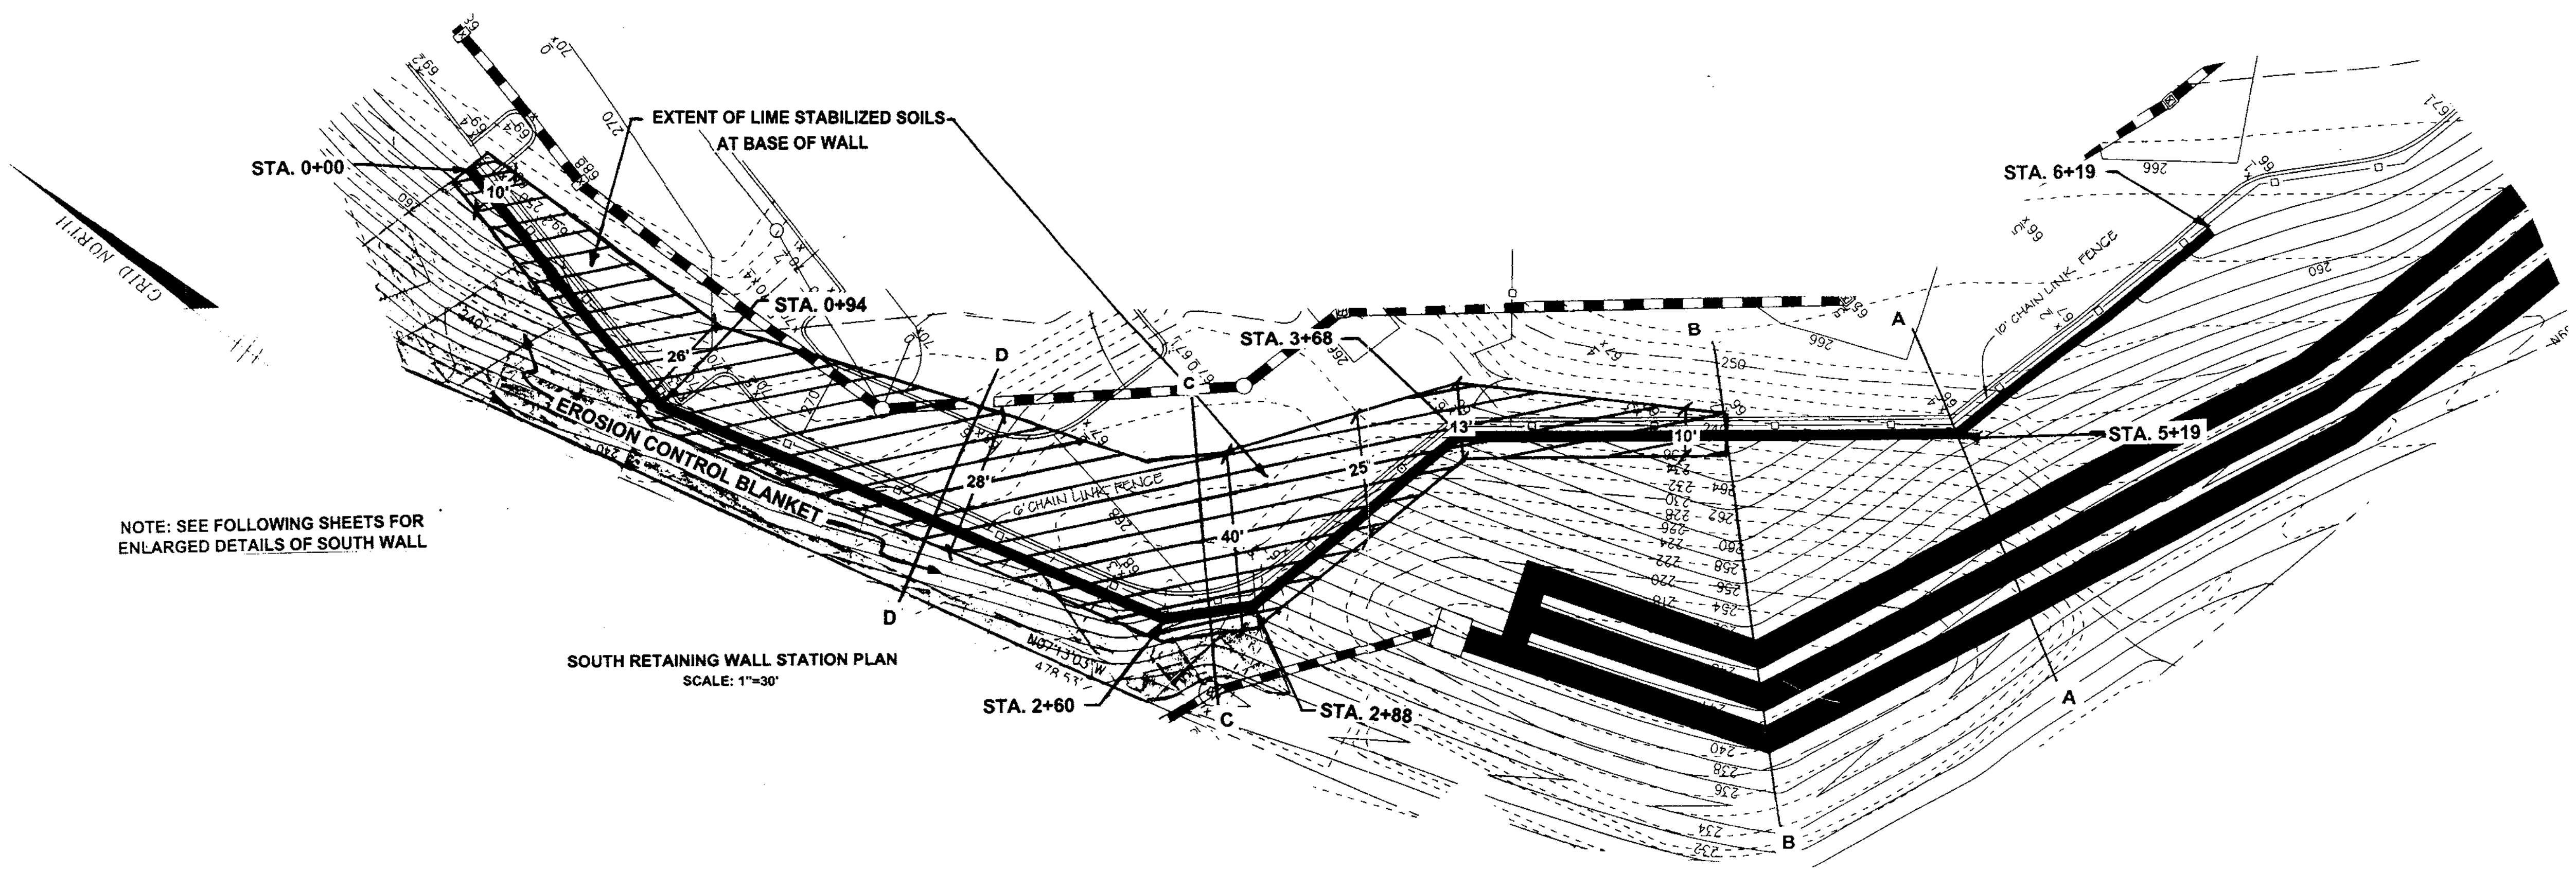


NOTE: SEE FOLLOWING SHEETS FOR ENLARGED DETAILS OF SOUTH WALL

SOUTH RETAINING WALL STATION PLAN  
SCALE: 1"=30'

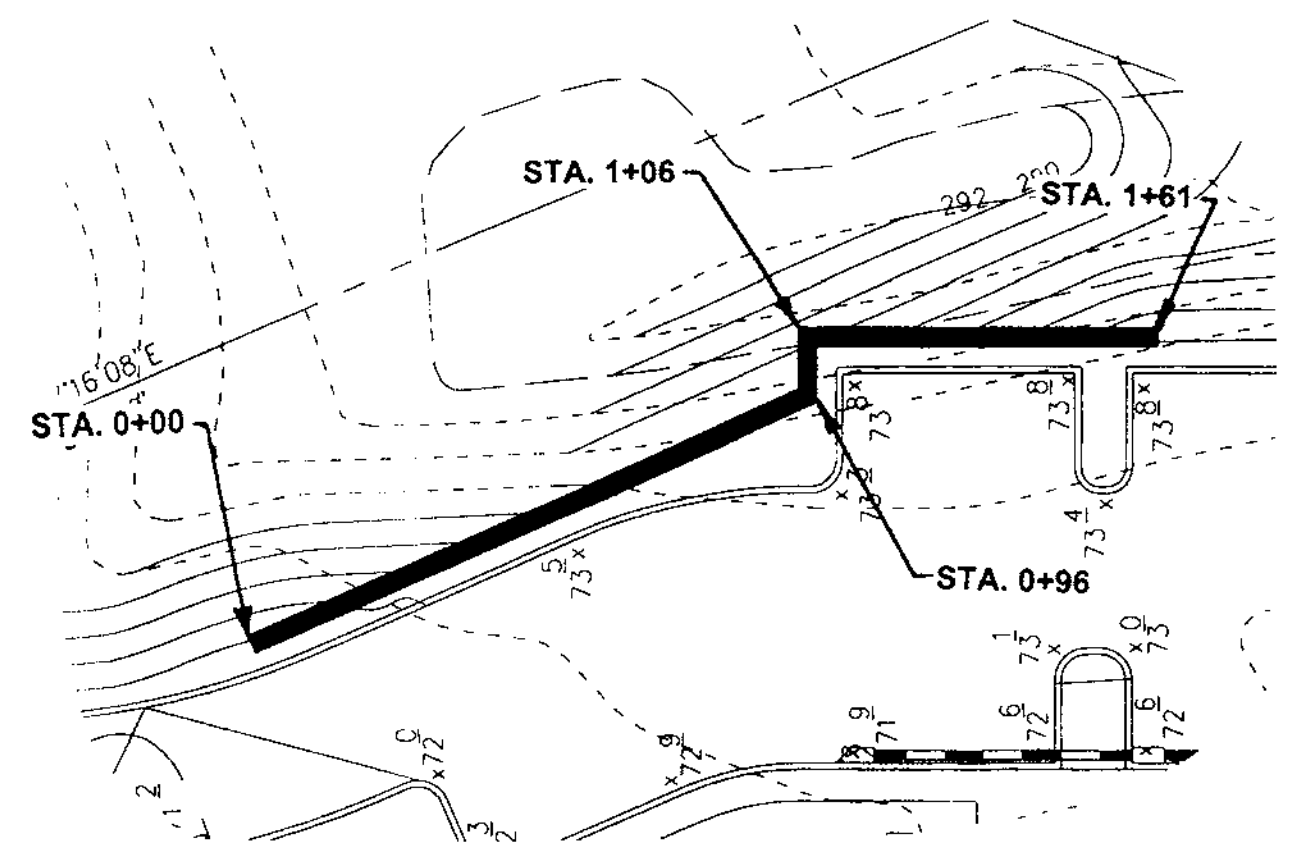

NORTH RETAINING WALL STATION PLAN  
SCALE: 1"=30'

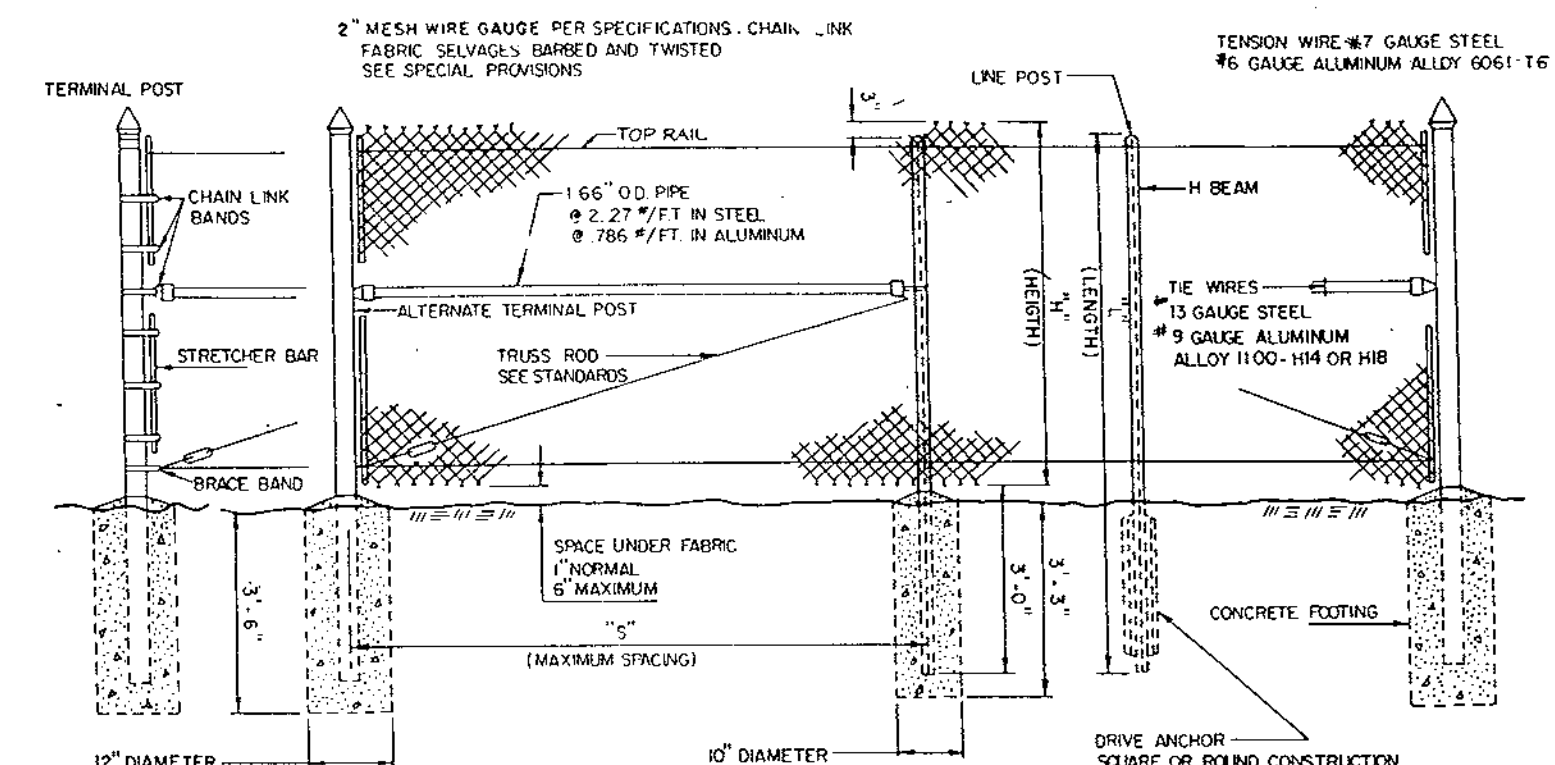

ITEM	DESCRIPTION	QUANTITY	UNIT
1	12" DIAMETER TERMINAL POST	1	EA
2	10" DIAMETER LINE POST	1	EA
3	12" DIAMETER DRIVE ANCHOR	1	EA
4	CONCRETE FOOTING	1	EA
5	REINFORCEMENT	1	EA
6	CHAIN LINK FENCE	1	EA

PART 1 GENERAL

1.1 Work includes furnishing and installing Modular block retaining wall units to the lines and grades designated on the construction drawings and as specified herein.

1.2 REFERENCE STANDARDS

- A. ASTM C90-75 (1981 rev) - Hollow Load Bearing Masonry Units
- B. ASTM C140-75 (1981 rev) - Sampling and Testing Concrete Masonry Units
- C. ASTM C145-75 (1981 rev) - Solid Load Bearing Concrete Masonry Units

1.3 DELIVERY, STORAGE AND HANDLING

- A. Contractor should check the materials upon delivery to assure that proper material has been received.
- B. Contractor should prevent excessive mud, wet cement, epoxy, and like materials which may affix themselves, from coming in contact with the materials.
- C. Contractor should protect the materials from damage. Damaged material should not be incorporated into the reinforced retaining walls.

PART 2 RETAINING WALL

2.1 MATERIALS

- A. Concrete Units
  - 1. Masonry units should be Versa-Lok Retaining Wall Brute Units as indicated on the drawings.
  - 2. Concrete wall units should have a minimum 28-day compressive strength of 3000 psi in accordance with ASTM C-90. The concrete should have adequate freeze/thaw protection with a maximum moisture absorption of 6 to 8 percent.
  - 3. Exterior dimensions may vary.
  - 4. Units should have angled sides and capable of retaining concave and convex alignment curves.
  - 5. Units should be interlocked with non-corrosive nylon/fiberglass pins.
  - 6. Units should be interlocked as to provide a setback of 0- to 3-inch per each course of wall height.
- B. Connecting pins
  - 1. Two Versa-Tuff nylon/fiberglass pins are used per unit to provide set back and alignment.
- C. Base Material
  - 1. Material for the south wall footing should consist of 4,000 psi strength air entrained concrete constructed to either 36" by 18" or 36" by 12" footings as shown on drawings. The north wall base material shall consist of graded aggregate meeting SHA-GAB.
- D. Reinforced Backfill
  - 1. On-site or borrow soils having a friction angle of at least 32° when compacted will be considered suitable for backfill, provided it is approved by a State of Maryland Registered Professional Engineer. Suitable on-site or off-site borrow materials must also meet AASHTO A-2-4 or more granular. The material should be non-plastic.

2.2 RETAINING WALL INSTALLATION

A. Excavation

- 1. The owner's contractor should excavate to the lines and grades shown on the construction drawings. Under no circumstances should the excavation lines and grades be exceeded. The contractor should protect the excavation from sloughing by placing a membrane over the face of the excavation. In addition, benching of the slope may be required if the slope exceeds 5H:1V.

B. Foundation Soil Preparation

- 1. Foundation soil should be excavated as required for footing dimensions shown on the construction drawings, or as directed by the Engineer.
- 2. Most of the foundation soil below the south wall should be over-excavated a minimum of 5 feet as shown on plans and backfilled with compacted lime stabilized clay (5% lime by dry unit wt.). The over-excavations should extend to the lengths shown on the wall plan. The over-excavation will be directed by GTA.
- 3. Foundation soil should be examined by the Engineer to assure that the actual foundation soil strength meets or exceeds assumed design strength. Soils not meeting required strength should be removed and replaced with acceptable material.
- 4. Over-excavated areas should be filled with compacted backfill material, meeting AASHTO A-2-4 or cement/lime modified soil as approved by GTA.
- 5. The required bearing capacity for natural and controlled, compacted fill soils varied between 2000 and 5500 psf to be verified by GTA.

C. Base Footing

- 1. The leveling pad concrete footing for the south wall should be placed as shown on the construction drawings with a minimum thickness of 18" and 12" inches. The north wall leveling pad shall be a minimum 6 inches thick by 30 inches wide and compacted to 92 percent of the ASTM D-1557.
- 2. Leveling pad footing materials should be installed upon undisturbed in situ soils or controlled, compacted backfill.
- 3. Footing should be prepared to insure complete contact of retaining wall unit with base. Gaps should not be allowed.

D. Unit Installation

- 1. First course of concrete wall units should be placed on the footing. The units should be checked for level and alignment. The first course is the most important to insure accurate and acceptable results.
- 2. Insure that units are in full contact with base.
- 3. Units are placed side by side for full length of wall alignment. Alignment may be done by means of a string line or offset from base line.
- 4. Install Versa-Tuff connecting pins.
- 5. Lay up each course insuring that pins are inserted through two of the four front holes in the unit beneath and into the receiving slot in the course being installed. Two pins are required per unit. Pull each unit forward, away from the embankment, against pins in the previous course and backfill as the course is completed. Repeat procedure to the extent of wall height.

6. At the end of each course where the wall changes elevation, units should be turned into the backfill. Units should be laid as to create the minimum radius possible. A minimum of 2 units should be installed into the grade. Only the front face of the units should be visible from the side of the wall.

- 7. Versa-Lok Brute Units should be used to make convex and concave curves in accordance with manufacturer's recommendations.
- 8. Cap units should be installed and bonded with construction adhesive or epoxy cement as required by manufacturer.
- 9. Contractor should provide positive drainage for the back of the retaining wall during construction.

GEORGRID WALL REINFORCEMENT

PART 1 GENERAL

1.1 Work includes furnishing and installing geogrid reinforcement, wall fill, and backfill to the lines and grades designated on the construction drawings. Also included is the furnishing and installing all appurtenant materials required for construction of the geogrid reinforced soil retaining wall as shown on the construction drawings.

1.2 REFERENCE STANDARDS

- A. ASTM D638 - Test Method for Tensile Properties of Plastic
- B. ASTM D 1248 - Specification of Polyethylene Plastics Molding and Extrusion Materials
- C. ASTM D 4218 - Test Method for Carbon Black Content in Polyethylene Compounds by the Muffle Furnace Technique
- D. ASTM D 1785 - Specification for Poly (Vinyl Chloride) (PVC) Plastic Pipe, Schedules 20, 40, 80 and 120

1.3 DELIVERY STORAGE AND HANDLING

A. GEORGRID

- 1. Contractor should check the geogrid upon delivery to assure that the proper material has been received.
- 2. Geogrids should be stored above -20 degrees F.
- 3. Contractor should prevent excessive mud, wet cement, epoxy and like materials which may affix themselves to the grid-work, from coming in contact with the geogrid.
- 4. Maximum geogrid spacing should be 2.67 feet.

PART 2 MATERIALS

2.1 DEFINITIONS

- A. Geogrid is specifically fabricated for use as a soil reinforcement.
- B. Concrete retaining wall units are as detailed on the drawings and are specified under PART 2-2.1-A Concrete Units.
- C. Backfill is the non-plastic granular fill (AASHTO A-2-4) which is used as fill for the reinforced zone.
- D. Foundation soil is the in situ soil or compacted fill at foundation level.

2.2 PRODUCTS

- A. Geogrid should be TENSAR UX1500 or UX1600, as shown.

PART 3 EXECUTION

3.1 GEOGRID INSTALLATION FOR RETAINING WALLS

- A. The geogrid soil reinforcement should be laid horizontally on compacted backfill, connected to the concrete wall units and embedded a minimum of 12 inches. Hook grid over pins, pull taut, and anchor before backfill is placed on the geogrid.
- B. Slack in the geogrid at the wall unit connections should be removed in a manner, and to such a degree, as approved by the Engineer.
- C. Geogrid should be laid at the proper elevation and orientation as shown on the construction drawings or as directed by the Engineer.
- D. Correct orientation (roll direction) of the geogrid should be verified by the Contractor.
- E. Geogrid should be secured in-place with staples, pins, sand bags, or backfill as required by fill properties, fill placement procedures, or weather conditions, or as directed by the Engineer.

4. FILL PLACEMENT

- A. Wall fill material should be placed in 8-inch lifts and compacted to 92 percent of Modified Proctor (ASTM D-1557).
- B. Backfill should be placed, spread, and compacted in such a manner that minimizes the development of wrinkles in and/or movement of the geogrid.
- C. Only hand-operated compaction equipment should be allowed within 5 feet of wall face.
- D. Backfill should be placed from the wall outward to insure that the geogrid remains taut.
- E. Tracked construction equipment should not be operated behind or above the wall.
- F. Rubber-tired equipment may pass over the geogrid reinforcement at slow speeds, less than 10 MPH. Sudden braking and sharp turning should be avoided.

5. DRAINAGE FILL

- A. A 6 inch drainage layer wrapped in filter fabric (M140N) should be constructed between the reinforced fill and the retained soil zones as shown on the drawings.
- B. A 12- to 18-inch drainage layer of #57 stone wrapped in a filter fabric (M140N) shall be constructed as shown in the drawings.

GENERAL NOTES

PART 1 CONSTRUCTION CERTIFICATION

- A. The required leveling pad subgrade bearing capacity should be certified by a Maryland Registered Professional Geotechnical Engineer prior to footing placement.
- B. Construction of retaining wall should be performed under the observations of a Maryland Registered Professional Engineer. Upon completion of the work, the engineer should submit a signed and sealed report stating that the retaining wall was constructed in accordance with the plans, specifications, and accepted modifications (if applicable).

PART II DESIGN CRITERIA

- A. The required allowable bearing capacity for natural soils and compacted fill varies between 2000 psf and 6000 psf to be verified by GTA.
- B. Design  $\phi = 32^\circ$  for the reinforced backfill.
- C. Surcharge load = 250 psf.
- D. Retaining wall was not designed to resist hydrostatic pressure.

APPROVED: HOWARD COUNTY DEPARTMENT OF PLANNING AND ZONING.

*Paul R. Smith* 10/14/99  
DIRECTOR DATE

*Cheryl K. Hester* 10/15/99  
CHIEF, DEVELOPMENT ENGINEERING DIVISION DATE

*Cheryl K. Hester* 10/15/99  
CHIEF, DIVISION OF LAND DEVELOPMENT DATE

DATE	NO.	REVISION
OWNER/DEVELOPER		
PROLOGIS DEVELOPMENT SERVICES INCORPORATED 5200 EISENHOWER AVENUE, SECOND FLOOR ALEXANDRIA, VIRGINIA 22304 (703)751-9292		
PROJECT MEADOWRIDGE BUSINESS PARK PARCEL G-2 2 WAREHOUSE BUILDINGS		
AREA TAX MAP NO. 37 ZONED M-1 PARCEL G-2 1st ELECTION DISTRICT HOWARD COUNTY, MARYLAND		
TITLE		

10-7-99 DATE

DESIGNED BY: JR/MG

DRAWN BY: JR

PROJECT NO.: 99231.C

DATE: OCTOBER 11, 1999

SCALE: AS SHOWN

DRAWING NO. 15 OF 25

**GEO-TECHNOLOGY ASSOCIATES, INC.**  
GEOTECHNICAL AND ENVIRONMENTAL CONSULTANTS


42 N. Main Street, Suite 200  
Bel Air, Maryland 21014  
(301) 879-9448 - (301) 838-9123  
Fax (301) 893-3437

9090 Junction Drive, Suite 9  
Annapolis Junction, Maryland 20701  
(301) 792-9448 - (301) 470-4470  
Fax (301) 792-7395


MEADOW RIDGE  
RETAINING WALL SPECIFICATIONS  
NORTH AND SOUTH WALL PLANS  
HOWARD COUNTY, MARYLAND

DATE	REVISIONS
7/30/99	REVISION TO NORTH, SOUTH, AND TIERED WALLS



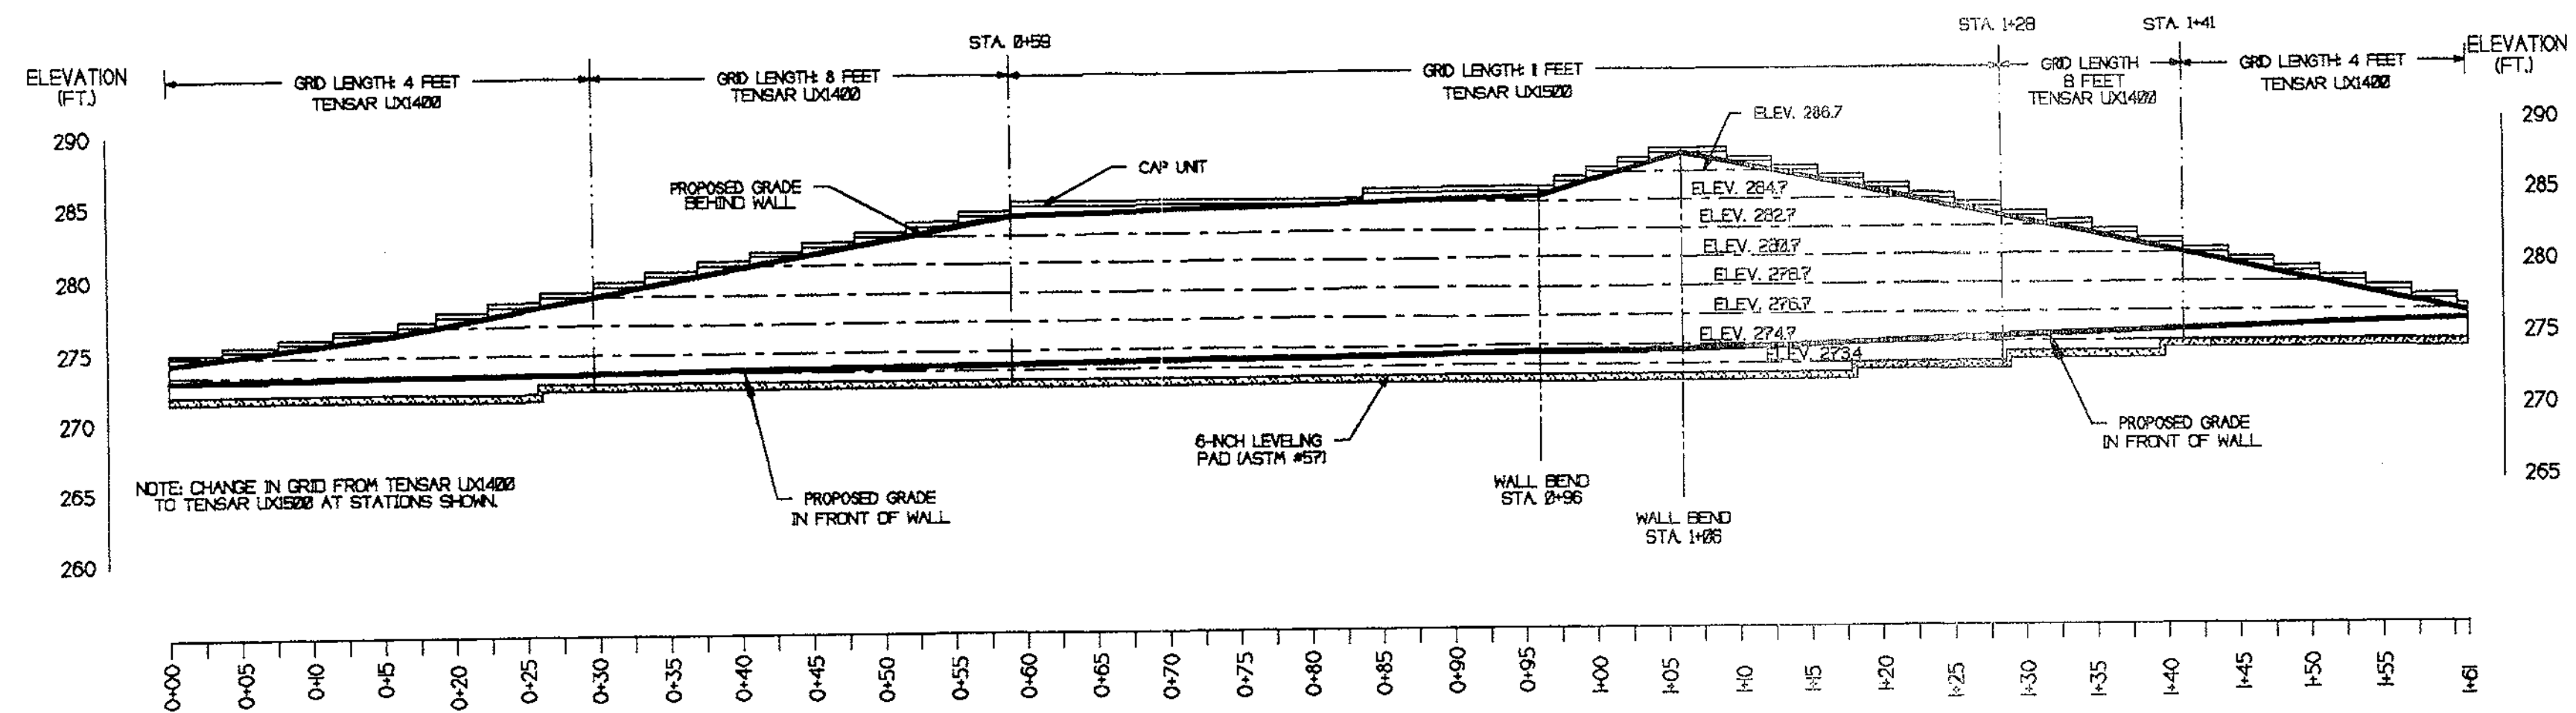

NORTH RETAINING WALL PROFILE  
SCALE: HORIZ. 1"=10'  
VERT. 1"=10'

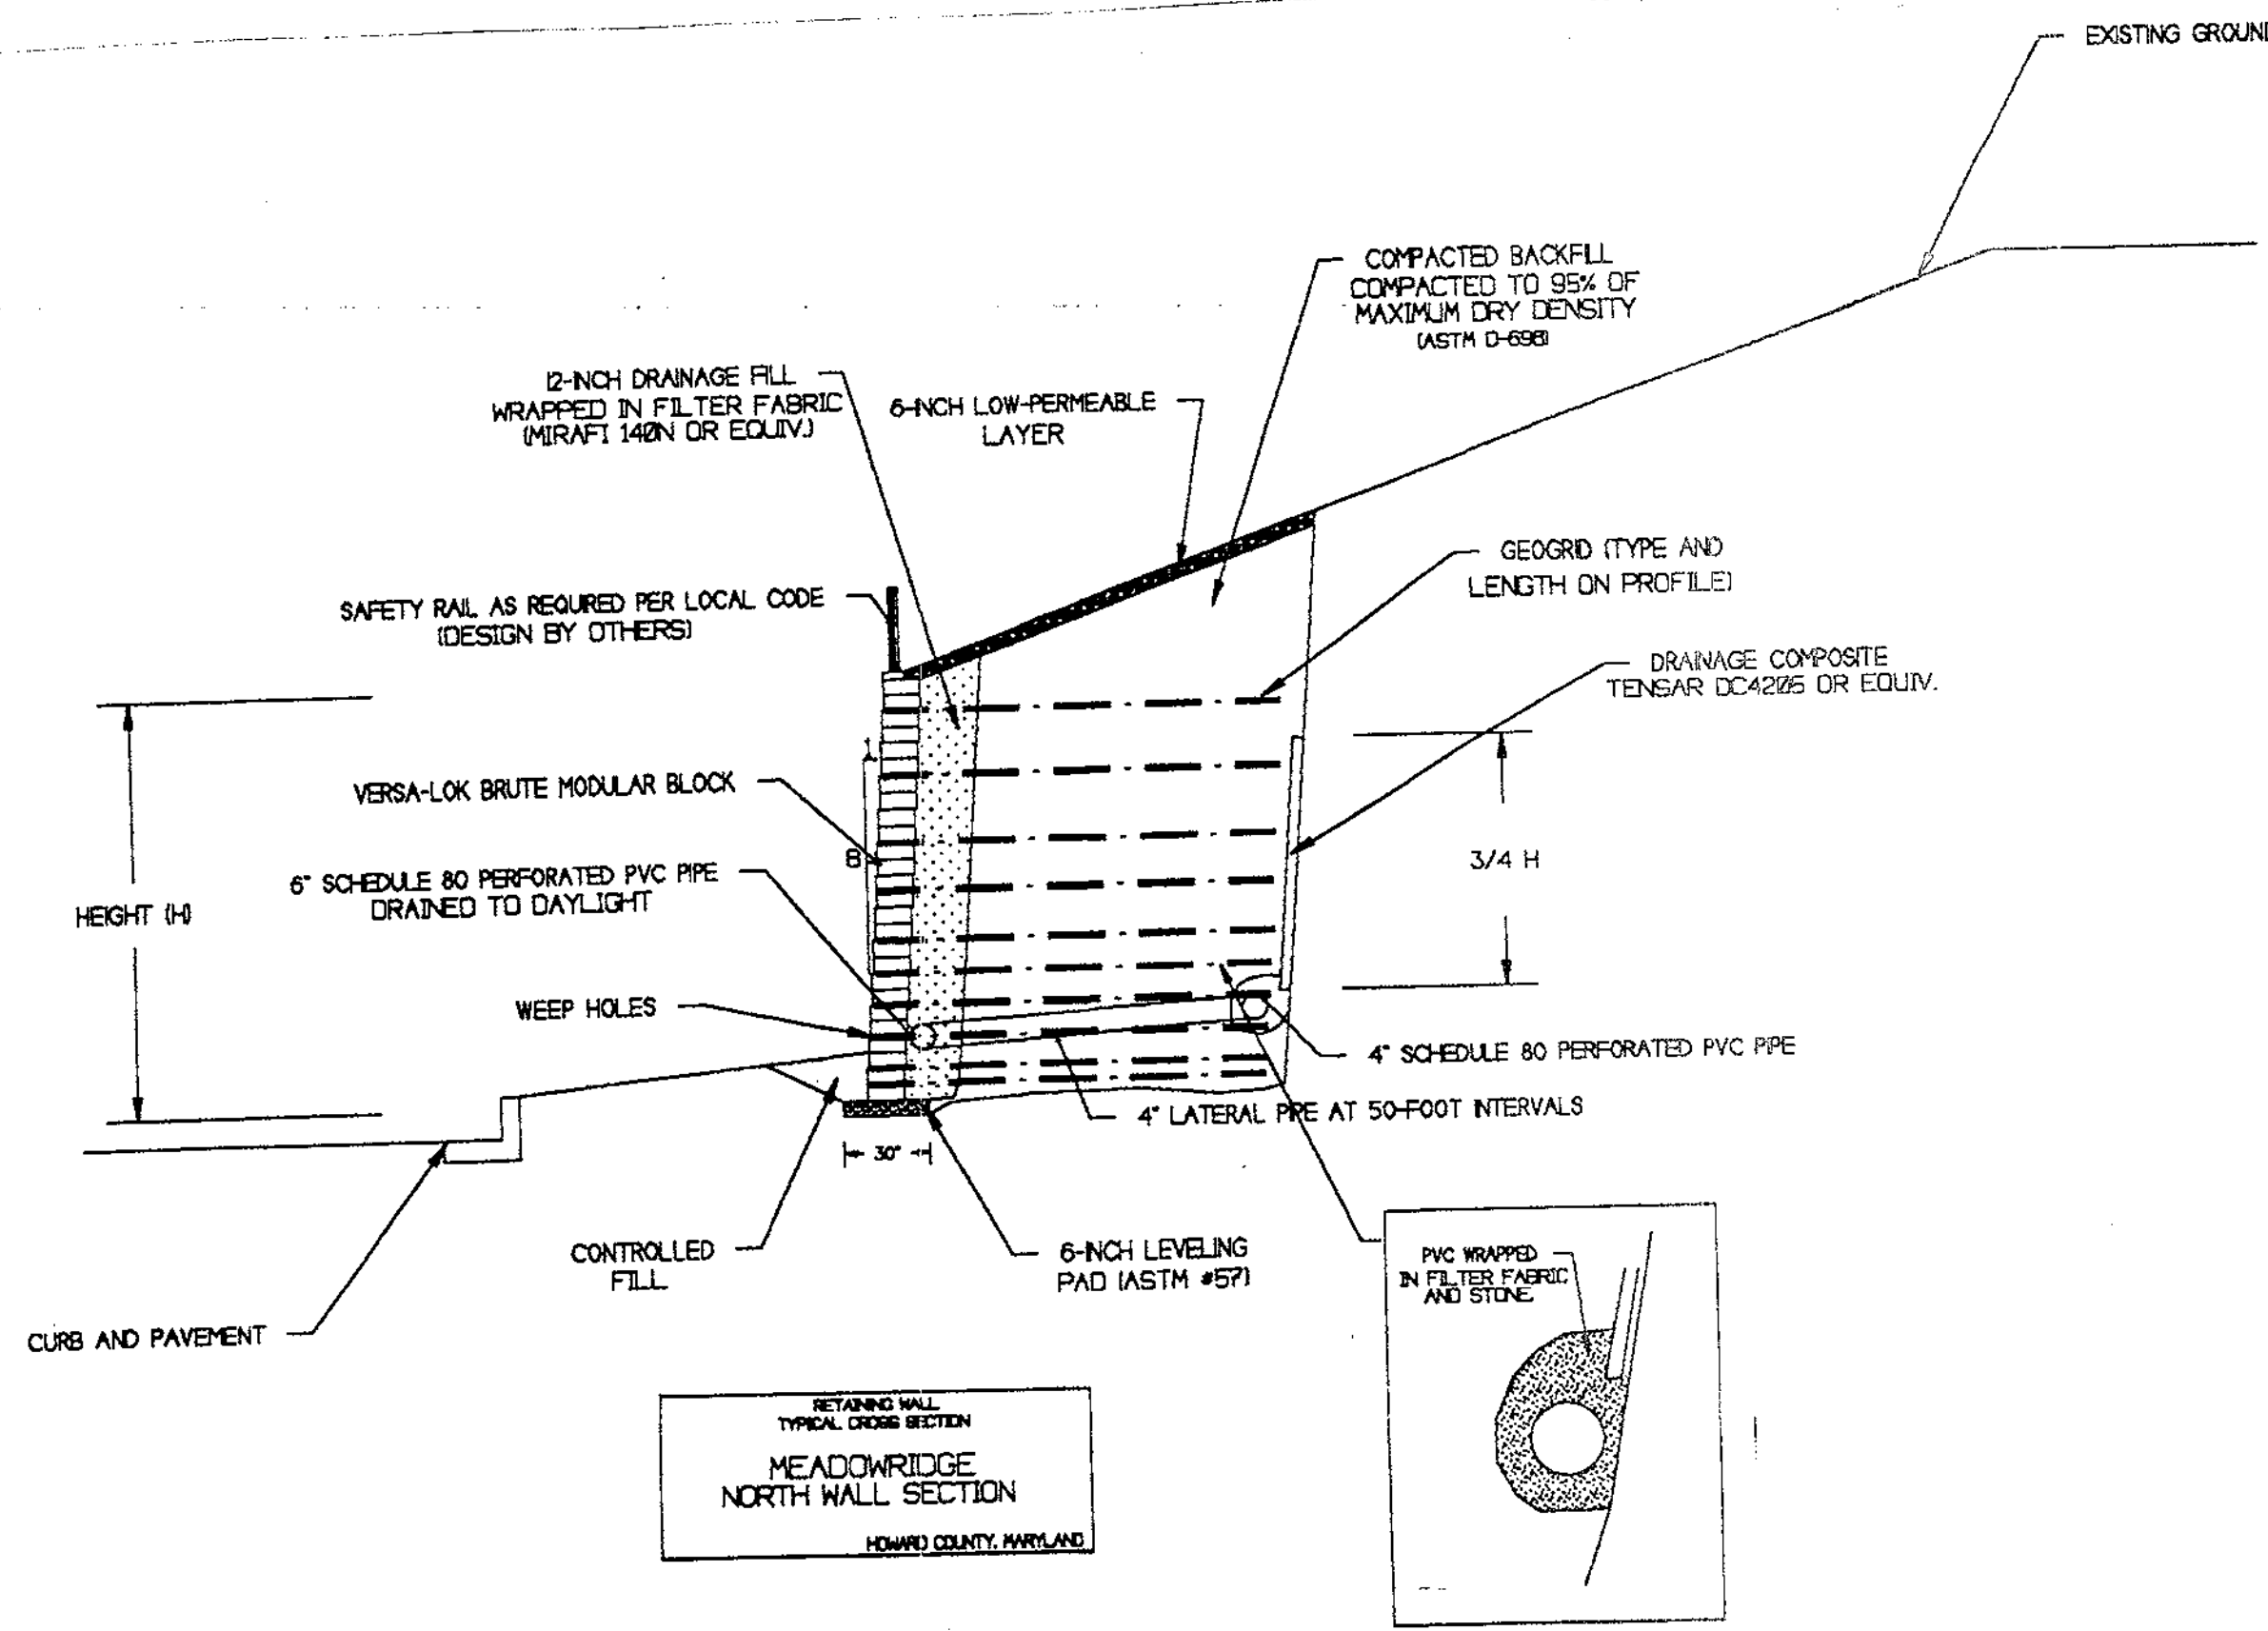

RETAINING WALL  
TYPICAL CROSS SECTION  
MEADOWRIDGE  
NORTH WALL SECTION  
HOWARD COUNTY, MARYLAND

**NOTE**  
PROPOSED CONSTRUCTION OF ALL RETAINING WALLS SHALL BE PERFORMED UNDER THE OBSERVATION OF A MARYLAND REGISTERED PROFESSIONAL ENGINEER.

- NORTH WALL AND SOUTH ENTRANCE WALL**
- 2 SOUTH ENTRANCE WALL CROSS SECTION MODIFICATIONS**
- A. VERSA-LOK BRUTE MODULAR BLOCK SHALL BE VERSA-LOK MODULAR BLOCK.
  - B. THE COMPACTED BACKFILL, COMPACTED TO 95% OF MAXIMUM DRY DENSITY OF ASTM D-698 SHALL BE CONFORMED TO AASHTO A-2-4 MATERIAL.
  - C. THE 6-INCH LEVELLING PAD (ASTM #75) CAN BE MSHA GAB MATERIAL.

APPROVED: HOWARD COUNTY DEPARTMENT OF PLANNING AND ZONING.

*James B. Smith* 10/24/99  
DIRECTOR DATE

*[Signature]* 10/16/99  
CHIEF, DEVELOPMENT ENGINEERING DIVISION DATE

*David Hamilton* 10/18/99  
CHIEF, DIVISION OF LAND DEVELOPMENT DATE

DATE	NO.	REVISION
OWNER/DEVELOPER		
PROLOGIS DEVELOPMENT SERVICES INCORPORATED 5200 EISENHOWER AVENUE, SECOND FLOOR ALEXANDRIA, VIRGINIA 22304 (703)751-9292		
PROJECT MEADOWRIDGE BUSINESS PARK PARCEL-G-2 2 WAREHOUSE BUILDINGS		
AREA TAX MAP NO. 37 ZONED M-1 PARCEL G-2 1st ELECTION DISTRICT HOWARD COUNTY, MARYLAND		
TITLE		

10-7-99

DESIGNED BY: JR/MG  
DRAWN BY: JR  
PROJECT NO: 00281.C  
DATE: OCTOBER 11, 1999  
SCALE: AS SHOWN  
DRAWING NO. 16 OF 25


**GTA**  
**GEO-TECHNOLOGY ASSOCIATES, INC.**  
GEOTECHNICAL AND ENVIRONMENTAL CONSULTANTS

42 N. Main Street, Suite 200 Towson, Maryland 21284 (301) 879-9446 (301) 893-3437  
906-D Bostley Avenue Towson, Maryland 21284 (301) 821-6366 (301) 821-1748  
9080 Junction Drive, Suite 9 Annapolis Junction, Maryland 20701 (301) 792-9445 (301) 470-4470 (301) 792-7395

MEADOWRIDGE  
NORTH WALL PROFILE AND SECTION  
HOWARD COUNTY, MARYLAND

DATE	REVISIONS	JOB NO.
7/30/99	REVISION TO NORTH, SOUTH, AND TIERED WALLS	
4/10/00	MODIFIED WALL SECTION	
		SCALE:
		DATE:
		DRAWN BY:
		DESIGN BY:
		REVIEW BY:
		SHEET:



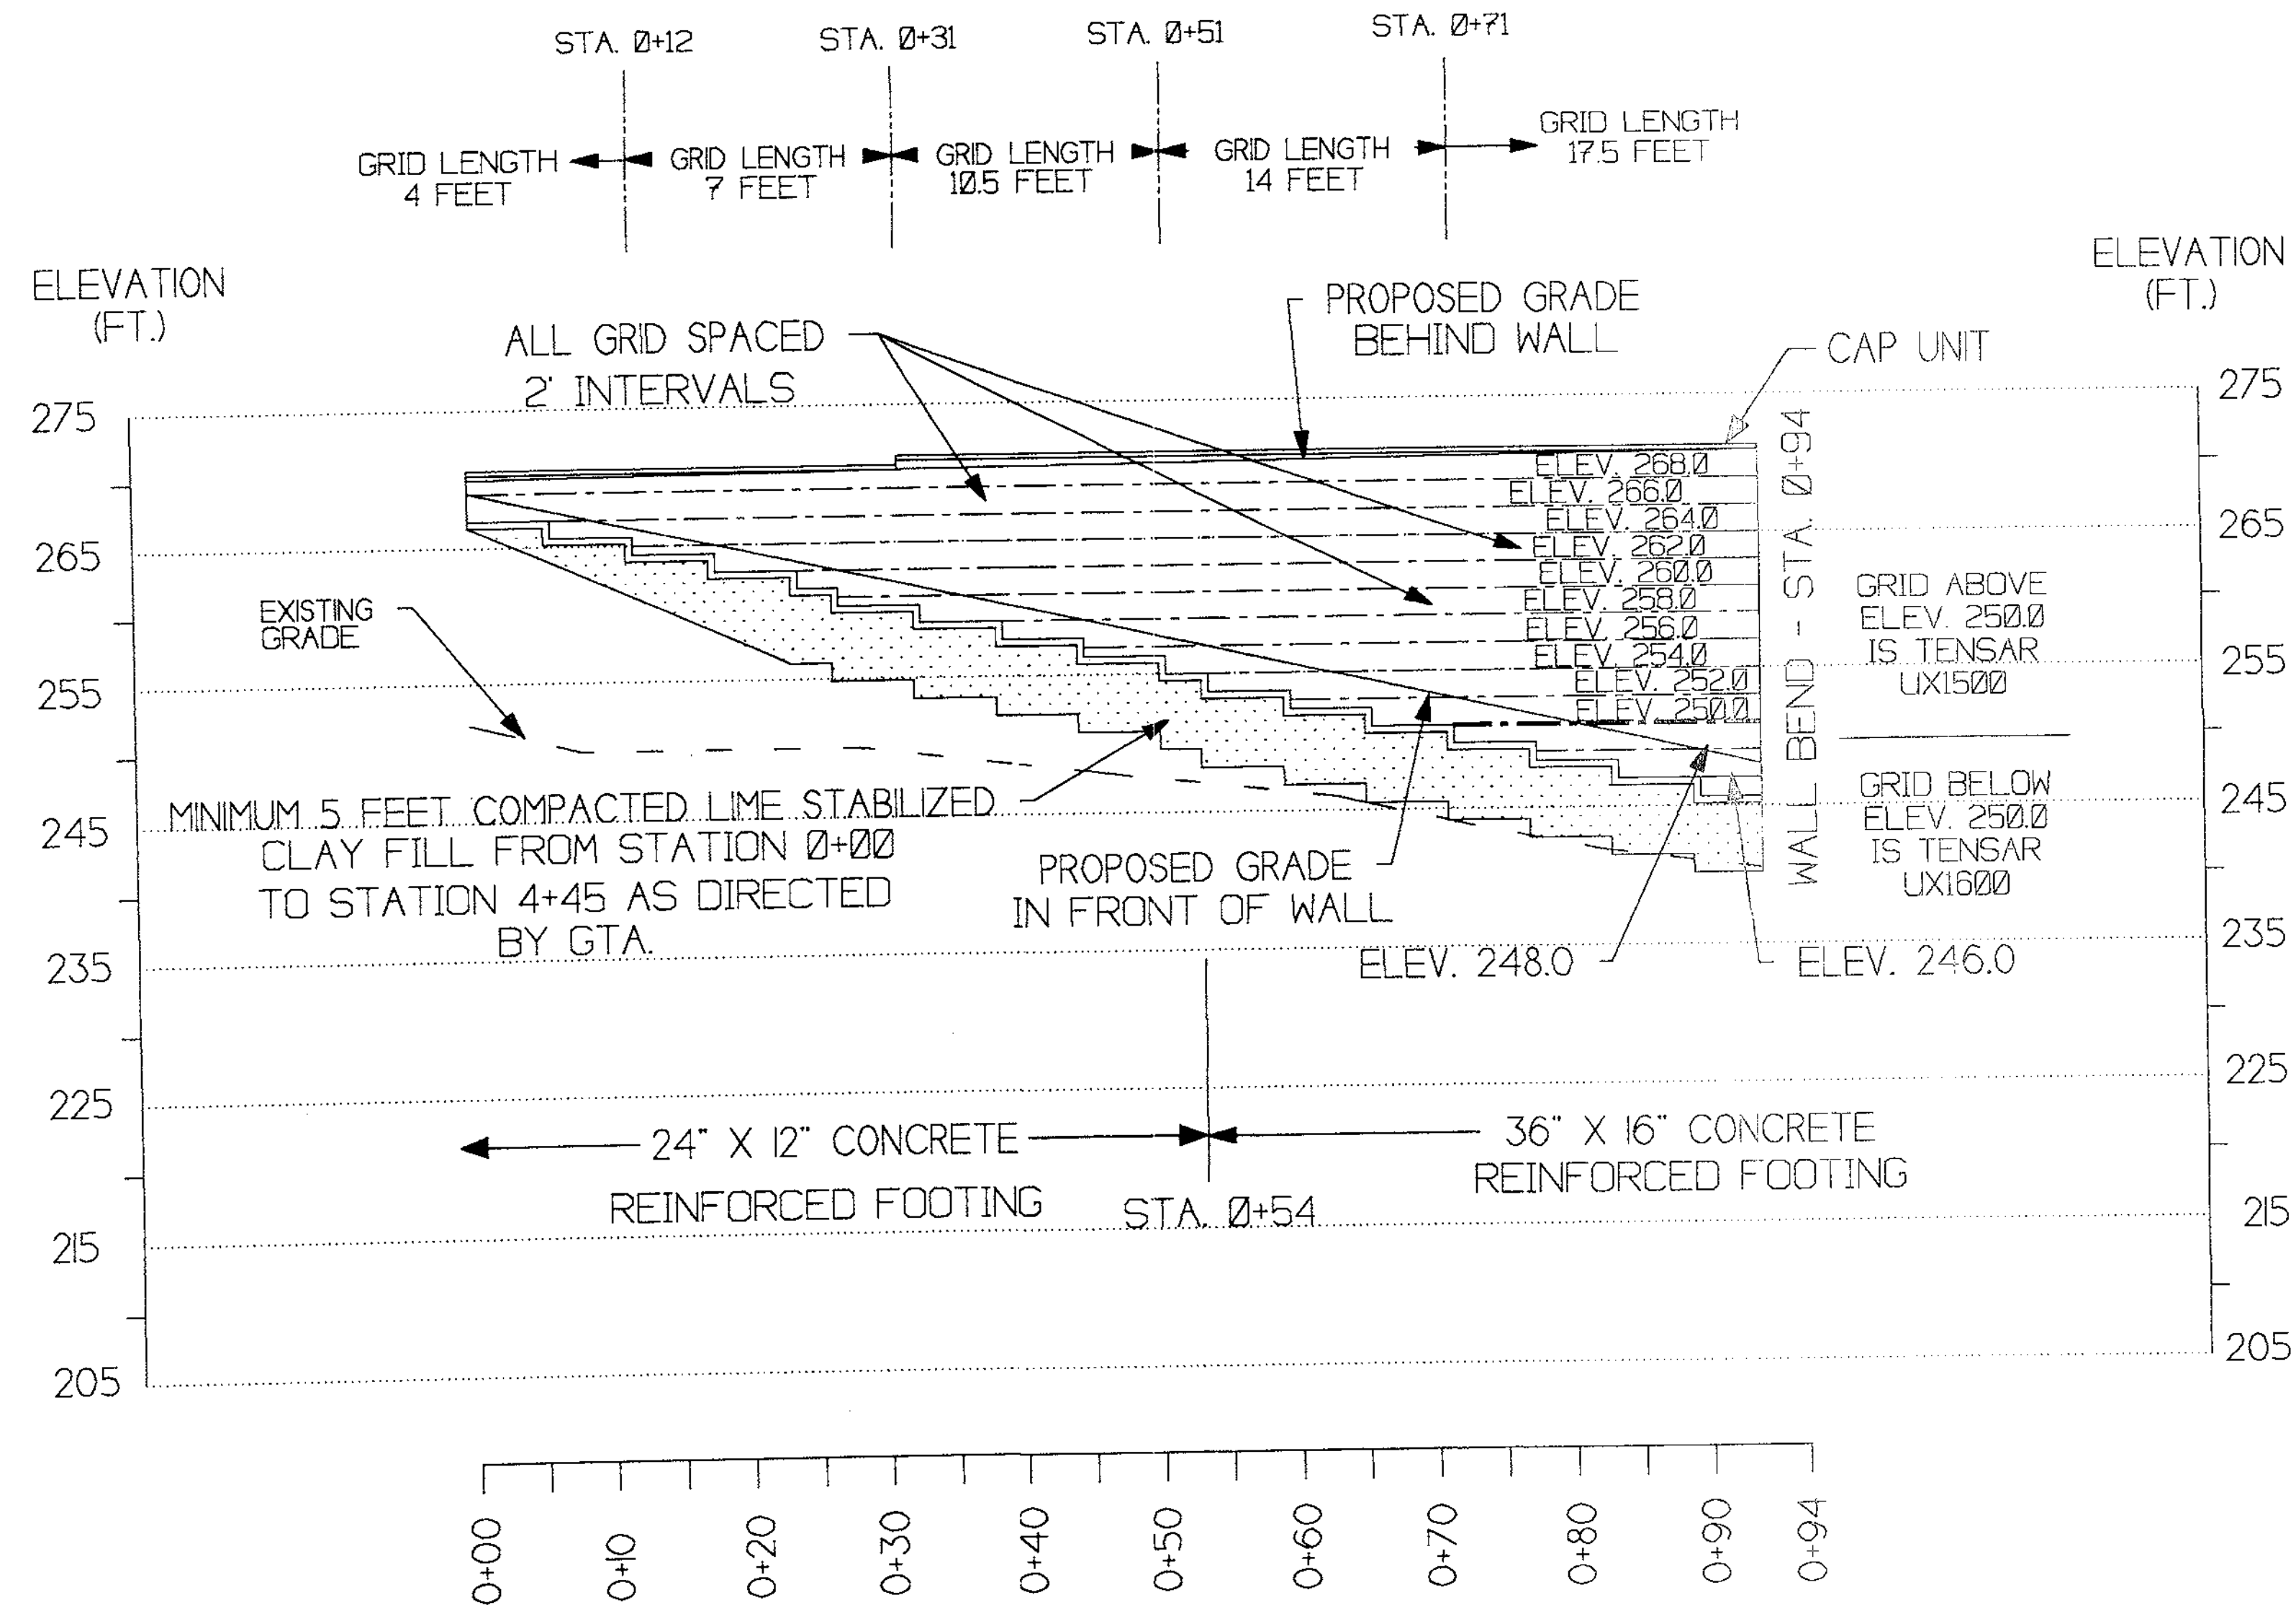

SOUTH RETAINING WALL PROFILE


STA. 0+00 TO STA. 0+94

SCALE: HORIZ. 1"=10'  
VERT. 1"=10'

APPROVED: HOWARD COUNTY DEPARTMENT OF PLANNING AND ZONING	
<i>[Signature]</i> DIRECTOR	10/19/99 DATE
<i>[Signature]</i> CHIEF, DEVELOPMENT ENGINEERING DIVISION	10/15/99 DATE
<i>[Signature]</i> CHIEF, DIVISION OF LAND DEVELOPMENT	10/15/99 DATE
DATE NO.	REVISION
OWNER/DEVELOPER PROLOGIS DEVELOPMENT SERVICES INCORPORATED 5200 EISENHOWER AVENUE, SECOND FLOOR ALEXANDRIA, VIRGINIA 22304 (703)751-9292	
PROJECT MEADOWRIDGE BUSINESS PARK PARCEL-G-2 2 WAREHOUSE BUILDINGS	
AREA TAX MAP NO. 37 ZONED M-1 PARCEL G-2 1st ELECTION DISTRICT HOWARD COUNTY, MARYLAND	
TITLE	
10-7-99 DATE	DESIGNED BY: JR/MG
	DRAWN BY: JR
	PROJECT NO: 99231.C
	DATE: OCTOBER 11, 1999
	SCALE: AS SHOWN
	DRAWING NO. 17 OF 25

	<b>GEO-TECHNOLOGY ASSOCIATES, INC.</b> GEOTECHNICAL AND ENVIRONMENTAL CONSULTANTS	
	<small>           42 N. Main Street, Suite 200 Bel Air, Maryland 21014 (301) 879-9446 - (301) 826-9123 Fax: (301) 895-3437           <span style="margin-left: 20px;">             808-D Bosley Avenue Towson, Maryland 21204 (301) 821-6386 Fax: (301) 821-1748             <span style="margin-left: 20px;">               8090 Junction Drive, Suite 9 Annapolis Junction, Maryland 20701 (301) 792-9446 - (301) 470-4470 Fax: (301) 792-7395             </span> </span> </small>	
MEADOWRIDGE SOUTH WALL PROFILE FROM STA. 0+00 TO 0+94 HOWARD COUNTY, MARYLAND		
DATE	REVISIONS	JOB NO.
7/30/99	REVISION TO NORTH, SOUTH, AND TIERED WALLS	SCALE:
		DATE:
		DRAWN BY:
		DESIGN BY:
		REVIEW BY:
		SHEET:



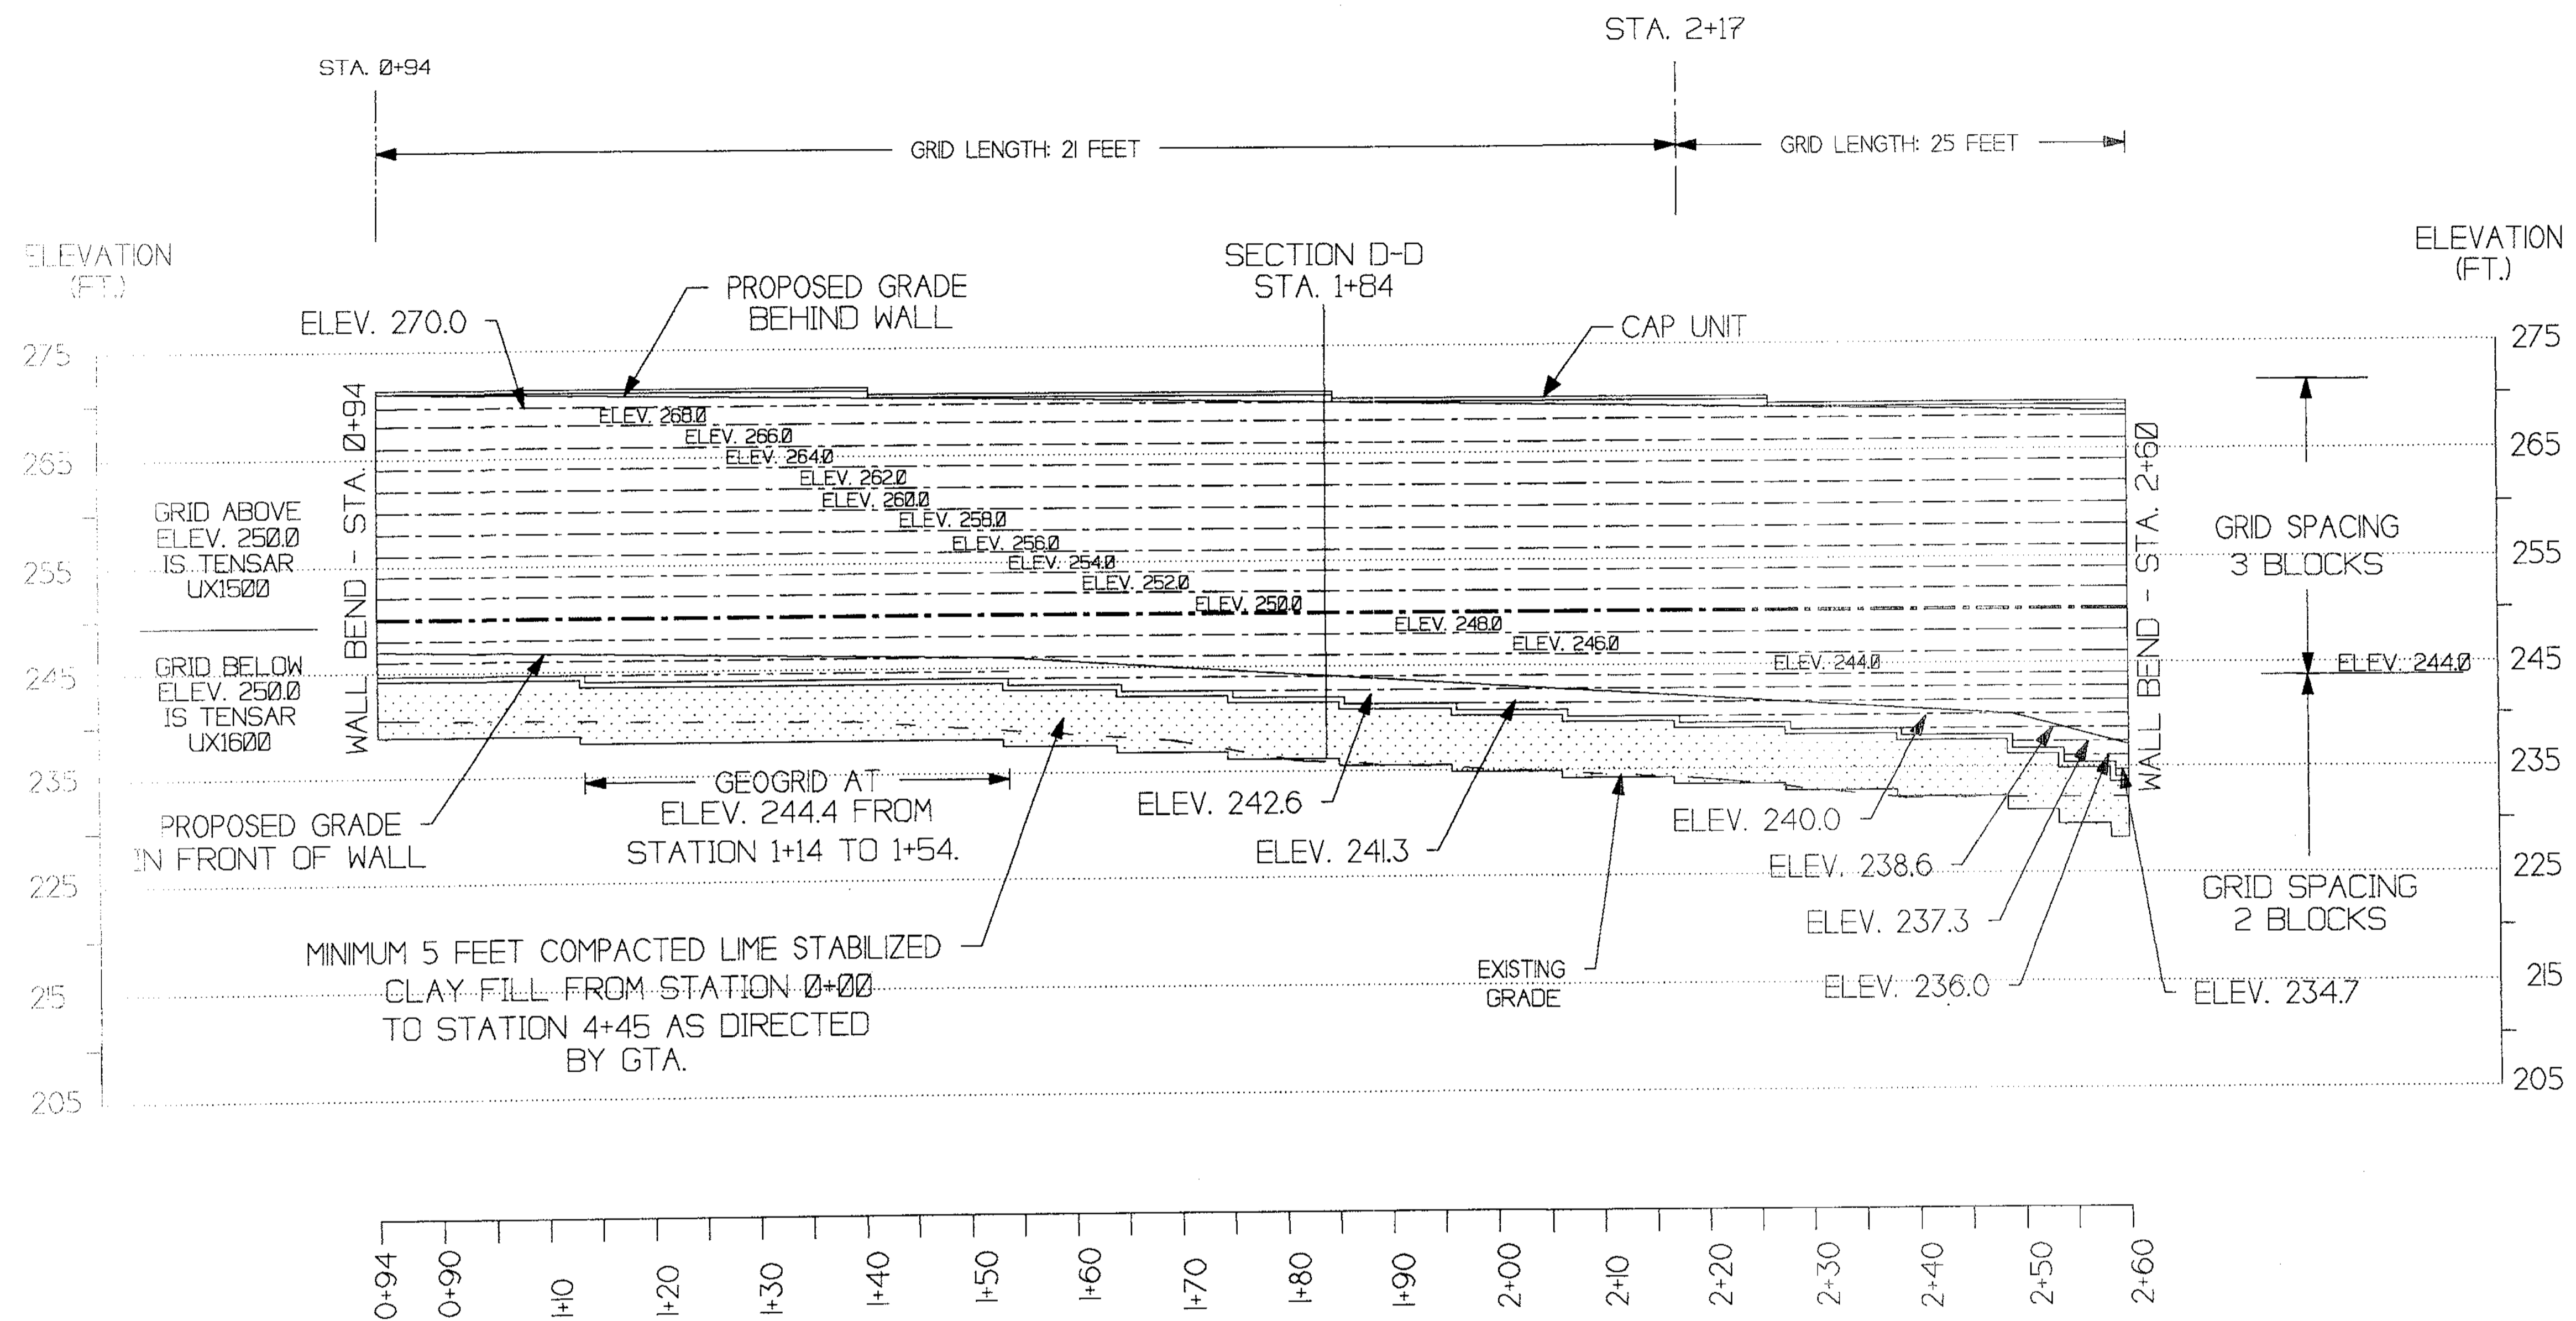

SOUTH RETAINING WALL PROFILE

STA. 0+94 TO STA. 2+60

SCALE: HORIZ. 1"=10'  
VERT. 1"=10'

APPROVED : HOWARD COUNTY DEPARTMENT OF PLANNING AND ZONING.

*James Smith* 10/12/99  
DIRECTOR DATE

*[Signature]* 10/15/99  
CHIEF, DEVELOPMENT ENGINEERING DIVISION DATE

*[Signature]* 10/18/99  
CHIEF, DIVISION OF LAND DEVELOPMENT DATE

DATE NO.	REVISION
OWNER/DEVELOPER	
PROLOGIS DEVELOPMENT SERVICES INCORPORATED 5200 EISENHOWER AVENUE, SECOND FLOOR ALEXANDRIA, VIRGINIA 22304 (703)751-9292	
PROJECT MEADOWRIDGE BUSINESS PARK PARCEL-G-2 2 WAREHOUSE BUILDINGS	
AREA TAX MAP NO. 37 ZONED M-1 PARCEL G-2 1st ELECTION DISTRICT HOWARD COUNTY, MARYLAND	
TITLE	

10-7-99  
DATE

DESIGNED BY : JR/MG

DRAWN BY: JR

PROJECT NO : 99231.C

DATE : OCTOBER 11, 1999

SCALE : AS SHOWN

DRAWING NO. 18 OF 25



**GTA** GEO-TECHNOLOGY ASSOCIATES, INC.  
GEOTECHNICAL AND ENVIRONMENTAL CONSULTANTS

42 N. Main Street, Suite 200 Bel Air, Maryland 21014 (301) 879-9446 (301) 836-9123 Fax: (301) 893-3437

608-D Bosley Avenue Towson, Maryland 21284 (301) 821-6386 Fax: (301) 821-1748

9090 Junction Drive, Suite 9 Annapolis Junction, Maryland 20701 (301) 792-9446 (301) 470-4470 Fax: (301) 792-7395


MEADOWRIDGE  
SOUTH WALL PROFILE  
FROM STA. 0+94 TO STA. 2+60  
HOWARD COUNTY, MARYLAND

DATE	REVISIONS	JOB NO.
7/30/99	REVISION TO NORTH, SOUTH, AND TIERED WALLS	SCALE:
		DATE:
		DRAWN BY:
		DESIGN BY:
		REVIEW BY:
		SHEET:







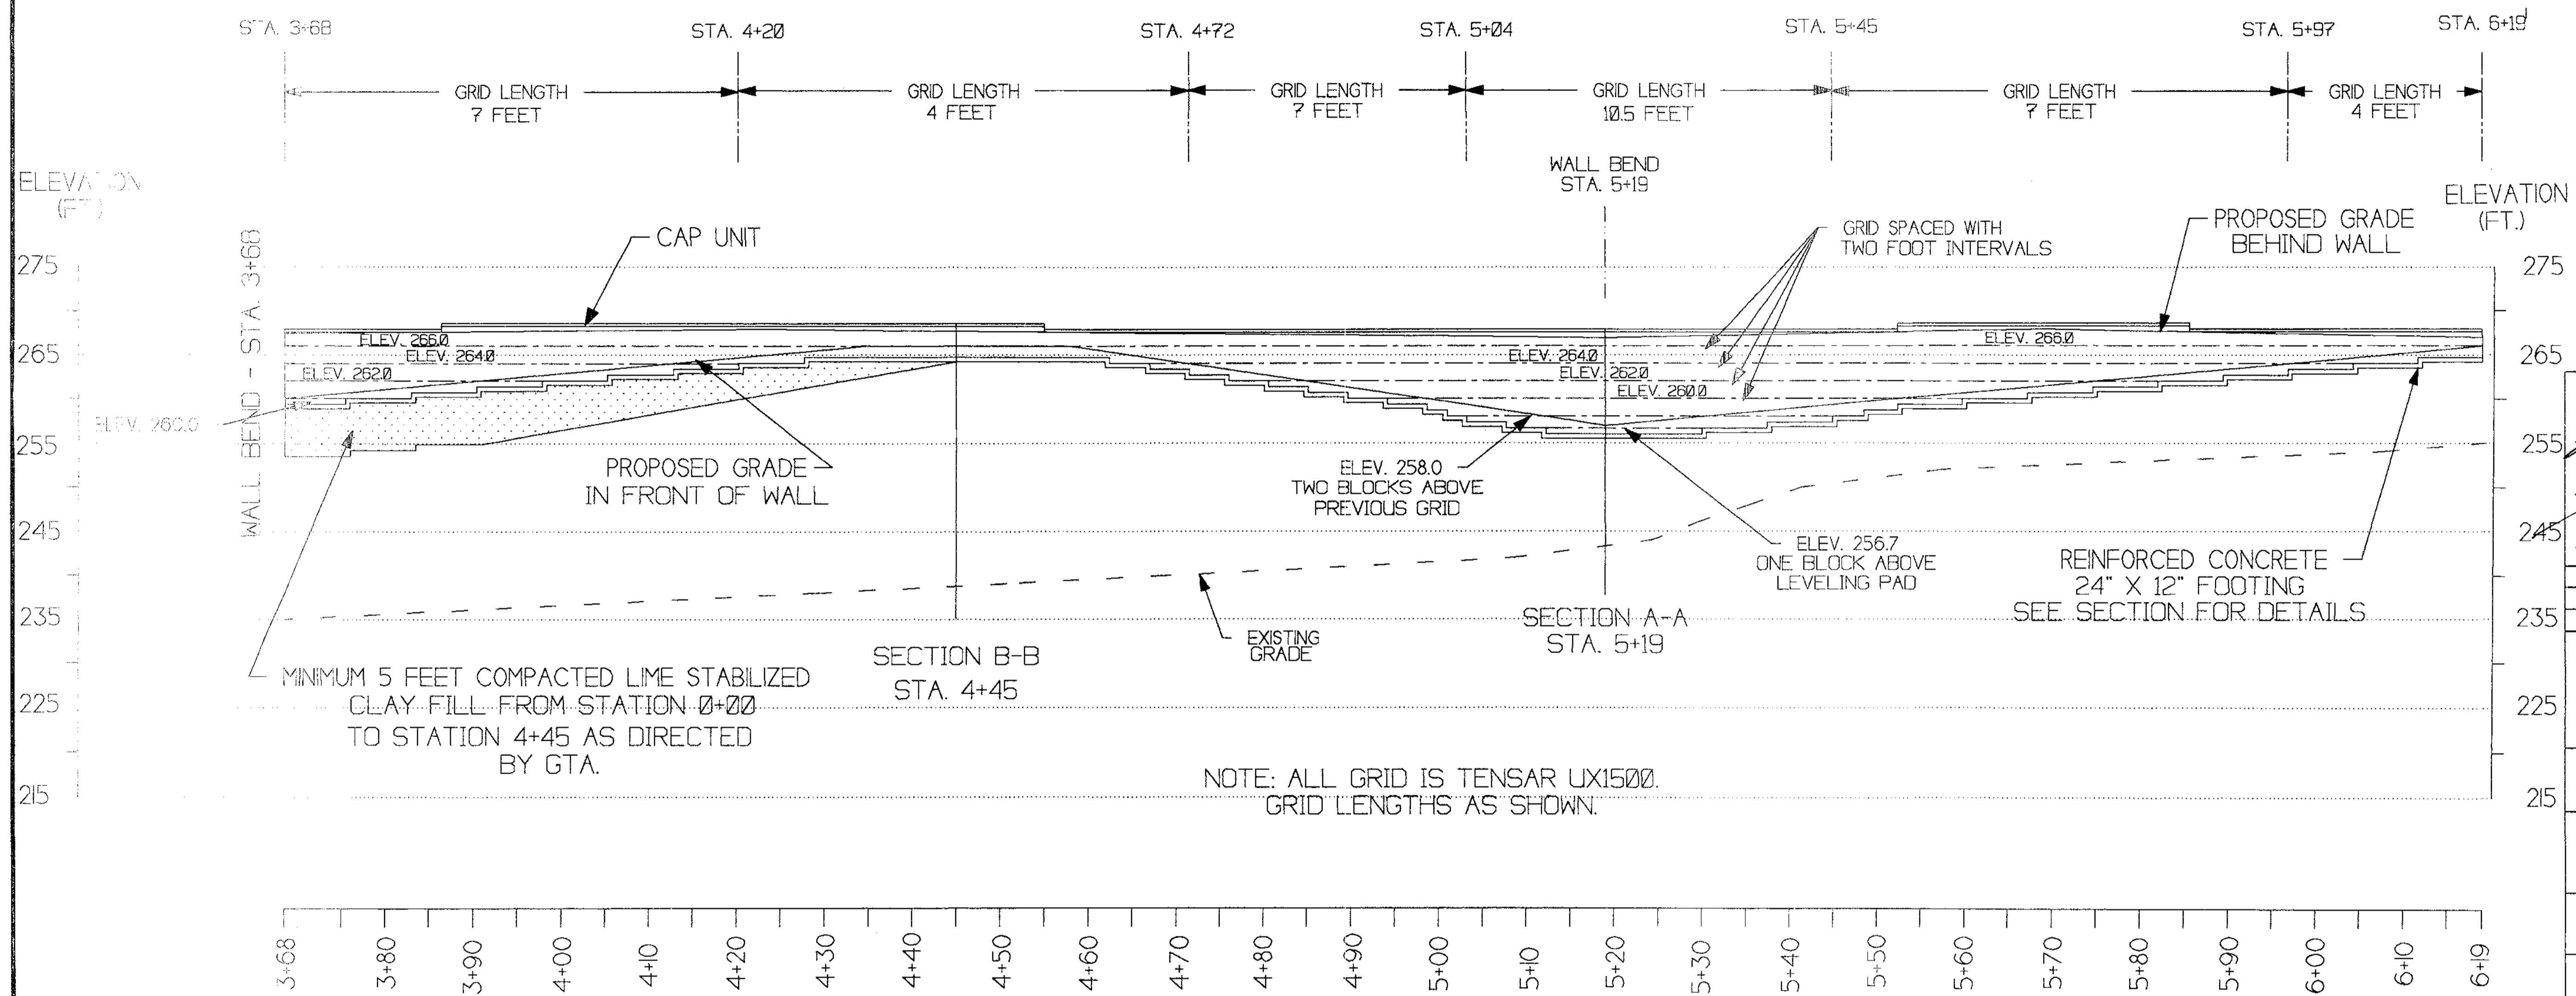

**SOUTH RETAINING WALL PROFILE**  
 STA. 3+68 TO STA. 6+19  
 SCALE: HORIZ. 1"=10'  
 VERT. 1"=10'

APPROVED : HOWARD COUNTY DEPARTMENT OF PLANNING AND ZONING.  
*[Signature]* 10/12/99  
 DIRECTOR DATE  
*[Signature]* 10/15/99  
 CHIEF, DEVELOPMENT ENGINEERING DIVISION DATE  
*[Signature]* 10/15/99  
 CHIEF, DIVISION OF LAND DEVELOPMENT DATE

DATE	NO.	REVISION
OWNER/DEVELOPER		
PROLOGIS DEVELOPMENT SERVICES INCORPORATED 5200 EISENHOWER AVENUE, SECOND FLOOR ALEXANDRIA, VIRGINIA 22304 (703)751-9292		
PROJECT MEADOWRIDGE BUSINESS PARK PARCEL G-2 2 WAREHOUSE BUILDINGS		
AREA TAX MAP NO. 37 ZONED M-1 PARCEL G-2 1st ELECTION DISTRICT HOWARD COUNTY, MARYLAND		
TITLE		

10-7-99  
 DATE  
 DESIGNED BY : JR/MG  
 DRAWN BY: JR  
 PROJECT NO : 99231.C  
 DATE : OCTOBER 11, 1999  
 SCALE : AS SHOWN  
 DRAWING NO. 20 OF 25



**GTA**  
**GEO-TECHNOLOGY ASSOCIATES, INC.**  
 GEOTECHNICAL AND ENVIRONMENTAL CONSULTANTS  

 42 N. Main Street, Suite 200 Bel Air, Maryland 21014 (301) 879-9448 - (301) 836-9123 Fax: (301) 893-3437  
 606-D Bosley Avenue Towson, Maryland 21284 (301) 821-6366 Fax: (301) 821-1748  
 3390 Junction Drive, Suite 9 Annapolis Junction, Maryland 20701 (301) 792-9446 - (301) 470-4470 Fax: (301) 792-7395



**MEADOWRIDGE**  
**SOUTH WALL PROFILE**  
**FROM STA. 3+68 TO STA. 6+19**  
**HOWARD COUNTY, MARYLAND**

DATE	REVISIONS	JOB NO.
7/30/99	REVISION TO NORTH, SOUTH, AND TIERED WALLS	SCALE:
		DATE:
		DRAWN BY:
		DESIGN BY:
		REVIEW BY:
		SHEET:



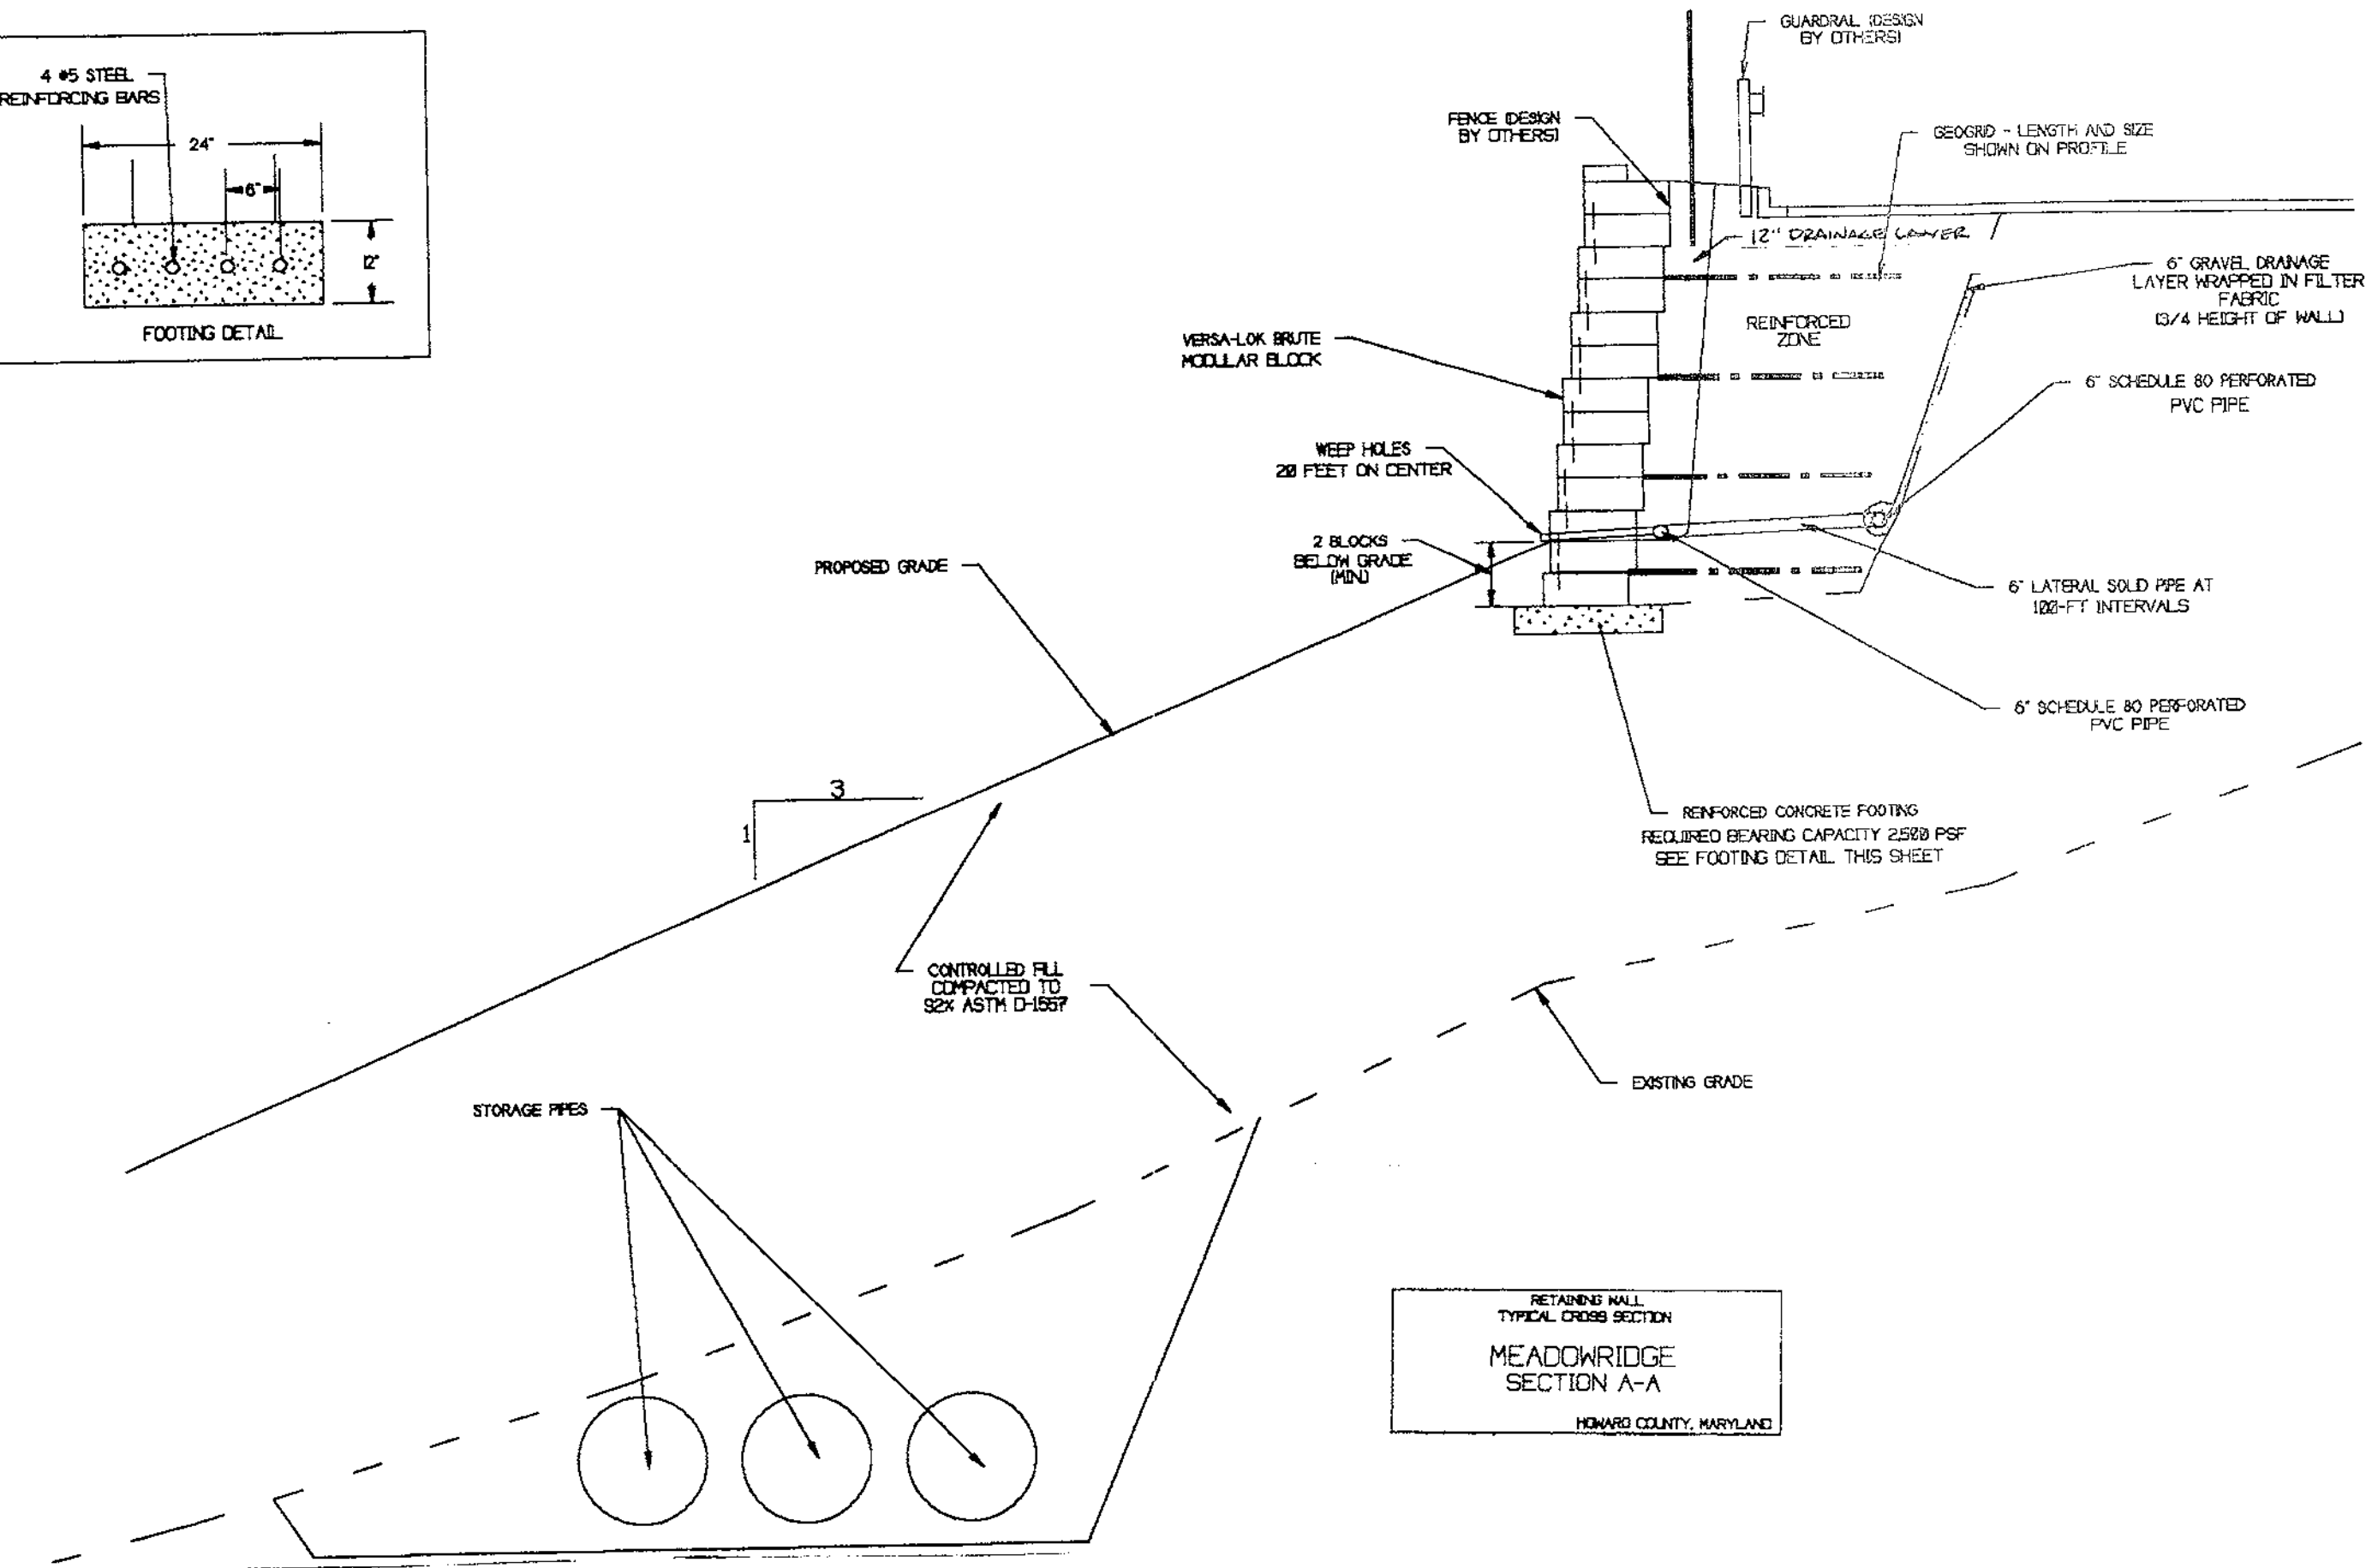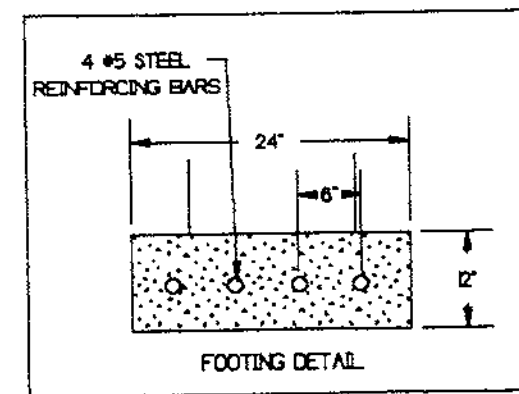

RETAINING WALL  
TYPICAL CROSS SECTION  
MEADOWRIDGE  
SECTION A-A  
HOWARD COUNTY, MARYLAND

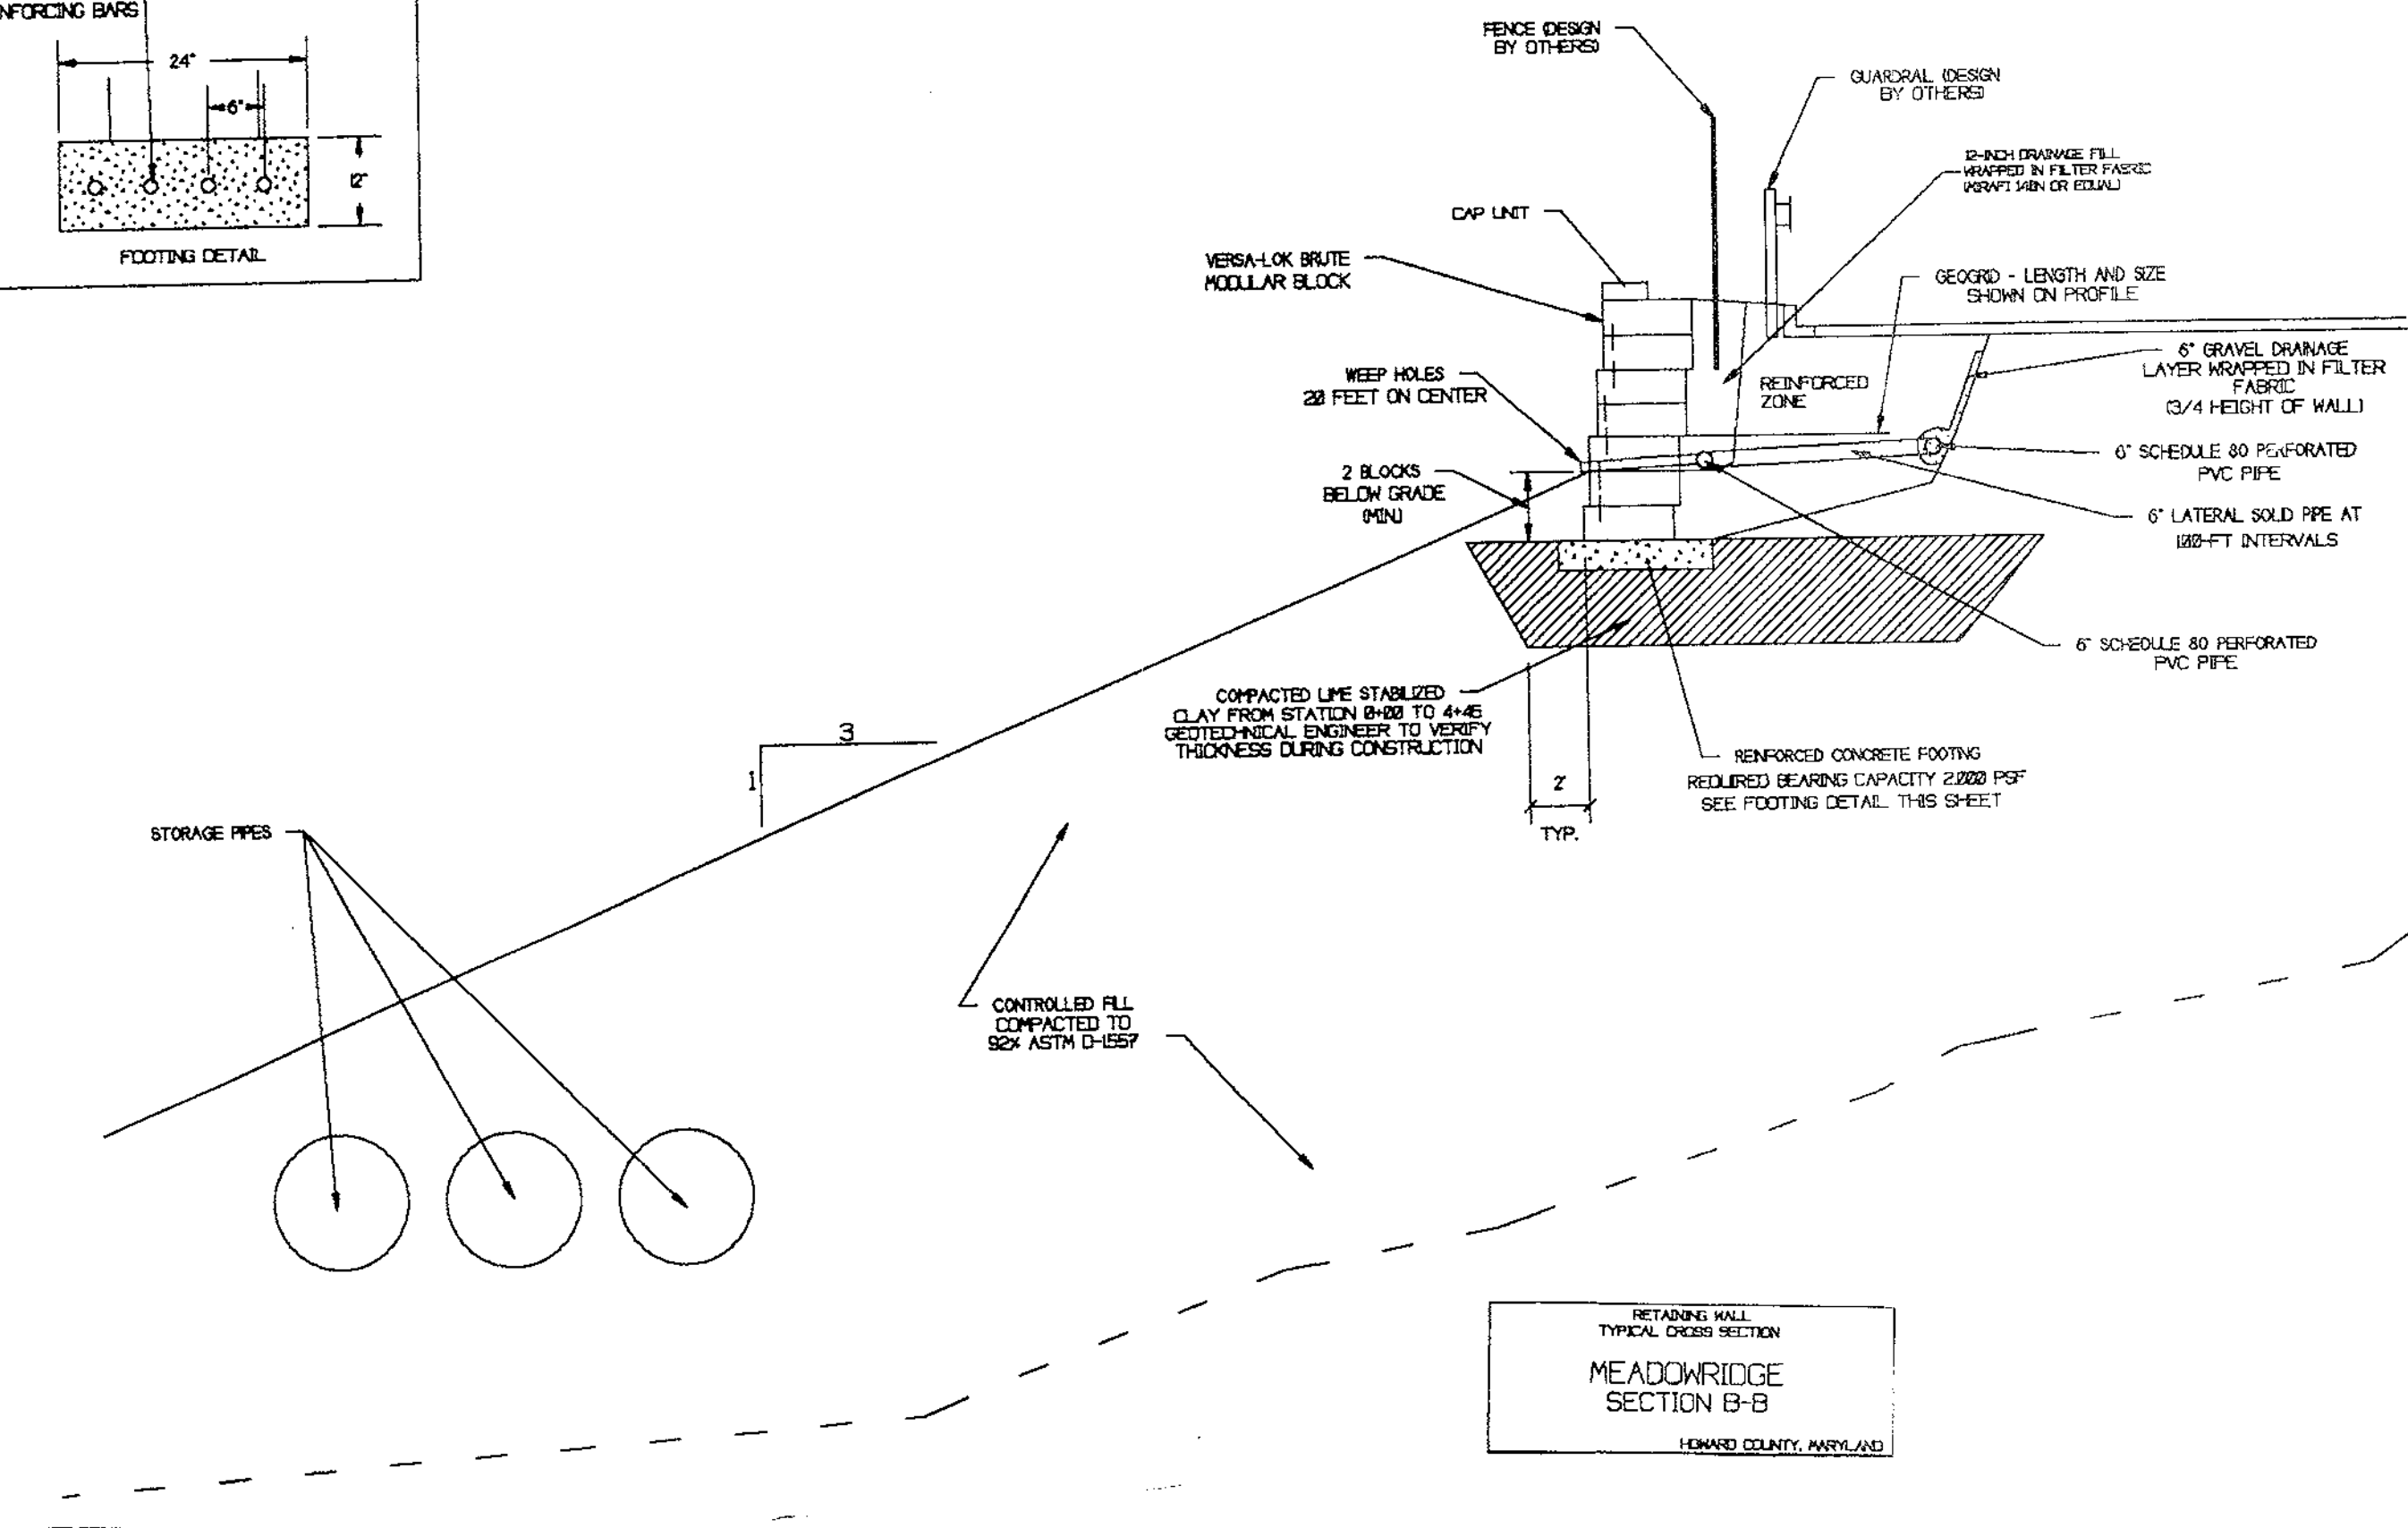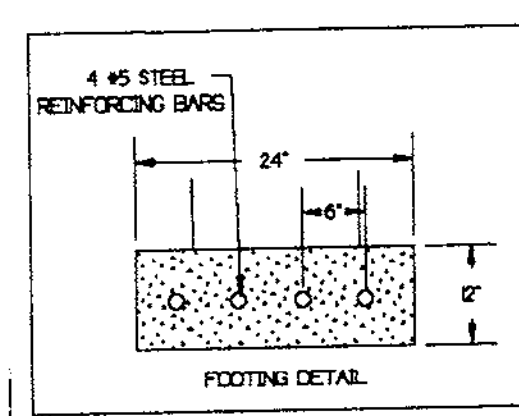

RETAINING WALL  
TYPICAL CROSS SECTION  
MEADOWRIDGE  
SECTION B-B  
HOWARD COUNTY, MARYLAND

APPROVED: HOWARD COUNTY DEPARTMENT OF PLANNING AND ZONING.

*John Smith* 10/19/99  
DIRECTOR DATE

*[Signature]* 10/15/99  
CHIEF, DEVELOPMENT ENGINEERING DIVISION DATE

*Christy Hamilton* 10/15/99  
CHIEF, DIVISION OF LAND DEVELOPMENT DATE

OWNER/DEVELOPER

PROLOGIS DEVELOPMENT SERVICES INCORPORATED  
5200 EISENHOWER AVENUE, SECOND FLOOR  
ALEXANDRIA, VIRGINIA 22304  
(703)751-9292

PROJECT MEADOWRIDGE BUSINESS PARK  
PARCEL-C-2  
2 WAREHOUSE BUILDINGS

AREA TAX MAP NO. 37 ZONED M-1 PARCEL G-2  
1st ELECTION DISTRICT  
HOWARD COUNTY, MARYLAND

10-7-99  
DATE

DESIGNED BY: JR/MG  
DRAWN BY: JR  
PROJECT NO: 99231.C  
DATE: OCTOBER 11, 1999  
SCALE: AS SHOWN  
DRAWING NO. 21 OF 25



**GTA** GEO-TECHNOLOGY ASSOCIATES, INC.  
GEOTECHNICAL AND ENVIRONMENTAL CONSULTANTS

42 N. Main Street, Suite 200 Bel Air, Maryland 21014 (301) 879-9446 • (301) 836-8123 Fax: (301) 893-3437

806-D Bosley Avenue Towson, Maryland 21204 (301) 821-6386 Fax: (301) 821-1748

9090 Junction Drive, Suite 9 Annapolis Junction, Maryland 20701 (301) 792-9446 • (301) 470-4470 Fax: (301) 792-7395


MEADOWRIDGE  
SOUTH WALL SECTION A-A AND SECTION B-B  
HOWARD COUNTY, MARYLAND

DATE	REVISIONS	JOB NO:
7/30/99	REVISION TO NORTH, SOUTH, AND TIERED WALLS	SCALE:
		DATE:
		DRAWN BY:
		DESIGN BY:
		REVIEW BY:
		SHEET:









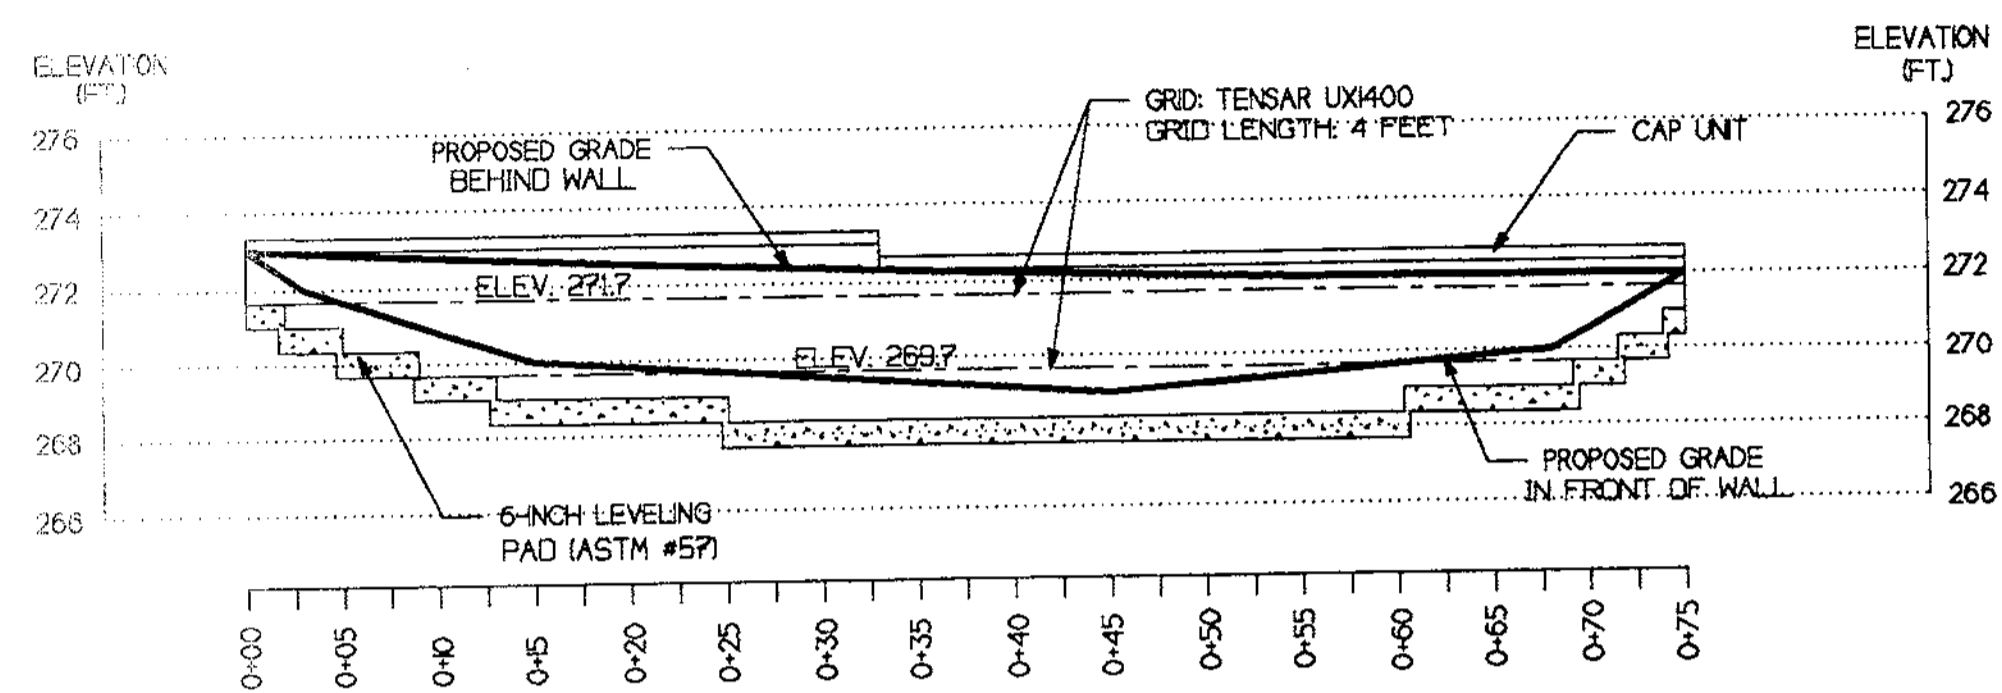



TIERED RETAINING WALL  
UPPER WALL  
SCALE: HORIZ. 1"=10'  
VERT. 1"=5'

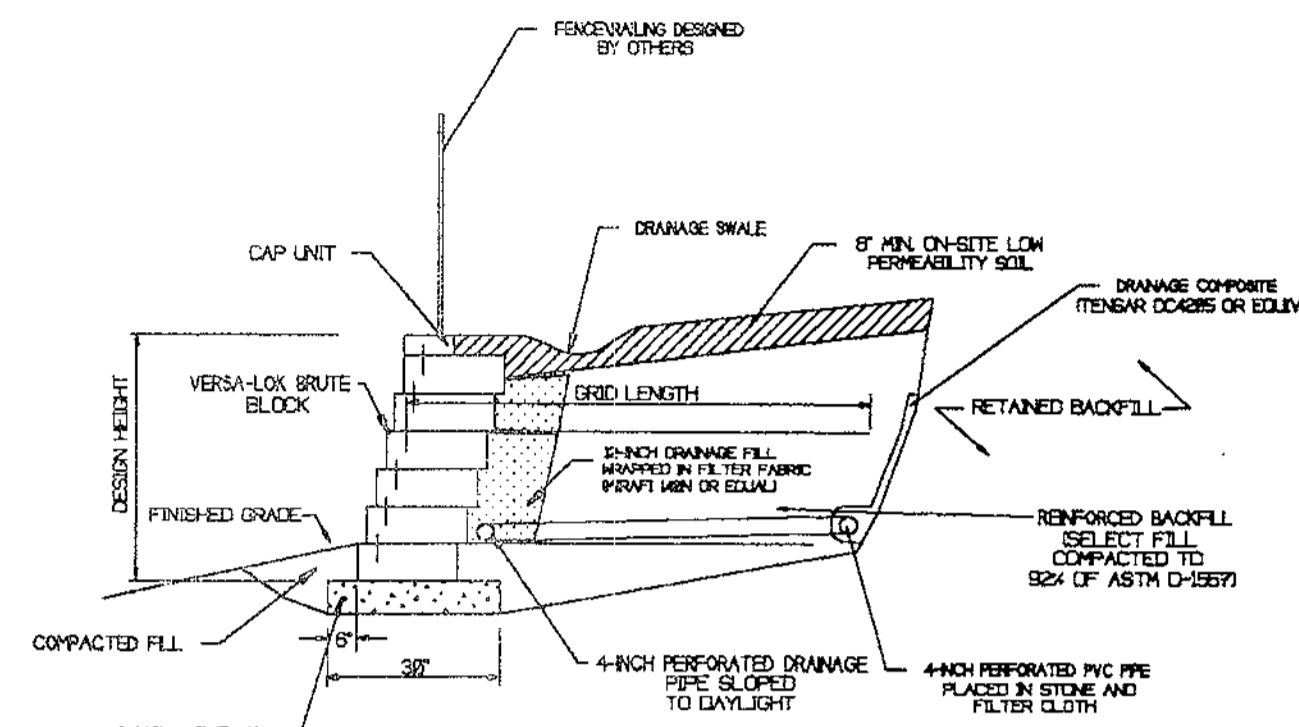

TYPICAL REINFORCED SECTION  
VERSALOK BRUTE BLOCK  
SCALE: AS SHOWN

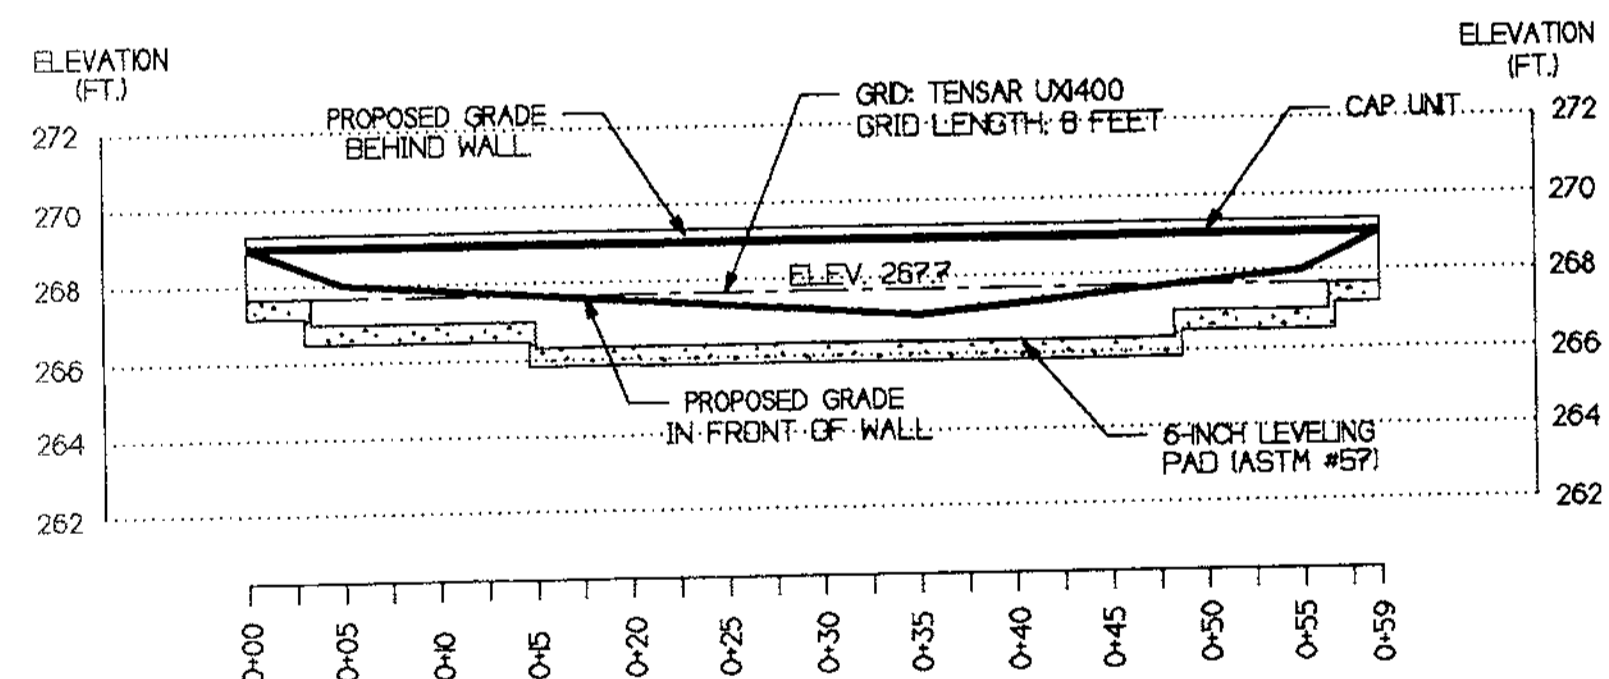


TIERED RETAINING WALL  
LOWER WALL  
SCALE: HORIZ. 1"=10'  
VERT. 1"=5'

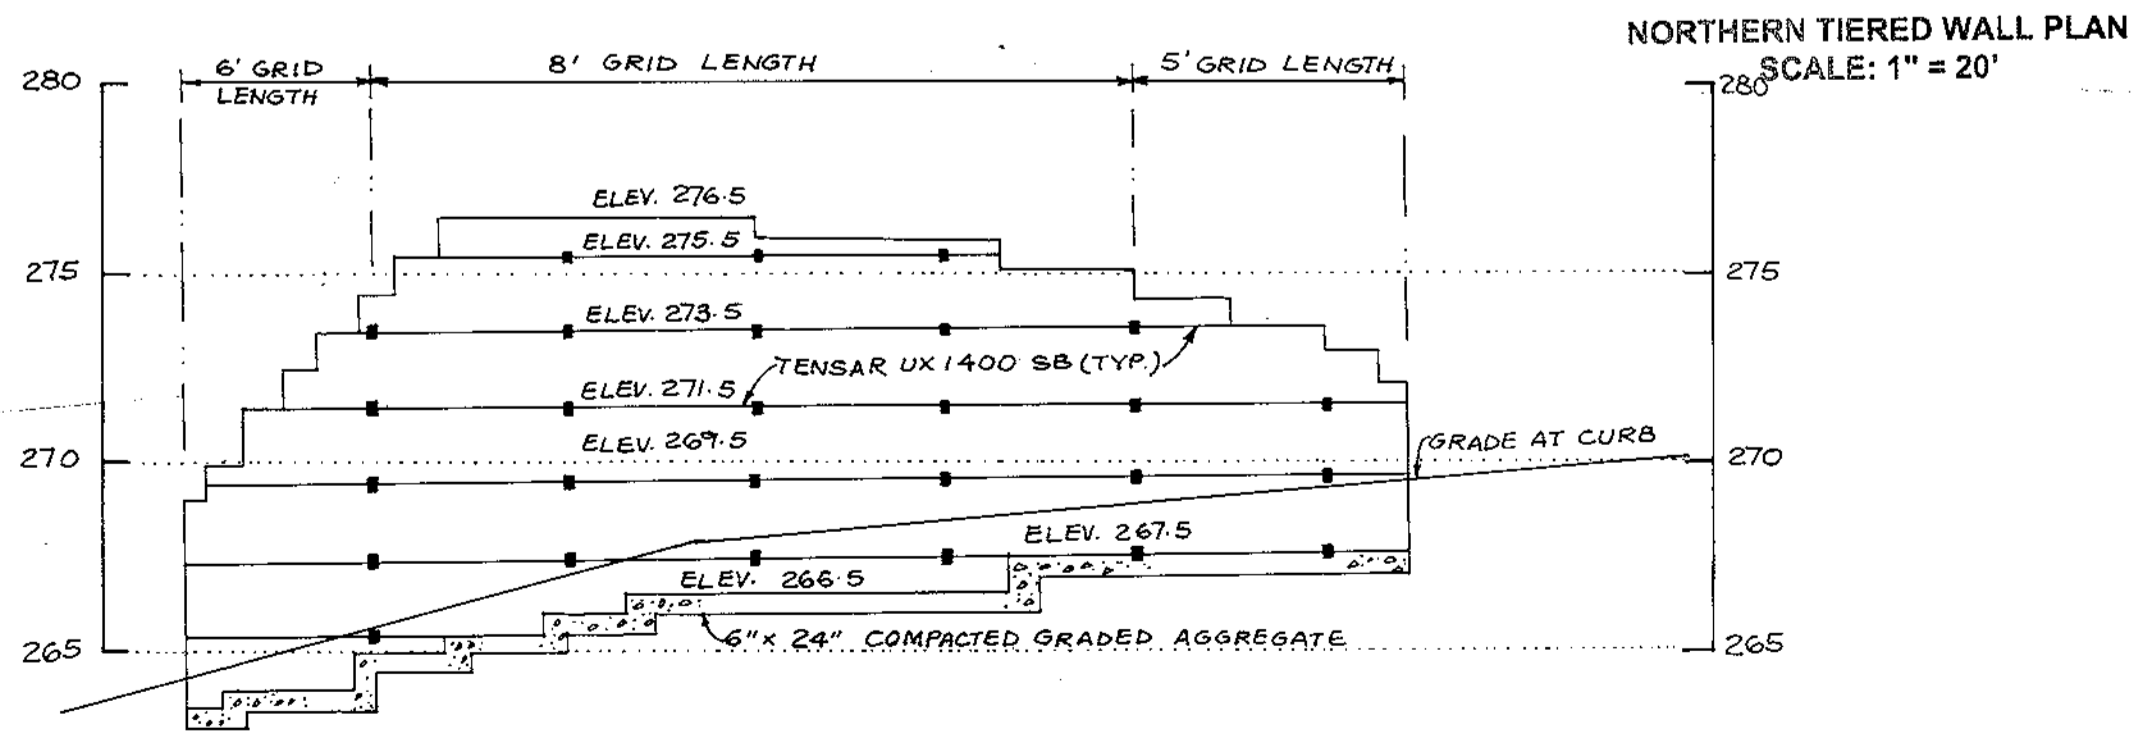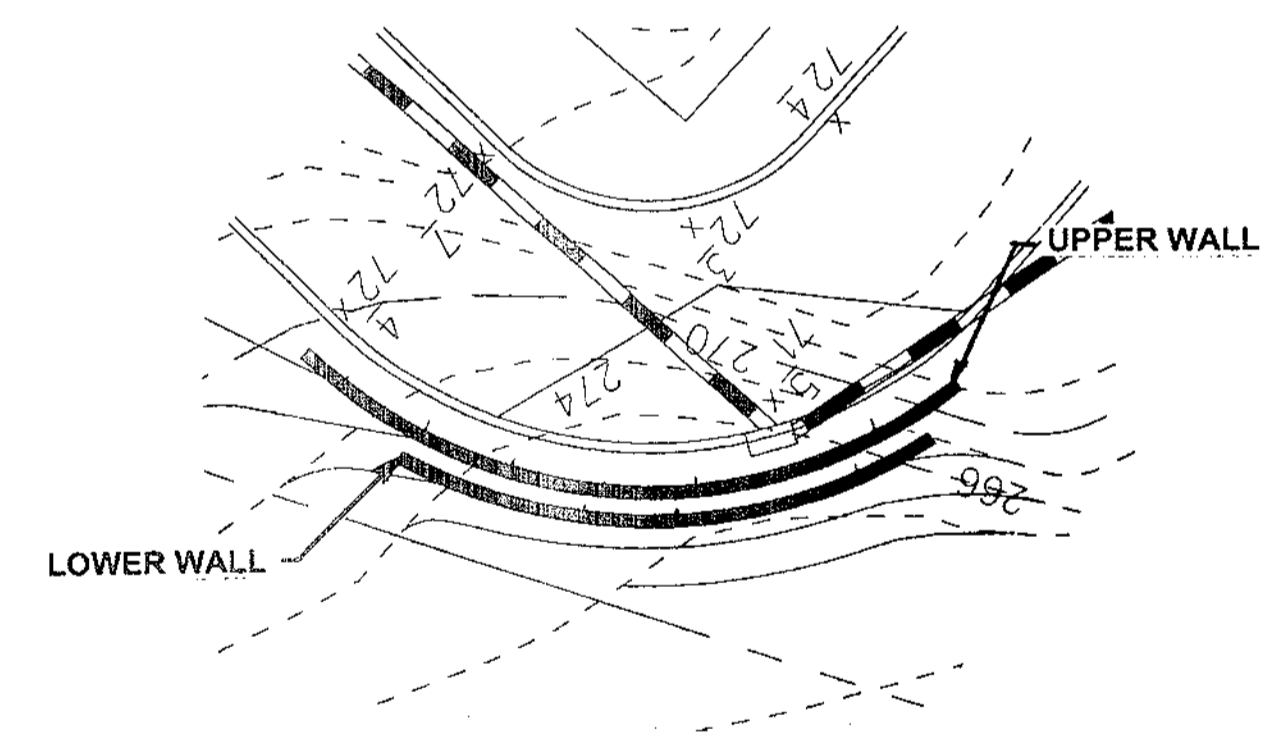

MODIFICATION OF SOUTH ENTRANCE RETAINING WALL  
SCALE: HOR. 1"=30'  
VERT. 1"=5'

APPROVED: HOWARD COUNTY DEPARTMENT OF PLANNING AND ZONING.	
<i>Paul Smith</i> DIRECTOR	10/19/99 DATE
<i>[Signature]</i> CHIEF, DEVELOPMENT ENGINEERING DIVISION	10/19/99 DATE
<i>Clive Hamilton</i> CHIEF, DIVISION OF LAND DEVELOPMENT	10/15/99 DATE




DATE NO.	REVISION
OWNER/DEVELOPER	
PROLOGIS DEVELOPMENT SERVICES INCORPORATED 5200 EISENHOWER AVENUE, SECOND FLOOR ALEXANDRIA, VIRGINIA 22304 (703)751-9292	
PROJECT MEADOWRIDGE BUSINESS PARK PARCEL G-2 2 WAREHOUSE BUILDINGS	
AREA TAX MAP NO. 37 ZONED M-1 PARCEL G-2 1st ELECTION DISTRICT HOWARD COUNTY, MARYLAND	
TITLE	

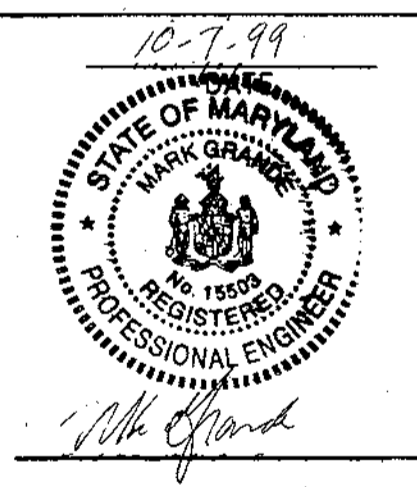

DESIGNED BY: JR/MG
DRAWN BY: JR
PROJECT NO: 99231.C
DATE: OCTOBER 11, 1999
SCALE: AS SHOWN
DRAWING NO. 23 OF 25






<b>GTA</b>		<b>GEO-TECHNOLOGY ASSOCIATES, INC.</b> GEOTECHNICAL AND ENVIRONMENTAL CONSULTANTS	
42 N. Main Street, Suite 200 Bel Air, Maryland 21034 (301) 879-9446 • (301) 836-9123 Fax: (301) 893-3437		606-D Bosley Avenue Townson, Maryland 21204 (301) 821-6366 Fax: (301) 821-1748	
9090 Junction Drive, Suite 9 Annapolis Junction, Maryland 20701 (301) 792-8446 • (301) 470-4470 Fax: (301) 792-7395			
MEADOWRIDGE NORTHERN TIERED WALL PLAN, PROFILE AND SECTION DRAWING			
HOWARD COUNTY, MARYLAND			
DATE	REVISIONS	JOB NO:	
7/30/99	REVISION TO NORTH, SOUTH, AND TIERED WALLS	SCALE:	
4/10/00	ADD RETAINING WALL ELEVATION	DATE:	
		DRAWN BY:	
		DESIGN BY:	
		REVIEW BY:	
		SHEET:	



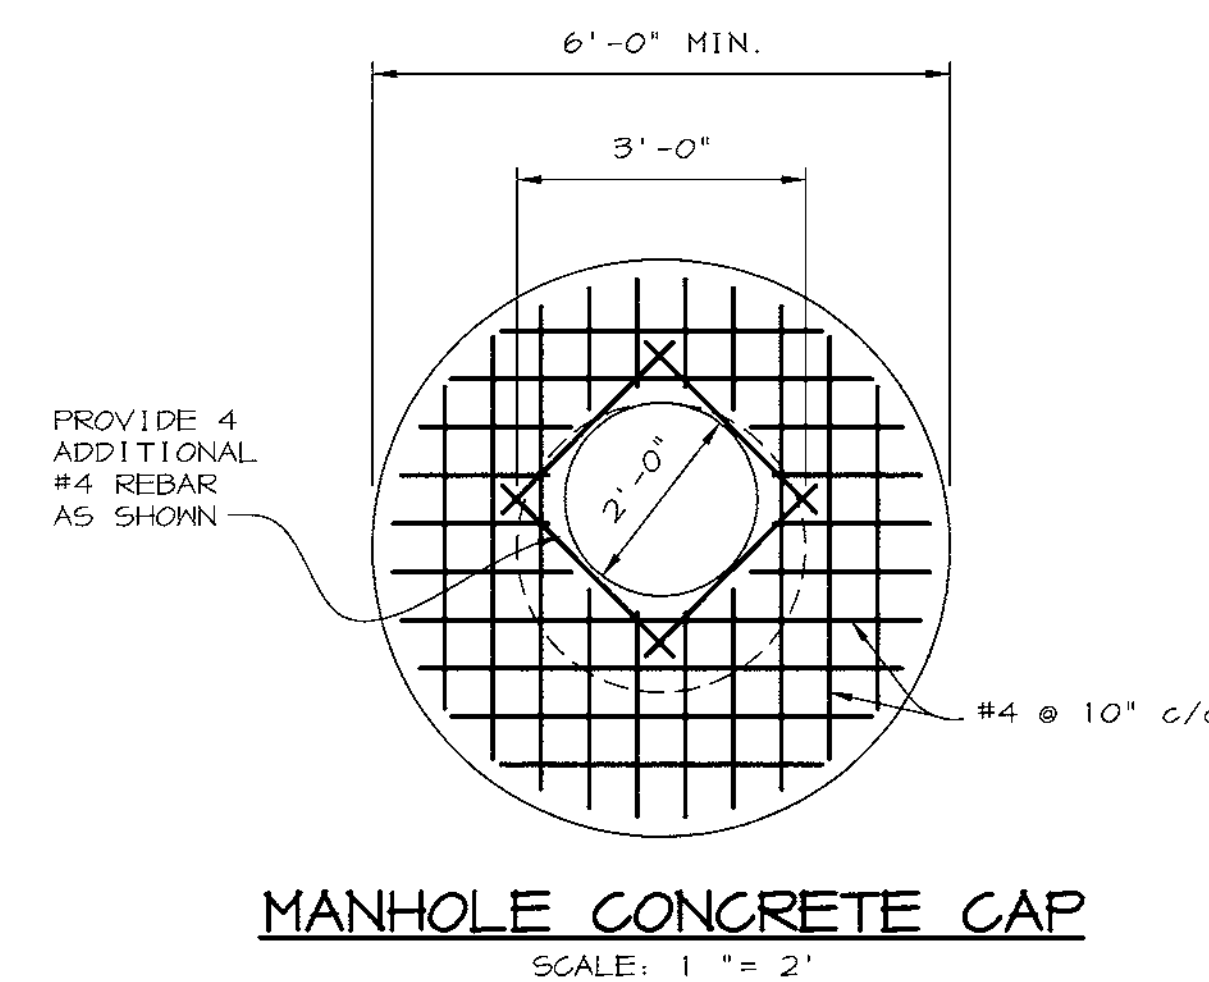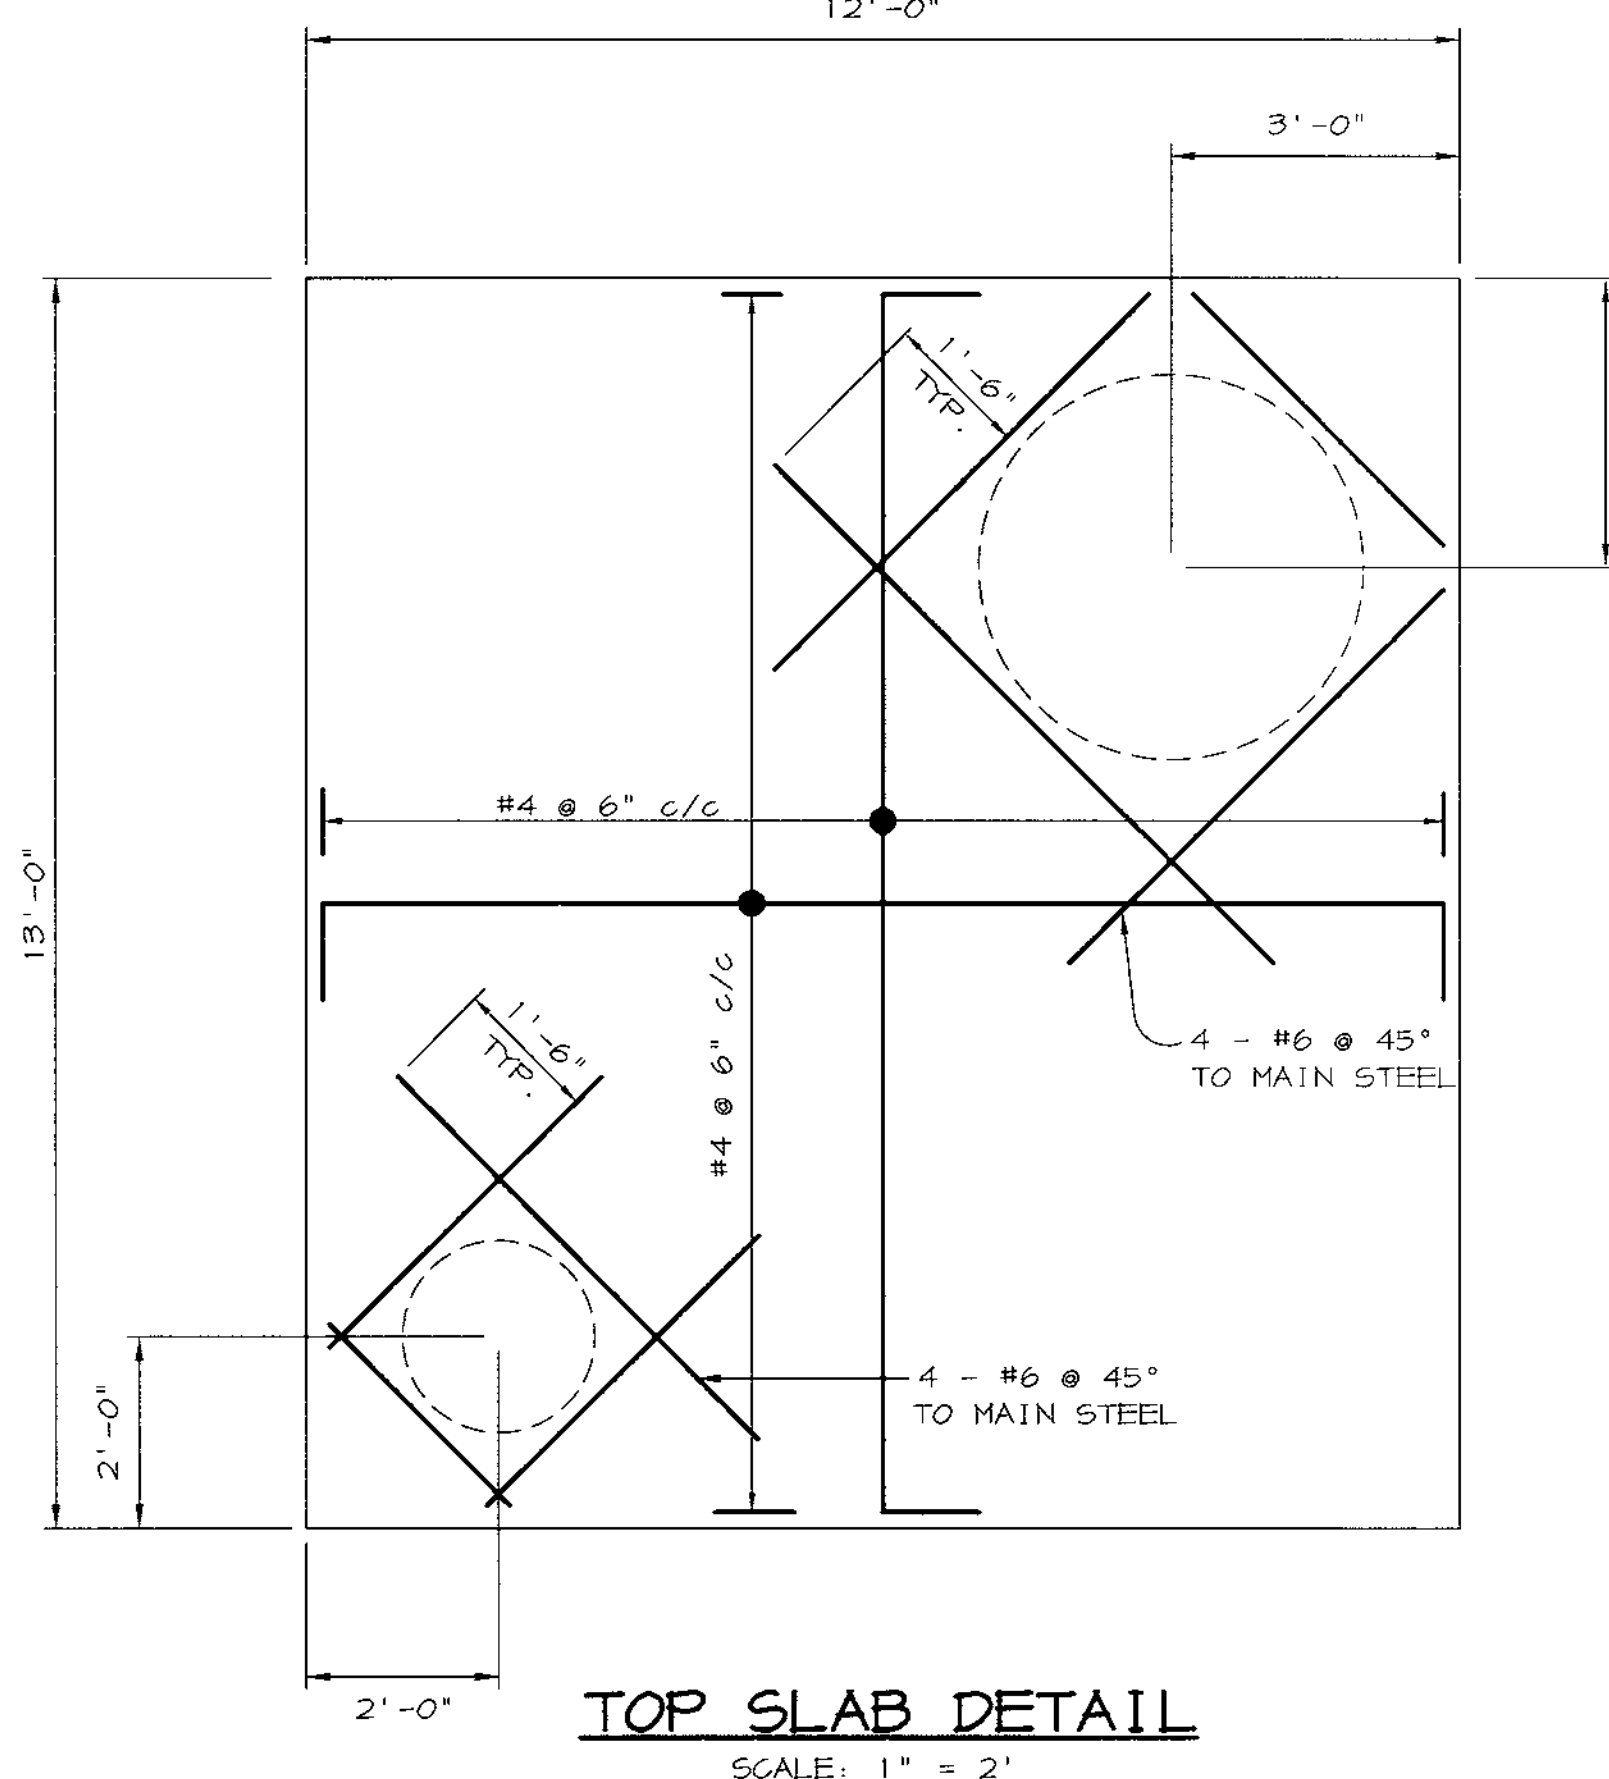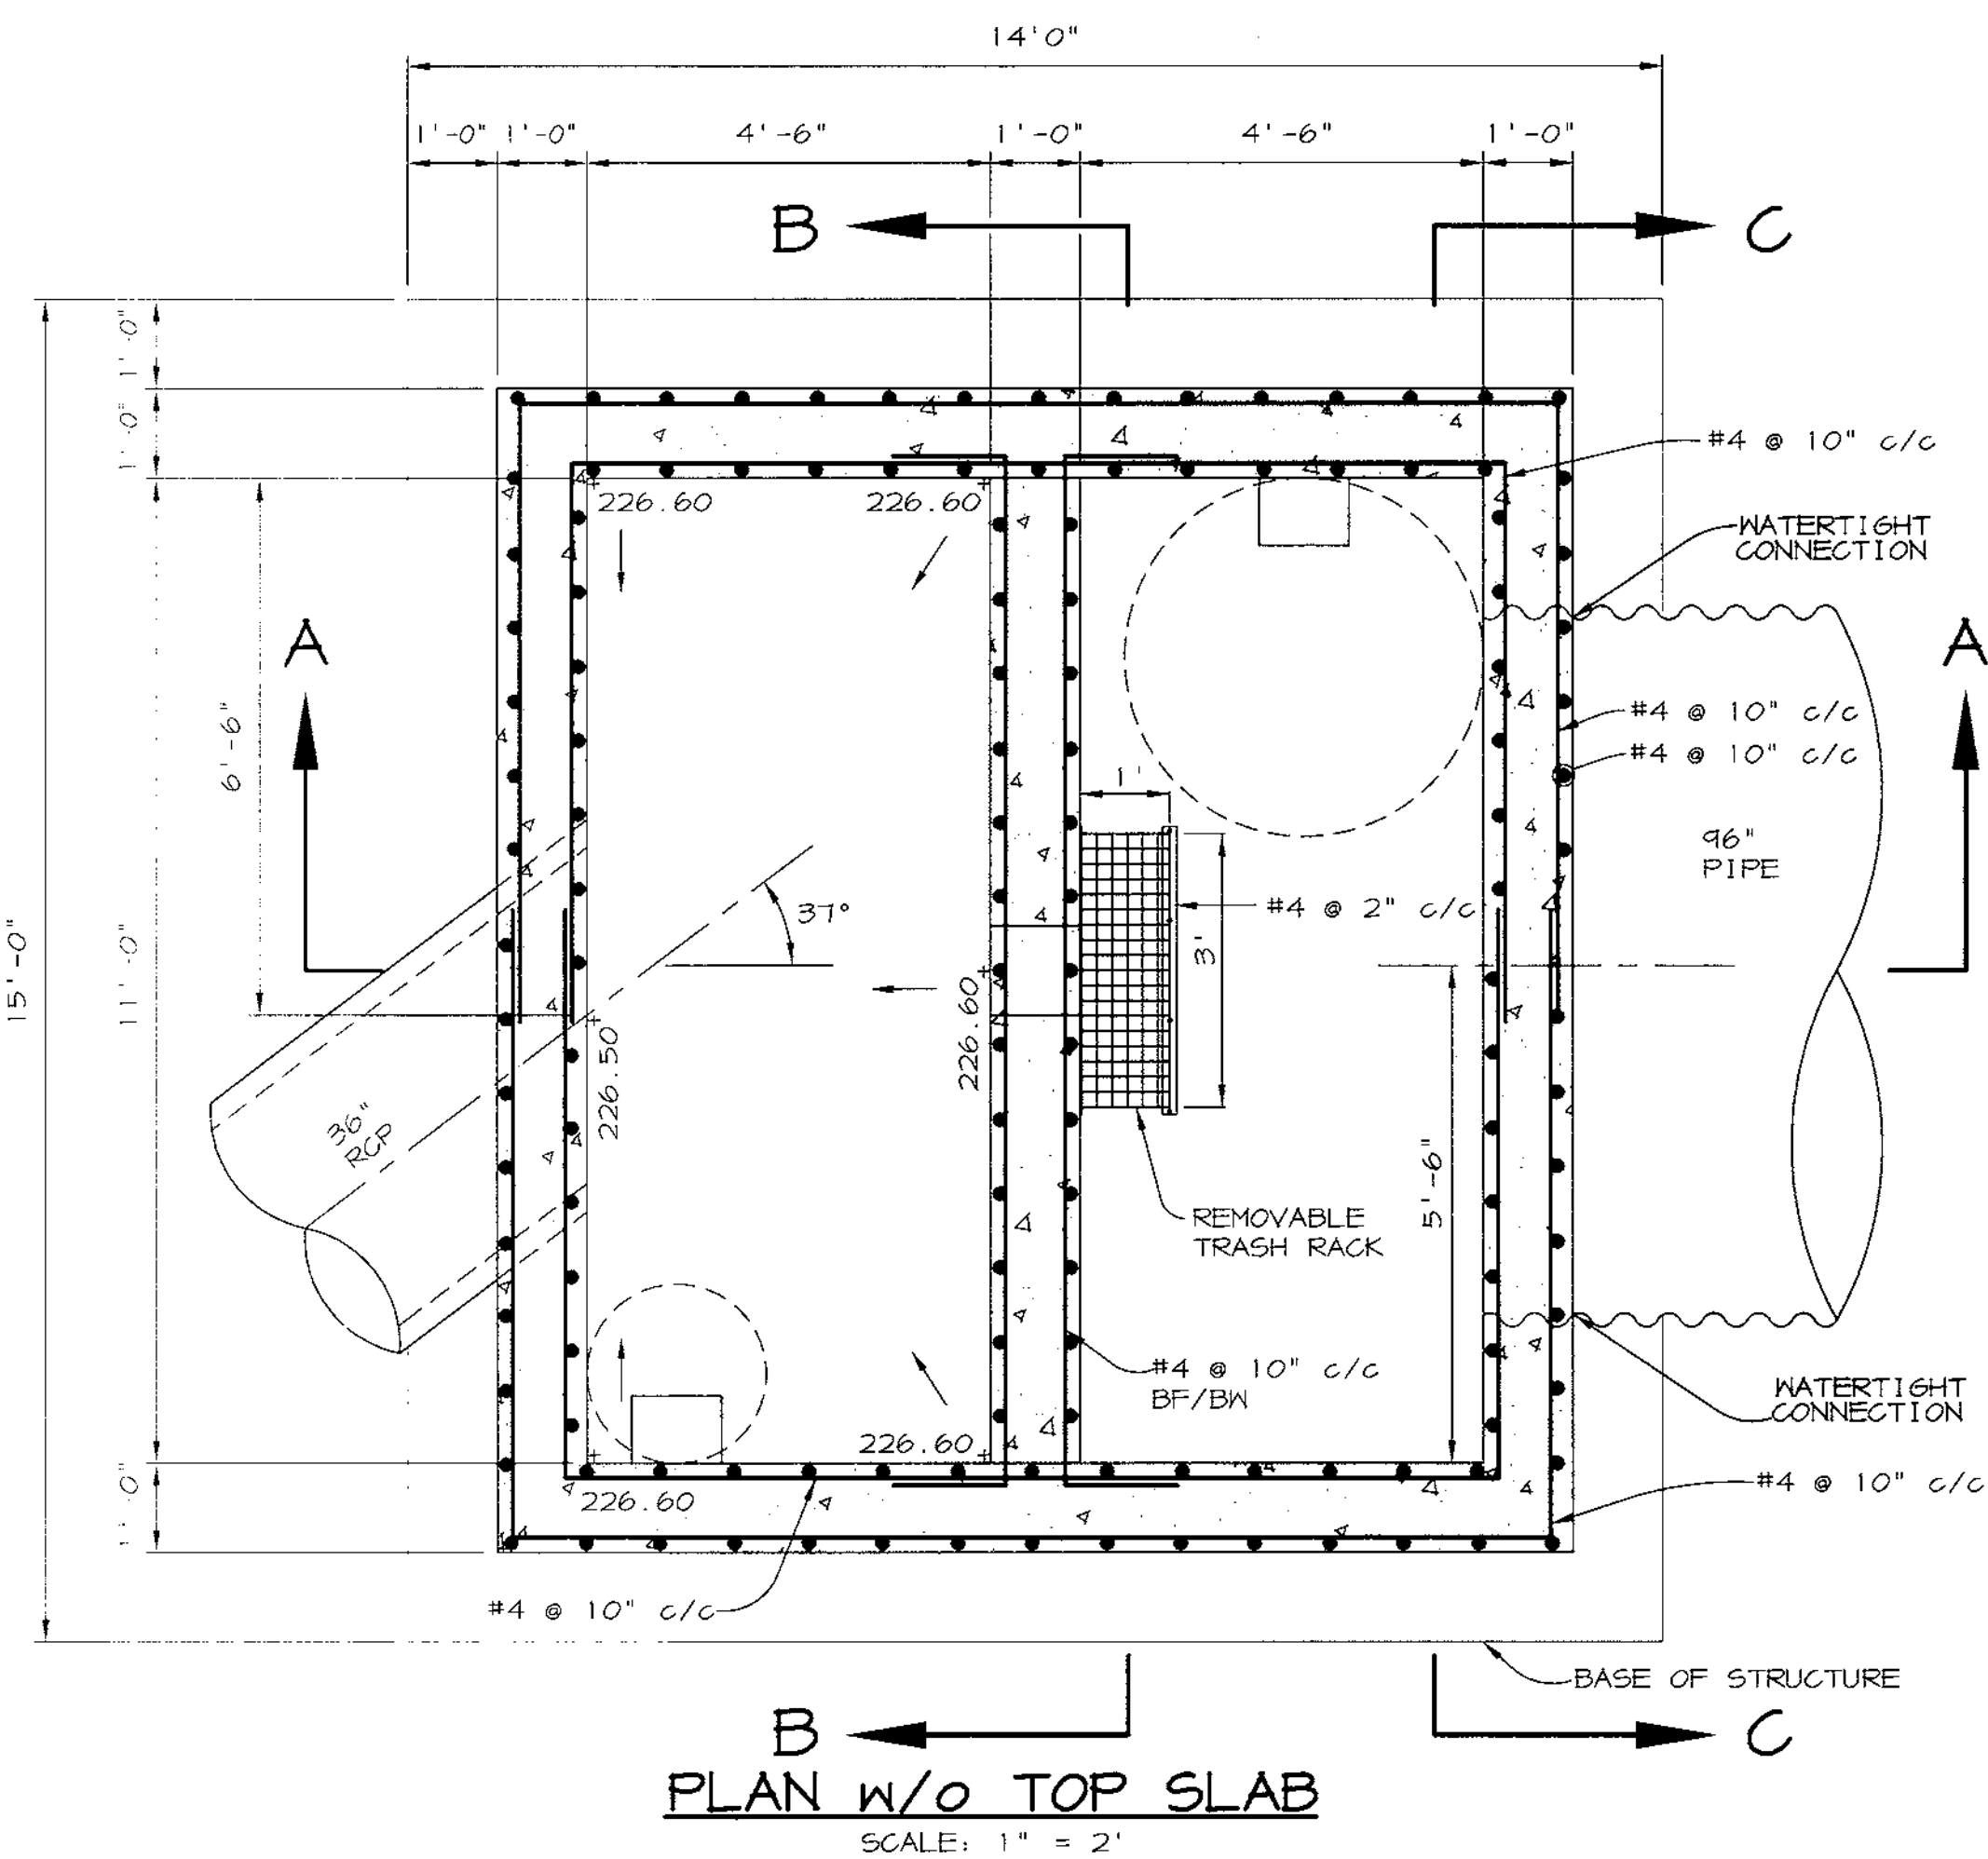

- MANHOLE NOTES:**
1. CONCRETE CAP TO BE MIX NO. 3
  2. MANHOLE RISER TO BE SAME GA. AS MAIN LINE PIPE.
  3. STEPS TO BE INSTALLED IN MANHOLE PER MANUFACTURER'S SPECIFICATIONS.
  4. COMPACT TOP 1" OF SUBGRADE UNDER CONCRETE CAP 100% OF MAXIMUM DRY DENSITY (PER AASHTO T-99-C).
  5. SEE GEOMETRY PLAN FOR MANHOLE LOCATIONS AND RIM ELEVATIONS SH. 6 & 11.


- TRASH RACK NOTES:**
1. STEEL TO CONFORM TO ASTM A-36. BARS TO BE SMOOTH.
  2. #4 REBARS @ 2" c/c HORIZONTALLY AND 2" c/c VERTICALLY.
  3. ALL REBAR TO BE WELDED AT ALL INTERSECTIONS.
  4. ALL BENDS TO BE 2" RADIUS.
  5. WELD BARS TO 2" x 1/8" STEEL PLATE AND BOLT STEEL PLATE TO STRUCTURE WITH 1/2" ANCHOR BOLTS.
  6. GALVANIZE TRASH RACK AFTER FABRICATION.

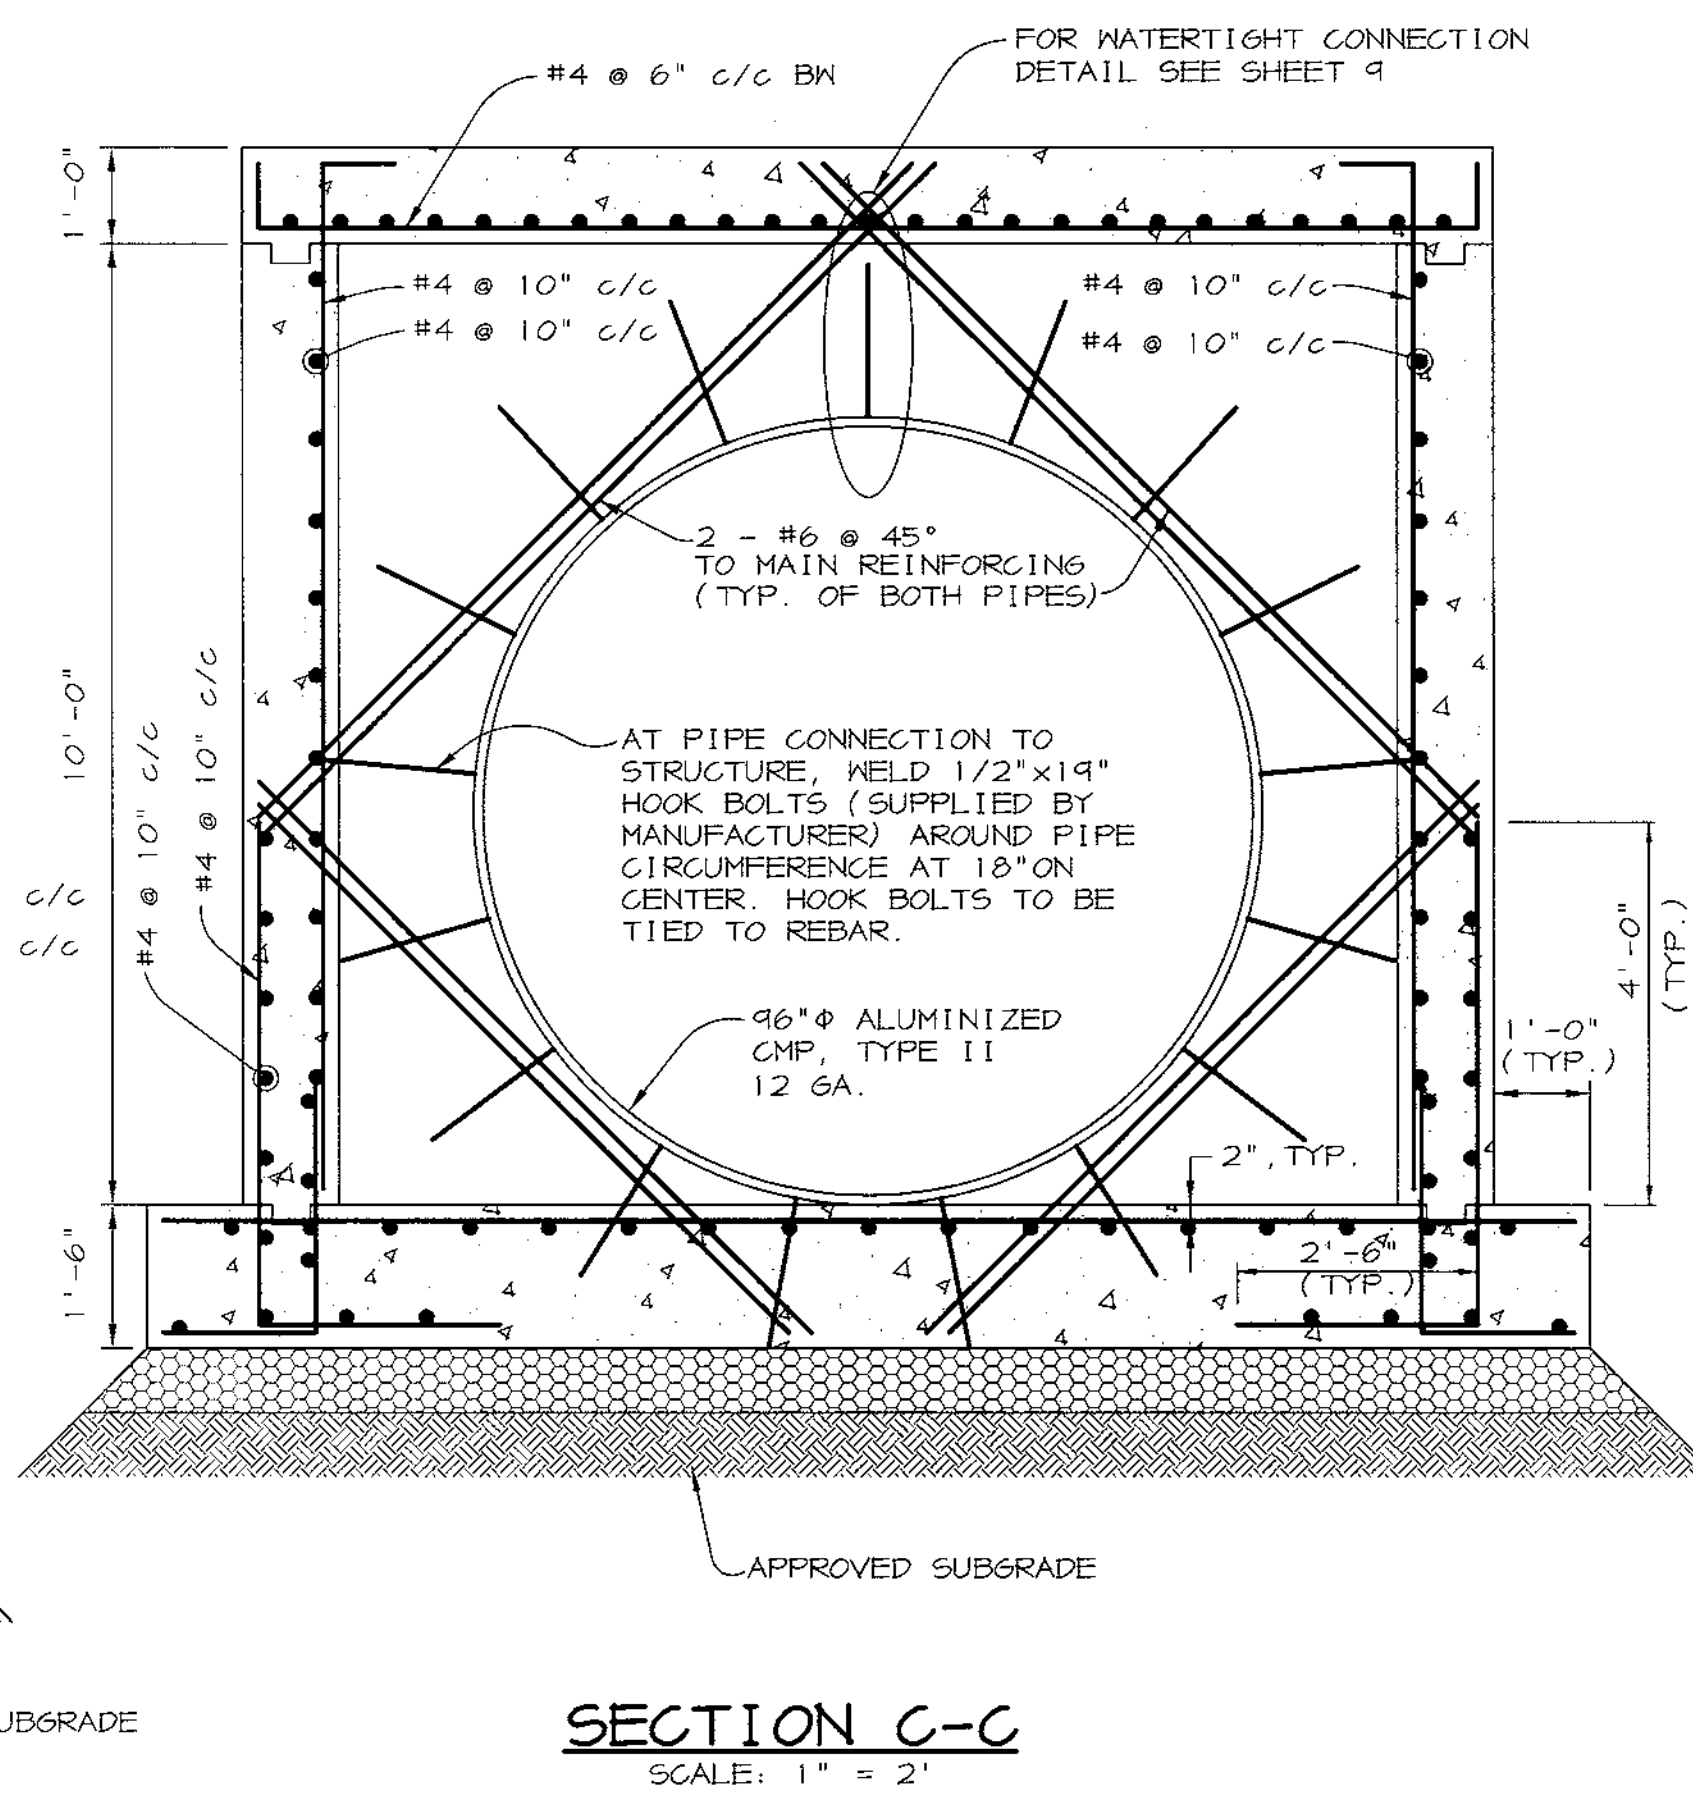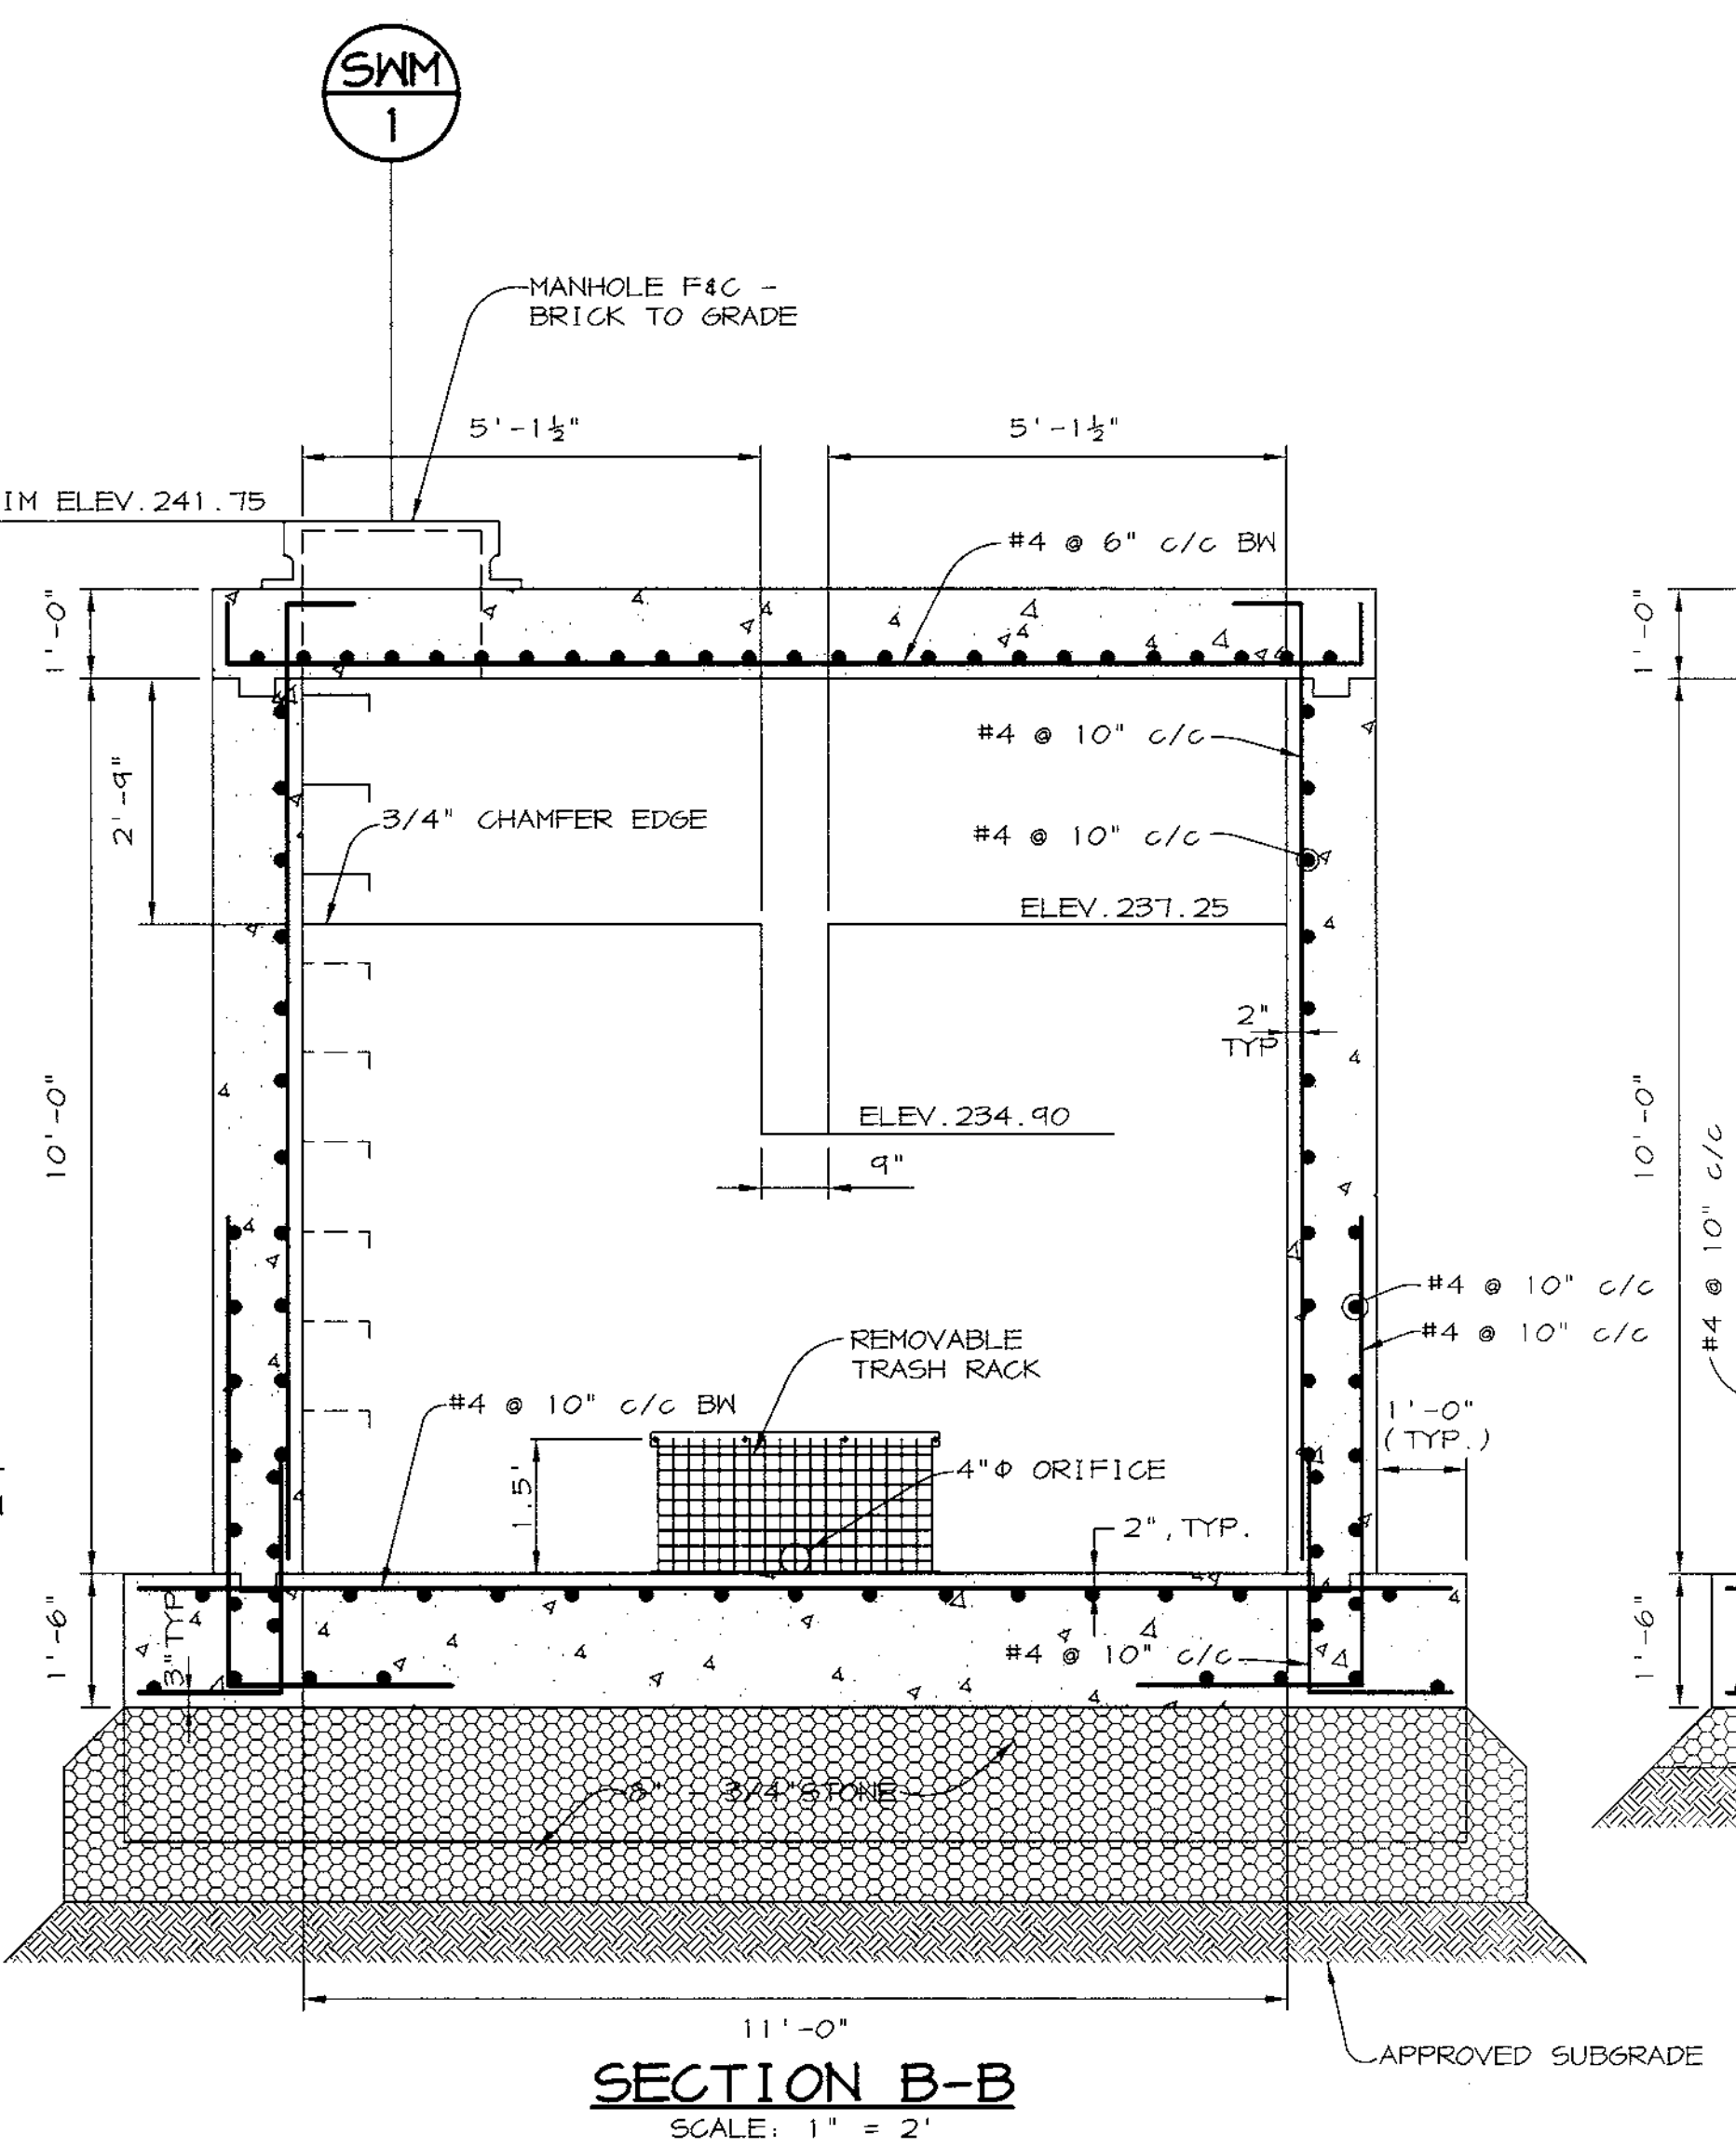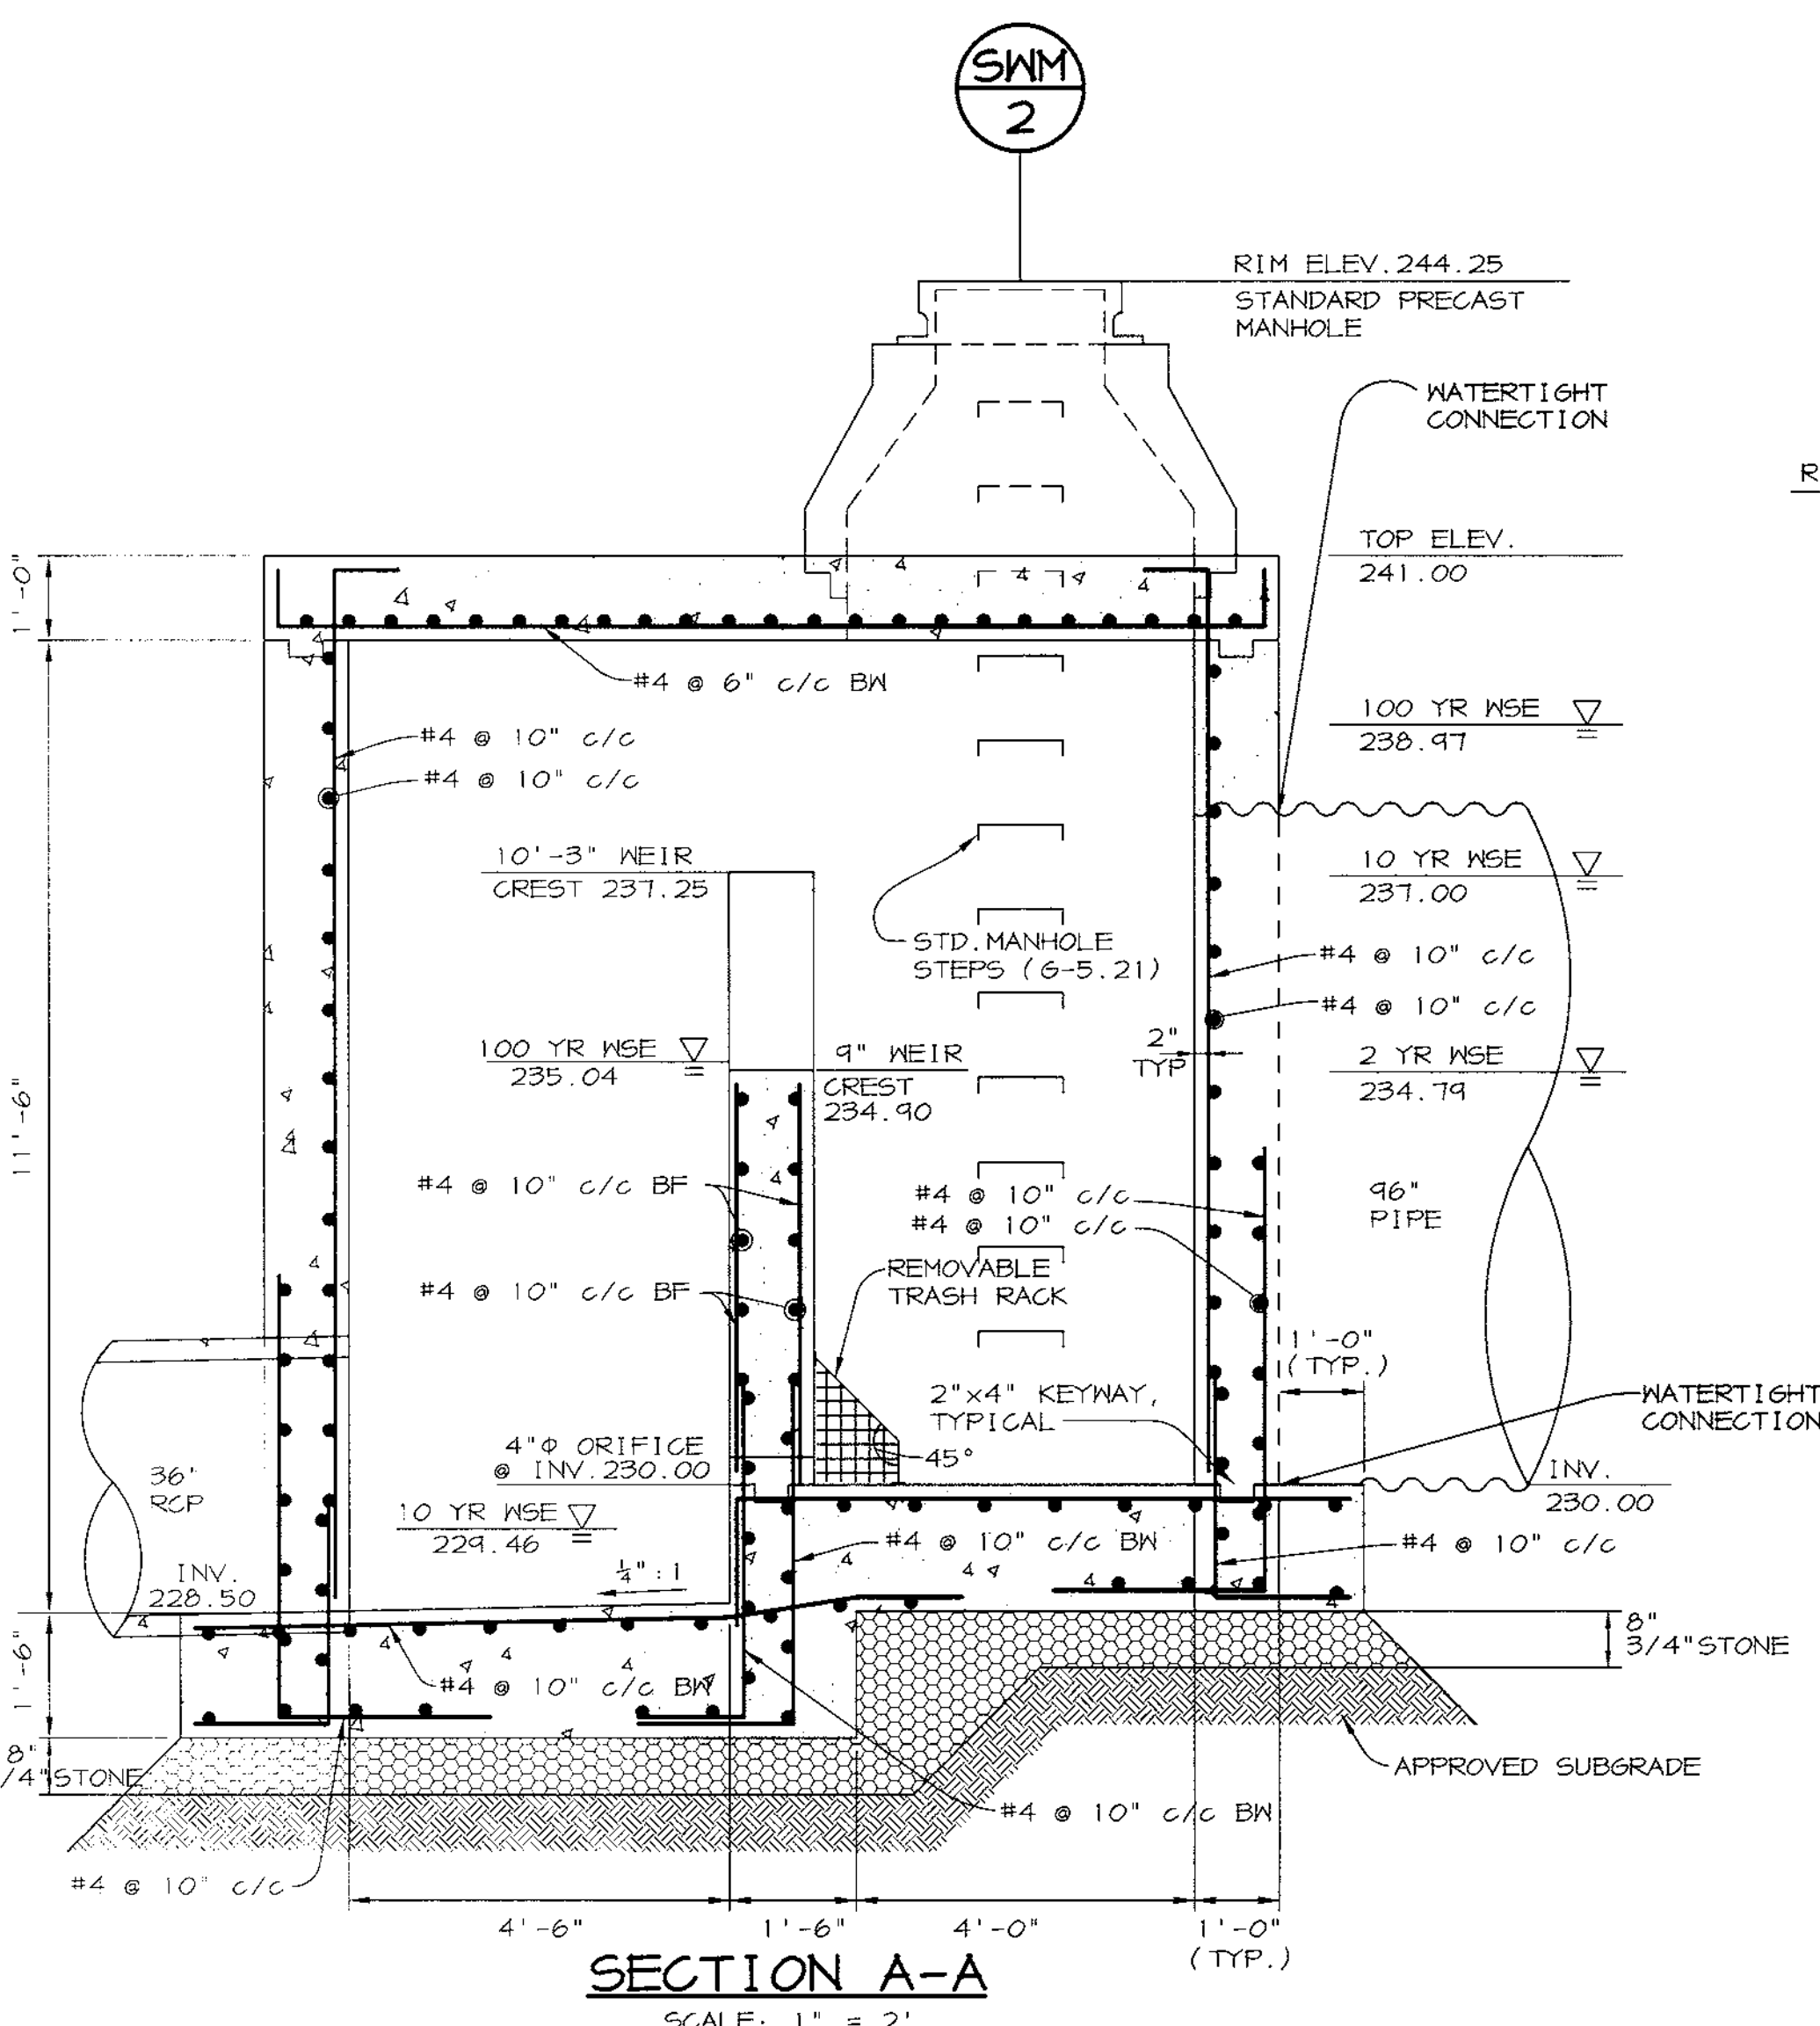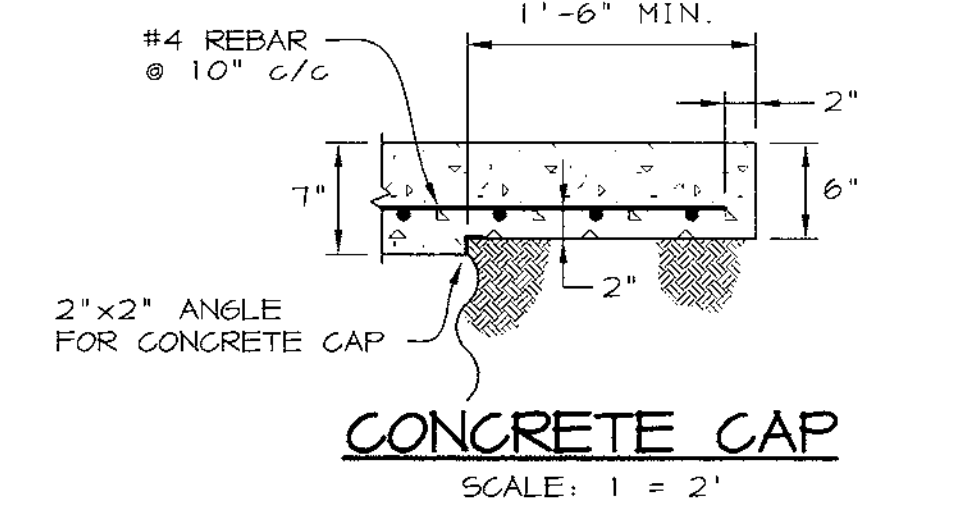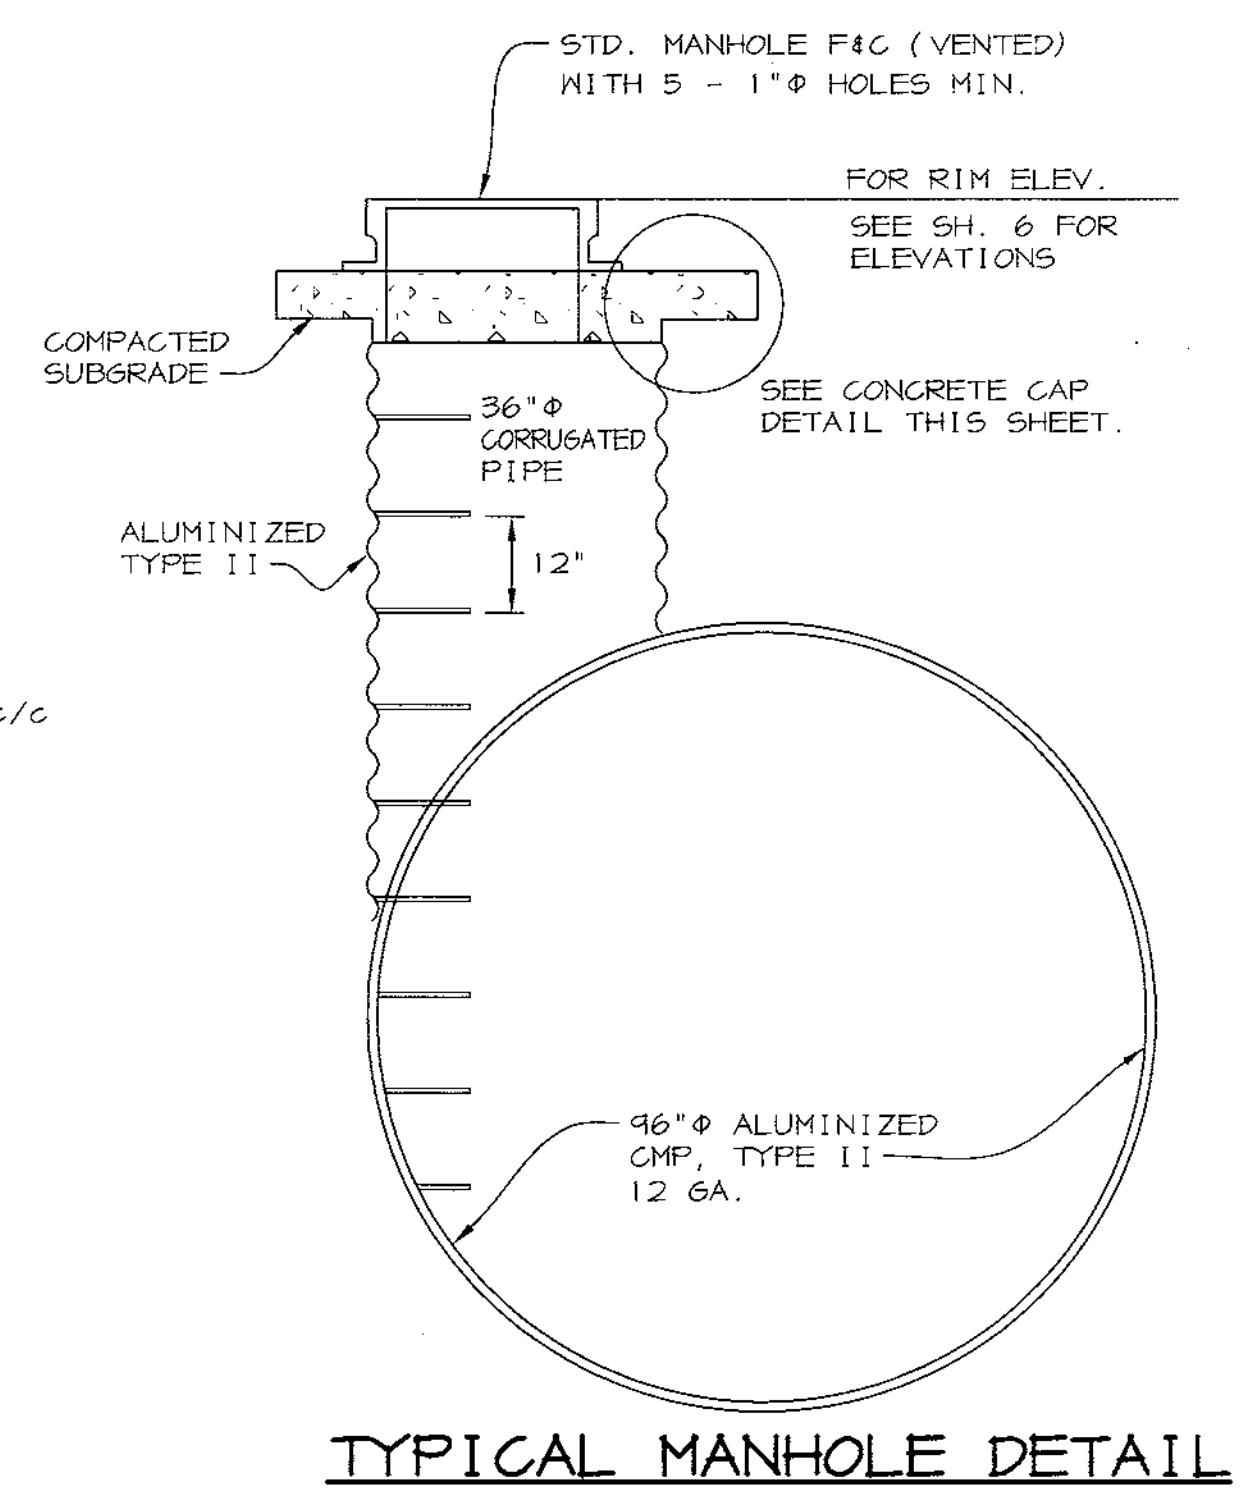


AS BUILT CERTIFICATE	
DATE	DATE
APPROVED: HOWARD COUNTY DEPARTMENT OF PLANNING AND ZONING.	10/15/99
<i>[Signature]</i> DIRECTOR	10/15/99
CHIEF, DEVELOPMENT ENGINEERING DIVISION	10/15/99
<i>[Signature]</i> CHIEF, DIVISION OF LAND DEVELOPMENT	10/15/99
DATE NO.	REVISION
OWNER/DEVELOPER	
PROLOGIS DEVELOPMENT SERVICES INCORPORATED 5200 EISENHOWER AVENUE, SECOND FLOOR ALEXANDRIA, VIRGINIA 22304 (703)751-9292	
PROJECT	MEADOWRIDGE BUSINESS PARK PARCEL G-2 2 WAREHOUSE BUILDINGS
AREA	TAX MAP NO. 37 ZONED M-1 PARCEL G-2 1st ELECTION DISTRICT HOWARD COUNTY, MARYLAND
TITLE	STORMWATER MANAGEMENT DETAILS & NOTES
RIEMER MUEGGE & ASSOCIATES INC. ENGINEERING • ENVIRONMENTAL SERVICES • PLANNING • SURVEYING 8618 Centra Park Drive, Columbia, MD 21046 Tel 410.997.8900 Fax 410.997.8282	
DATE	DESIGNED BY: ACR
	DRAWN BY: GTH
	PROJECT NO.: 97320/PARCEL_G SDP15.DWG
	DATE: OCTOBER 11, 1999
	SCALE: AS SHOWN
	DRAWING NO. 24 OF 25

M:\SDP\PARCEL\_G-2\DWG 10/11/99 RIEMER MUEGGE & ASSOCIATES, INC.




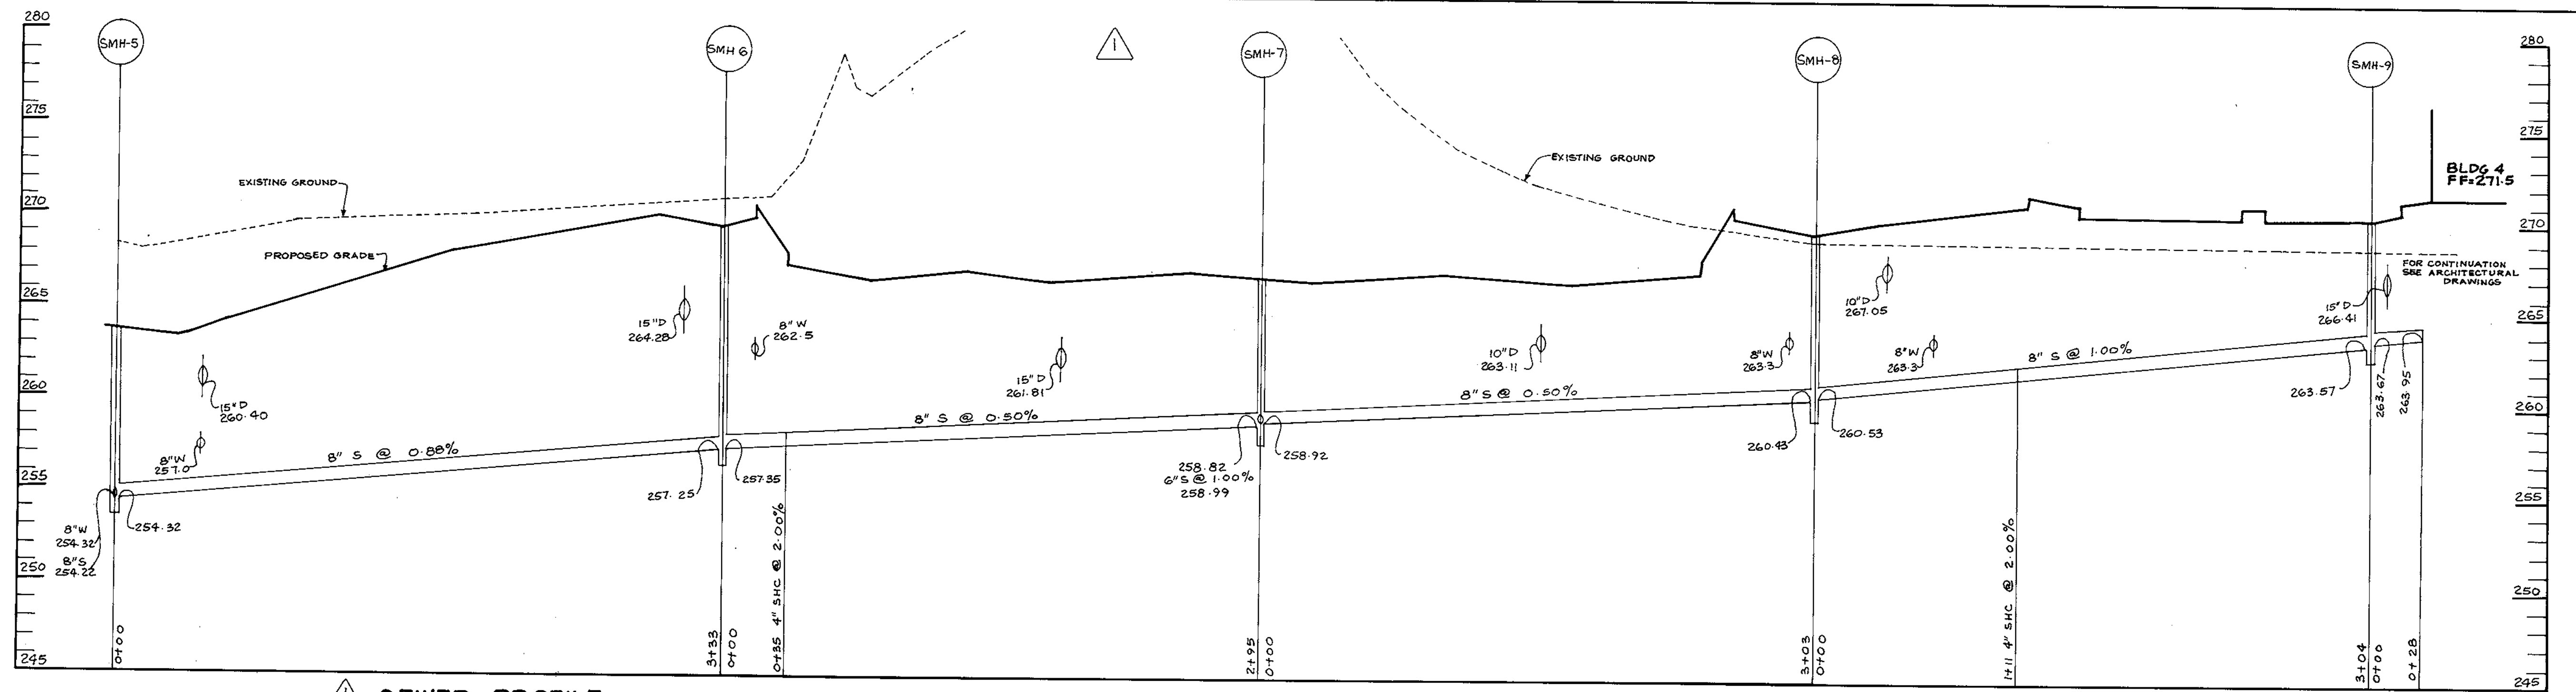

**SEWER PROFILE**  
 SCALE:  
 HOR. - 1" = 50'  
 VERT. - 1" = 5'

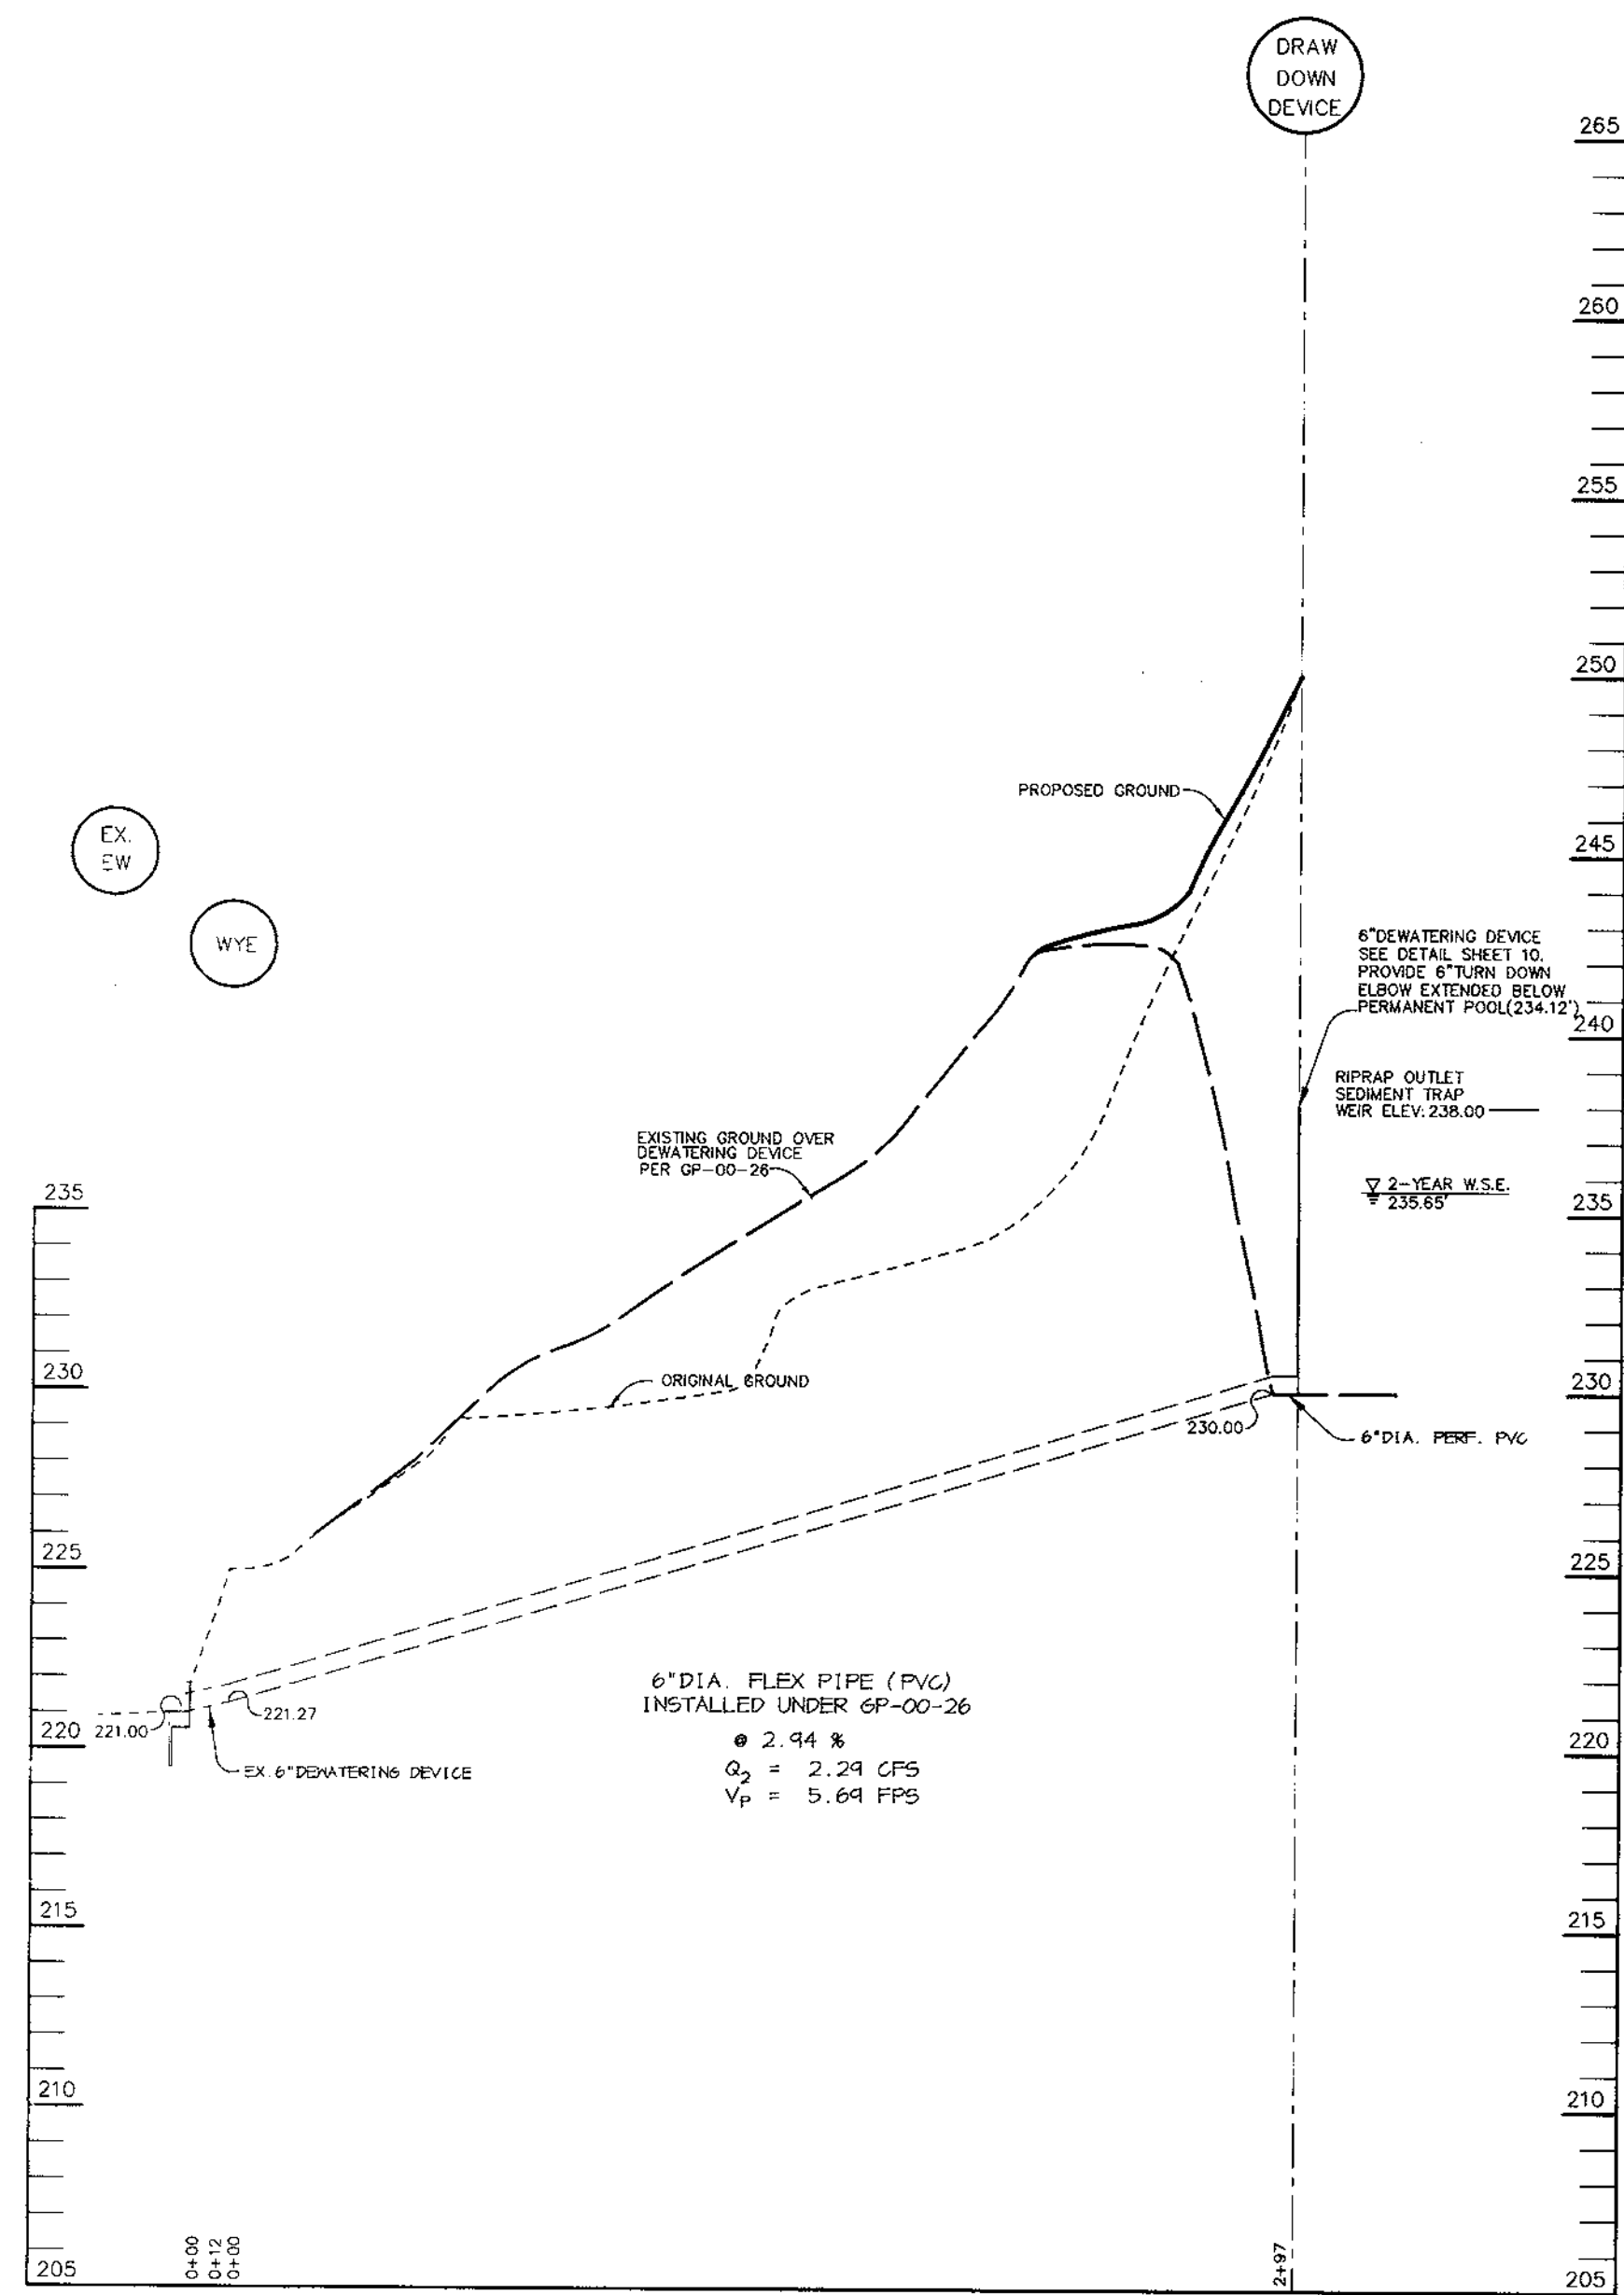


**PROFILE THRU 6" FLEXIBLE PIPE**  
 SCALE:  
 HOR. - 1" = 50'  
 VERT. - 1" = 5'

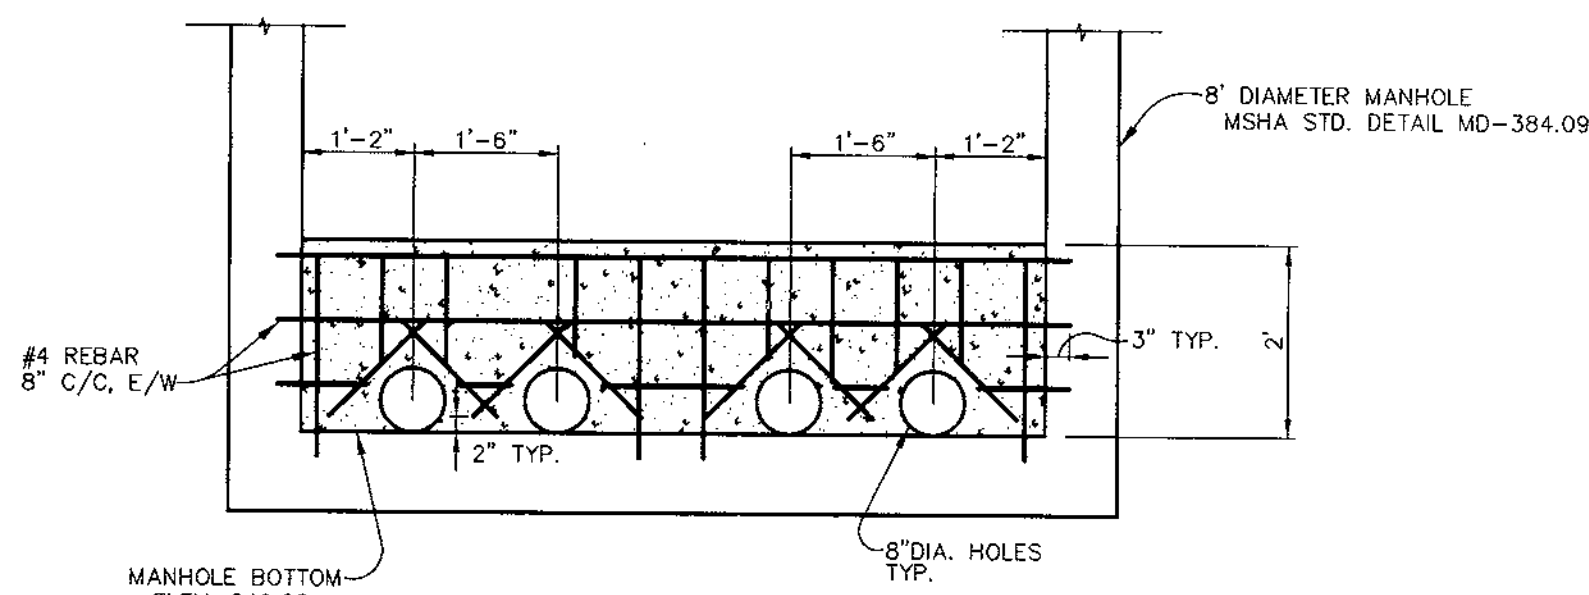

**SECTION A-A**  
 SCALE: 1" = 2'

- NOTES:
1. USE #4 DEFORMED BARS AT 8" CENTER TO CENTER EACH WAY.
  2. REBAR SHALL BE EPOXY GROUTED A MINIMUM OF 3" INTO BOTTOM AND SIDES OF MANHOLE.
  3. REBAR SHALL BE PLACED IN CENTER OF WALL.
  4. USE MIX NO.3 CONCRETE.

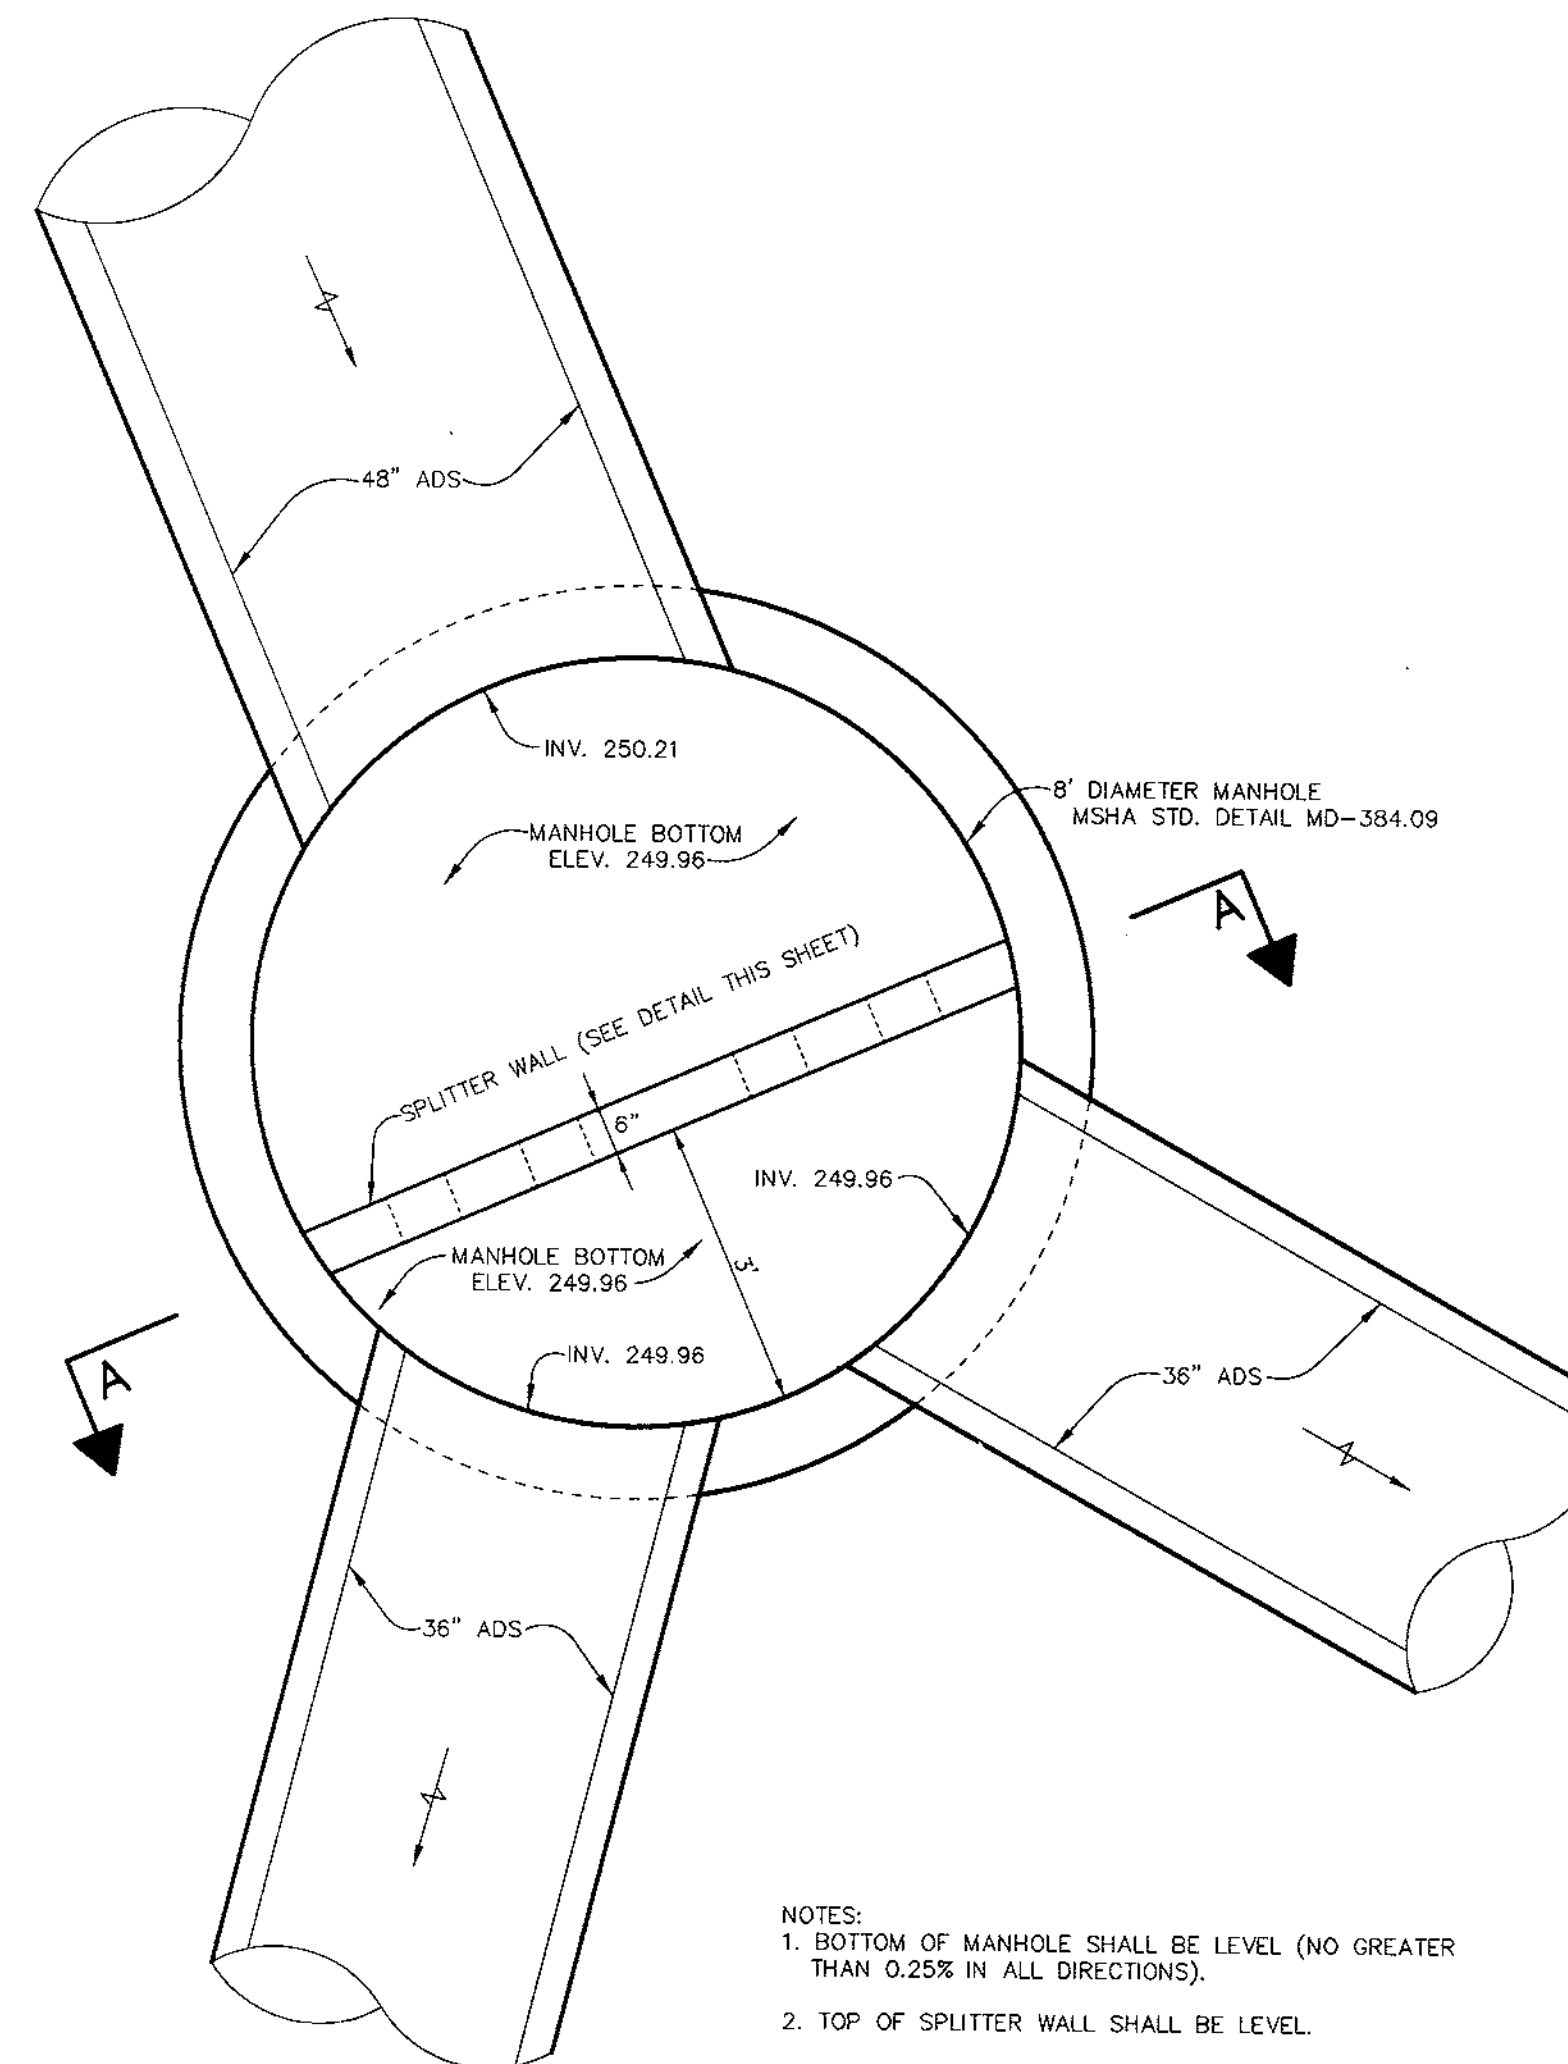

**FLOW SPLITTER M-3A**  
 SCALE: 1" = 2'

- NOTES:
1. BOTTOM OF MANHOLE SHALL BE LEVEL (NO GREATER THAN 0.25% IN ALL DIRECTIONS).
  2. TOP OF SPLITTER WALL SHALL BE LEVEL.

AS BUILT CERTIFICATE	
APPROVED: HOWARD COUNTY DEPARTMENT OF PLANNING AND ZONING.	DATE: 10/19/99
DIRECTOR: [Signature]	DATE: 10/15/99
CHIEF, DEVELOPMENT ENGINEERING DIVISION	DATE: 10/15/99
CHIEF, DIVISION OF LAND DEVELOPMENT	DATE: 10/15/99
ADDED SEWER PROFILE	
DATE: 10/08/99	REVISION:
OWNER/DEVELOPER: PROLOGIS DEVELOPMENT SERVICES INCORPORATED, 5200 EISENHOWER AVENUE, SECOND FLOOR, ALEXANDRIA, VIRGINIA 22304, (703)751-9292	
PROJECT: MEADOWRIDGE BUSINESS PARK, PARCEL G-2, 2 WAREHOUSE BUILDINGS	
AREA: TAX MAP NO. 37, ZONED M-1, PARCEL G-2, 1st ELECTION DISTRICT, HOWARD COUNTY, MARYLAND	
TITLE: PROFILE & DETAIL SHEET	
RIEMER MUEGGE & ASSOCIATES INC. ENGINEERING • ENVIRONMENTAL SERVICES • PLANNING • SURVEYING, 8818 Centre Park Drive, Columbia, MD 21045, tel 410.997.8800 fax 410.997.9282	
DATE: 10/15/99	DESIGNED BY: ACR
PROJECT NO.: 97320/PARCEL G SDP14.DWG	DRAWN BY: DAM
DATE: OCTOBER 11, 1999	SCALE: AS SHOWN
DRAWING NO.: 25 OF 25	