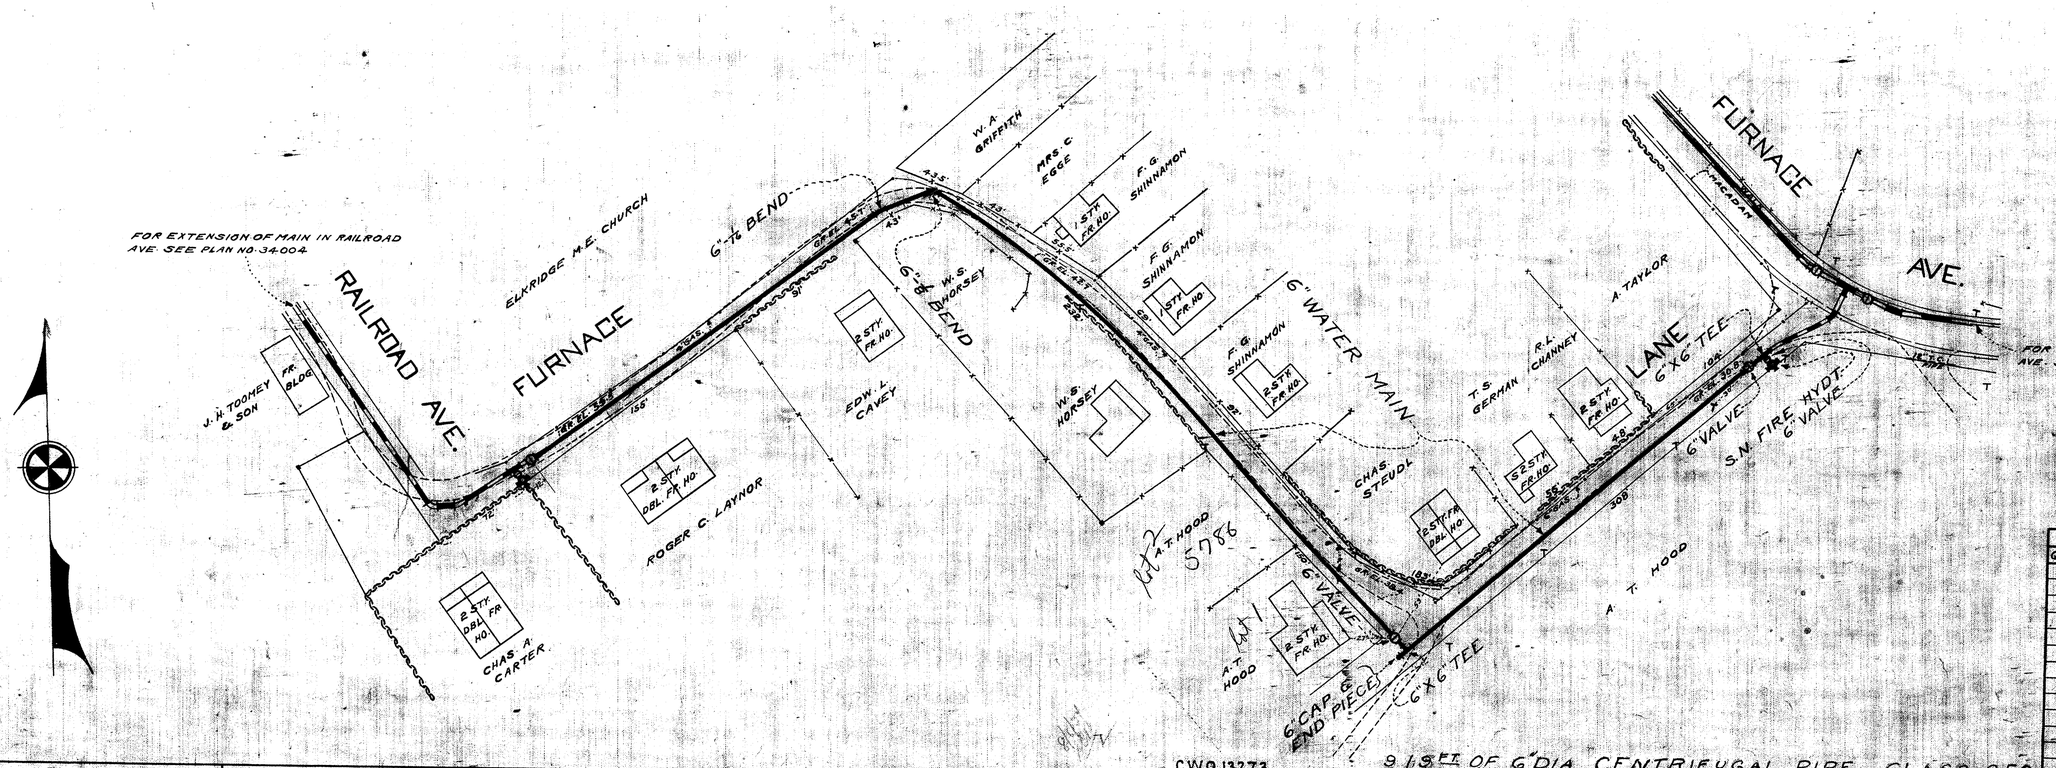

LIST OF FITTINGS		
QUANTITY	DESCRIPTION	SIZE
2	TEES	6"x6"
3	VALVES	6"
1	FIRE HYDRANT	6"
1	CAP	6"
1	BEND	6"-1/8
1	BEND	6"-1/16

C.W.O. 13273

9 1/8 FT. OF 6" DIA. CENTRIFUGAL PIPE, CLASS 250.

DRAWN R. Hughes TRACED R. Hughes CHECKED DATE	PLANS PREPARED BY Robert C. Norris W. F. Preston	ELKRIDGE WATER DISTRICT HOWARD COUNTY-MARYLAND	APPROVED BY COUNTY COMMISSIONERS May 23-1938 DATE Daniel H. Gaither H. Grafton Penny Hart B. Nace	APPROVED FOR CITY OF BALTIMORE Aug. 8 1934 DATE [signature]	PROPOSED WATER IN FURNACE LANE FROM RAILROAD AVE. TO FURNACE AVE. ELKRIDGE MARYLAND

DRAWING	SCALE:	J.O.
NO. 1 OF 1	1"=50'	34005 FILE