
INDEX OF SHEETS

SHEET NO. DESCRIPTION TITLE SHEET TYPICAL SECTIONS / ROADWAY DETAILS ROADWAY PLAN SHEETS STORM DRAIN PIPE PROFILES DRAINAGE DETAILS EROSION AND SEDIMENT CONTROL DETAILS AND NOTES EROSION AND SEDIMENT CONTROL PLANS EROSION AND SEDIMENT DRAINAGE AREA (DA) MAP

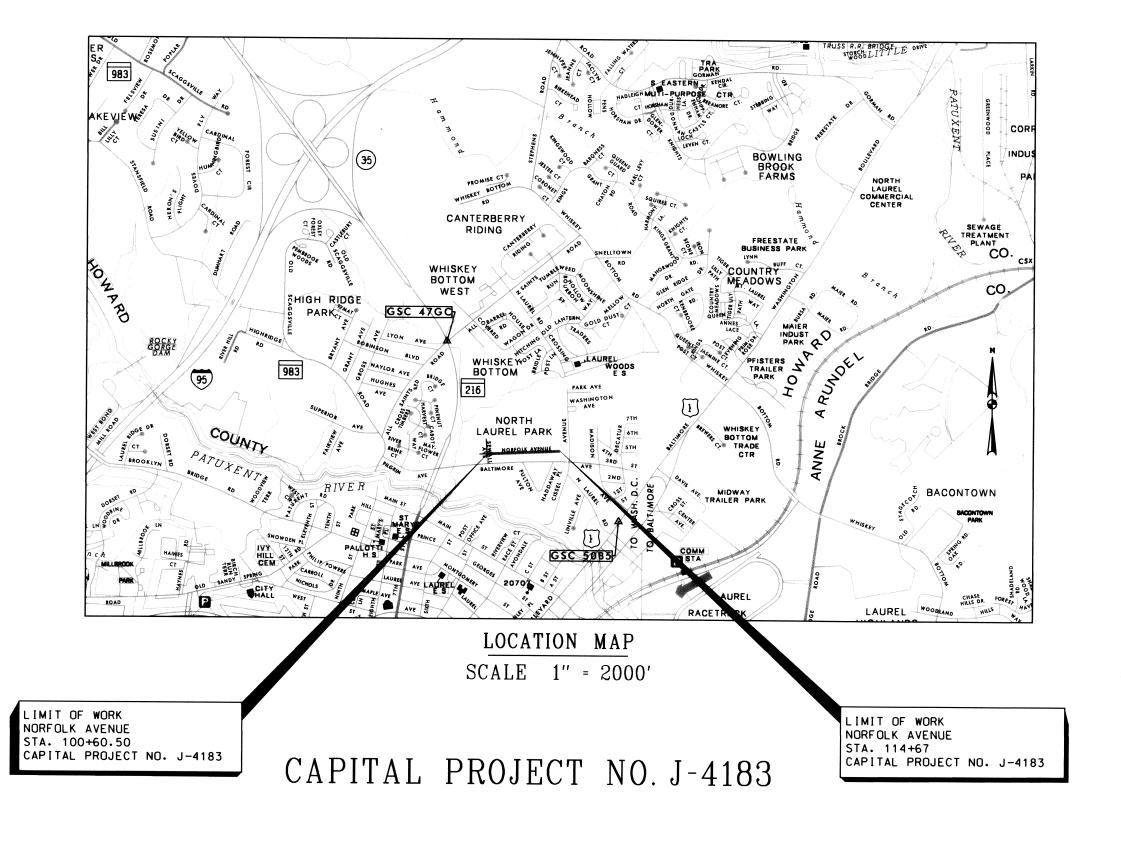

GENERAL NOTES

- I. ALL CONSTRUCTION SHALL BE IN ACCORDANCE WITH THE LATEST STANDARDS AND SPECIFICATIONS OF HOWARD COUNTY AND MSHA STANDARDS AND SPECIFICATIONS IF APPLICABLE.
- ALL INFORMATION AND DETAILS ON THESE DRAWINGS SHALL BE CONSTRUCTED AS PER THE PLANS OR AS DIRECTED BY THE HOWARD COUNTY ENGINEER.
- 3. ALL STATIONING AND DIMENSIONING ARE TO BE FIELD VERIFIED BY THE CONTRACTOR.
- 4. STORM DRAINAGE SLOPES ARE TO BE AS SHOWN ON THE PLANS OR AS DIRECTED BY THE HOWARD COUNTY ENGINEER.
- APPROXIMATE LOCATIONS OF EXISTING UTILITIES ARE SHOWN. THESE LOCATIONS ARE BASED ON UTILITY PLANS OR TOPOGRAPHIC SURVEYS. TEST PIT LOCATIONS ARE PROVIDED IN THE SPECIFICATIONS. IT IS THE CONTRACTOR'S RESPONSIBILITY TO RESOLVE ANY DISCREPANCIES BETWEEN THE UTILITY LOCATIONS SHOWN ON THE PLANS AND THE TEST PIT INFORMATION PROVIDED. THE CONTRACTOR SHALL TAKE ALL NECESSARY PRECAUTIONS TO PROTECT EXISTING UTILITIES AND TO MAINTAIN UNINTERRUPTED SERVICE. ANY DAMAGE INCURRED SHALL BE REPAIRED IMMEDIATELY TO THE SATISFACTION OF THE ENGINEER BY THE CONTRACTOR AT THE CONTRACTOR'S EXPENSE. THE CONTRACTOR SHALL NOTIFY THE FOLLOWING UTILITIES OR AGENCIES AT LEAST FIVE (5) DAYS BEFORE STARTING WORK SHOWN ON THESE PLANS.

COMCAST 410-461-1362 BGE (CONTRACTOR SERVICES) 410-850-4620 BGE (UNDERGROUND DAMAGE CONTROL) 410-787-9068 MISS UTILITY 1-800-257-7777 HOWARD COUNTY BUREAU OF UTILITIES 410-313-4900 HOWARD COUNTY DIVISION OF CONSTRUCTION INSPECTION 410-313-1880 VERIZON I-800-743-0033 / 410-224-9210

- 6. SEE HOWARD COUNTY STANDARD DETAILS NO'S G-I.OI AND G-I.O2 FOR STANDARD SYMBOLS AND ABBREVIATIONS.
- HORIZONTAL COORDINATES ARE BASED ON MD NAD 83/91 HORIZONTAL DATUM AND VERTICAL ELEVATIONS ARE BASED ON NAVD 1988 VERTICAL DATUM, TRANSFERRED FROM HOWARD COUNTY CONTROL STATIONS; 50B5 AND 47GC.

50B5 N 524,999.3552 47GC N 528,939.7525 E 1,357,925.6879 ELEV. 177.424

E 1,354,223.5926 ELEV. 226.267

- 8. A STAGING AND STOCKPILE AREA WILL BE DETERMINED BY THE CONTRACTOR AND APPROVED BY THE HOWARD COUNTY ENGINEER.
- 9. TOPOGRAPHY SURVEY INFORMATION BASED ON FIELD SURVEY PERFORMED BY JOHNSON, MIRMIRAN & THOMPSON DATED APRIL / MAY, 2005.
- THROUGHOUT THE PERIOD OF CONSTRUCTION, TRAFFIC WILL BE MAINTAINED BY IMPLEMENTING STANDARD TRAFFIC CONTROL WORK ZONE TYPICAL PLANS IN ACCORDANCE WITH THE LATEST PLANS AND MANUALS OF THE MARYLAND STATE HIGHWAY ADMINISTRATION. THE CONTRACTOR WILL BE REQUIRED TO ADHERE TO THE MANUAL ON UNIFORM TRAFFIC CONTROL DEVICES (2000 EDITION AND ALL REVISIONS). THE CONTRACTOR IS REQUIRED TO MAINTAIN ACCESS TO ALL DRIVEWAYS AT ALL TIMES FOR THE DURATION OF THE PROJECT. ALL ITEMS NOT LISTED IN THE ITEMIZED SCHEDULE OF PRICES, REQUIRED FOR MAINTAINING TRAFFIC, INCLUDING BUT NOT LIMITED TO SIGNING, BARRIERS, DRUMS, TEMPORARY AGGREGATE AND PAVEMENT, SHALL BE INCLUDED IN THE LUMP SUM UNIT BID PRICE FOR MAINTENANCE OF TRAFFIC.
- THE CONTRACTOR SHALL UTILIZE A TWO LANE, TWO WAY ROADWAY FLAGGING OPERATION AS SPECIFIED IN THE MARYLAND SHA BOOK OF STANDARDS FOR HIGHWAY AND INCIDENTAL STRUCTURES, STANDARD NO. MD 104.02-10 FOR TRAFFIC CONTROL DURING CONSTRUCTION.
- 12. TOP OF CURB (T.C.) FOR CURB OPENING INLETS SHALL APPLY TO CENTERLINE OF INLET AT TOP OF CURB TOP OF RIM (T.R.) MANHOLE ELEVATIONS SHALL APPLY TO CENTER OF MANHOLE COVER.


NORFOLK AVENUE - ROADWAY IMPROVEMENTS


HOWARD COUNTY, MARYLAND DEPARTMENT OF PUBLIC WORKS

CONVENTIONAL SIGNS

DRAINAGE AREA BOUNDARY	
EXISTING SIGN	₫
LIMIT OF GRADING	— C — — F —
ELECTRICAL HAND BOX - SIGNALS	H.B.
PROPOSED MEDIAN BARRIER	
BURIED UTILITY LINES & NO. OF CABLES	4
STATE, COUNTY OR CITY LINES	
PROPOSED TRAFFIC BARRIER	
EXISTING TRAFFIC BARRIER	<u> </u>
FENCE LINE	—_x—_x—
RIGHT OF WAY LINE	
EXISTING ROADWAY	
RAILROAD ·····	
BASE OR SURVEY LINE	3 +50 32
FIRE HYDRANT	F.H.

TEST PIT	TP-4
PROPOSED HMA PAVEMENT MILL AND OVERLAY	
PROPOSED HMA PAVEMENT OVERLAY	
PROPOSED FULL DEPTH HMA PAVEMENT	
PROPOSED RIPRAP	0850\00851 D2190D219
EXISTING CULVERT	□ ====================================
PROPOSED CULVERT	
EXISTING DROP INLET	:
UTILITY POLE	+
MARSH	عاد عاد
HEDGE	~~~~~
GROUND ELEVATION	DATUM LINE -
GRADE ELEVATION	DATUM LINE

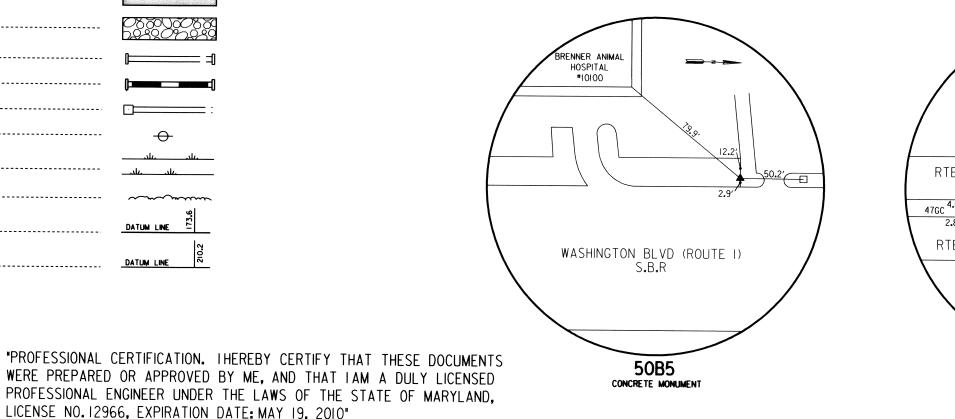

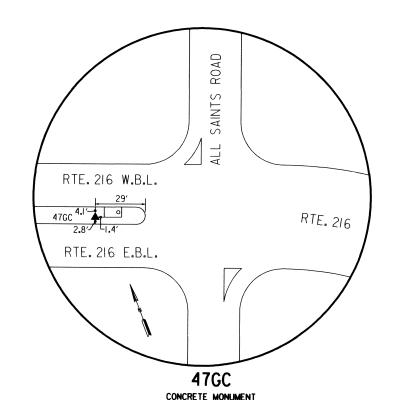

APPROVED: FOR STORM DRAINAGE SYSTEMS AND PUBLIC ROADS. HOWARD COUNTY DEPARTMENT OF PUBLIC WORKS


Steve Shanav CHIEF, TRANSPORTATION AND SPECIAL PROJECTS DIVISION

7/9/08

DEPARTMENT OF PUBLIC WORKS

Steve Shavar 7/9/08 CHIEF, TRANSPORTATION AND

Engineering A Brighter Future 72 Loveton Circle Baltimore, Maryland 21152-0949



	DES:	SER				
						1
	DRN:	CWW				
4	CHK: WRK					
	האדר	7 (2000				
9	DATE:	7/2008	BY	NO.	DATE	

CAPITAL PROJECT NO. J-4183

TITLE SHEET

ELECTION DISTRICT 3

NORFOLK AVENUE ROADWAY IMPROVEMENTS


HOWARD COUNTY, MARYLAND


AS SHOWN


SPECIAL PROJECTS DIVISION


Milli J. May . 7-10-08
CHIEF, BUREAU OF HIGHWAYS

LICENSE NO. 12966, EXPIRATION DATE: MAY 19. 2010"

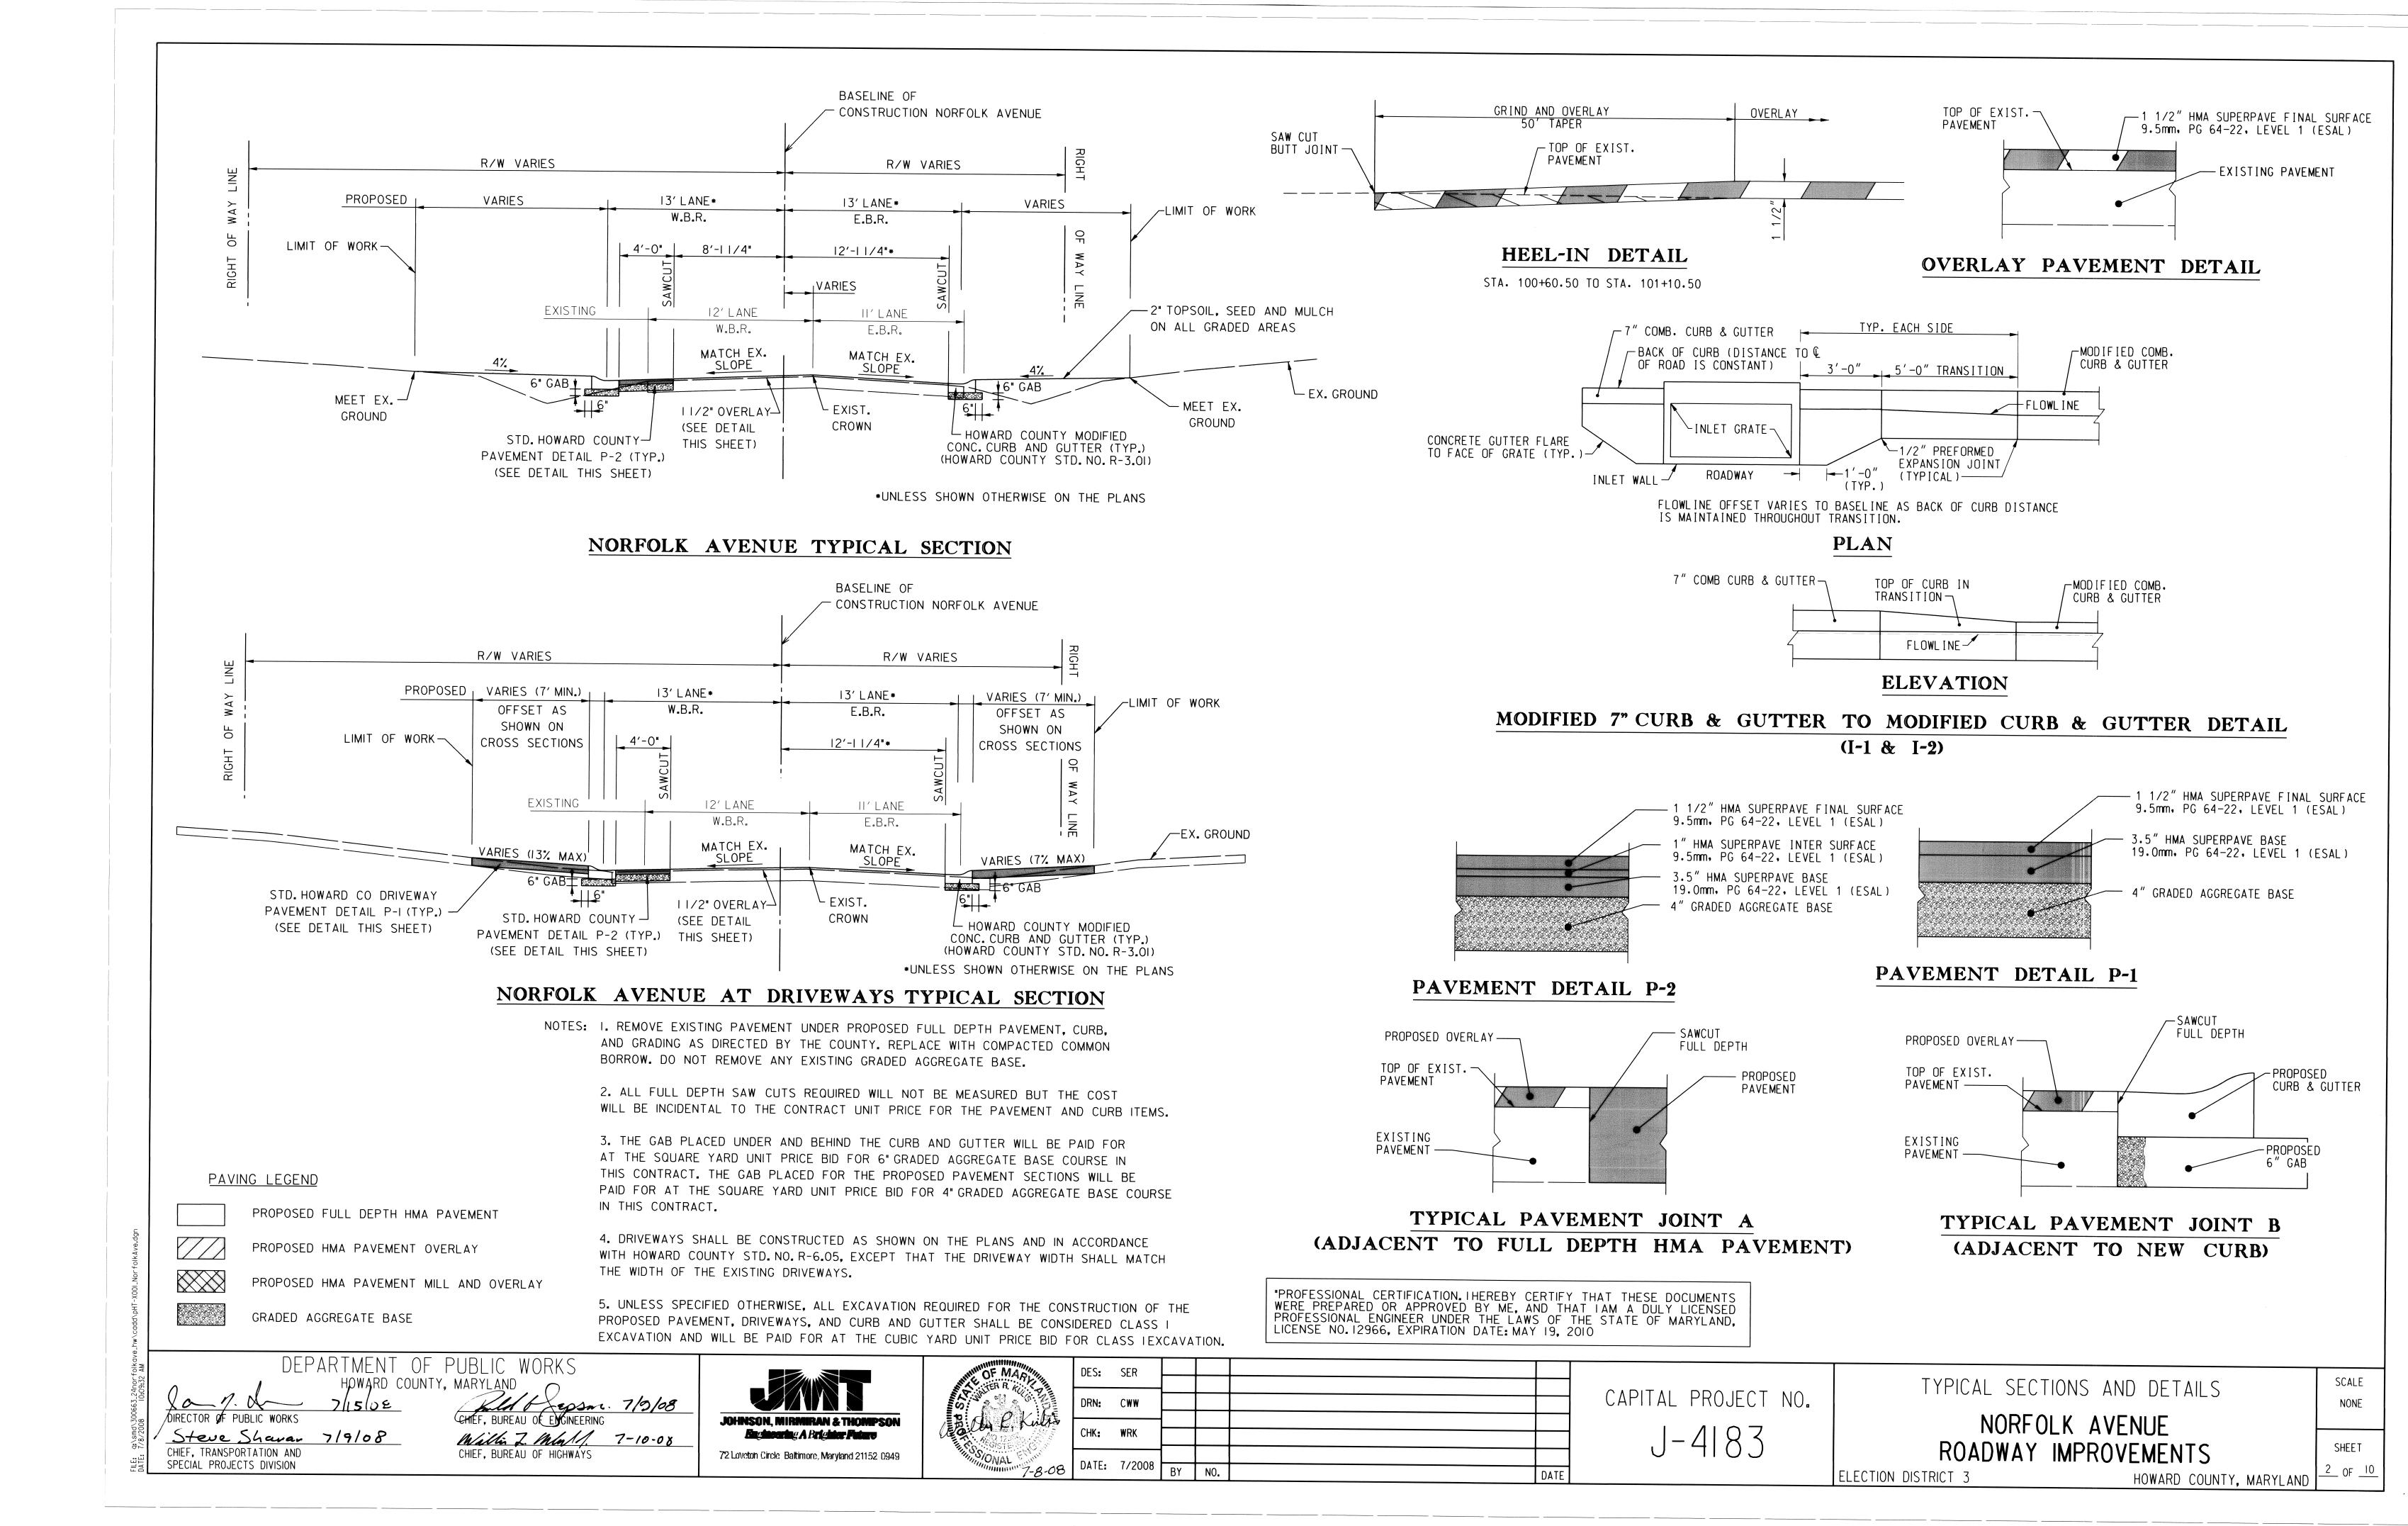


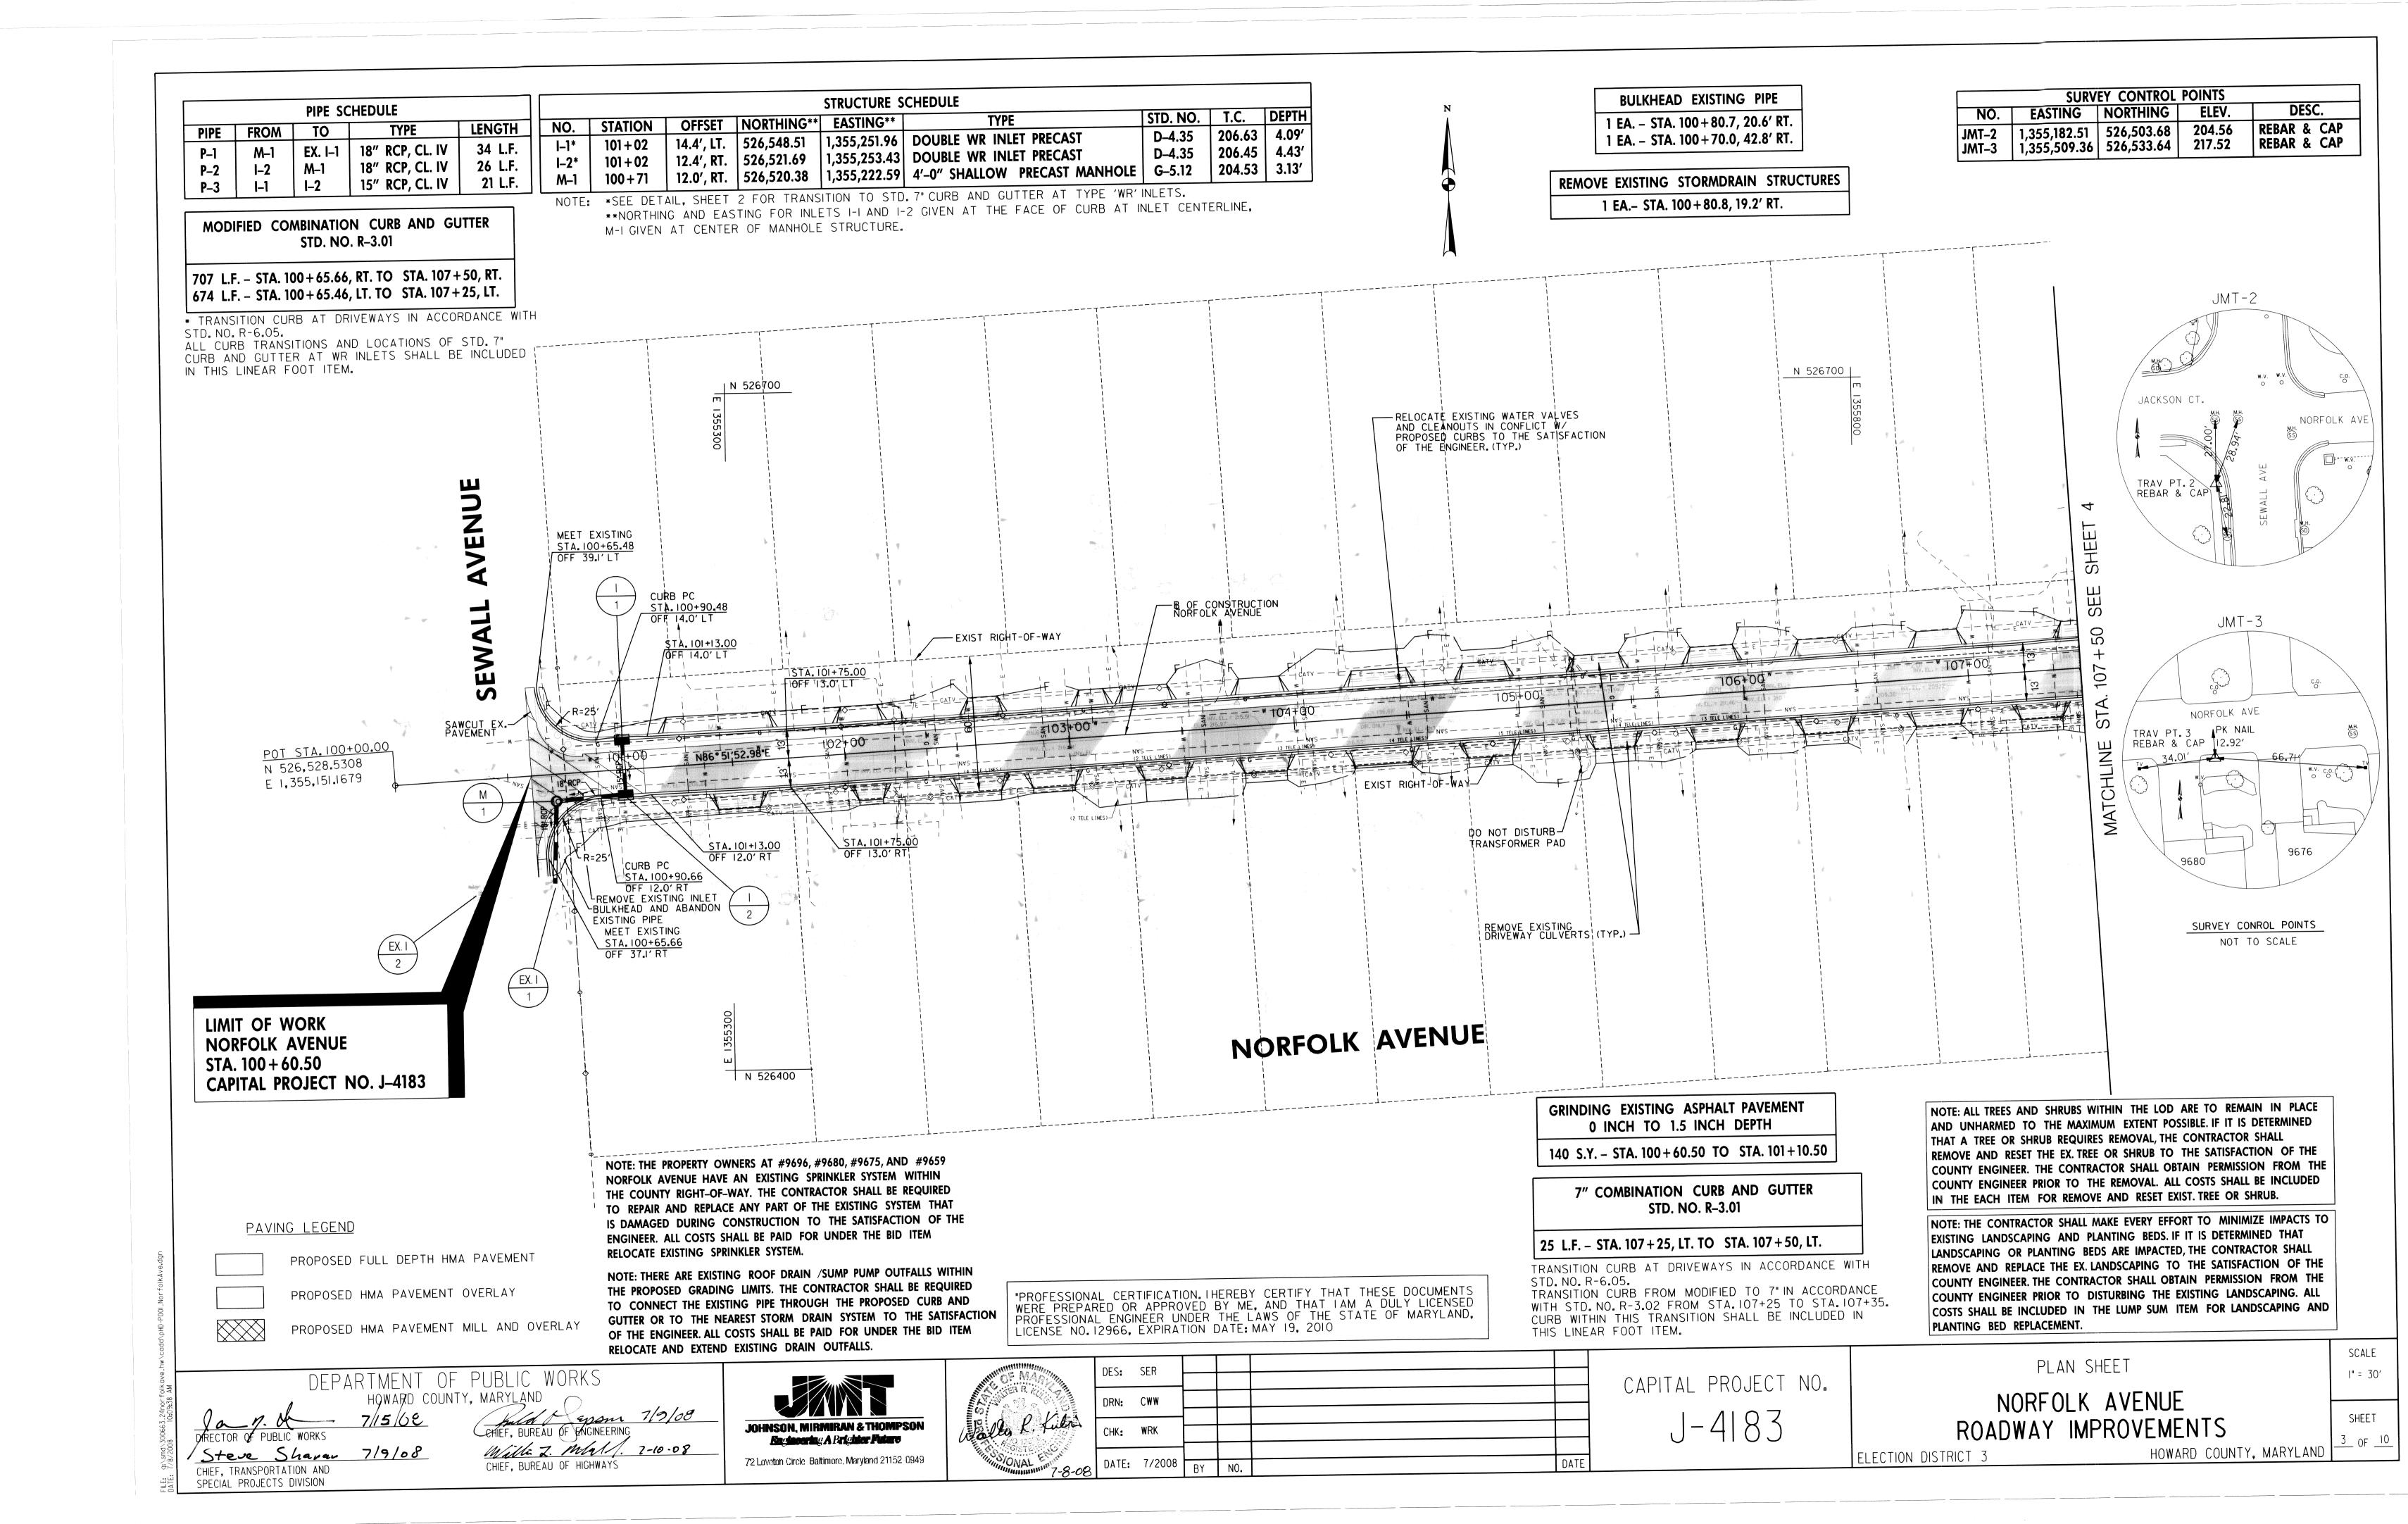

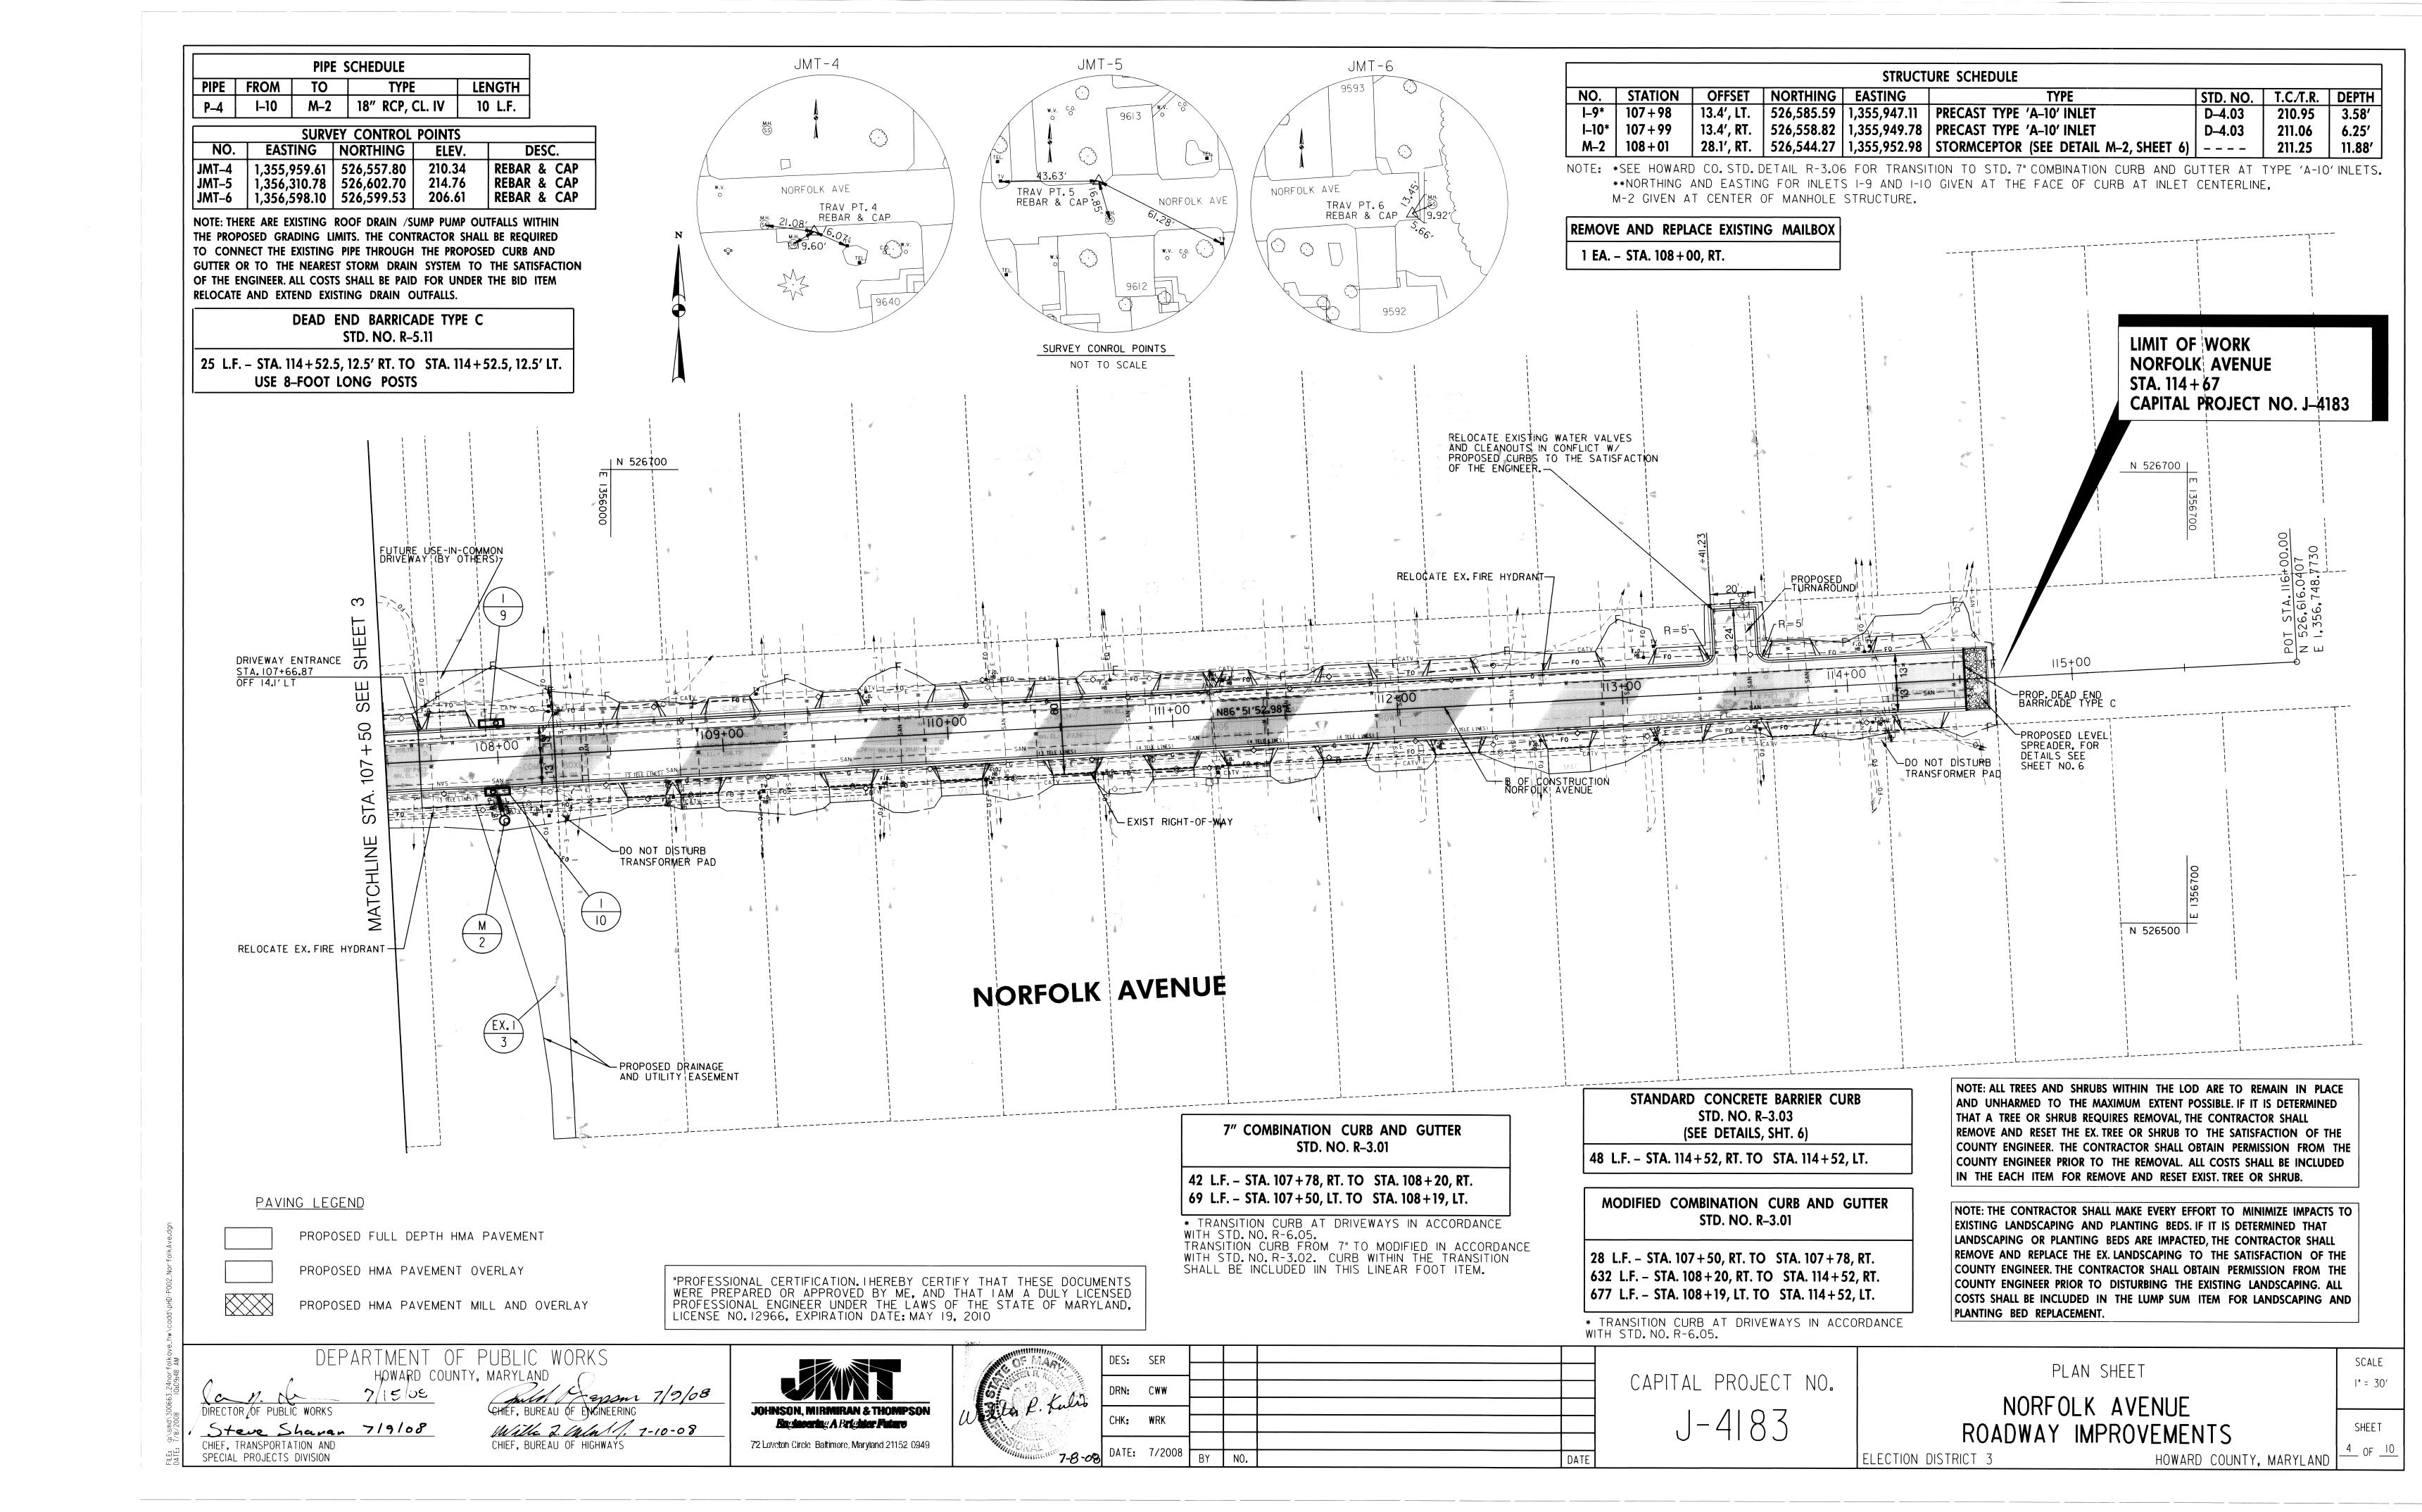

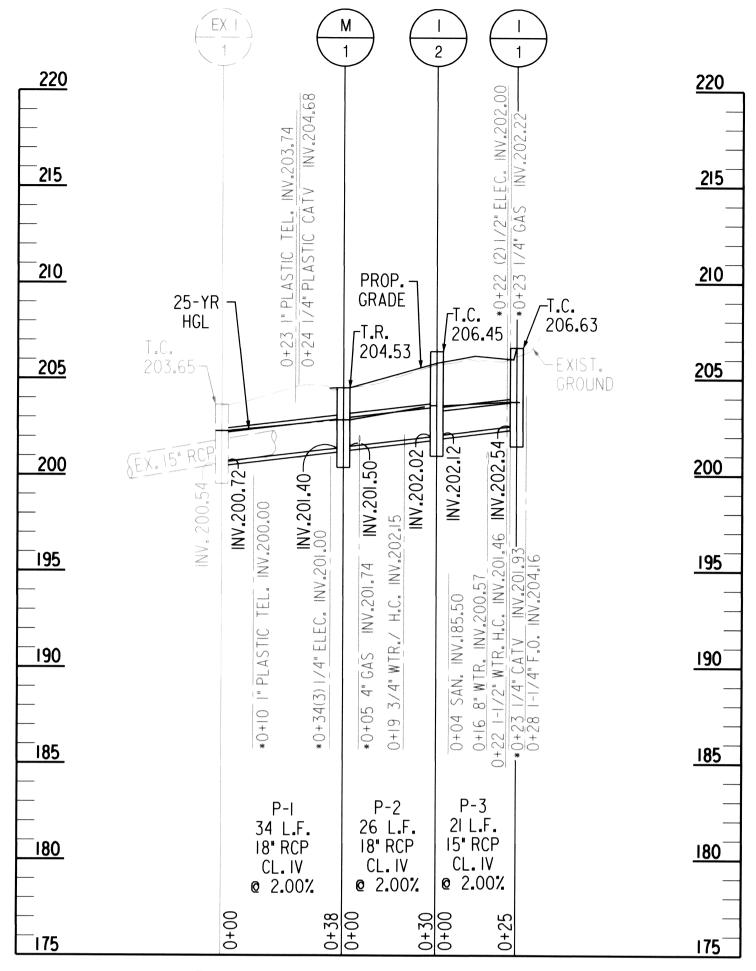

• UTILITY TO BE RELOCATED BY OTHERS

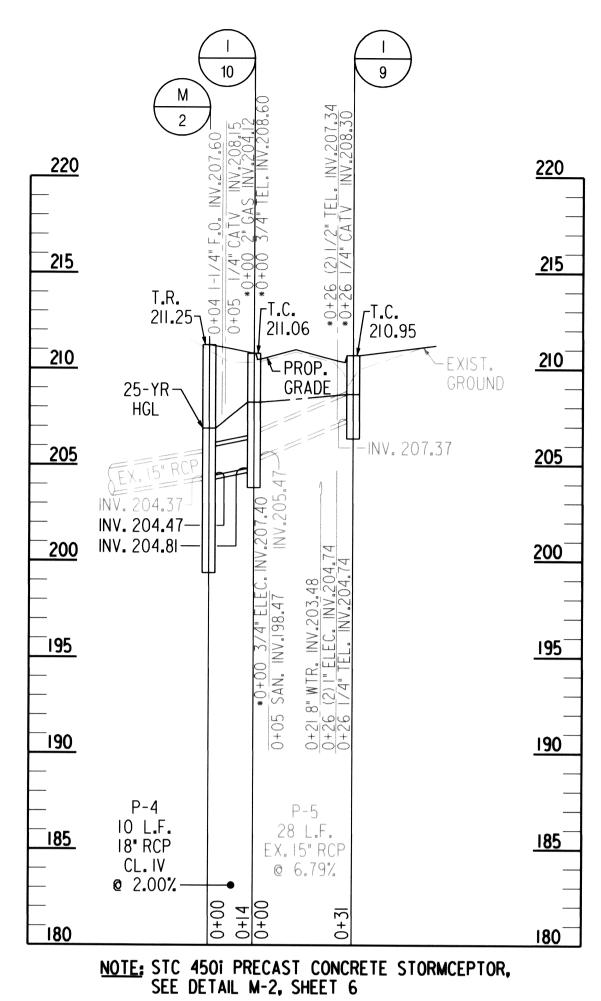

• UTILITY TO BE RELOCATED BY OTHERS

ADJUST EXISTING UTILITIES SHEET 3								
LOCATION	UTILITY TYPE	EXIST. ELEV.	PROP. ELEV.					
1 EA STA. 100+89.7, 23.3'RT. 1 EA STA. 101+92.2, 24.0'RT. 1 EA STA. 102+40.7, 15.4'LT. 1 EA STA. 102+41.8, 24.9'RT. 1 EA STA. 103+10.8, 24.7'RT. 1 EA STA. 103+50.5, 25.9'RT. 1 EA STA. 103+59.9, 14.7'LT. 1 EA STA. 104+01.0, 25.6'RT. 1 EA STA. 104+07.5, 25.8'RT. 1 EA STA. 104+58.8, 25.4'RT. 1 EA STA. 104+99.1, 25.7'RT. 1 EA STA. 105+10.2, 25.6'RT. 1 EA STA. 105+61.4, 24.6'RT. 1 EA STA. 105+61.4, 24.6'RT. 1 EA STA. 106+00.5, 26.0'RT. 1 EA STA. 106+00.5, 26.0'RT. 1 EA STA. 106+00.5, 26.0'RT. 1 EA STA. 106+00.3, 25.1'RT. 1 EA STA. 106+60.3, 25.1'RT. 1 EA STA. 106+99.9, 24.2'RT.	CLEANOUT CLEANOUT CLEANOUT CLEANOUT CLEANOUT WATER VALVE	205.65 213.53 215.54 217.21 218.59 218.48 217.87 217.43 217.37 216.40 215.37 214.94 214.22 214.21 213.65 213.65 213.62 212.21 211.48	206.05 213.62 216.85 217.40 219.19 218.72 218.27 217.65 217.48 216.46 215.55 214.57 214.39 213.87 213.76 212.71 212.51 211.90					
1 EA STA. 107+09.3, 25.3'RT. 1 EA STA. 107+47.6, 27.5'RT.	CLEANOUT CLEANOUT	211.25 211.24	211.81 211.29					

ADJUST EXISTING UTILITIES SHEET 4									
LOCATION		UTILITY TYPE	EXIST. ELEV.	PROP. ELEV.					
1 EA STA. 107+90.5. 1 EA STA. 108+39.7. 1 EA STA. 108+49.0. 1 EA STA. 109+28.3. 1 EA STA. 109+40.0. 1 EA STA. 109+78.8. 1 EA STA. 109+89.7. 1 EA STA. 110+89.1. 1 EA STA. 110+80.6. 1 EA STA. 111+90.5. 1 EA STA. 111+98.0. 1 EA STA. 112+50.6. 1 EA STA. 112+91.0. 1 EA STA. 112+91.0. 1 EA STA. 112+99.7. 1 EA STA. 114+57.8.	25.9'RT. 26.1'RT. 26.1'RT. 25.4'RT. 25.2'RT. 25.2'RT. 26.0'RT. 24.2'RT. 25.0'RT. 24.6'RT. 24.6'RT. 25.7'RT. 25.9'RT.	SAN. SEWER MANHOLE CLEANOUT WATER VALVE CLEANOUT WATER VALVE CLEANOUT WATER VALVE CLEANOUT WATER VALVE CLEANOUT CLEANOUT CLEANOUT WATER VALVE CLEANOUT SAN. SEWER MANHOLE	210.82 211.25 211.50 211.37 211.86 212.36 212.18 213.75 214.25 214.25 214.55 214.55 214.55 214.55 213.12 212.44 212.14 205.99	211.68 211.59 211.64 212.37 212.55 213.24 213.47 214.29 214.88 215.00 214.81 213.48 212.54 212.54 212.31 206.48					

"PROFESSIONAL CERTIFICATION. I HEREBY CERTIFY THAT THESE DOCUMENTS WERE PREPARED OR APPROVED BY ME, AND THAT I AM A DULY LICENSED PROFESSIONAL ENGINEER UNDER THE LAWS OF THE STATE OF MARYLAND, LICENSE NO. 15466, EXPIRATION DATE: JULY 15, 2009"

DEPARTMENT OF PUBLIC WORKS HOWARD COUNTY, MARYLAND

PRECTOR OF PUBLIC WORKS Steve Shavan 7/9/08
CHIEF, TRANSPORTATION AND SPECIAL PROJECTS DIVISION



			Control of the Contro			
	DES:	AMB				
	DRN:	J M B				
	CHK:	CWH				
$t \mid$						
	DATE:	7/2008	BY	NO.	DATE	

CAPITAL PROJECT NO. J-4183

PIPE PROFILES


NORFOLK AVENUE ROADWAY IMPROVEMENTS ELECTION DISTRICT 3

HOWARD COUNTY, MARYLAND

SHEET

H: I" = 30'


V: I'=5'

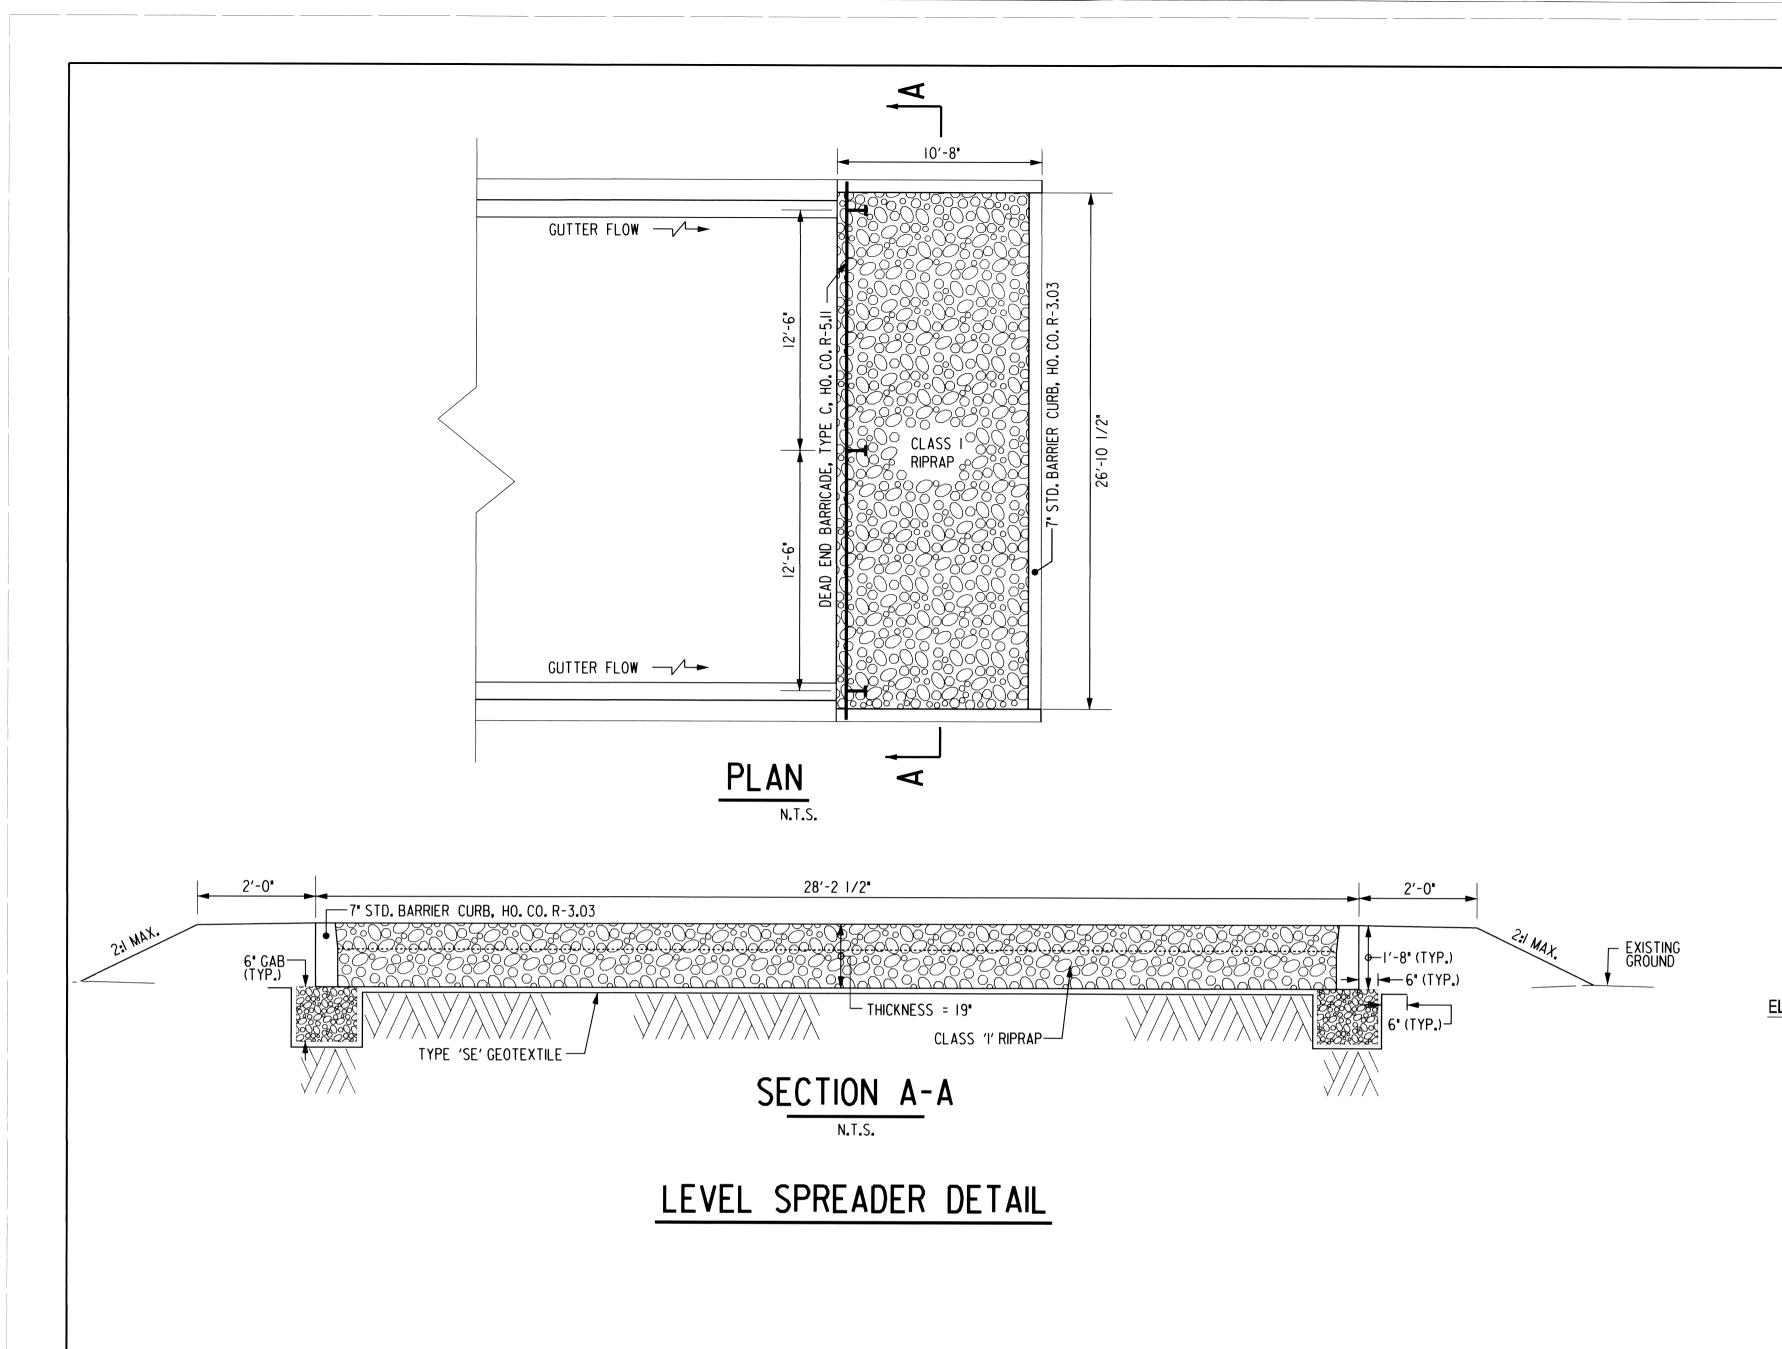



Concrete Pipe Division

STC 450i Precast Concrete Stormceptor® (450 U.S. Gallon Capacity)

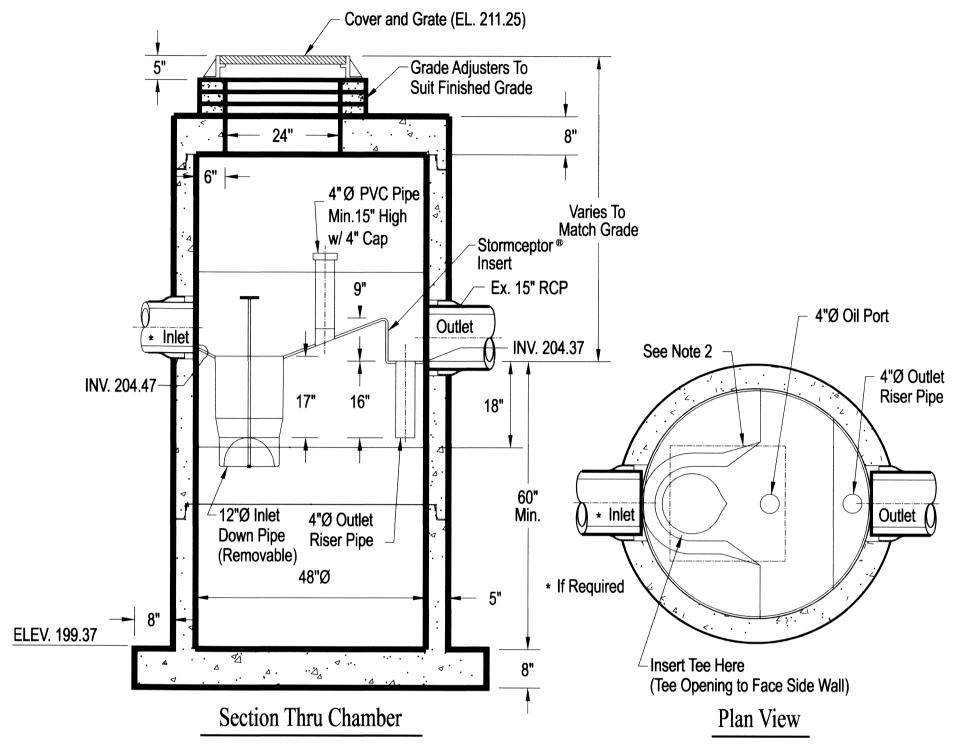

- 1. The Use Of Flexible Connection is Recommended at The Inlet and Outlet Where Applicable.
- 2. The Cover Should be Positioned Over The Inlet Drop Pipe and The Oil Port.
- 3. The Stormceptor System is protected by one or more of the following U.S. Patents: #4985148, #5498331, #5725760, #5753115, #5849181, #6068765, #6371690.
- 4. Contact a Concrete Pipe Division representative for further details not listed on this drawing.

Rinker 027

DETAIL M-2


"PROFESSIONAL CERTIFICATION. I HEREBY CERTIFY THAT THESE DOCUMENTS WERE PREPARED OR APPROVED BY ME, AND THAT I AM A DULY LICENSED PROFESSIONAL ENGINEER UNDER THE LAWS OF THE STATE OF MARYLAND, LICENSE NO. 15466, EXPIRATION DATE: JULY 15, 2009"

DEPARTMENT OF PUBLIC WORKS HOWARD COUNTY, MARYLAND etief, BUREAU OF ENGINEERING DIRECTOR OF PUBLIC WORKS 7/15/08 Steve Shaman 7/9/08

CHIEF, TRANSPORTATION AND SPECIAL PROJECTS DIVISION

Milla J. MINT. 7-10-08
CHIEF, BUREAU OF HIGHWAYS



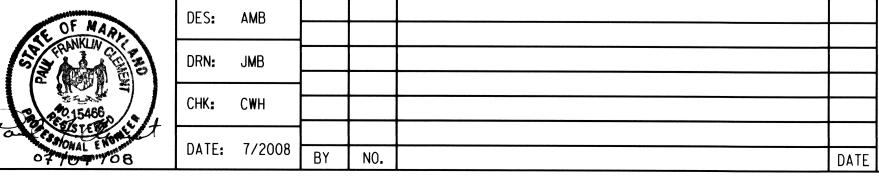

CAPITAL PROJECT NO. J-4183

DRAINAGE DETAILS

NORFOLK AVENUE ROADWAY IMPROVEMENTS

HOWARD COUNTY, MARYLAND

<u>6</u> of <u>10</u>

AS SHOWN

STANDARD SEDIMENT CONTROL NOTES

- I. A minimum of 48 hours notice must be given to the Howard County Department of Inspections, Licenses and Permits. Sediment Control Division prior to the start of any construction (410-313-1855).
- 2. All vegetative and structural practices are to be installed according to the provisions of this plan and are to be in conformance with the most current MARYLAND STANDARDS AND SPECIFICATIONS FOR SOIL FROSION AND SEDIMENT CONTROL and revisions thereto.
- 3. Following initial soil disturbance or re-disturbance, permanent or temporary stabilization shall be completed within: a) 7 calender days for all perimeter sediment control structures, dikes, perimeter slopes and all slopes greater than 3:1, b)14 days as to all other disturbed or graded areas on the project site.
- All sediment traps/basins shown must be fenced and warning signs posted around their perimeter in accordance with Vol.I, Chapter 12 of the HOWARD COUNTY DESIGN MANUAL, Storm Drainage.
- All disturbed areas must be stabilized within the time period specified above in accordance with the 1994 MARYLAND STANDARDS AND SPECIFICATIONS FOR SOIL EROSION AND SEDIMENT CONTROL for permanent seeding (Sec. 51), sod (Sec. 54), temporary seeding (Sec. 50) and mulching (Sec. 52). Temporary stabilization with mulch alone can only be done when recommended seeding dates do not allow for proper germination and establishment of grasses.
- All sediment control structures are to remain in place and are to be maintained in operative condition until permission for their removal has been obtained from the Howard County Sediment Control Inspector.
- 7. Site Analysis:

- 8. Any sediment control practice which is disturbed by grading activity for placement of utilities must be repaired on the same day of disturbance.
- Additional sediment control must be provided, if deemed necessary by the Howard County Sediment Control
- 10. On all sites with disturbed areas in excess of 2 acres, approval of the inspection agency shall be requested upon completion of installation of perimeter erosion and sediment controls, but before proceeding with any other earth disturbance or grading. Other building or grading inspection approvals may not be authorized until this initial approval by the inspection agency is made.
- II. Trenches for the construction of utilities is limited to three pipe lengths or that which shall be back-filled and stabilized by the end of each work day, whichever is shorter.

PERMANENT SEEDING NOTES

Apply to graded or cleared areas not subject to immediate further disturbance where a permanent long-lived vegetative cover is needed.

Seedbed Preparation: Loosen upper three inches of soil by raking, disking or other acceptable means before seeding, if not previously loosened.

Soil Amendments: In lieu of soil test recommendations, use one of the following schedules:

- I. Preferred -- Apply 2 tons/acre dolomitic limestone (92 lbs/1000 sq. ft.) and 600 lbs/acre 10-10-10 fertilizer (14 bs/1000 sq.ft.) before seeding. Harrow or disk into upper three inches of soil. At time of seeding, apply 400 lbs/acre 30-0-0 ureaform fertilizer (9 lbs/1000 sq. ft.).
- Acceptable -- Apply 2 tons/acre dolomitic limestone (92 lbs/1000 sq. ft.) and 1000 lbs/acre 10-10-10 fertilizer (23 lbs/1000 sq. ft.) before seeding. Harrow or disk into upper three inches of soil.

Seeding -- For the period March I -- April 30, and August I -- October 15, seed with 60 lbs/acre (1.4 lbs/1000 sq. ft.) of Kentucky 31 Tall Fescue. For the period May 1 -- July 31, seed with 60 lbs Kentucky 31 Tall Fescue per acre and 2 lbs/acre (.05 lbs/1000 sq.ft.) of weeping lovegrass. During the period of October 16 -- February 28, protect site by: Option I -- Two tons per acre of well-anchored straw mulch and seed as soon as possible in the spring.

Option 2 -- Use sod. Option 3 -- Seed with 60 lbs/acre Kentucky 30 Tall Fescue and mulch with 2 tons/acre well anchored straw.

Mulching -- Apply I-1/2 to 2 tons per acre (70 to 90 lbs/1000 sq.ft.) of unrotted small grain straw immediately after seeding. Anchor mulch immediately after application using mulch anchoring tool or 218 gallons per acre (5 gal/1000 sq. ft.) of emulsified asphalt on flat areas. On slopes 8 feet or higher, use 348 gallons per acre (8 gal/1000 sq. ft.) for anchoring.

Maintenance -- Inspect all seeding areas and make needed repairs, replacements and reseedings.

TEMPORARY SEEDING NOTES

Apply to graded or cleared areas likely to be re-disturbed where a short-term vegetative cover is needed.

<u>Seedbed preparation:</u> -- Loosen upper three inches of soil by raking, disking or other acceptable means before seeding, if not previously loosened.

Soil Amendments: -- Apply 600 lbs/acre 10-10-10 fertilizer (14 lbs/1000 sq.ft.).

Seeding: -- For periods March I -- April 30 and from August 15 -- October 15, seed with 2-1/2 bushels per acre of annual rye (3.2 lbs/1000 sq.ft.). For the period May I -- August 14, seed with 3 lbs/acre of weeping lovegrass (.07 Ibs/1000 sq. ft.). For the period November 16 -- February 28, protect site by applying 2 tons/acre of well anchored straw mulch and seed as soon as possible in the spring, or use sod.

Mulching: -- Apply 1-1/2 to 2 tons/acre (70 to 90 lbs/1000 sq.ft.) of unrotted weed-free, small grain straw immediately after seeding. Anchor mulch immediately after application using mulch anchoring tool or 218 gallons per acre (5 gal/ 1000 sq. ft.) of emulsified asphalt on flat areas. On slopes 8 feet or higher, use 348 gallons per acre (8 gal/1000 sq. ft.) for anchoring.

Refer to the 1994 MARYLAND STANDARDS AND SPECIFICATIONS FOR SOIL EROSION AND SEDIMENT CONTROL for additional rates and methods not covered.

DETAIL 33 - SUPER SILT FENCE NOTE: FENCE POST SPACING 10' MAXIMUM SHALL NOT EXCEED 10' CENTER TO CENTER 34" MINIMUM GROUND 1/8//8//8 SURFACE 36" MINIMUM 21/2" DIAMETER GALVANIZED CHAIN LINK FENCE OR ALUMINUM WITH 1 LAYER OF — 8" MINIMUN POSTS FILTER CLOTH CHAIN LINK FENCING FILTER CLOTH FLOW ____ 34" MINIMUM TATATA 16" MIN. 1ST LAYER OF FILTER CLOTH* EMBED FILTER CLOTH 8" MINIMUM INTO GROUND STANDARD SYMBOL * IF MULTIPLE LAYERS ARE REQUIRED TO ATTAIN 42" ---- SSF -----Construction Specifications

1. Fencing shall be 42" in height and constructed in accordance with the latest Maryland State Highway Details for Chain Link Fencing. The specification for a 6' fence shall be used, substituting 42" fabric and 6' length posts.

2. Chain link fence shall be fastened securely to the fence posts with wire ties. The lower tension wire, brace and truss rods, drive anchors and post caps are not required except on the ends of the fence.

3. Filter cloth shall be fastened securely to the chain link fence with ties spaced every 24" at the top and mid section.

4. Filter cloth shall be embedded a minimum of 8" into the ground.


5. When two sections of filter cloth adjoin each other, they shall be overlapped by 6" and folded.

6. Maintenance shall be performed as needed and silt buildups removed when "bulges" develop in the silt fence, or when silt reaches 50% of fence height


7. Filter cloth shall be fastened securely to each fence post with wire ties or staples at top and mid section and shall meet the following requirements for

Georestile Class F:		
Tensile Strength	50 lbs/in (min.)	Test: MSMT 509
Tensile Modulus	20 lbs/in (min.)	Test: MSMT 509
Flow Rate	0.3 gal/ft²/minute (max.) Test: MSMT 322
Filtering Efficiency	75% (min.)	Test: MSMT 322
U.S. DEPARTMENT OF AGRICULTURE	PAGE	MARYLAND DEPARTMENT OF ENVIRONMENT
SOIL CONSERVATION SERVICE	H - 26 - 3	WATER MANAGEMENT ADMINISTRATION

DETAIL 23B - AT GRADE INLET PROTECTION

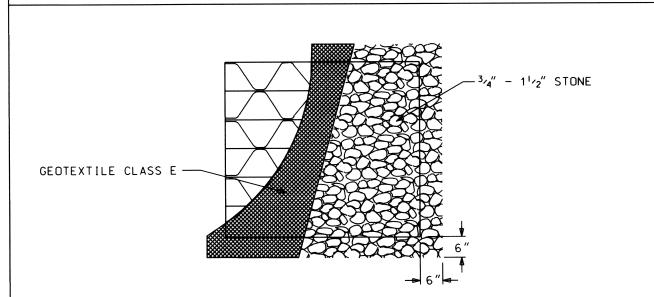

PLAN/CUT AWAY VIEW

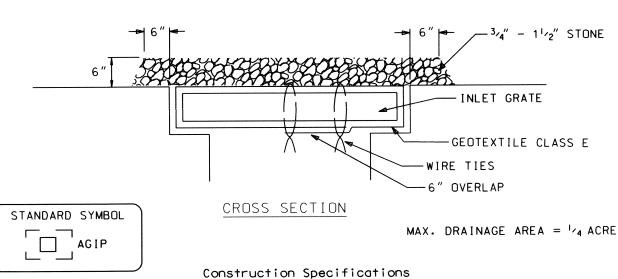

1. Lift grate and wrap with Geotextile Class E to completely cover all openings. then set grate back in place.

2. Place $\frac{3}{4}$ to $\frac{1}{2}$ stone, $\frac{4}{-6}$ thick on the grate to secure the fabric and provide additional filtration.

MARYLAND DEPARTMENT OF ENVIRONMENT U.S. DEPARTMENT OF AGRICULTURE WATER MANAGEMENT ADMINISTRATION E - 16 - 5ASOIL CONSERVATION SERVICE

SUPER SILT FENCE

Design Criteria Silt Fence Length Slope Slope Length (maximum) (maximum) Steepness Slope Unlimited 0 - 10% 0 - 10:1 Unlimited 1,500 feet 10 - 20% 10:1 - 5:1 200 feet 20 - 33% 5:1 - 3:1 100 feet 1,000 feet 3:1 - 2:1 100 feet 500 feet 33 - 50% 250 feet 2:1 + 50 feet 50% + MARYLAND DEPARTMENT OF ENVIRONMENT U.S. DEPARTMENT OF AGRICULTURE WATER MANAGEMENT ADMINISTRATION SOIL CONSERVATION SERVICE

SEQUENCE OF CONSTRUCTION

- I. CONTRACTOR SHALL OBTAIN GRADING PERMIT FROM HOWARD COUNTY DEPARTMENT OF INSPECTION, LICENSES AND PERMITS PRIOR TO BEGINNING CONSTRUCTION.
- 2. CONTRACTOR SHALL CONTACT HOWARD COUNTY DEPARTMENT OF INSPECTION, LICENSES, AND PERMITS AT (410) 313-2455 TO SCHEDULE A PRE-CONSTRUCTION MEETING AT LEAST 72 HOURS BEFORE CONSTRUCTION IS TO BEGIN.
- 3. INSTALL SUPER SILT FENCE, SSF-I AND SSF-2 AT EAST END OF NORFOLK AVENUE.
- 4. INSTALL ROADWAY BASE WIDENING, CURB AND GUTTER FROM STA. 103+00 TO STA. 101+00. CONTRACTOR SHALL PERFORM FILLING OPERATIONS. REMOVE EXISTING DRIVEWAY CULVERTS, AND PROVIDE DRIVEWAY REHAB FOR AREAS BEHIND CURB FROM UPSTREAM TO DOWNSTREAM AS ROADWAY WORK PROGRESSES.
- 5. CONSTRUCT STORM DRAIN SYSTEM FROM EX.I-I TO I-2 AND INSTALL CIP-I, AGIP-2, AND AGIP-I. RUNOFF SHALL NOT BE DIRECTED TO AGIP-I AND AGIP-2 UNTIL THE CONTRIBUTING DRAINAGE AREA IS STABILIZED.
- 6. INSTALL ROADWAY BASE WIDENING, CURB AND GUTTER AT SEWALL AVE INTERSECTION. CONTRACTOR SHALL PERFORM FILLING OPERATIONS, REMOVE EXISTING DRIVEWAY CULVERTS AND STORMDRAIN STRUCTURES, BULKHEAD EXISTING PIPES, AND PROVIDE DRIVEWAY REHAB FOR AREAS BEHIND CURB FROM UPSTREAM TO DOWNSTREAM AS ROADWAY WORK PROGRESSES.
- INSTALL ROADWAY BASE WIDENING. CURB AND GUTTER FROM STA.103+00 TO STA.107+75, FROM STA. III+50 TO 108+25. AND FROM STA. III+50 TO 114+50. CONTRACTOR SHALL PERFORM FILLING OPERATIONS, REMOVE EXISTING DRIVEWAY CULVERTS, AND PROVIDE DRIVEWAY REHAB FOR AREAS BEHIND CURB FROM UPSTREAM TO DOWNSTREAM AS ROADWAY WORK PROGRESSES.
- 8. INSTALL ROADWAY BASE WIDENING, CURB AND GUTTER FROM STA.107+75 TO STA.108+25. REMOVE EXISTING JUNCTION BOX AND PIPE CONNECTIONS, CONSTRUCT I-9 AND STORMDRAIN SYSTEM FROM 1-10 TO M-2. INSTALL CIP-10 AND CIP-9.
- 9. CONSTRUCT LEVEL SPREADER AT EAST END OF NORFOLK AVE.
- IO. ONCE ALL DISTURBED AREAS HAVE BEEN STABILIZED AND WITH THE APPROVAL OF THE INSPECTOR. REMOVE INLET PROTECTIONS AND SUPER SILT FENCE.

- . CONTRACTOR IS RESPONSIBLE FOR MAINTAINING POSITIVE DRAINAGE THROUGHOUT THE LENGTH OF THE PROJECT.
- 2. WITHIN 24 HOURS OF INITIAL DISTURBANCE, ALL DISTURBED AREA UNDER ROADS SHALL BE STABILIZED WITH GAB AND/OR PAVEMENT AND LAWN AREAS SHALL BE STABILIZED WITH SEED AND MULCH.
- 3. INSTALLATION OF THE STORM DRAIN SHALL BE LIMITED TO THAT WHICH CAN BE BACKFILLED AND STABILIZED EACH WORKING DAY.
- 4. INSTALL INLET PROTECTION AS EACH INLET IS BUILT.
- 5. SPOIL FROM THE TRENCHING OPERATION IS TO BE PLACED ON THE UPHILL SIDE OF CONSTRUCTION.


"PROFESSIONAL CERTIFICATION. I HEREBY CERTIFY THAT

THESE DOCUMENTS WERE PREPARED OR APPROVED BY

ENGINEER UNDER THE LAWS OF THE STATE OF MARYLAND, LICENSE NO. 15466, EXPIRATION DATE: JULY 15, 2009

ME. AND THAT IAM A DULY LICENSED PROFESSIONAL

| DETAIL 23 - CURB INLET PROTECTION (COG OR COS INLETS)

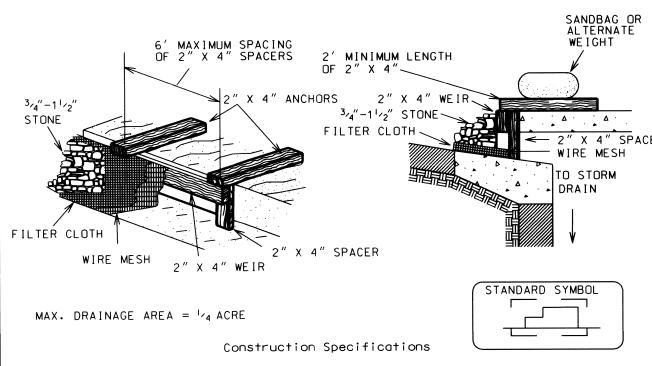

1. Attach a continuous piece of wire mesh (30" minimum width by throat length, plus 4") to the 2" x 4" weir (measuring throat length plus 2") as shown on the standard

2. Place a continuous piece of Geotextile Class E the same as the wire mesh over the wire mesh and securely attach it to the 2" x 4" weir.

3. Securely nail the 2" X 4" weir to a 9" long vertical spacer to be located between the weir and the inlet face (max. 4' apart).

4. Place the assembly against the inlet throat and nail (minimum 2' lengths of $2" \times 4"$ to the top of the weir at spacer locations). These $2" \times 4"$ anchors shall extend across the inlet top and be held in place by sandbags or alternate weight.

5. The assembly shall be placed so that the end spacers are a minimum 1 ' beyond both ends of the throat opening.

6. Form the $\frac{1}{2}$ x $\frac{1}{2}$ wire mesh and the geotextile fabric to the concrete gutter and against the face of the curb on both sides of the inlet. Place clean $\frac{3}{4}x1^{1}x2^{0}$ stone over the wire mesh and geotextile in such a manner to prevent water from entering the inlet under or around the geotextile.

7. This type of protection must be inspected frequently and the filter cloth and stone replaced when clogged with sediment.

8. Assure that storm flow does not bypass the inlet by installing a temporary earth or asphalt dike to direct the flow to the inlet.

MARYLAND DEPARTMENT OF ENVIRONMENT U.S. DEPARTMENT OF AGRICULTURE SOIL CONSERVATION SERVICE WATER MANAGEMENT ADMINISTRATION

By the Developer:

"I/We certify that all development and construction will be done according to this plan, and that any responsible personnel involved in the construction project will have a Certificate of Attendance at a Department of the Environment approved Training Program for the Control of Sediment and Erosion before beginning the project. Lalso authorize periodic on-site inspection by the Howard Soil Conservation District."

Ronald G. Lapson

Signature of Developer Print name below Signature

Signature of Engineer

Print name below Signature

By the Engineer:

'Icertify that this plan for erosion and sediment control represents a practical and workable plan based on my personal knowledge of the site conditions and that it was prepared in accordance with the requirements of the Howard Soil Conservation District."

Jan 7. Clement 07/08/08 PAUL F. CLEMENT

7/2/08

EROSION AND SEDIMENT CONTROL DETAILS AND NOTES

NORFOLK AVENUE

ROADWAY IMPROVEMENTS

HOWARD COUNTY, MARYLAND

DEPARTMENT OF PUBLIC WORKS HOWARD COUNTY, MARYLAND

RECTOR OF PUBLIC WORKS Steve Shanan 7/9/08 CHIEF. TRANSPORTATION AND SPECIAL PROJECTS DIVISION



DES: AMB DRN: JMB CHK: CWH DATE: 7/2008 BY NO.

CAPITAL PROJECT NO.


ELECTION DISTRICT 3

AS SHOWN

SHEET

CHIEF, BUREAU OF HIGHWAYS

JOHNSON, MIRMIRAN & THOMPSON Regineering A Brighter Future 72 Loveton Circle Baltimore, Maryland 21152-0949

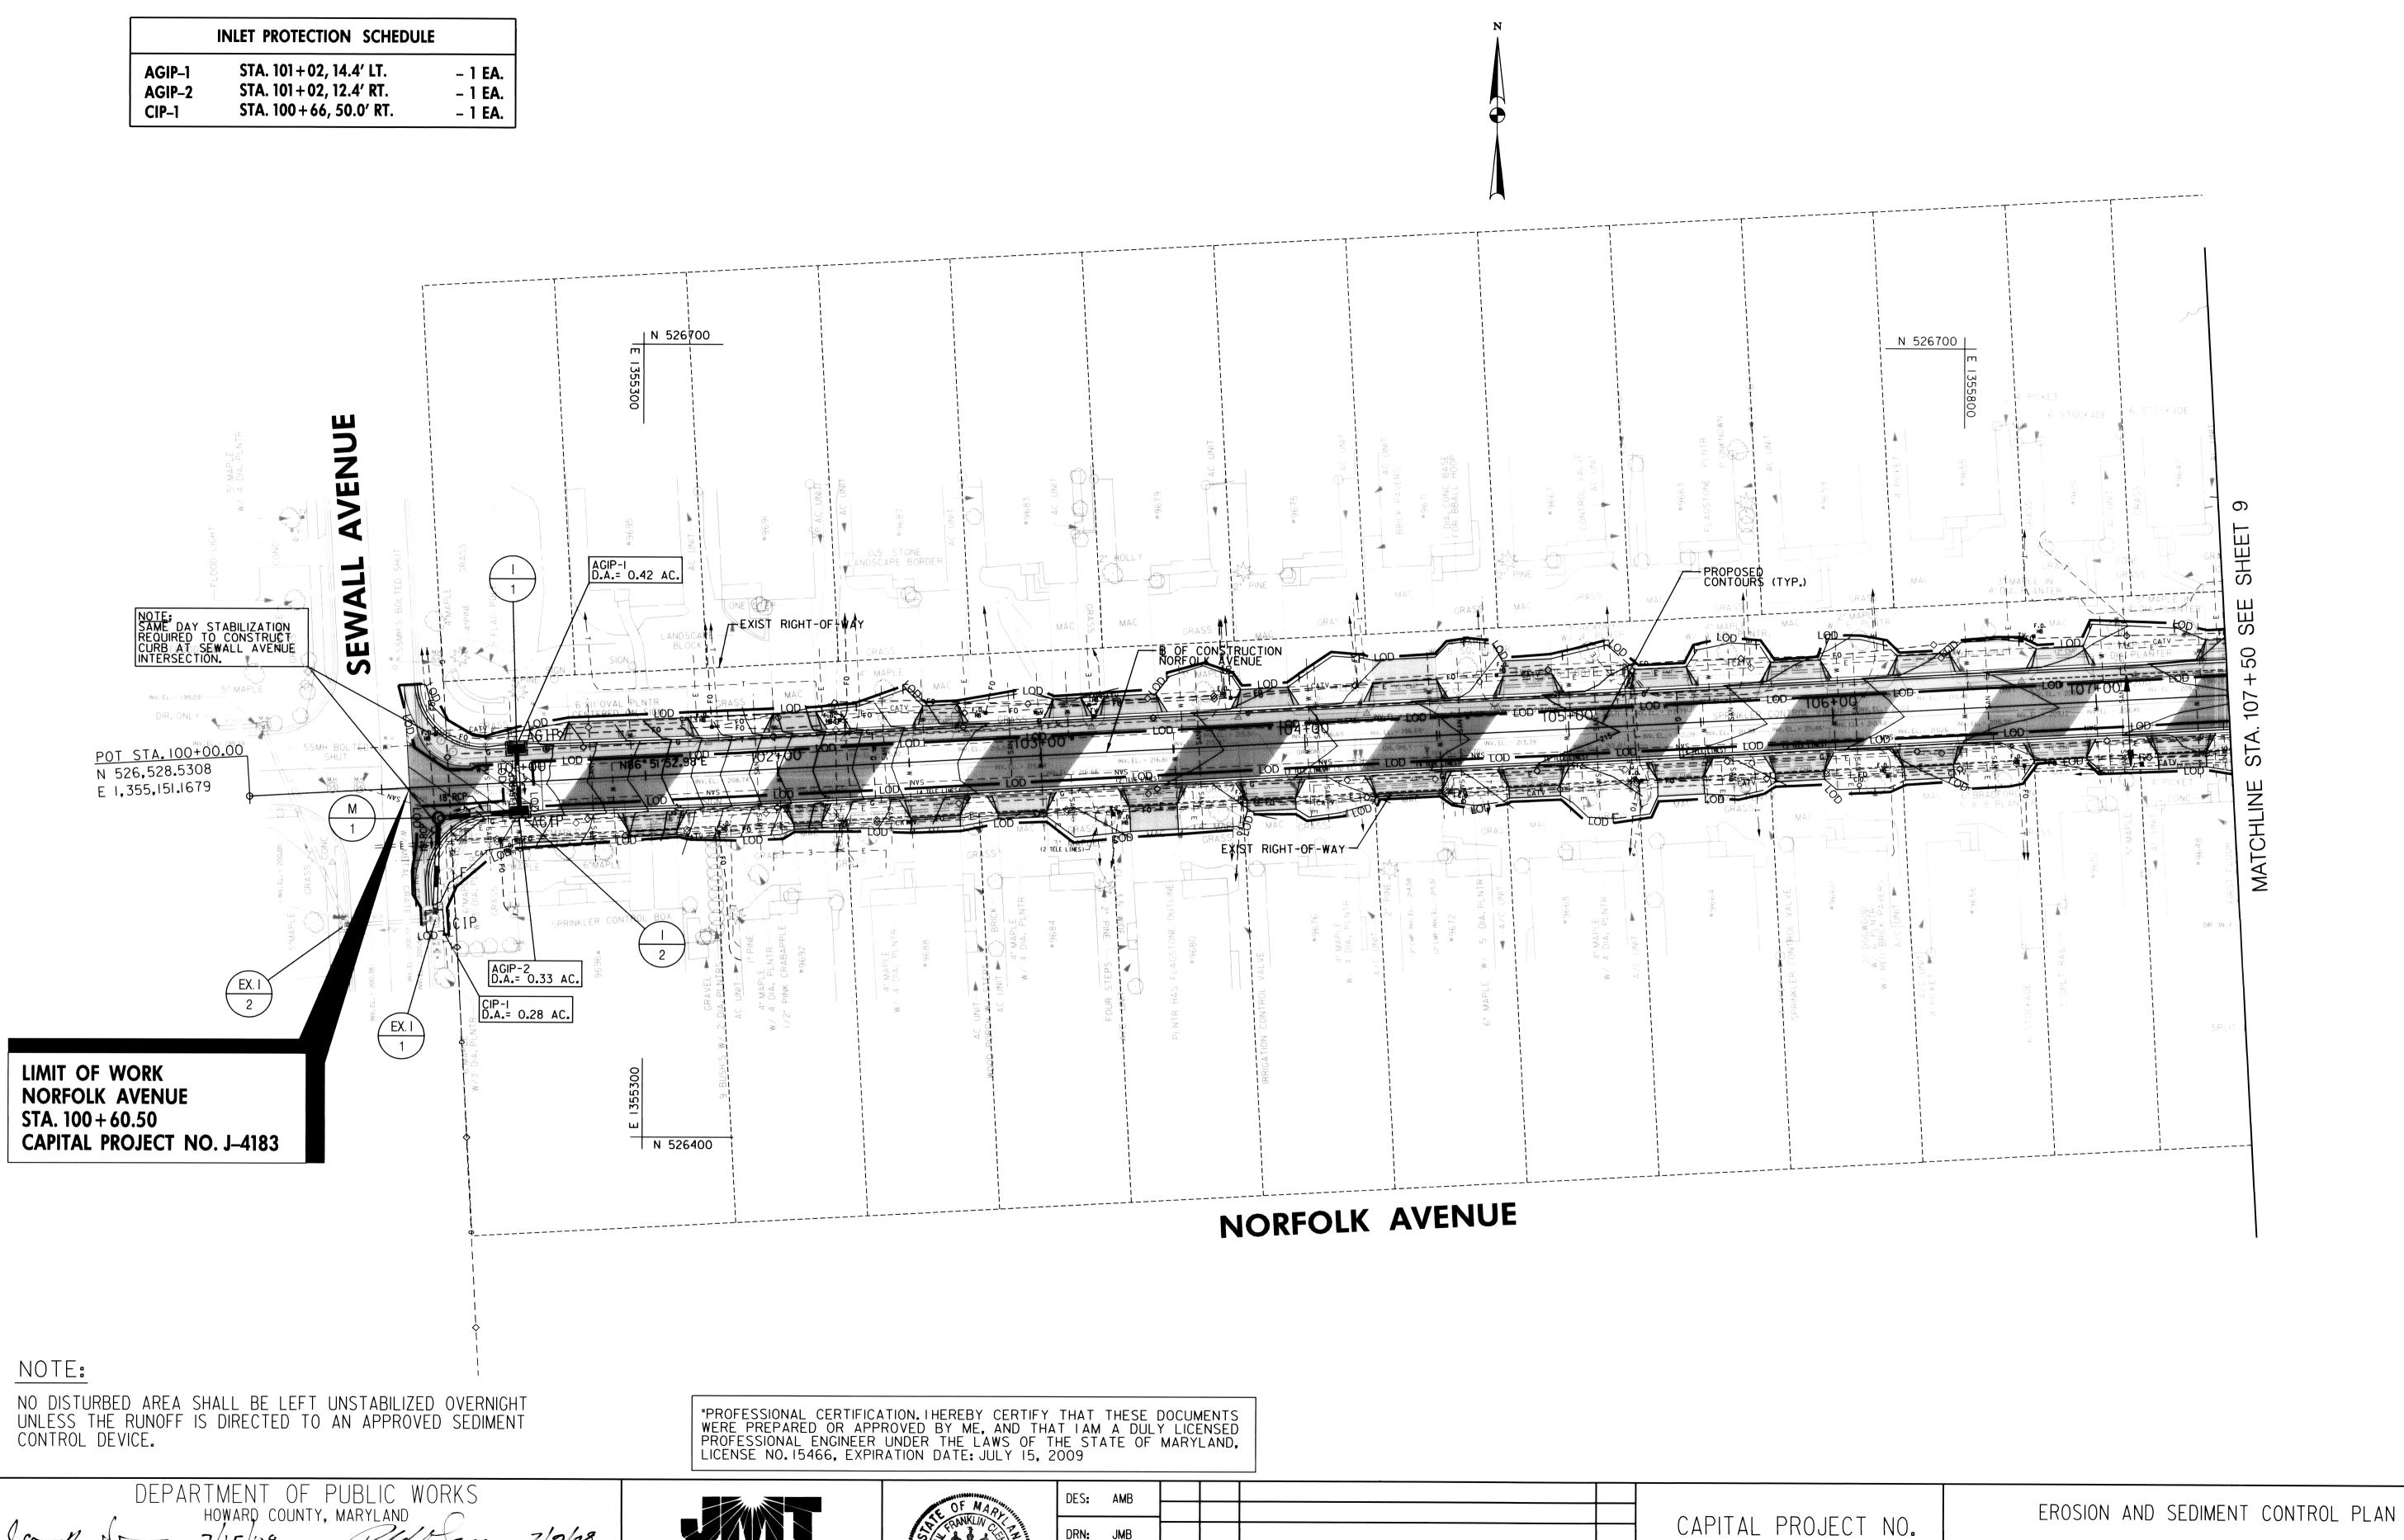

I**"** = 30'

8 OF <u>10</u>

ROADWAY IMPROVEMENTS

NORFOLK AVENUE

ELECTION DISTRICT 3

J-4183

HOWARD COUNTY, MARYLAND

DIRECTOR OF PUBLIC WORKS

CHIEF, TRANSPORTATION AND SPECIAL PROJECTS DIVISION

Steve Shavan 7/9/08


CHIEF, BUREAU OF EMIGINEERING Malle 2. Mall. 7-10-08 CHIEF, BUREAU OF HIGHWAYS


JOHNSON, MIRMIRAN & THOMPSON

Engineering A Brighter Future 72 Loveton Circle Baltimore, Maryland 21152-0949



1. 1. 1. 1. 1. 1. 1. 1. 1. 1. 1. 1. 1. 1					
	DRN:	JMB			
	CHK:	С₩Н			
	DATE:	7/2008	RY	NΩ	

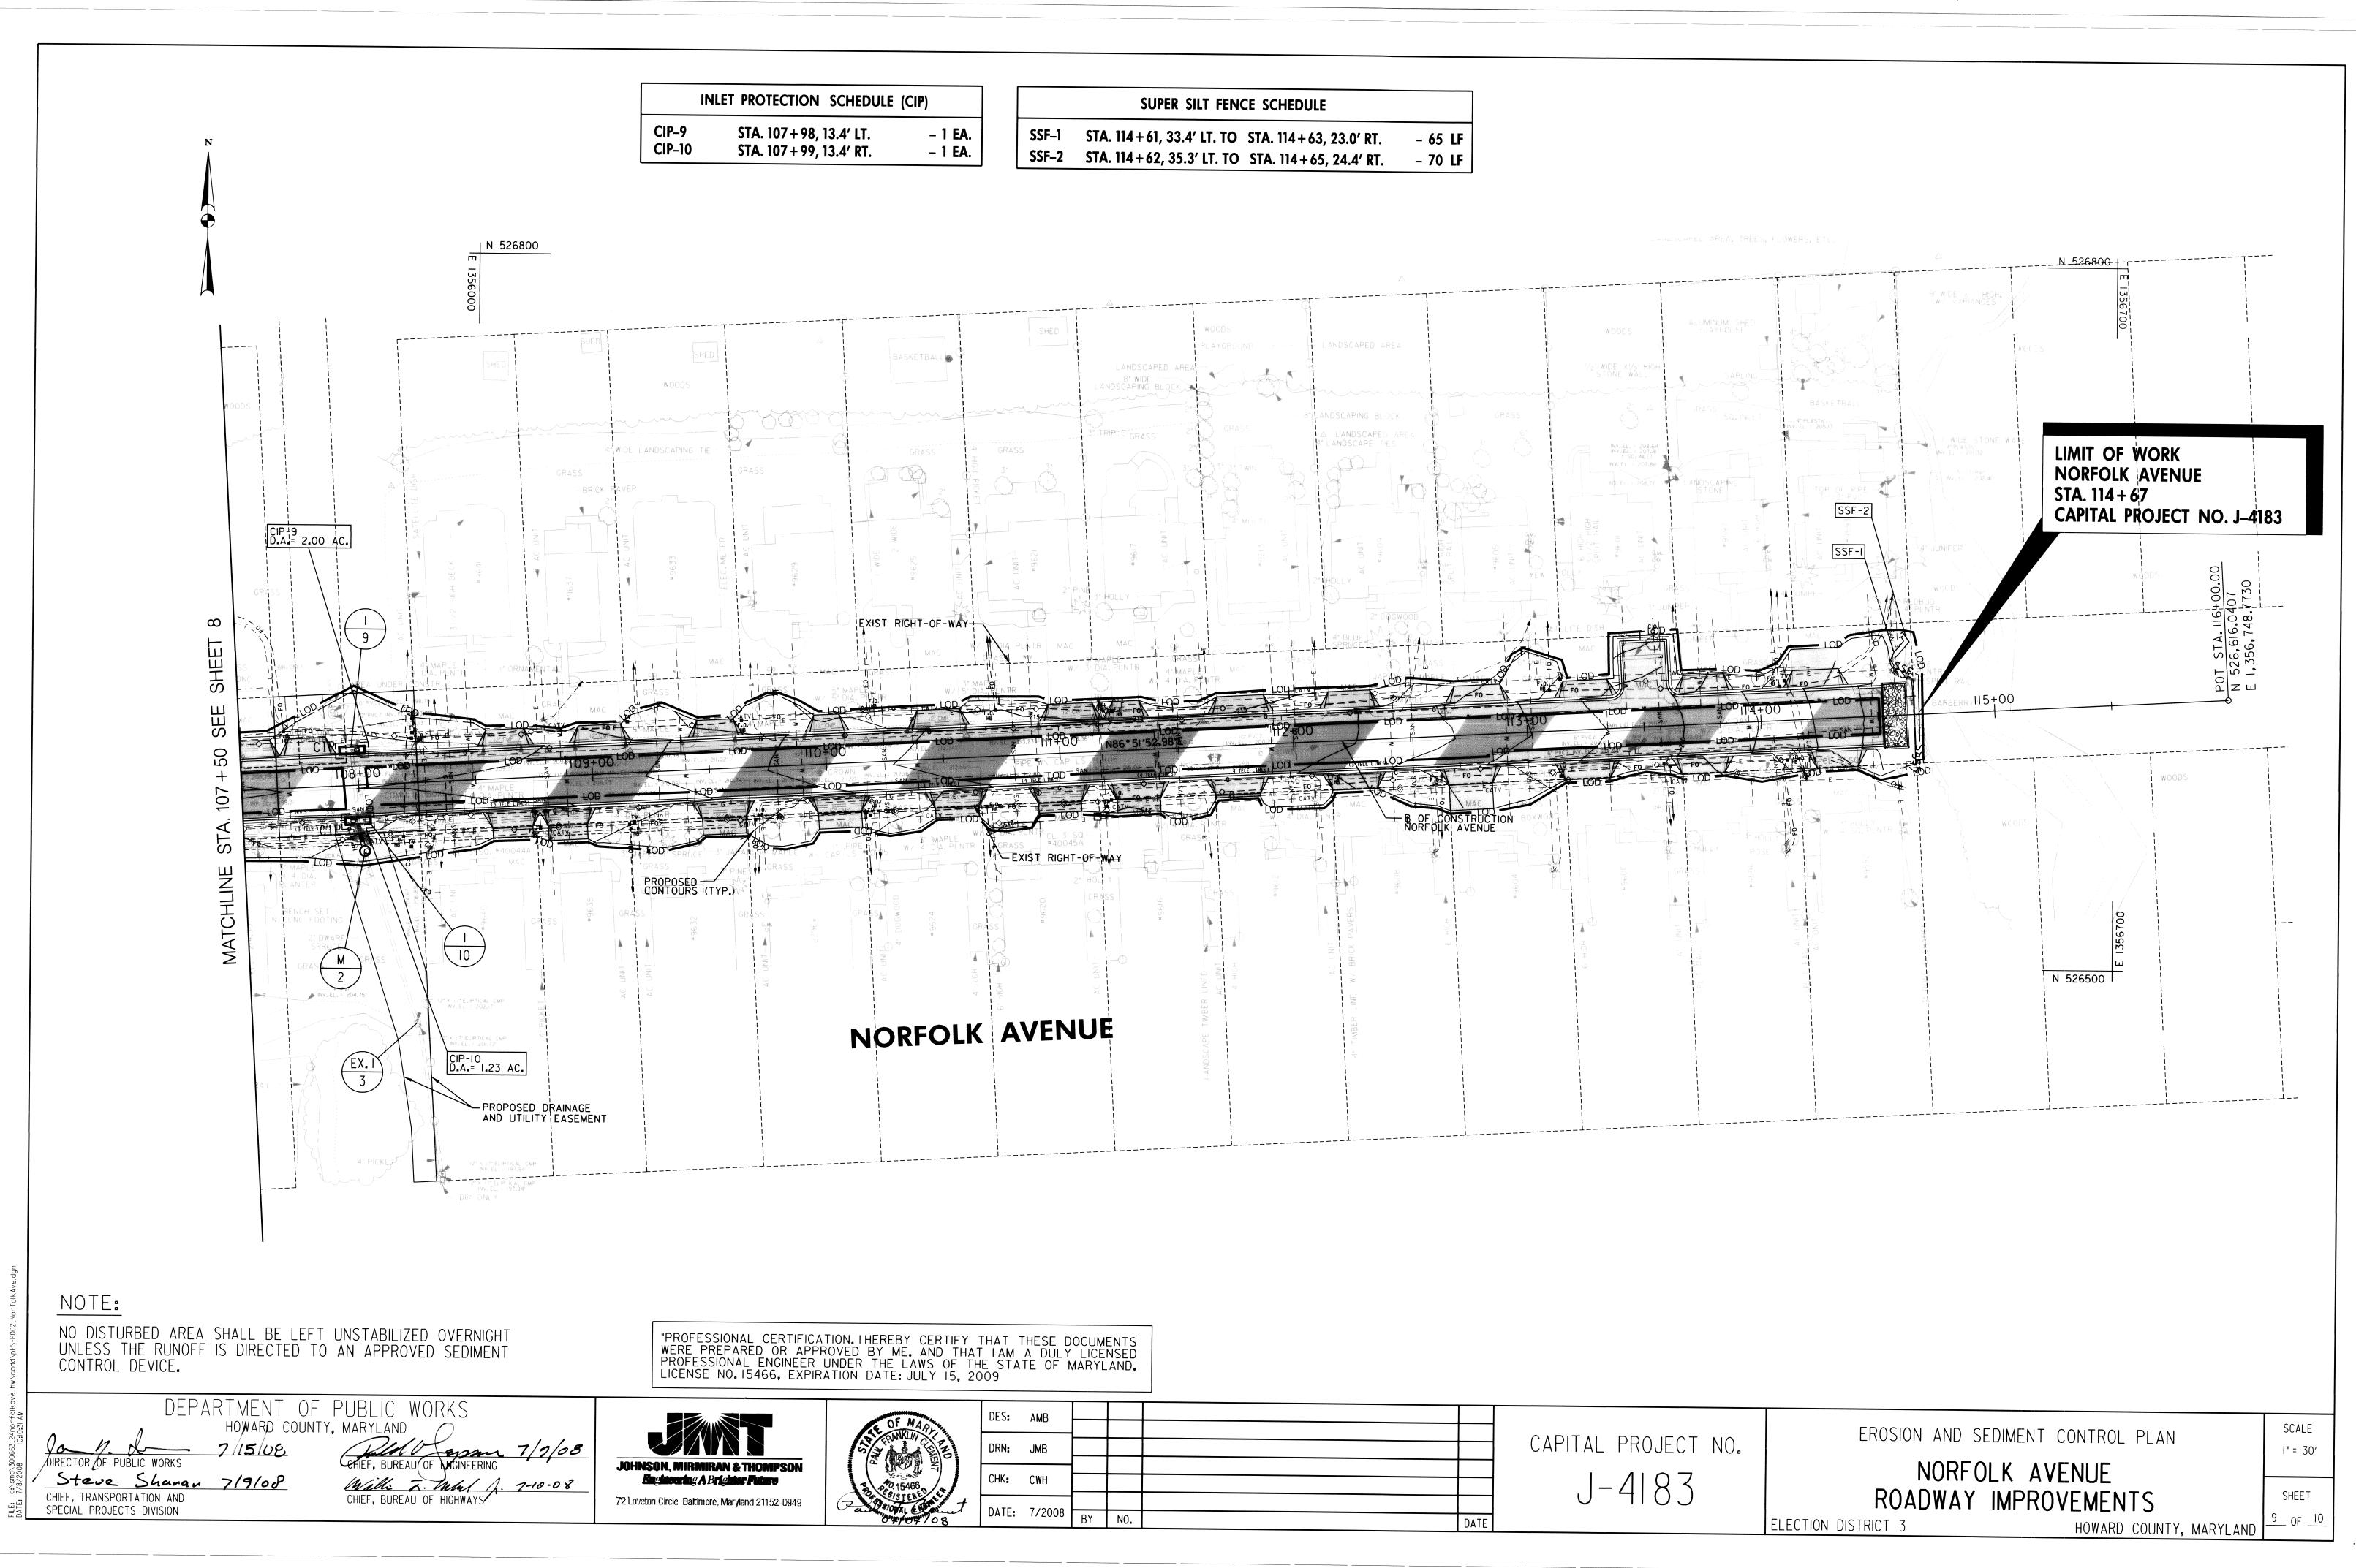

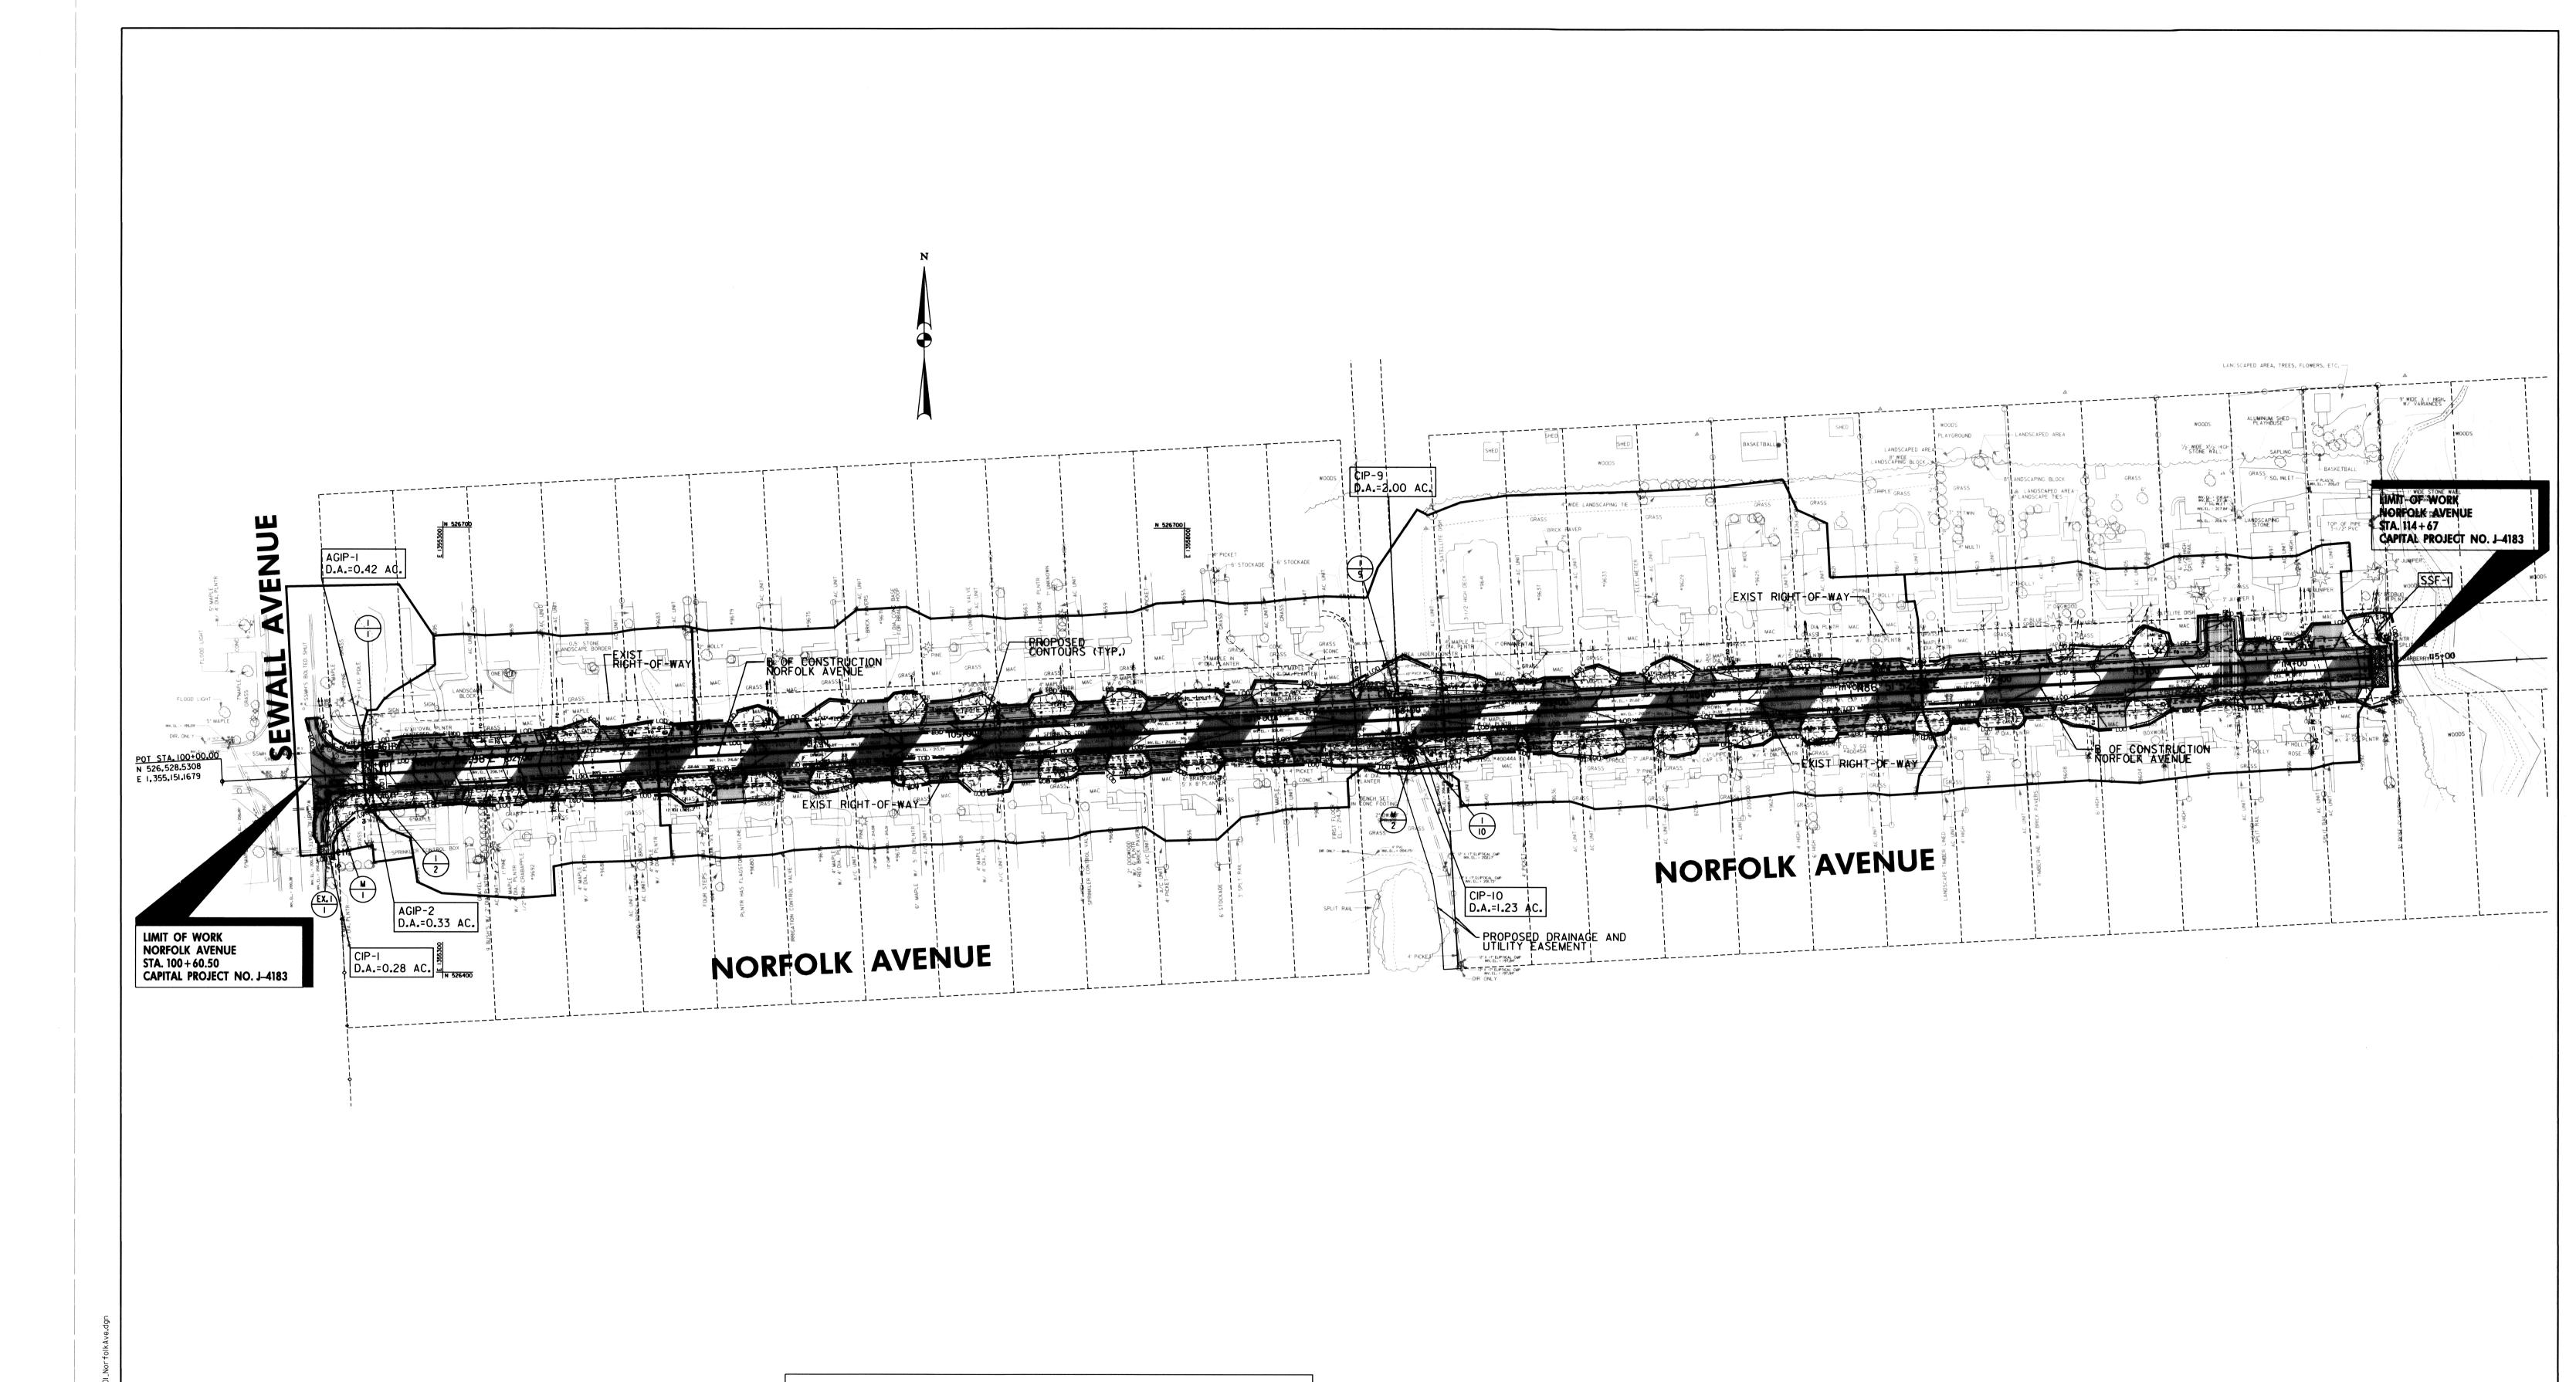

"PROFESSIONAL CERTIFICATION. I HEREBY CERTIFY THAT THESE DOCUMENTS WERE PREPARED OR APPROVED BY ME, AND THAT I AM A DULY LICENSED PROFESSIONAL ENGINEER UNDER THE LAWS OF THE STATE OF MARYLAND, LICENSE NO. 15466, EXPIRATION DATE: JULY 15, 2009

DEPARTMENT OF PUBLIC WORKS
HOWARD COUNTY, MARYLAND

DIRECTOR OF PUBLIC WORKS Steve Shavan 7/9/08
CHIEF, TRANSPORTATION AND

SPECIAL PROJECTS DIVISION

CHIEF, BUREAU OF ENGINEERING With 2 MM/.
CHIEF, BUREAU OF HIGHWAYS

JOHNSON, MIRMIRAN & THOMPSON

Registeering A Brighter Future 72 Loveton Circle Baltimore, Maryland 21152-0949



DES:	AMB				
DRN:	JMB				
CHK:	CWH				
DATE:	7/2008	BY	NO.	DATE	

CAPITAL PROJECT NO. J-4183

EROSION AND SEDIMENT CONTROL DA MAP

NORFOLK AVENUE ROADWAY IMPROVEMENTS ELECTION DISTRICT 3

HOWARD COUNTY, MARYLAND

SCALE

I" = 50'

SHEET