# ROUTE 216 PUMPING STATION UPGRADE HOWARD COUNTY, MARYLAND

## GENERAL NOTES

- 1. APPROXIMATE LOCATION OF EXISTING UTILITIES ARE SHOWN. THE CONTRACTOR SHALL AND MAINTAIN UNINTERRUPTED SERVICE. ANY DAMAGE INCURRED SHALL BE REPAIRED IMMEDIATELY TO THE SATISFACTION OF THE ENGINEER AT THE CONTRACTOR'S
- 2. TOPOGRAPHIC FIELD SURVEYS WERE PERFORMED IN FEBRUARY 2008 BY KCI TECHNOLOGIES, INC.
- 3. THE CONTRACTOR SHALL PROVIDE SURVEY CONSTRUCTION STAKEOUT FOR ALL NECESSARY LINES, GRADES AND ELEVATION OF THE PROPOSED FACILITY.
- 4. ALL EXCAVATION SHALL BE KEPT FREE OF WATER UNTIL BACKFILL IS PROPERLY TAMPED IN PLACE TO FINISHED GRADE.
- 5. FOR DETAILS NOT SHOWN ON THE DRAWINGS, AND FOR MATERIALS AND CONSTRUCTION METHODS, USE HOWARD COUNTY DESIGN MANUAL, VOLUME IV, STANDARD SPECIFICATIONS AND DETAILS FOR CONSTRUCTION (LATEST EDITION). THE CONTRACTOR SHALL HAVE A COPY OF VOLUME IV AT THE JOB SITE.
- 6. CONTRACTOR SHALL NOTIFY THE FOLLOWING UTILITY COMPANIES OR AGENCIES AT LEAST FIVE WORKING DAYS BEFORE STARTING WORK SHOWN ON THESE PLANS.

BG&E (CONSTRUCTION SERVICES) BG&E (EMERGENCY) BUREAU OF UTILITIES (DPW) COLONIAL PIPELINE CO. MISS UTILITY STATE HIGHWAY ADMINISTRATION VERIZON

1-800-252-1133 410-850-4620 410-685-1400 410-313-4900 410-795-1390 1-800-257-7777 410-531-5533 1-800-743-0033 / 410-224-9210

- 7. CONTRACTOR SHALL REMOVE TREES, STUMPS AND ROOTS ALONG THE LINE OF PRICE BID FOR CONSTRUCTION OF THE RESPECTIVE FEATURES AND FACILITIES SHOWN
- 8. TREES AND SHRUBS OUTSIDE THE LOD SHALL BE PROTECTED FROM DAMAGE TO THE MAXIMUM EXTENT. TREES AND SHRUBS WITHIN THE CONSTRUCTION AREA ARE NOT TO BE REMOVED UNLESS DESIGNATED FOR REMOVAL ON THE PLANS OR AS DIRECTED BY ENGINEER.
- 9. THE CONTRACTOR SHALL NOT OPERATE ANY WATER VALVES ON THE EXISTING WATER SYSTEM. THE CONTRACTOR SHALL NOTIFY THE BUREAU OF UTILITIES, HOWARD COUNTY 15 DAYS PRIOR TO WATER MAIN SHUT DOWNS.
- 10. CLEAR ALL UTILITIES BY A MINIMUM OF 12". CLEAR ALL POLES BY 5'-0" MINIMUM OR TUNNEL AS REQUIRED UNLESS OTHERWISE NOTED. THE OWNER HAS CONTACTED THE UTILITY COMPANIES AND HAS MADE ARRANGEMENTS FOR BRACING OF POLES AS SHOWN ON THE DRAWINGS. IN THE EVENT THE CONTRACTOR'S WORK REQUIRES THE BRACING OF ADDITIONAL POLES, ANY COST INCURRED BY THE OWNER FOR THE BRACING OF ADDITIONAL POLES OR DAMAGES SHALL BE DEDUCTED FROM MONIES OWED THE CONTRACTOR. THE CONTRACTOR SHALL COORDINATE WITH THE UTILITY COMPANIES TO SCHEDULE THE BRACING OF THE POLES


#### HORIZONTAL & VERTICAL CONTROL

THE HORIZONTAL AND VERTICAL CONTROL BASED ON MARYLAND NAD 83/91 (HORIZONTAL) AND NAVD '88 (VERTICAL) DATUM. HOWARD COUNTY GEODETIC SURVEY CONTROL NUMBERS

NO. 46BC N 539925.113 E 1337205.733 ELEV. 472.028

NO. 41GD N 541496.623 E 1333747.187 ELEV. 463.443 DEPARTMENT OF PUBLIC WORKS

CAPITAL PROJECT No. W8280 CONTRACT NO. 44-4579

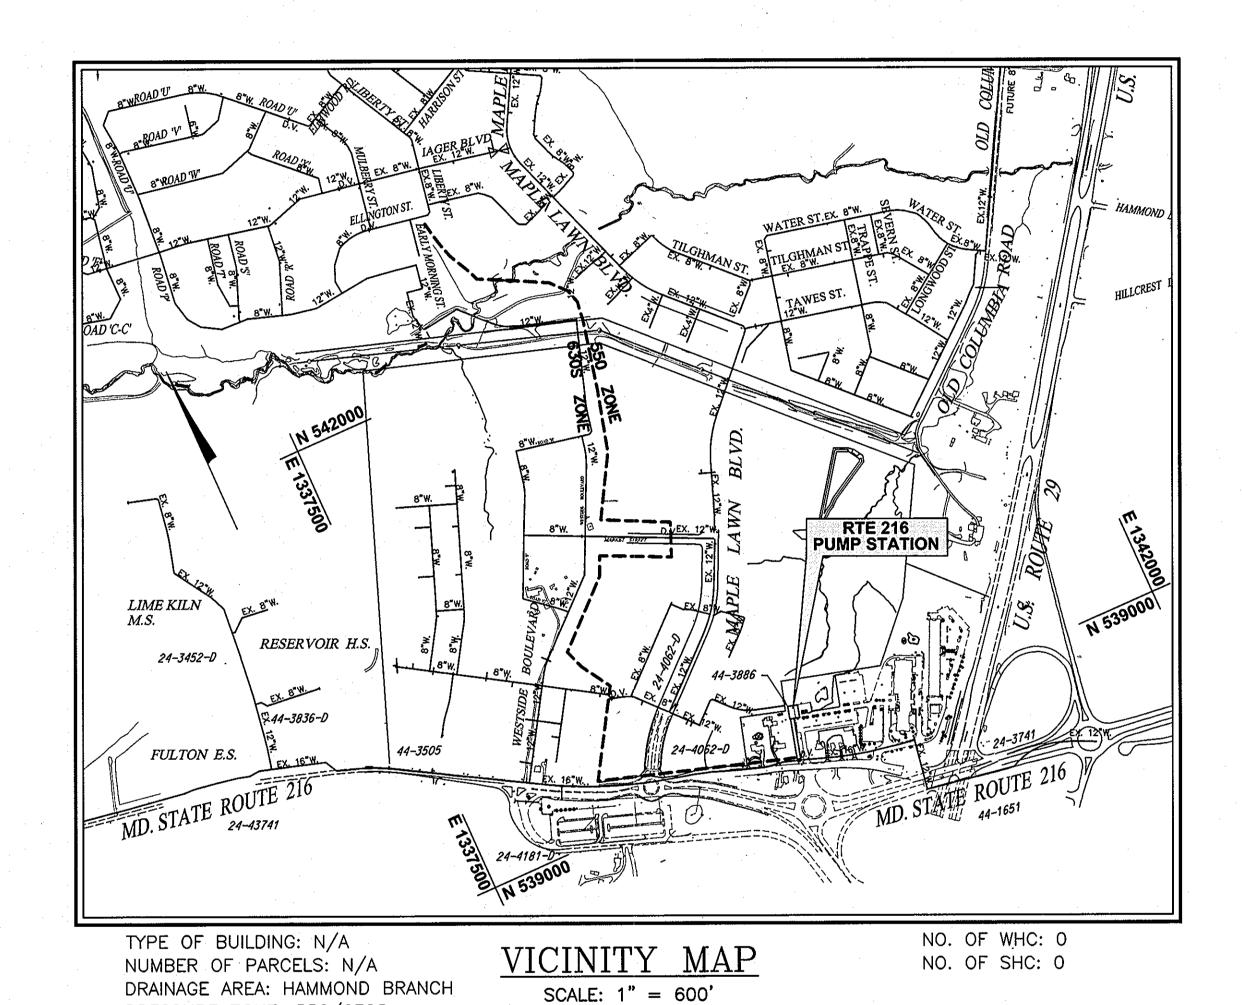

PRESSURE ZONE: 550/630S DIRECTIONS: TAKE ROUTE 216 WEST FROM 1-95. PASS OVER US. 29 TURN RIGHT AT FIRST TRAFFIC CIRCLE, ENTER COUNTY ANNEX PARKING LOT, SITE ON LEFT.


ADJACENT WATER & SEWER FACILITY CONTRACTS:


YR. 1987, 44-1651 MD. RTE. 216 ROUTINE WATER EXTENSION WESTERN SCHOOL COMPLEX WATER MAIN EXTENSION YR. 1996, 24-3452-D WESTERN ELEMENTARY SCHOOL NO. 2 PARCEL NO. 115 WATER AND SEWER YR. 1998, 24-3741 MD. RTE. 216 AND US RTE. 29 12-INCH WATER AND 8-INCH SEWER RELOCATION YR. 2000 44-3886 MD. RTE. 216 BOOSTER PUMPING STATION YR. 2000 44-3836-D EASTERN HIGH SCHOOL NO. 2 WATER SERVICE YR. 2003 24-4062-D MAPLE LAWN FARMS BUSINESS DISTRICT - AREA -1 YR. 2004 24-4181-D GRACE COMMUNITY CHURCH WATER AND SEWER

INDEX OF SHEETS


SHEET NO.	DESCRIPTION
G-1	TITLE SHEET '
C-1	SITE PLAN LEGEND AND DETAILS
C-2	ENLARGED SITE PLAN
SC-1	SEDIMENT AND EROSION CONTROL NOTES AND DETAILS
ME-1	PUMP STATION SCHEMATIC SYSTEM CURVES AND DESIGN CRITERIA
ME-2	EXISTING PUMP STATION DEMOLITION
ME-3	PROPOSED PUMP STATION UPGRADES
E-1	SINGLE-LINE DIAGRAM AND PROPOSED LOADS
I—1	INSTRUMENTATION AND CONTROL LEGEND AND SYMBOLS
I-2	PROCESS & INSTRUMENTATION DIAGRAM AND RISER DIAGRAMS
1–3	CONTROL DIAGRAMS


# DRAWING SYMBOLS

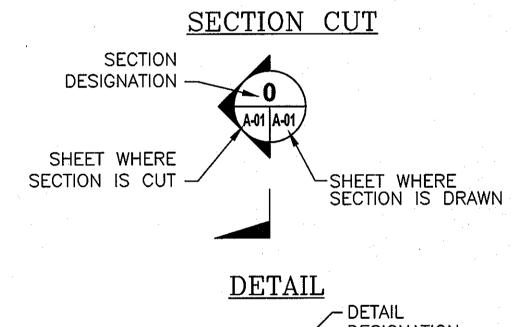

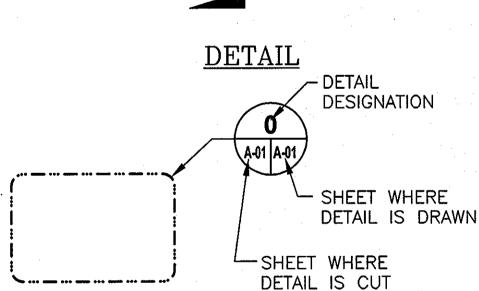

#### PLAN/SCHEMATIC REFERENCE





GRAPHIC SCALE

600 300 0 SCALE: 1"=600'

G-1

SHEET

DEPARTMENT OF PUBLIC WORKS

HOWARD COUNTY, MARYLAND 10/1/08 DATE CHIEF, UTILITY DESIGN DIVISION

TECHNOLOGIES

CONSTRUCTION MANAGERS 10 North Park Drive Hunt Valley, MD 21030 PHONE: (410) 316-7800 Fax: (410) 316-7817 www.kci.com



a duly licensed professional engineer under the laws of the State of Maryland, License No. 14364 Expiration Date 03/29/09

PROFESSIONAL CERTIFICATION. I hereby certify that these documents were prepared or approved by me, and that I am

PARTY TO STAND	(
S CHANGE	ſ
	[
01438	Į.

DES: SEA DRN: LFN снк: JRK LFN | / AS BUILT BY **REVISION** 

TITLE SHEET

BLOCK NO. \_


2.24.10


DATE 600' SCALE MAP NO.


RTE 216 PUMP STATION UPGRADE

CAPITAL PROJECT No. W8280 CONTRACT No. 44-4579

ELECTION DISTRICT NO.5 HOWARD COUNTY, MARYLAND 1 of 11

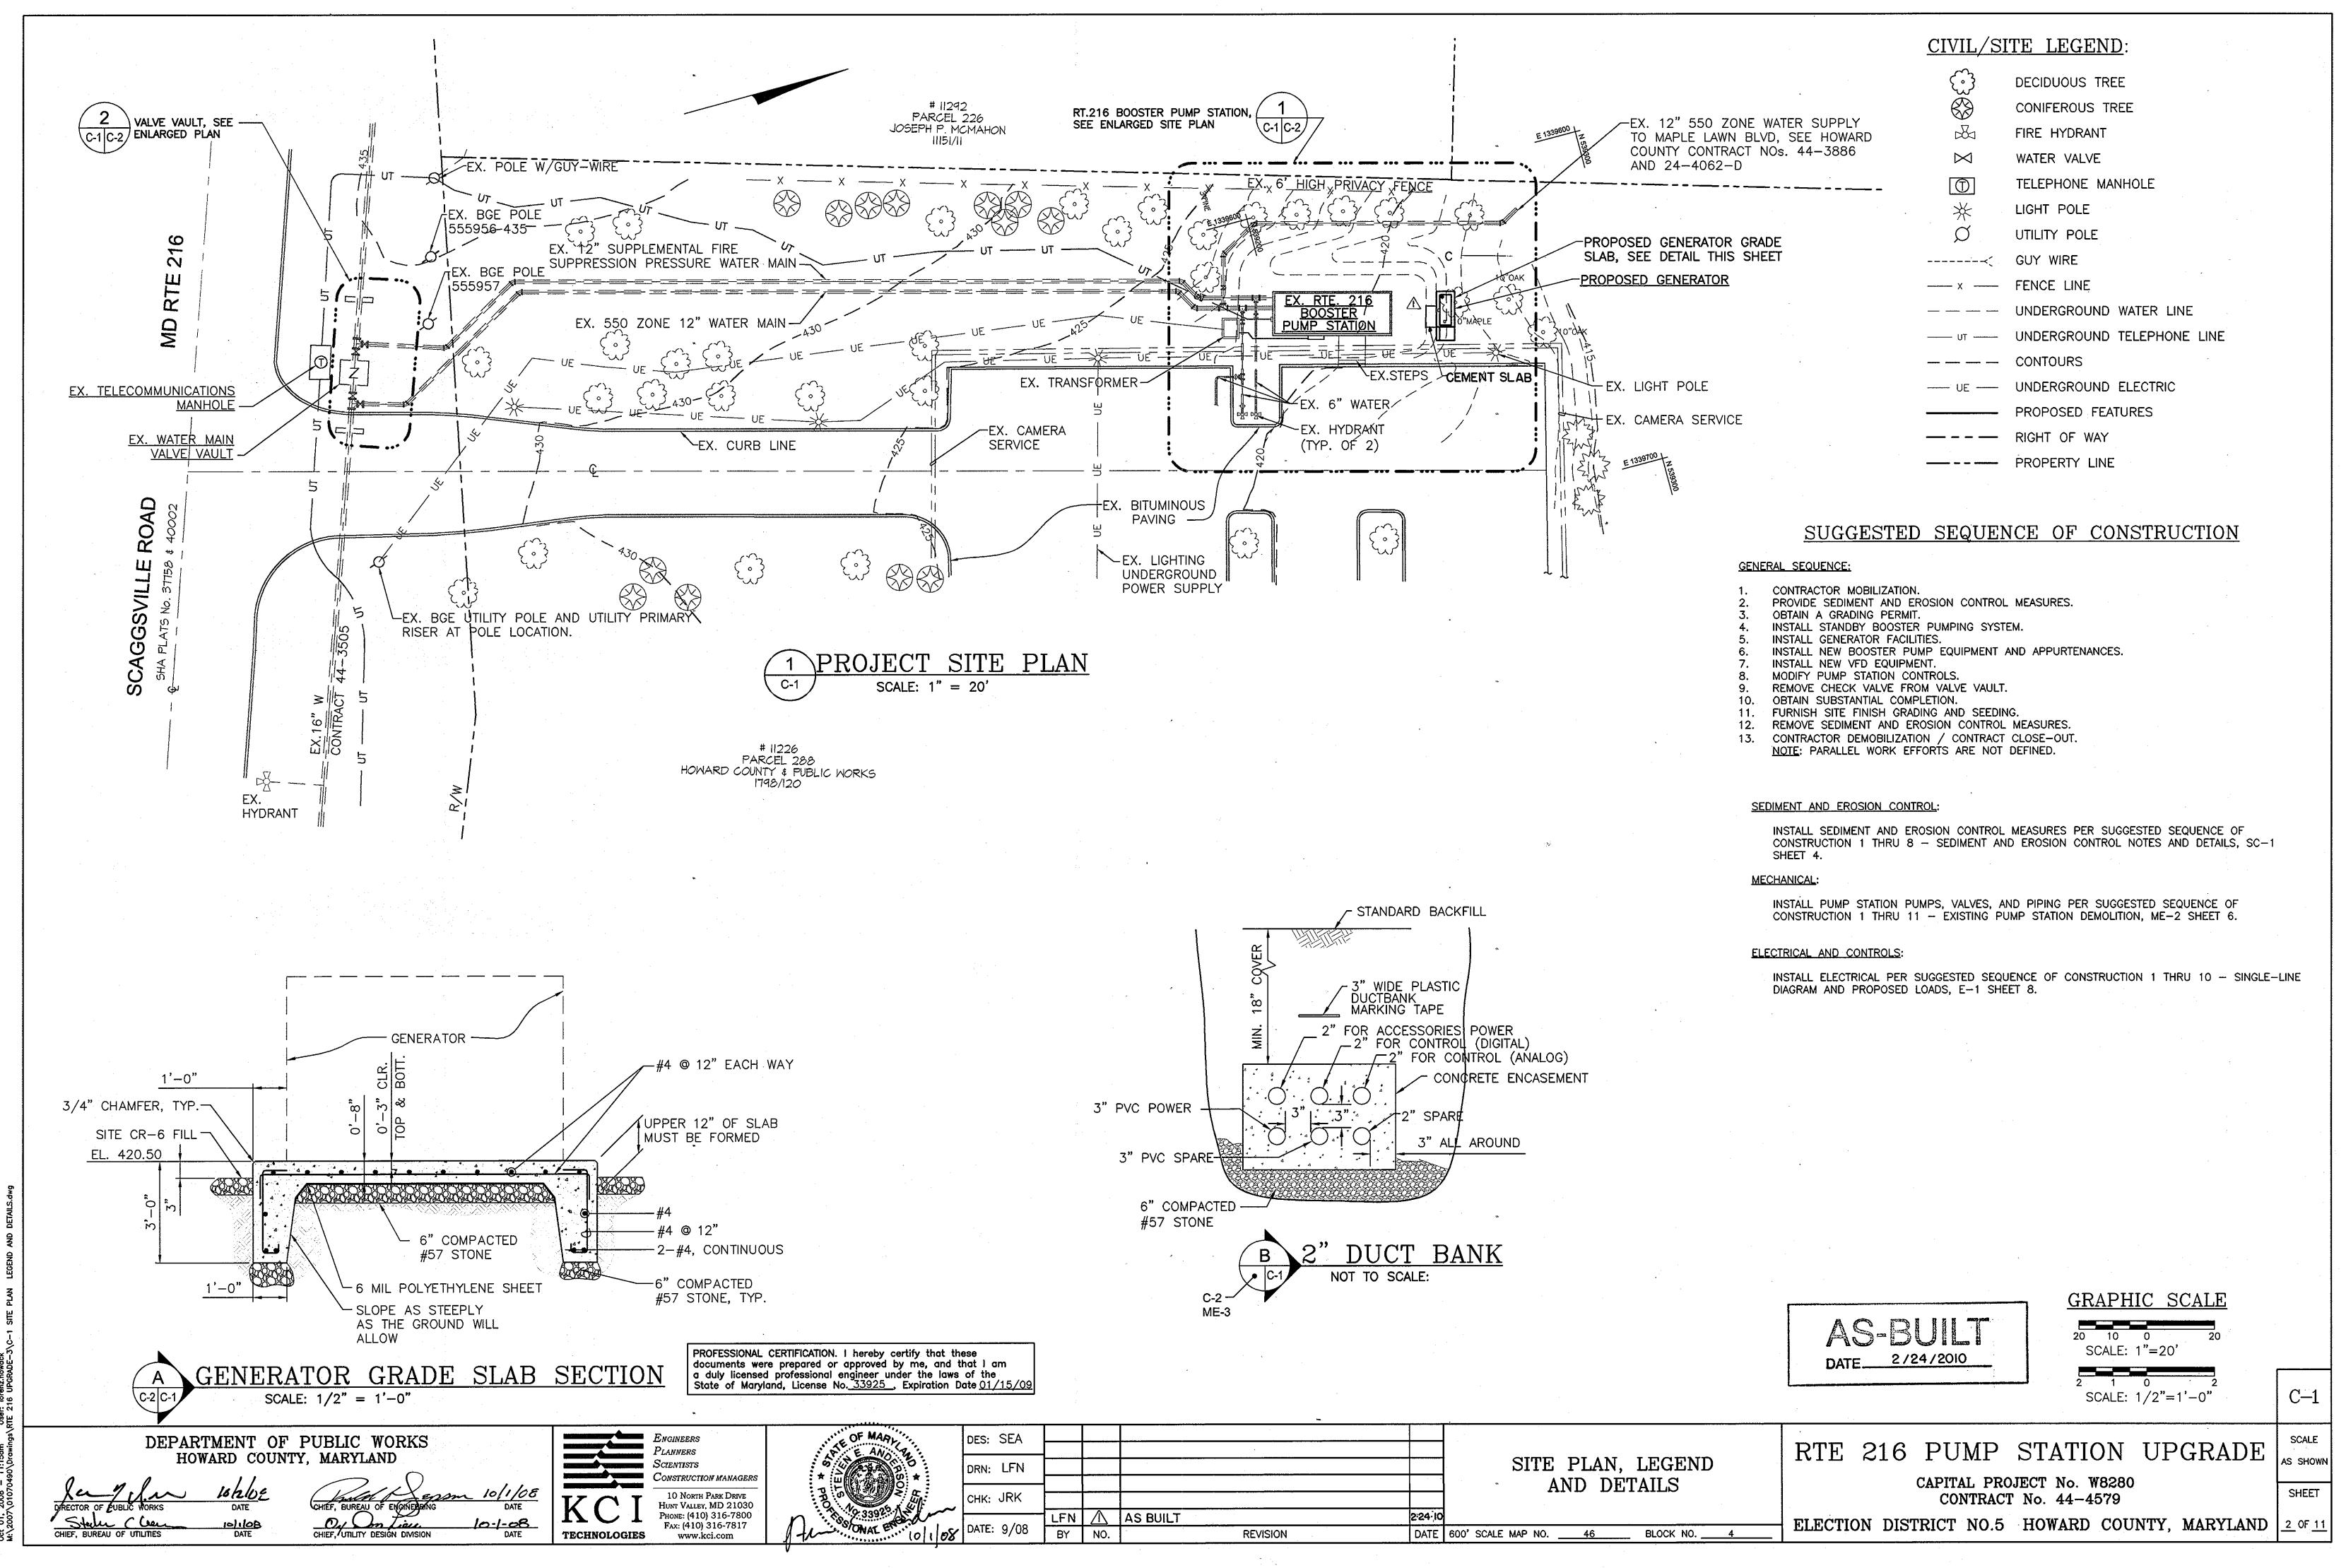

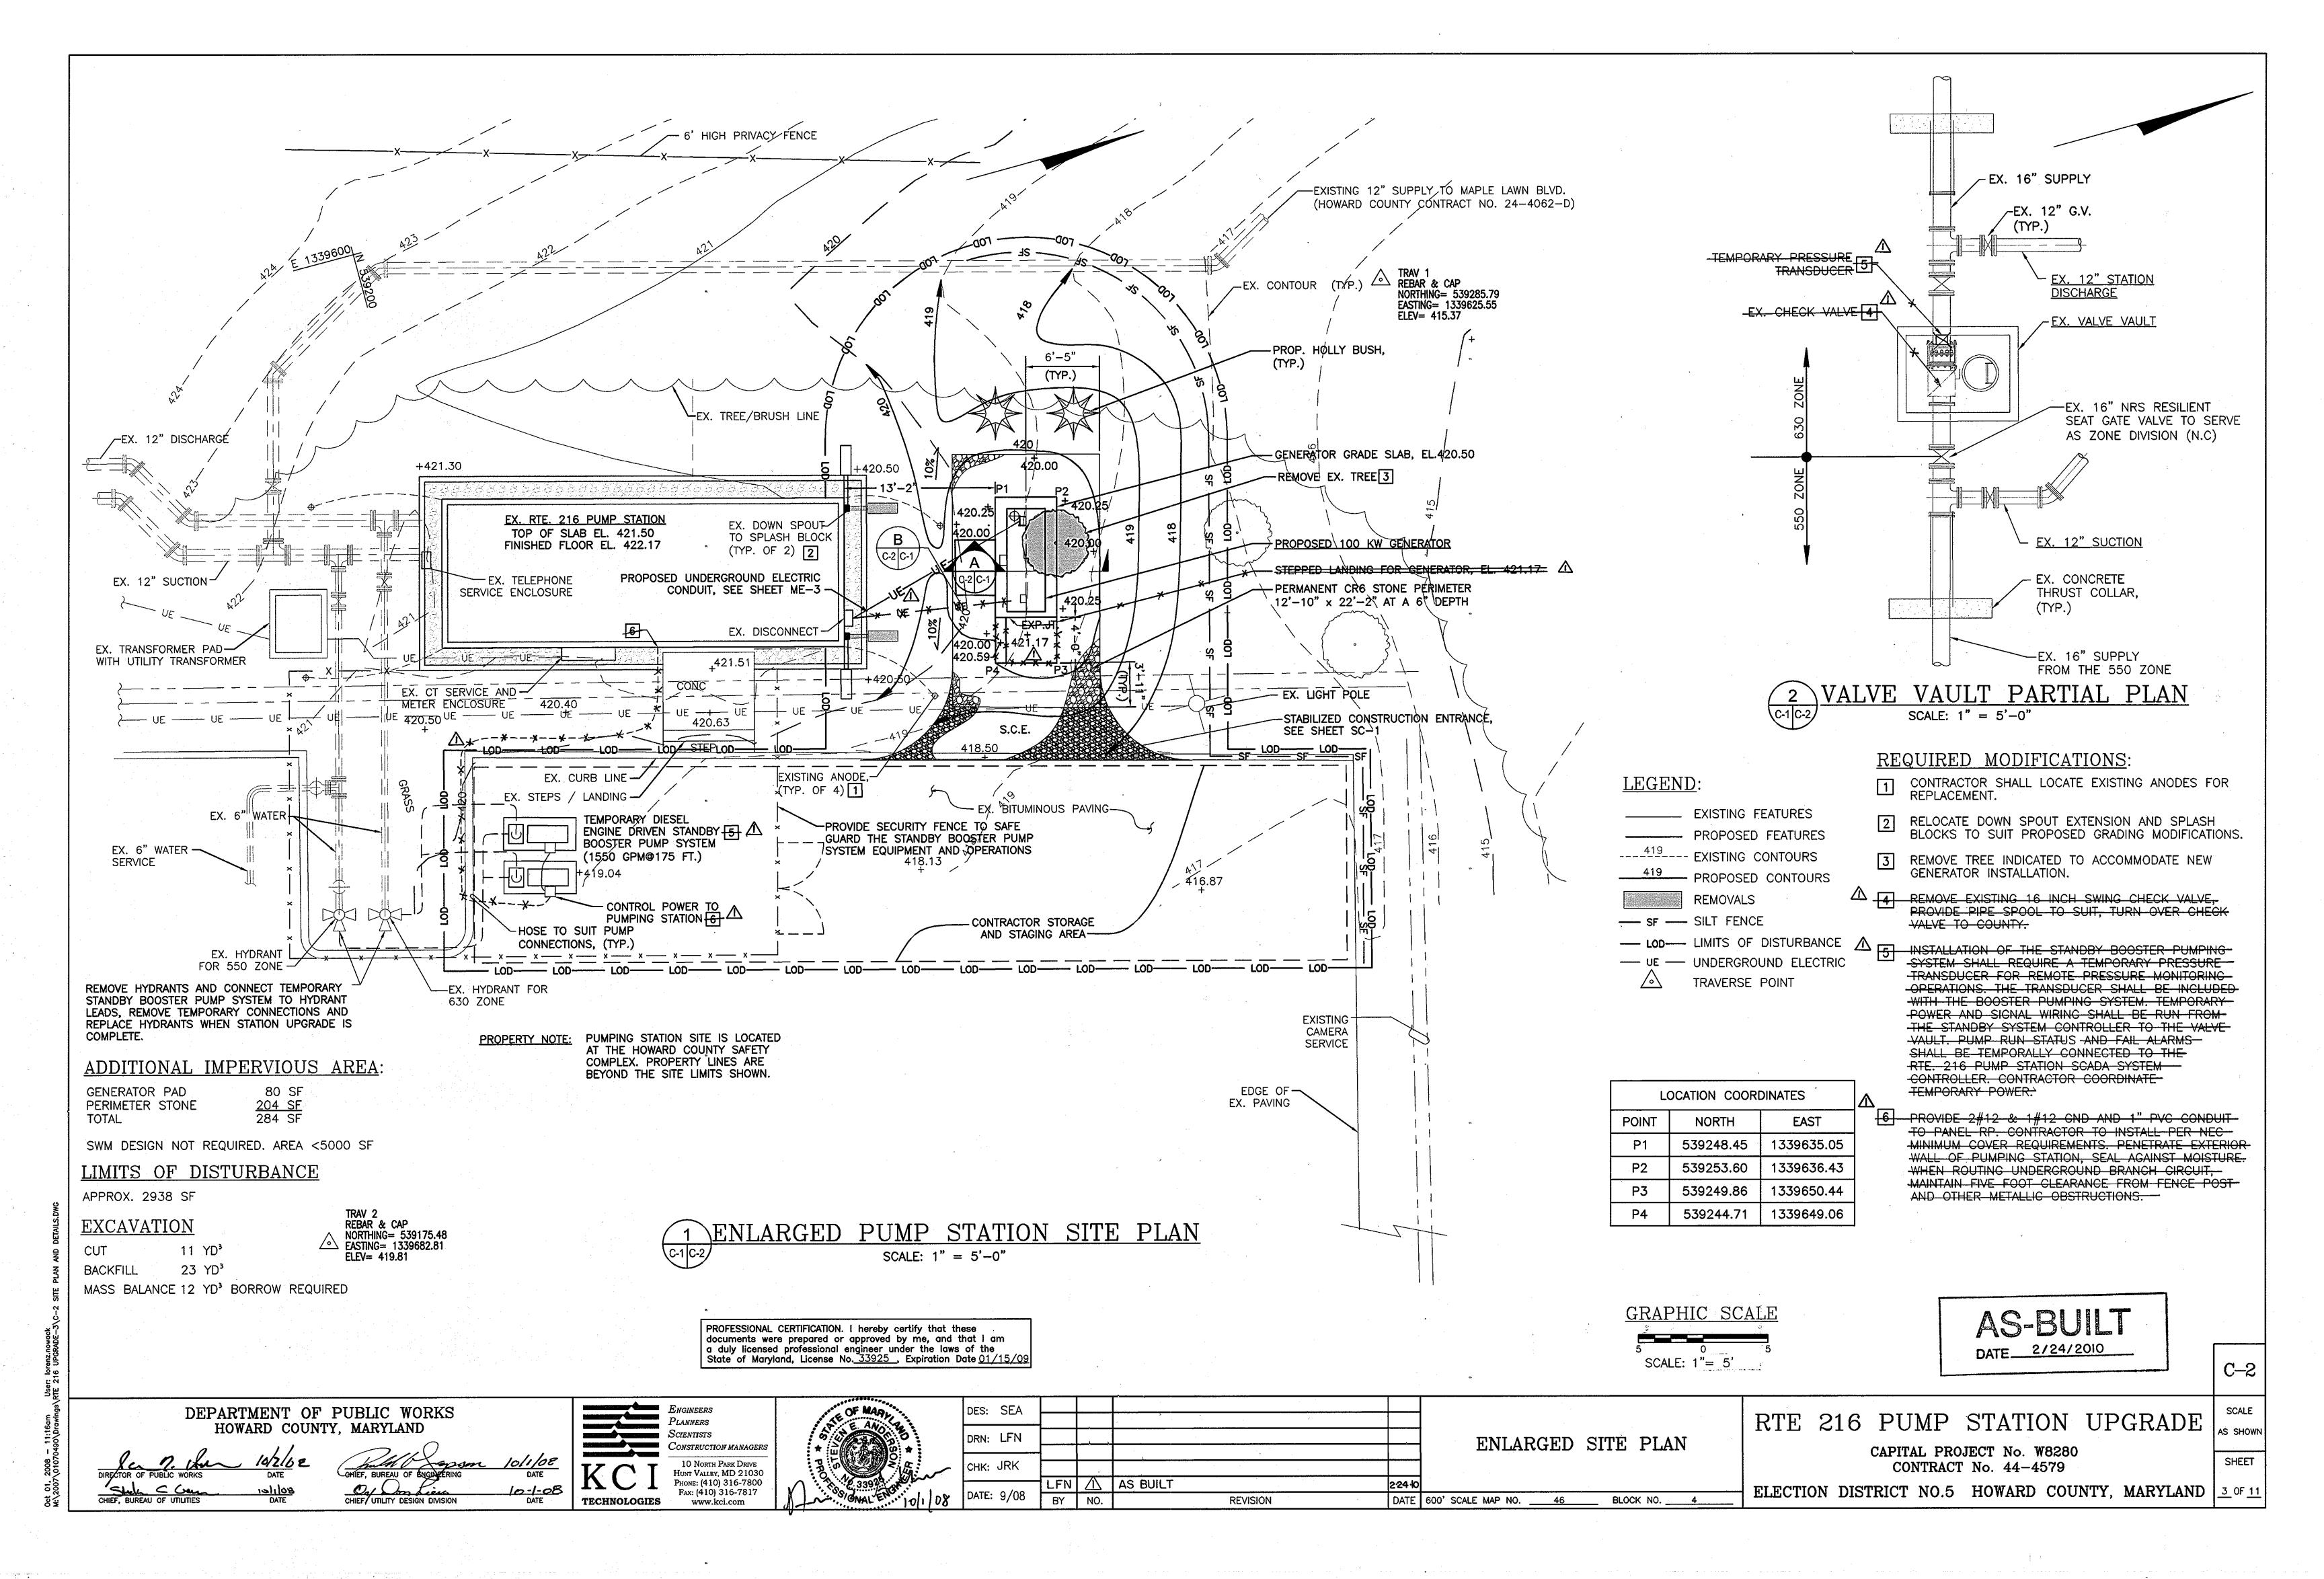

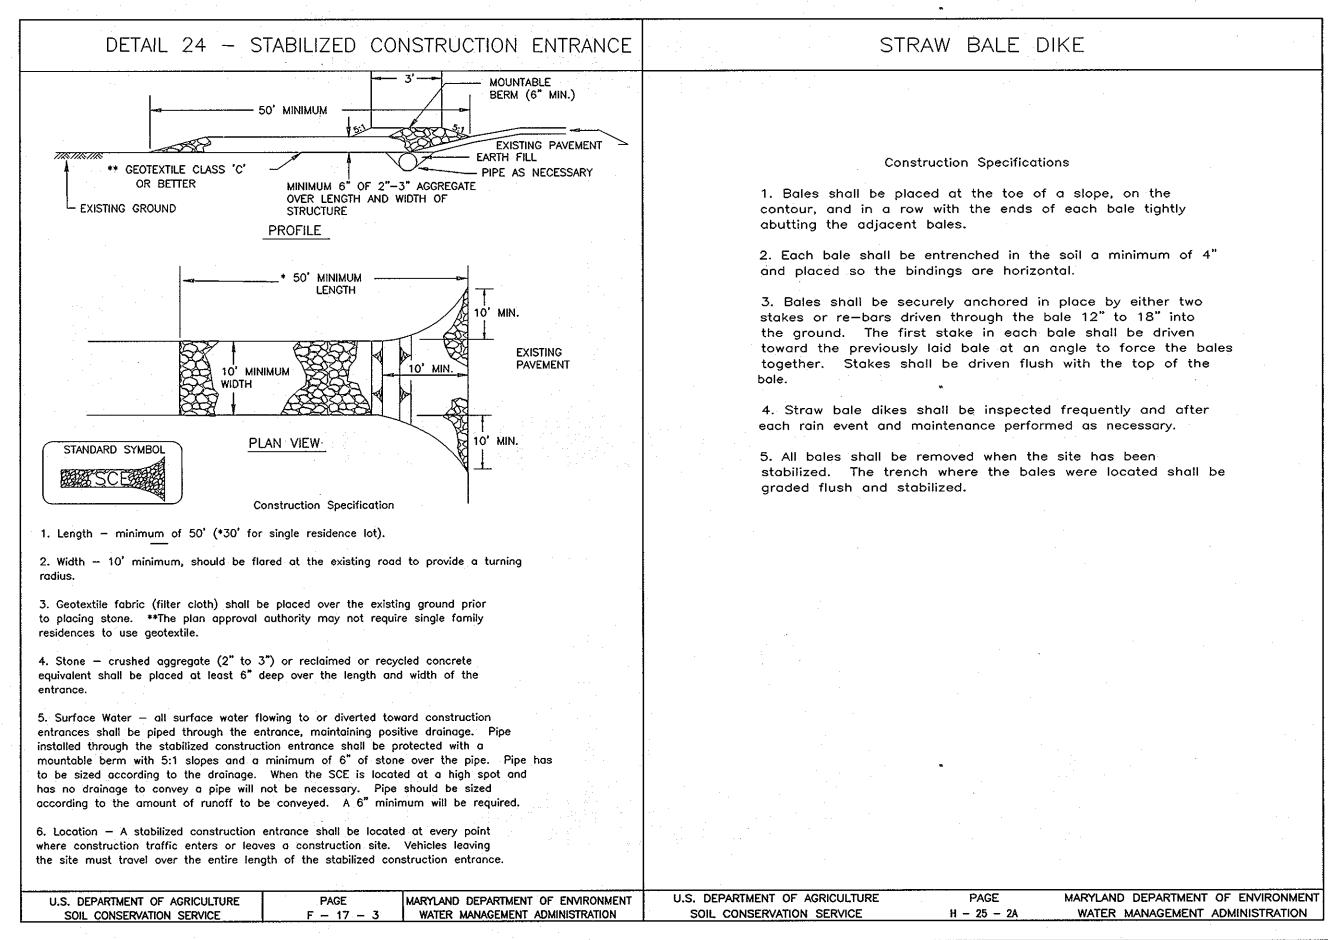

PROFESSIONAL CERTIFICATION. I hereby certify that these documents were prepared or approved by me, and that I am a duly licensed professional engineer under the laws of the State of Maryland, License No. 33925 , Expiration Date 01/15/09

#### STANDARD SEDIMENT CONTROL NOTES

- 1. A MINIMUM OF 48 HOURS NOTICE MUST BE GIVEN TO THE HOWARD COUNTY DEPARTMENT OF INSPECTIONS, LICENSES AND PERMITS, SEDIMENT CONTROL DIVISION PRIOR TO THE START OF ANY CONSTRUCTION, (313-1855).
- 2. ALL VEGETATIVE AND STRUCTURAL PRACTICES ARE TO BE INSTALLED ACCORDING TO THE PROVISIONS OF THIS PLAN AND ARE TO BE IN CONFORMANCE WITH THE MOST CURRENT "MARYLAND STANDARDS AND SPECIFICATIONS FOR SOIL EROSION AND SEDIMENT CONTROL", AND REVISIONS THERETO.
- 3. FOLLOWING INITIAL SOIL DISTURBANCE OR REDISTURBANCE, PERMANENT OR TEMPORARY STABILIZATION SHALL BE COMPLETED WITHIN:
- a) 7 CALENDAR DAYS FOR ALL PERIMETER SEDIMENT CONTROL STRUCTURES, DIKES, PERIMETER SLOPES AND ALL SLOPES GREATER THAN 3:1,
- b) 14 days as to all other disturbed or graded areas on the project site.
- 4. ALL SEDIMENT TRAPS/BASINS SHOWN MUST BE FENCED AND WARNING SIGNS POSTED AROUND THEIR PERIMETER IN ACCORDANCE WITH VOL. I, CHAPTER 12, OF THE HOWARD COUNTY DESIGN MANUAL, STORM DRAINAGE.
- 5. ALL DISTURBED AREAS MUST BE STABILIZED WITHIN THE TIME PERIOD SPECIFIED ABOVE IN ACCORDANCE WITH THE 1994 MARYLAND STANDARDS AND SPECIFICATIONS FOR SOIL EROSION AND SEDIMENT CONTROL (SEC. G20.0) FOR PERMANENT SEEDLINGS, SOD, TEMPORARY SEEDING AND MULCHING. TEMPORARY STABILIZATION WITH MULCH ALONE CAN ONLY BE DONE WHEN RECOMMENDED SEEDING DATES DO NOT ALLOW FOR PROPER GERMINATION AND ESTABLISHMENT OF GRASSES.
- 6. ALL SEDIMENT CONTROL STRUCTURES ARE TO REMAIN IN PLACE AND ARE TO BE MAINTAINED IN OPERATIVE CONDITION UNTIL PERMISSION FOR THEIR REMOVAL HAS BEEN OBTAINED FROM THE HOWARD COUNTY SEDIMENT CONTROL INSPECTOR.

7. SITE ANALYSIS: ACRES TOTAL AREA OF SITE 0.043 ACRES AREA DISTURBED \_\_\_\_\_O.007\_\_\_\_ ACRES AREA TO BE ROOFED OR PAVED <u>0.035</u> ACRES AREA TO BE VEGATATIVELY STABILIZED TOTAL CUT TOTAL FILL CU. YDS. OFFSITE WASTE/BORROW AREA LOCATION CONTRACTOR COORDINATE

- 8. ANY SEDIMENT CONTROL PRACTICE WHICH IS DISTURBED BY GRADING ACTIVITY FOR PLACEMENT OF UTILITIES MUST BE REPAIRED ON THE SAME DAY OF THE DISTURBANCE
- 9. ADDITIONAL SEDIMENT CONTROLS MUST BE PROVIDED, IF DEEMED NECESSARY BY THE HOWARD COUNTY SEDIMENT CONTROL INSPECTOR.
- 10. ON ALL SITES WITH DISTURBED AREAS IN EXCESS OF 2 ACRES, APPROVAL OF THE INSPECTION AGENCY SHALL BE REQUESTED UPON COMPLETION OF INSTALLATION OF PERIMETER EROSION AND SEDIMENT CONTROLS, BUT BEFORE PROCEEDING WITH ANY OTHER EARTH DISTURBANCE OR GRADING. OTHER BUILDING OR GRADING INSPECTION APPROVALS MAY NOT BE AUTHORIZED UNTIL THIS INITIAL APPROVAL BY THE INSPECTION AGENCY IS MADE.
- 11. TRENCHES FOR THE CONSTRUCTION OF UTILITIES IS LIMITED TO THREE (3) PIPE LENGTHS OR THAT WHICH CAN BE BACK FILLED AND STABILIZED WITHIN ONE WORKING DAY, WHICHEVER
- 12. CONTRACTOR SHALL PLACE EXCAVATED MATERIALS ON UPHILL SIDE OF TRENCH AND PLACE SILT

#### SUGGESTED SEQUENCE OF CONSTRUCTION

- 1. LAYOUT SITE ALIGNMENT (1 DAY).
- 2. INSTALL SEDIMENT CONTROL DEVICES AS SHOWN ON PLAN.
- OBTAIN A GRADING PERMIT.
- 4. EXCAVATE SITE FOR GENERATOR GRADE SLAB AND CONNECTION
- OF ELECTRICAL CONDUIT (1 DAY).
- 5. BACKFILL AROUND FOUNDATION AND DUCTBANK TRENCH AND
- STABILIZE (5 DAYS).
- 6. PERFORM FINAL GRADING, SEEDING AND LANDSCAPING
- (2-DAYS).
- 7. CLEAN UP CONSTRUCTION SITE, DEMOBILIZE (1-DAY).
- 8. REMOVE SEDIMENT CONTROL DEVICES AFTER PERMISSION IS GRANTED BY THE SEDIMENT CONTROL INSPECTOR (2 DAYS).

#### PERMANENT SEEDING NOTES

APPLY TO GRADED OR CLEARED AREAS NOT SUBJECT TO IMMEDIATE FURTHER DISTURBANCE WHERE A PERMANENT LONG-LIVED VEGETATIVE COVER IS NEEDED.

SEEDBED PREPARATION: LOOSEN UPPER THREE INCHES OF SOIL BY RAKING, DISKING OR OTHER ACCEPTABLE MEANS BEFORE SEEDING, IF NOT PREVIOUSLY LOOSENED.

SOIL AMENDMENTS: IN LIEU OF SOIL TEST RECOMMENDATIONS, USE ONE OF THE FOLLOWING SCHEDULES:

1)PREFERRED - APPLY 2 TONS PER ACRES DOLOMITIC LIMESTONE (92 LBS/1000 SQ FT.)
AND 600 LBS PER ACRE 10-10-10 FERTILIZER (14LBS/1000 SQ FT.) BEFORE SEEDING. HARROW OR DISK INTO UPPER THREE INCHES OF SOIL. AT TIME OF SEEDING, APPLY 400 LBS PER ACRE 30-0-0 UREAFORM FERTILIZER (9 LBS/1000 SQ FT.) 2)ACCEPTALBE - APPLY 2 TONS PER ACRE DOLOMITIC LIMESTONE (92 LBS/1000 SQ FT.) AND 1000 LBS PER ACRE 10-10-10 FERTILIZER (23 LBS/1000 SQ FT.) BEFORE SEEDING. HARROW OF DISK INTO UPPER THREE INCHES OF SOIL.

<u>SEEDING</u> - FOR THE PERIODS MARCH 1 THRU APRIL 30, AND AUGUST 1 THRU OCTOBER 15, SEED WITH 60 LBS PER ACRE (1.4 LBS/1000 SQ FT.) OF KENTUCKY 31 TALL FESCUE. FOR THE PERIOD MAY 1 THRU JULY 31, SEED WITH 60 LBS KENTUCKY 31 TALL FESCUE PER ACRE AND 2 LBS PER ACRE (.05 LBS/1000 SQ FT.) OF WEEPING LOVEGRASS. DURING THE PERIOD OF OCTOBER 16 THRU FEBRUARY 28, PROTECT SITE BY: OPTION ( 2 TONS PER ACRE OF WELL ANCHORED STRAW MULCH AND SEED AS SOON AS POSSIBLE IN THE SPRING. OPTION (2) USE SOD. OPTION (3) SEED WITH 60 LBS/ACRE KENTUCKY 31 TALL FESCUE AND MULCH WITH 2 TONS/ACRE WELL ANCHORED STRAW.

MULCHING - APPLY 1-1/2 TO 2 TONS PER ACRE (70 TO 90 LBS/1000 SQ FT.) OF UNROTTED SMALL GRAIN STRAW IMMEDIATELY AFTER SEEDING. ANCHOR MULCH IMMEDIATELY AFTER APPLICATION USING MULCH ANCHORING TOOL OR 218 GALLONS PER ACRE (5 GAL/1000 SQ FT.) OF EMULSIFIED ASPHALT ON FLAT AREAS. ON SLOPES 8 FEET OR HIGHER, USE 348 GALLONS PER ACRE (8 GAL/1000 SQ FT.) FOR ANCHORING.

MAINTENANCE - INSPECT ALL SEEDED AREAS AND MAKE NEEDED REPAIRS, REPLACEMENTS AND RESEEDINGS.

#### TEMPORARY SEEDING NOTES

APPLY TO GRADED OR CLEARED AREAS LIKELY TO BE REDISTURBED WHERE A SHORT-TERM VEGETATIVE COVER IS NEEDED.

SEEDBED PREPARATION: LOOSEN UPPER THREE INCHES OF SOIL BY RAKING, DISKING OR OTHER ACCEPTABLE MEANS BEFORE SEEDING, IF NOT PREVIOUSLY LOOSENED.

SOIL AMENDMENTS: - APPLY 600 LBS PER ACRE 10-10-10 FERTILIZER (14 LBS/1000 SQ FT.).

SEEDING: - FOR PERIODS MARCH 1 THRU APRIL 30 AND FROM AUGUST 15 THRU OCTOBER 15. SEED WITH 2-1/2 BUSHEL PER ACRE OF ANNUAL RYE (3.2 LBS/1000 SQ FT.). FOR THE PERIOD MAY 1 THRU AUGUST 14, SEED WITH 3 LBS PER ACRE OF WEEPING LOVEGRASS (.07 LBS/1000 SQ FT.). FOR THE PERIOD NOVEMBER 16 THRU FEBRUARY 28, PROTECT SITE BY APPLYING 2 TONS PER ACRE OF WELL ANCHORED STRAW MULCH AND SEED AS SOON AS POSSIBLE IN THE SPRING, OR USE SOD.

MULCHING: - APPLY 1-1/2 TO 2 TONS PER ACRE (70 TO 90 LBS/1000 SQ FT.) OF UNROTTED SMALL GRAIN STRAW IMMEDIATELY AFTER SEEDING. ANCHOR MULCH IMMEDIATELY AFTER APPLICATION USING MULCH ANCHORING TOOL OR 218 GAL PER ACRE (5 GAL/1000 SQ FT.) OF EMULSIFIED ASPHALT ON FLAT AREAS. ON SLOPES 8 FT OR HIGHER, USE 348 GAL PER ACRE (8 GAL/1000 SQ FT.) FOR ANCHORING.

REFER TO THE 1994 MARYLAND STANDARDS AND SPECIFICATIONS FOR SOIL EROSION AND SEDIMENT CONTROL FOR RATE AND METHODS NOT COVERED.

> THIS DEVELOPMENT PLAN IS APPROVED FOR THE SOIL EROSION AND SEDIMENT CONTROL

BY THE HOWARD SOIL CONSERVATION DISTRICT

HOWARD S.C.D.

ENGINEER'S CERTIFICATION I/WE CERTIFY THAT THIS PLAN FOR EROSION AND SEDIMENT CONTROL, REPRESENTS A PRACTICAL AND WORKABLE PLAN BASED ON MY PERSONAL KNOWLEDGE OF THE SITE CONDITIONS AND THAT IT WAS PREPARED IN ACCORDANCE WITH THE REQUIREMENTS OF THE HOWARD

SOIL PONSERVATION DISTRICT, Andr STÉVEN E. ANDERSON KCI TECHNOLOGIES, INC

10 NORTH PARK DRIVE HUNT VALLEY, MD 21030

DEVELOPER'S CERTIFICATION I/WE CERTIFY THAT DEVELOPMENT AND CONSTRUCTION WILL BE DONE ACCORDING TO THIS PLAN, AND THAT ANY RESPONSIBLE PERSONNEL INVOLVED IN THE CONSTRUCTION PROJECT WILL HAVE A CERTIFICATE OF ATTENDANCE AT A DEPARTMENT OF ENVIRONMENT APPROVED TRAINING PROGRAM FOR THE CONTROL OF SEDIMENT AND EROSION BEFORE BEGINNING THE PROJECT. I ALSO AUTHORIZE PERIODIC ON-SITE INSPECTION BY THE HOWARD SOIL CONSERVATION DISTRICT.

10/1/08

10/1/08

AS-BUILT DATE 2/24/2010

DEPARTMENT OF PUBLIC WORKS

HOWARD COUNTY, MARYLAND CHIEF, BUREAU OF ENGIN 10-1-08

LANNERS ONSTRUCTION MANAGERS 10 North Park Drive HUNT VALLEY, MD 21030 PHONE: (410) 316-7800 Fax: (410) 316-7817 TECHNOLOGIES www.kci.com



	DES: SEA				A Company of the Comp					
	DES. SEA	1.				-			S	$\mathbb{E}$
	DRN: LFN								ER	$\cap$
							}.	_		
	снк: JRK						]	-	NOTI	<b>T</b> S
	/	LFN		AS BUILT		 2.24.10				
80	DATE: 9/08	BY	NO.		REVISION	DATE	600'	SCALE	MAP NO.	_

SEDIMENT AND EROSION CONTROL NOTES AND DETAILS


BLOCK NO. \_

RTE 216 PUMP STATION UPGRADE


CAPITAL PROJECT No. W8280 CONTRACT No. 44-4579

ELECTION DISTRICT NO.5 HOWARD COUNTY, MARYLAND

SHEET

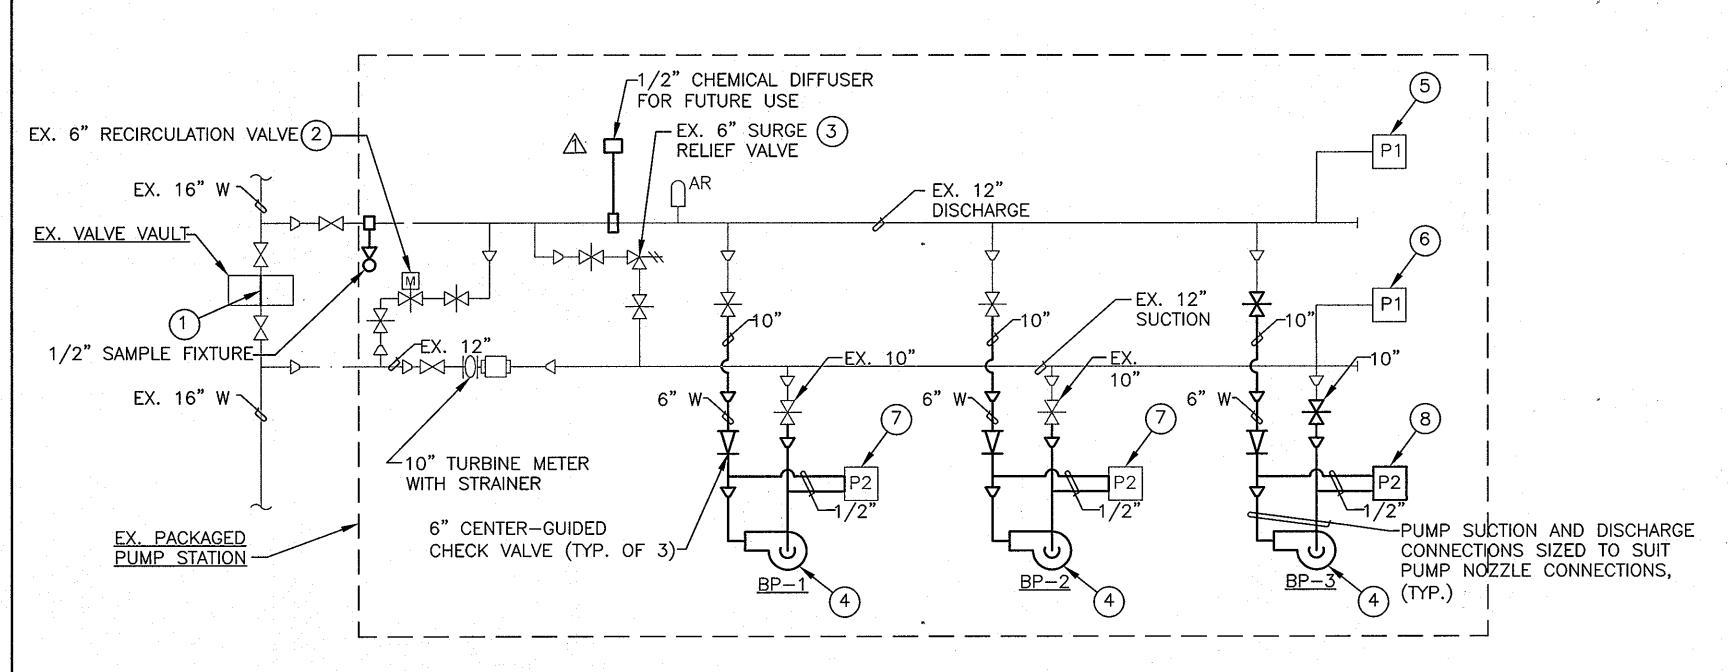

PUMP STATION SCHEMATIC

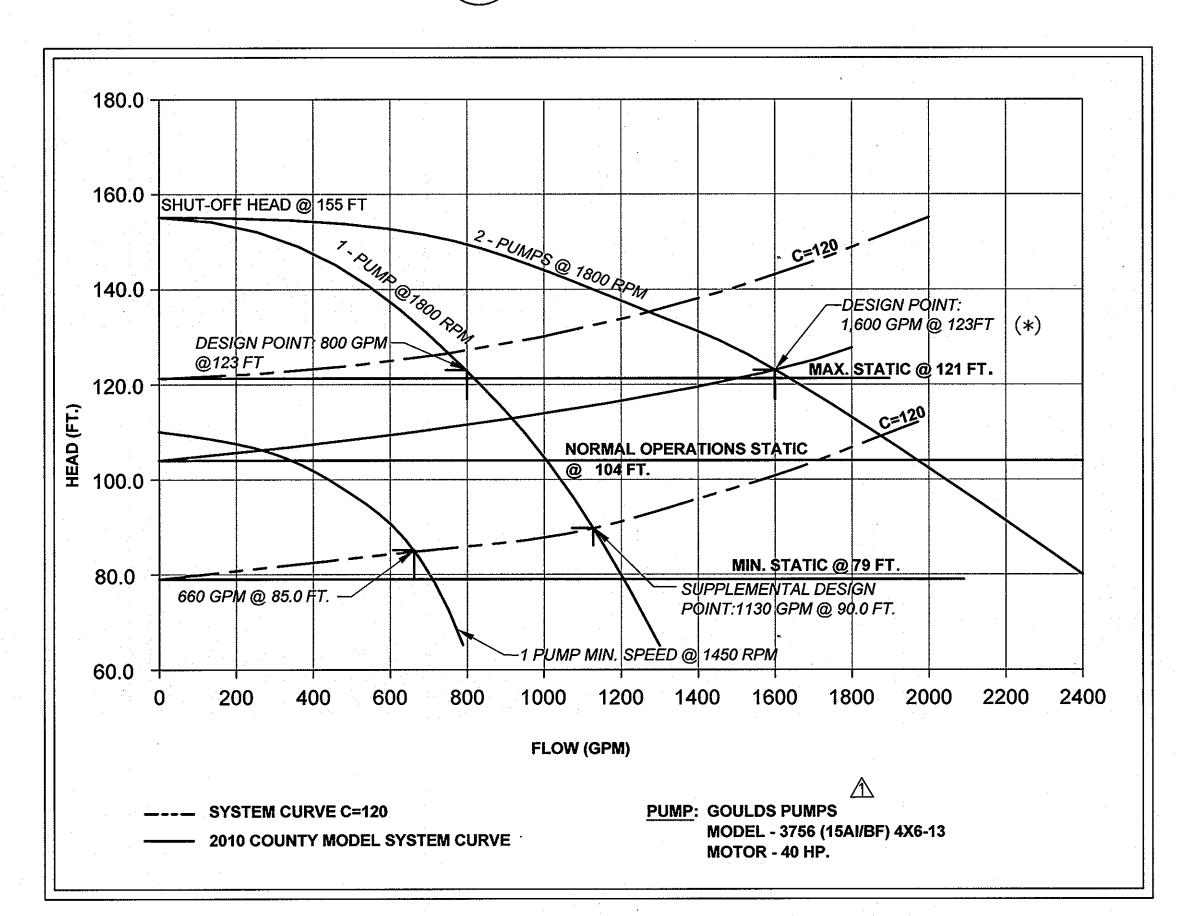

# 2 PUMP STATION SYSTEM CURVES

/(\*)CONDITIONS: MAXIMUM DAY DEMAND PLUS FIREFLOW, COUNTY MODEL SIMULATION. SCAGGSVILLE TANK AT 531, STATION SUCTION GRADIENT AT 516, AND FULTON TANK AT 620.

PROFESSIONAL CERTIFICATION. I hereby certify that these documents were prepared or approved by me, and that I am a duly licensed professional engineer under the laws of the State of Maryland, License No. 33925, Expiration Date 01/15/09

# ABBREVIATIONS:

### **EQUIPMENT / RATINGS**

- A AMP
- BOOSTER PUMP
- BUTTERFLY VALVE
- CURRENT TRANSFORMER
- DUCTILE IRON PIPE
- FEET
- FLAT ON TOP (EGC. REDUCER)
- GALLONS PER MINUTE
- GATE VALVE
- HEATING-VENTILATING AND AIR CONDITIONING
- JUNCTION BOX

HORSEPOWER

- MILLION GALLONS PER DAY
- POWER PANEL (480V)
- POUNDS PER SQUARE INCH
- RECEPTACLE PANEL (120V)
- REVOLUTIONS PER MINUTE
- SOLID STATE REDUCED VOLTAGE
- VICTAULIC FITTING
- XFMR POWER TRANSFORMER

#### **PANELS**

- CENTRAL CONTROL UNIT
- PUMP CONTROL PANEL
- VARIABLE FREQUENCY DRIVE

#### LEGEND:

- ----- EXISTING FEATURES
- G GROUNDING GRID
- REMOVALS/MODIFICATIONS

#### **CODED NOTES**:

- (1) REMOVE EXISTING 16" CHECK VALVE AS SHOWN ON PLAN
- (2) MODIFY RECIRCULATION VALVE PROGRAMMING AS DESCRIBED IN THE SPECIFICATIONS.
- (3) ADJUST RELIEF VALVE SET-POINT TO 105 PSIG.
- (4) INSTALL NEW 40 HP. BOOSTER PUMPS AS SHOWN ON DETAILED PLANS AND SECTIONS. MODIFY PUMP CONTROLS FOR TANK LEVEL MANAGEMENT AND MAINTAIN PRESSURE CONTROL SCENARIOS AS DESCRIBED IN THE SPECIFICATIONS.
- (5) INSTALL NEW 0-160 PSI DISCHARGE PRESSURE GAUGE, CALIBRATE TRANSDUCER SIGNAL TO CCU AND CHART-RECORDER.
- 6 INSTALL NEW 0-100 PSI SUCTION GAUGE, CALIBRATE TRANSDUCER SIGNAL TO CCU AND CHART-RECORDER.
- (7) INSTALL NEW SUCTION AND DISCHARGE PRESSURE GAUGES AT EXISTING PANELS AS FOLLOWS: 0-100 PSIG DISCHARGE: 0-160 PSIG
- (8) INSTALL NEW SUCTION AND DISCHARGE PRESSURE PANEL COMPLETE WITH GAUGES AS FOLLOWS: 0-100 PSIG SUCTION: DISCHARGE: 0-160 PSIG

### SYMBOLS:

- AIR RELEASE VALVE
- BUTTERFLY VALVE
- CENTER-GUIDED CHECK VALVE
- CENTRIFUGAL PUMP
- GATE VALVE
- GROUNDING ROD/GRID
- MOTORIZED BUTTERFLY VALVE
- PRESSURE PANEL (BOOSTER PUMP)
- P1 PRESSURE PANEL (WATER MAIN)
- SURGE RELIEF VALVE
- TURBINE METER WITH STRAINER

PUMPING EQUIPMENT

# PUMP STATION DESIGN CRITERIA

 SCAGGSVILLE ELEVATED TANK  FULL LEVEL EL.  LOW LEVEL EL.	
FULTON ELEVATED TANK  FULL LEVEL EL.  LOW LEVEL EL.	
RTE 216 SUCTION GRADIENT  MAX LEVEL EL.  MIN LEVEL EL.	535 509
STATIC HEAD CONDITIONS  MAXIMUM STATIC HEAD (630-509) -121  MINIMUM STATIC HEAD (614-535) - 79	
•	OO GPM

COLOCO WILE FLE WITED TANK

<u>OPERATIONS</u>	
FIRE STORAGE	250,000 GALS.
4 HR. RECOVERY	1,042 GPM
MODELED RATE	1,600 GPM
SINGLE PUMP FLOW	800 GPM ·
PUMP QUANTITY	THREE (3)
	2 - DUTY
	1 - STANDBY
CONTROL	VARIABLE SPEED
SCENARIO - 1	TANK LEVEL
	(CONSTANT SPEED)
SCENARIO - 2	MAINTAIN PRESSURE
	(VARIABLE SPEED)
MAX PRESSURE	60 PSI @ EL. 475
MIN PRESSURE	50 PSI @ EL. 475
MAX GRADIENT	EL. 614
MIN GRADIENT	EL. 591
STATION FLOOR	EL. 422
START PRESSURE	73 PSI.
MAINTAIN PRESSURE	-83 PSI.
MAX PRESSURE	100 PSI

TYPE - - - - - - CENTRIFUGAL END-SUCTION CAPACITY - - - - - - 800 GPM @ 123 FT. SPEED - - - - - - - 1,800 RPM (MAX.) MOTOR - - - - - - - 40 HP (MAX.) - - GOULDS PUMPS A MODEL 3756 (15AI/BF) 4X6-13 OPERATIONS - - - - - VARIABLE SPEED VFD — CONTROLLED PRESSURE GAUGES SUCTION - - - - - 0 - 100 PSI. DISCHARGE - - - - 0 - 160 PSI. PRESSURE RELIEF TYPE - - - - - - SURGE RELIEF (ANGLE STYLE) CONTROL - - - - - HYDRAULIC PILOT SETTING - - - - 105 PSI.

# AS BUILT REPLACEMENT SHEET

DATE: 2-34-2010

RTE 216 PUMP STATION UPGRADE

CAPITAL PROJECT No. W8280 CONTRACT No. 44-4579

ELECTION DISTRICT NO.5 HOWARD COUNTY, MARYLAND 5 of 11

DEPARTMENT OF PUBLIC WORKS HOWARD COUNTY, MARYLAND



Construction managers HUNT VALLEY, MD 21030 PHONE: (410) 316-7800 Fax: (410) 316-7817

www.kci.com



DES: SEA DRN: LFN 1 2010 DATE: 9/08


LFN AS BUILT NO. REVISION

DATE 600' SCALE MAP NO. \_\_\_\_\_46 \_\_\_\_ BLOCK NO. \_\_\_\_4


PUMP STATION SCHEMATIC,


SYSTEM CURVES AND DESIGN

CRITERIA

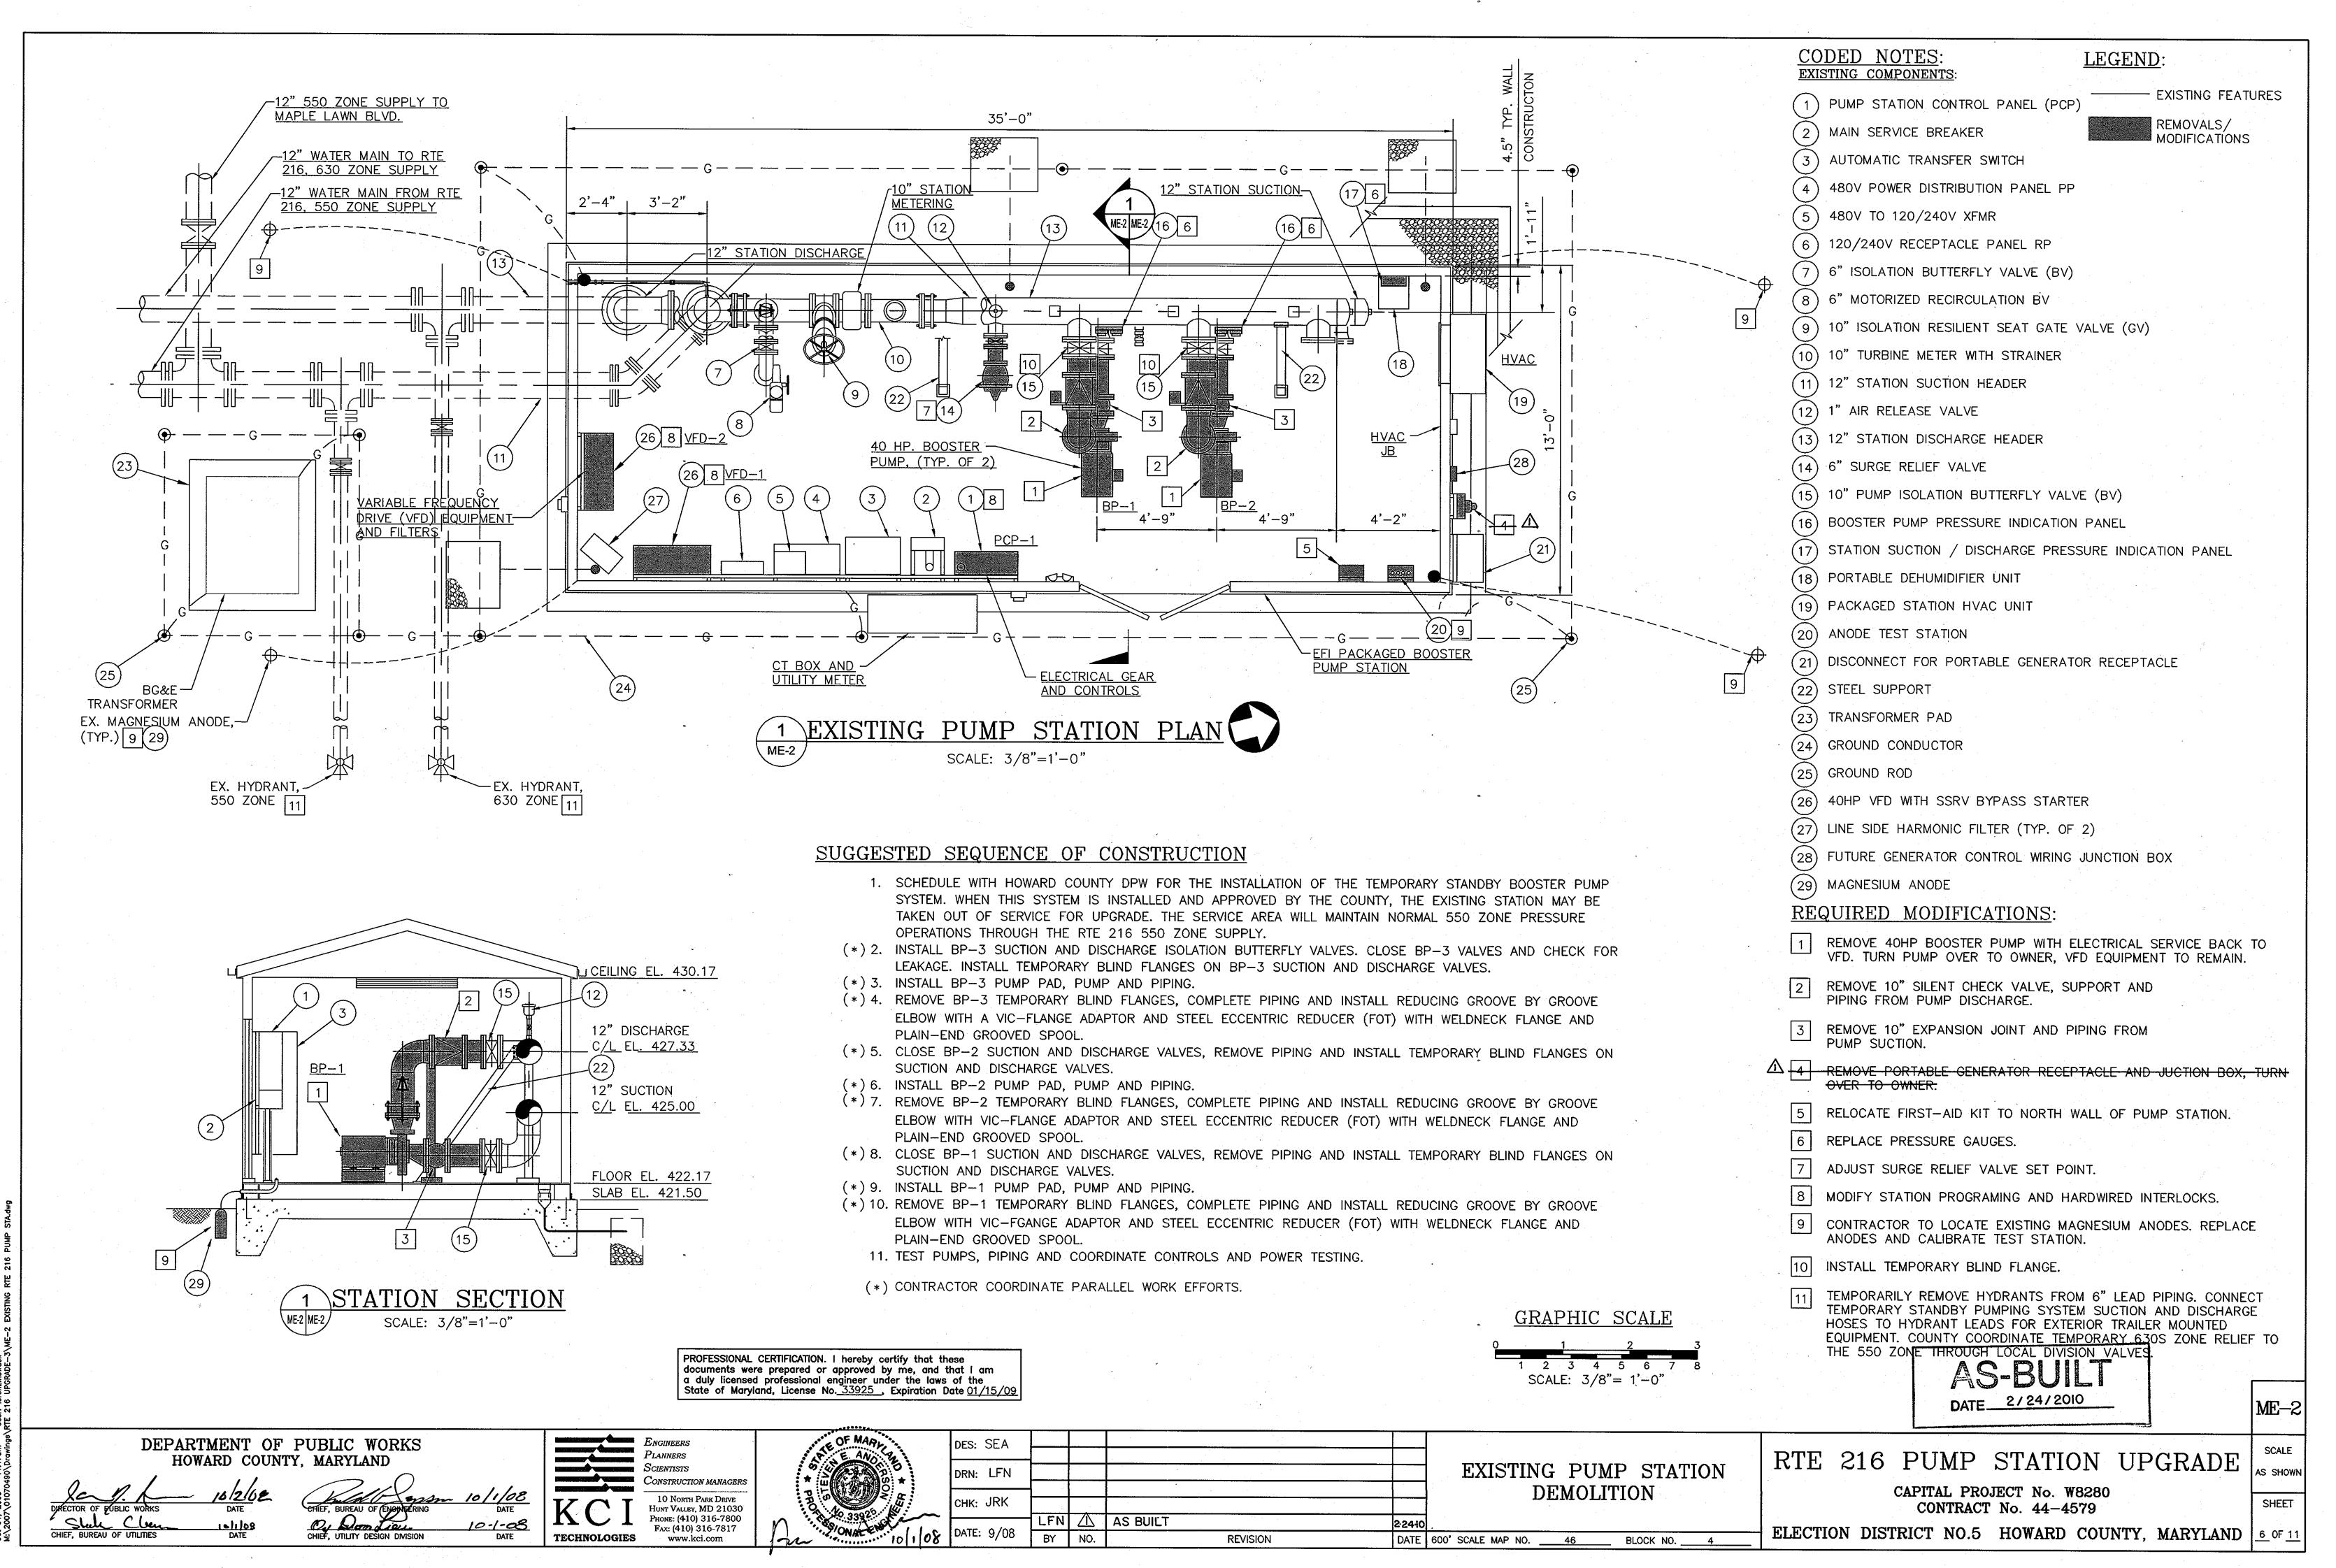

Oct 01 2008 -- 11:17cm Bear lorenz nowach

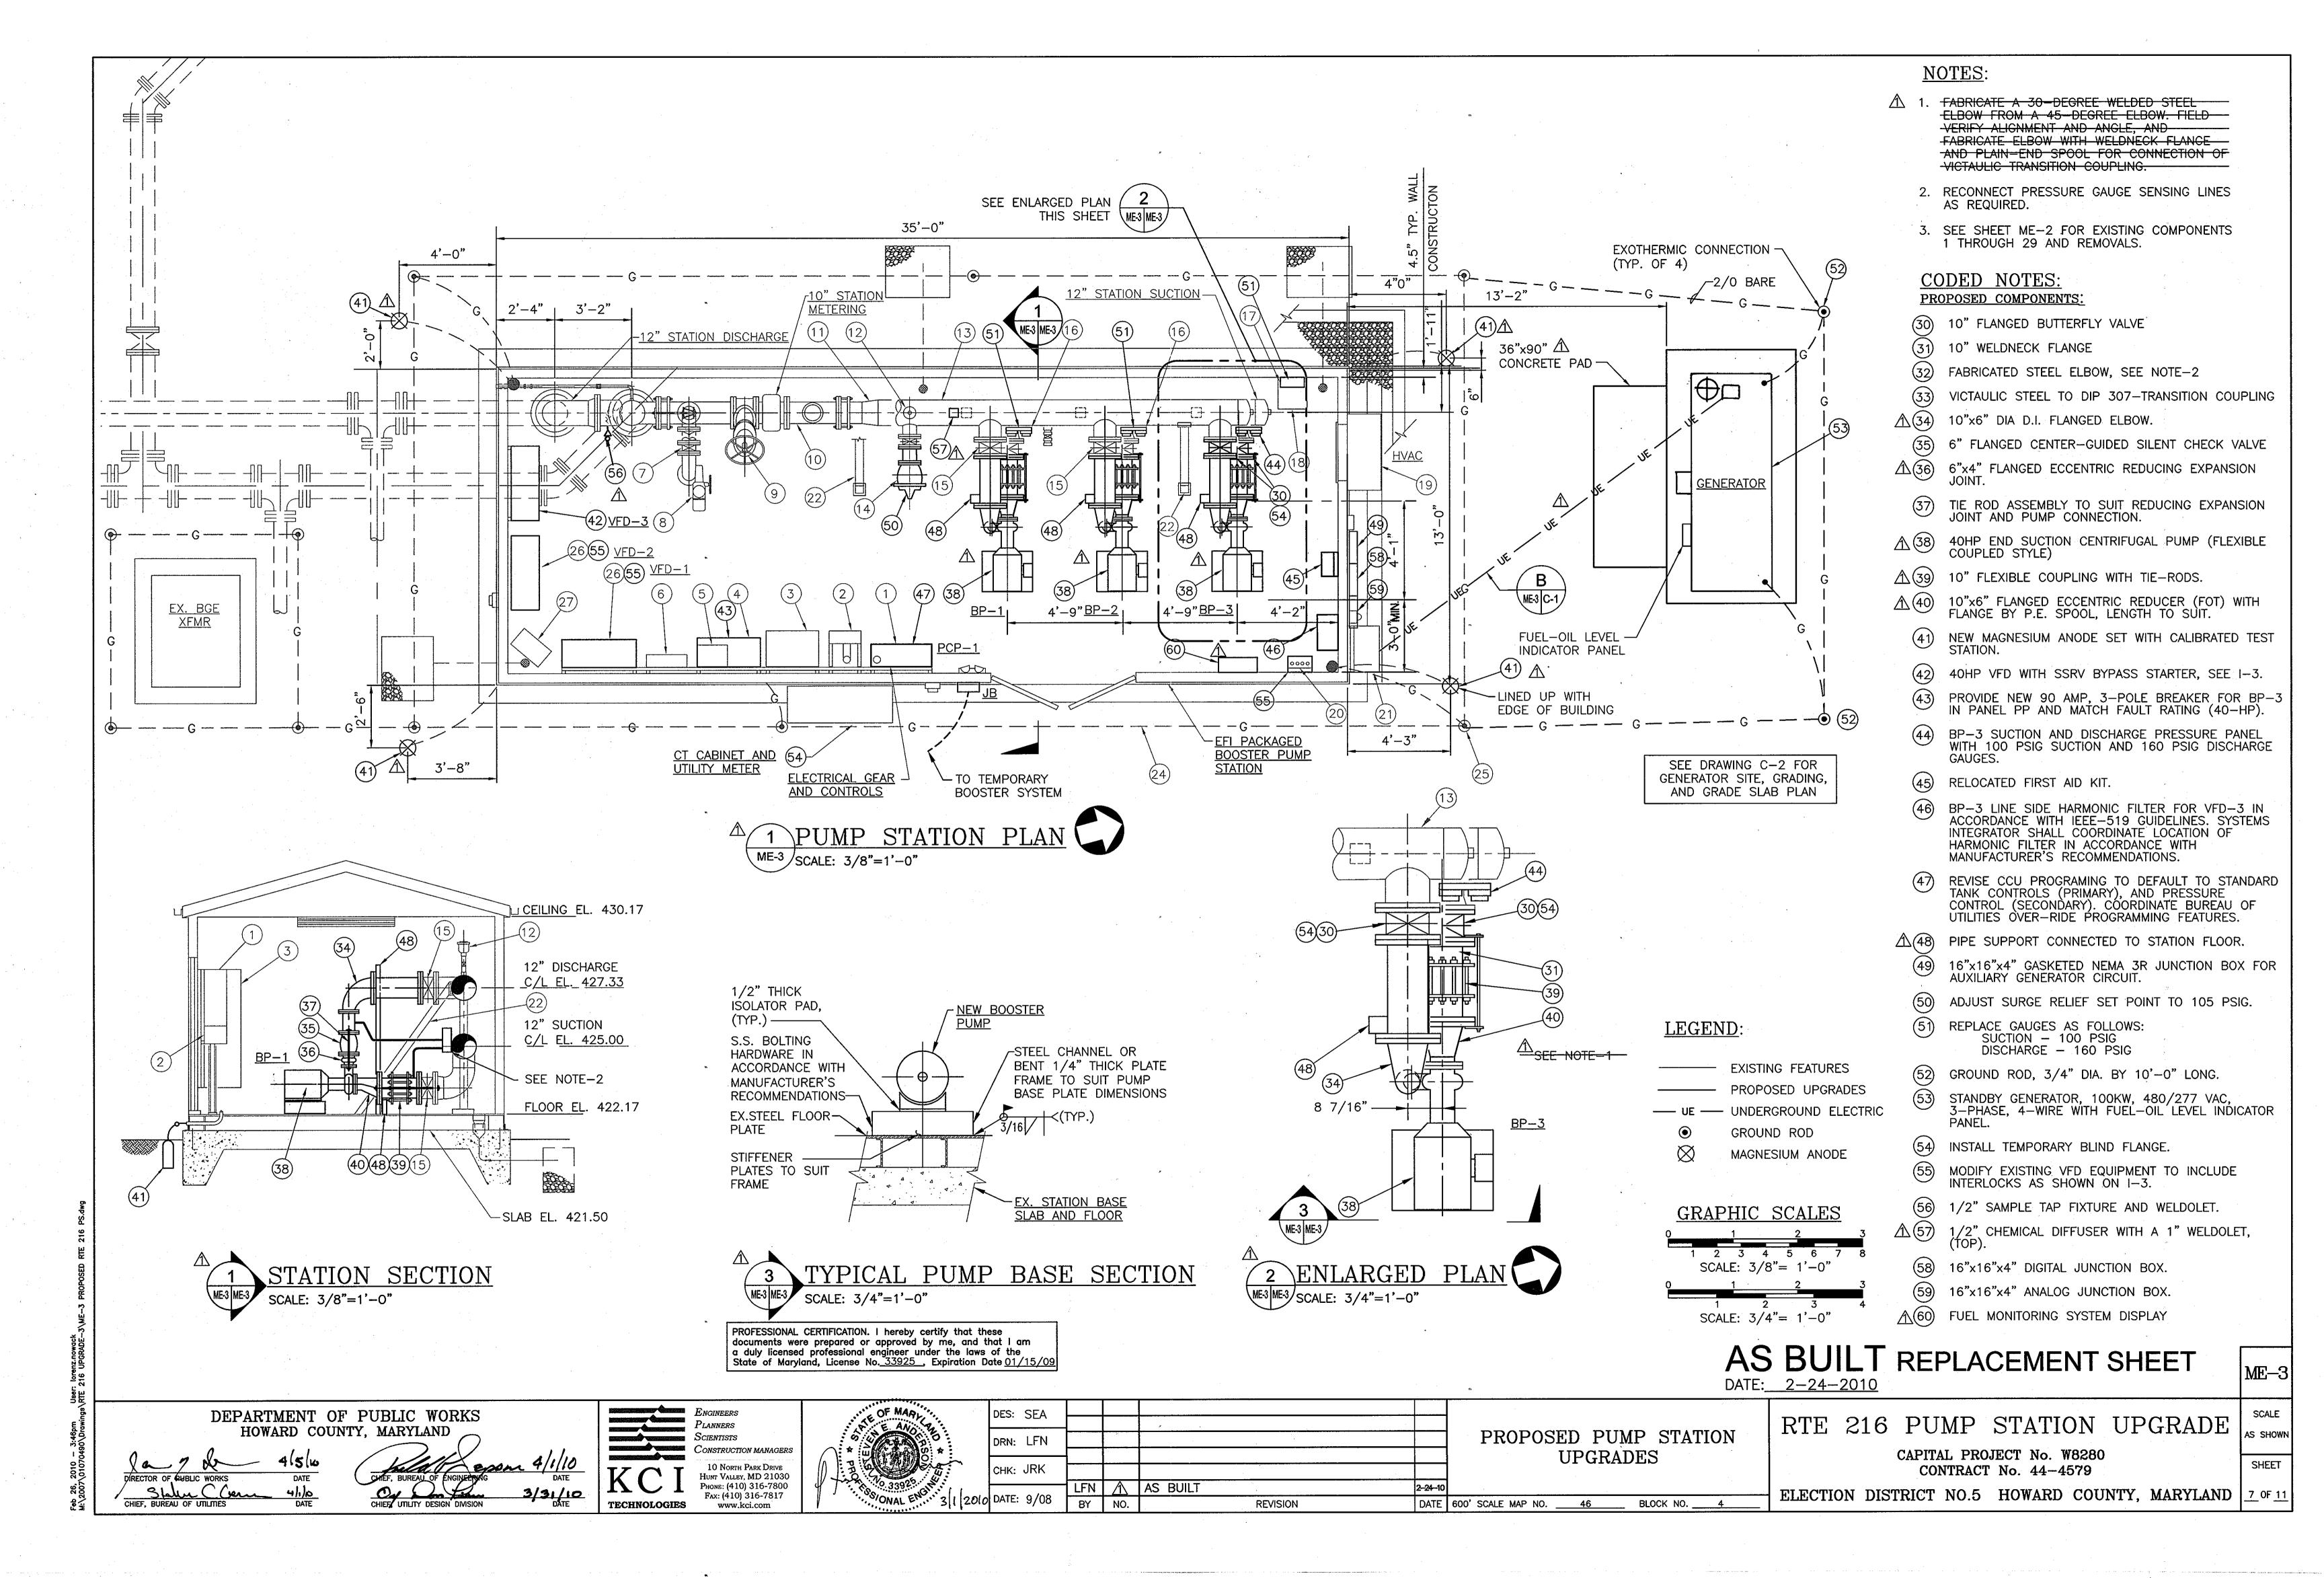

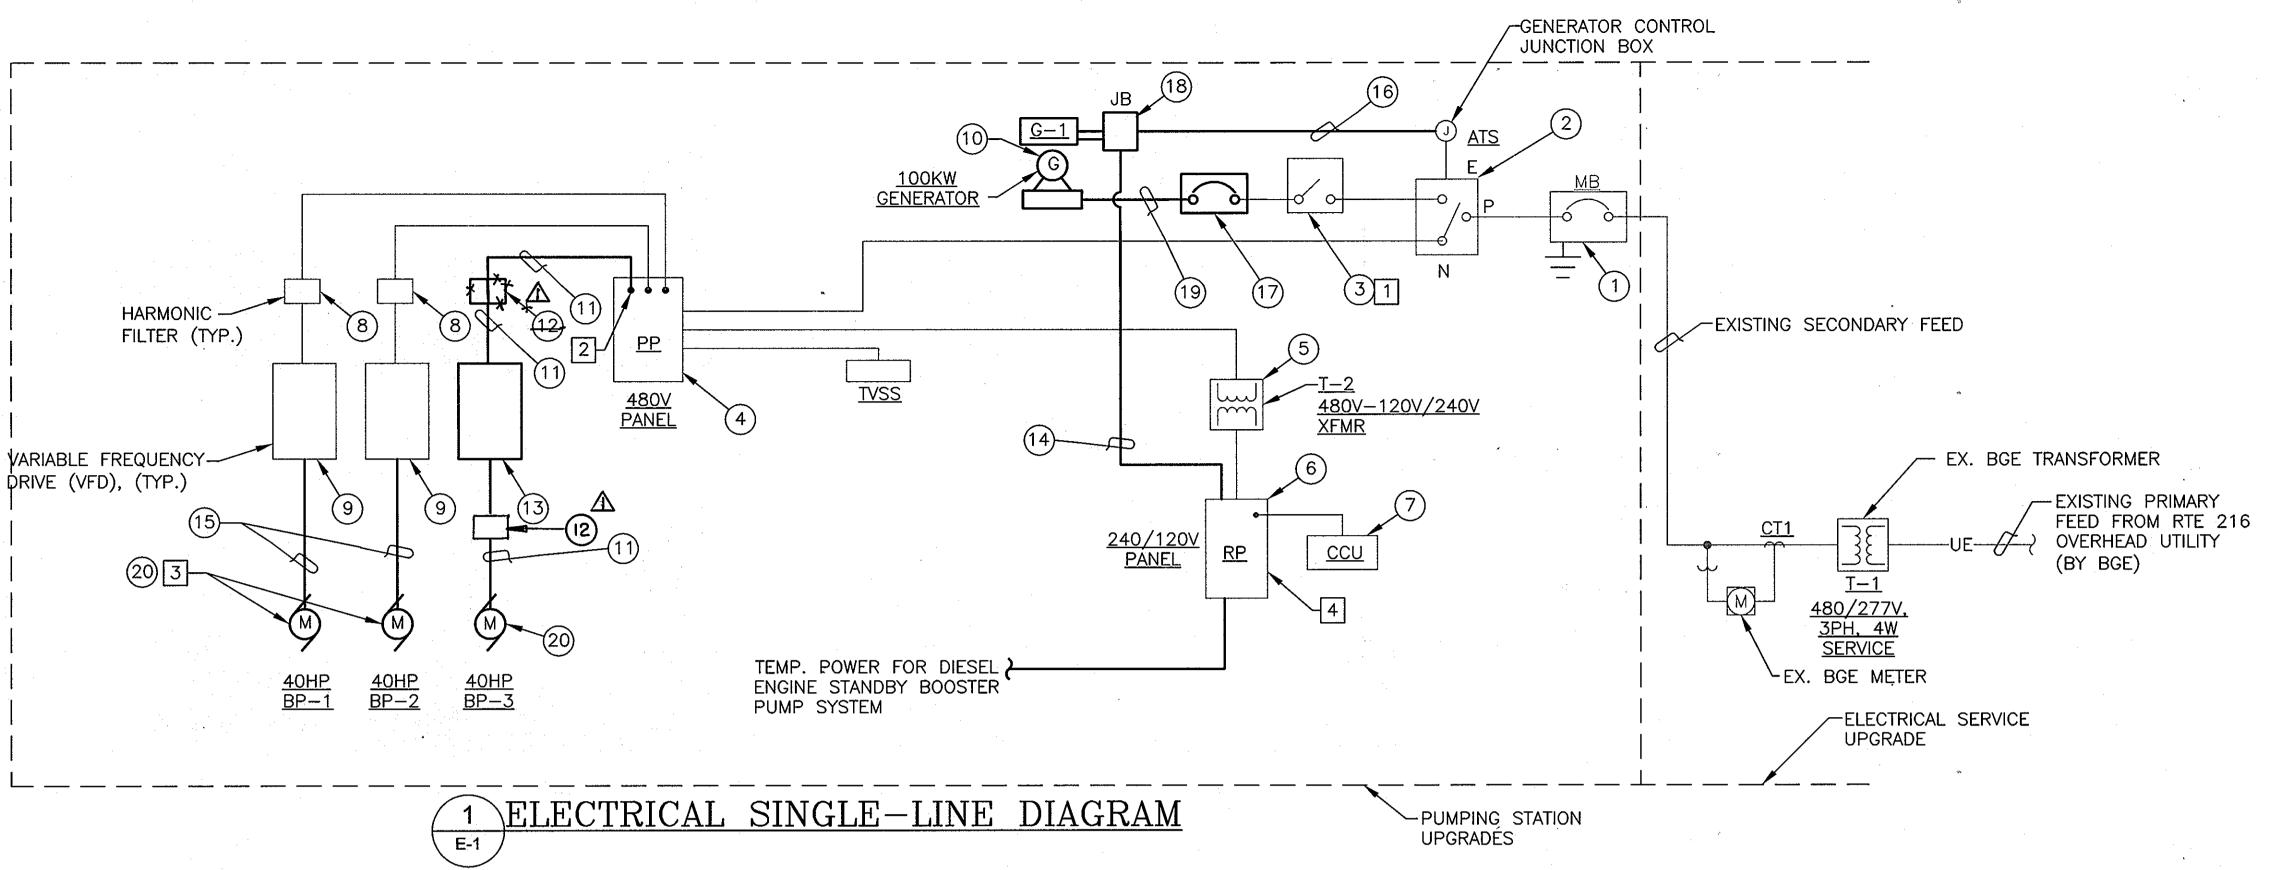

# PROPOSED AND EXISTING ELECTRICAL LOADS

	The second secon						
<u>DESCRIPTION</u>	<u>VOLTS</u>	<u>PHASE</u>	<u>AMP</u>	<u>KW</u>	<u>HP</u>	<u>KVA</u>	<u>TOTAL</u>
BP−1 <b>3</b>	480	3	52	30	40	43.23	: <del>-</del>
BP-2 3	480	3	52	30	40	43.23	<del>_</del>
BP-3 3	480	3	52	30	40	43.23	· —
HVAC	480	3	7.22	6	· · · ·	9.02	· -
RV-1	480	3	0.29	0.25	0.33	0.42	<del>_</del>
TOTAL 480V LOAD	_	<del></del>		_	_		139.13
LIGHTS	120	1	8.33	1	_	1.11	_
EXT. LIGHTS	120	1	2.50	0.30	<u></u>	0.33	<u>.</u>
CCU	120	1 .	2.08	0.25		0.28	
FLOW METER	120	1	0.42	0.05		0.06	· <u> </u>
PRESSURE TRANSMITTER	120	1	0.82	0.10		0.12	· <u>-</u>
CHART RECORDER	120	1	0.83	0.10		0.11	
DEHUMIDIFIER	120	1	2.08	0.25	0.33	0.41	-
GENERATOR HEATER	120	1	12	1.44	<u></u>	1.44	
GENERATOR BATTERY CHARGER	120	1	12	1.44	<del>-</del>	1.44	: - -
TOTAL 120V LOAD	****	<del></del>	_	<del>-</del>	_		5.3
CONNECTED LOAD		. —		_	_	_	144.43
OPERATING LOAD		_	-	_			101.2
TEMP. BOOSTER PUMP SYSTEM	120	1	. 10	1.2	. —	_	1.2

# NOTE: (1) 120V, 1PH, LOADS HAVE BEEN PHASE BALANCED.

(2) MAX DEMAND IS BASED ON RUNNING TWO PUMPS SIMULTANEOUSLY PLUS OTHER MISC. LOADS.

CHIÉF, UTILITY DESIGN DIVISION

3 PROPOSED LOADS.

# SUGGESTED SEQUENCE OF CONSTRUCTION

#### **ELECTRICAL AND CONTROLS:**

- INSTALL GENERATOR PAD, EQUIPMENT AND CONTROLS.
- TEST GENERATOR AND SETUP GENERATOR EXERCISE MODE IN ACCORDANCE WITH COUNTY DPW OPERATIONS. GENERATOR SHALL BE TESTED AND APPROVED.
- (\*) 3. INSTALL BP-3 VFD AND HARMONIC FILTER, ELECTRICAL TERMINATIONS, BREAKER AND PRESSURE INDICATION PANEL WITH STATION SUCTION AND DISCHARGE GAUGE UPGRADES
- (\*) 4. TEST BP-3 PUMP ROTATION AND ELECTRICAL SERVICE CONNECTIONS. (\*) 5. INSTALL BP-2 ELECTRICAL CONNECTIONS. TEST PUMP ROTATION AND ELECTRICAL SERVICE CONNECTIONS.
- (\*) 6. INSTALL BP-1 ELECTRICAL CONNECTIONS. TEST PUMP ROTATION AND ELECTRICAL SERVICE CONNECTIONS.
- 7. ADJUST THE STATION PRESSURE RELIEF VALVE SETTING IN ACCORDANCE WITH CONTRACT DRAWINGS. ALL SETTINGS AND ADJUSTMENTS MUST BE PERFORMED BY A FACTORY TRAINED REPRESENTATIVE CERTIFIED TO WORK ON THE VALVE.
- 8. MODIFY CONTROLS TO SUIT THE ADDITION OF BP-3 WITHIN LEAD/LAG ALTERNATIONS AND CONSTANT AND VARIABLE SPEED OPERATIONS.
- 9. MODIFY CONTROLS TO INCLUDE BOTH PRESSURE AND TANK CONTROL MODES ACCORDANCE WITH CONTRACT SPECIFICATIONS. TEST PUMPING STATION PUMP OPERATIONS.
- 10. COORDINATE REMOVAL OF CHECK VALVE FROM THE 16-INCH WATER MAIN VALVE VAULT WITH THE COUNTY AND COMPLETION OF THE FULTON ELEVATED TANK. WHEN THE 630S ZONE IS OPERATIONAL, PERMANENTLY POSITION THE ZONE DIVISION GATE VALVE CLOSED AT THE ROUTE 216 PUMP STATION WATER MAIN VAULT. COUNTY TO DETERMINE THE STATION CONTROL MODE PRIOR TO 630S ZONE COMPLETION (CONSTANT SPEED BOOSTER SERVICE OR VARIABLE SPEED ZONE OPERATIONS).
- (\*) CONTRACTOR COORDINATE PARALLEL WORK EFFORTS.

#### ABBREVIATIONS:

- AUTOMATIC TRANSFER SWITCH
- CURRENT TRANSFORMER
- DISCONNECT SWITCH
- FUSE
- J/JB JUNCTION BOX
- METER OR MOTOR

- POWER PANEL, 3-PHASE
- PRIMARY

- TVSS TRANSIENT VOLTAGE SURGE SUPPRESSION
- UE UNDERGROUND ELECTRIC

- **EMERGENCY**

- MAIN BREAKER
- PHASE
- RECEPTACLE PANEL, 1 AND 3 PHASE
- T-X TRANSFORMER
- UPS UNINTERRUPTIBLE POWER SUPPLY/BATTERY
- VOLT

- AMPERE
- CCU CENTRAL CONTROL UNIT

- EXTERIOR
- GENERATOR

- MISC MISCELLANEOUS
- NORMAL

- RECIRCULATION VALVE

- VFD VARIABLE FREQUENCY DRIVE
- XFMR TRANSFORMER

DATE 2/24/2010

RTE 216 PUMP STATION UPGRADE

CAPITAL PROJECT No. W8280 CONTRACT No. 44-4579

ELECTION DISTRICT NO.5 HOWARD COUNTY, MARYLAND 8 of 11

CHIÉF, BUREAU OF ENGINERING DATE 10/2/02 DIRECTOR OF PUBLIC WORKS 10-1-08

DEPARTMENT OF PUBLIC WORKS

HOWARD COUNTY, MARYLAND



ENGINEERS PLANNERS Scientists

CONSTRUCTION MANAGERS 10 North Park Drive HUNT VALLEY, MD 21030 PHONE: (410) 316-7800 Fax: (410) 316-7817

www.kci.com



PROFESSIONAL CERTIFICATION. I hereby certify that these

documents were prepared or approved by me, and that I am

a duly licensed professional engineer under the laws of the State of Maryland, License No. 27795, Expiration Date 7/11/2010

DES: MA DRN: LFN CHK: RW LFN AS BUILT DATE: 9/08 NO. REVISION

AND PROPOSED LOADS 2.24.10 DATE 600' SCALE MAP NO. 46 BLOCK NO. 4

SINGLE-LINE DIAGRAM

LEGEND:

CODED NOTES:

**EXISTING COMPONENTS:** 

CLOSED POSITION).

PROPOSED COMPONENTS:

EXISTING FEATURES

— MODIFICATIONS

( 1 ) 480V, 300A, 3PH, 3P, MAIN BREAKER

3) 480V, 3PH, 400A EXTERIOR DISCONNECT (PROVIDE LOCK IN

4 480V, 3PH, 3W, 400 AMP POWER PANEL (PP). PANEL INCLUDES A 480V TVSS MONITOR.

(6) 240/120V, 1PH, 3W, 100 AMP RECEPTACLE PANEL (RP).

9) 40HP, 480V, 4W VFD WITH SOFT-START BYPASS STARTER.

GENERATOR WITH SUB-BASE FUEL-OIL STORAGE AND

480V, 3PH, 4W HARMONIC LINE-SIDE FILTER IN ACCORDANCE WITH IEEE-519 REGULATIONS.

STARTER. THE VFD SHALL BE A MINIMUM 100 AMP FRAME

(13) 40HP, 480V, 3PH, 4W VFD WITH SOFT-START BYPASS

(14) PROVIDE SINGLE-PHASE 120V AUXILIARY CIRCUITS FOR

#12 AWG WITH 1 #12 AWG GROUND.

EXTENSION FOR CONDUIT AS REQUIRED.

(18) 16"x16"x4" GASKETED NEMA 3R JUNCTION BOX.

C-1 FOR DUCTBANK DETAIL.

(19) 4 #4/0 & 1 #4 G IN 3" CONDUIT.

**ELECTRICAL MODIFICATIONS:** 

MATCH EXISTING PANEL.

GENERATOR.

(20) NEW 40HP PUMP.

OWNER.

OWNER.

GENERATOR BATTERY CHARGER, LEVEL CONTROL AND

(15) PROVIDE 3 #6 & 1 #8 G IN EXISTING 1 1/4"C. PROVIDE

(16) PROVIDE ATS CALL SIGNALS AND GENERATOR RUN STATUS

HEATERS IN 2" CONDUIT TO SUIT MANUFACTURER'S LOAD

REQUIREMENTS. MINIMUM CIRCUIT CONDUCTORS SHALL BE 2

WIRING IN 2" CONDUIT FOR ATS TRANSFER AUTOMATION, SEE

INSTRUMENTATION DRAWINGS FOR CONTROL CIRCUITS AND

CONDUCTORS. SEE DWG. I-2 FOR WIRE COUNT, AND DWG.

(17) CIRCUIT BREAKER 480V, 3PH, AND 200A PROVIDED WITH THE

REMOVE EXISTING 480V, 3-POLE, 400AMP RECEPTACLE FOR

2 PROVIDE A 480V, 90A 3-POLE BREAKER IN AVAILABLE

CIRCUIT BREAKERS TO MATCH EXISTING PANELS.

SPACE TO POWER THE NEW PUMP. NEW BREAKER TO

REMOVE EXISTING 480V CONDUCTORS AND TERMINATIONS FROM MOTOR TO VFD. TURN OVER ALL EQUIPMENT TO

PROVIDE 1P, 120V, 20A CIRCUIT BREAKERS IN AVAILABLE SPACE IN PANEL RP FOR GENERATOR AUXILIARY LOADS.

PORTABLE GENERATOR SERVICE. TURN OVER EQUIPMENT TO

7 STATION CENTRAL CONTROL UNIT WITH UPS/BATTERY BACKUP.

(10) PROVIDE A 100 KW, 480/277V, 3PH, 4W STANDBY

(11) PROVIDE 3 #6 & 1 #8 G IN 1 1/4" CONDUIT.

(8) 480V, 3PH, 4W LINE-SIDE HARMONIC FILTER.


ACOUSTICAL GRADE ENCLOSURE.

2) 480V, 3PH, 3W, 400 AMP, ATS.

(5) 480V-120/240V, 10KVA XFMR.

SHEET

E-1

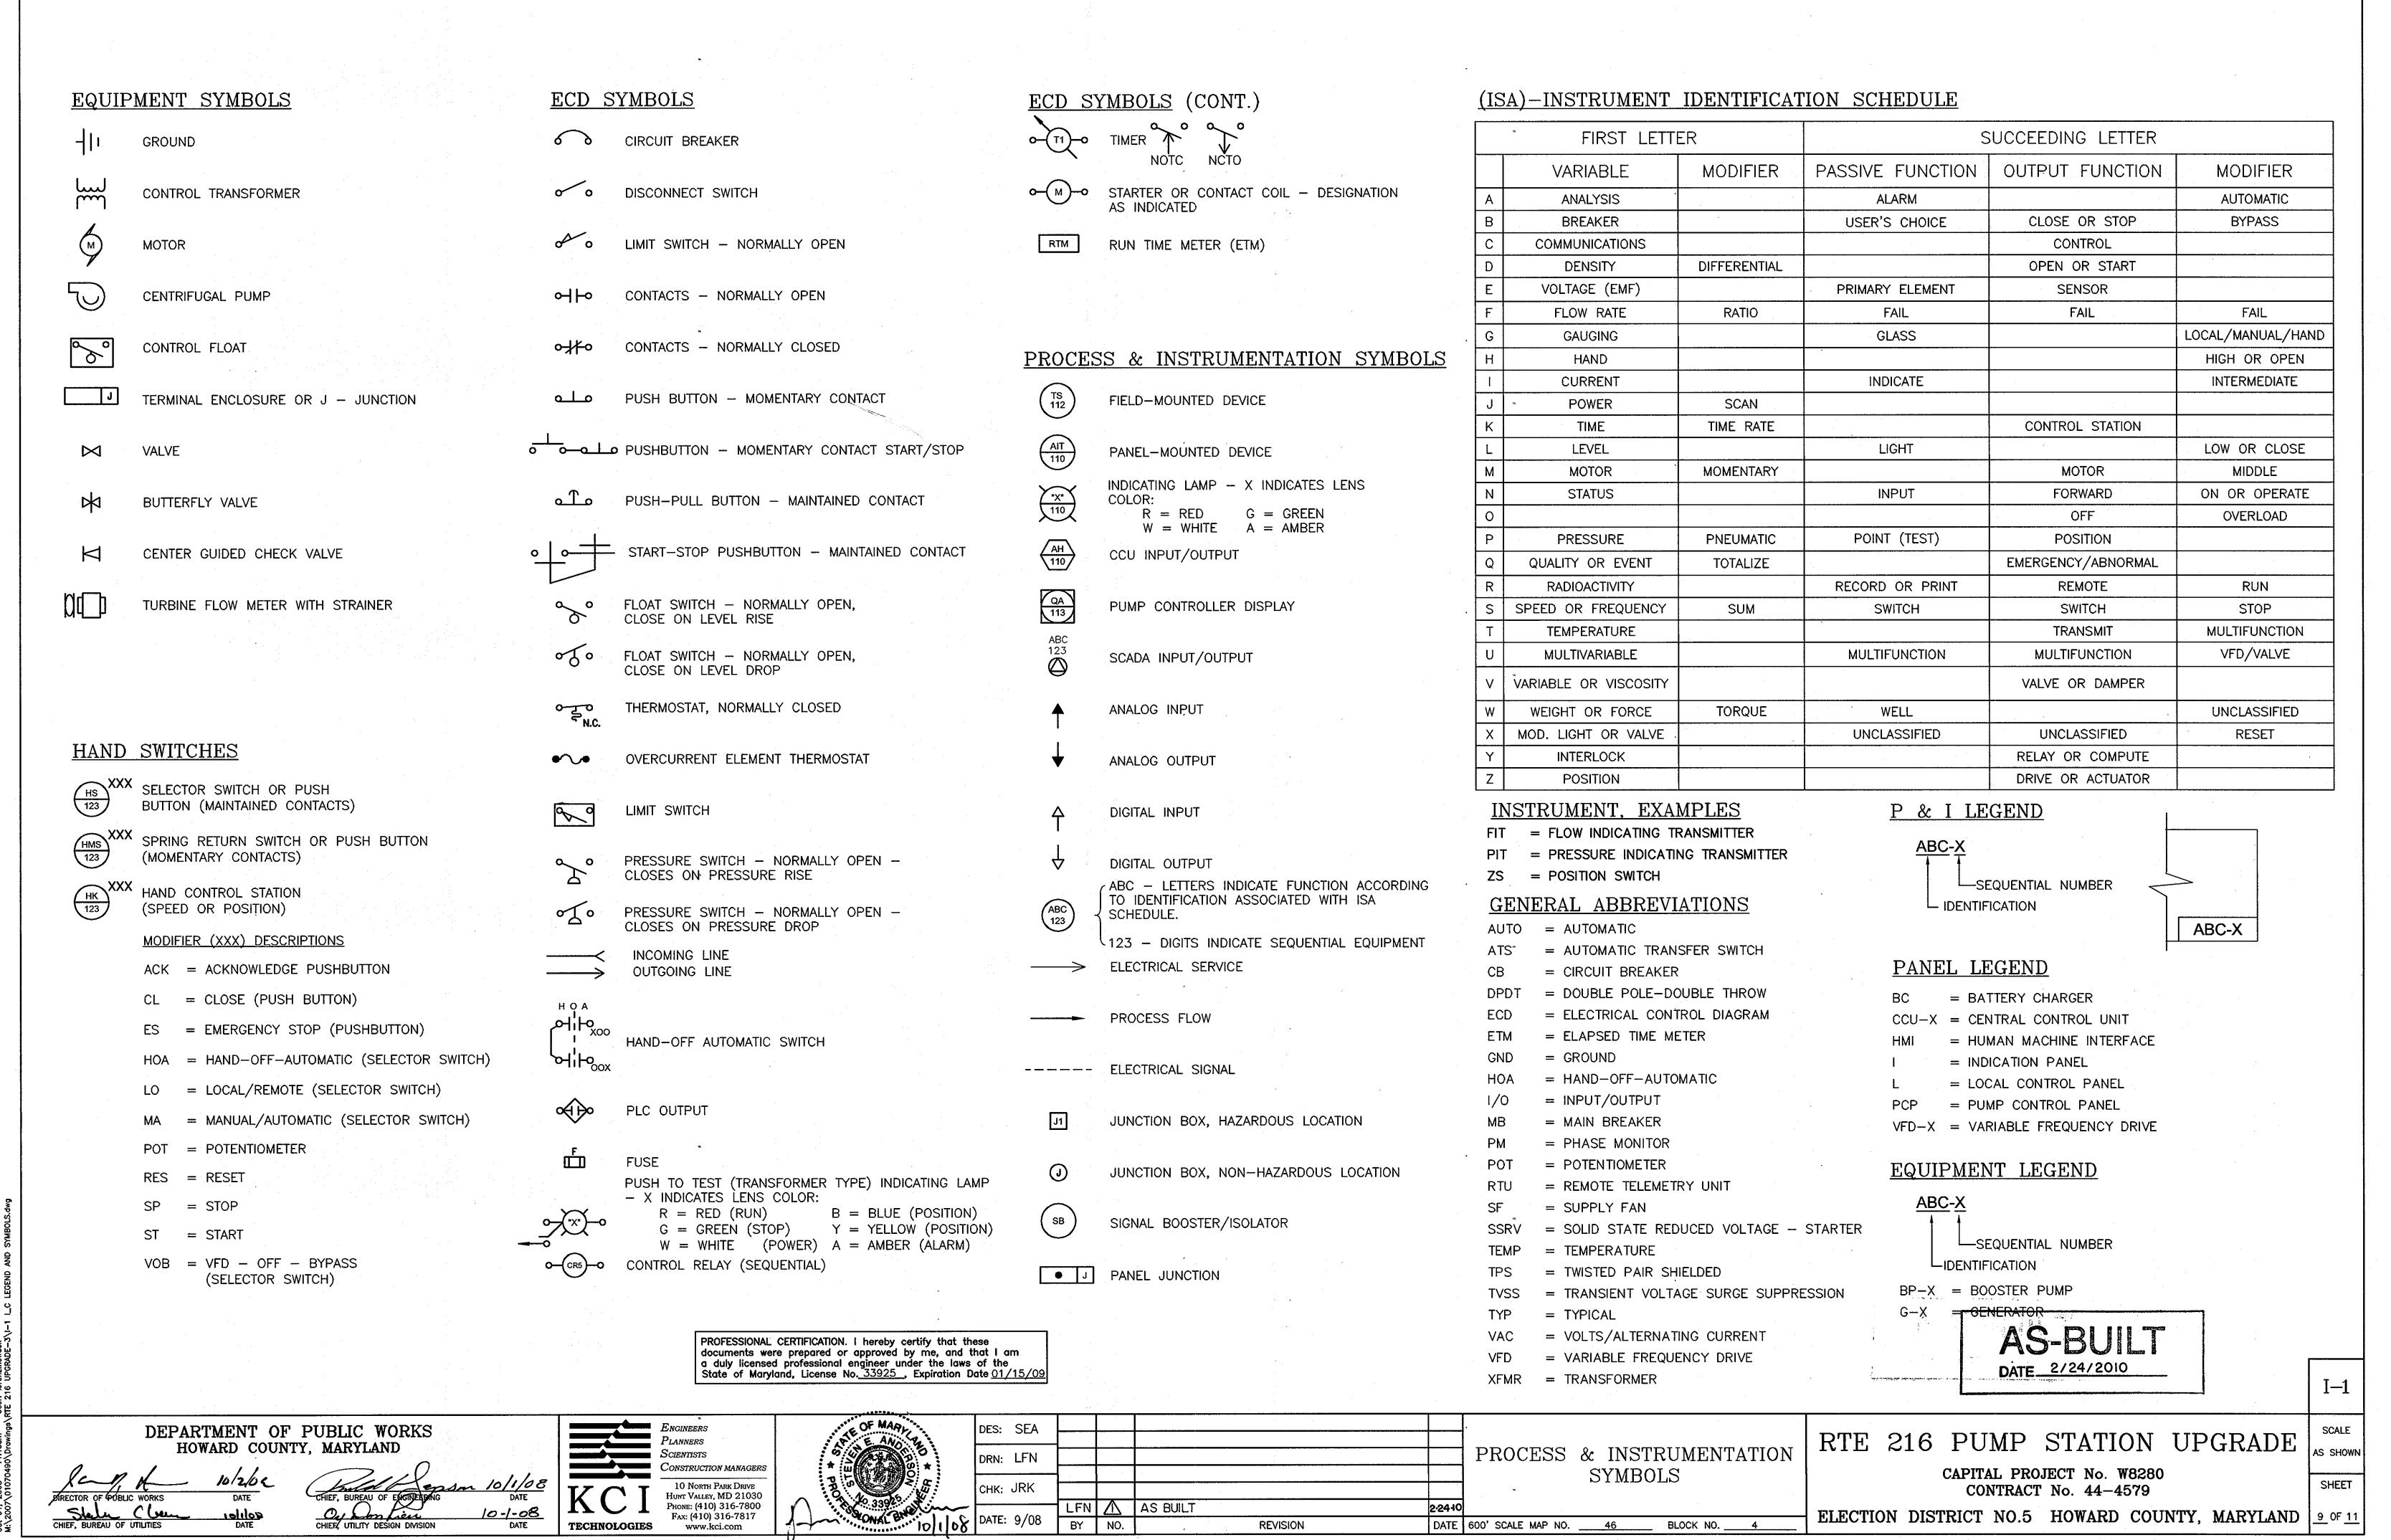

01 2008 - 11-18am ilser lorenz nownek

