

**Date:** 6/21/94



**Time:** 10:20A - 12:55P

**Effective Groundbed Width (ft):** 200

**Stray Current Shifts (mV):** DC 81mV;

**Comments:** Test site parallel to 12" Water main along Old Stockbridge Road near survey stake 912.

**Figure 34. Stray Current Survey (AM) for Site 11**

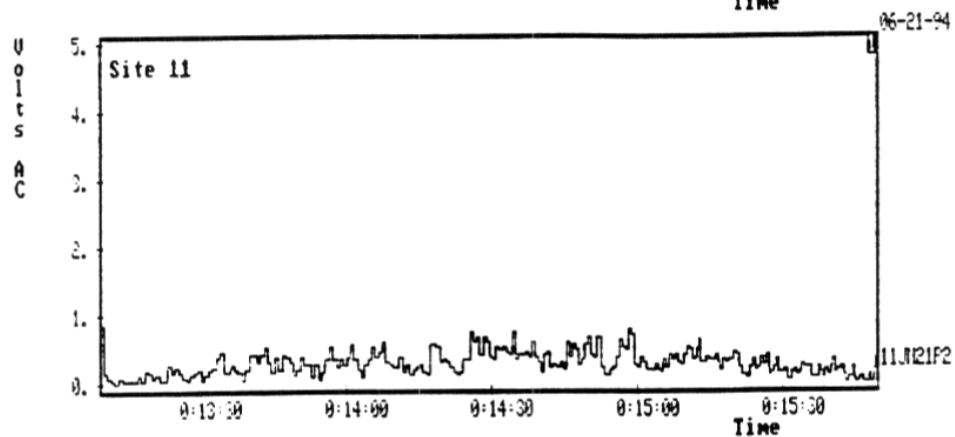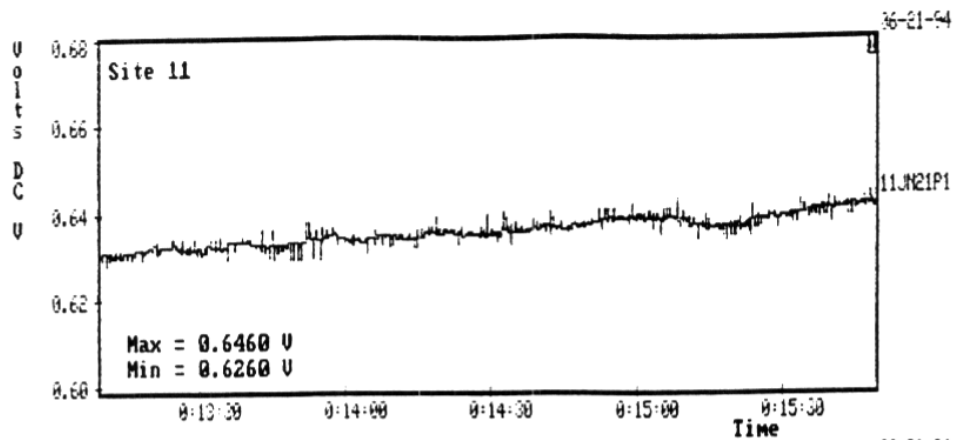

**Date:** 6/21/94

**Time:** 1:05P - 3:45P

**Effective Groundbed Width (ft):** 200

**Stray Current Shifts (mV):** DC 20mV;

**Comments:**

**Figure 35. Stray Current Survey (PM) for Site 11**



**Figure 9. Location of Site 10**



**Figure 10. Location of Site 11**