

LEGEND

CONTOUR INTERVAL: 2 FT
 EXISTING CONTOUR: ---
 PROPOSED CONTOUR: - - -
 DIRECTION OF DRAINAGE: →
 WALK OUT BASEMENT: [Symbol]
 SPOT ELEVATION: [Symbol]
 STREET TREES PER F. 96-130: [Symbol]

SCHEDULE A PERIMETER LANDSCAPE EDGE

Category	Adjacent to Roadways	LOT 277	LOT
Landscape Type		B	
Frontage/Perimeter		131	
Number of Plants Required			
Shade Trees	(1/20)	3	
Evergreen Trees	(1/40)	3	
Number of Plants Provided			
Shade Trees		3	
Evergreen Trees		3	
Surety Amount		\$1350	

NOTES:

- All plant materials shall be full and heavy, be well formed and symmetrical, conform to the most current AAN specifications and be installed in accordance with HRD planting specifications.
- Contractor shall verify location of all underground utilities prior to digging.
- Final location of plant material may need to vary to meet final field conditions. Trees shall not be in the bottom of drainage swales.

PLANT SCHEDULE

KEY	PLANT NAME	SIZE	QUAN.	REMARKS
AR	ACER RUBRUM 'RED SUNSET'	2 1/2"-3" CAL.	3	BAB
PS	PINUS STREBUS WHITE PINE	12"-14" HT.	3	BAB

GENERAL NOTES:

- Subject property is zoned NTSFLD per 10-18-93 Comprehensive Zoning Plan.
- The total area included in this submission is: 0.7129 Acres.
- The total number of lots included in this submission is: 2
- Improvement to property: Single Family Detached
- The maximum lot coverage permitted is: 30%
- Department of Planning and Zoning reference file numbers: S-93-21P-95-11, F-96-30, W-5 Cont. No. 34-3420-D, F-96-222-A, P-96-12, P-96-12.
- Utilities shown as existing are taken from approved Water and Sewer plans Contract #34-3420-D, approved Road Construction plans F-96-130.
- Any damage to county owned rights-of-way shall be corrected at the developer's expense.
- All roadways are public and existing.
- The existing topography was taken from Road Construction Plans prepared by Dorf, Moore, Walker, Inc. 7-10-97
- The coordinates shown herein are based upon the Howard County Geodetic Control which is based upon the Maryland State Plane Coordinate System - Howard County Monuments Numbers: 2964 & 2965
- The contractor shall notify the Department of Public Works/Division of Construction Inspection at (410) 313-1000 at least twenty-four (24) hours prior to the start of work.
- The contractor shall notify "Miss Utility" at 1-800-267-7777 at least 48 hours prior to any excavation work.
- For driveway entrance details, refer to Ho. Co. Design Manual Volume IV details R.6.03 & R.6.05.
- In accordance with F.D.P. phase 222-A, Part IV, bay windows or chimneys rise 222-A, Part IV in width may project not more than 4 feet into any setbacks; porches and decks may project not more than 3 feet into the front or rear setbacks. No exterior stairway or areaway is allowed to encroach into any BRL.
- Stormwater Management quantity and quality for the improvements from Bright Flow Mews, area North of Distant Thunder Trail DA to #509 from Section 4 Area 5, F-96-122 will be provided by an excavated pond East of Distant Thunder Trail. Said pond will be jointly maintained. Stormwater Management quantity for the improvements West of Indian Summer Drive and South of Summit Drive is provided by Village of River Hill Section 4 Area I, Phase I, F-96-110, Water quality will be provided by bio-retention or shallow marsh at the storm drain outfalls and will be jointly maintained. Stormwater Management quantity for the improvements East of Indian Summer Drive and South of Distant Thunder Trail are provided for in Section 4 Area I, F-96-110 by proposed features as described in a report prepared by Whitman, Reardon & Associates and approved as of 1/20/95. Water quality will be provided by bio-retention or shallow marsh at the storm drain outfalls and will be jointly maintained.
- SHC Elevations shown are at the property lines.
- This plan has been prepared in accordance with the provisions of section 16.124 of the Howard County code and Landscape Manual. Financial Surety for the trees in schedule A in the amount of \$1,350 shall be part of the Builders Grading Permit Application.

SPECIAL NOTE:

This plan is for house siting and lot grading only. Improvements shown within the rights-of-way on this S.D.P. are not to be used for construction for construction, see approved Road Construction Plans F-96-130 and/or approved Water and Sewer Plans Contract #34-3420-D.

This project is exempt from the Forest Conservation Act of 1991, Section 11-101(a)(1)(iv) of the Howard County Code, because it is part of planned unit development with preliminary plan approval prior to December 31, 1992.

DEVELOPER'S/BUILDERS CERTIFICATE

I/We certify that the landscaping shown on this plan will be done according to plan, section 16.124 of the Howard County Code and the Howard County Landscape Manual. I/We further certify that upon completion a Certificate of Landscape Installation, accompanied by an executed one year guarantee of plant materials, will be submitted to the Department of Planning and Zoning.

Douglas J. Dieringer
 Name: DOUGLAS J. DIERINGER Date: 5-19-00

ADDRESS CHART

LOT NUMBER	STREET ADDRESS
277	12000 DISTANT THUNDER TRAIL
278	5853 INDIAN SUMMER DRIVE

SHEET INDEX

DESCRIPTION	SHEET NO.
SITE DEVELOPMENT PLAN	1 OF 2
SEDIMENT & EROSION CONTROL PLAN	2 OF 2

OWNER / DEVELOPER

THE HOWARD RESEARCH AND DEVELOPMENT CORP.
 10275 LITTLE PATUXENT PARKWAY
 COLUMBIA, MARYLAND 21044


CLARK • FINEFROCK & SACKETT, INC.
 ENGINEERS • PLANNERS • SURVEYORS
 7135 MINSTREL WAY • COLUMBIA, MD 21045 • (410) 381-7500 BALT. • (301) 621-8100 WASH.

DESIGNED: JME
 DRAWN: BLP
 CHECKED: JME
 DATE: APRIL, 2000

SITE DEVELOPMENT PLAN, LOTS 277 & 278
COLUMBIA VILLAGE OF RIVER HILL
 SECTION 4 AREA 4
 FIFTH (5TH) ELECTION DISTRICT
 HOWARD COUNTY, MARYLAND

FOR: DOUGLAS HOMES
 P.O. Box 628 (Dorsey Hall Drive)
 Dorsey Hall Professional Park
 Ellicott City, Maryland 21043

SCALE: 1" = 30'
 DRAWING: 1 of 2
 JOB NO.: 00-024
 FILE NO.: 00-024-X

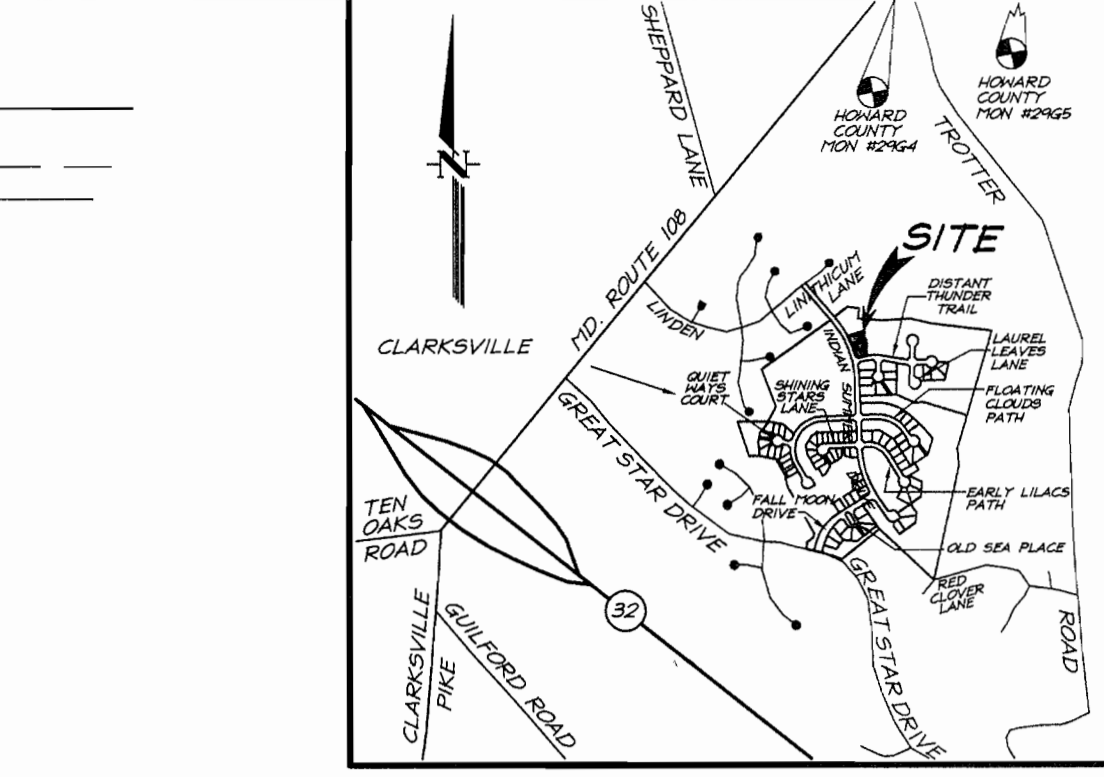

STERLING

2912.66 SF = 8708.87 SF
 0.3 Min. Lot Size w/all Options

3072.66 SF = 10,242.20 SF
 0.3 Min. Lot Size w/all Options w/10'x16' Deck

APPROVED: DEPARTMENT OF PLANNING & ZONING
 Chief, Development Engineering Division: 7/6/00
 Chief, Division of Land Development: 7/7/00
 Director: 7/6/00

WARWICK

2323.66 SF = 7745.53 SF
 0.3 Min. Lot Size w/all Options

2483.16 SF = 8277.20 SF
 0.3 Min. Lot Size w/all Options w/10'x16' Deck

WESTCHESTER

2555.89 SF = 8519.63 SF
 0.3 Min. Lot Size w/all Options

2715.89 SF = 9052.97 SF
 0.3 Min. Lot Size w/all Options w/10'x16' Deck

OAKWOOD

2745.98 SF = 9153.27 SF
 0.3 Min. Lot Size w/all Options

2905.98 SF = 9606.60 SF
 0.3 Min. Lot Size w/all Options w/10'x16' Deck

PLYMOUTH

2022.77 SF = 6675.90 SF
 0.3 Min. Lot Size w/all Options

2162.77 SF = 7209.23 SF
 0.3 Min. Lot Size w/all Options w/10'x16' Deck

CHANDLER

2266.00 SF = 7553.33 SF
 0.3 Min. Lot Size w/all Options

2426.00 SF = 8086.67 SF
 0.3 Min. Lot Size w/all Options w/10'x16' Deck

GREENBRIAR

2594.00 SF = 8646.67 SF
 0.3 Min. Lot Size w/all Options

2754.00 SF = 9180.00 SF
 0.3 Min. Lot Size w/all Options w/10'x16' Deck

PINEHURST

2543.87 SF = 8479.57 SF
 0.3 Min. Lot Size w/all Options

2703.87 SF = 9012.90 SF
 0.3 Min. Lot Size w/all Options w/10'x16' Deck

NEWBURY

2004.54 SF = 6681.80 SF
 0.3 Min. Lot Size w/all Options

2164.54 SF = 7215.13 SF
 0.3 Min. Lot Size w/all Options w/10'x16' Deck

CARROLLTON 1

2486.58 SF = 8288.60 SF
 0.3 Min. Lot Size w/all Options

2646.58 SF = 8821.93 SF
 0.3 Min. Lot Size w/all Options w/10'x16' Deck

ASTER

2596.00 SF = 8653.33 SF
 0.3 Min. Lot Size w/all Options

2756.00 SF = 9186.67 SF
 0.3 Min. Lot Size w/all Options w/10'x16' Deck

BRENTWOOD

2029.45 SF = 6764.83 SF
 0.3 Min. Lot Size w/all Options

2189.45 SF = 7298.17 SF
 0.3 Min. Lot Size w/all Options w/10'x16' Deck

21.0 STANDARDS AND SPECIFICATIONS FOR TOPSOIL

Definition
Placement of topsoil over a prepared subsoil prior to establishment of permanent vegetation.

Purpose
To provide a suitable soil medium for vegetable growth. Soils of concern have low moisture content, low nutrient levels, low pH, materials toxic to plants, and/or unacceptable soil gradation.

Conditions Where Practice Applies

- This practice is limited to areas having 21 or flatter slopes where:
 - The texture of the exposed subsoil/parent material is not adequate to produce vegetative growth.
 - The soil material is so shallow that the rooting zone is not deep enough to support plants or furnish continuing supplies of moisture and plant nutrients.
 - The original soil to be vegetated contains material toxic to plant growth.
 - The soil is so acidic that treatment with limestone is not feasible.
- For the purpose of these Standards and Specifications, areas having slopes steeper than 2:1 require special consideration and design for adequate stabilization. Areas having slopes steeper than 2:1 shall have the appropriate stabilization shown on the plans.

Construction and Material Specifications

- Topsoil salvaged from the existing site may be used provided that it meets the standards as set forth in these specifications. Typically, the depth of topsoil to be salvaged for a given soil type can be found in the representative soil profile section in the Soil Survey published by USDA-NRCS in cooperation with Maryland Agricultural Experiment Station.
- Topsoil Specifications - Soil to be used as topsoil must meet the following:
 - Topsoil shall be a loam, sandy loam, clay loam, silt loam, sandy clay loam, loamy sand. Other soils may be used if recommended by an agronomist or a soil scientist and approved by the appropriate approval authority. Regardless, topsoil shall not be a mixture of contrasting textured subsoils and shall contain less than 5% by volume of chert, stones, slag, coarse fragments, gravel, sticks, roots, trash, or other materials larger than 1 and 1/2" in diameter.
 - Topsoil must be free of plants or plant parts such as Bermuda grass, quackgrass, Johnsongrass, nutgrass, poison ivy, thistle, or others as specified.
 - Where the subsoil is either highly acidic or composed of heavy clays, ground limestone shall be spread at the rate of 4-8 tons/acre (200-400 pounds per 1,000 square feet) prior to the placement of topsoil. Lime shall be distributed uniformly over designated areas and worked into the soil in conjunction with tillage operations as described in the following procedures.
- For sites having disturbed areas under 5 acres:
 - Place topsoil (if required) and apply soil amendments as specified in 20.0 Vegetative Stabilization - Section 1 - Vegetative Stabilization Methods and Materials.

PERMANENT SEEDING NOTES

APPLY TO GRADED OR CLEARED AREAS NOT SUBJECT TO IMMEDIATE FURTHER DISTURBANCE WHERE A PERMANENT LONG-LIVED VEGETATIVE COVER IS NEEDED.

SEEDBED PREPARATION: Loosen upper three inches of soil by raking, discing or other acceptable means before seeding, if not previously loosened.

SOIL AMENDMENTS: In lieu of soil test recommendations, use one of the following schedules:

- Preferred - Apply 2 tons per acre dolomitic limestone (92 lb/100 sq ft.) and 400 lbs per acre 10-10-10 fertilizer (14 lbs/100 sq ft.) before seeding. Harrow or disc into upper three inches of soil. At the time of seeding, apply 400 lbs per acre 30-0-0 ureaform fertilizer (4 lbs/100 sq ft.).
- Acceptable - Apply 2 tons per acre dolomitic limestone (92 lb/100 sq ft.) and apply 1000 lbs per acre 10-10-10 fertilizer (28 lbs/100 sq ft.) before seeding. Harrow or disc into upper three inches of soil.

SEEDING: For the periods March 1 thru April 30, and August 1 thru October 15, seed with 60 lbs per acre (1.4 lbs/100 sq ft.) of Kentucky 31 Tall Fescue. For the period May 1 thru July 31, seed with 60 lbs Kentucky 31 Tall Fescue per acre and 2 lbs per acre (.28 lbs/100 sq ft.) of weeping lovegrass. During the period of October 16 thru February 28, protect site by applying 1 1/2 tons per acre well anchored straw mulch and seed as soon as possible in the spring. Option (2) Use seed, Option (3) Seed with 60 lbs/acre Kentucky 31 Tall Fescue and mulch with 2 tons/acre well anchored straw.

MULCHING: Apply 1 1/2 to 2 tons per acre (70 to 90 lbs/1000 sq ft.) of unrattled small grain straw immediately after seeding. Anchor mulch immediately after application using mulch anchoring tool or 200 gallons per acre (5 gal/1000 sq ft.) of erumulated asphalt on flat areas. On slopes 8 feet or higher, use 340 gallons per acre (8 gal/1000 sq ft.) for anchoring.

MAINTENANCE: Inspect all seeded areas and make needed repairs, replacements and reseeding.

TEMPORARY SEEDING NOTES



SEEDBED PREPARATION: Loosen upper three inches of soil by raking, discing or other acceptable means before seeding, if not previously loosened.

SOIL AMENDMENTS: Apply 600 lbs per acre 10-10-10 fertilizer (14 lbs/100 sq ft.).

SEEDING: For the periods March 1 thru April 30 and from August 15 thru November 15, seed with 2 1/2 bushels per acre of annual ryegrass (3 lbs/1000 sq ft.) For the period May 1 thru August 14, seed with 3 lbs per acre of weeping lovegrass (.7 lbs/1000 sq ft.). For the period November 1 thru February 28, protect site by applying 2 tons per acre of well anchored straw mulch and seed as soon as possible in the spring, or use seed.

MULCHING: Apply 1 1/2 to 2 tons per acre (70 to 90 lbs/1000 sq ft.) of unrattled small grain straw immediately after seeding. Anchor mulch immediately after application using mulch anchoring tool or 200 gallons per acre (5 gal/1000 sq ft.) of erumulated asphalt on flat areas. On slopes 8 feet or higher, use 340 gallons per acre (8 gal/1000 sq ft.) for anchoring.

REFER TO THE 1984 MARYLAND STANDARDS AND SPECIFICATIONS FOR SOIL EROSION AND SEDIMENT CONTROL FOR RATE AND METHODS NOT COVERED.

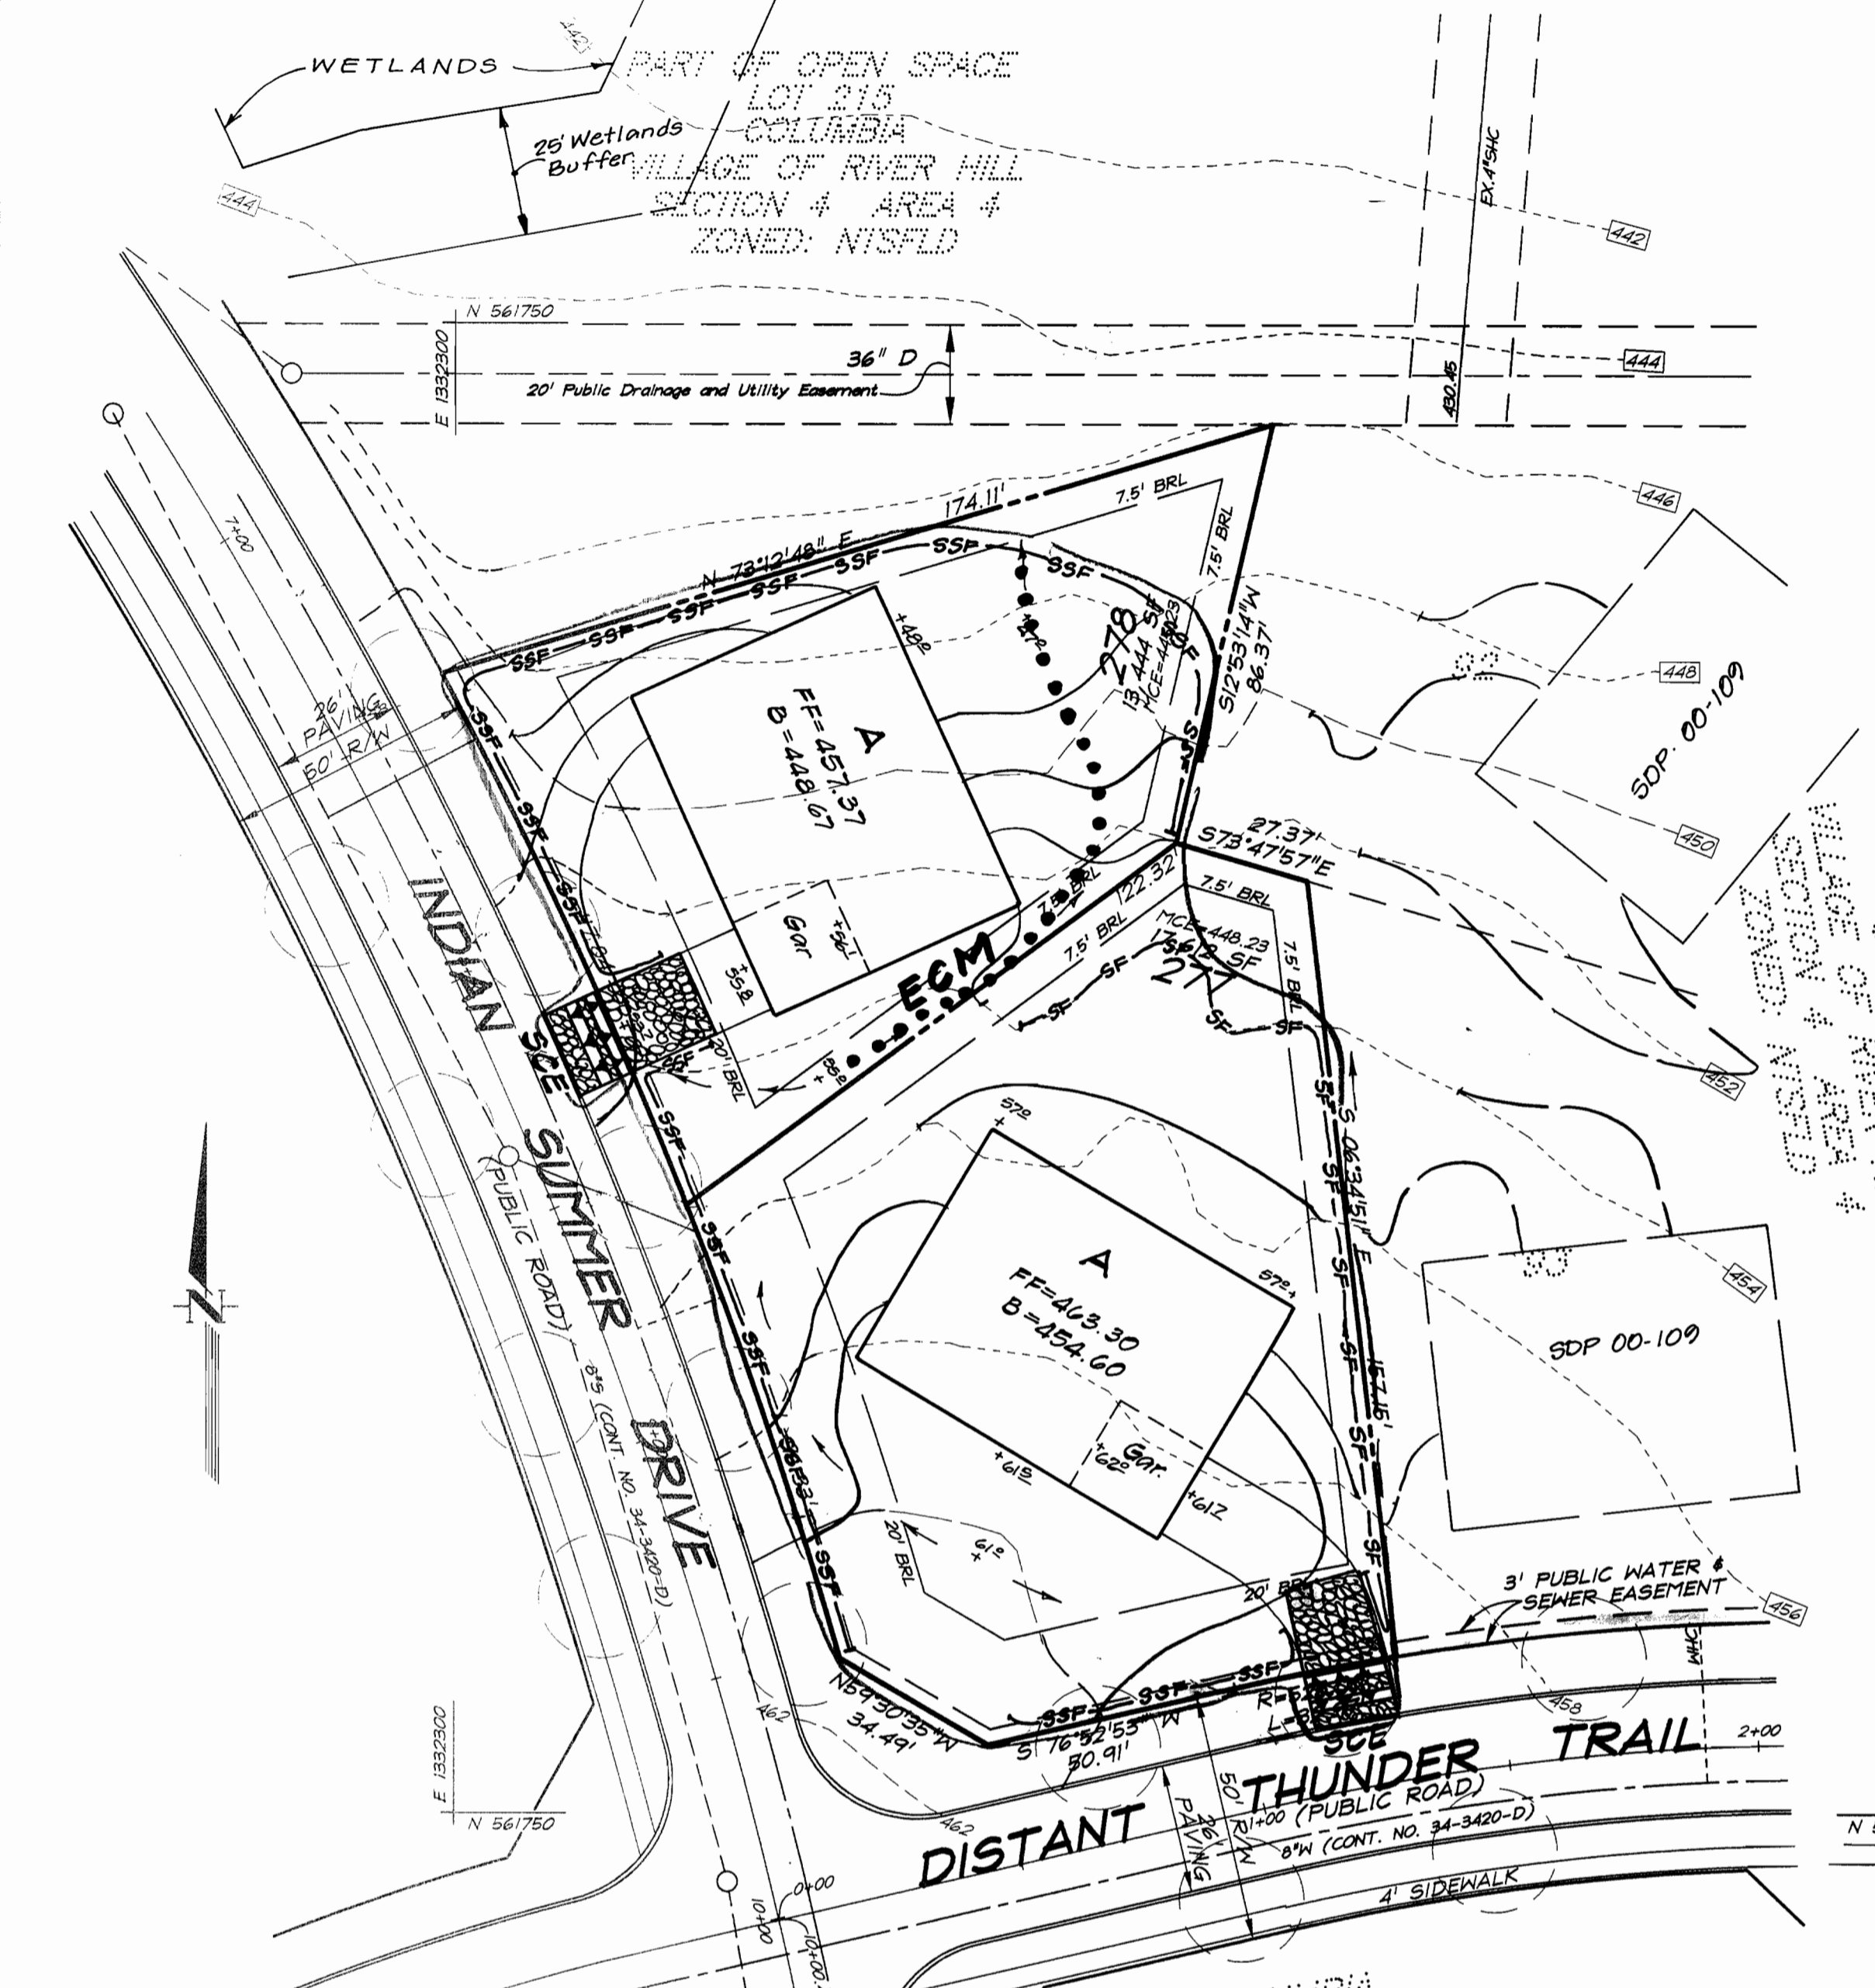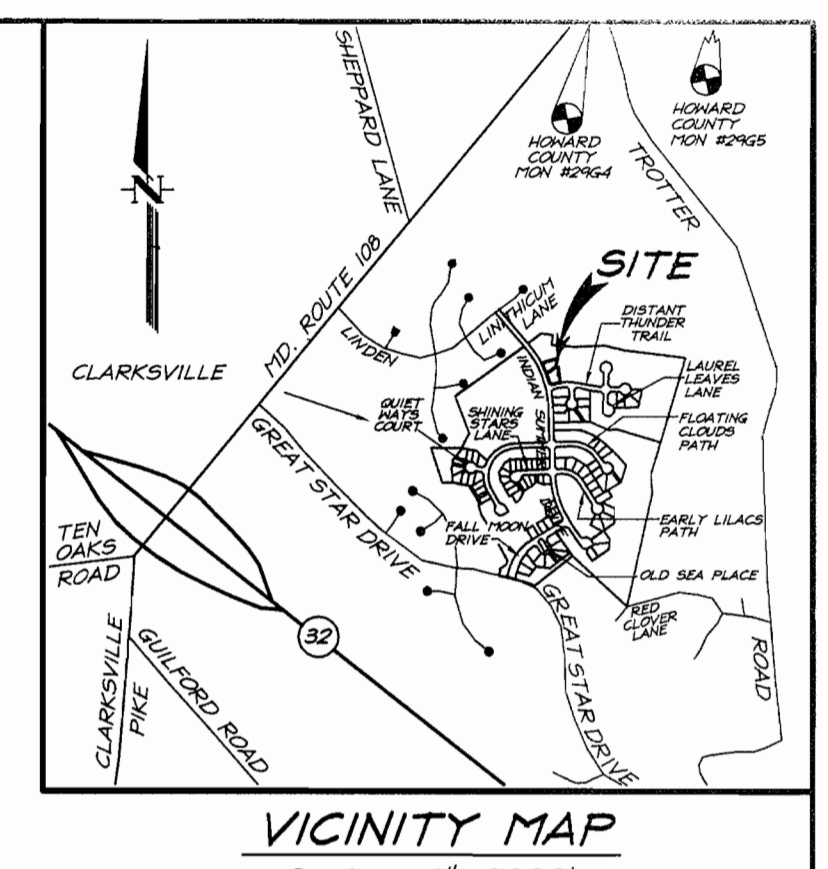

SEDIMENT AND EROSION CONTROL NOTES

- A minimum of 48 hours notice must be given to the Howard County Department of Inspection, Licenses and Permits, Sediment Control Division prior to the start of any construction (313-1855).
 - All vegetative and structural practices are to be installed according to the provisions of this plan and are to be in conformance with the 1984 MARYLAND STANDARDS AND SPECS. FOR SOIL EROSION AND SEDIMENT CONTROL and revisions thereto.
 - Following initial soil disturbance or redistribution, permanent or temporary stabilization shall be completed within:
 - 7 calendar days for all perimeter sediment control structures, dikes, berm slopes and all slopes greater than 3:1
 - 14 days for all other disturbed or graded areas on the project site.
 - All sediment traps/basins shown must be fenced and warning signs posted around their perimeters in accordance with Vol. 1, Chapter 7, of the HOWARD COUNTY MANUAL, Storm Drainage.
 - All disturbed areas must be stabilized within the time period specified above, in accordance with the 1984 MARYLAND STANDARDS AND SPECIFICATIONS FOR SOIL EROSION AND SEDIMENT CONTROL for permanent seeding, and temporary seeding and mulching (see G). Temporary stabilization with mulch alone can only be done when recommended seeding rates do not allow for proper germination and establishment of grasses.
 - All sediment control structures are to remain in place and are to be maintained in operative condition until permission for their removal has been obtained from the Howard County Sediment Control Inspector.
 - SITE ANALYSIS:**






Total Area of Site:	0.71 Acres
Area Disturbed:	0.63 Acres
Area to be vegetatively stabilized:	0.41 Acres
Total Cut:	
Total Fill:	
Off-site Maste/Borrow Area Location:	
 - Any sediment control practice which is disturbed by grading activity for placement of utilities must be repaired on the same day of disturbance.
 - Additional sediment control must be provided, if deemed necessary by the Howard County DPM Sediment Control Inspector.
 - On all sites with disturbed areas in excess of 2 acres, approval of the inspection agency shall be requested upon completion of installation of perimeter erosion and sediment controls, but before proceeding with any other earth disturbance or grading. Other building or grading inspection approvals may not be authorized until this initial approval by the inspection agency is made.
 - Trenches for the construction of utilities shall be backfilled and stabilized within one working day, or is limited to three pipe lengths.
 - The total amount of silt fence = 221 LF
 - The total amount of super silt fence = 474 LF
 - The total amount of super diversion fence =
- * It is the responsibility of the contractor to identify the spill/borrow site and notify and gain approval from the sediment control inspector of the site and its grading permit number at the time of construction.

CONSTRUCTION SEQUENCE:

- Obtain grading permit.
 - Install tree protection fence.
 - Install sediment and erosion control devices and stabilize.
 - Excavate for foundations, rough grade and temporarily stabilize.
 - Construct structures, sidewalks and driveways.
 - Final grade, install Erosion Control Matting and stabilize in accordance with standards and specifications.
 - Upon approval of the sediment control inspector, remove sediment and erosion control devices and stabilize.
- * Delay construction of houses on lots: N/A

OWNER / DEVELOPER

THE HOWARD RESEARCH AND DEVELOPMENT CORP.
10276 LITTLE PATUENT PARKWAY
COLUMBIA, MARYLAND 21044

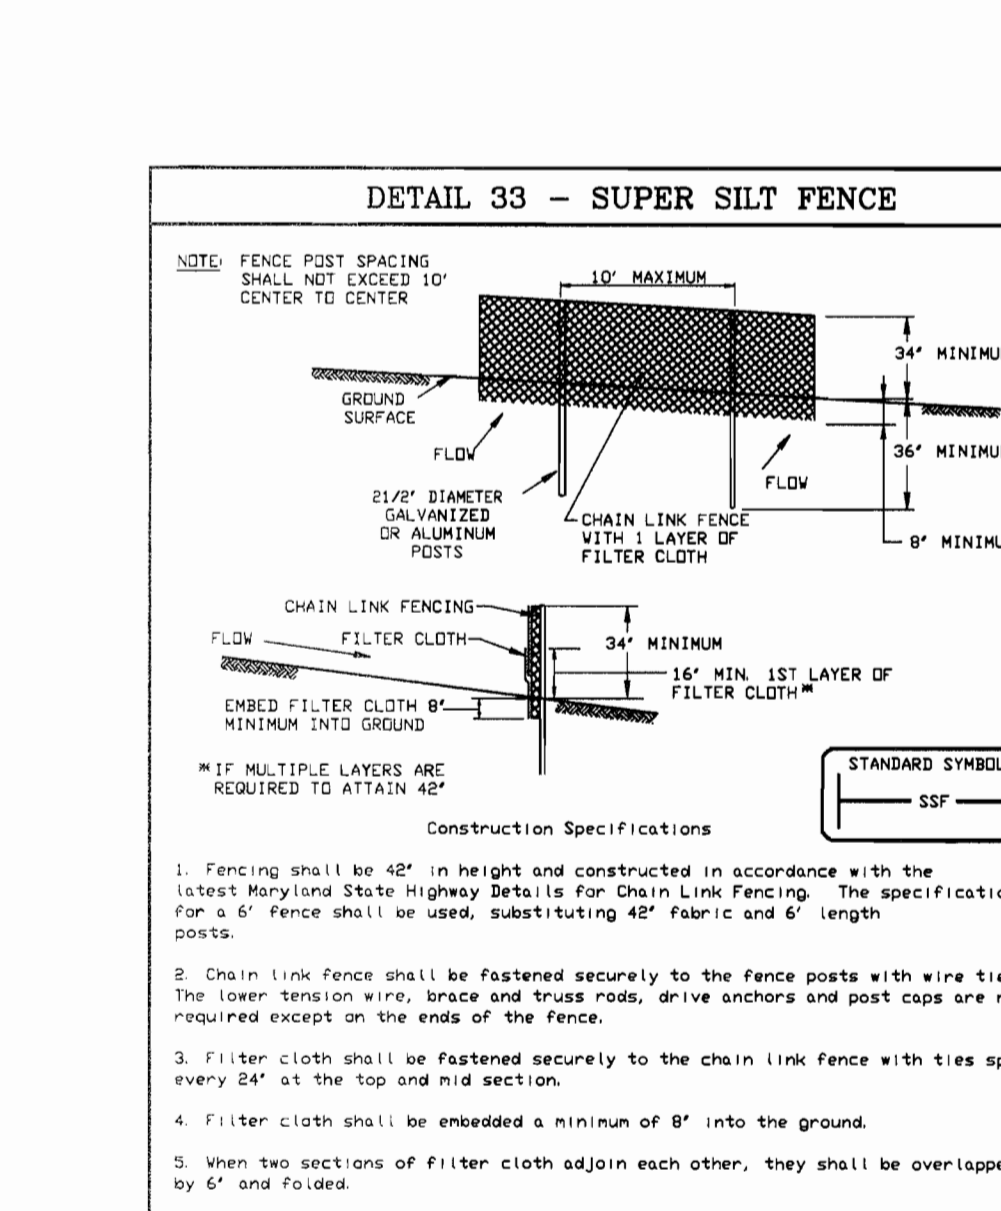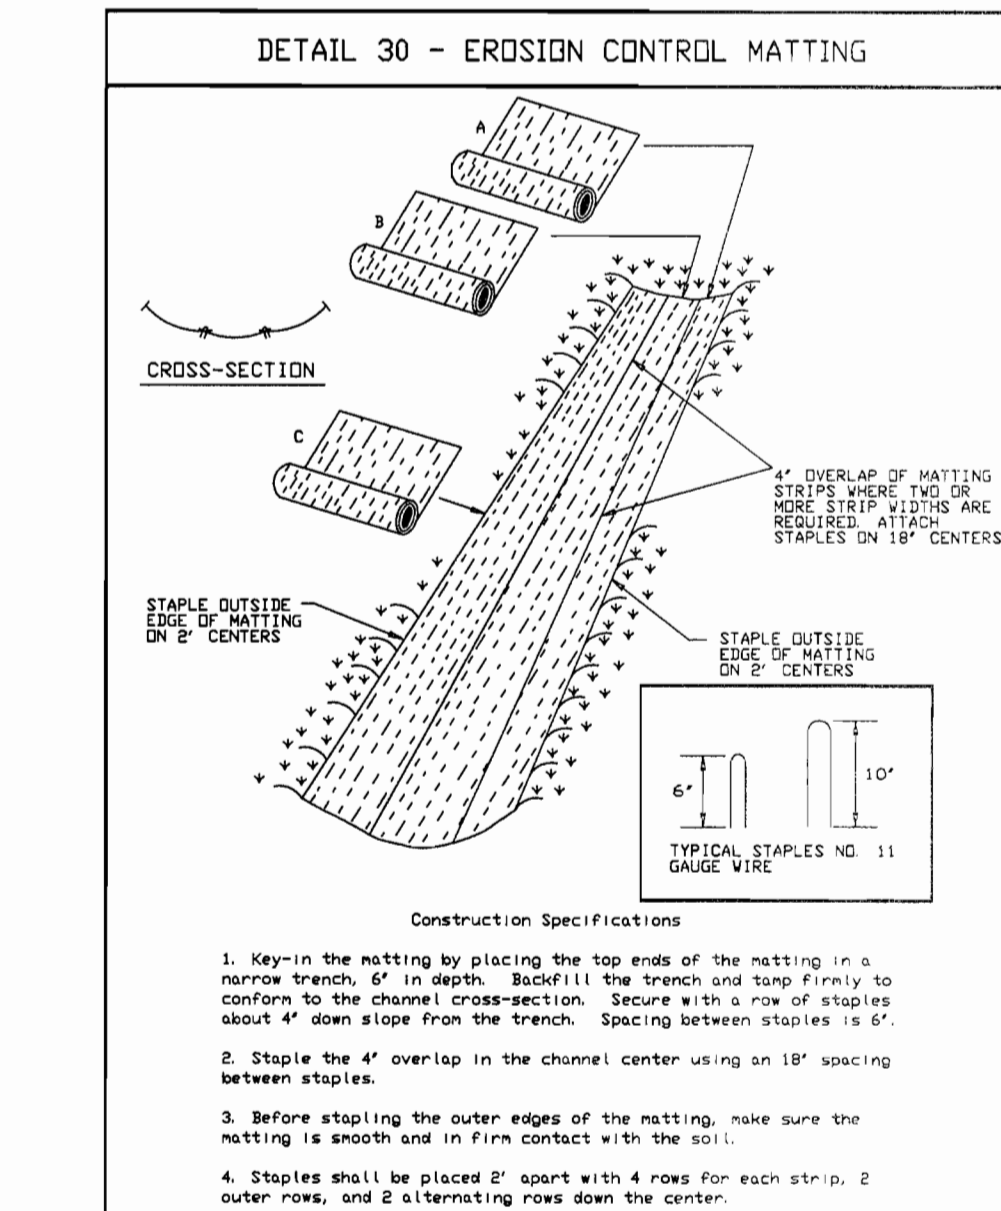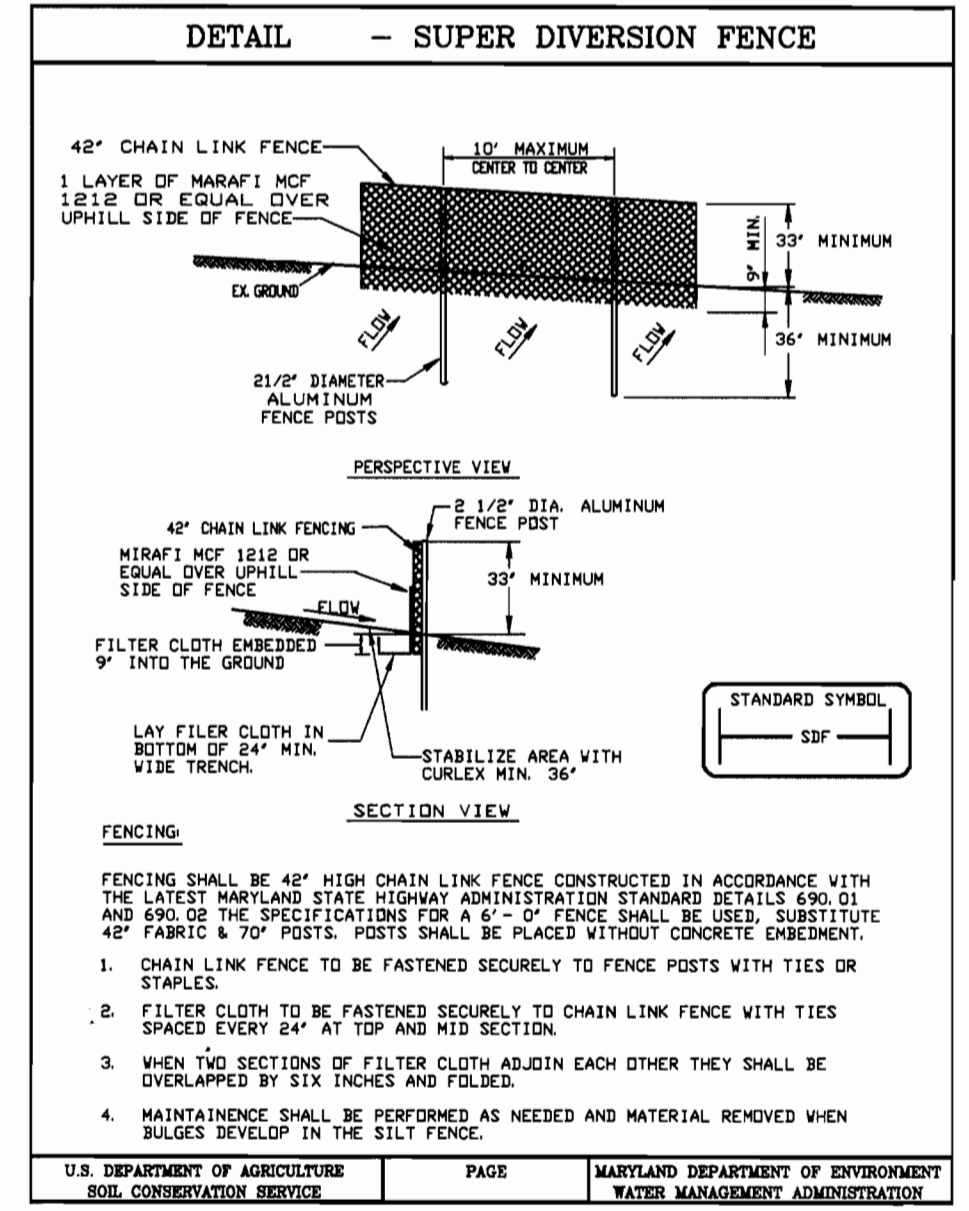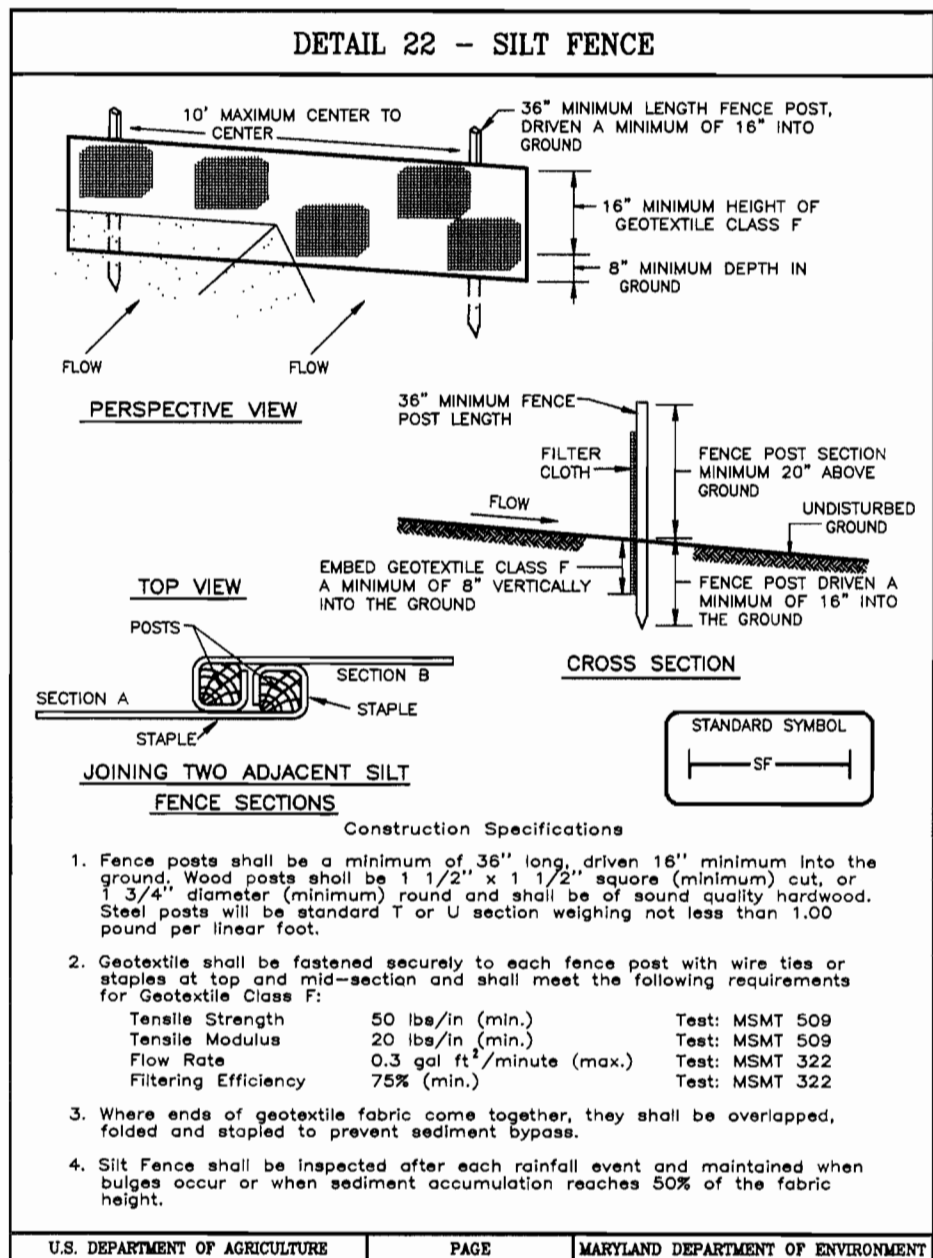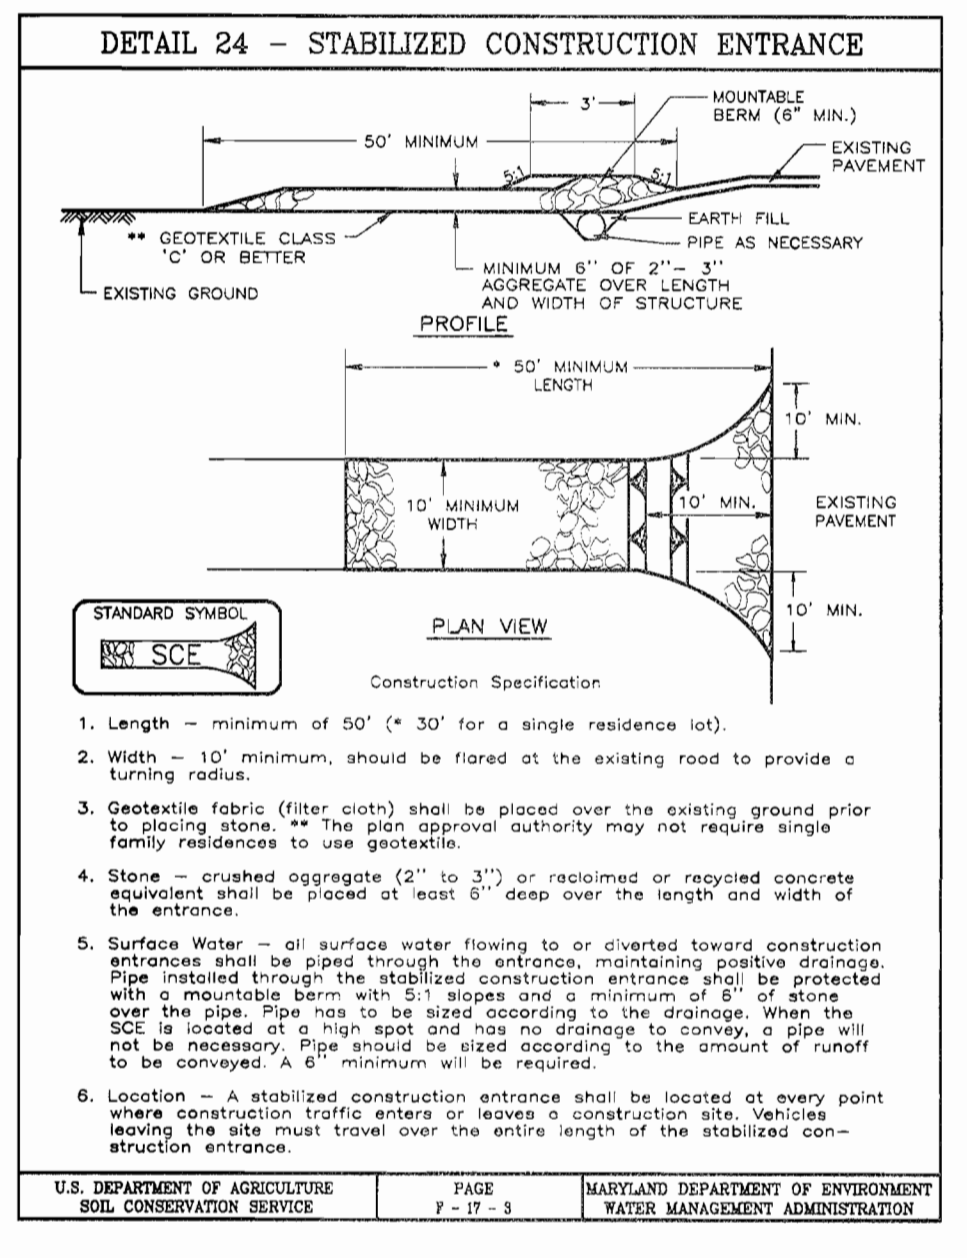

LEGEND

CONTOUR INTERVAL: 2 FT.

EXISTING CONTOUR: ---

PROPOSED CONTOUR: - - -

DIRECTION OF DRAINAGE: →

WALK OUT BASEMENT: [Symbol]

SPOT ELEVATION: +78.4

STABILIZED CONSTRUCTION ENTRANCE: [Symbol]

EROSION CONTROL MATTING: [Symbol]

SUPER SILT FENCE: [Symbol]

SILT FENCE: [Symbol]

EROSION CONTROL MATTING LIMIT OF DISTURBED AREA: [Symbol]

EXISTING TREES TO REMAIN: [Symbol]

APPROVED: DEPARTMENT OF PLANNING & ZONING

John R. Robertson 7/16/00 DATE

John R. Robertson 7/16/00 DATE

John R. Robertson 7/16/00 DATE

Reviewed for HOWARD S.C.D. and other Technical Requirements

John R. Robertson 7/16/00

Signature Date

U.S. Natural Resource Conservation Service

THIS DEVELOPMENT PLAN IS APPROVED FOR SOIL EROSION AND SEDIMENT CONTROL BY THE HOWARD SOIL CONSERVATION DISTRICT.

John R. Robertson 7/13/00

Approved

DEVELOPER'S/BUILDER'S CERTIFICATE

"We certify that all development and construction will be done according to this plan of development and plan for sediment and erosion control and that all responsible personnel involved in the construction project will have a Certificate of Attendance at a Department of the Environment Approved Training Program for the Control of Sediment and Erosion before beginning the project. I also authorize periodic on-site inspection by the Howard Soil Conservation District or their authorized agents, as are deemed necessary."

John R. Robertson 5-19-00 DATE

NAME: DOUGLAS J. DIERINGER

ENGINEER'S CERTIFICATE

"I hereby certify that this plan for Sediment and Erosion Control represents a practical and workable plan based on my personal knowledge of the site conditions and that it was prepared in accordance with the requirements of the Howard Soil Conservation District."

John R. Robertson 6-16-00 DATE

G. NELSON CLARK

CLARK • FINEFROCK & SACKETT, INC.
ENGINEERS • PLANNERS • SURVEYORS

7135 MINSTREL WAY • COLUMBIA, MD 21045 • (410) 381-7500 BALT. • (301) 621-8100 WASH.

DESIGNED	JME	SCALE	1" = 30'
DRAWN	BLP	DRAWING	2 of 2
CHECKED	JME	JOB NO.	00-024
DATE	APRIL, 2000	FILE NO.	00-024-SB
FOR: DOUGLAS HOMES		P.O. Box 628 (Dorsey Hall Drive)	
		Dorsey Hall Professional Park	
		Ellicott City, Maryland 21043	