


VICINITY MAP  
SCALE: 1" = 200'




**SITE ANALYSIS**

1. AREA OF PARCEL - 3.94 ACRES OR 171,083.00 SQ. FT.
2. PRESENT ZONING - M-2
3. FLOOR SPACE (ON EACH LEVEL)  
27,188 SF / LEVEL x 2 = 54,376 SF  
TOTAL AREA
4. NUMBER OF PARKING SPACES  
REQ. = 7 SPACES / 10 EMPLOYEES, OFFICE  
TOTAL EMPLOYEES = 250  
250 x 7 / 10 = 175 SPACES. REQ'D  
PROVIDED = 201 194 RES. PS.  
7 HANDICAP.
5. DEED REFERENCE  
LIBER - 415  
FOU10 - 272  
LIBER - 1800  
FOU10 - 547
6. OPEN SPACE:  
20% MIN. REQ. = 34,325 SF  
PROVIDED = 66,613 SF OR 38.8%
7. FOR HANDICAP RAMP DETAILS  
SEE SHEET 2 OF B
8. PARKING AREA = 83,040 SF  
PARKING GREEN AREA = 4,560 SF  
% GREEN SPACE = 5.5%

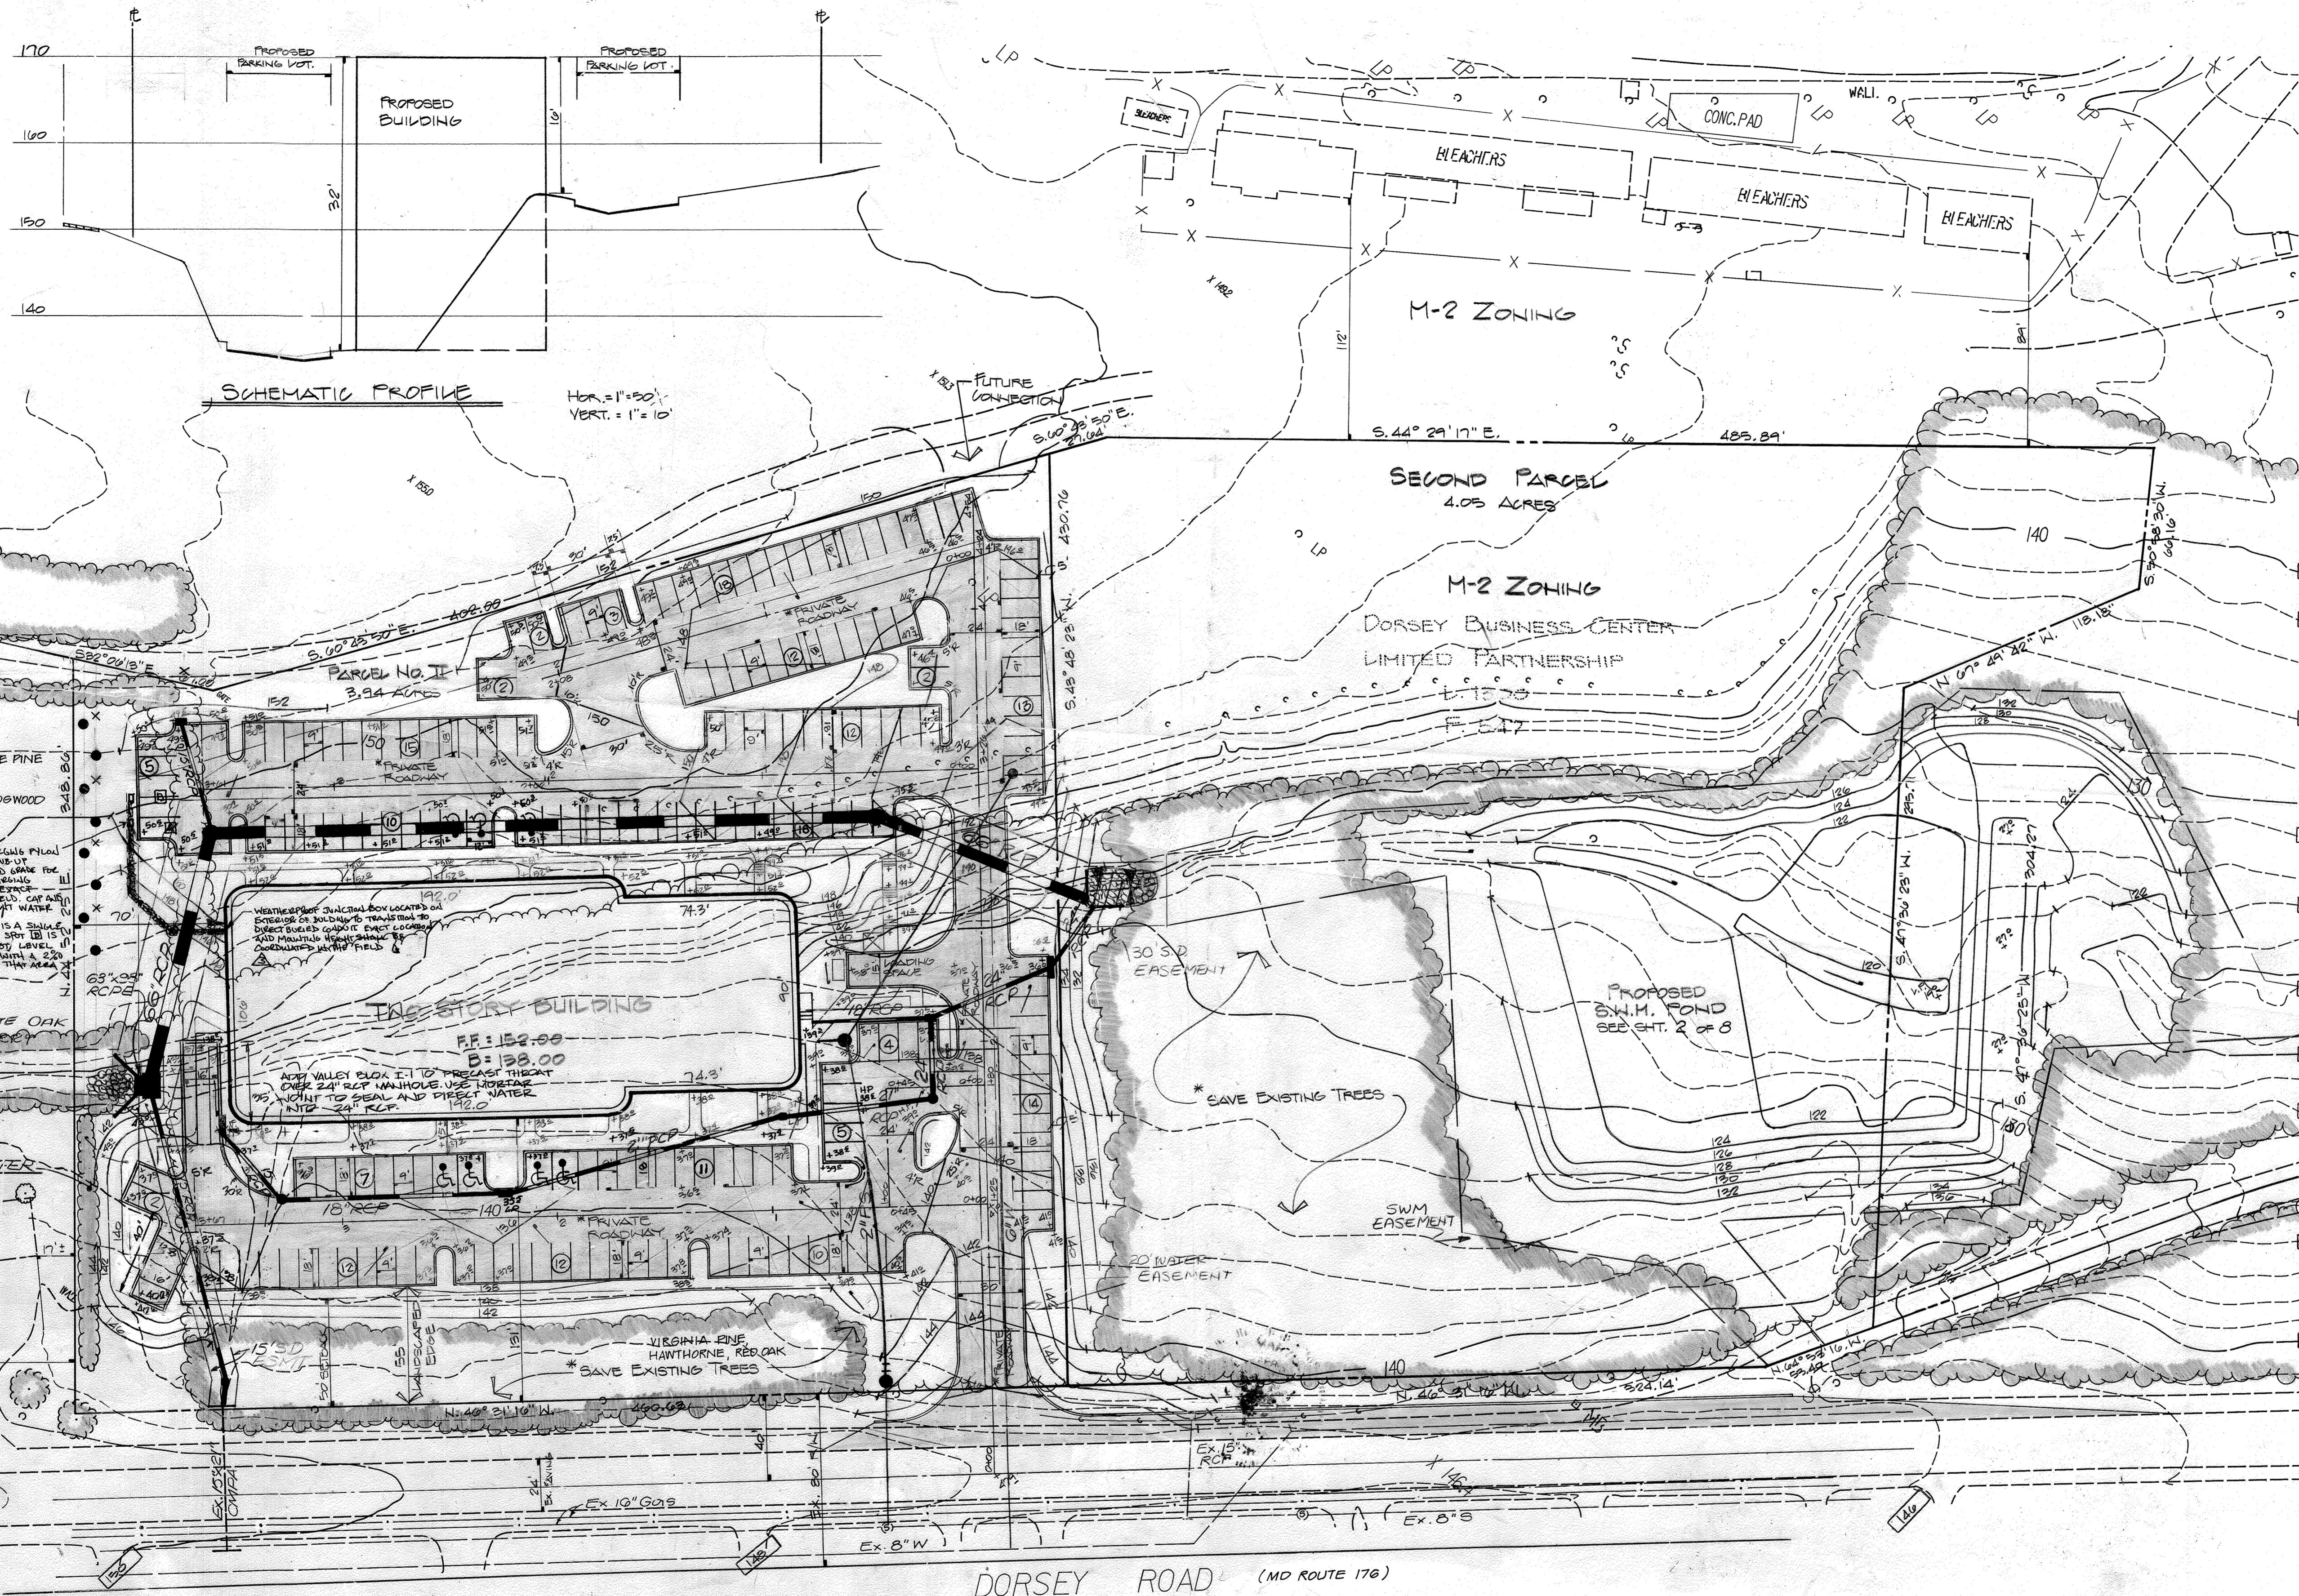

APPROVED  
DIVISION OF LAND DEVELOPMENT &  
ZONING ADMINISTRATION  
HOWARD COUNTY, MARYLAND  
DATE **6-17-85**

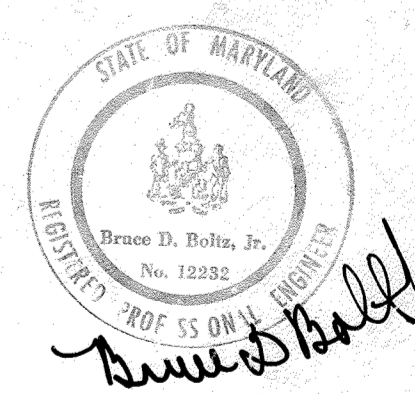

ADDRESS CHART	
LOT NUMBER	STREET ADDRESS
PARCEL II	6717 DORSEY ROAD

SUBDIVISION NAME	SECT./AREA	LOT/PARCEL #
DORSEY BUSINESS CENTER		PARCEL 2
PLAT # OR L/F	BLOCK #	ZONE
415 / 272	24	M-2
TAX / ZONE MAP	ELEC. DIST.	CENSUS TR.
07	1	6012
WATER CODE	SEWER CODE	

APPROVED: For Public Water, Public Sewerage & Storm Drainage Systems and Public Roads  
HOWARD COUNTY DEPT. OF PUBLIC WORKS  
Director: [Signature]  
Date: 7-29-85

APPROVED: For Public Water & Public Sewerage Systems  
HOWARD COUNTY HEALTH DEPARTMENT  
County Health Officer: [Signature]  
Date: 7/29/85

APPROVED: HOWARD COUNTY OFFICE OF PLANNING & ZONING  
Planning Director: [Signature]  
Date: 7-30-85

**OWNER:**  
DORSEY BUSINESS CENTER LTD. PARTNERSHIP  
7223 PARKWAY DRIVE  
HANOVER, MARYLAND 21076  
PHONE: (301) 796-4446

No.	REVISION	DATE	BY
1)	REVISED HANDICAP PARKING SPACE LOCATIONS	6-27-85	JEB
2)	ADDED LOADING DOCK; REVISED PARKING	8-14-85	NWC
3)	ADDED ELECTRIC VEHICLE CHARGING STATIONS	11-7-22	NAA




**GREENHORNE & O'MARA, INC.**  
ENGINEERS • ARCHITECTS • PLANNERS • SURVEYORS  
2 RESEARCH PLACE  
ROCKVILLE, MD.  
(301) 948 - 0900  
20850  
GREENBELT, MD • ANNAPOLIS, MD • FAIRFAX, VA • NO. HUNTINGDON, PA


SITE DEVELOPMENT PLAN  
**DORSEY BUSINESS CENTER**  
PARCEL II  
ELECTION DISTRICT # 1 HOWARD COUNTY, MARYLAND

JEB DESIGN	SCALE 1" = 40'
JEB/LSD DRAWN	1 OF 9
RHM CHECKED	SHEET
JEB/BS DATE	JOB No. R-1114-X FILE No.



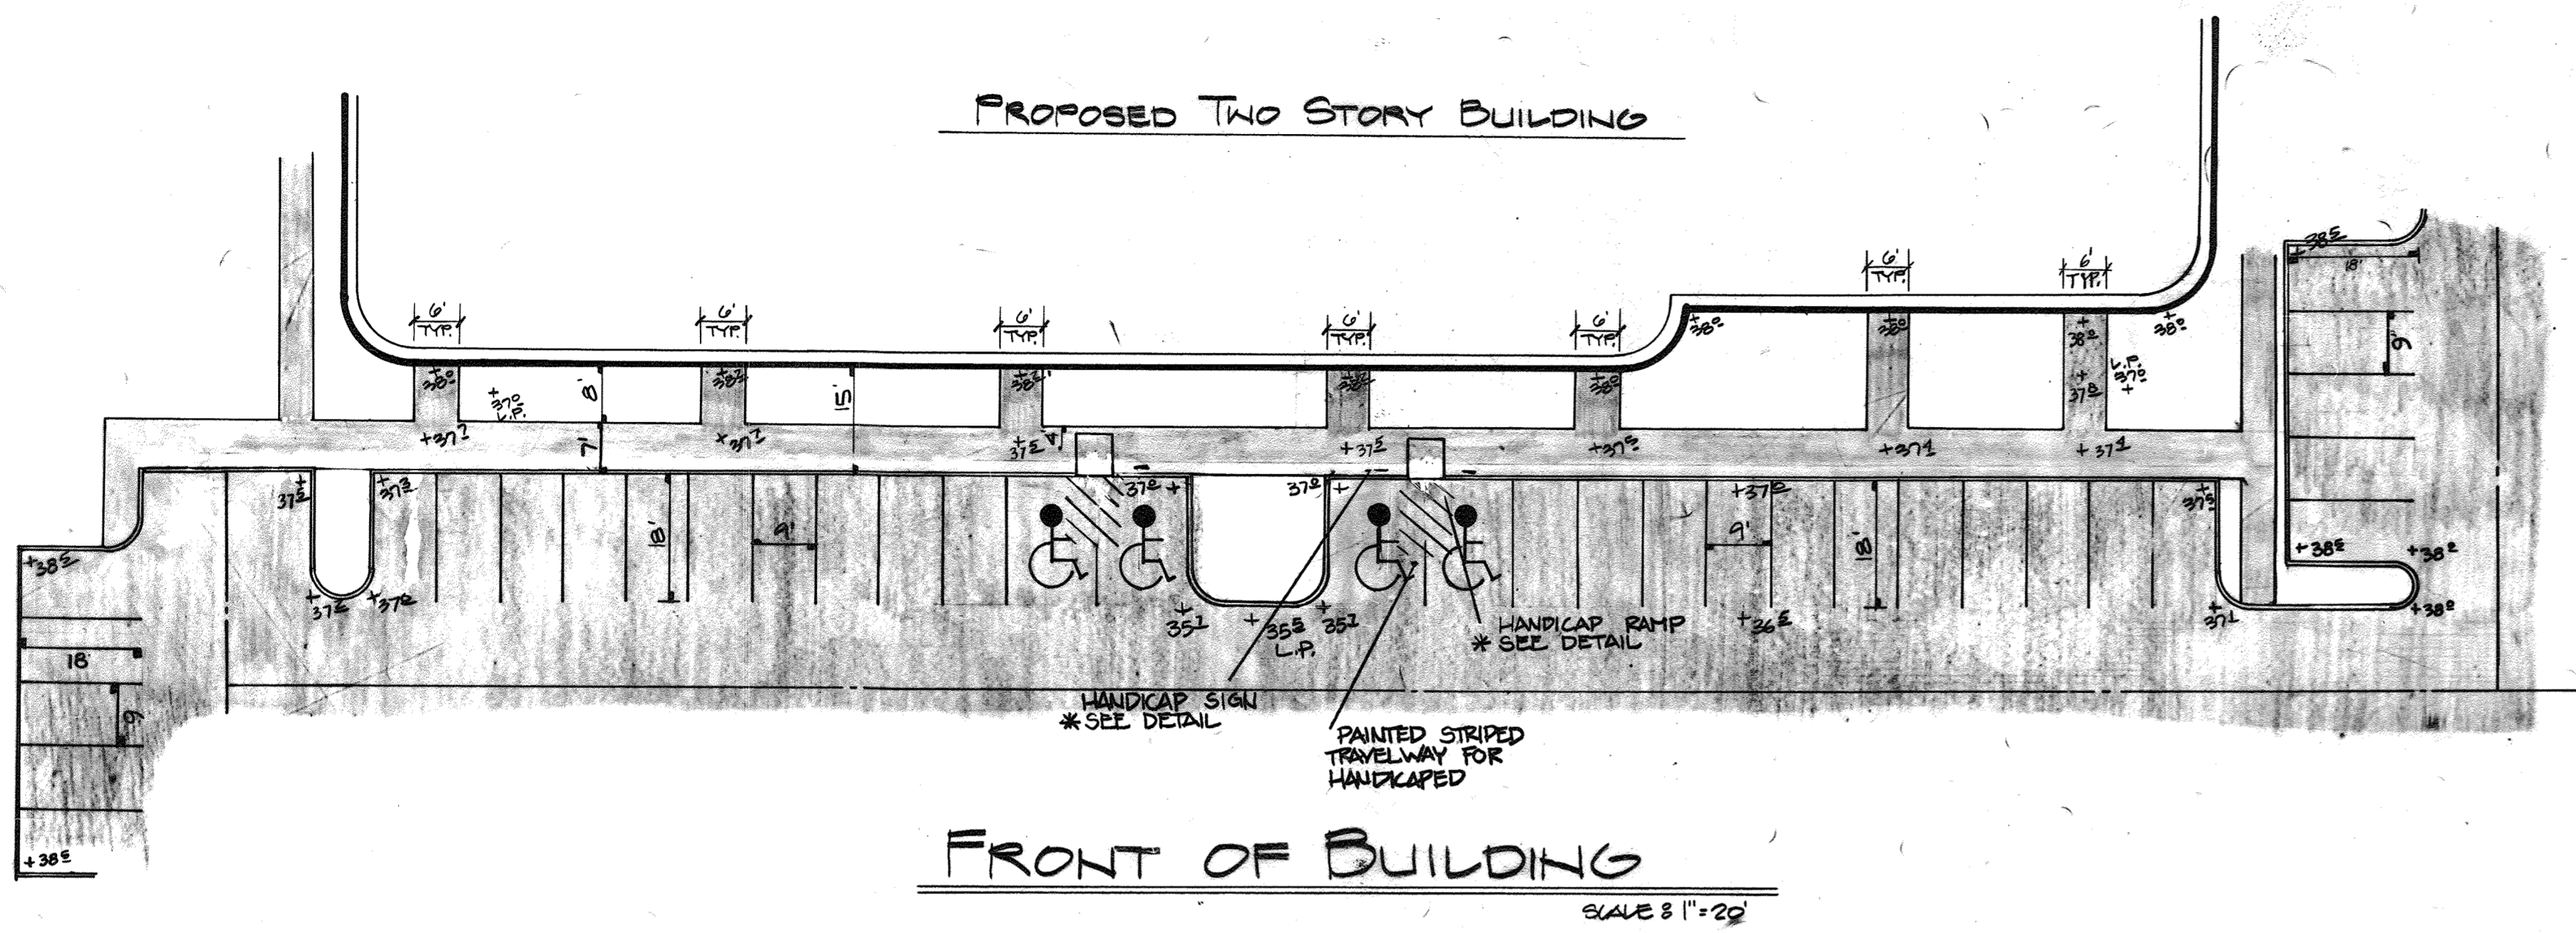

FRONT OF BUILDING  
SCALE: 1" = 20'

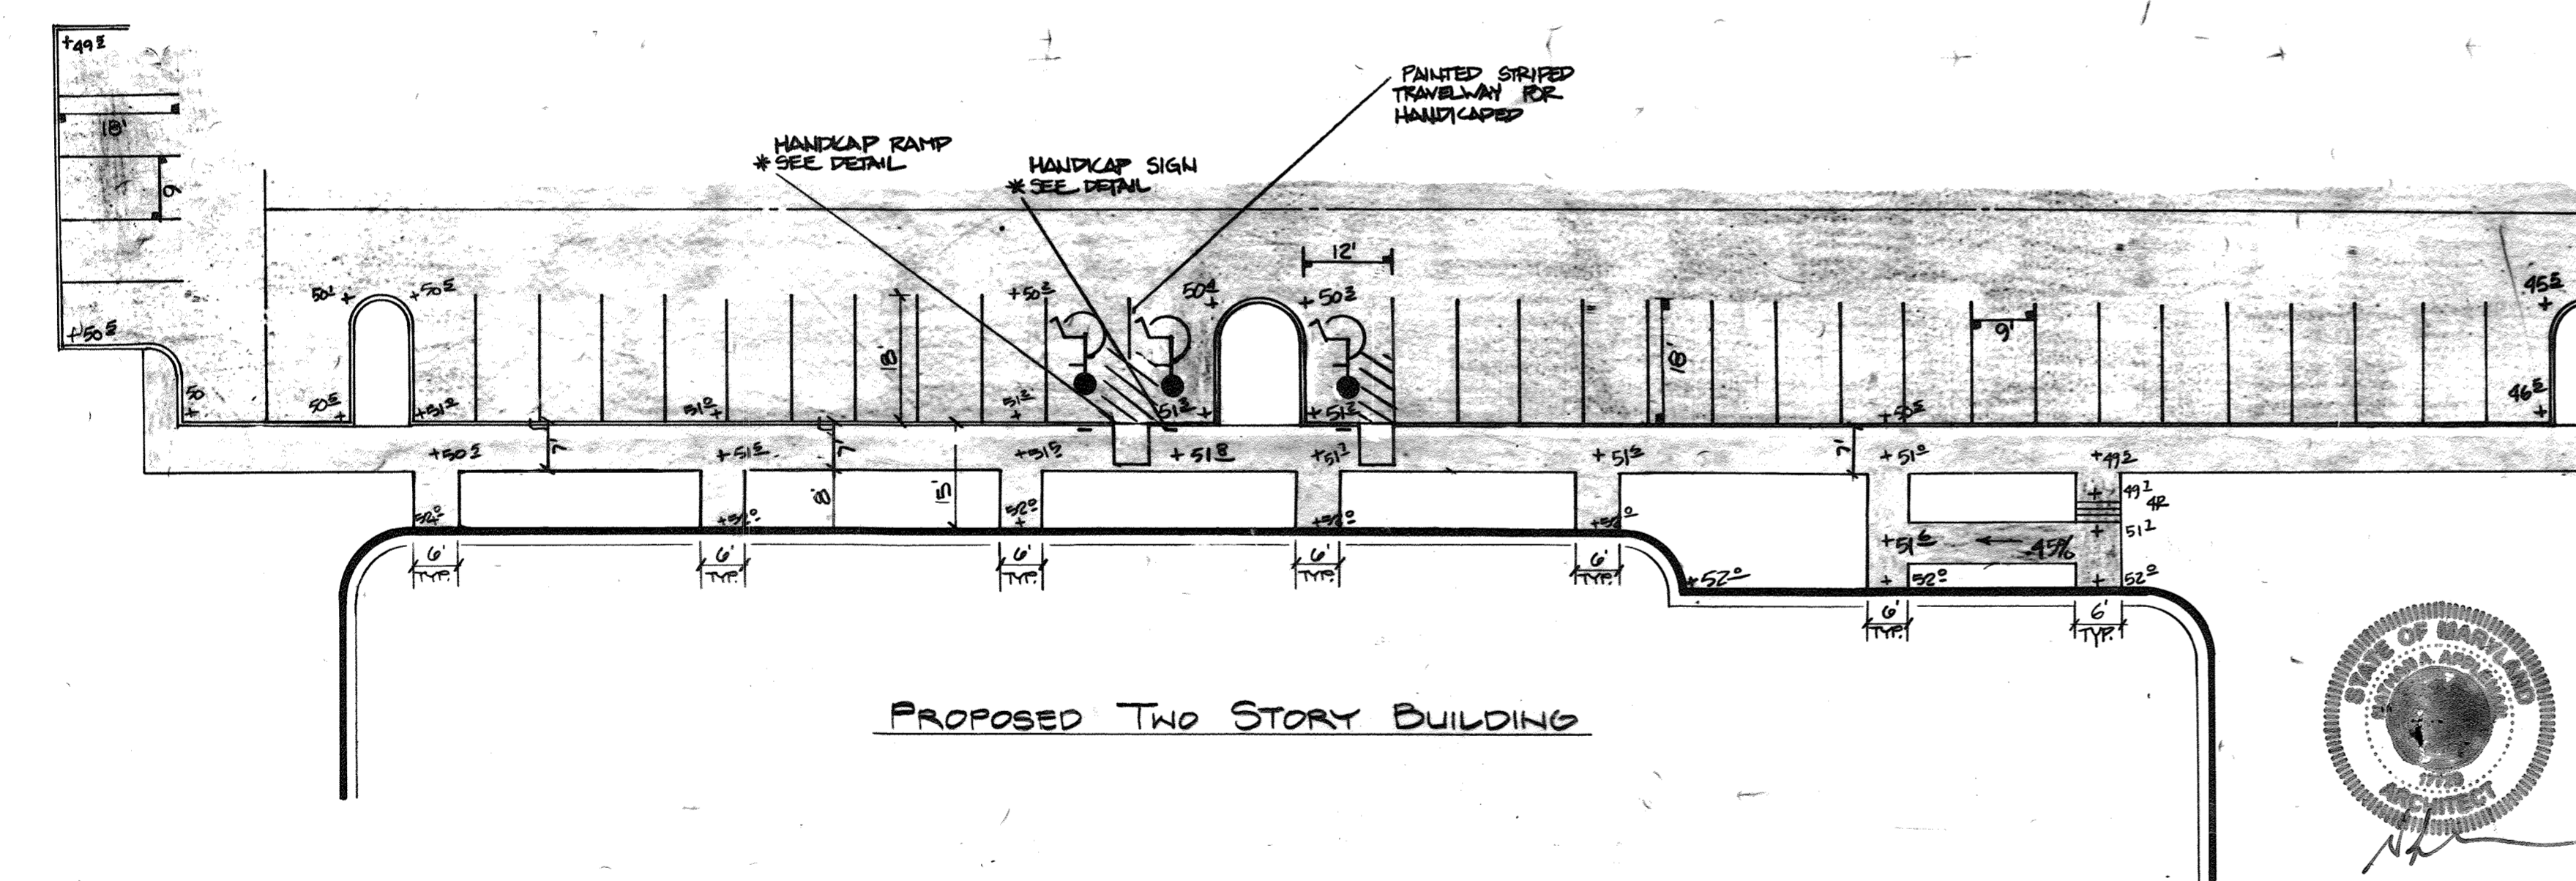


REAR OF BUILDING  
SCALE: 1" = 20'

- \* NOTES:**
- 1) ALL REFERENCED MATERIAL WAS TAKEN FROM:  
- ST. OF MD. STANDARD HIGHWAY SIGNS BOOKLET  
- MD. DEPT. OF TRANSPORTATION,  
P.O. BOX 717  
707 NORTH CALVERT ST.  
BALTIMORE, MD. 21203
  - 2) STANDARD COLORS  
- LEGEND & BORDER - GREEN  
- WHITE SYMBOL ON BLUE BACKGROUND  
- BACKGROUND - WHITE
  - 3) ONE SIGN IS REQUIRED FOR EACH PARKING SPACE




HANDICAP SIGN DETAIL  
NOT TO SCALE


- 1) "RESERVED PARKING" SIGN SETS INCLUDE A 12" X 18" "RESERVED PARKING" SIGN WITH A 12" X 6" SUPPLEMENTAL SIGN DESIGNATING THE FINE BELOW IT. THE ADDITIONAL SIGN INTENDED TO RESERVE THE PARKING SPACE ONLY FOR PERSONS WITH AN OFFICIAL PERMIT OR HANDICAP PLATE SHOULD BE NO LOWER THAN 7'-0".
- 2) NORMAL MOUNTING OF SIGN(S) OR SET(S) OF SIGNS SHALL BE ON A STEEL POST PLACED IN THE GROUND ADJACENT TO THE PARKING SPACE. THE BOTTOM OF THE SIGN OR SET SHALL BE SEVEN FEET SIX INCHES ABOVE THE GRADE IN THE PARKING SPACE. THE SUPPLEMENTAL SIGN SHOULD BE NO LOWER THAN 7'-0".
- 3) NORMAL MOUNTING OF SIGN(S) OR SET(S) OF SIGNS SHALL BE ON A STEEL POST PLACED IN THE GROUND ADJACENT TO THE PARKING SPACE.

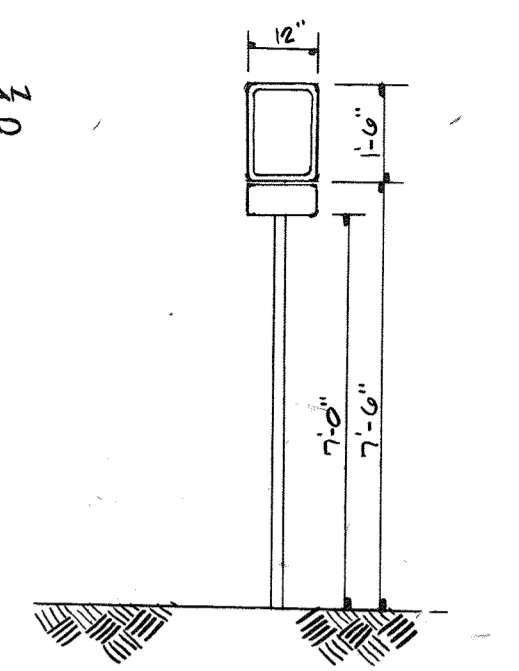


TYPICAL HANDICAP SIGN DETAIL  
NOT TO SCALE

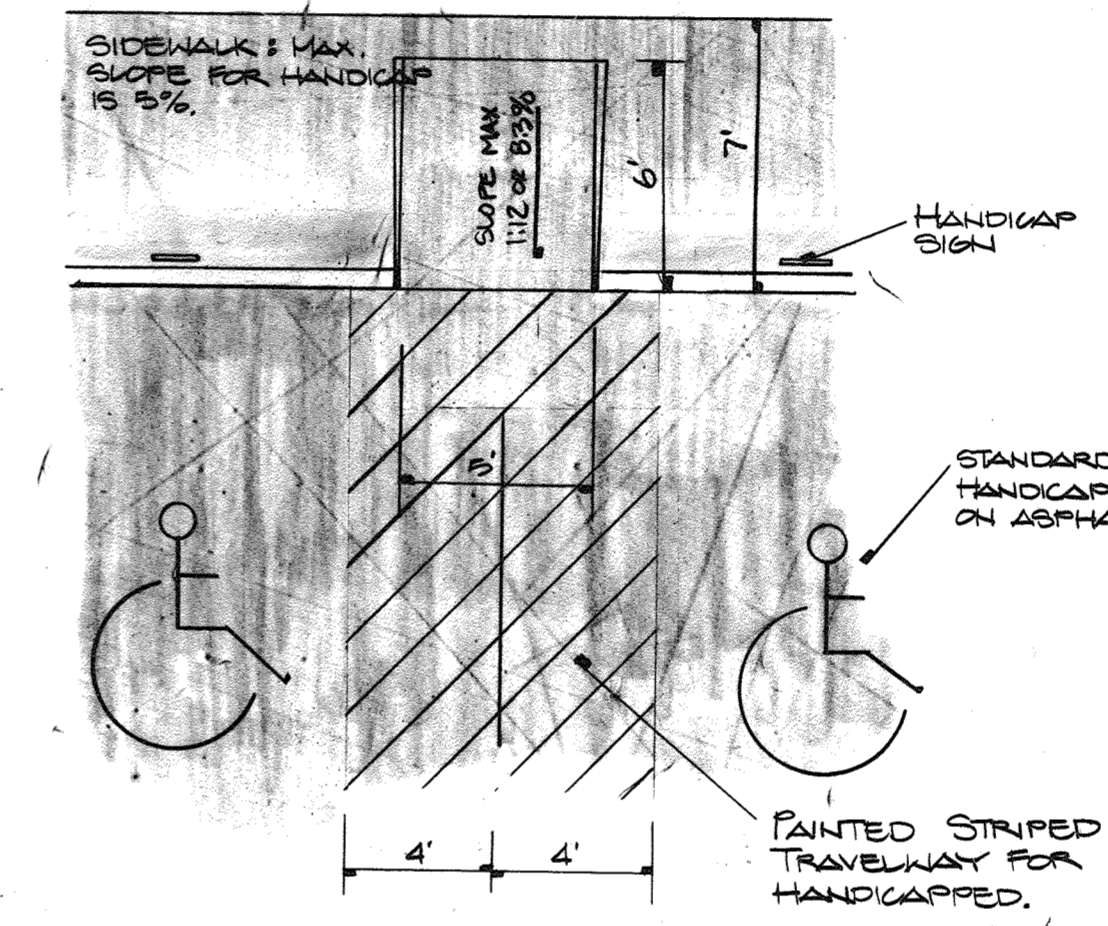

HANDICAP RAMP DETAIL  
NOT TO SCALE

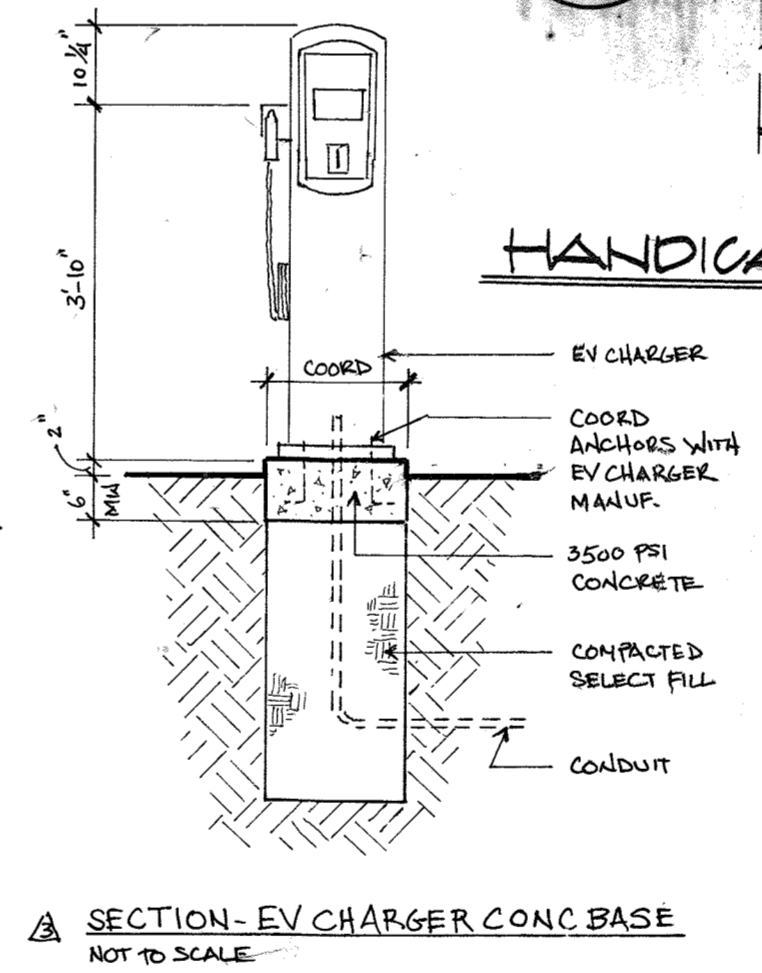


SECTION - EV CHARGER CONC. BASE  
NOT TO SCALE

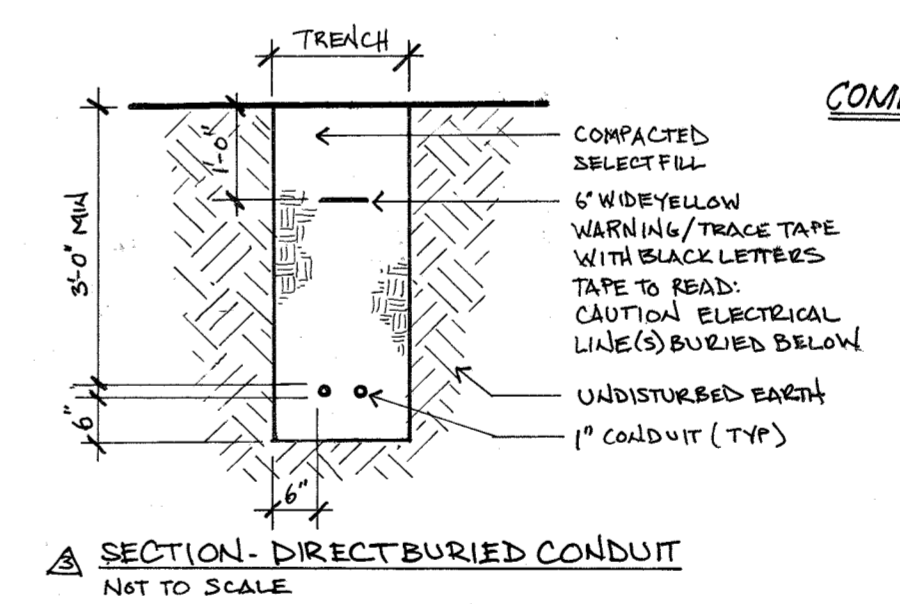


SECTION - DIRECT-BURIED CONDUIT  
NOT TO SCALE


TYPICAL PAVING SECTION (HCBPW P2)

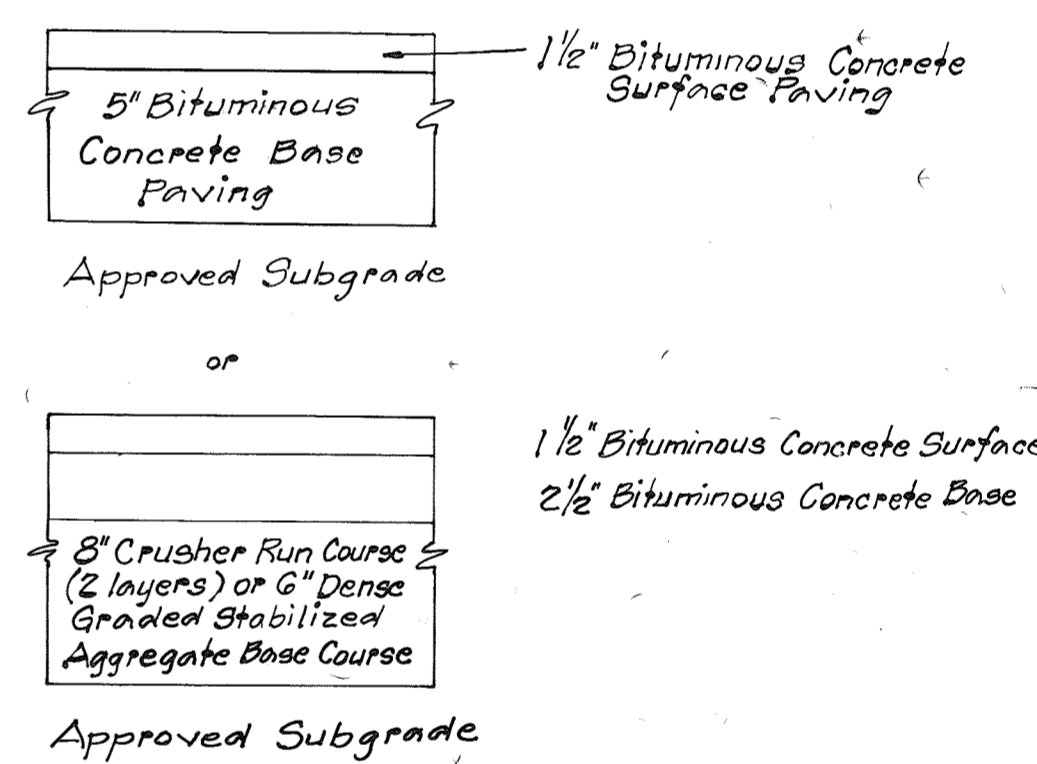


COMBINATION CURB & GUTTER DETAIL (HCDPW R-3.01)

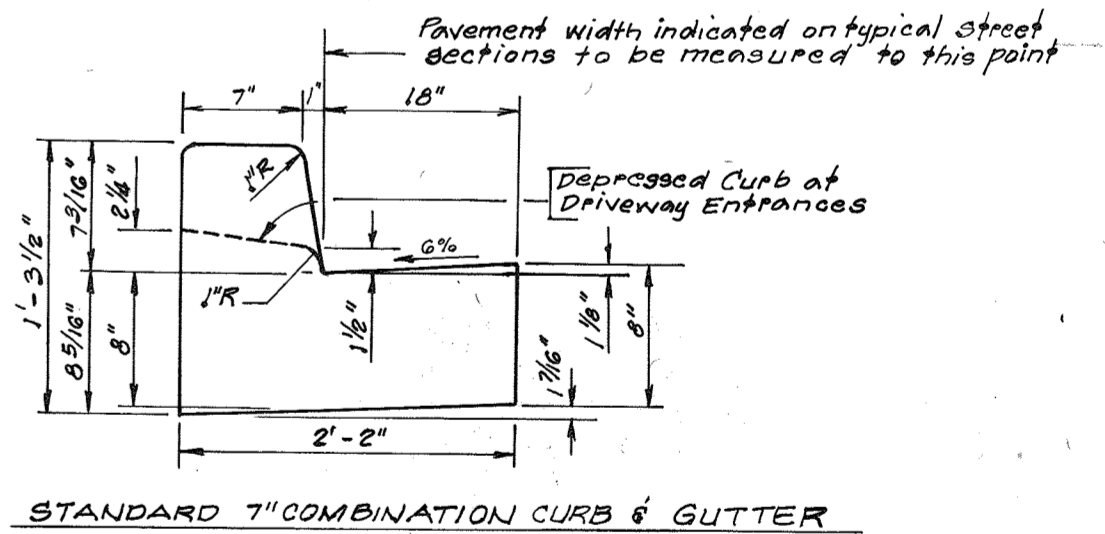

STANDARD 7" COMBINATION CURB & GUTTER

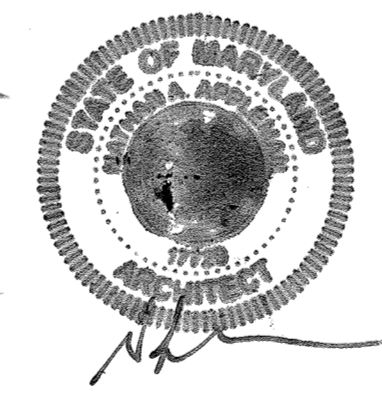

APPROVED  
DIVISION OF LAND DEVELOPMENT &  
ZONING ADMINISTRATION  
HOWARD COUNTY, MARYLAND  
DATE: 6-17-85  
JMM

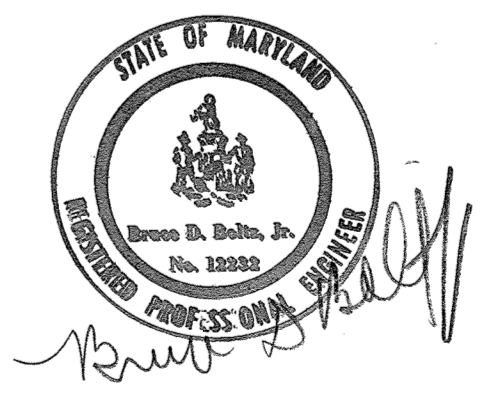


APPROVED: FOR PUBLIC WATER, PUBLIC SEWERAGE & STORM DRAINAGE SYSTEMS & PUBLIC ROADS  
HOWARD COUNTY DEPT. OF PUBLIC WORKS  
DIRECTOR: [Signature] DATE: 7-29-85  
CHIEF, BUREAU OF ENGINEERING: [Signature] DATE: 7-29-85

APPROVED: FOR PUBLIC WATER & PUBLIC SEWERAGE SYSTEMS  
HOWARD COUNTY HEALTH DEPARTMENT  
[Signature] DATE: 7/29/85  
COUNTY HEALTH OFFICER

APPROVED: HOWARD COUNTY OFFICE OF PLANNING & ZONING  
PLANNING DIRECTOR: [Signature] DATE: 7-30-85  
CHIEF, BUREAU OF ENGINEERING & ZONING ADMINISTRATION: [Signature] DATE: 7-30-85

OWNER:  
DORSEY BUSINESS CENTER LTD. PARTNERSHIP  
7823 PARKWAY DRIVE  
HANOVER, MARYLAND 21076  
PHONE: (301) 796-4446

No.	REVISION	DATE	BY
1)	HANDICAP PARKING/ARH SPECS.	5/20/85	JEB
2)	REVISED HANDICAP PARKING SPACE LOCATIONS	6-27-85	JEB
3)	ADDED ELECTRIC VEHICLE CHARGING STATIONS	11-07-82	AAA

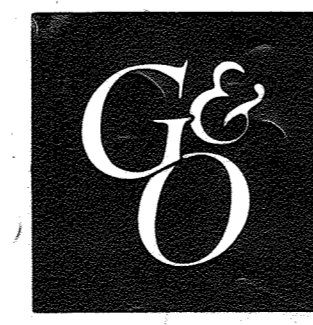


ENGINEERS • ARCHITECTS • PLANNERS • SCIENTISTS • SURVEYORS • PHOTOGRAMMETRISTS  
**GREENHORNE & O'MARA, INC.**  
2 RESEARCH PLACE, ROCKVILLE, MARYLAND 20850  
(301) 948-0900  
GREENBELT, MD • ANNAPOLIS, MD • ATLANTA, GA • BECKLEY, WV • SULPEPER, VA • DENVER, CO  
FAIRFAX, VA • GREENSBORO, NC • MONROE, MI • EXPORT, PA • WILLISTON PARK, NY

**SITE PLAN DETAILS**  
**DORSEY BUSINESS CENTER**  
**PARCEL II**  
ELECTION DISTRICT #1 HOWARD CO., MARYLAND

JEB DESIGN	SCALE: AS SHOWN
JEB DRAWN	2 OF 9
CHECKED SHEET	
DATE: MAY 85	FILE No. R-1114-X
JOB No.	SDP-85-154



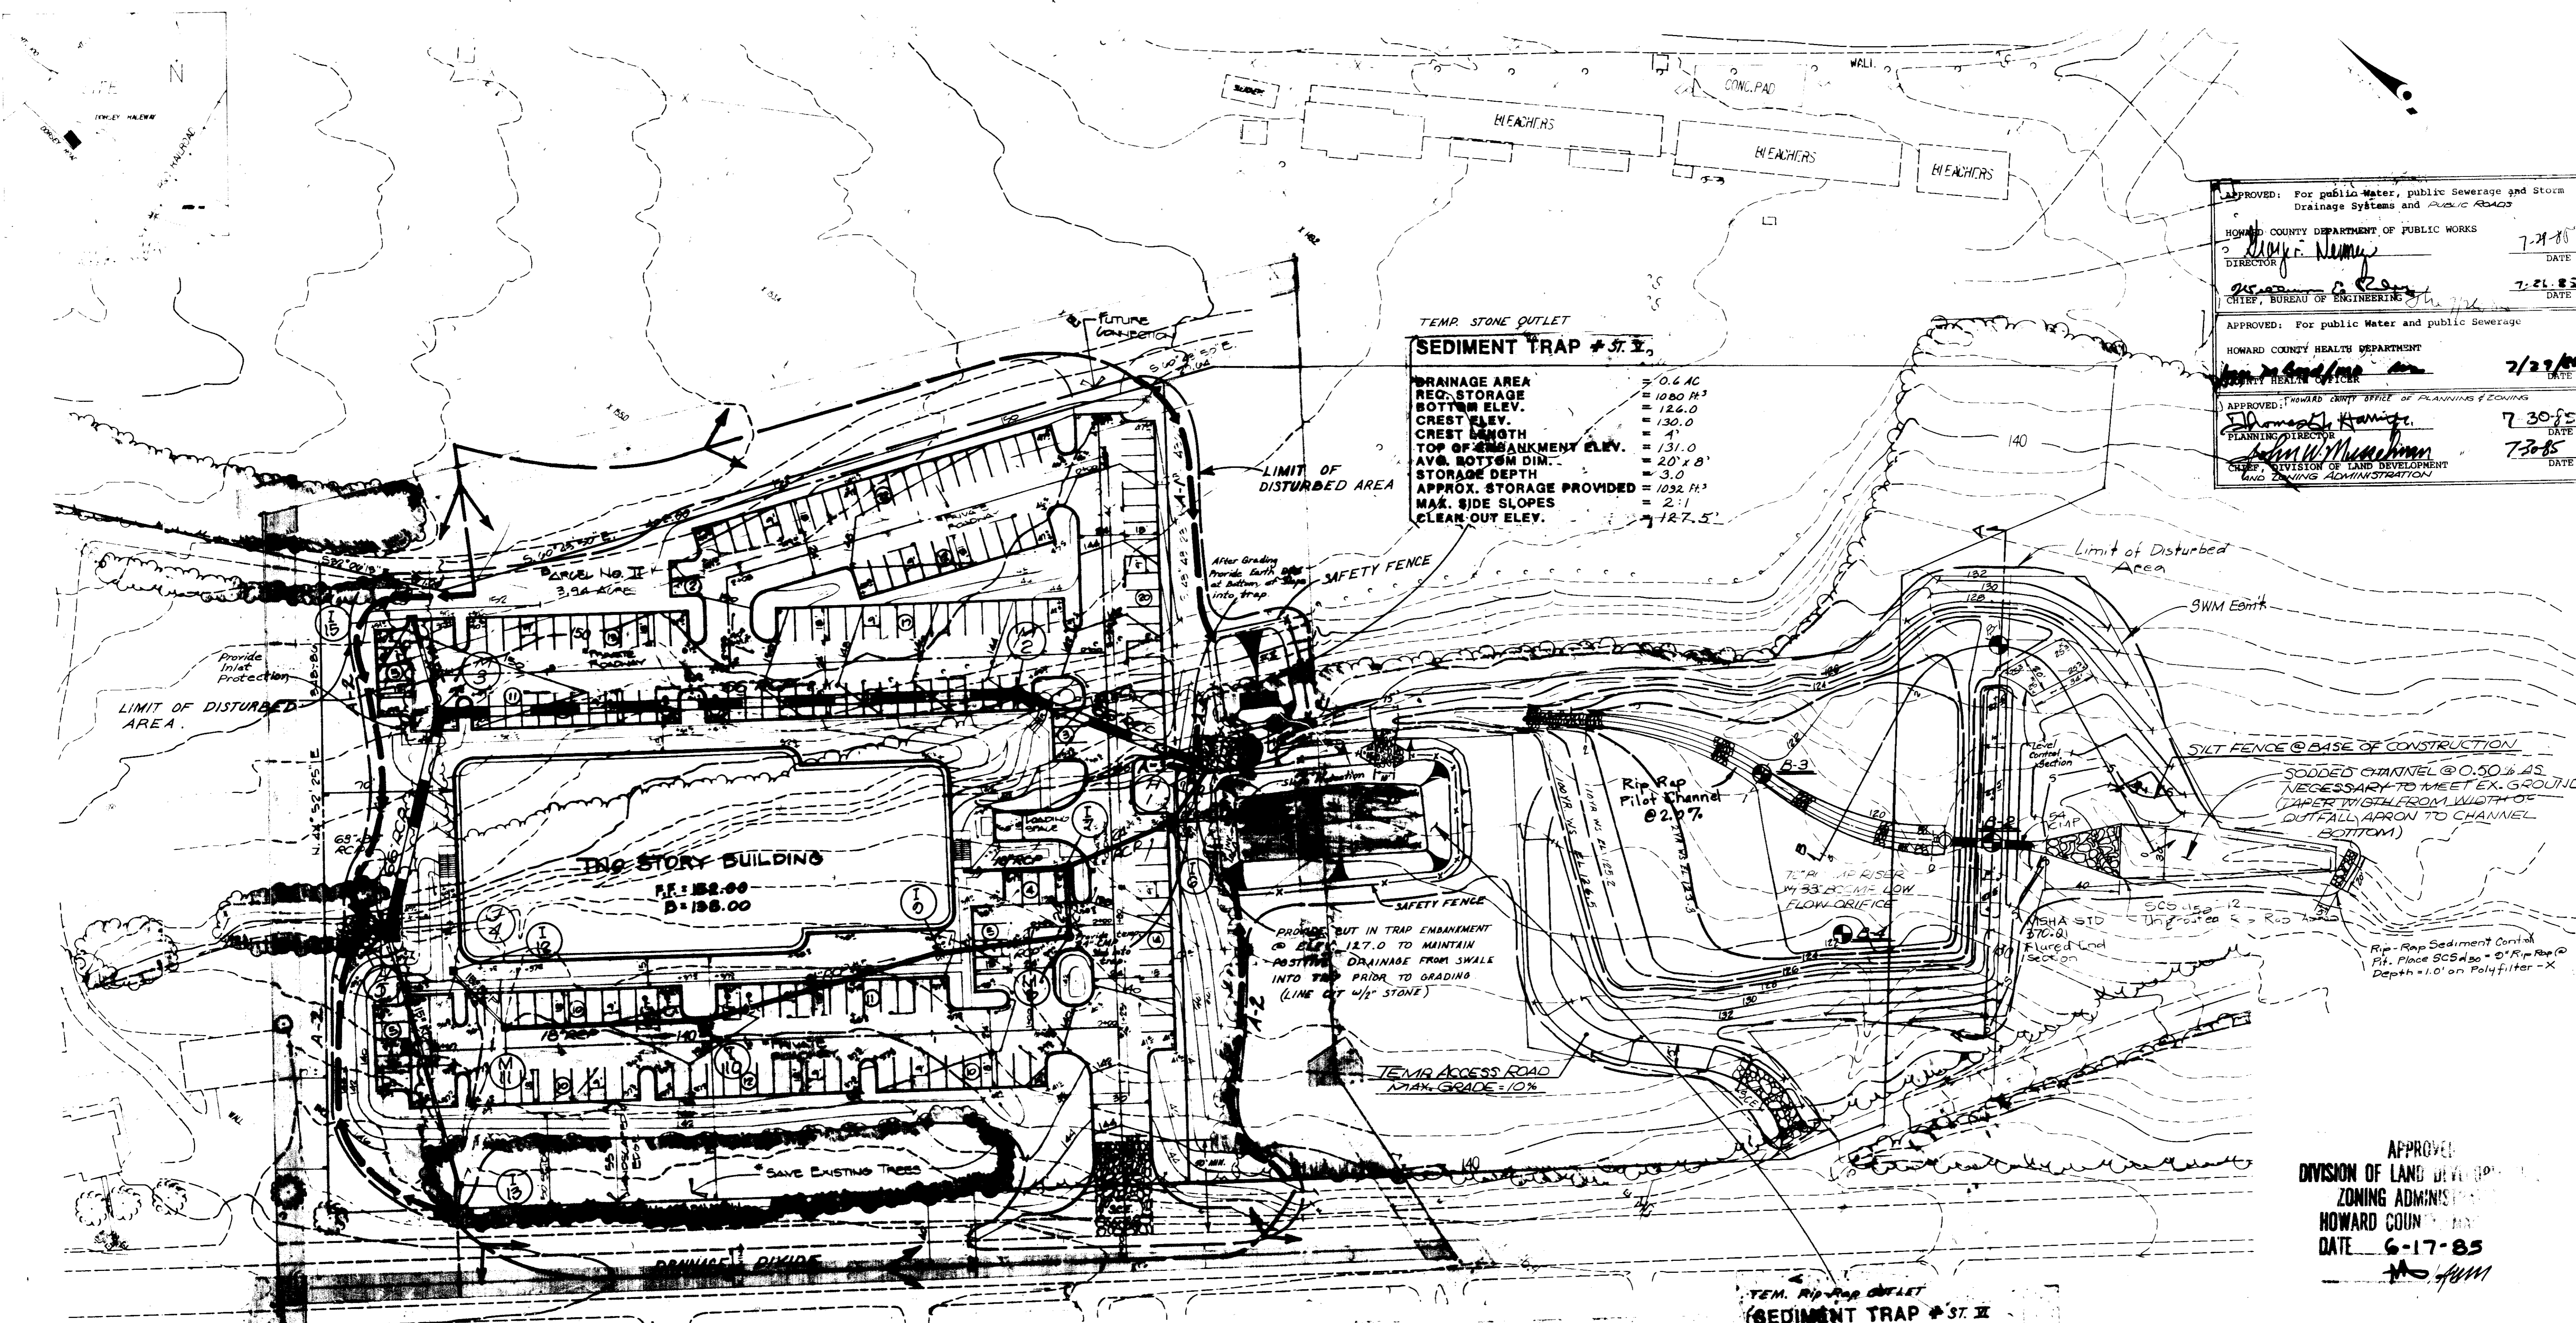

APPROVED: For public Water, public Sewerage and Storm Drainage Systems and PUBLIC ROAD  
 HOWARD COUNTY DEPARTMENT OF PUBLIC WORKS  
 DIRECTOR: *[Signature]* 7-21-85  
 CHIEF, BUREAU OF ENGINEERING  
 APPROVED: For public Water and public Sewerage  
 HOWARD COUNTY HEALTH DEPARTMENT  
 HEALTH OFFICER: *[Signature]* 7-27-85  
 APPROVED: HOWARD COUNTY OFFICE OF PLANNING & ZONING  
 PLANNING DIRECTOR: *[Signature]* 7-30-85  
 CHIEF, DIVISION OF LAND DEVELOPMENT AND ZONING ADMINISTRATION  
 7-30-85

TEMP. STONE OUTLET  
**SEDIMENT TRAP # ST. II**  
 DRAINAGE AREA = 0.6 AC  
 REQ. STORAGE = 1080 H<sup>3</sup>  
 BOTTOM ELEV. = 126.0  
 CREST ELEV. = 130.0  
 CREST LENGTH = 4'  
 TOP OF EMBANKMENT ELEV. = 131.0  
 AVG. BOTTOM DIM. = 20' x 8'  
 STORAGE DEPTH = 3.0  
 APPROX. STORAGE PROVIDED = 1052 H<sup>3</sup>  
 MAX. SIDE SLOPES = 2:1  
 CLEAN-OUT ELEV. = 127.5'


SILT FENCE @ BASE OF CONSTRUCTION  
 SODDED CHANNEL @ 0.50% AS NECESSARY TO MEET EX. GROUND. (TAPER TO 1/8" FROM WIDTH OF DUTFALL APRON TO CHANNEL BOTTOM)

APPROVED  
 DIVISION OF LAND DEVELOPMENT & ZONING ADMINISTRATION  
 HOWARD COUNTY  
 DATE: 6-17-85  
*[Signature]*

THIS SHEET IS NOT FOR SITE GRADING

By the Developer:  
 "I certify that all development and/or construction will be done according to these plans, and that any responsible personnel involved in the construction project will have a Certificate of Attendance from the Department of Public Works, approved Training Program for the Control of Sediment and Erosion before beginning the project. I will provide the Howard Soil Conservation District with an "as-built" plan of the work within 30 days of completion."  
*[Signature]* 7/21/85

By the Engineer:  
 "I certify that this plan for pond construction, erosion and sediment control is a practical and workable plan based on the best available information of the site conditions. This plan was prepared in accordance with the requirements of the Howard Soil Conservation District. I have certified the design to the best of my knowledge and belief. The design was prepared in accordance with the Howard Soil Conservation District's plan of the pond within 30 days of completion."  
*[Signature]* 7/21/85  
 BRUCE D. BOLTZ  
 M.O. RE. NO. 12282

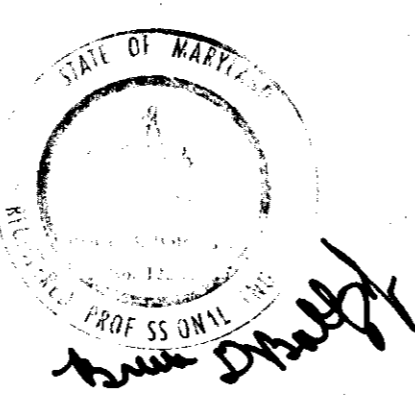

These plans have been reviewed for the Howard Soil Conservation District and meet the technical requirements for small pond construction, soil erosion and sediment control.  
*[Signature]* 7/21/85  
 Date  
 Howard Soil Conservation District

TEMP. RIP RAP OUTLET  
**SEDIMENT TRAP # ST. II**  
 DRAINAGE AREA = 0.6 AC  
 REQ. STORAGE = 1080 H<sup>3</sup>  
 BOTTOM ELEV. = 126.0  
 CREST ELEV. = 130.0  
 CREST LENGTH = 4'  
 TOP OF EMBANKMENT ELEV. = 131.0  
 AVG. BOTTOM DIM. = 20' x 8'  
 STORAGE DEPTH = 3.0  
 APPROX. STORAGE PROVIDED = 1052 H<sup>3</sup>  
 MAX. SIDE SLOPES = 2:1 (H&V) 1:1 (C&V)  
 CLEAN-OUT ELEV. = 127.5'  
 DEPTH OF FLOW = 2.5'

OWNER:  
 DORSEY BUSINESS CENTER LTD. PARTNERSHIP  
 7223 PARKWAY DRIVE  
 HANOVER, MARYLAND 21076  
 PHONE: (301) 796-4446

NO.	REVISION	DATE	BY
1	STORM DRAIN I.B., H.B., I.I., M.I., J.B., M.B.		
	CORRECTED TO CONFORM WITH STORM DRAIN PLAN	6/23/85	BJT




**GREENHORNE & O'MARA, INC.**  
 ENGINEERS • ARCHITECTS • PLANNERS • SURVEYORS  
 2 RESEARCH PLACE ROCKVILLE, MD.  
 (301) 948-0900 20850  
 GREENBELT, MD • ANNAPOLIS, MD • FAIRFAX, VA • NO. HUNTINGDON, PA

STORMWATER MANAGEMENT AND SEDIMENT CONTROL PLAN  
**DORSEY BUSINESS CENTER**  
 PARCEL "II"  
 ELECTION DISTRICT # 1 HOWARD COUNTY, MARYLAND


JSL DESIGN	SCALE 1" = 40'
M DRAWN	3 OF 3
RHM CHECKED	SHEET
Mar. 85 DATE	R-X
JOB No.	FILE No.

SDP-85-154




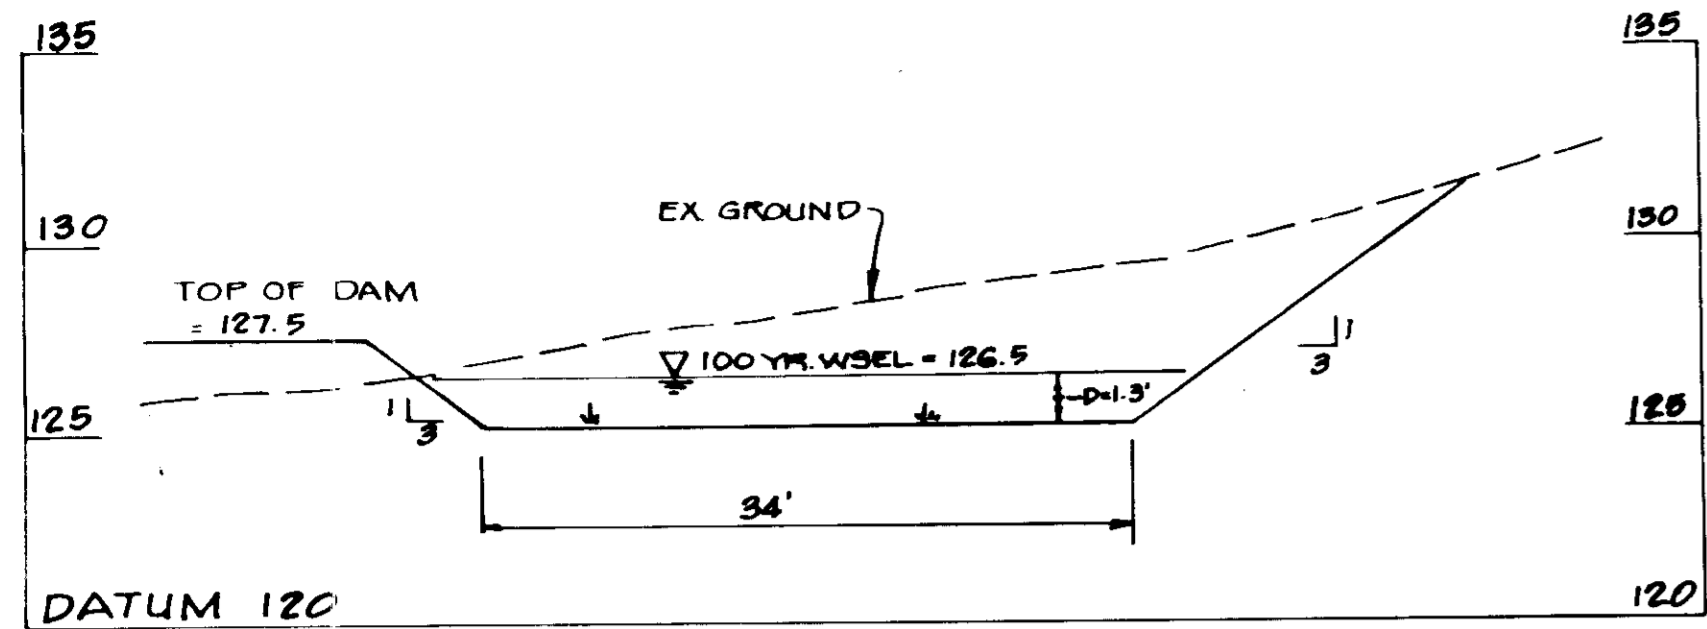

**CROSS SECTION EMERGENCY SPILLWAY**  
SCALE HORIZ 1" = 10'  
VERT 1" = 5'

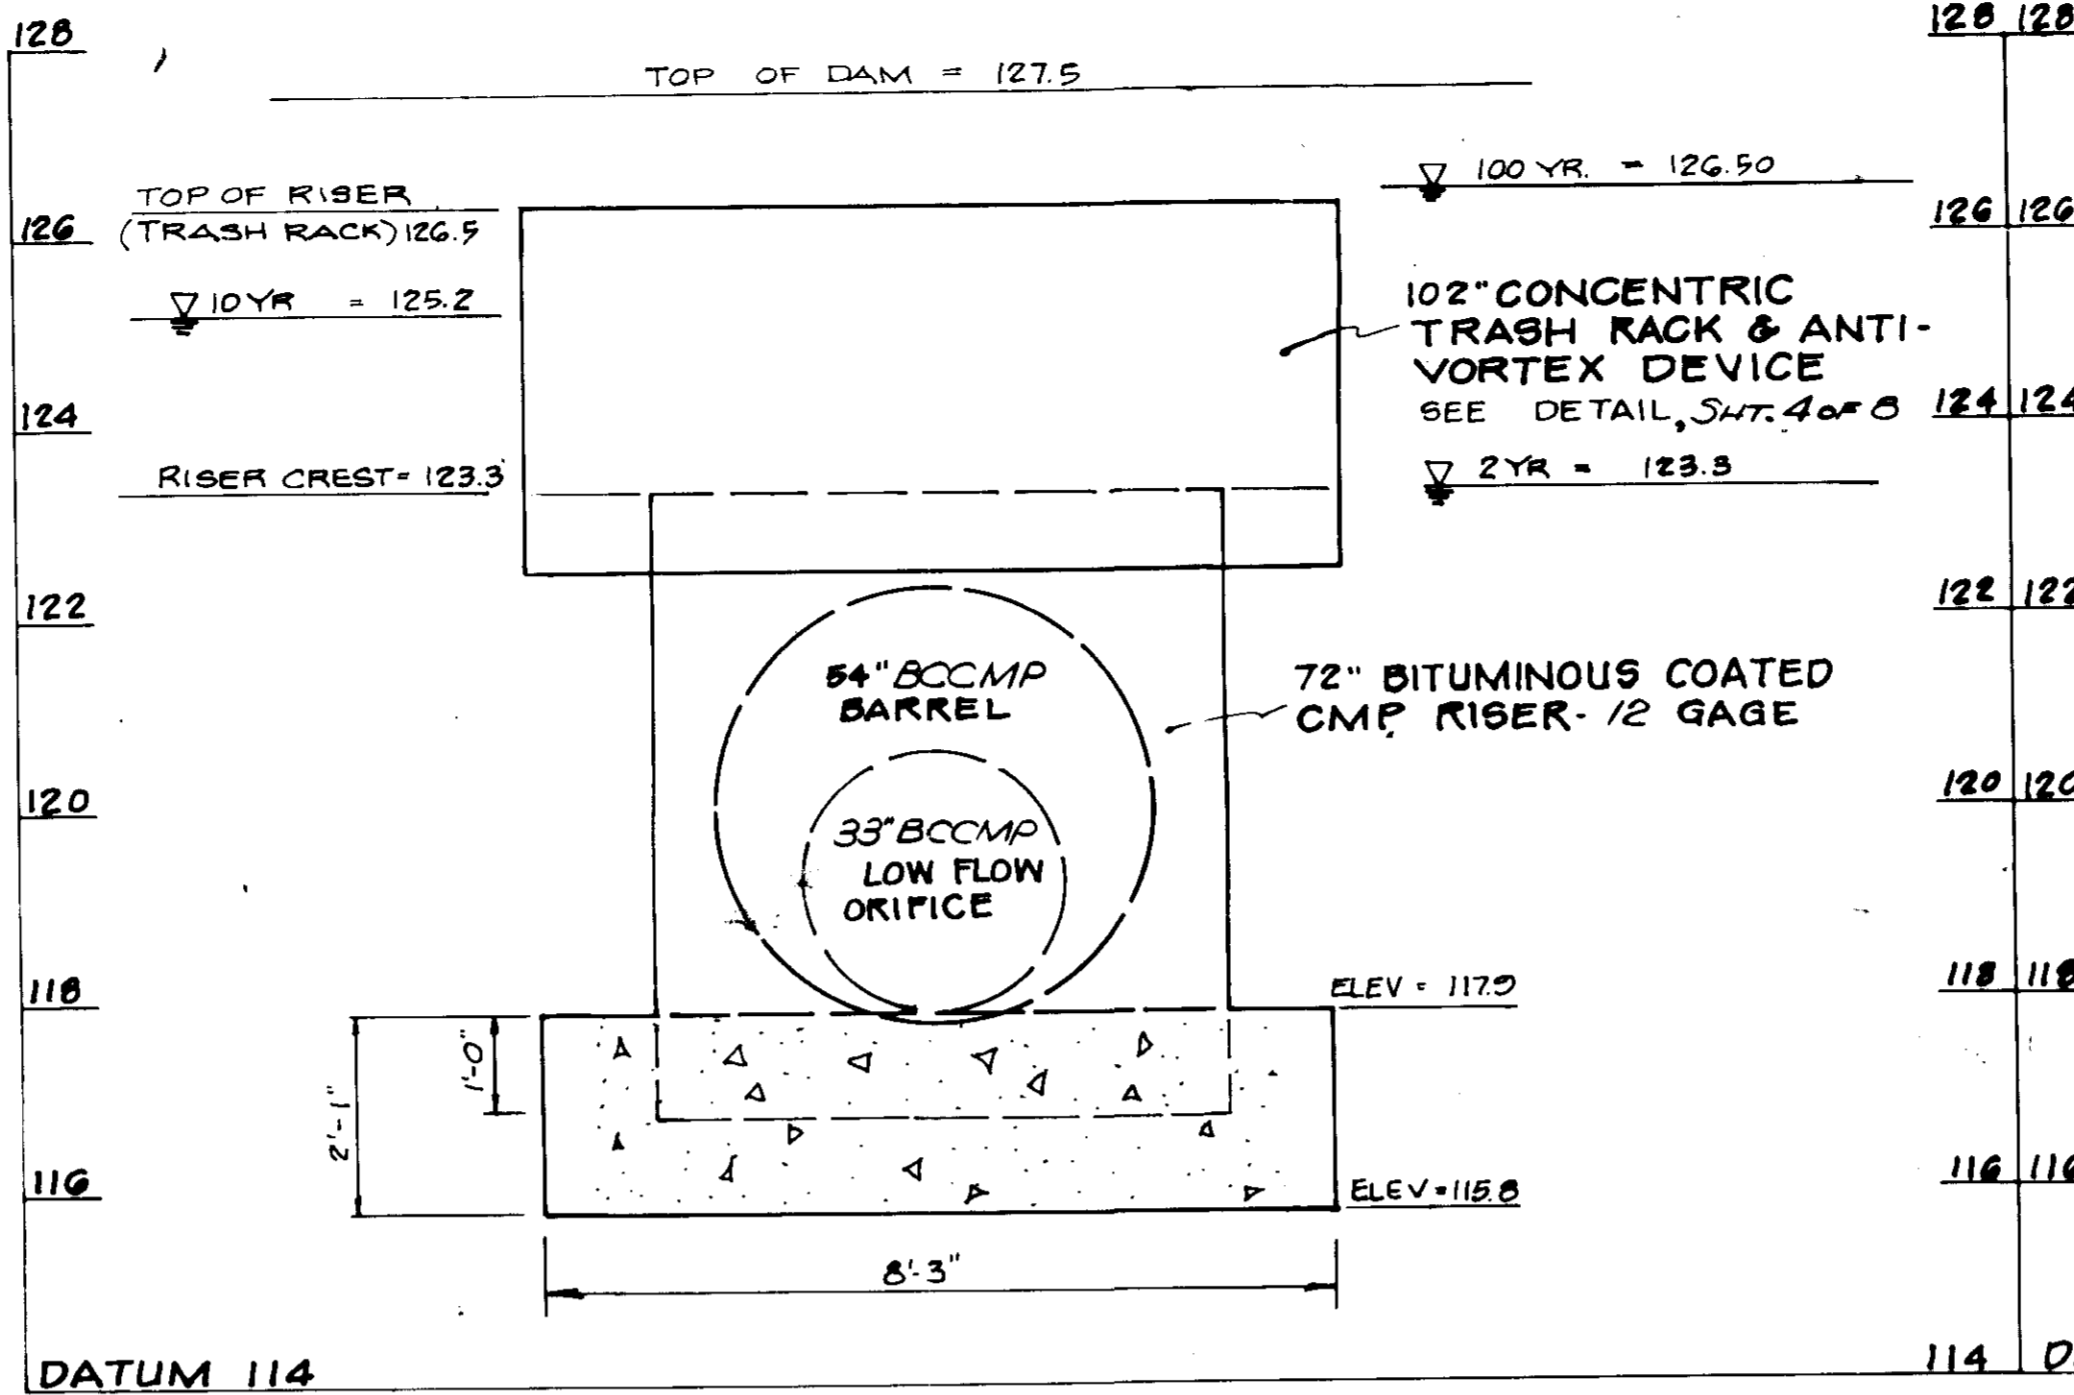


**FRONT VIEW**

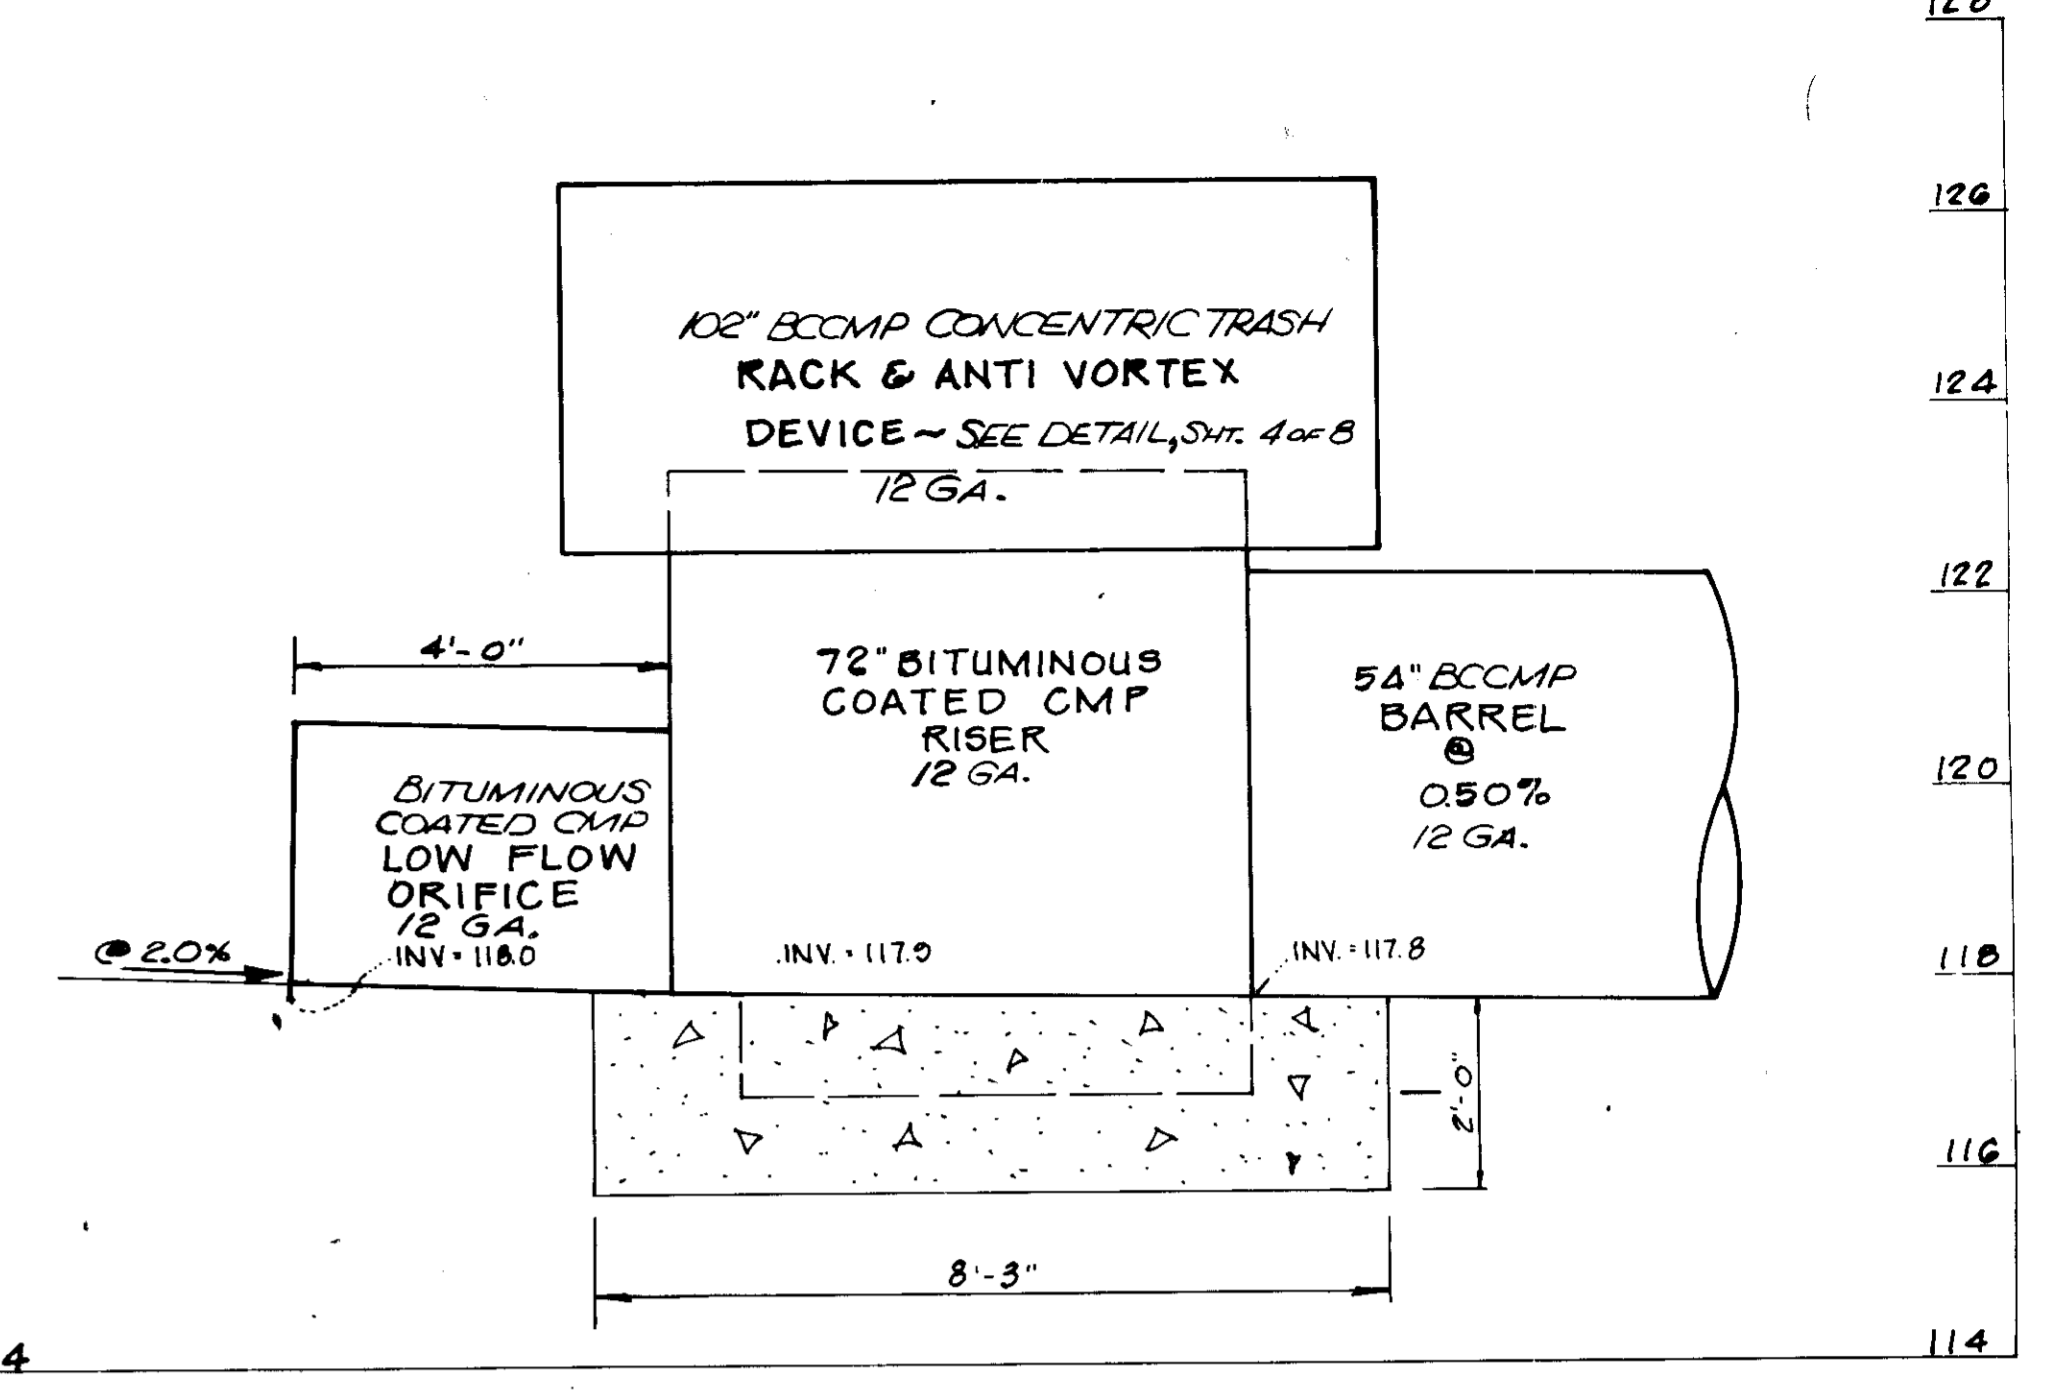


**SIDE VIEW**

**DETAIL - RISER STRUCTURE**


SCALE: 1" = 2'

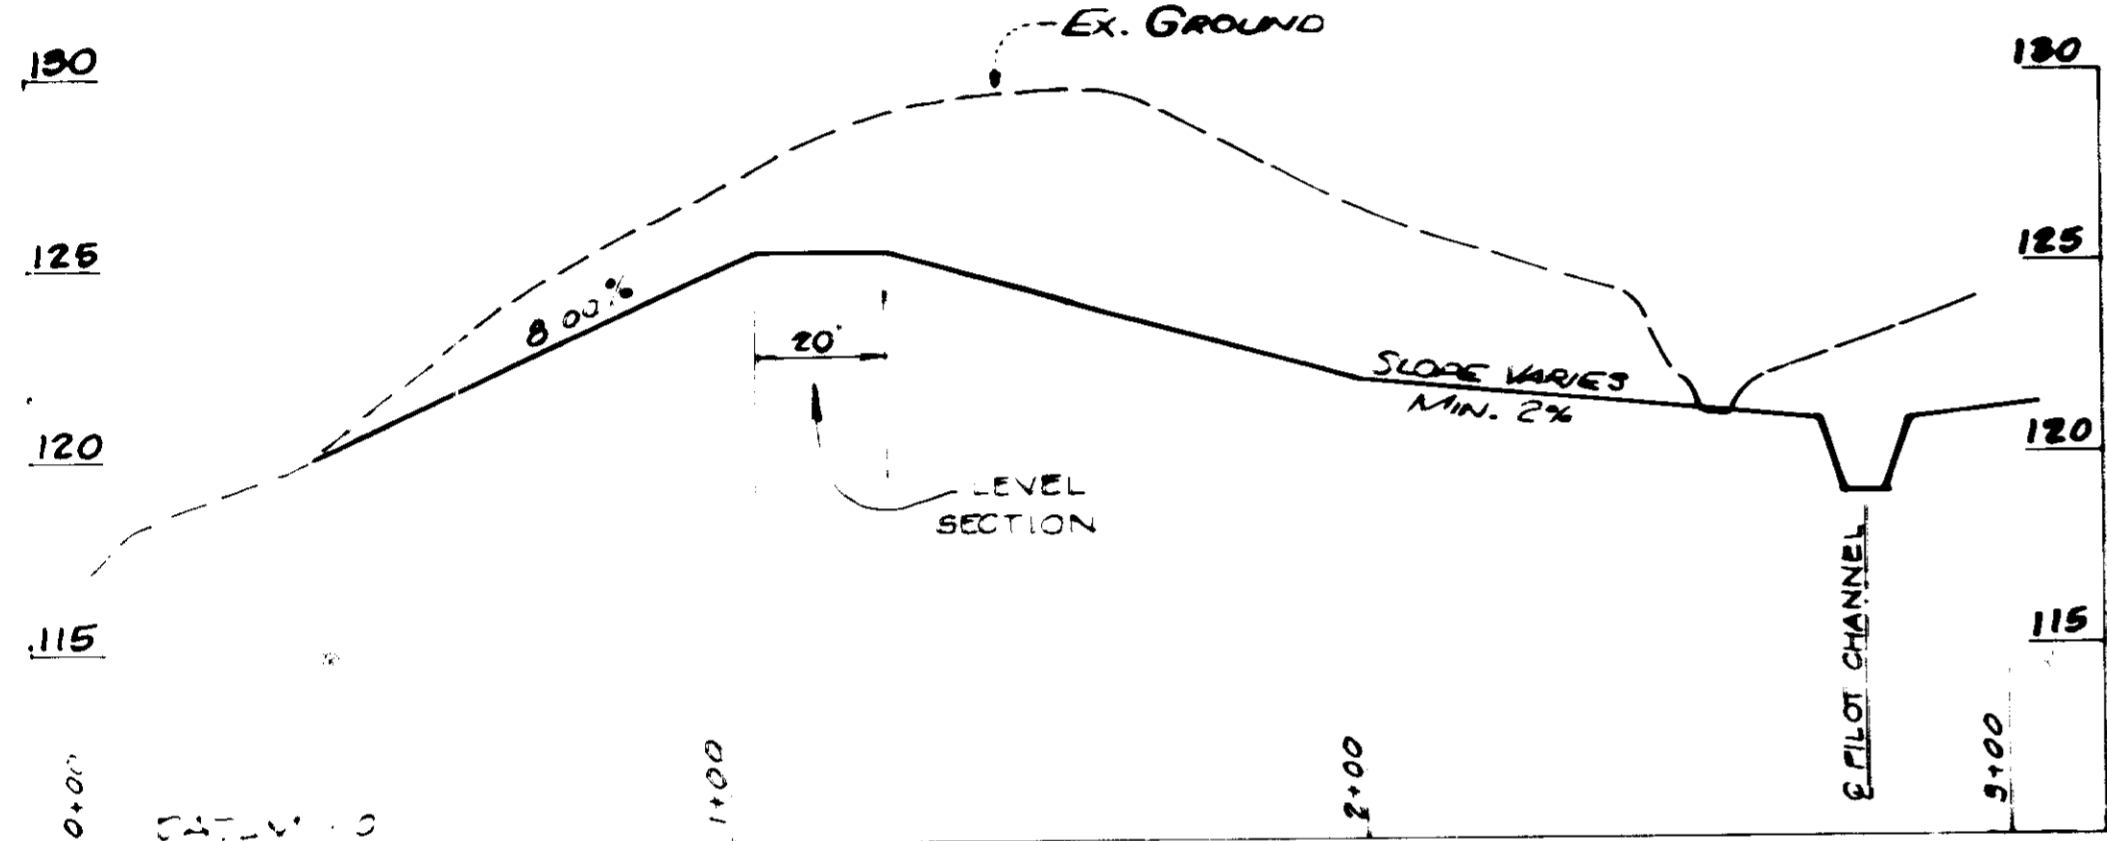


**SECTION B-B THRU EMERGENCY SPILLWAY**  
SCALE HORIZ 1" = 20'  
VERT 1" = 5'

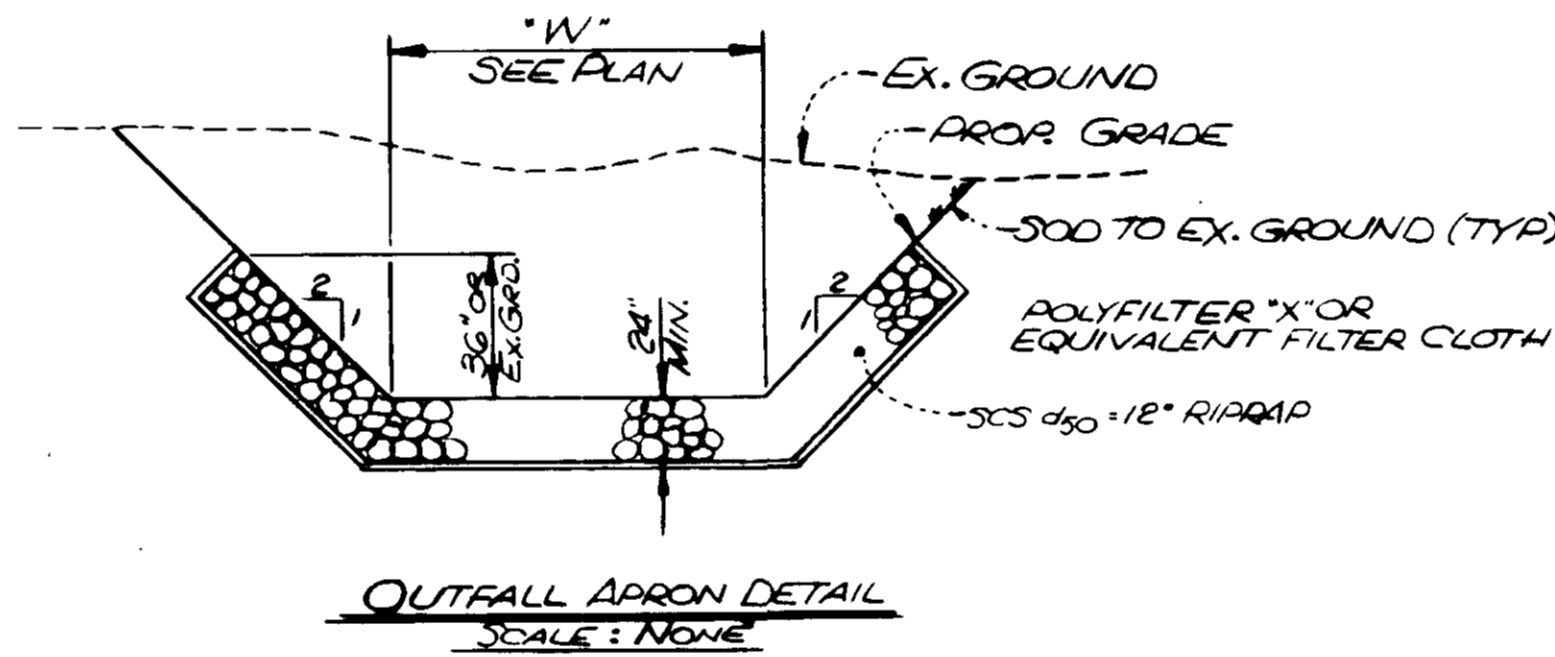

**OUTFALL APRON DETAIL**  
SCALE: NONE

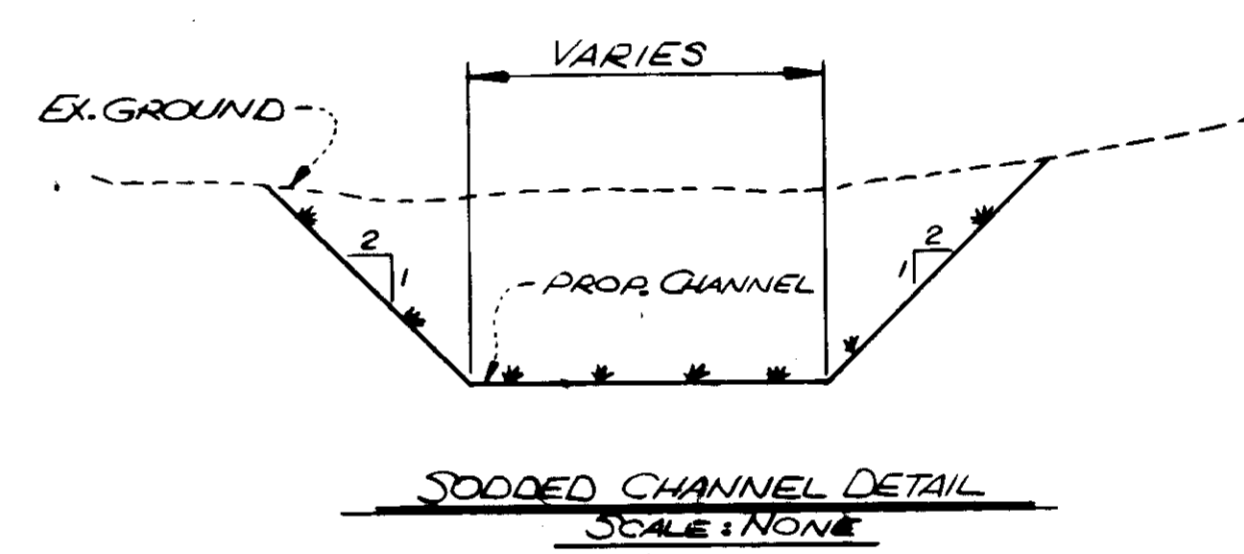

**SODDED CHANNEL DETAIL**  
SCALE: NONE

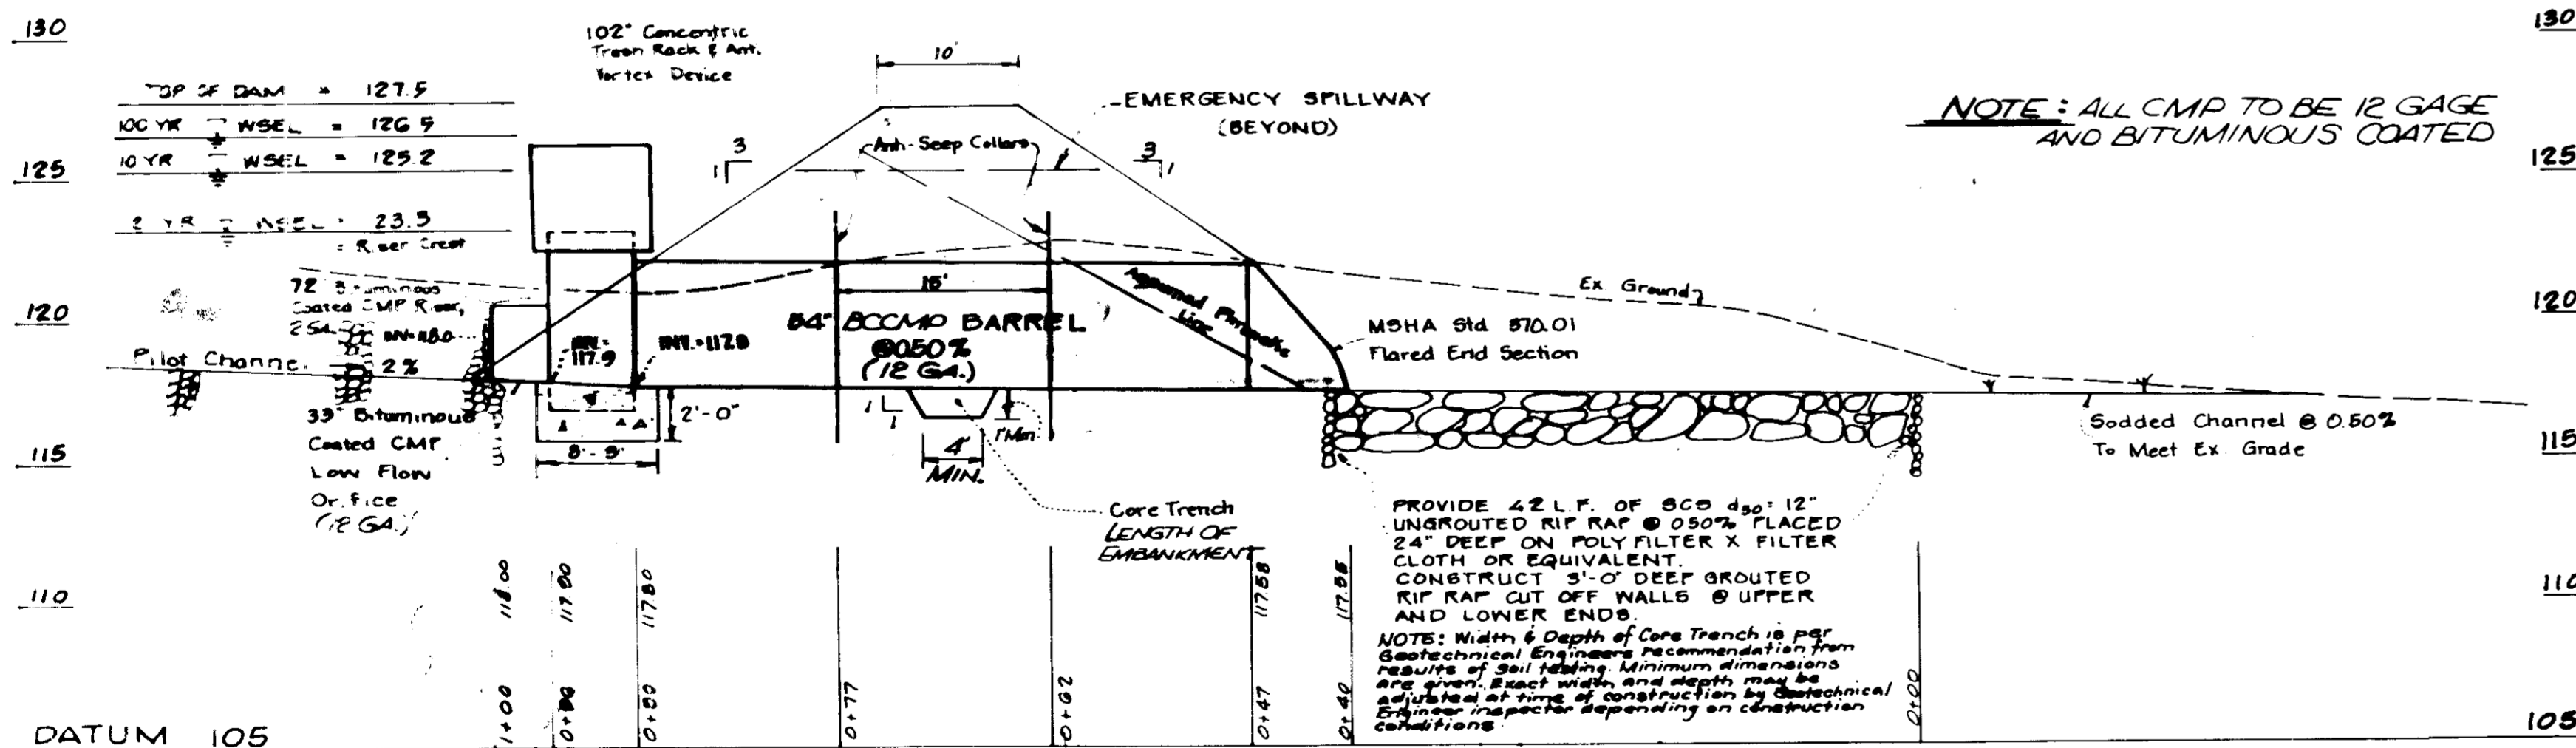

**PROFILE THRU PRINCIPLE SPILLWAY**

SCALE: HORIZ 1" = 10'  
VERT 1" = 5'

**NOTE: ALL CMP TO BE 12 GAGE AND BITUMINOUS COATED**

APPROVED: For public Water, public Sewerage and Storm Drainage Systems and Public Roads  
HOWARD COUNTY DEPARTMENT OF PUBLIC WORKS  
DIRECTOR: [Signature] DATE: 7-24-85  
CHIEF, BUREAU OF ENGINEERING: [Signature] DATE: 7-24-85

APPROVED: For public Water and public Sewerage  
HOWARD COUNTY HEALTH DEPARTMENT  
COUNTY HEALTH OFFICE: [Signature] DATE: 7/28/85

APPROVED: HOWARD COUNTY OFFICE OF PLANNING & ZONING  
PLANNING DIRECTOR: [Signature] DATE: 7-30-85  
CHIEF, DIVISION OF LAND DEVELOPMENT AND ZONING ADMINISTRATION: [Signature] DATE: 7-30-85

APPROVED  
DIVISION OF LAND DEVELOPMENT  
ZONING ADMINISTRATION  
HOWARD COUNTY, MARYLAND  
DATE: 6-17-85  
[Signature]



OWNER:  
DORSEY BUSINESS CENTER LTD. PARTNERSHIP  
7223 PARKWAY DRIVE  
HANOVER, MARYLAND 21076  
PHONE: (301) 796-4416


No.	REVISION	DATE	BY




**GREENHORNE & O'MARA, INC.**  
ENGINEERS • ARCHITECTS • PLANNERS • SURVEYORS  
2 RESEARCH PLACE  
ROCKVILLE, MD. 20850  
(301) 948-0900  
GREENBELT, MD • ANNAPOLIS, MD • FAIRFAX, VA • NO. HUNTINGDON, PA

STORMWATER MANAGEMENT AND  
SEDIMENT CONTROL PLAN  
**PARCEL II**  
**DORSEY BUSINESS CENTER**  
ELECTION DISTRICT #1  
HOWARD COUNTY, MARYLAND

JSL DESIGN	SCALE AS SHOWN
M DRAWN	4 OF 9
RHM CHECKED	SHEET
Mar. 85 DATE	R-1114-X FILE No.
JOB No.	SDP-85-154

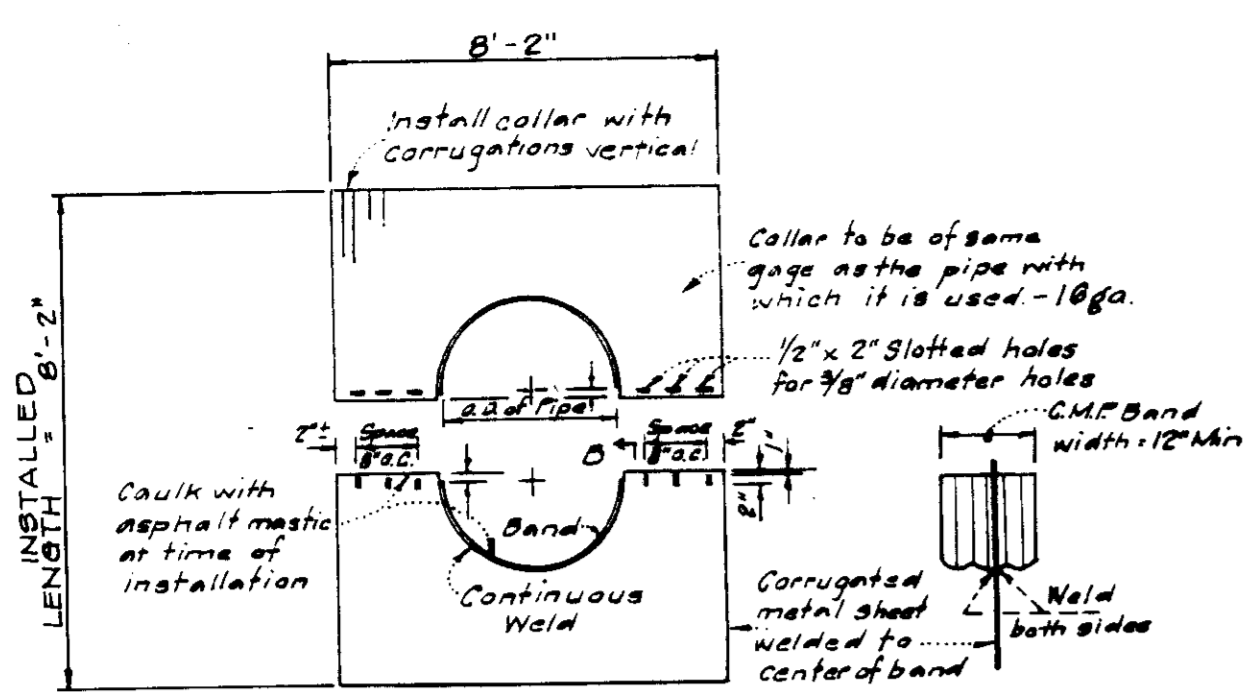


**ELEVATION OF SECTION B-B UNASSEMBLED COLLAR**  
 NOTE: Each collar shall be furnished with two 1/2" diameter rods with standard tank lugs for connecting collars to pipe  
**DETAILS OF CORRUGATED METAL ANTI-SEEP COLLAR**  
 NO SCALE

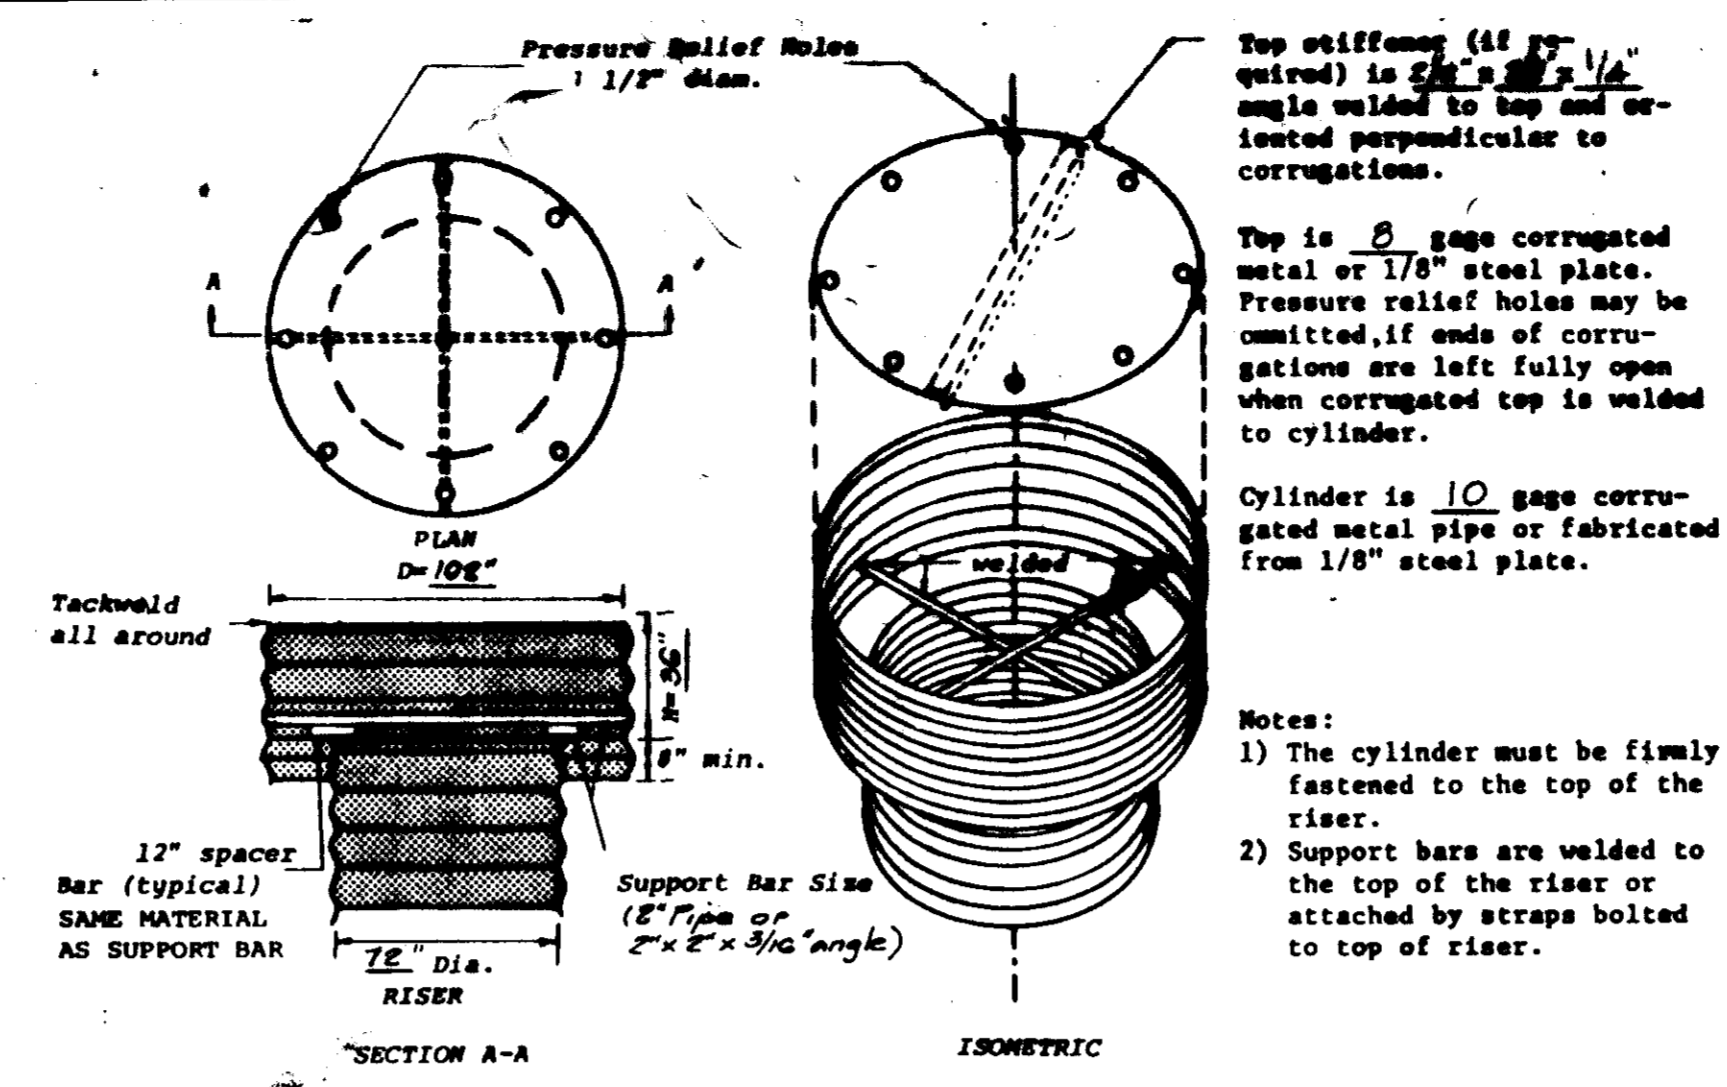


**CONCENTRIC TRASH RACK AND ANTI-VORTEX DEVICE**  
 (not to scale)

PIPE SCHEDULE		
DIA.	*TYPE	LENGTH
39"	CMP	4 L.F.
54"	CMP	43 L.F.
72"	CMP	6.5 L.F.




\* ALL CORRUGATED METAL PIPE TO BE 18 GA. & BITUMINOUS COATED.

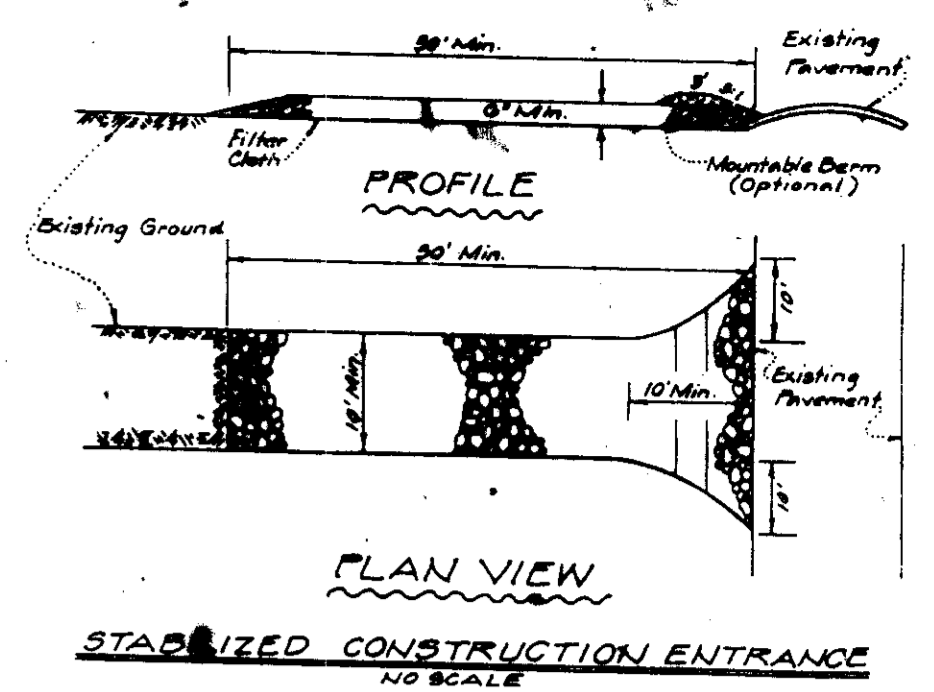


**PLAN VIEW STABILIZED CONSTRUCTION ENTRANCE**  
 NO SCALE

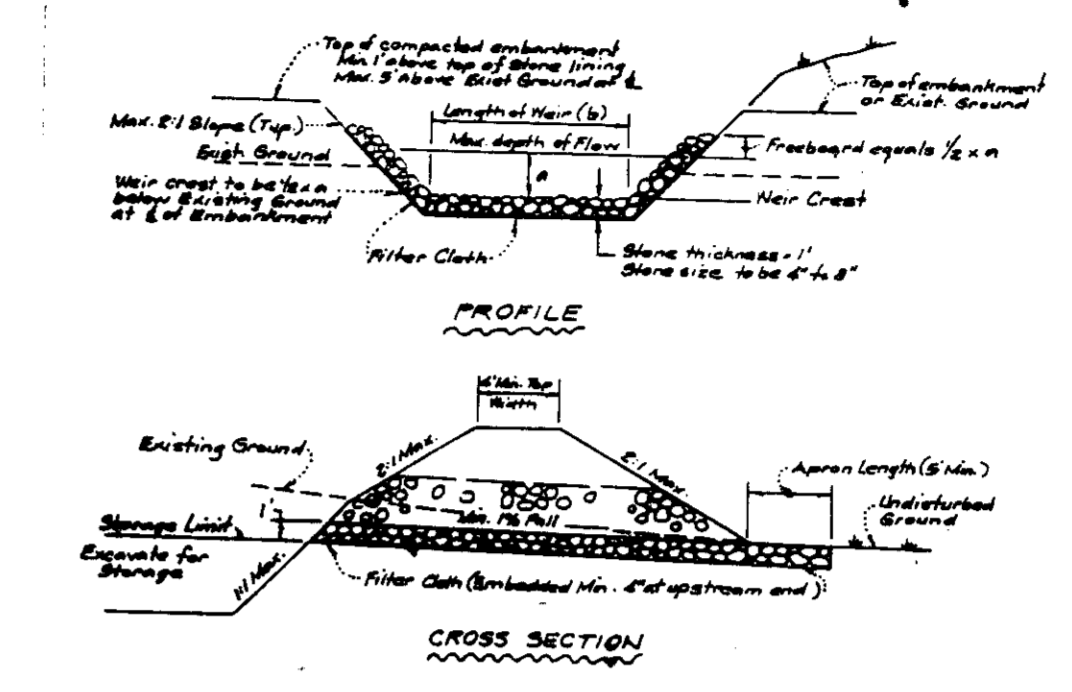


**RIP-RAP OUTLET SEDIMENT TRAP**  
 NO SCALE  
 NOTE: SEE SHEET 5 OF 8 FOR CONSTRUCTION SPECIFICATIONS

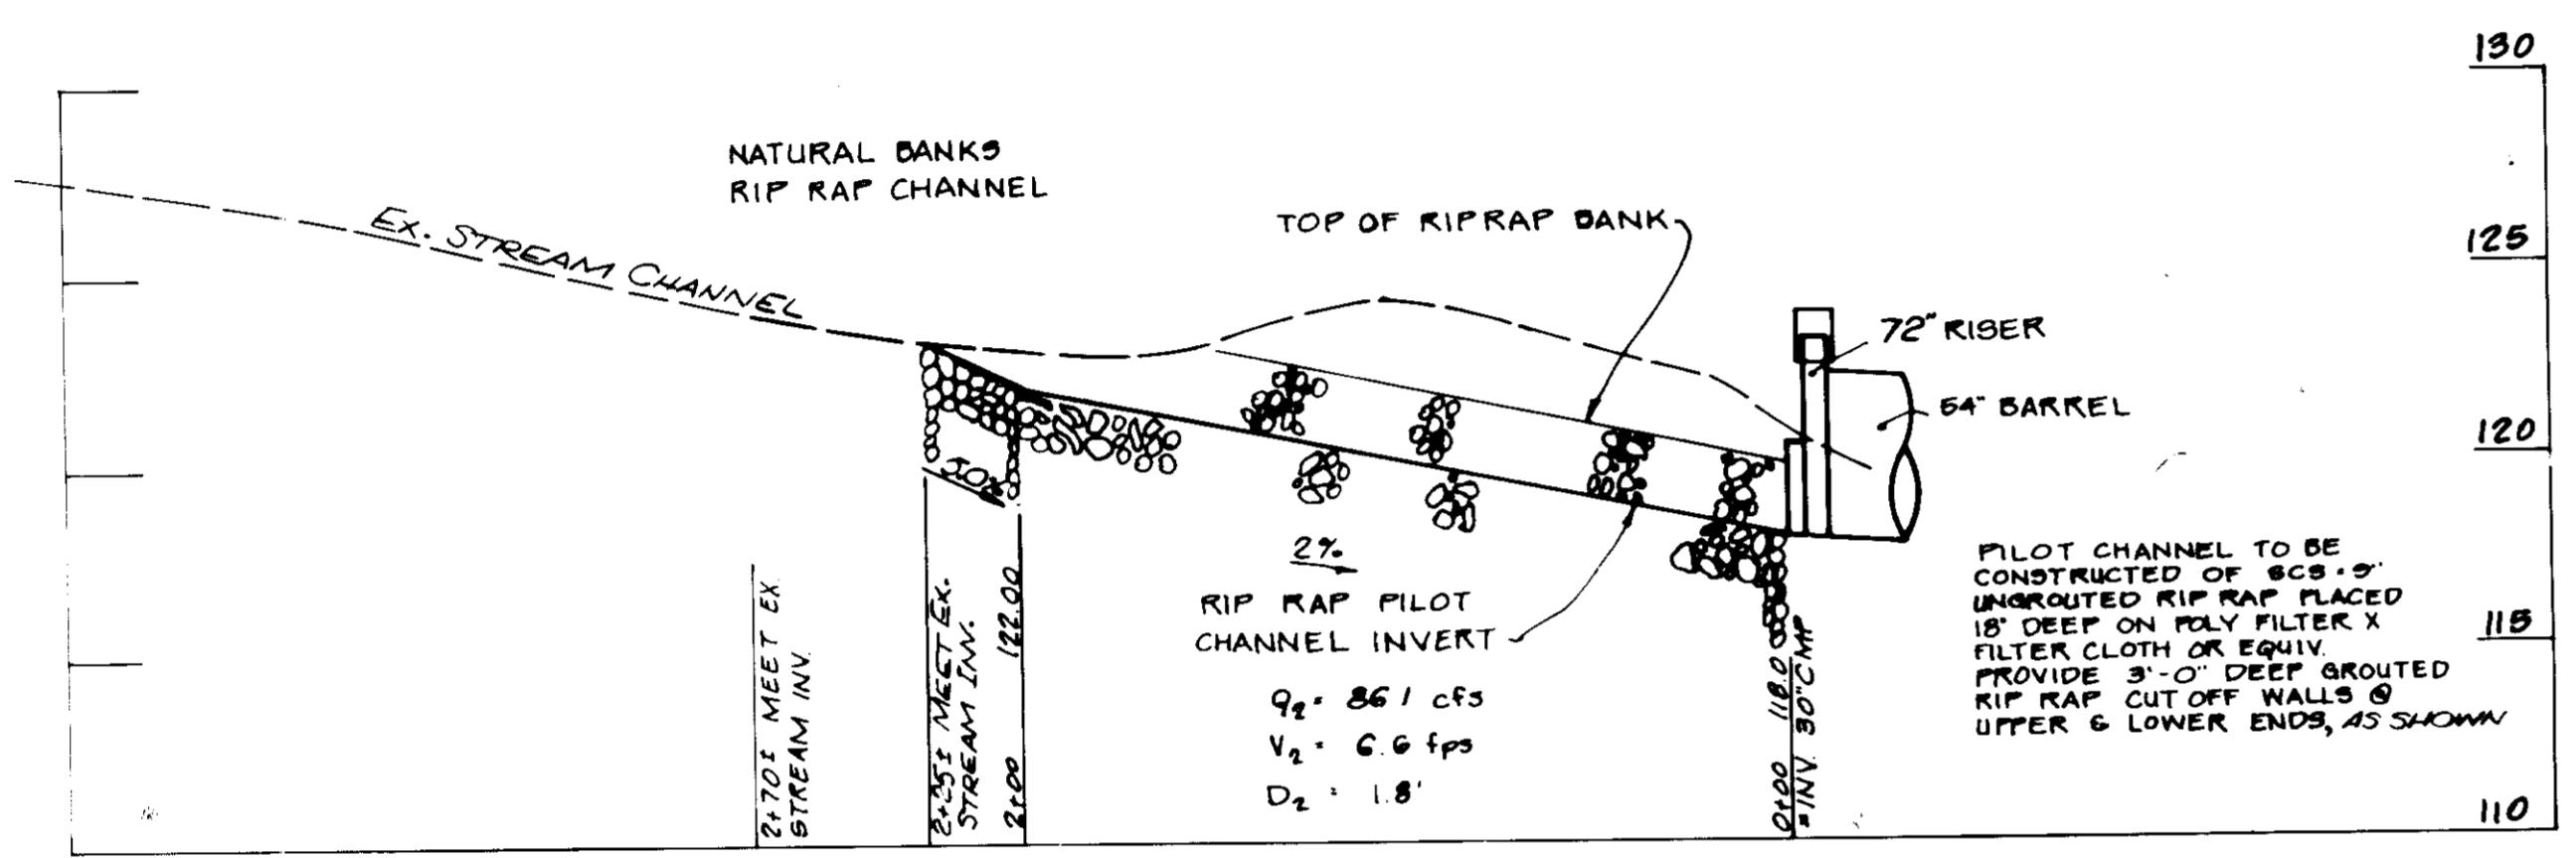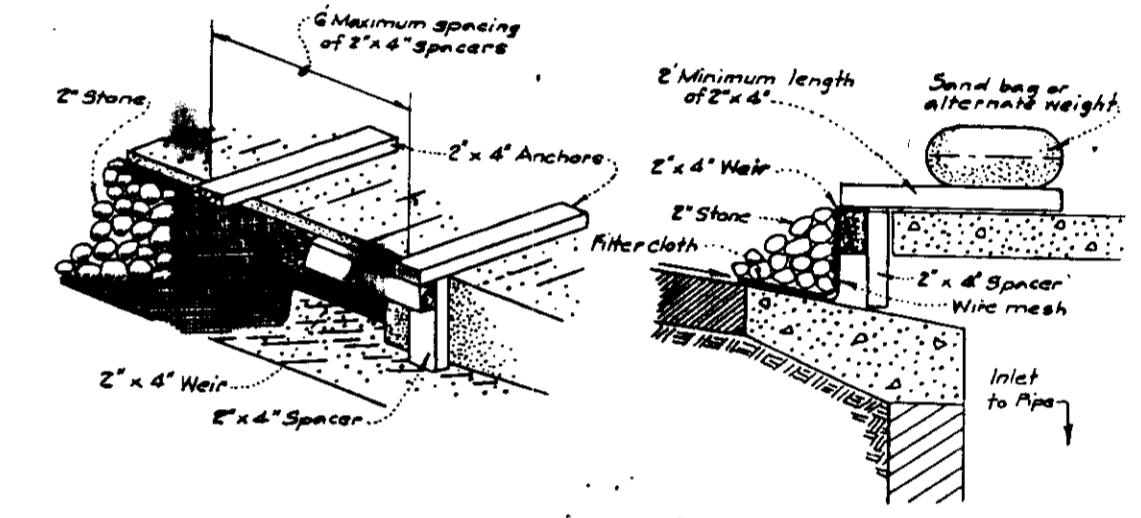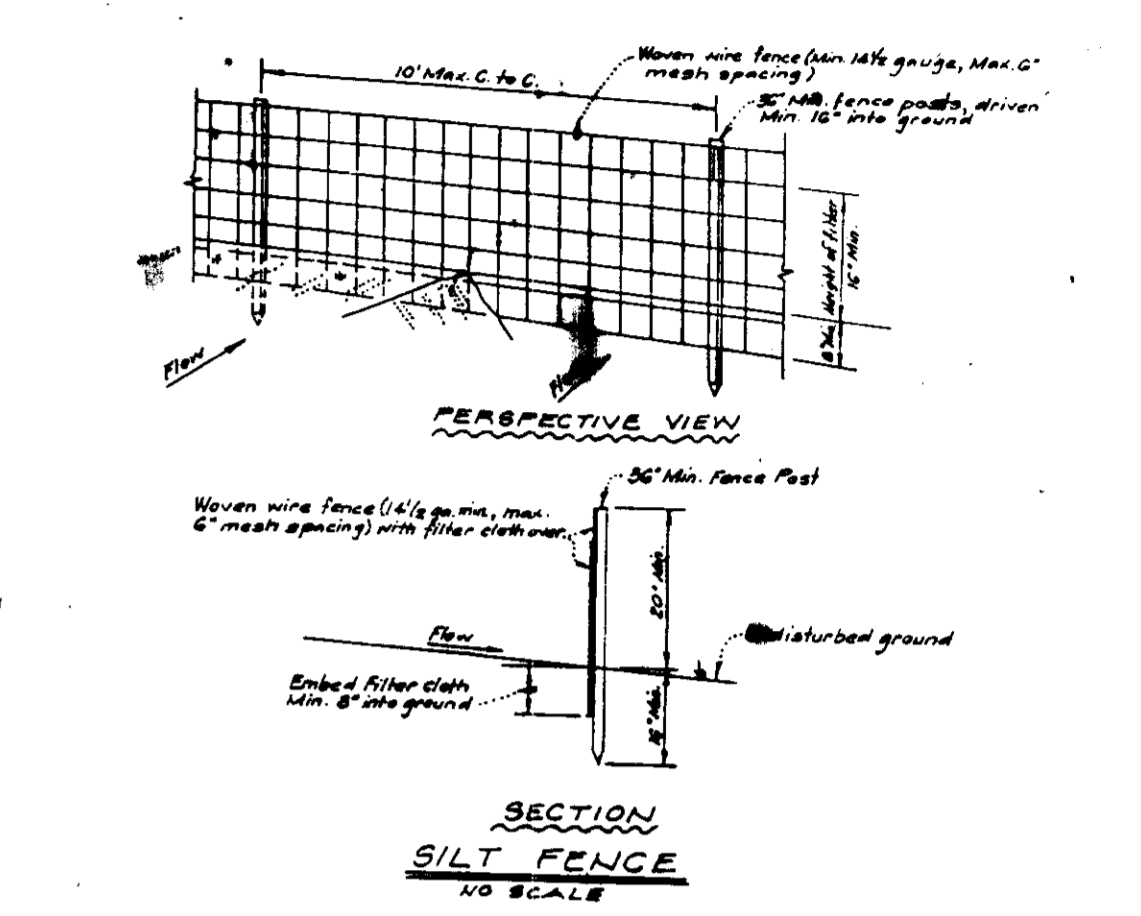


**PROFILE OF PILOT CHANNEL**  
 SCALE: HORIZ: 1" = 30'  
 VERT: 1" = 6'

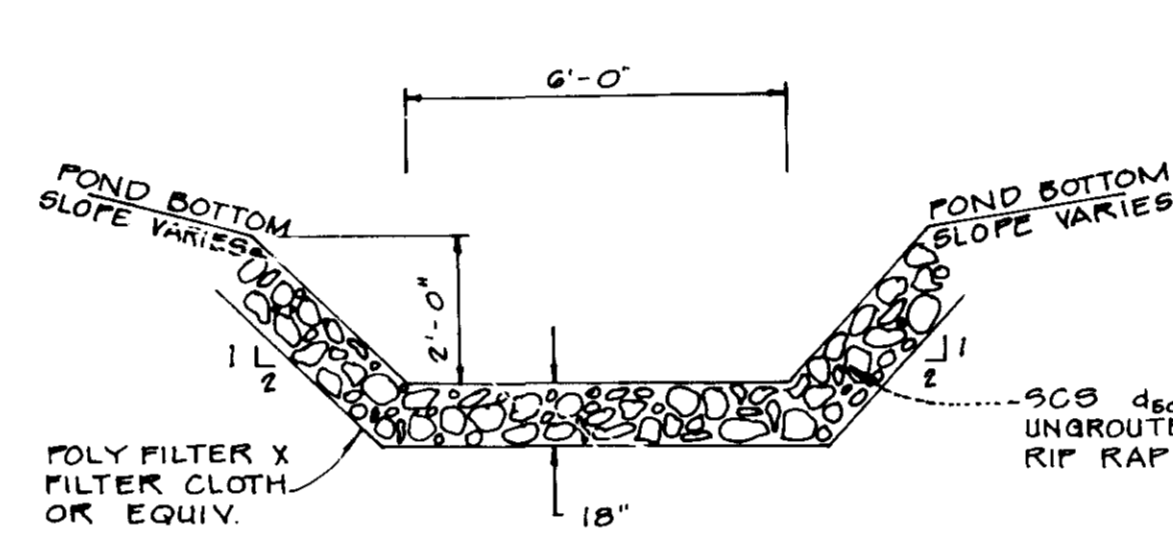


**DETAIL OF RIP RAP PILOT CHANNEL**  
 NOT TO SCALE

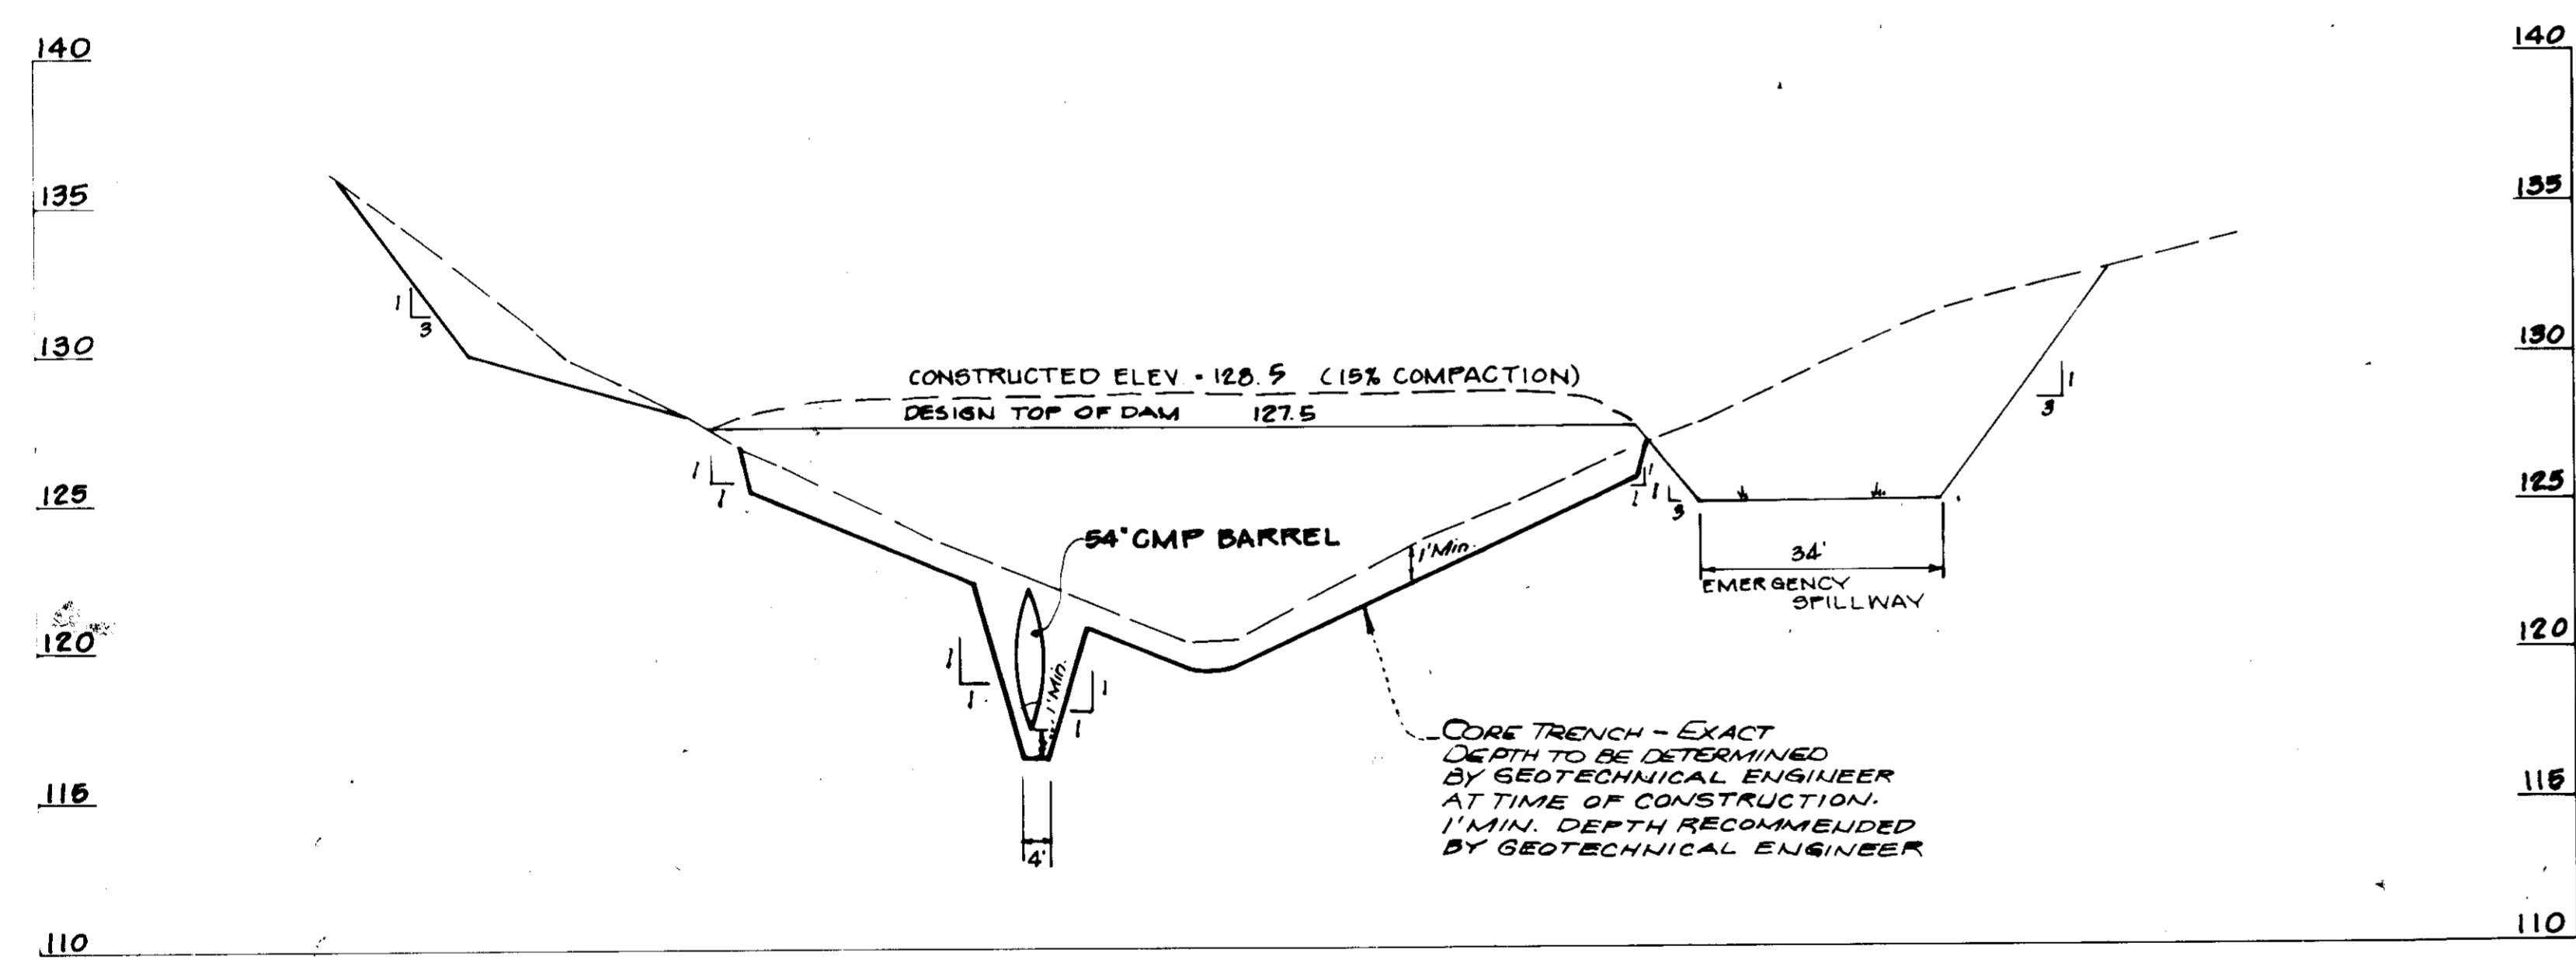

**SECTION A-A ALONG C/DAM**  
 SCALE: HORIZ: 1" = 20'  
 VERT: 1" = 5'

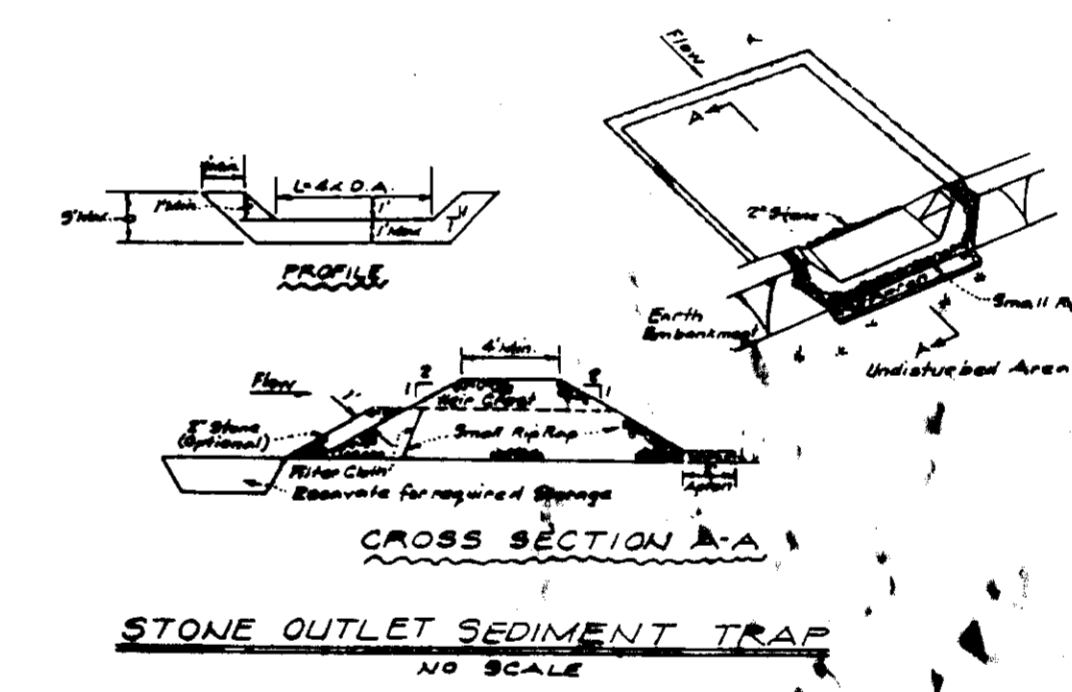

**STONE OUTLET SEDIMENT TRAP**  
 NO SCALE

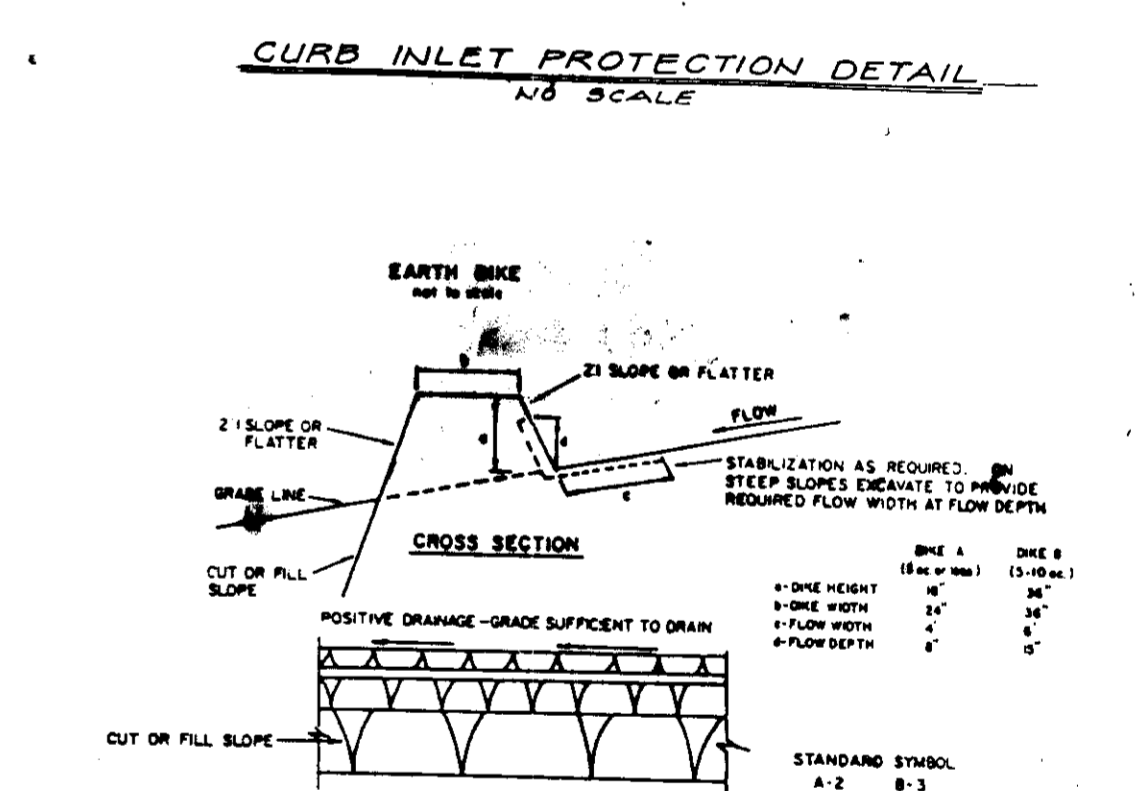

**CONSTRUCTION SPECIFICATIONS**

- All dikes shall be compacted by earthmoving equipment.
- All dikes shall have positive drainage to an outlet.
- Top width may be 8' and side slopes may be flatter if desired to facilitate field local construction traffic.
- Where necessary, dikes shall be stabilized as needed to utilize a stabilized safe outlet.
- Earth dikes shall have an outlet that functions with a minimum of erosion. Erosion shall be conveyed to a sediment trapping device such as a sediment trap or equivalent structure.
- Stabilization shall be: (A) in accordance with standard specifications for seed and straw mulch or straw mulch if not in seeding season; (B) flow channel as per the chart below.

TYPE OF EROSION	CHANNEL SIZE	FLOW CHANNEL STABILIZATION	
		DIKE A	DIKE B
1	5-3.0'	SEED AND STRAW MULCH	SEED AND STRAW MULCH
2	3.1-5.0'	SEED AND STRAW MULCH	SEED WITH LITE, OR MULCH, 500:1" STONE
3	5.1-8.0'	SEED WITH LITE, OR STONE	EMBED RIP-RAP 4-8"
4	8.1-20'	LINED RIP-RAP 4-8"	ENGINEERING DESIGN

1. Stone to be 2 inch stone, or recycled concrete equivalent, in a layer at least 3 inches in thickness and be pressed into the soil with construction equipment.  
 2. Rip-rap to be 4-8 inches in a layer at least 8 inches thickness and pressed into the soil.  
 3. Approved equivalents can be substituted for any of the above materials.  
 7. PUBLIC INSPECTION AND REQUIRED MAINTENANCE MUST BE PROVIDED AFTER EACH RAIN EVENT.

APPROVED  
 DIVISION OF LAND DEVELOPMENT &  
 ZONING ADMINISTRATION  
 HOWARD COUNTY, MARYLAND  
 DATE 6-17-85

APPROVED: For public Water, Public Sewerage and Storm Drainage Systems and Roads  
 HOWARD COUNTY DEPARTMENT OF PUBLIC WORKS  
 DIRECTOR: [Signature] DATE: 7-28-85  
 CHIEF, BUREAU OF ENGINEERING: [Signature] DATE: 7-28-85

APPROVED: For public Water and public Sewerage  
 HOWARD COUNTY HEALTH DEPARTMENT  
 COUNTY HEALTH OFFICER: [Signature] DATE: 7/29/85

APPROVED: HOWARD COUNTY OFFICE OF PLANNING AND ZONING  
 PLANNING DIRECTOR: [Signature] DATE: 7-30-85  
 CHIEF, DIVISION OF LAND DEVELOPMENT AND ZONING ADMINISTRATION: [Signature] DATE: 7-30-85

OWNER:  
 DORSEY BUSINESS CENTER LTD. PARTNERSHIP  
 7223 PARKWAY DRIVE  
 HANOVER, MARYLAND 21076  
 PHONE: (301) 796-4416

No.	REVISION	DATE	BY



**GREENHORNE & O'MARA, INC.**  
 ENGINEERS • ARCHITECTS • PLANNERS • SURVEYORS  
 2 RESEARCH PLACE  
 (301) 948 - 0900  
 GREENBELT, MD • ANNAPOLIS, MD • FAIRFAX, VA • NO. HUNTINGDON, PA

STORMWATER MANAGEMENT AND  
 SEDIMENT CONTROL PLAN  
**PARCEL II**  
 DORSEY BUSINESS CENTER  
 ELECTION DISTRICT # 1  
 HOWARD COUNTY, MARYLAND

J&L DESIGN	SCALE AS SHOWN
772	5 OF 9
DRAWN	SHEET
RHM CHECKED	DATE
Mar. 85	2-1114-x
DATE	FILE No.
	SDP-85-154



SEQUENCE OF CONSTRUCTION

1. Clear and grub areas necessary to construct sediment control measures and construct all sediment control measures.
2. Construct storm drain structures 1-5 and connecting pipe to by-pass offsite runoff.
3. Construct temporary access road to stormwater management.
4. Commence construction of stormwater management pond.
  - a. CLEAR & GRUB STORMWATER MANAGEMENT SITE
  - b. PROVIDE DRAINAGE MEASURES NECESSARY AS DESIGNATED BY ENGR. PRIOR TO CONSTRUCTION.
  - c. Construct riser, barrel and low flow orifice including base and anti-seep collar
  - d. Construct outfall
  - e. Commence dam embankment construction including emergency spillway
  - f. Grade pond to design specification including rip-rap pilot channel
  - g. Stabilize disturbed areas
5. Clear and grub Parcel II area.
6. Commence site grading.
7. Upon completion of rough site grading, construct storm drainage and onsite utilities and provide temporary 24" CMP stub from structure 1-6 to rip-rap outlet sediment trap.
8. Upon completion of storm drainage and utility construction, fine grade building area and commence building construction.
9. Fine grade paving areas and commence curb and gutter paving construction.
10. Complete grading and stabilize disturbed areas.
11. Upon completion of all construction and disturbed area stabilization, remove temporary sediment control measures.
12. Stabilize any remaining disturbed areas.

STORMWATER MANAGEMENT CONSTRUCTION SPECIFICATIONS

A. Site Preparation

Areas under the embankment, structural works, and stream diversion shall be cleared, grubbed, and the topsoil stripped to remove all trees, vegetation, roots, or other objectionable material. To facilitate clean out and restoration, the permanent pool area should be cleared of all brush and trees.

B. Earth Fill

Earth fill shall conform to SMA specification Article 31.06 and these specifications:

1. Material

The fill material shall be taken from an approved borrow area. The first two feet of excavation under the embankment is to be wasted at the designated spoil area. The final decision as to the suitability of the exposed soil shall be made by the Soils Engineer at the time of construction. All material shall be free from roots, stumps, wood, rubbish, oversized stones, frozen or other objectionable materials. The dam embankment should be formed of material conforming to the Unified Soil Classification SC, CL, and ML. As a minimum criteria, the fill material for the dam embankment (except as noted below) will have a maximum density not less than 100 pcf as determined by ASTM 79 Method A. The liquid limit shall not exceed 40 and the Plasticity Index must be between 12 and 25. All material shall contain no stone larger than three inches in the greatest dimension. Such stones shall not be more than 25 percent by volume of the fill material. For dam core trenches, the material used can include clean and organic-free CH and MH material in addition to CL and ML. The embankment shall be constructed to an elevation which provides for anticipated settlement to the design elevation. The fill height all along the length of the embankment shall be increased at least ten percent above the design elevation (including freeboard) unless otherwise shown on the plans.

2. Placement

Areas on which fill is to be placed shall be scarified prior to placement of fill. Fill materials shall be placed in eight-inch maximum thickness (before compaction) layers and shall be continuous over the entire length of the fill. The next borrow material shall be placed in the downstream sections of the embankment.

3. Compaction

The movement of hauling and spreading equipment over the fill shall be controlled so that the entire surface of each lift shall be compacted to a minimum of 95 percent of the maximum dry density obtained in compaction tests of the fill materials performed in accordance with the requirements of the ASTM designation 99 Method A, prior to next lift being spread and be certified by the Soils Engineer at the time of construction. The fill shall be compacted to a minimum of 95 percent of the maximum dry density of the compacted material. The moisture content of the embankment material shall be within the designated upper and lower limits of the optimum moisture content. Limits of moisture content may be modified by the engineer during construction depending on material encountered. Fill placed at densities lower than the specified minimum density or at moisture contents outside the specified acceptable range of moisture content or otherwise not conforming to the requirements of the specifications shall be removed or replaced by acceptable fill.

B. Core Trench/Cut-off Trench

Where specified, a core trench shall be excavated along or parallel to the centerline of the embankment as shown on the plans. The bottom width of the trench shall be governed by the equipment used for excavation, with the minimum width being 24" feet. The depth shall be at least ONE (1) FT. or as shown on the plans. The side slopes of the trench shall be one and one-half (1.5) to one (1). The backfill material for the core trench shall be approved prior to use and shall be free of all organic matter. The fill for the trench shall be compacted with equipment or rollers to assure that a minimum of 95 percent of the maximum dry density and minimum permeability is achieved. **GEOTECHNICAL ENGINEER TO SPECIFY MINIMUM DEPTH CURBARS**

C. Structural Backfill

Backfill material shall be of the type and quality conforming to that specified for the adjoining fill material. The fill shall be placed in horizontal layers not to exceed four inches in thickness and connected by hand tappers or other connection equipment. The material must completely fill all spaces under and adjacent to the structure or pipe. At no time during the backfilling operation shall driven equipment be allowed to operate closer than four feet, measured horizontally, to any part of a structure. Under no circumstances shall the contractor drive equipment over any part of a concrete structure or pipe unless there is a connected fill of 24 inches or greater over the structure or pipe.

D. Pipe Conduits

All pipe denoted as "CP" may be either corrugated aluminum pipe or asphalt coated corrugated steel pipe. The barrel, riser, trash rack, and section, and anti-seep collars must all be made of the same material (either steel or aluminum).

K. Corrugated Metal Pipe

a. Materials - (Steel Pipe) - This pipe and its appurtenances shall be galvanized and have full bituminous coating and shall conform to the requirements of ASTM Specification M-190, Type A, with watertight coupling bands. Any bituminous coating damaged or otherwise removed shall be replaced with cold applied bituminous coating compound.

b. Materials - (Aluminum Pipe) - This pipe and its appurtenances shall conform to the requirements of ASTM Specification M-196 or M-211 with watertight coupling bands. Coupling bands, anti-seep collars, and sections, etc., must be composed of the same material as the pipe.

Metals must be insulated from dissimilar materials with use of rubber or plastic insulating materials at least 1/8 inch in thickness. Aluminum surfaces that are to be in contact with concrete shall be painted with one coat of zinc chromate primer. Hot dip galvanized bolts may be used for connections. The pit of the surrounding soil shall be less than nine (9) and greater than four (4) inches. Helically corrugated pipe, in addition to the requirements above, shall have either continuously welded seams or have lock seams which are caulked with a neoprene bead.

b. Connections - All connections with pipes must be completely watertight. The drain pipe or barrel connection to the riser shall be welded all around and shall be at the proper angle to provide a watertight connection. Watertight coupling bands shall be used at all joints. Anti-seep collars shall be connected to the pipe in such a manner as to be completely watertight.

c. Bedding - The pipe shall be firmly and uniformly bedded throughout its entire length. Where rock or soft, spongy or other unstable soil is encountered, all such material shall be removed and replaced with suitable earth compacted to provide adequate support.

d. Laying pipe - The pipe shall be placed with inside circumferential laps pointing downstream and with the longitudinal laps at the sides.

e. Backfilling shall conform to structural backfill as described above.

f. Other details (anti-seep collars, valves, etc.) shall be as shown on the drawings.

2. Reinforced Concrete Pipe

a. Materials - This pipe shall conform to SMA specification, Article 20.16. Class IV pipe shall be used unless otherwise specified. Reinforced concrete pipe shall have a rubber gasket joint and shall equal or exceed ASTM Specification C-361. Approved equivalents are ASTM Specifications C-300, -301, and -302.

b. Bedding - All reinforced concrete pipe shall be laid in a concrete bedding for their entire length. This bedding shall consist of high slump concrete placed under the pipe and to the sides of the pipe at least ten percent of its diameter with a minimum thickness of three inches. **MINIMUM THICKNESS TO BE DETERMINED BY ENGINEER**

c. Laying pipe - Bell and spigot pipe shall be placed with the bell and upstream. Joints shall be made in accordance with recommendations of the manufacturer of the material. After the joints are sealed on the entire line, the bedding shall be placed so that all spaces under the pipe are filled. Care shall be exercised to prevent any deviation from the original line and grade of the pipe.

d. All concrete pipe joints will be sealed with mortar inside and outside.

e. Backfilling shall conform to structural backfill as described above.

f. Other details (anti-seep collars, valves, etc.) shall be as shown on the drawings.

E. Concrete

Concrete shall meet minimum requirements set forth in SMA Specification and Supplement (August 1980), Article 20.07 (Portland Cement Concrete Mixtures), for Class 3(A-1) or 2(F-1) concrete and 20.10 for reinforcement. Concrete construction shall conform to SMA Specifications, Articles 34.08 and 34.09.

F. Rip Rap and Slope Protection

Rock for rip rap shall conform to SMA specifications and Supplement (August 1980), Article 20.03-6. Plastic filter cloth shall be placed under all rip rap. Filter cloth shall be "Poly Filter 2" or approved substitute.

G. Fencing

When required by the **HOWARD SOIL CONSERVATION DISTRICT CHAIR** link fence fabric, fence posts, corner posts, braces, gates, and accessories shall conform to the requirements of Federal Specification RR-F-193. Materials shall be as follows, except as otherwise specified:

Fabric: Type 1, 2-inch mesh, 9-gauge, minimum weight of zinc coating-1.8 ounces per square foot.  
Barbed Wire: Zinc-coated steel.  
Posts: Type 1, Class 1, zinc-coated.  
Top Rails: Type 11, Class 1, zinc-coated.  
Braces: Zinc-coated steel.  
Gates: Type 1, zinc-coated steel.

H. Stabilization

Borrow areas, spoil areas, and all graded areas of the dam and road shall be graded to provide proper drainage and left in a slightly condition. All exposed surfaces of the embankment, spillway, and borrow areas shall be stabilized by seeding and applying straw mulch in accordance with these specifications and SMA Specifications, Article 20.07, 20.18, 20.19, 36.04, and 36.05.

Apply to graded or cleared areas not subject to immediate further disturbance where a permanent long-lived vegetative cover is needed.

**Seedbed Preparation:** Loosen upper three inches of soil by raking, disking or other acceptable means before seeding.

**Soil Amendments:** In lieu of soil test recommendations, use one of the following schedules:

- 1) Preferred - Apply 2 tons per acre dolomitic limestone (92 lbs/1000 square ft) and 600 lbs per acre 10-10-10 fertilizer (14 lbs/1000 sq ft) before seeding. Harrow or disc into upper three inches of soil. At time of seeding, apply 400 lbs per acre 30-0-0 ureaform fertilizer (9 lbs/1000 sq ft).
- 2) Acceptable - Apply 2 tons per acre dolomitic limestone (92 lbs/1000 sq ft) and 1000 lbs per acre 10-10-10 fertilizer (23 lbs/1000 sq ft) before seeding. Harrow or disc into upper three inches of soil.

**Seeding -** For the periods March 1 thru April 30, and August 1 thru October 15, seed with 60 lbs per acre (1.4 lbs/1000 sq ft) of Kentucky 31 Tall Fescue. For the period May 1 thru July 31, seed with 60 lbs Kentucky 31 Tall Fescue per acre and 2 lbs per acre (.05 lbs/1000 sq ft) of weeping lovegrass. During the period of October 16 thru February 28, protect site by: Option (1) 2 tons per acre of well anchored straw mulch and seed as soon as possible in the spring. Option (2) Use sod. Option (3) Seed with 60 lbs/acre Kentucky 31 Tall Fescue and mulch with 2 tons/acre well anchored straw.

**Mulching -** Apply 1 1/2 to 2 tons per acre (70 to 90 lbs/1000 sq ft) of unrotted small grain straw immediately after seeding. Anchor mulch immediately after application using mulch anchoring tool or 218 gallons per acre (5 gal/1000 sq ft) of emulsified asphalt on flat areas. On slopes 8 feet or higher, use 348 gallons per acre (8 gal/1000 sq ft) for anchoring.

**Maintenance -** Inspect all seeded areas and make needed repairs, replacements and reseeding.

I. Revegetation

Seedlings should be planted above the two-year storm pool. Varieties and spacing shall be in accordance with the State Forester, Maryland Forestry Service. The State Forestry Service should be contacted to establish details of Revegetation Plan.

J. Construction Inspection by Designated Engineer

The construction of the pond and embankment shall be under the supervision of a registered engineer. The engineer must certify that the pond and embankment have been built in accordance with the plans and submit such a written certification to the **HOWARD SOIL CONSERVATION DISTRICT** immediately following the completion of the project. The engineer shall have the responsibility and authority to make minor changes in the plans in order to compensate for unusual soil conditions encountered during construction as long as changes do not adversely affect the integrity of the dam. Major changes to the design which may result from site conditions encountered during construction must be reviewed and approved by the Design Engineer and the **MSDC** prior to initiation of construction. **CONSTRUCTION INSPECTION TO BE MADE BY GEOTECHNICAL ENGINEER.**

K. Care of Water During Construction

All work on permanent structures shall be carried out in areas free from water. The contractor shall construct and maintain all temporary dikes, levees, cofferdams, drainage channels, and stream diversions necessary to protect the areas to be occupied by the permanent works, and to furnish, install, operate, and maintain all necessary pumping and other equipment required for removal of water from the various parts of the work and for maintaining the excavations, foundation, and other parts of the work free from water as required or directed by the engineer for constructing each part of the work. After having served their purpose, all temporary protective works shall be removed or leveled and graded to the extent required to prevent obstruction in any degree whatsoever of the flow of water to the spillway or outlet works and so as not to interfere in any way with the operation or maintenance of the structure. The diversion and care of the stream will be diverted through the site until the full flow can be passed through the permanent works. The removal of water from the required excavation and the foundation shall be accomplished in a manner and to the extent that will maintain stability of the excavated slopes and bottom of required excavations and will allow satisfactory performance of all construction operations.

During the placing and compacting of material in required excavations, the water level at the locations being refilled shall be maintained below the bottom of the excavation at such locations, which may require draining the water to sumps from which the water shall be pumped.

**L. ADDITIONAL INFORMATION**  
CONSULT GEOTECHNICAL ENGINEERING REPORT PRIOR TO CONSTRUCTION FOR ANY ADDITIONAL REQUIREMENTS.

SEDIMENT CONTROL NOTES

- 1) A minimum of 24 hours notice must be given to the Howard County Office of Inspection and Permits prior to the start of any construction. (992-2437)
- 2) All vegetative and structural practices are to be installed according to the provisions of this plan and are to be in conformance with the 1983 MARYLAND STANDARDS AND SPECIFICATIONS FOR SOIL EROSION AND SEDIMENT CONTROL.
- 3) Following initial soil disturbance or disturbance, permanent or temporary stabilization shall be completed within 14 calendar days for all perimeter sediment control structures, dikes, perimeter slopes and all slopes greater than 3:1. b) 14 days as to all other disturbed or graded areas in the project site.
- 4) All sediment traps/basins shown must be fenced and warning signs posted around their perimeter in accordance with Vol. 1, Part 2 of the HOWARD COUNTY DESIGN MANUAL, Storm Drainage.
- 5) All disturbed areas must be stabilized within the time periods specified above in accordance with the HOWARD COUNTY STANDARDS AND SPECIFICATIONS FOR SOIL EROSION AND SEDIMENT CONTROL for permanent seedings Part II, Sec. 54, temporary seeding (Sec. 50) and Supplement (Sec. 55). Temporary stabilization with straw mulch can only be done when recommended seeding rates do not allow for proper germination and establishment of grasses.
- 6) All sediment control structures are to remain in place and are to be maintained in operative condition until permission for their removal has been obtained from the Howard County Sediment Control Inspector.

Site Statistics:

Total Area of Site	2.94 Acres
Area Disturbed	2.94 Acres
Area to be seeded or paved	2.42 Acres
Area to be vegetatively stabilized	1.51 Acres
Total Cut	3000 Cu. yds
Total Fill	3000 Cu. yds
Spillway waste/borrow area location	APPROVED STOCKPILE @ SPEEDWAY

All sediment control practice which is disturbed by grading activity for placement of utilities must be repaired in the same day of disturbance.

APPROVED  
DIVISION OF LAND DEVELOPMENT & ZONING ADMINISTRATION  
HOWARD COUNTY, MARYLAND  
DATE 6-17-85

APPROVED: For Public Water, Public Sewerage & Storm Drainage Systems and Public Roads  
HOWARD COUNTY DEPT. OF PUBLIC WORKS  
Director: [Signature]  
Chief, Bureau of Engineering: [Signature]

APPROVED: For Public Water & Public Sewerage Systems  
HOWARD COUNTY HEALTH DEPARTMENT  
County Health Officer: [Signature]

APPROVED: HOWARD COUNTY OFFICE OF PLANNING & ZONING  
Planning Director: [Signature]



OWNER:  
DORSEY BUSINESS CENTER LTD. PARTNERSHIP  
7223 PARKWAY DRIVE  
HANOVER, MARYLAND 21076  
PHONE: (301) 795-4446

No.	REVISION	DATE	BY

ENGINEERS • ARCHITECTS • PLANNERS • SCIENTISTS • SURVEYORS • PHOTOGRAMMETRISTS

**GREENHORNE & O'MARA, INC.**  
2 RESEARCH PLACE, ROCKVILLE, MARYLAND 20850  
(301) 948-0900



GREENBET, MD • ANNAPOLIS, MD • ATLANTA, GA • BECKLEY, WV • CULPEPER, VA • DENVER, CO  
FAIRFAX, VA • GREENSBORO, NC • MONROE, MI • EXPORT, PA • WILLISTON PARK, NY

STORMWATER MANAGEMENT AND SEDIMENT CONTROL PLAN  
PARCEL II  
DORSEY BUSINESS CENTER  
ELECTION DISTRICT # 1  
HOWARD COUNTY, MARYLAND

JSD DESIGN	SCALE NONE
DRAWN	6 OF 9
RHM CHECKED	SHEET
MARCH, 85	DATE
DATE	FILE No.

SDP-85-154



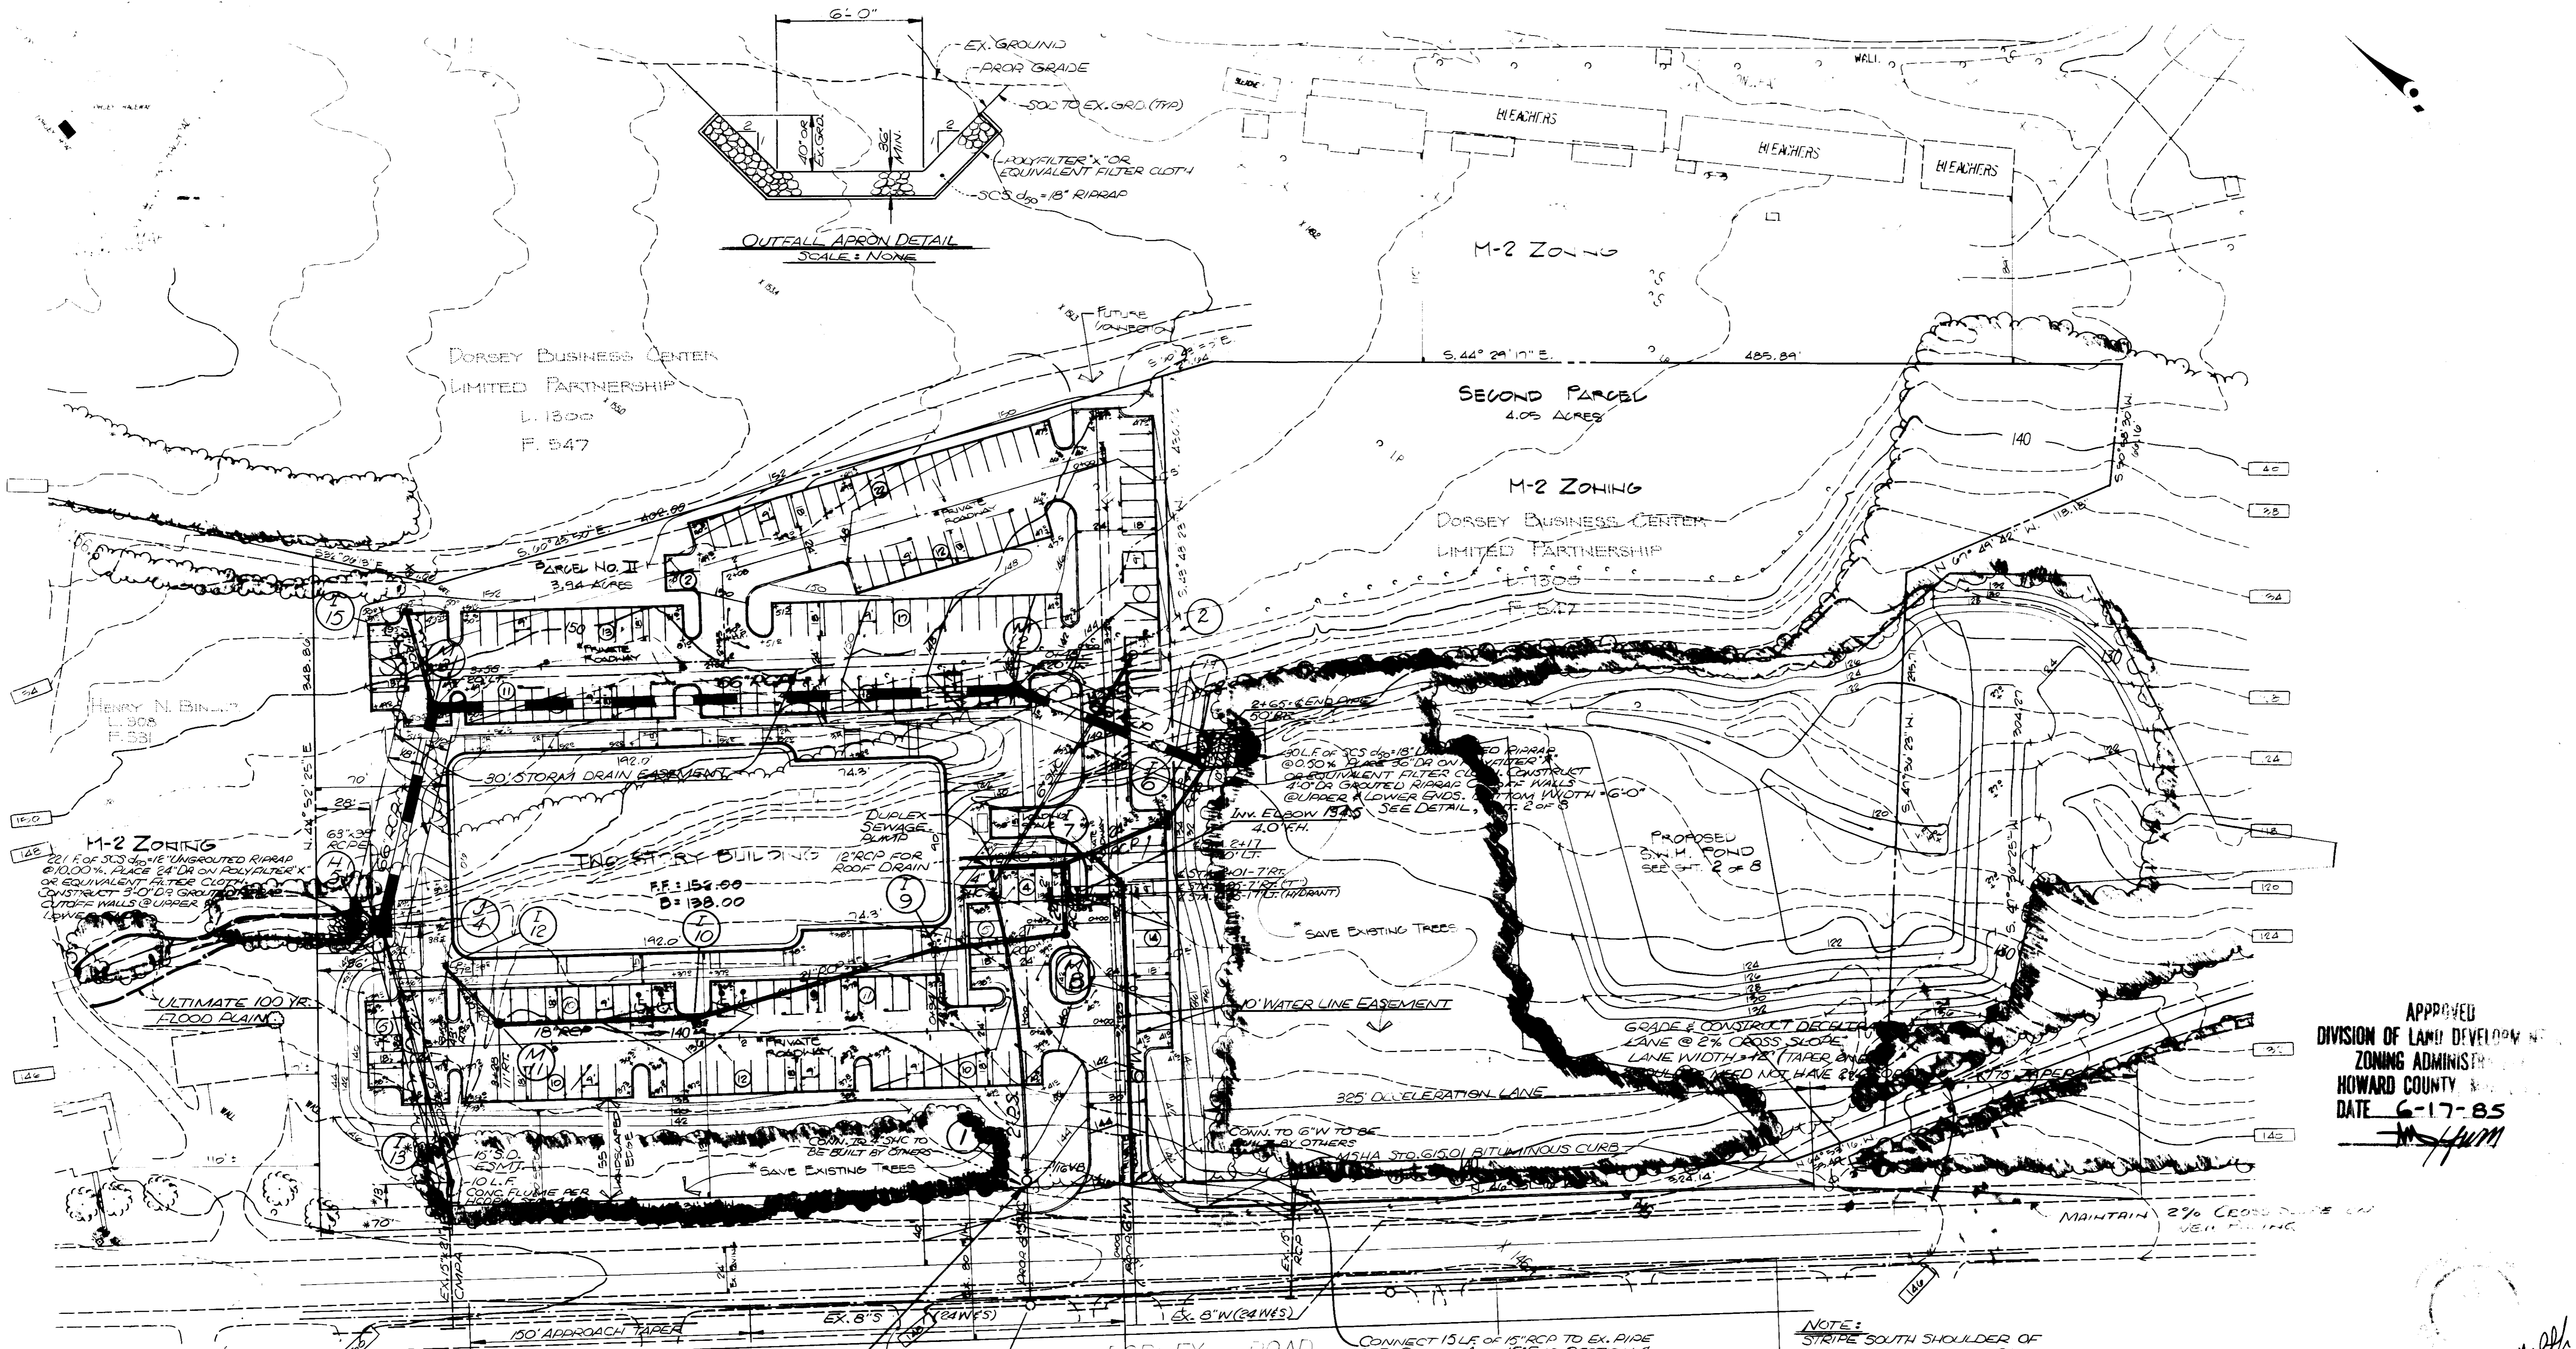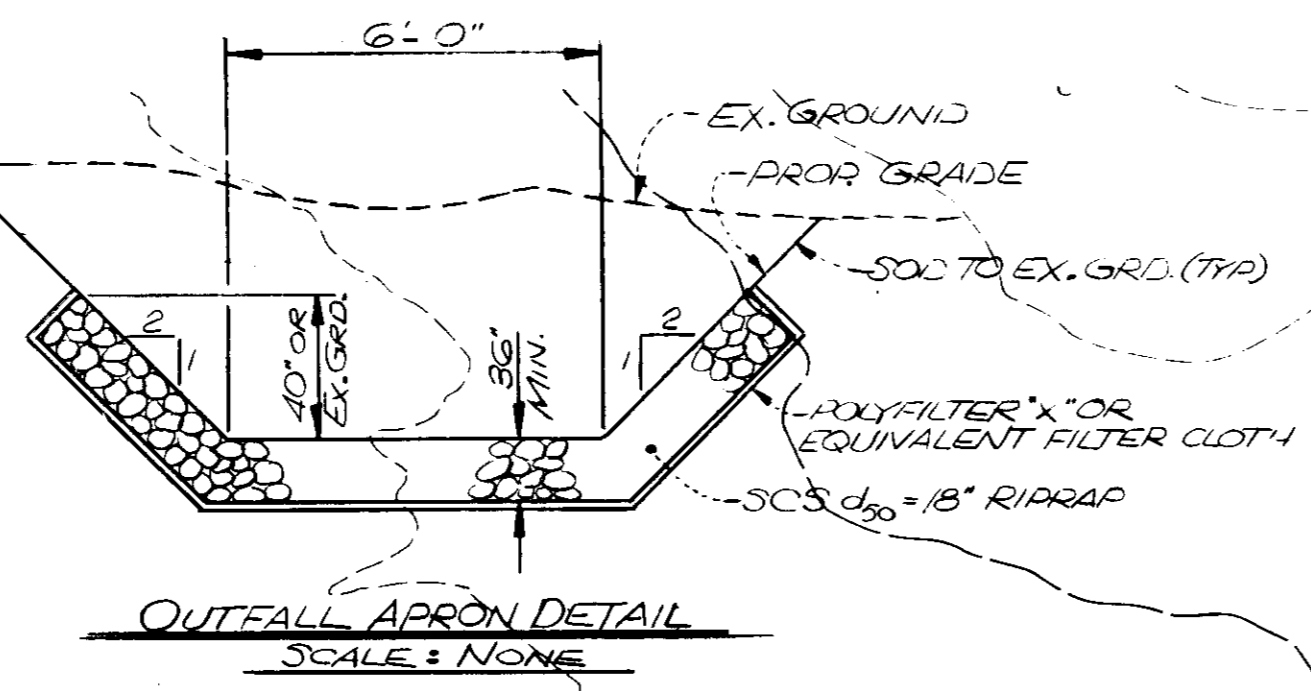

APPROVED  
 DIVISION OF LAND DEVELOPMENT & ZONING ADMINISTRATION  
 HOWARD COUNTY  
 DATE 6-17-85  
*[Signature]*

\* INLET IS TO BE LOCATED IN CENTER OF SWALE. FIELD ADJUST AS REQ'D.

TRANSITION MH #1  
 ELEV. & FITTING  
 SCHEDULE  
 SEE DETAIL  
 A = 139.96  
 B = 139.96  
 C = 140.36  
 D = 143.50  
 E = 4\"/>

NOTE: ON-SITE PAVING PER HCDPW STD. R-2.01 SECT. # P-2, FULL DEPTH BITUMINOUS CONCRETE

APPROVED: For Public Water, Public Sewerage & Storm Drainage Systems and Public Roads  
 HOWARD COUNTY DEPT. OF PUBLIC WORKS  
*[Signature]*  
 Director  
 Date 7-29-85

APPROVED: For Public Water & Public Sewerage Systems  
 HOWARD COUNTY HEALTH DEPARTMENT  
*[Signature]*  
 County Health Officer  
 Date 7-29-85

APPROVED: HOWARD COUNTY OFFICE OF PLANNING & ZONING  
*[Signature]*  
 Planning Director  
 Date 7-30-85

OWNER:  
 DORSEY BUSINESS CENTER LTD. PARTNERSHIP  
 7223 PARKWAY DRIVE  
 HANOVER, MARYLAND 21076  
 PHONE: (301) 796-4446

No.	REVISION	DATE	BY




**GREENHORNE & O'MARA, INC.**  
 ENGINEERS • ARCHITECTS • PLANNERS • SURVEYORS  
 2 RESEARCH PLACE  
 ROCKVILLE, MD.  
 (301) 948-0900  
 GREENBELT, MD • ANNAPOLIS, MD • FAIRFAX, VA • NO. HUNTINGDON, PA

**SITE UTILITIES & PAVING PLAN**  
 DORSEY BUSINESS CENTER  
 PARCEL II

DESIGN	SCALE 1"=40'
DRAWN	7 OF 9
CHECKED	SHEET
DATE	FILE No.


SDP-85-154



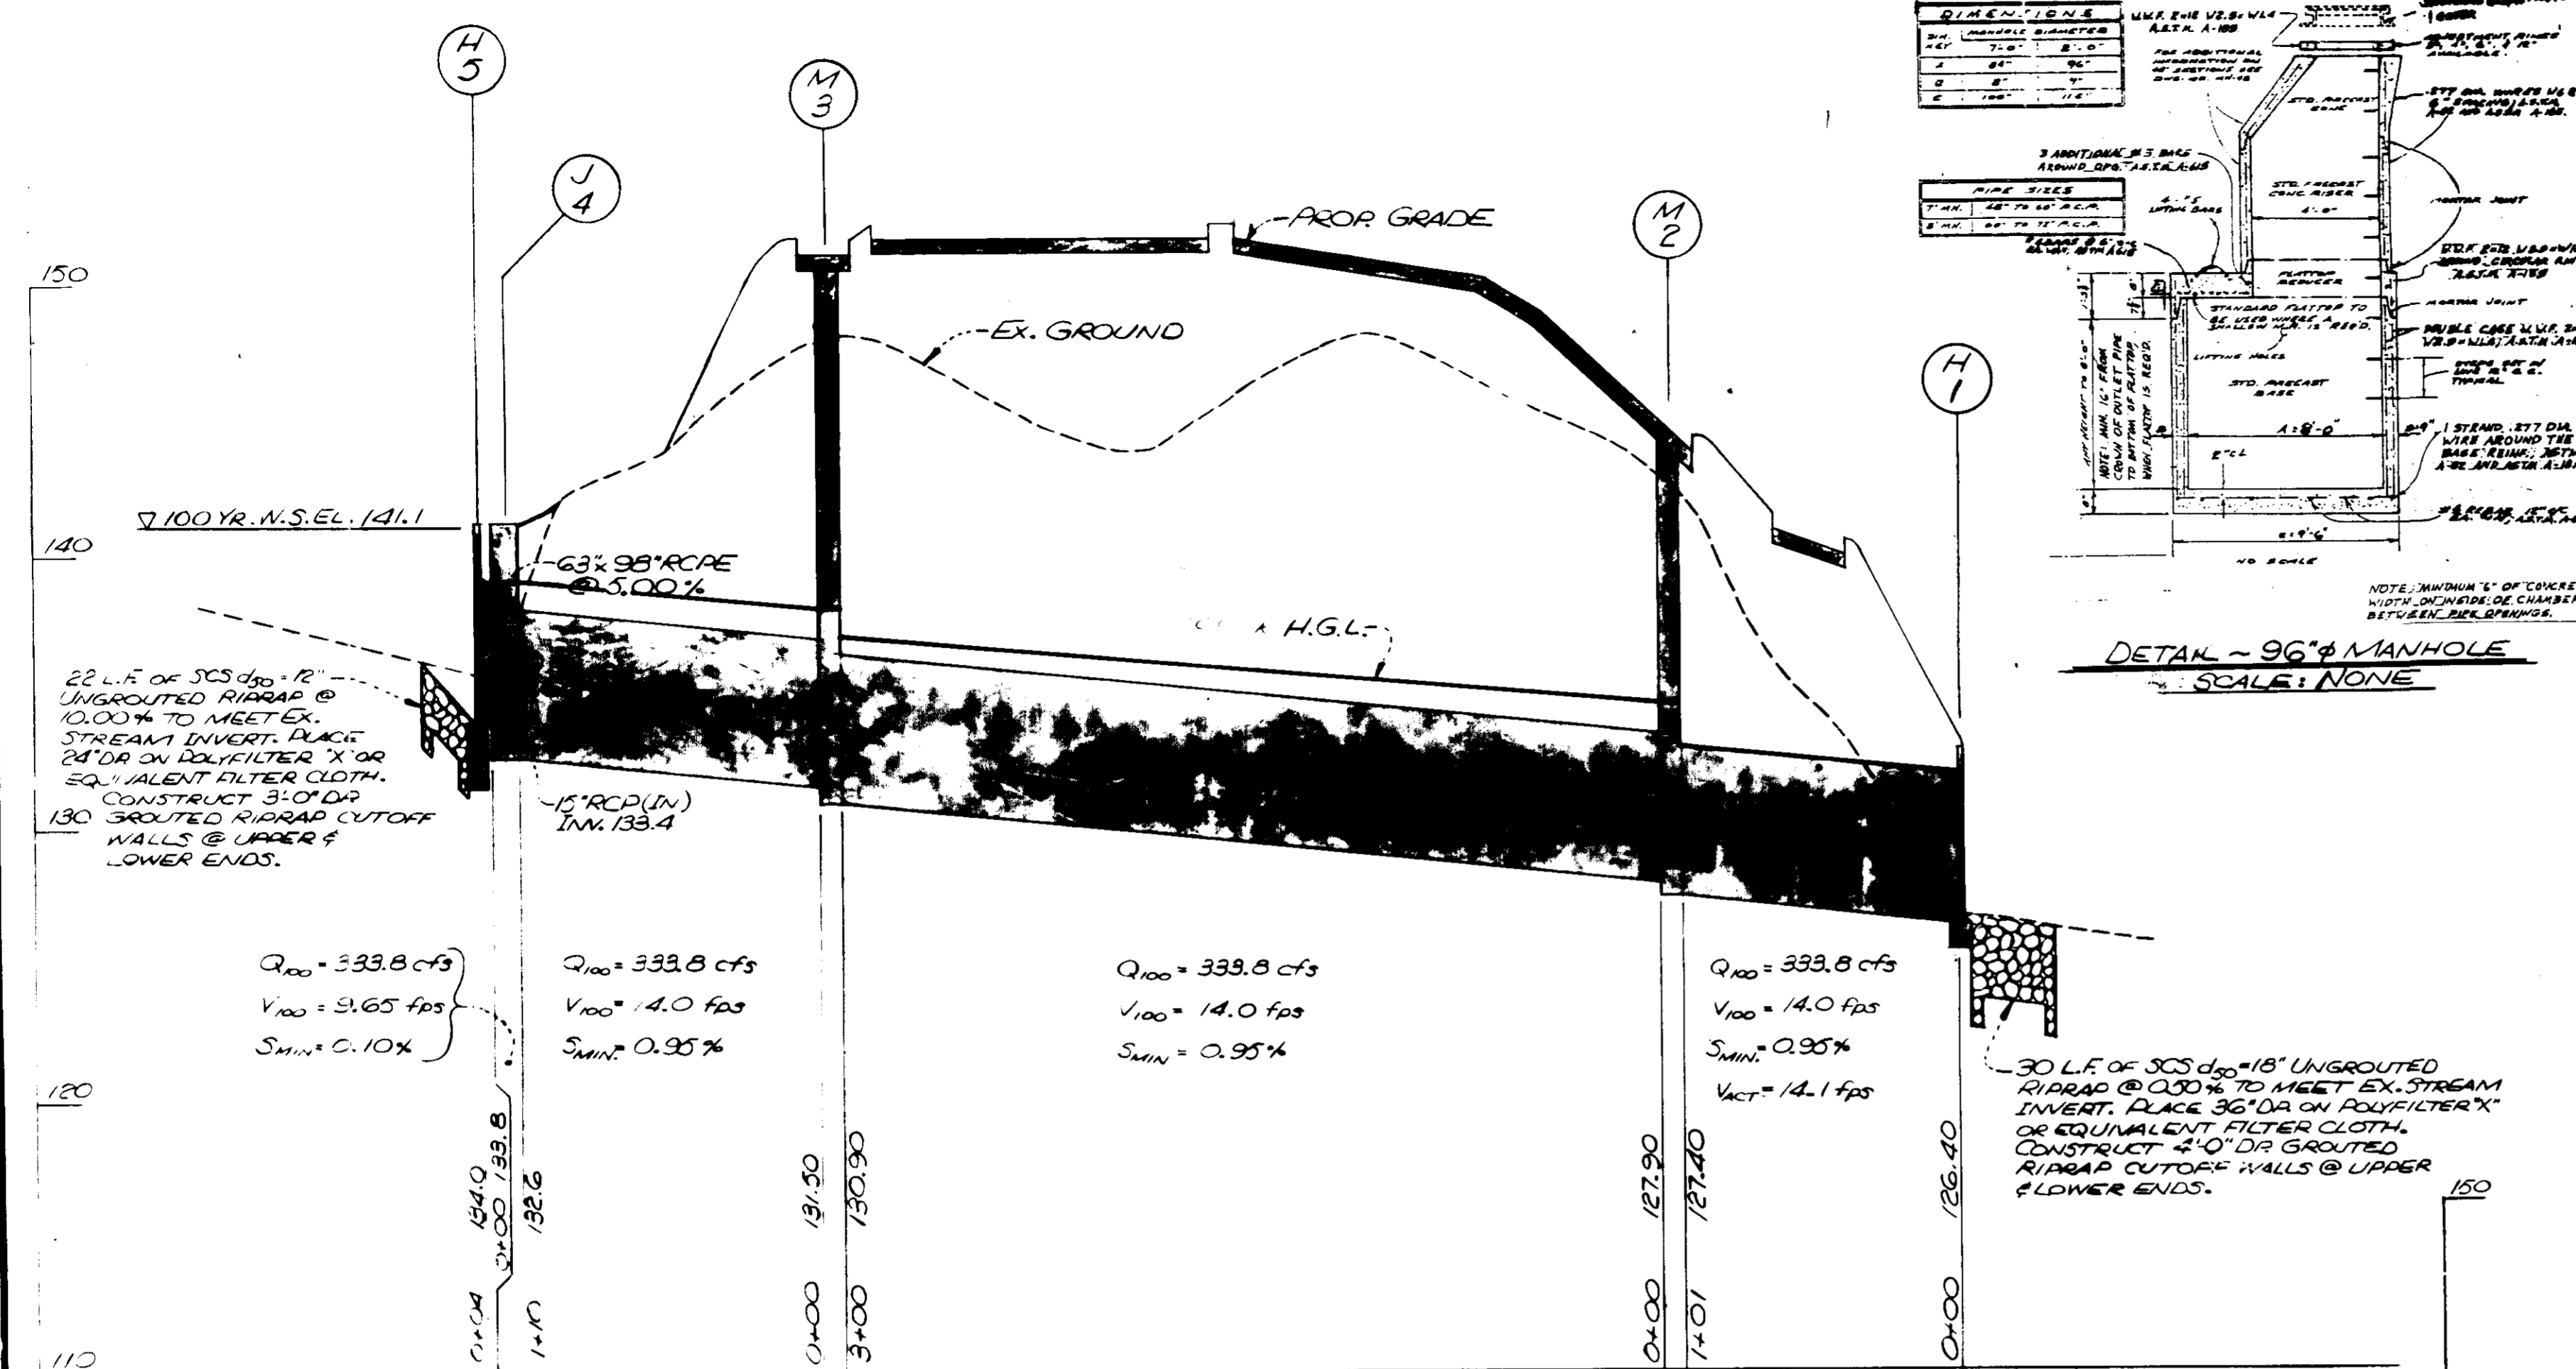

**STRUCTURE SCHEDULE**

NO.	TYPE	TOP ELEVATION UPPER	LOWER	REMARKS
M1	MANHOLE	141.60		PRECAST MANHOLE - SEE DETAIL
M2	MANHOLE	146.25		PRECAST MANHOLE - SEE DETAIL
M3	MANHOLE	150.40		PRECAST MANHOLE - SEE DETAIL
M4	MANHOLE	136.80		PRECAST MANHOLE - SEE DETAIL
M5	MANHOLE	137.60		PRECAST MANHOLE - SEE DETAIL
M6	MANHOLE	138.63		PRECAST MANHOLE - SEE DETAIL
M7	MANHOLE	137.00		PRECAST MANHOLE - SEE DETAIL
M8	MANHOLE	136.51		PRECAST MANHOLE - SEE DETAIL
M9	MANHOLE	137.00		PRECAST MANHOLE - SEE DETAIL
M10	MANHOLE	143.07		PRECAST MANHOLE - SEE DETAIL
M11	MANHOLE	149.80		PRECAST MANHOLE - SEE DETAIL
M12	MANHOLE			PRECAST MANHOLE - SEE DETAIL
M13	MANHOLE			PRECAST MANHOLE - SEE DETAIL
M14	MANHOLE			PRECAST MANHOLE - SEE DETAIL
M15	MANHOLE			PRECAST MANHOLE - SEE DETAIL
M16	MANHOLE			PRECAST MANHOLE - SEE DETAIL



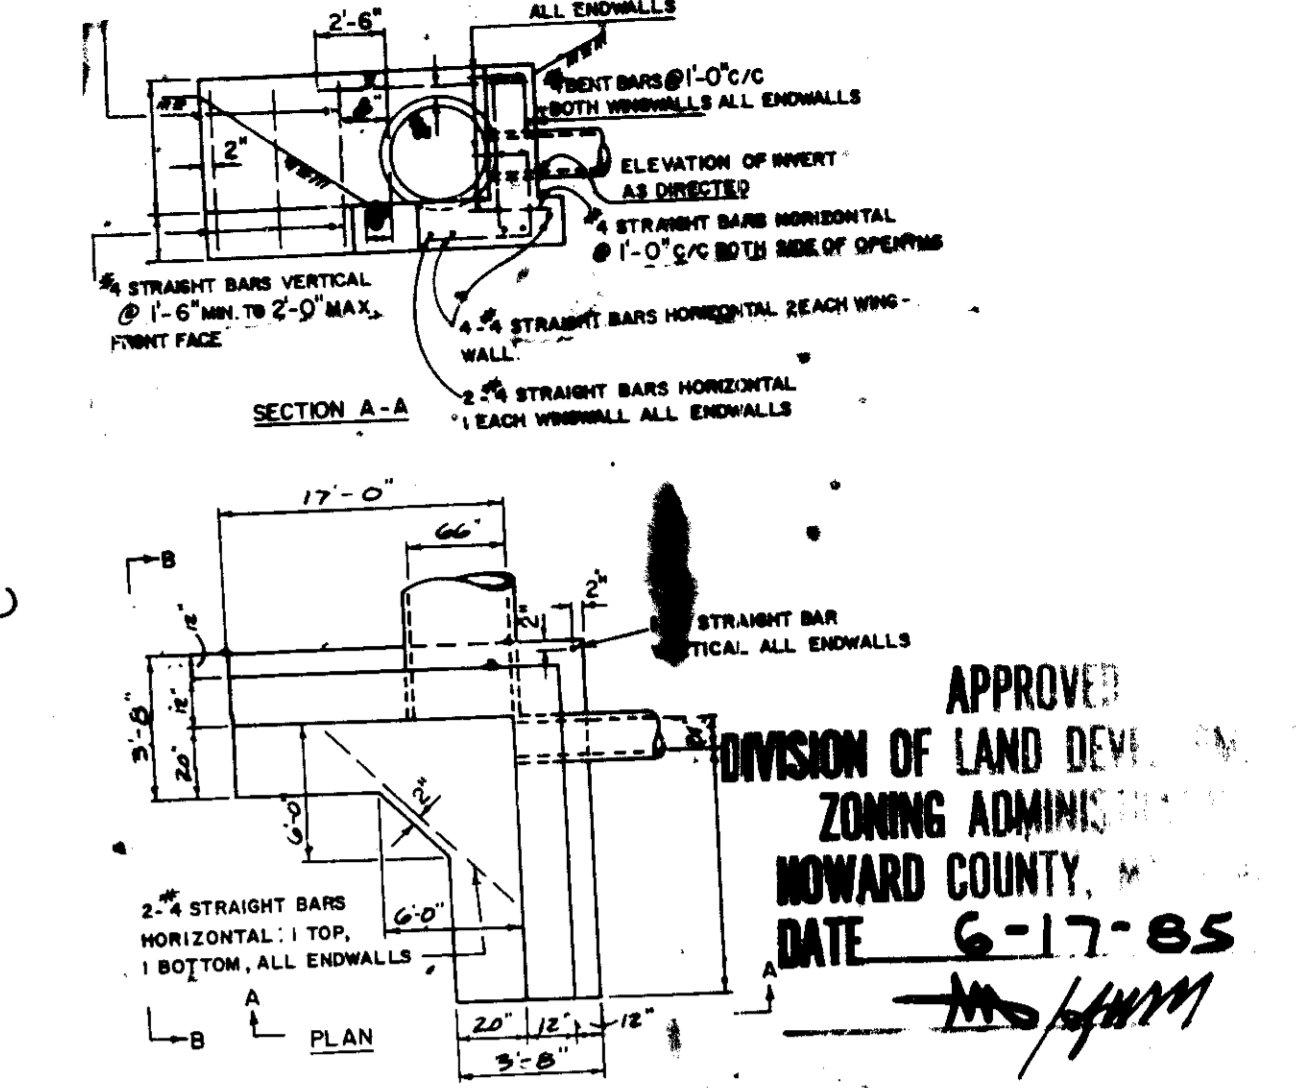


APPROVED: For Public Water, Public Sewerage & Storm Drainage Systems and Public Roads  
 HOWARD COUNTY DEPT. OF PUBLIC WORKS  
 Director: [Signature] Date: 7-24-85

APPROVED: For Public Water & Public Sewerage Systems  
 HOWARD COUNTY HEALTH DEPARTMENT  
 County Health Officer: [Signature] Date: 7-29-85

APPROVED: HOWARD COUNTY OFFICE OF PLANNING & ZONING  
 Planning Director: [Signature] Date: 7-30-85

APPROVED: [Signature] Date: 7-30-85  
 Chief, Div. of Land Development & Zoning Administration

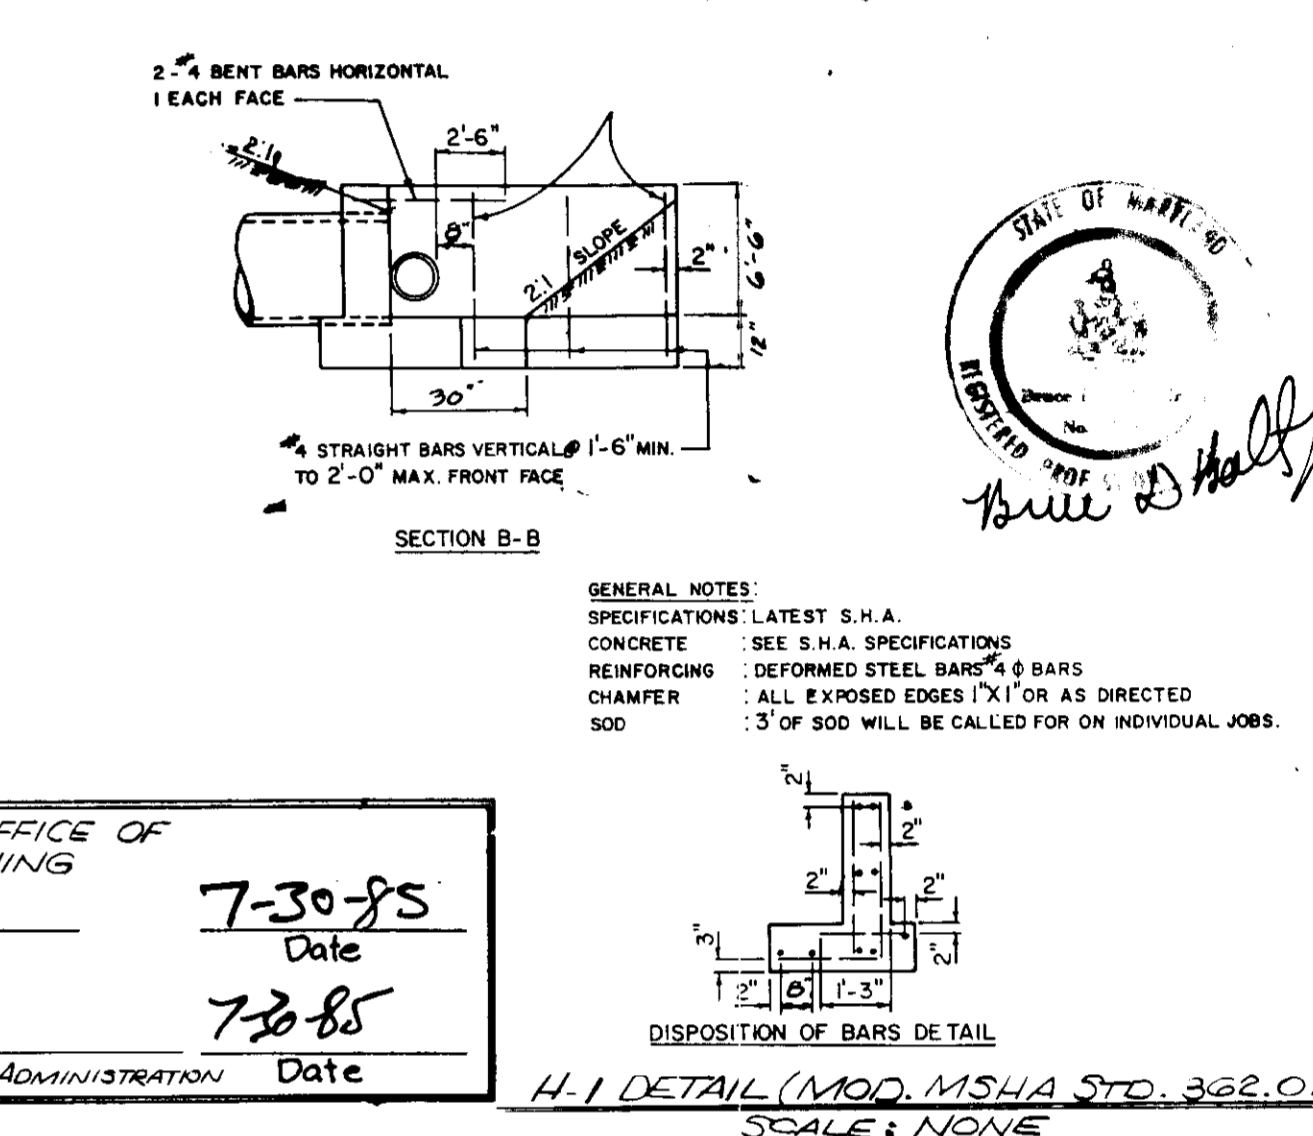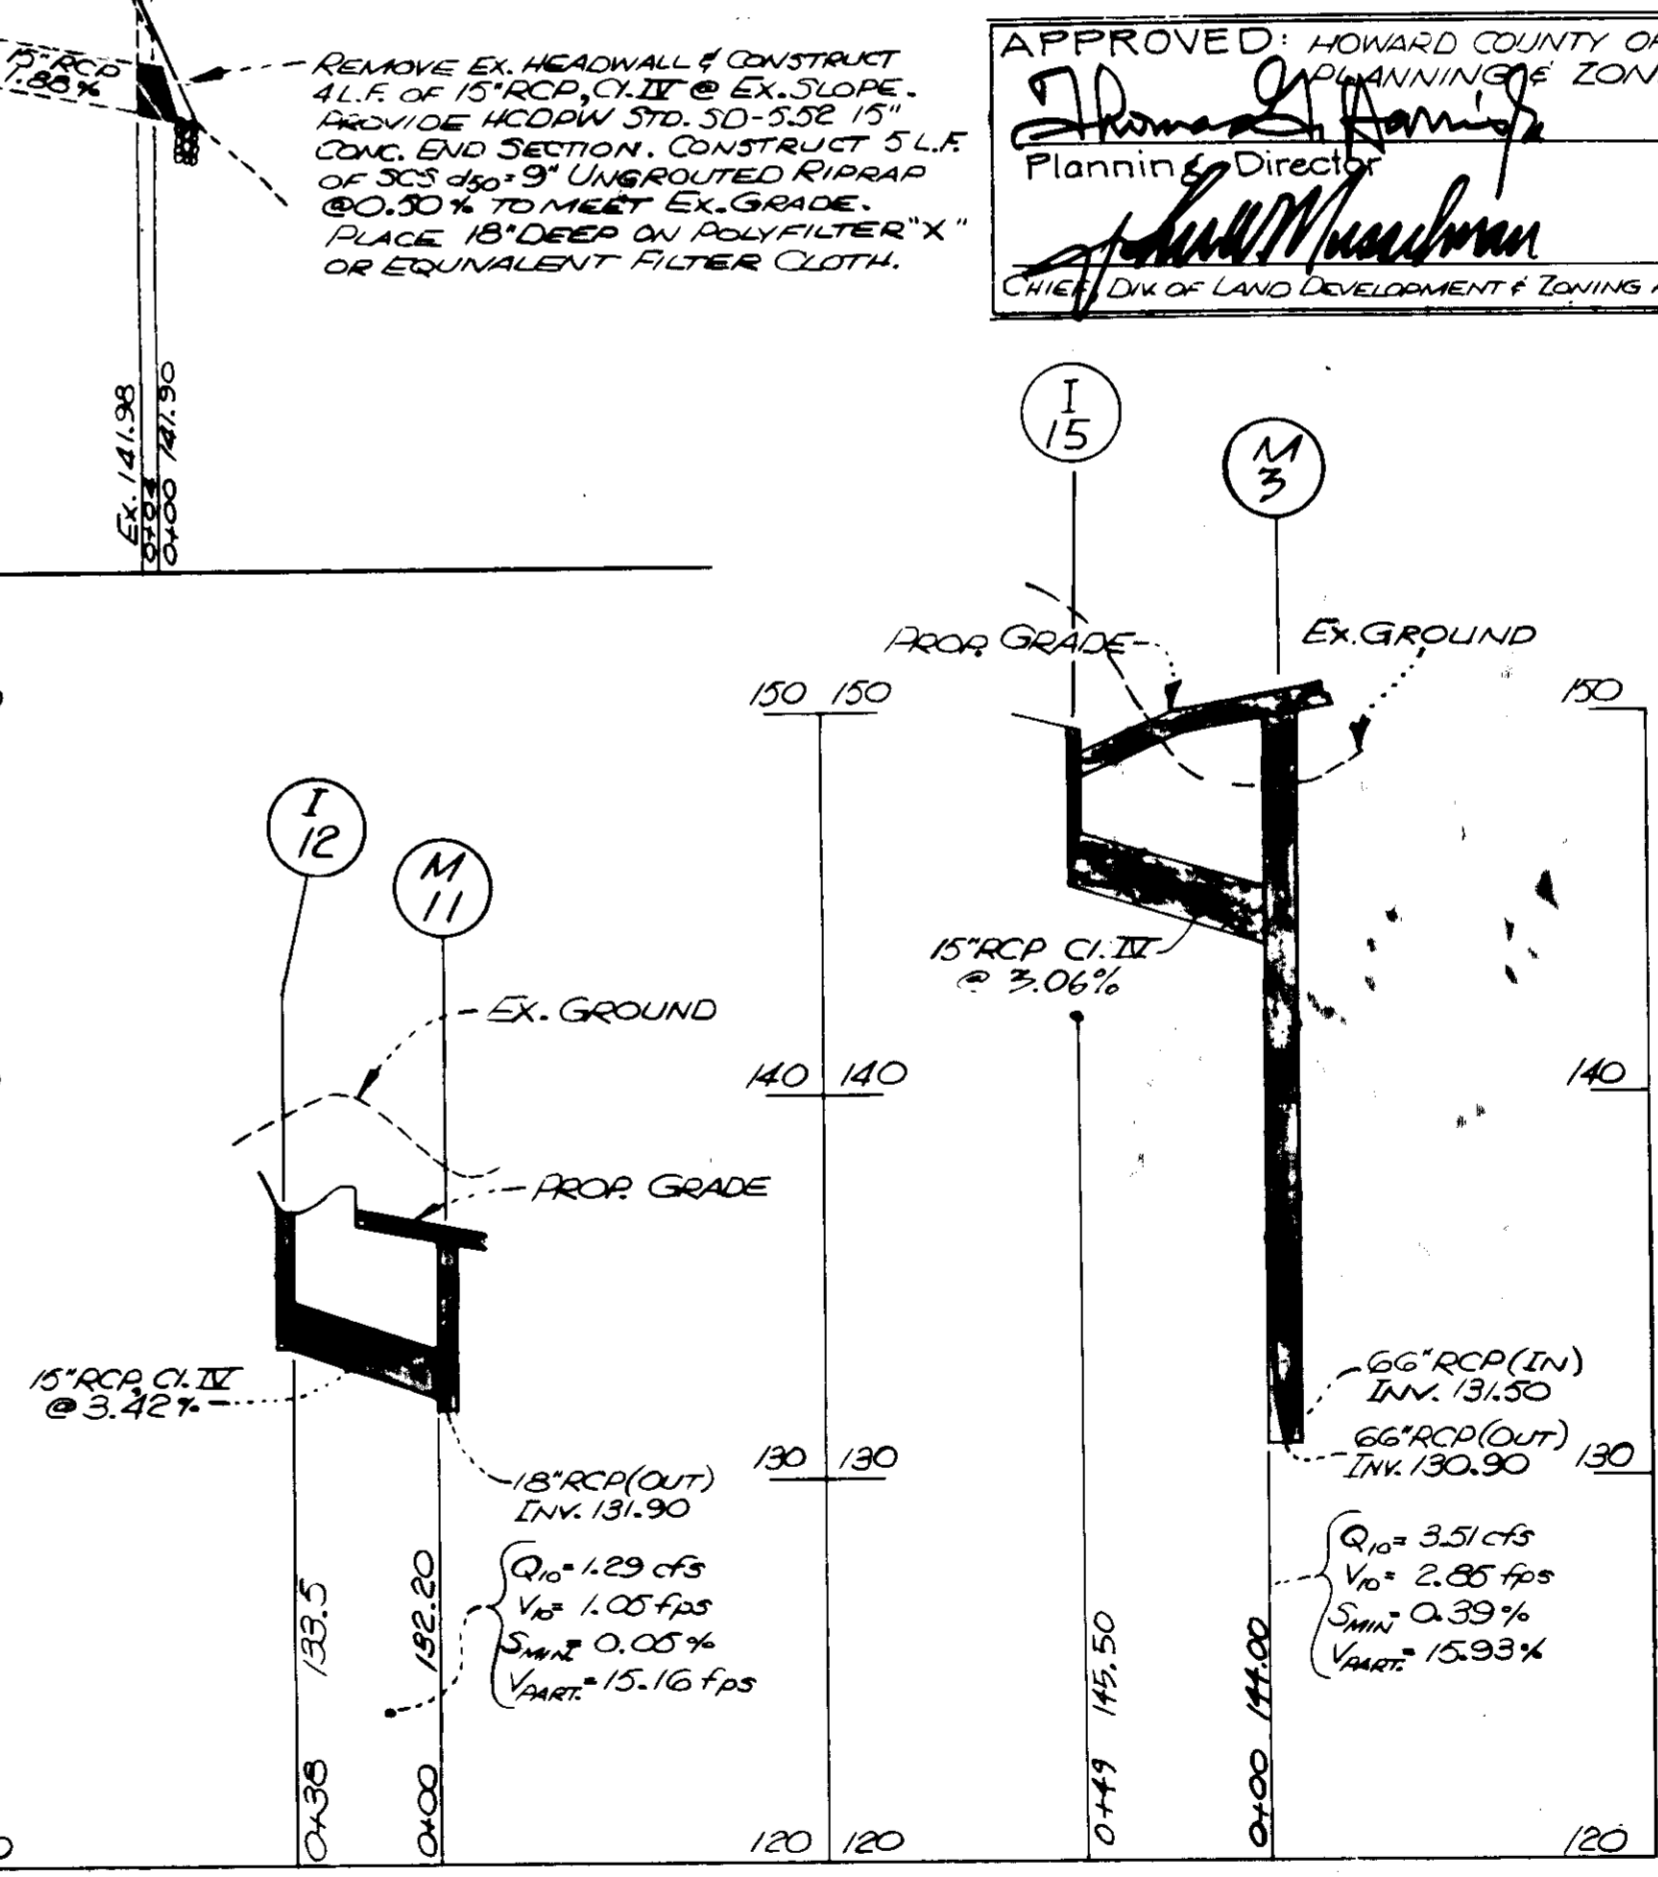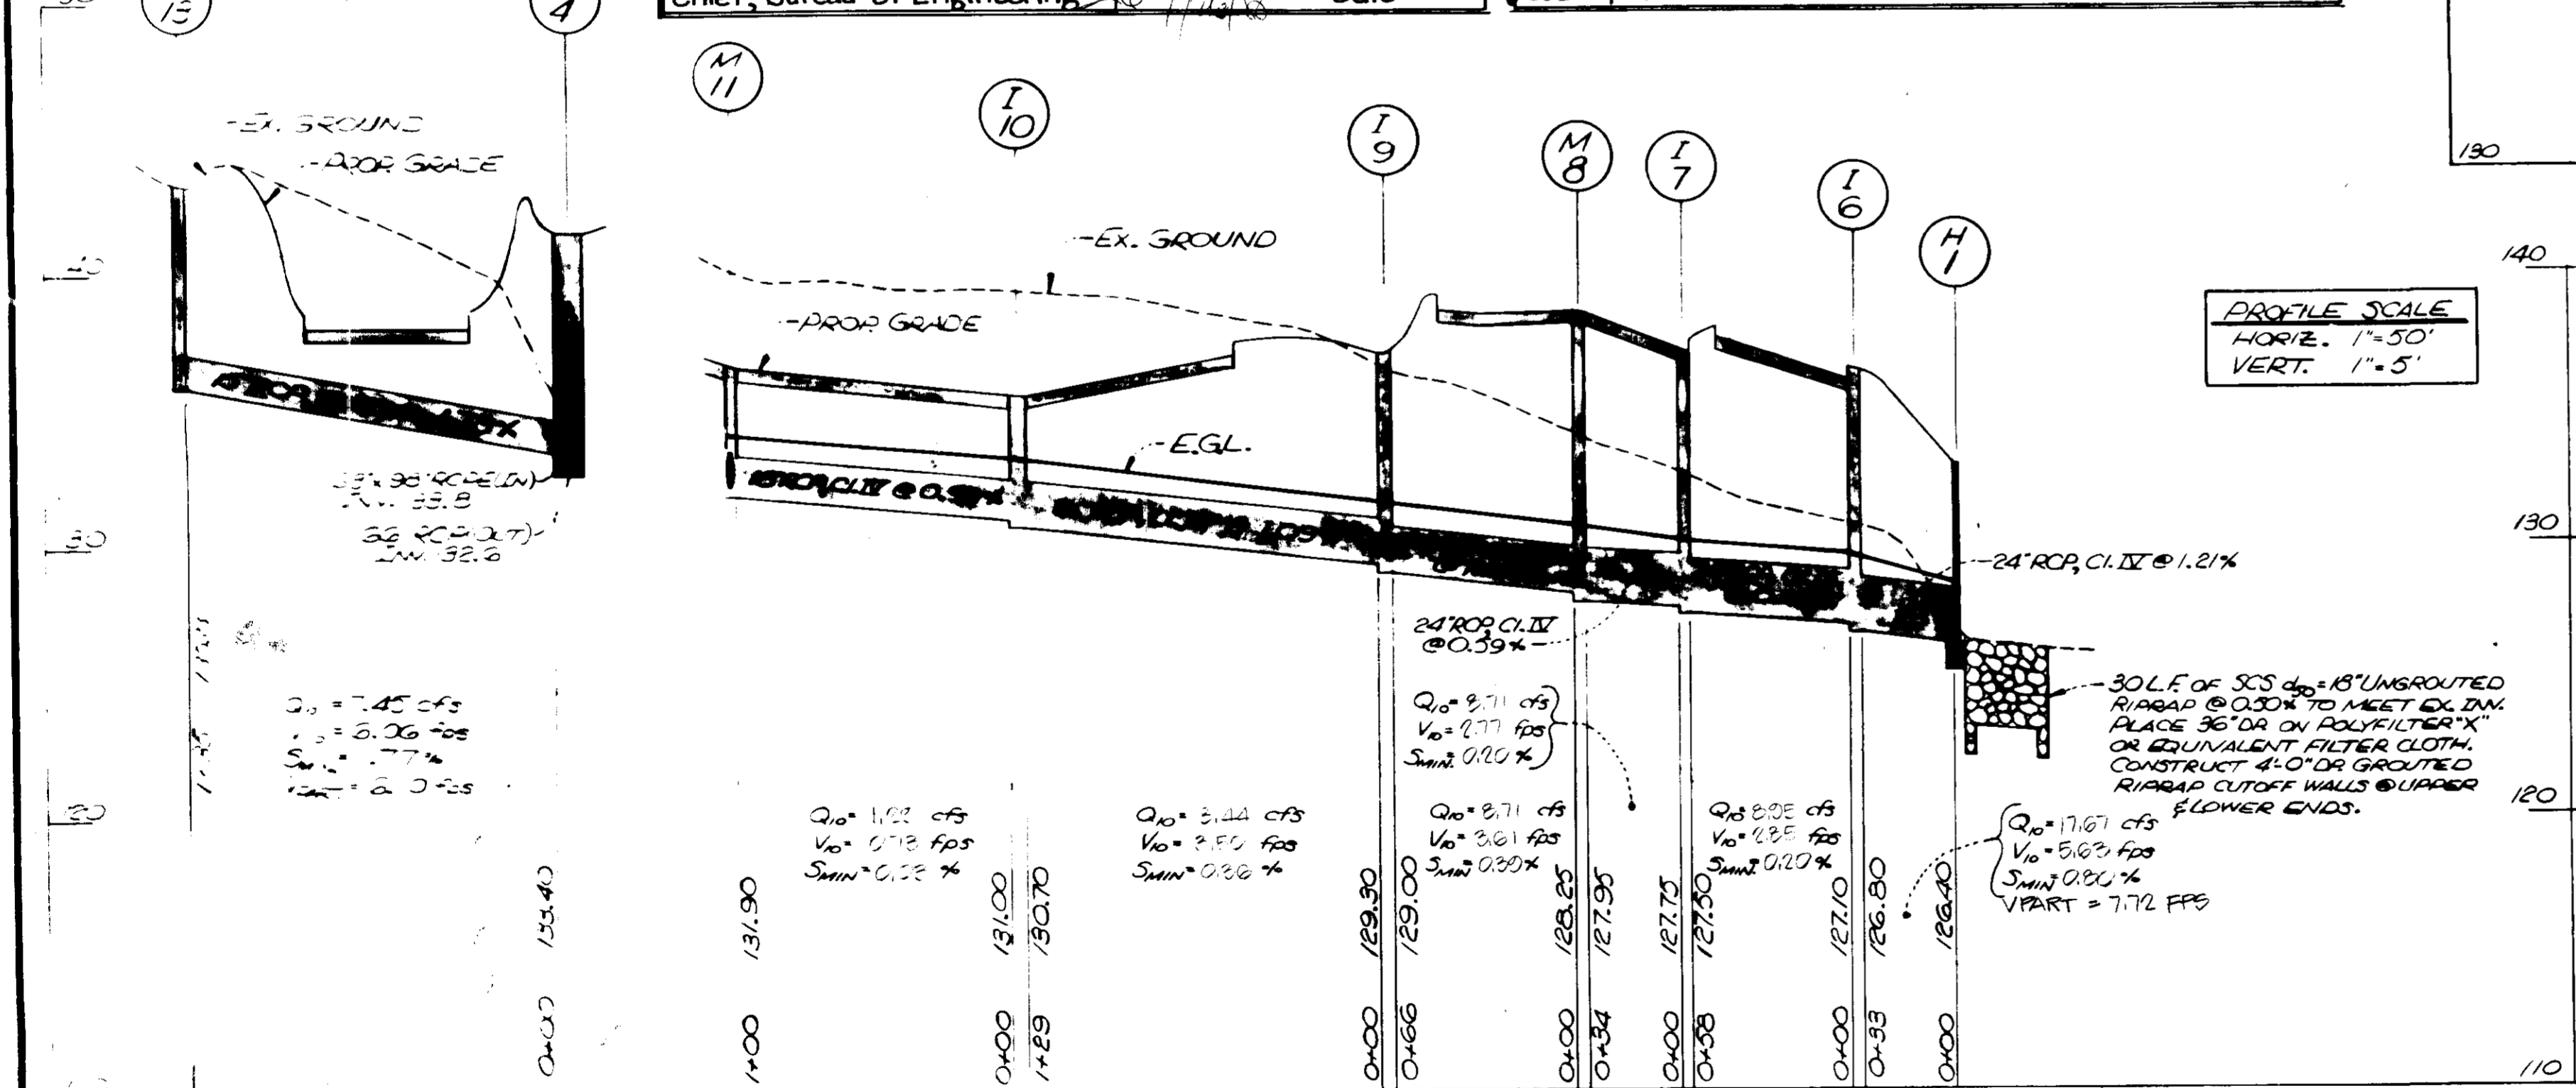

NOTE: SEE SH. 2 OF 9 FOR STD. FINISH & CURB SECTIONS

NOTE: SEE SH. 2 OF 9 FOR STD. FINISH & CURB SECTIONS

**OWNER:**  
 DORSEY BUSINESS CENTER LTD. PARTNERSHIP  
 7223 PARKWAY DRIVE  
 HANOVER, MARYLAND 21076  
 PHONE: (301) 796-4446

No.	REVISION	DATE	BY
1	HI TO M11, Q'S, V'S, SMIN UPDATED TO CONFORM TO APPROVED CONF.	8/12/85	BJP

ENGINEERS • ARCHITECTS • PLANNERS • SCIENTISTS • SURVEYORS • PHOTOGRAMMETRISTS

**GREENHORNE & O'MARA, INC.**  
 2 RESEARCH PLACE, ROCKVILLE, MARYLAND 20850  
 (301) 948-0900

GREENBELT, MD • ANNAPOLIS, MD • ATLANTA, GA • BECKLEY, WV • CULPER, VA • DENVER, CO  
 FAIRFAX, VA • GREENSBORO, NC • MONROE, MI • EXPORT, PA • WILLISTON PARK, NY

STORM DRAINAGE PROFILES & DETAILS

**PARCEL II**  
 DORSEY BUSINESS CENTER

ELECTION DISTRICT # 1  
 HOWARD COUNTY, MARYLAND

JSL DESIGN SCALE AS SHOWN  
 EB DRAWN 8 OF 9  
 RHM CHECKED SHEET  
 MAR 85 DATE JOB No. R-1114-X FILE No.  
 SDP-85-154



PARTS I, II & III

PART I

1. Approximate location of existing mains are shown. The contractor shall take all necessary precautions to protect existing mains and services and maintain uninterrupted supply. Any damage incurred shall be repaired immediately to the satisfaction of the Engineer, at the Contractor's expense.
2. All horizontal controls are based on Maryland State Coordinates.
3. All vertical controls are based on U.S.G.S Datum.
4. All pipe elevations shown are Invert elevations.
5. Clear all utilities by a minimum of 6'. Clear all poles by 2'-0" minimum or tunnels required. Any cost incurred to the contractor for tunneling or backing at pole shall be included in unit price bid for construction of the main.
6. For details not shown on the drawings use Howard County Standard Details.
7. For materials and construction methods use Howard County Standard Specifications.
8. Contractor shall locate existing utilities a minimum of two (2) weeks in advance of construction operations in the vicinity of proposed utilities at this own expense.
9. Contractor shall notify the following utilities or agencies at least five (5) working days before starting work shown on these plans:

- State Highway Administration - 531-5533
- Baltimore Gas & Electric Company - Underground Electric Distribution Customer Service - 685-0123
- Baltimore Gas & Electric Company - Underground Gas Distribution Customer Service - 685-0123
- Engineering - "Damage Control" - 234-5621
- Chesapeake & Potomac Telephone Company - 725-9976
- American Telephone & Telegraphy - Cable Location Division - 393-3553
- Colonial Pipe Company - 795-1390


10. Trees are to be protected from damage to maximum extent. Trees located within the construction strip are not to be removed or damaged by the contractor.
11. Contractor shall remove trees, stumps and roots along line of excavation as directed by the Engineer. Payment for such removal shall be included in the unit price bid for construction of the main.
12. Place regulation "Men Working" and warning signs as required to comply with Maryland State Highway Administration Manual of Traffic Control for Highway Construction and Maintenance Operations.

WATER - PART II

1. All water mains to be C.I.P. or D.I.P. unless otherwise noted.
2. Top of all water mains to have a minimum of 3 1/2' cover unless otherwise noted.
3. Valves adjacent to tees shall be strapped to tees.
4. Block all fittings with concrete.
5. Bury line elevations on fire hydrants shall be set to the elevations shown on the drawings. All fire hydrants shall be strapped and buttressed with concrete in accordance with standard details. Soil around the fire hydrant to be compacted in accordance with Sections 10.03 and 10.08 of the Standard Specifications.
6. All water house connections shall be for an inside meter setting.
7. The contractor shall not operate any water main valves on the existing system.
8. For all copper water house connections, utilize flared type fittings only.

SEWER - PART III


1. All sewer mains shall be CSPX, RCSP, VCPX, ACP Class 2400 or PVC unless otherwise noted.
2. The contractor shall provide a joint in all sewer main within 2'0" of exterior manhole wall.

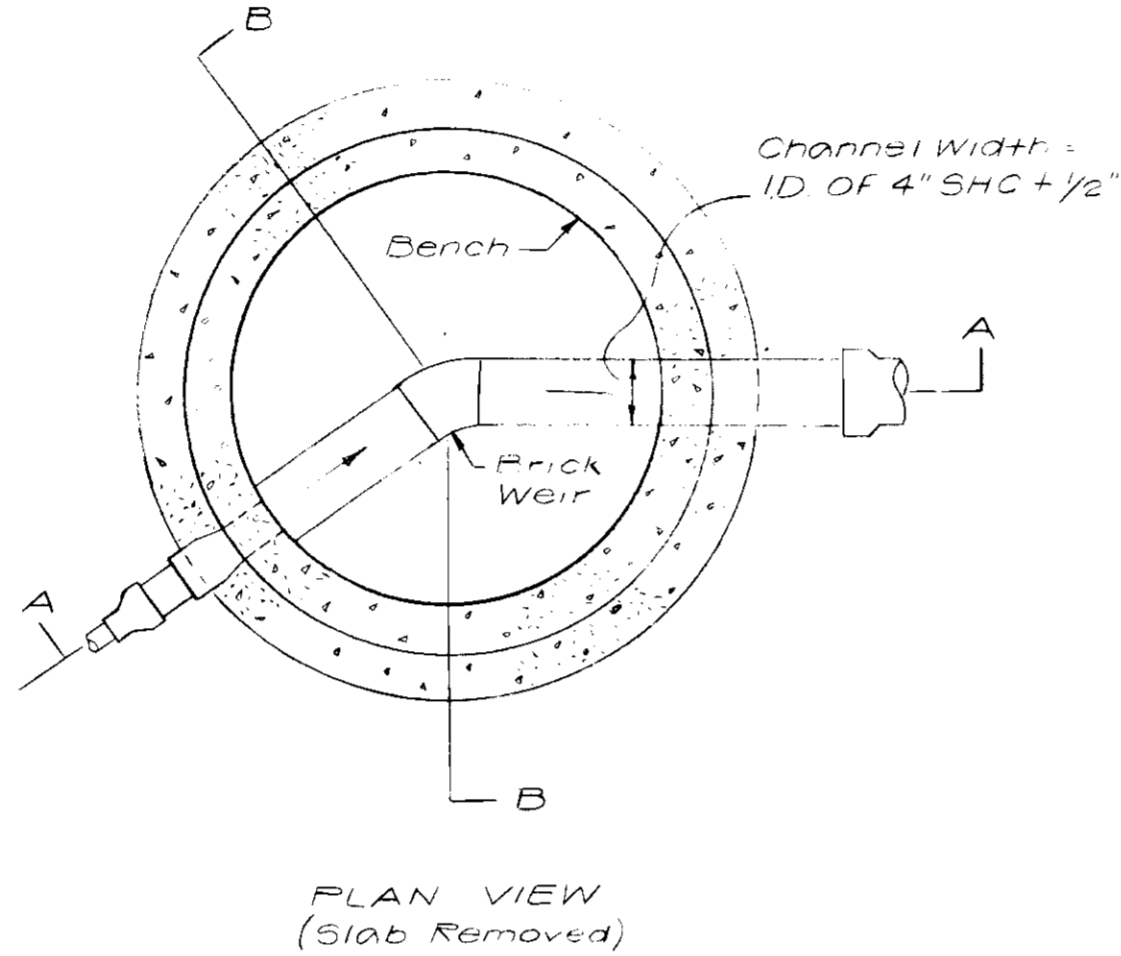


ELEVATION & FITTING SCHEDULE

A	Pressure Sewer Influent Invert Elev
B	Sewer Effluent Invert Elevation
C	Weir Top Elevation
D	Manhole Frame Elevation
E	P.V.C. Bell-End Section
F	P.V.C. Nipple
G	P.V.C. Reducer
H	P.V.C. Pressure Sewer




FOR SPECIFIC ELEVATIONS AND FITTING SIZES, SEE PLAN SHEET

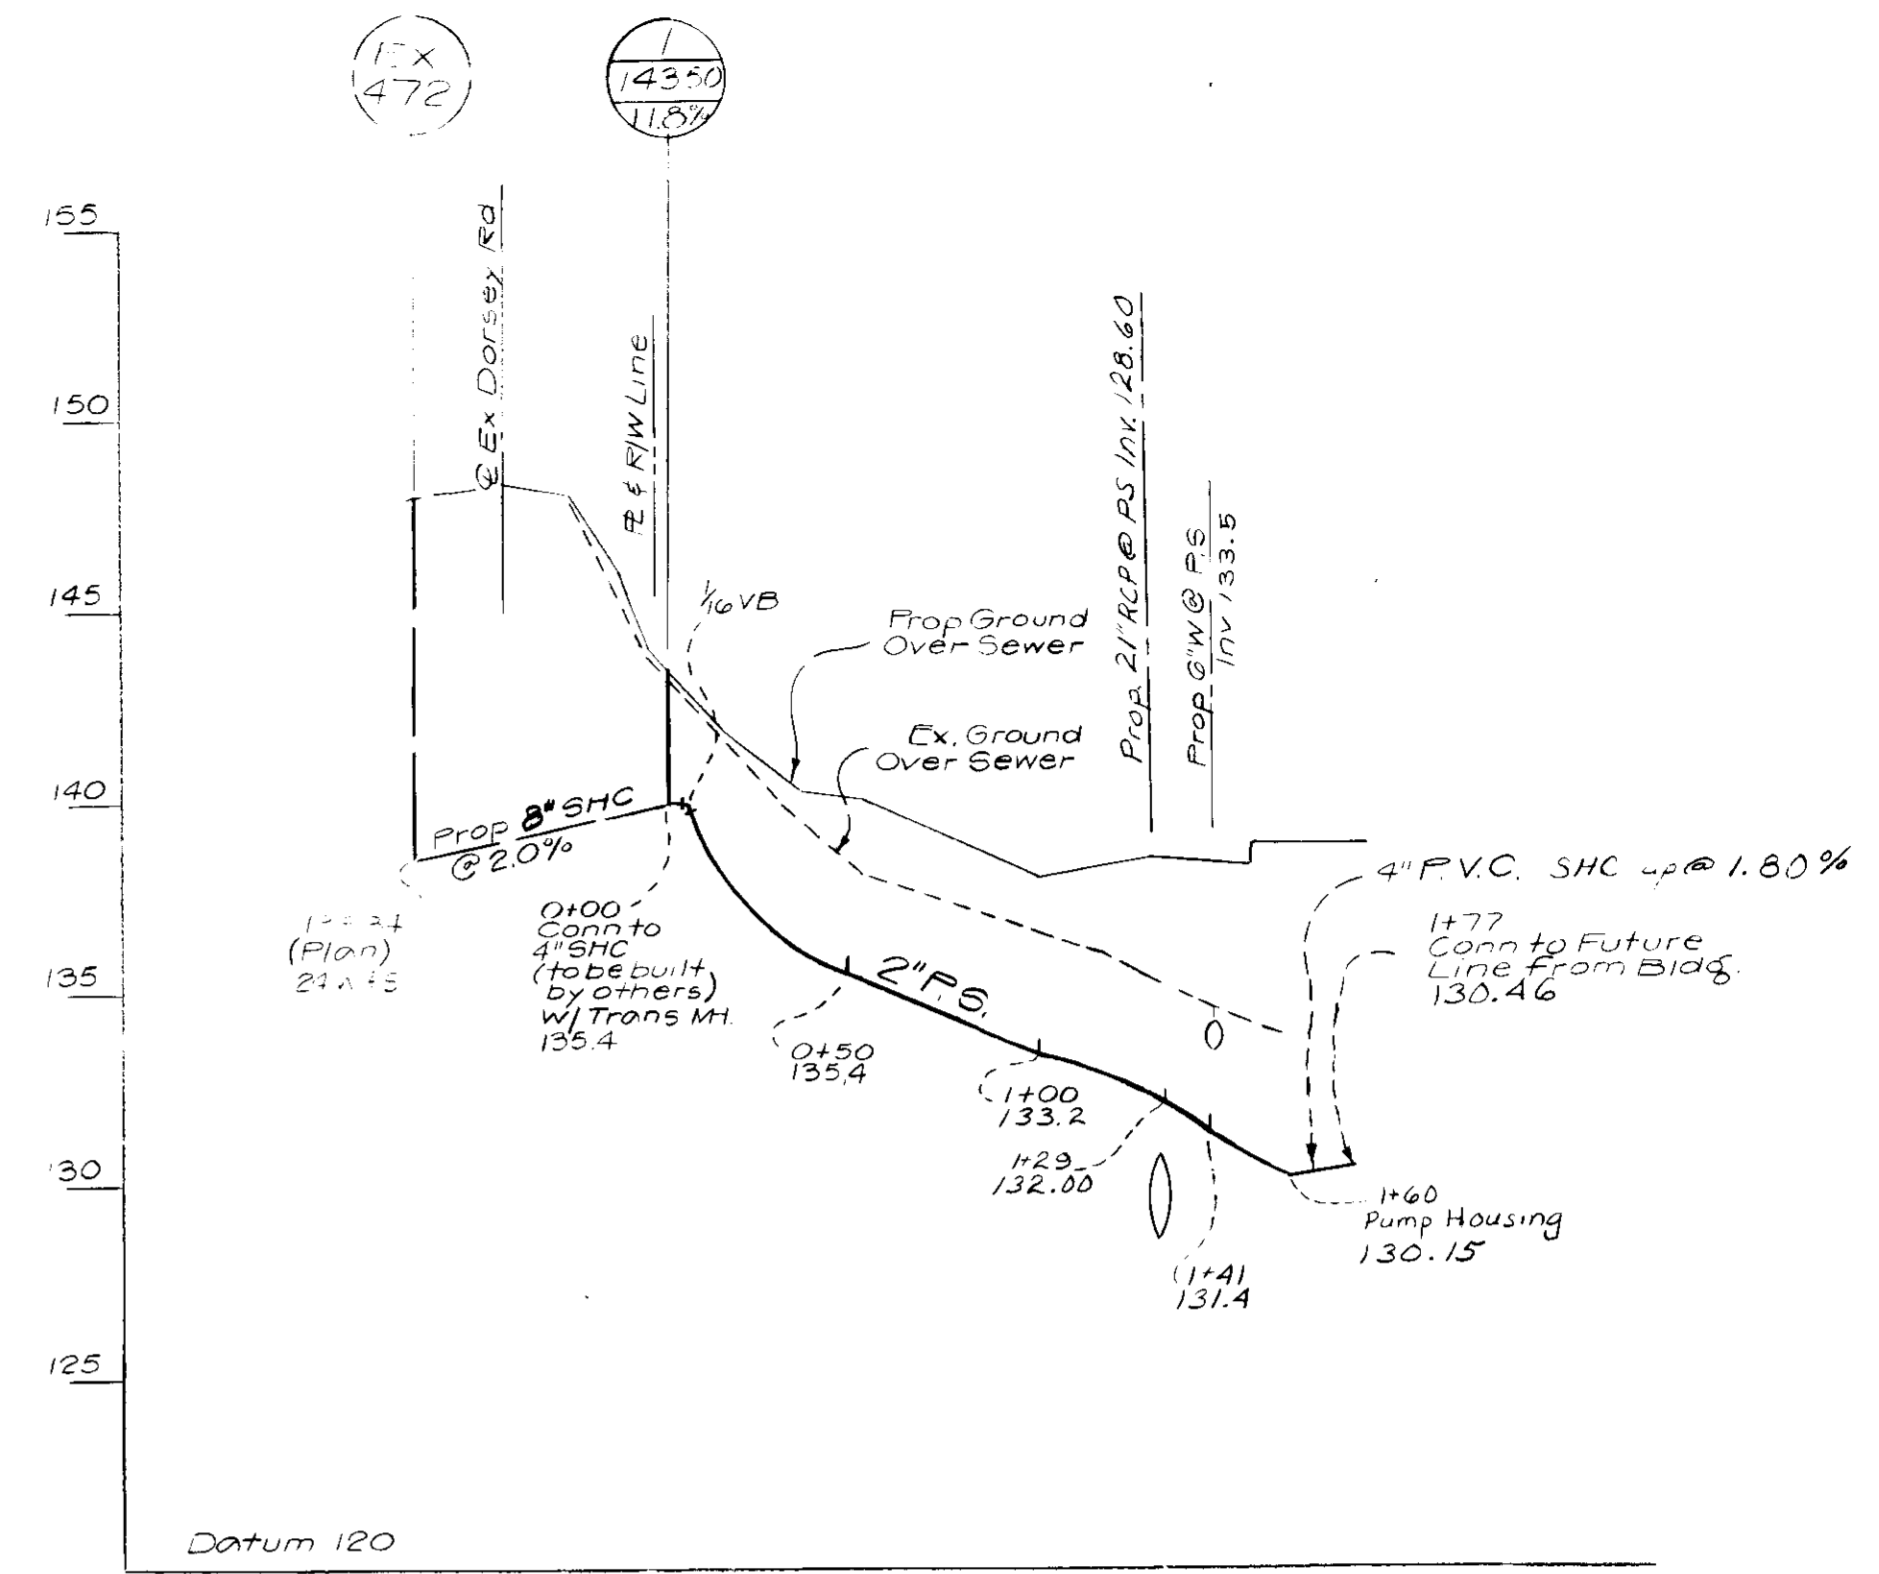

PROFILE SCALE  
Vert 1" = 5'  
Hor 1" = 50'

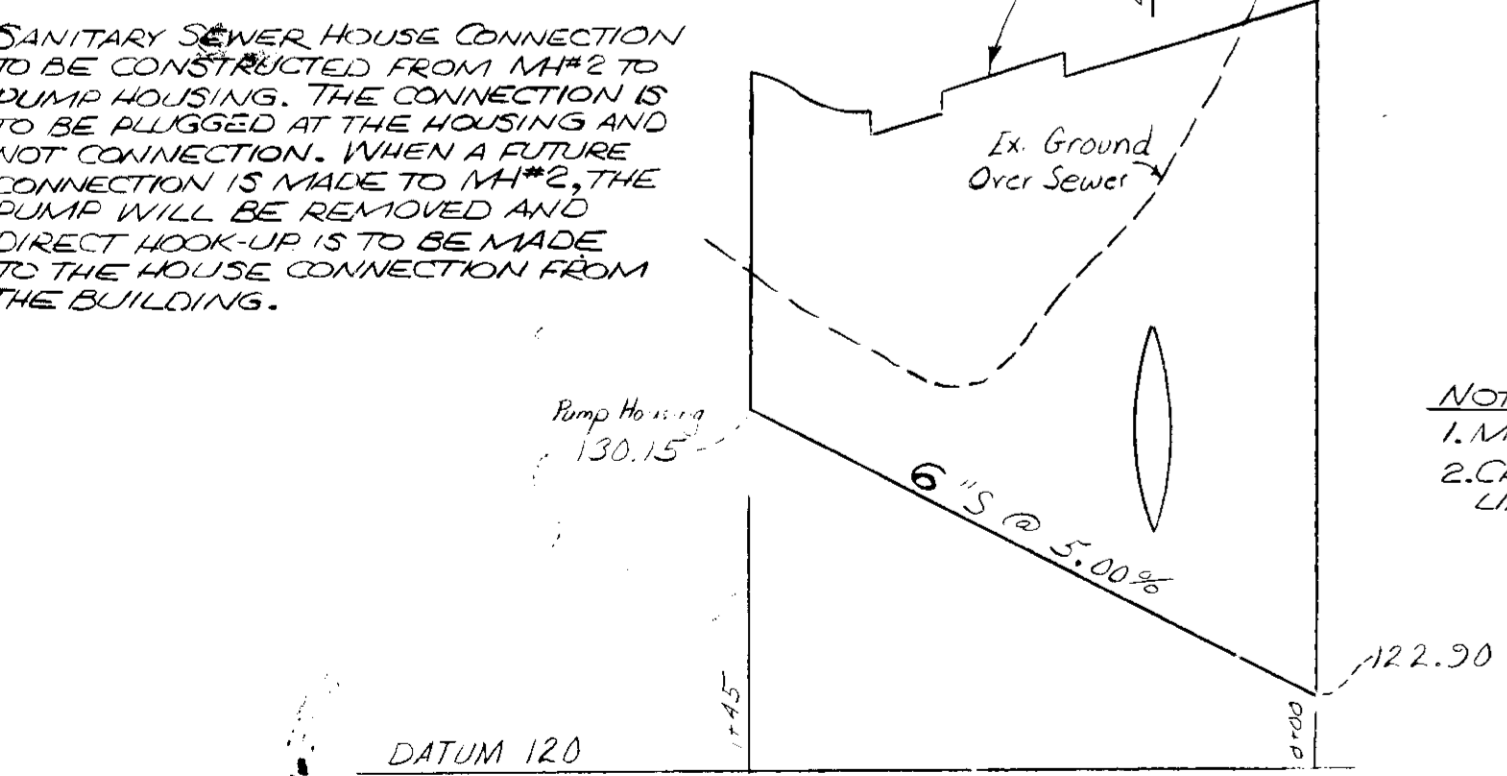

NOTES:  
1. MH 2 TO BE HOWARD CO. STD. G5.01 MANHOLE  
2. CHANNEL LINING TO BE 90° TO PROPERTY LINE WITH 3\"/>

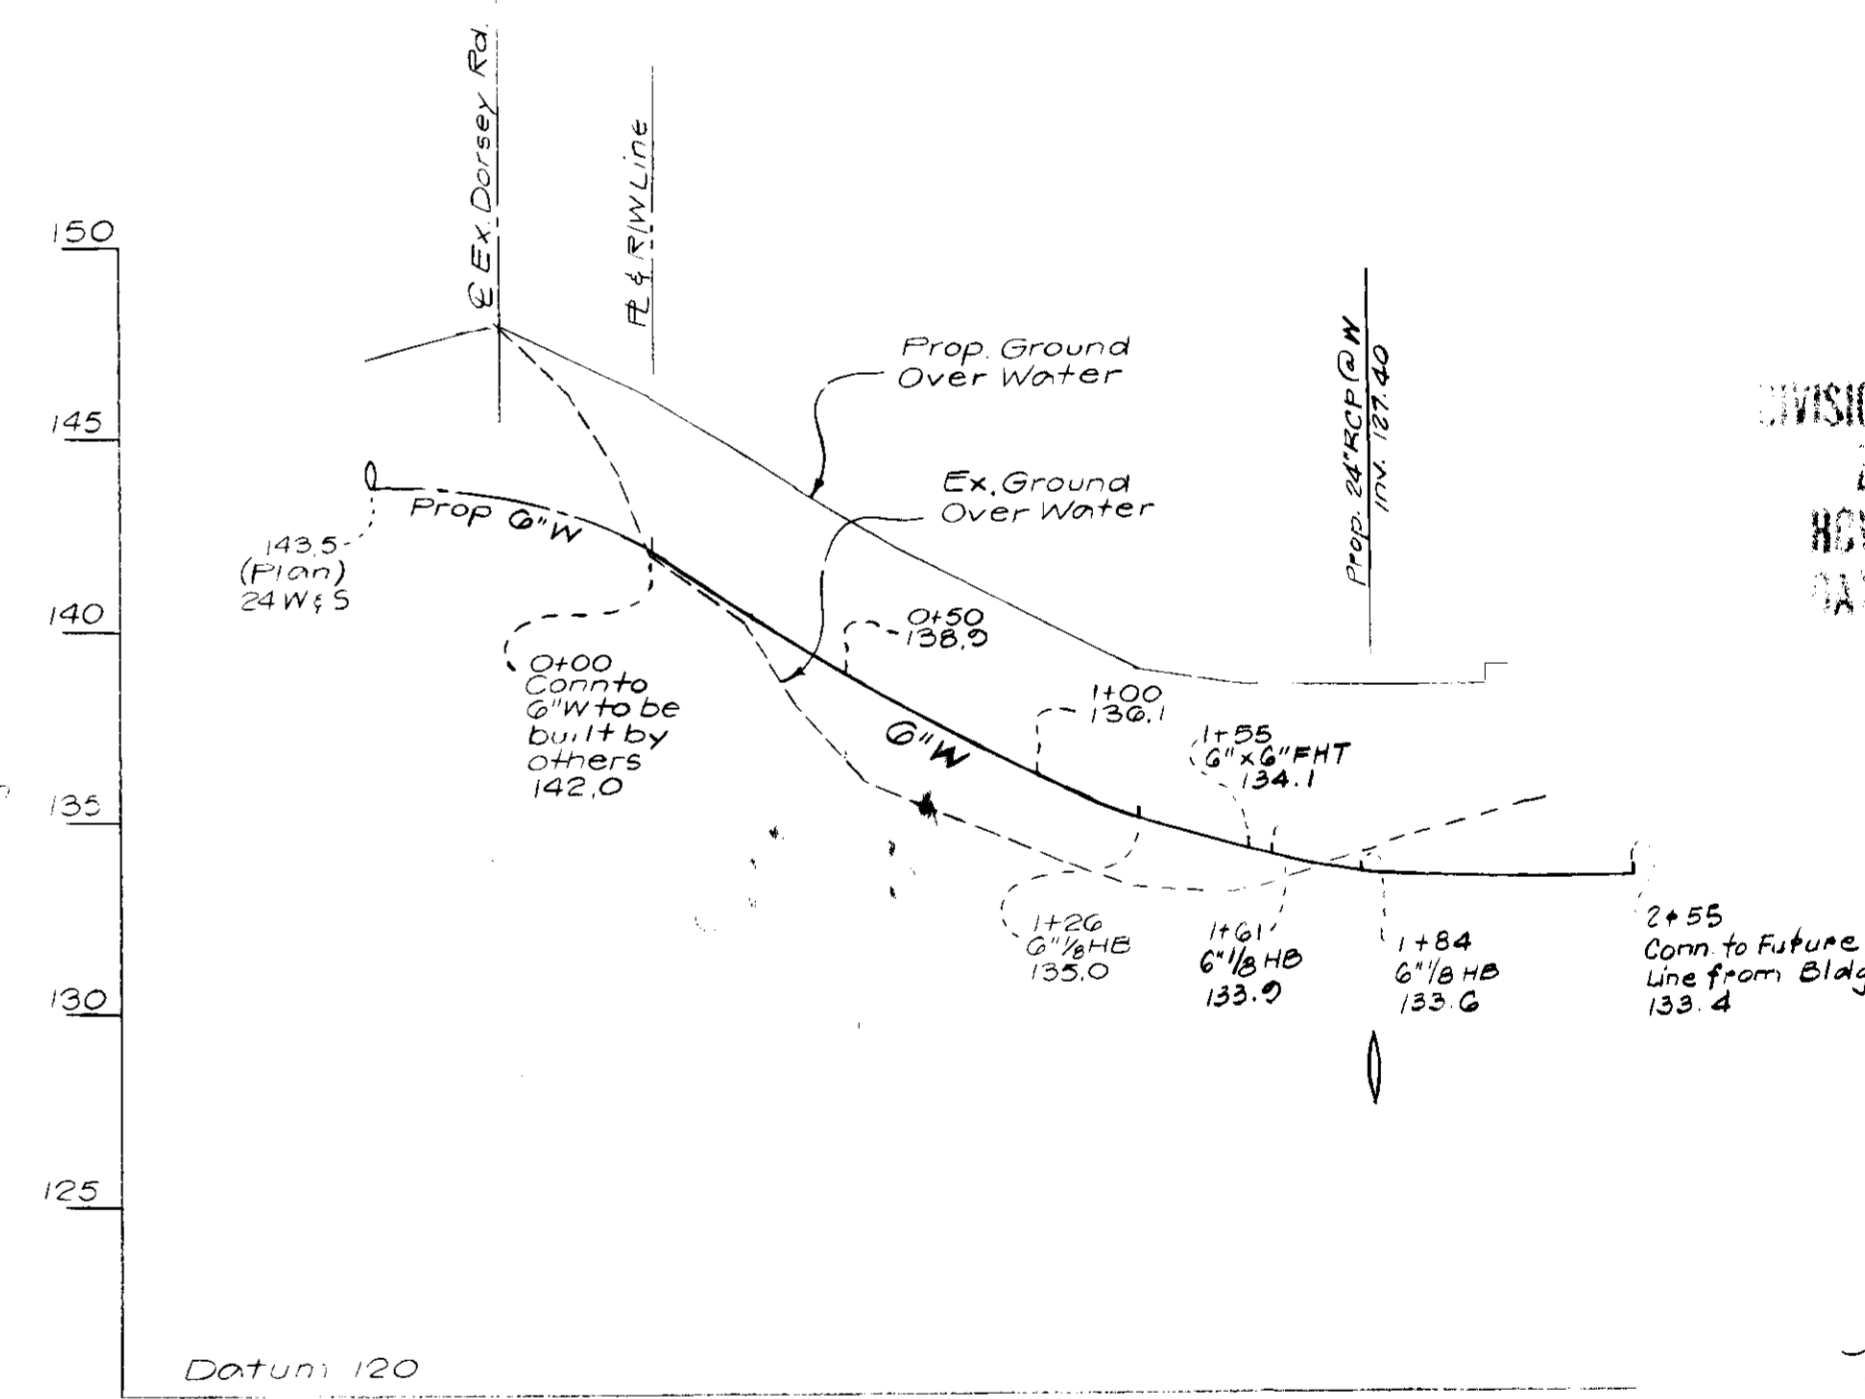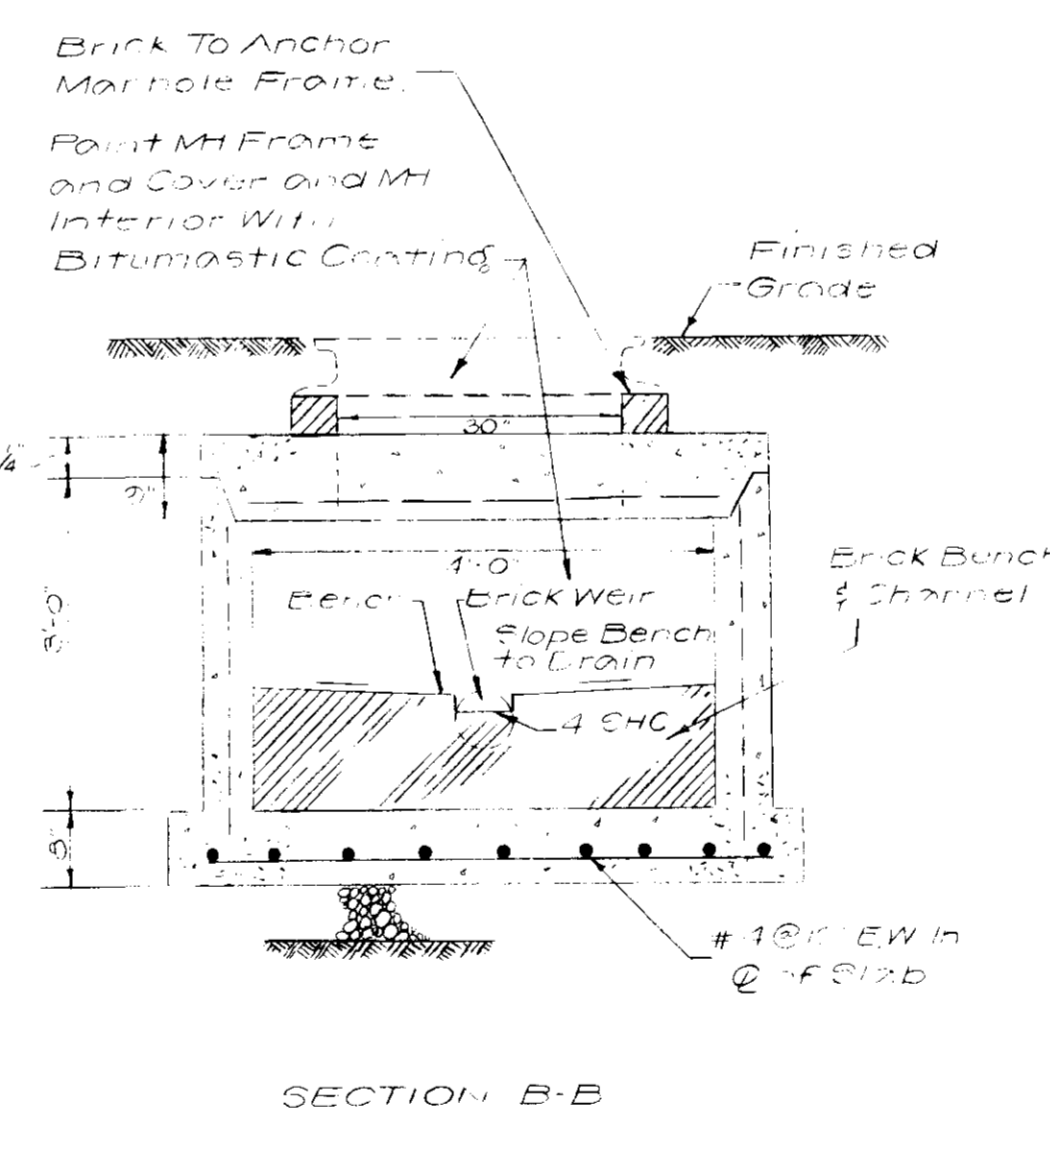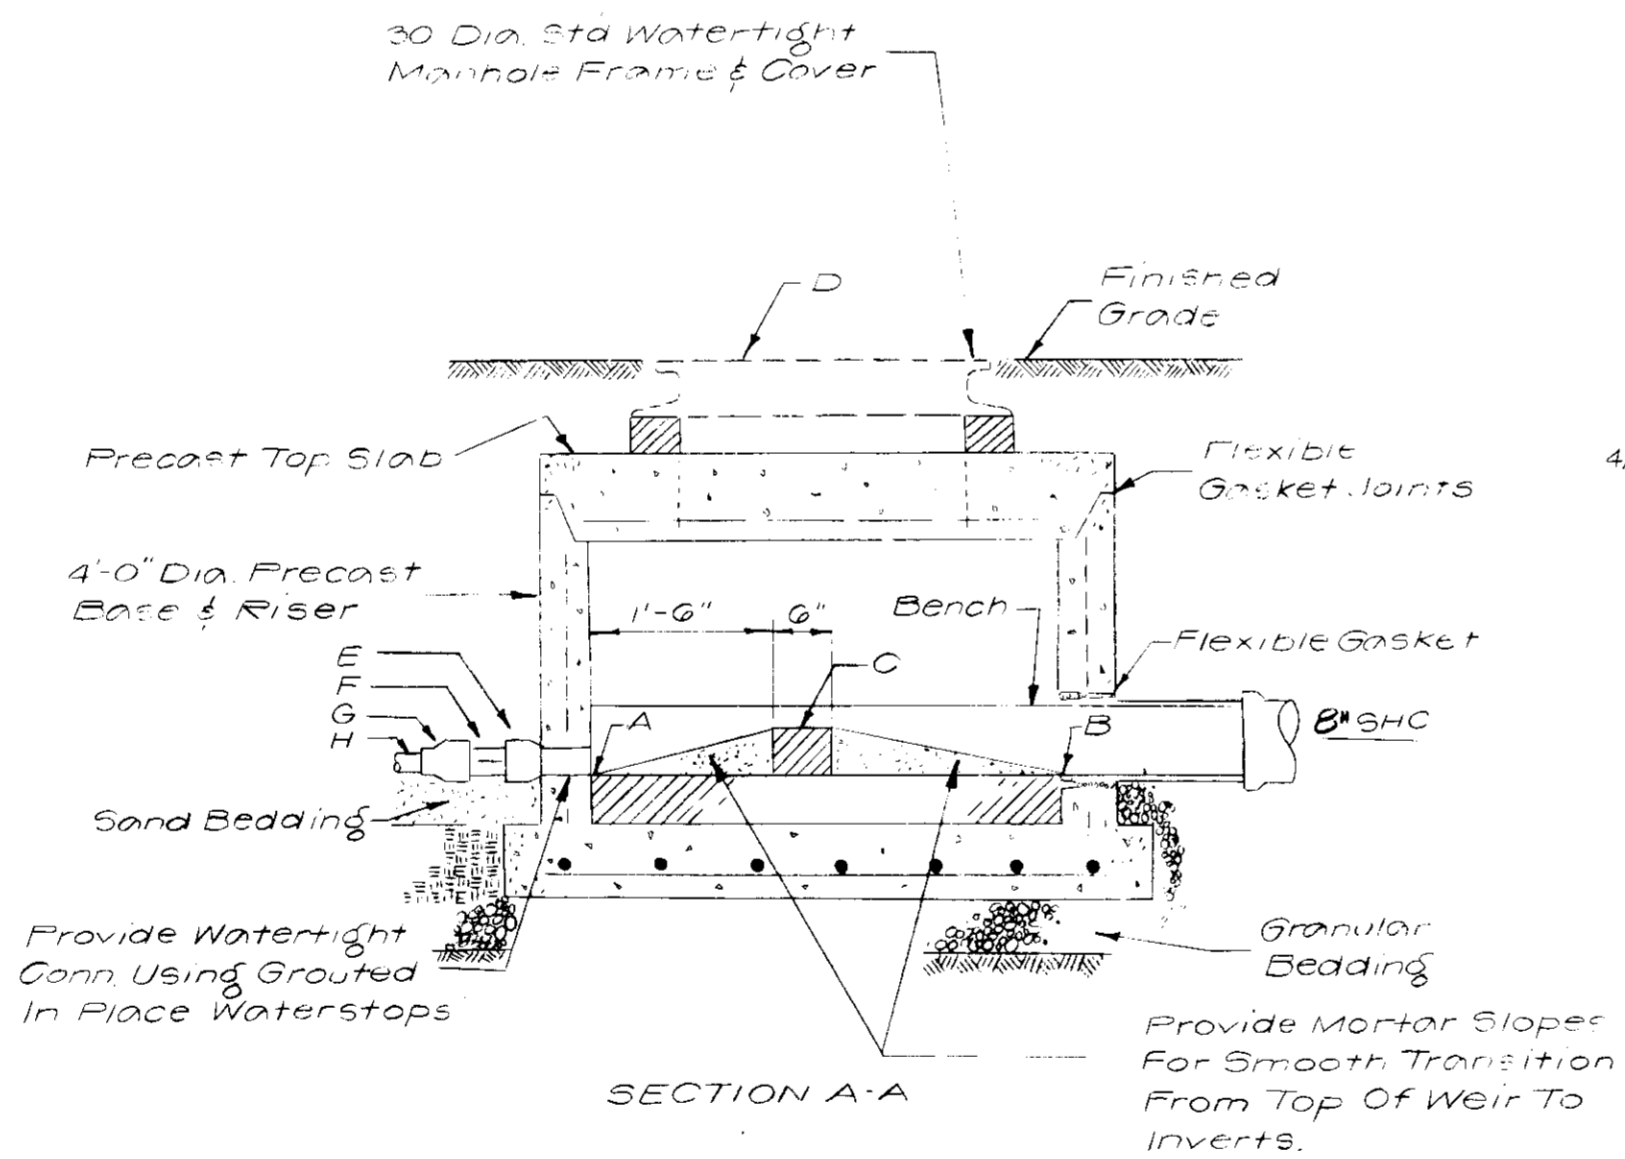

SEE CONTRACT 14-1383D  
FOR WATER & SEWER WORK IN Public R.O.W.

APPROVED  
DIVISION OF LAND DEVELOPMENT & ZONING ADMINISTRATION  
HOWARD COUNTY, MARYLAND  
DATE 6-17-85

M.D. & C.M.

APPROVED: FOR PUBLIC WATER, PUBLIC SEWERAGE & STORM DRAINAGE SYSTEMS AND PUBLIC ROADS  
HOWARD COUNTY DEPT OF PUBLIC WORKS  
Director: [Signature] Date: 6-24-85  
Chief Bureau of Engineering

APPROVED: For Public Water & Public Sewerage Systems  
HOWARD COUNTY HEALTH DEPARTMENT  
[Signature] Date: 7-29-85  
County Health Officer

APPROVED: HOWARD COUNTY OFFICE OF PLANNING & ZONING  
[Signature] Date: 7-30-85  
Chief, Div. of Land Development & Zoning Administration

OWNER:  
DORSEY BUSINESS CENTER LTD. PARTNERSHIP  
7223 PARKWAY DRIVE  
HANOVER, MARYLAND  
PHONE: (301) 790-4446

No.	REVISION	DATE	BY



ENGINEERS • ARCHITECTS • PLANNERS • SCIENTISTS • SURVEYORS • PHOTOGRAMMETRISTS  
**GREENHORNE & O'MARA, INC.**  
2 RESEARCH PLACE, ROCKVILLE, MARYLAND 20850  
(301) 948-0900  
GREENBELT, MD • ANNAPOLIS, MD • ATLANTA, GA • BECKLEY, WV • CULPEPER, VA • DENVER, CO  
FAIRFAX, VA • GREENSBORO, NC • MONROE, MI • EXPORT, PA • WILLISTON PARK, NY

WATER AND SEWER PROFILE, DETAIL SHEET  
**DORSEY BUSINESS CENTER**  
PARCEL II  
ELECTION DISTRICT NO. 1 HOWARD COUNTY

RGB DESIGN	SCALE AS SHOWN
RGB DRAWN	9 OF 9
BDE CHECKED	SHEET
Mar 85 DATE	R-114-X FILE No.
JOB No.	SDP-85-154