

**PERMANENT SEEDING NOTES**

Apply to graded or cleared areas not subject to immediate further disturbance where a permanent long-lived vegetative cover is needed.

**Seeding Preparation:** Loosen upper three inches of soil by raking, discing or other acceptable means before seeding.

**Soil Amendments:** In lieu of soil test recommendations, use one of the following schedules:

- 1) Preferred - Apply 2 tons per acre dolomitic limestone (92 lbs/1000 sq ft) and 600 lbs per acre 10-10-10 fertilizer (14 lbs/1000 sq ft) before seeding. Harrow or disc into upper three inches of soil. At time of seeding, apply 400 lbs per acre 20-0-0 urethane fertilizer (9 lbs/1000 sq ft).
- 2) Acceptable - Apply 2 tons per acre dolomitic limestone (92 lbs/1000 sq ft) and 1000 lbs per acre 10-10-10 fertilizer (23 lbs/1000 sq ft) before seeding. Harrow or disc into upper three inches of soil.

**Seeding -** For the periods March 1 thru April 30, and August 1 thru October 15, seed with 60 lbs per acre (1.4 lbs/1000 sq ft) of Kentucky 31 Tall Fescue. For the period May 1 thru July 31, seed with 60 lbs Kentucky 31 Tall Fescue per acre and 2 lbs per acre (0.5 lbs/1000 sq ft) of weeping lovegrass. During the period of October 16 thru February 28, protect site by: Option (1) 2 tons per acre of well anchored straw mulch and seed as soon as possible in the spring. Option (2) Use seed. Option (3) Seed with 60 lbs/acre Kentucky 31 Tall Fescue and mulch with 2 tons/acre well anchored straw.

**Mulching -** Apply 1 1/2 to 2 tons per acre (70 to 90 lbs/1000 sq ft) of unrotted small grain straw immediately after seeding. Anchor mulch immediately after application using mulch anchoring tool or 218 gal per acre (5 gal/1000 sq ft) of emulsified asphalt on flat areas. On slopes 8 feet or higher, use 348 gallons per acre (8 gal/1000 sq ft) for anchoring.

**Inspection -** Inspect all seeded areas and make needed repairs, replacements and reseedings.

**TEMPORARY SEEDING NOTES**

Apply to graded or cleared areas likely to be redisturbed where a short-term vegetative cover is needed.

**Seeding Preparation:** Loosen upper three inches of soil by raking, discing or other acceptable means before seeding.

**Soil Amendments:** Apply 600 lbs per acre 10-10-10 fertilizer (14 lbs/1000 sq ft).

**Seeding -** For periods March 1 thru April 30 and from August 15 thru November 15, seed with 25 bushels per acre of annual ryegrass (3.2 lbs/1000 sq ft). For the period May 1 thru August 15, seed with 3 lbs per acre of weeping lovegrass (0.7 lbs/1000 sq ft). For the period November 16 thru February 28, protect site by applying 2 tons per acre of well anchored straw mulch and seed as soon as possible in the spring, or use seed.

**Mulching:** Apply 1 1/2 to 2 tons per acre (70 to 90 lbs/1000 sq ft) of unrotted small grain straw immediately after seeding. Anchor mulch immediately after application using mulch anchoring tool or 218 gal per acre (5 gal/1000 sq ft) of emulsified asphalt on flat areas. On slopes 8 ft or higher, use 348 gal per acre (8 gal/1000 sq ft) for anchoring.

Refer to the 1983 MARYLAND STANDARDS AND SPECIFICATIONS FOR SOIL EROSION AND SEDIMENT CONTROL for rate and methods not covered.

**SEDIMENT CONTROL NOTES**

- 1) A minimum of 24 hours notice must be given to the Howard County Office of Inspection and Permitting prior to the start of any construction. (892-2437)
- 2) All vegetative and structural practices are to be installed according to the provisions of this plan and are to be in conformance with the 1983 MARYLAND STANDARDS AND SPECIFICATIONS FOR SOIL EROSION AND SEDIMENT CONTROL.
- 3) Following initial soil disturbance or redisturbance, permanent or temporary stabilization shall be completed within: a) 7 calendar days for all perimeter sediment control structures, dikes, perimeter slopes and all slopes greater than 3:1, b) 14 days as to all other disturbed or graded areas on the project site.
- 4) All sediment traps/basins shown must be fenced and warning signs posted around their perimeter in accordance with Vol. 1, Chapter 12, of the HOWARD COUNTY DESIGN MANUAL, Storm Drainage.
- 5) All disturbed areas must be stabilized within the time period specified above in accordance with the 1983 MARYLAND STANDARDS AND SPECIFICATIONS FOR SOIL EROSION AND SEDIMENT CONTROL for permanent seeding (Sec. 31) and (Sec. 32). Temporary stabilization with mulch alone can only be done when recommended seeding dates do not allow for proper germination and establishment of grasses.
- 6) All sediment control structures are to remain in place and are to be maintained in operative condition until permission for their removal has been obtained from the Howard County Sediment Control Inspector.
- 7) Site Analysis:
  - Total Area of Site: 1.943 Acres
  - Area Disturbed: 1.250 Acres
  - Area to be seeded or paved: 0.269 Acres
  - Area to be vegetatively stabilized: 0.985 Acres
  - Total Cut: 105.5 Cu. yds
  - Total Fill: 153.5 Cu. yds
  - Offsite waste/borrow area location: N/A
- 8) Any sediment control practice which is disturbed by grading activity for placement of utilities must be repaired on the same day of disturbance.
- 9) Additional sediment control must be provided, if deemed necessary by the Howard County DEW sediment control inspector.
- 10) On all sites with disturbed areas in excess of 2 acres, approval of the inspection agency shall be requested upon completion of installation of perimeter erosion and sediment controls, but before proceeding with any other earth disturbance or grading. Other building or grading inspection approvals may not be authorized until this initial approval by the inspection agency is made.
- 11) If houses are to be constructed on an "As-Built" basis, at random, single lot Sediment Control as shown below shall be implemented.
- 12) All pipes to be blocked at the end of each day (see detail below). N/A
- 13) The total amount of straw bale dikes/silt fence equals None.

**S.I.S.T. (ST-III) \* (See det above)**

D.A. = 1.9 Ac  
 Storage Required = 1.2 x 1800 = 3220 cf  
 Storage Provided = 3888 cf  
 Depth = 4'  
 Slot Elev = 374.5  
 Bottom Elev = 370.5  
 Bottom Dimensions: See Plan  
 Clean Out Elev = 374.5  
 \* 1" Side Slopes + Brick Shut Blots on N, S, & E Sides.

**APPROVED FOR PUBLIC WATER AND PUBLIC SEWERAGE SYSTEMS, HOWARD COUNTY HEALTH DEPARTMENT**

11-12-86

**APPROVED: HOWARD COUNTY OFFICE OF PLANNING & ZONING**


11-13-86

**APPROVED FOR PUBLIC WATER AND PUBLIC SEWERAGE, STORM DRAINAGE SYSTEMS AND PUBLIC ROADS, HOWARD COUNTY DEPARTMENT OF PUBLIC WORKS**

11-10-86


**CHIEF BUREAU OF ENGINEERING**

11-10-86

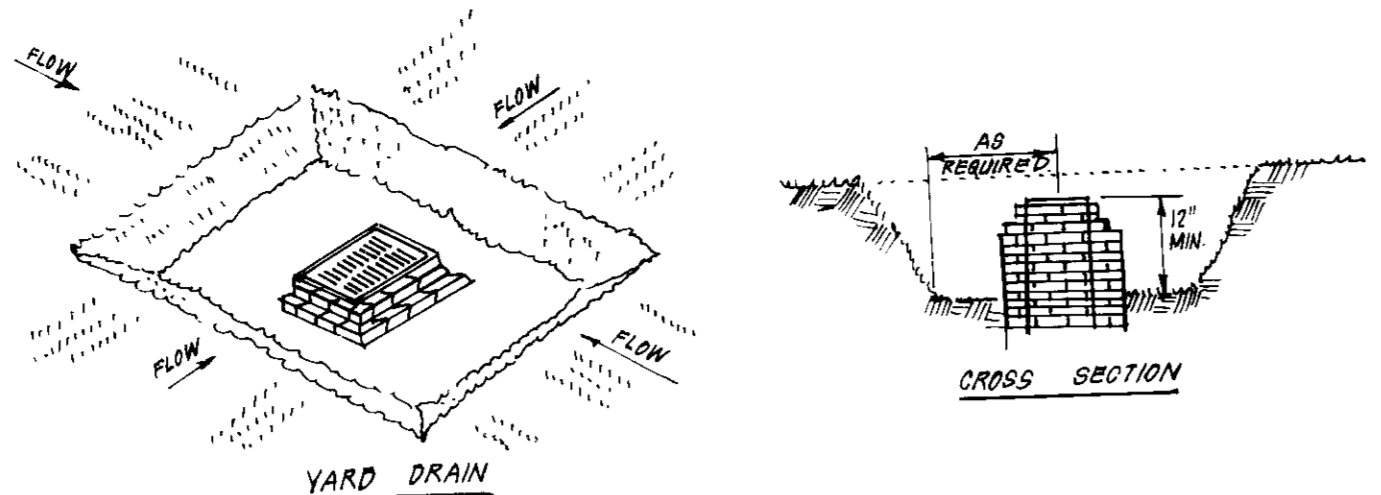

**CONSTRUCTION SPECIFICATIONS:**


1. Sediment trap shall be removed and the trap restored to its original dimensions when sediment has accumulated to the design depth of the trap. Removed sediment shall be deposited in a suitable area up to each structure that it will not erode.
2. The volume of sediment storage shall be 1000 cf/acre of contributory drainage.
3. The structure shall be inspected after each rain and repairs made as needed.
4. Construction operations shall be carried out in such a manner that erosion and water pollution shall be minimized.
5. The sediment trap shall be removed and the area stabilized when the constructed drainage area has been properly stabilized.
6. All cut slopes shall be 1:1 or flatter.

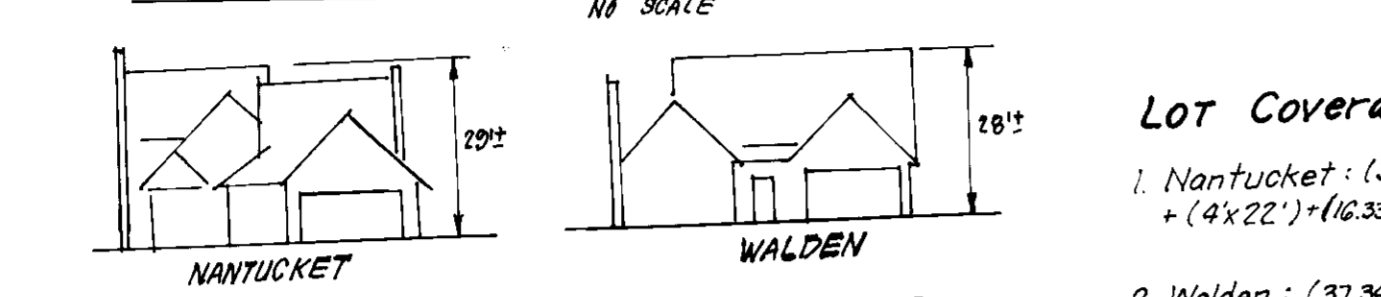

**TYPICAL HOUSES**  
 NO SCALE



**Lot Coverage:**

1. Nantucket: (31.34' x 44.17') + (25' x 22') + (4' x 22') + (6.33' x 6') = 2044.6 = 6815 sq ft  
 0.3 Min Lot Size
2. Walden: (37.34' x 20') + (31.67' x 10') + (53.34' x 20') + (6.27' x 10') = 2182 = 7290 sq ft  
 0.3 Min Lot Size

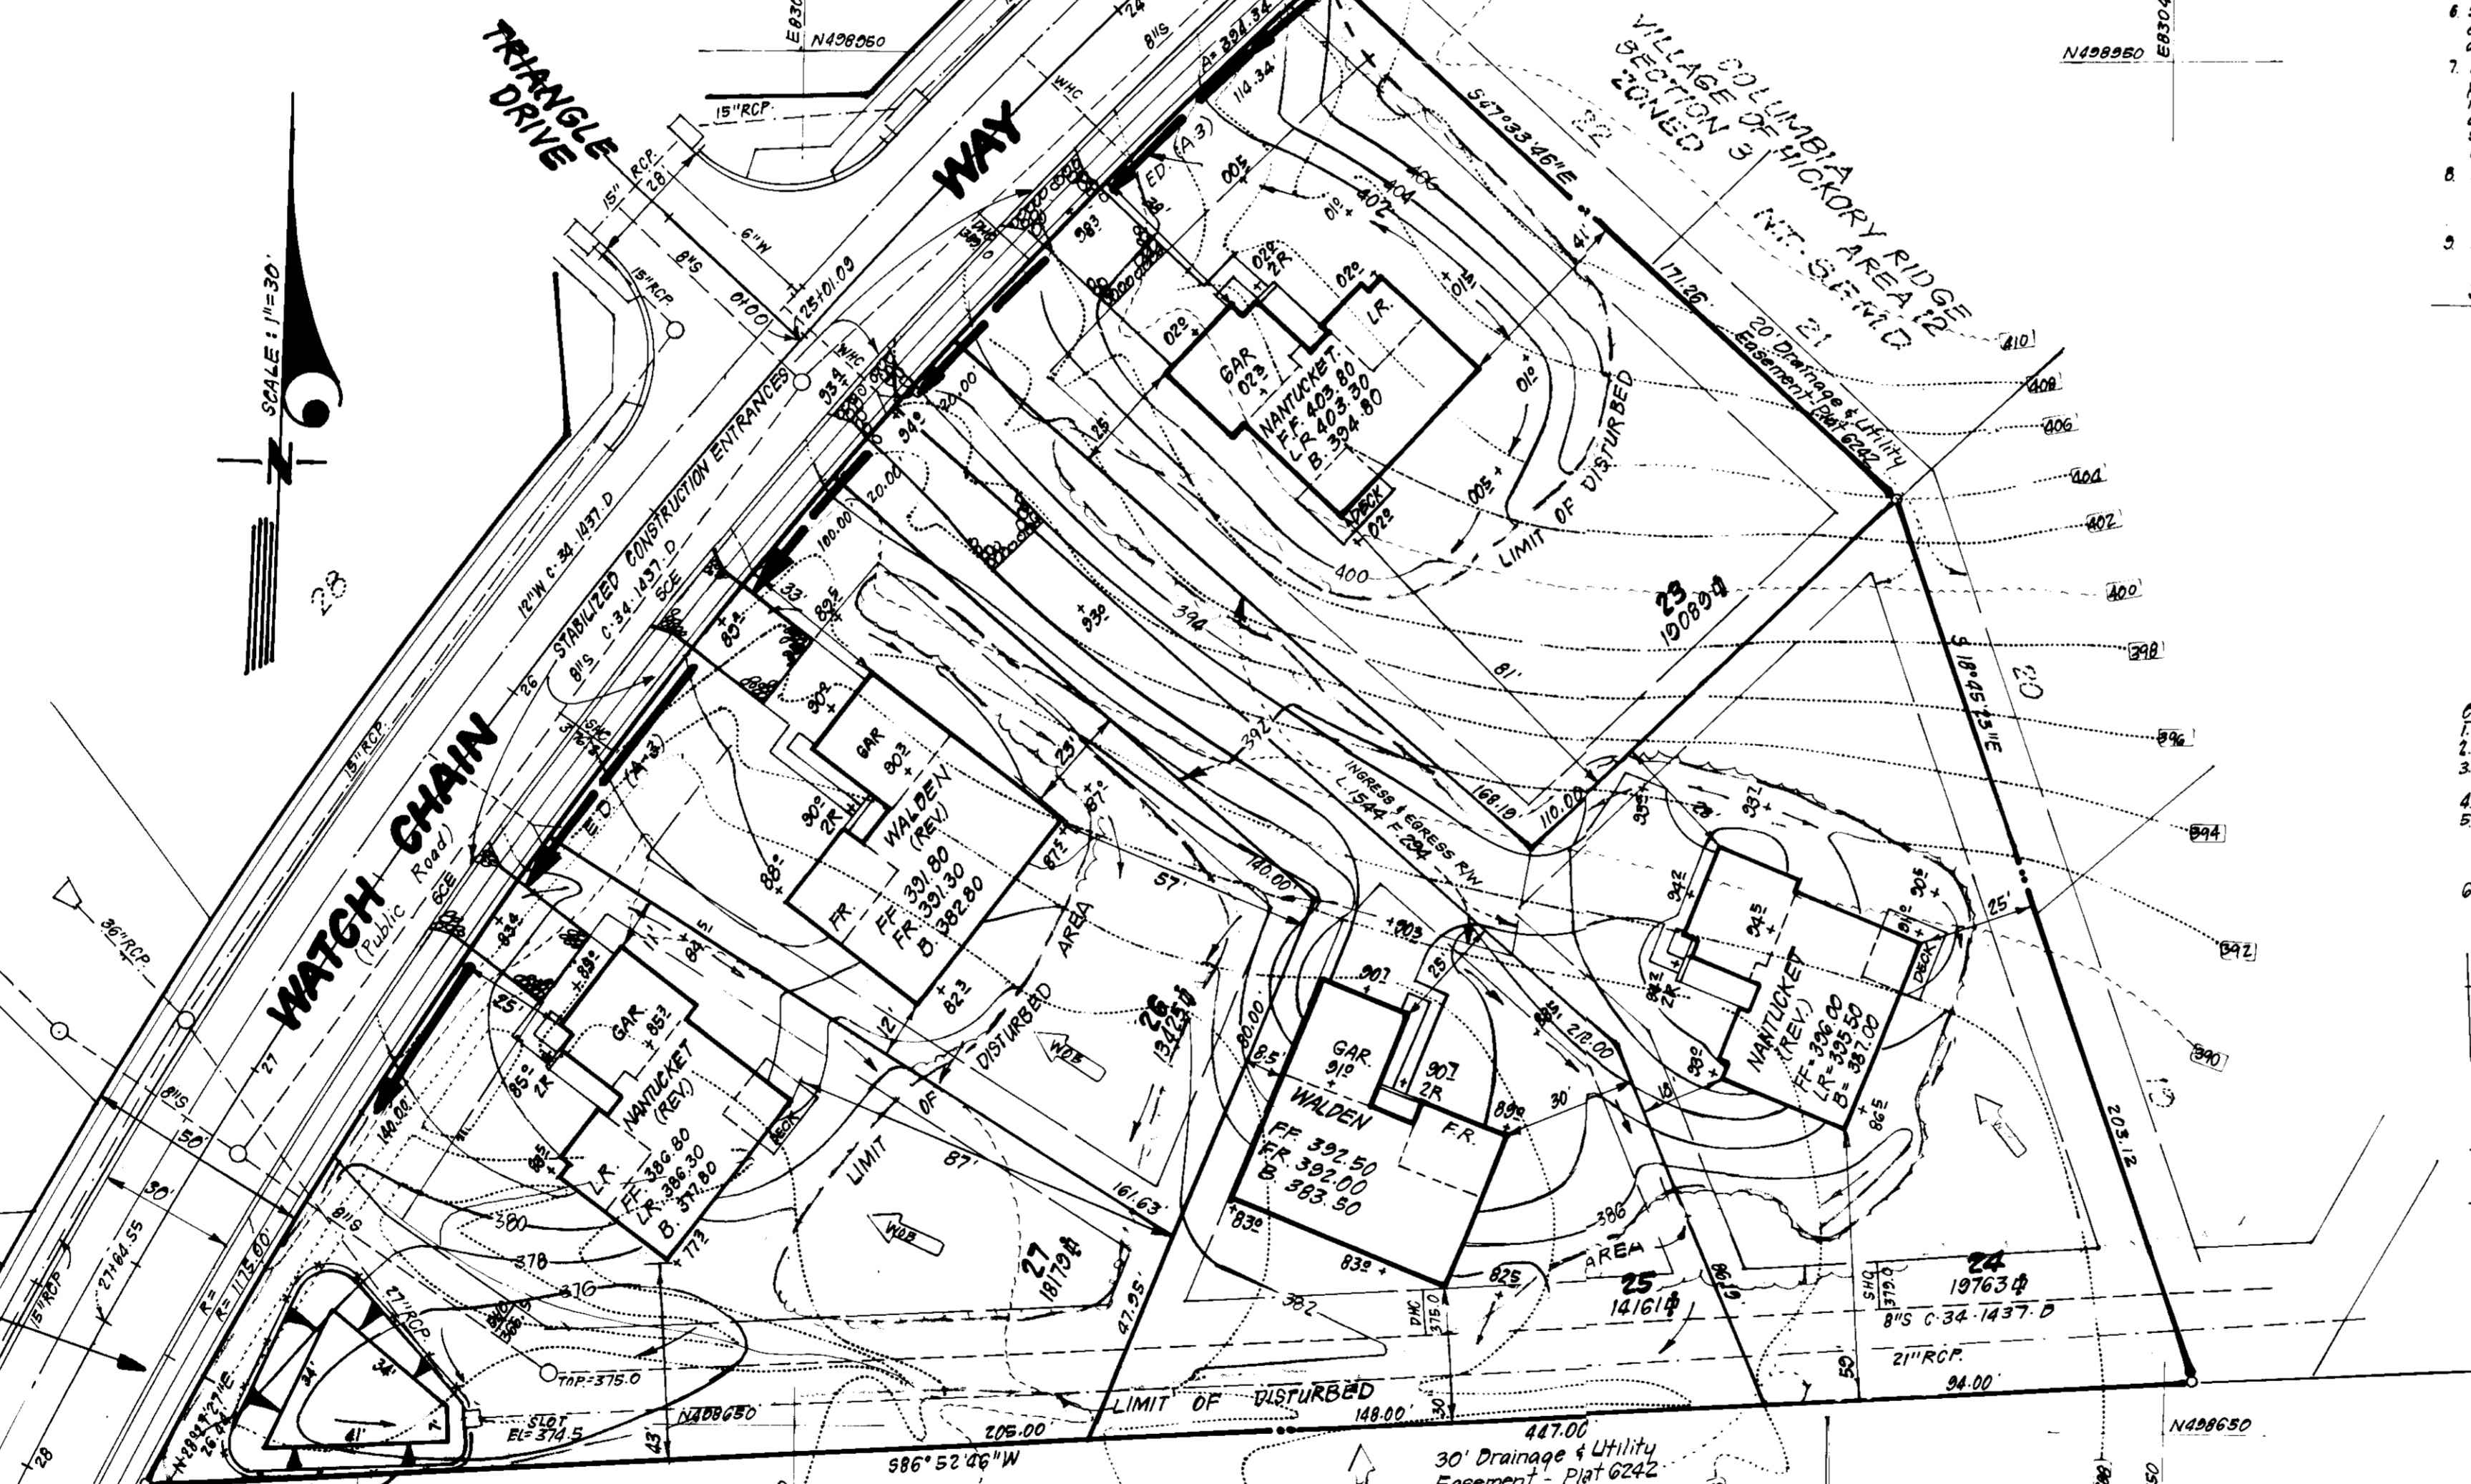


**CONSTRUCTION SEQUENCE**

CONSTRUCTION SEQUENCE	NO. OF DAYS
1. Obtain Grading Permit	3
2. Install Sediment & Erosion Control Measures	10
3. Clear & Rough Grade Site	30
4. Construct House, driveways & walks	120
5. Fine grade and stabilize all other areas inside	30
6. Upon approval of the sediment control inspector, remove sediment & erosion control measures and stabilize.	14

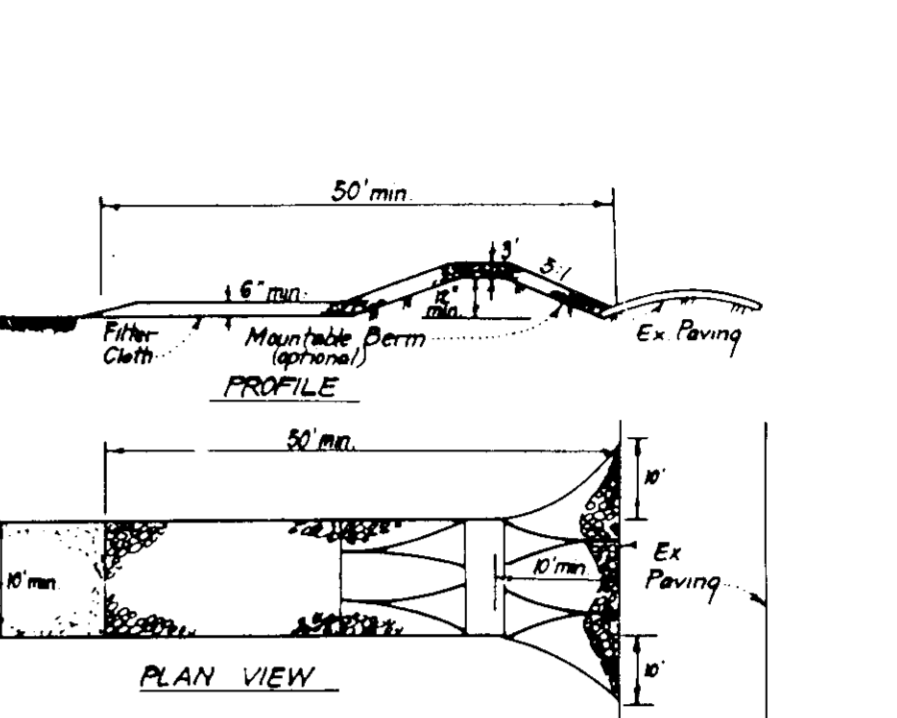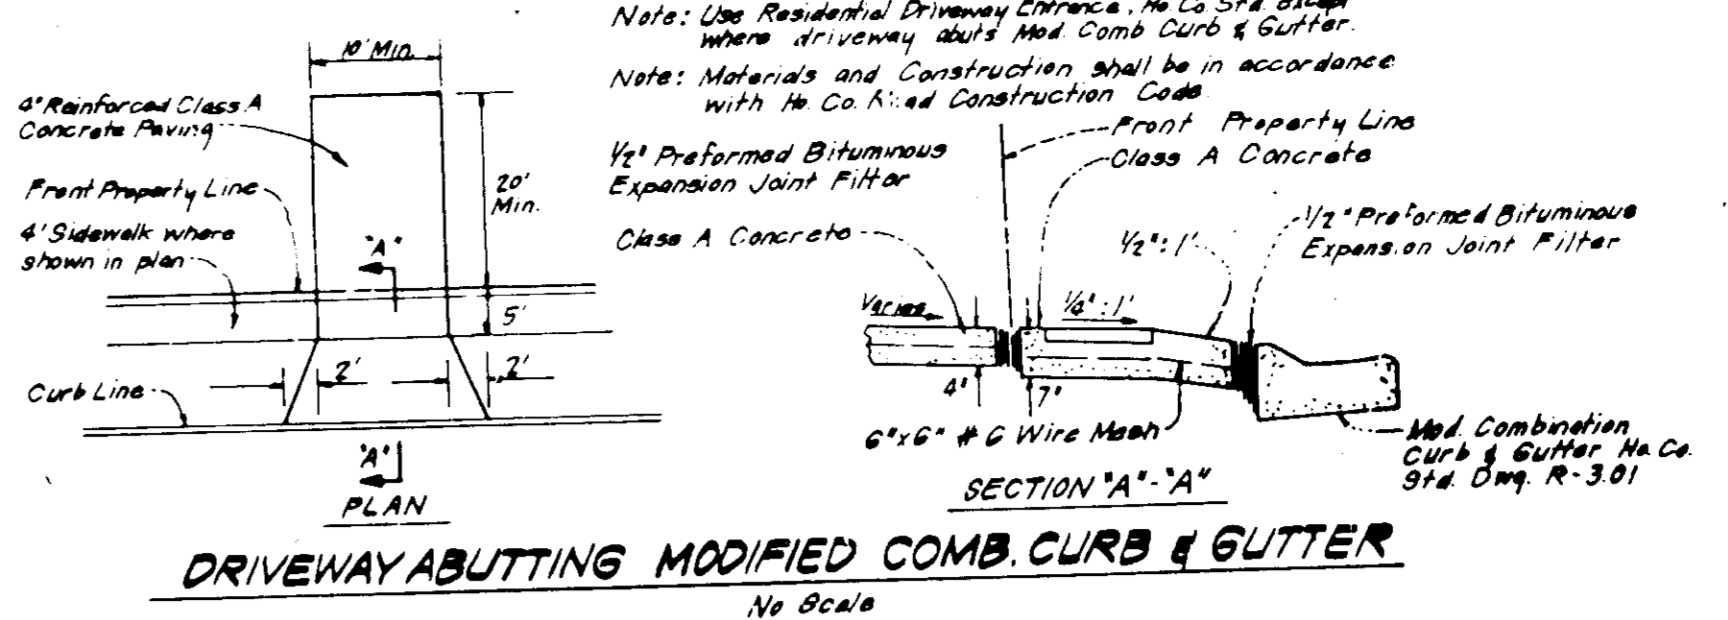

**CONSTRUCTION SPECIFICATIONS:**

1. Stone size - Use 2" stone or reclaimed or recycled concrete equivalent.
2. Length - As required, but not less than 50 feet (exception for a single residence lot where a 30 foot minimum length would apply).
3. Thickness - Not less than six (6) inches.
4. Width - Ten (10) feet minimum, but not less than the full width at points where ingress or egress occurs.
5. Filter Cloth - Will be placed over the entire area prior to placing of stone. Filter will not be required on single family residence lot.
6. Surface Water - All surface water flowing or diverted toward construction entrances shall be piped across the entrance. If piping is impractical, a mountable berm with 3:1 slopes will be permitted.
7. Maintenance - The entrance shall be maintained in a condition which will prevent tracking or flowing of sediment onto public rights-of-way. This may require periodic top dressing, with additional stone be condition deemed and/or cleanup of any measures used to trap sediment. All sediment applied, graded, washed or tracked onto public rights-of-way must be removed immediately.
8. Washing - Wheels shall be cleaned to remove sediment prior to entrance onto public rights-of-way. When washing is required, it shall be done on an area stabilized with stone and which drains into an approved sediment trapping device.
9. Periodic inspection and needed maintenance shall be provided after each rain.

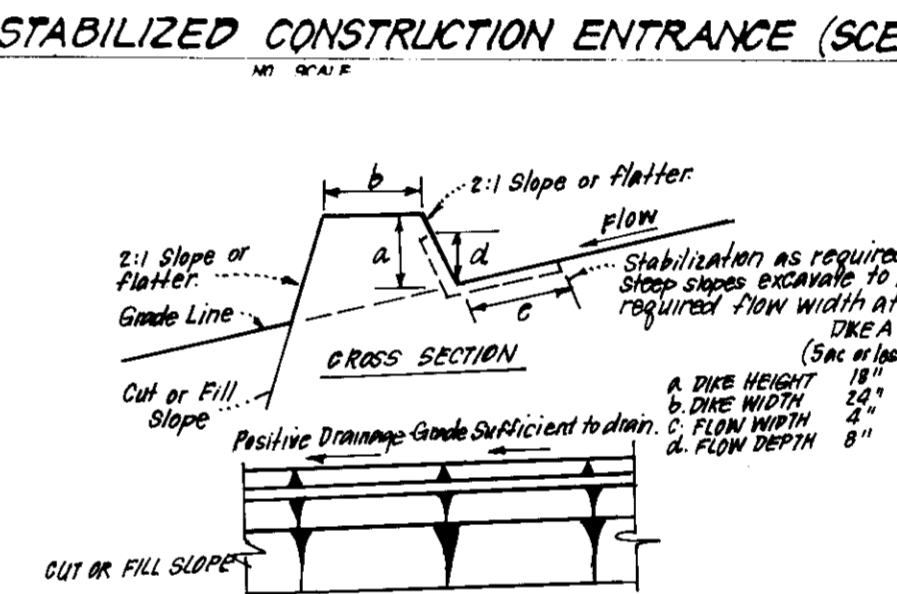

**CONSTRUCTION SPECIFICATIONS:**

1. All dikes shall be compacted by earth-moving equipment.
2. All dikes shall have positive drainage to an outlet.
3. Top width may be wider and side slopes may be flatter if desired, to facilitate crossing by construction equipment.
4. Earth dikes shall have an outlet that funnels with a minimum of erosion. Runoff shall be conveyed to a sediment trapping device such as a sediment trap or sediment basin where either the dike channel or the drainage area above the dike are not adequately stabilized.
5. Stabilization shall be: (a) in accordance with standard specifications for seed and straw mulch or straw mulch if not in seeding season, (b) flow channel as per detail below.

**TYPE OF TREATMENT**

CHANGES	TYPE A	TYPE B
1.	0.5 - 3.0% Seed/Stem Mulch	Seed or Straw Mulch
2.	3.1 - 8.0% Seed/Stem Mulch	Seed w/ Lime or Excelsior, Seed, or Stone
3.	8.1 - 10.0% Seed/Stem Mulch	Lime, Rip Rap, 4" x 4" of Stone
4.	10.1 - 100% Rip Rap	Excelsior Design

A. Stone to be 2" stone, or recycled concrete equivalent, in a layer of least 3" thick and be placed in a layer at least 8" thick, pressed into soil.  
 B. Rip Rap to be 4" - 8" in a layer at least 8" thick, pressed into soil.  
 C. Approved equivalents can be substituted for any of the above materials.  
 7. Periodic inspection and Required Maintenance must be provided after each rain.


**GENERAL NOTES:**

1. The land included is zoned: New Town, SFMD, per Final Development Plan No. F-3-7-81-04253.
2. Coordinates are based upon traverse controls for Columbia established by Maps Inc., in 1965 and Purdum Associates in 1981, which controls were tied to the Maryland Bureau of Control, Survey Monuments and U.S. Coast and Geodetic Survey Monuments in the Columbia Area.
3. All roads are public and existing.
4. Any damage to county owned rights-of-way to be corrected at the Developer's expense.
5. Total Area (including 1.243 Acres).
6. Total Number of Lots = 5

**LEGEND:**

1. Contour Interval	2 Ft.
2. Existing Contour	40
3. Proposed Contour	105
4. Spot Elevation	105
5. Direction of Drainage	
6. Existing Trees to be Saved	
7. Walk -ur. Basement	
8. Earth Dike	

Note: Storm Water Management provided in Central Facility in V.O.H.R. 3/1 P-83-120 and in VOHR 3/5, P-84-51.

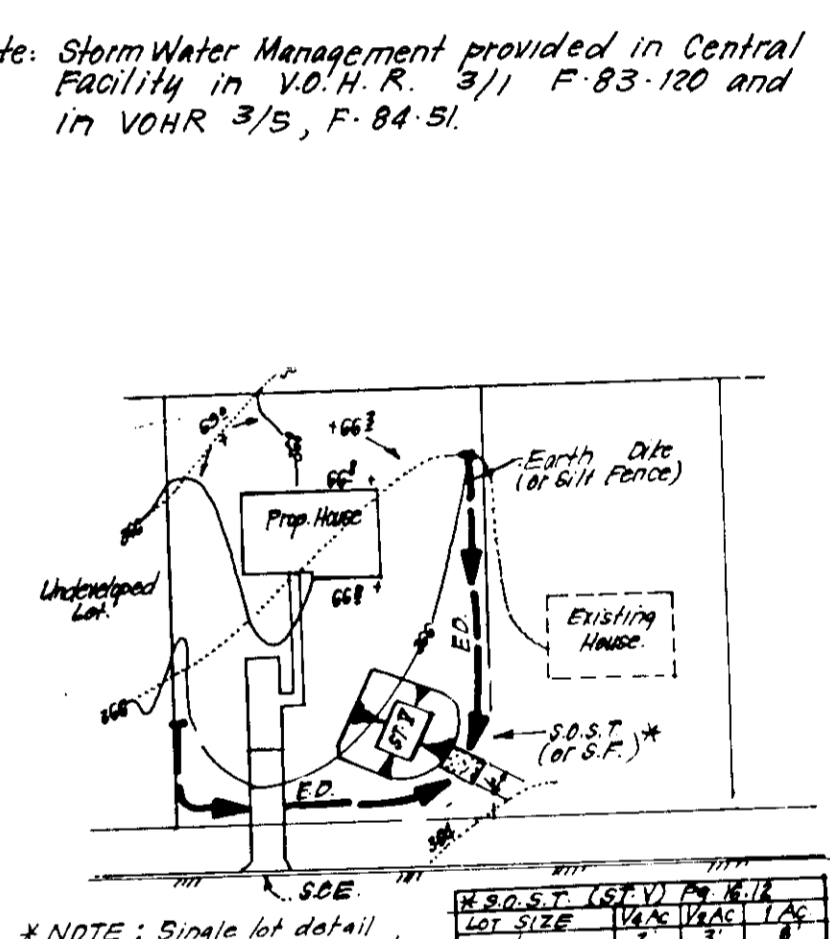

**ADDRESS CHART**

LOT NO.	STREET ADDRESS
23	6053 Watch Chain Way
24	6051 " " "
25	6051 " " "
26	6051 " " "
27	6051 " " "

Reviewed for Name and meets Technical Requirements  
 Signature: [Signature]  
 Date: 11-5-86  
 U.S. Soil Conservation Service  
 HIS DEVELOPMENT PLAN IS APPROVED FOR SOIL EROSION AND SEDIMENT CONTROL BY THE HOWARD COUNTY CONSERVATION DISTRICT.  
 Signature: [Signature]  
 Date: 11/18/86

**DEVELOPER'S BUILDER'S CERTIFICATE**

"We certify that all development and construction will be done according to this plan and that all persons concerned in the construction project will have a Certificate of Attendance at a Dept. of Natural Resources Approved Training Program for the Control of Sediment and Erosion before beginning the project. I also authorize periodic on-site inspection by the Howard County Conservation District or their authorized agents, as are deemed necessary."

Signature: [Signature]  
 Date: 7-10-86

**ENGINEER'S CERTIFICATE**

hereby certify that this plan for Erosion and Sediment Control represents a practical and workable plan based on my personal and professional knowledge of the site conditions and that it was prepared in accordance with the requirements of the Howard Soil Conservation District.

Signature: [Signature]  
 Date: 11/10/86

**CLARK • FINEFROCK & SACKETT**  
 ENGINEERS • PLANNERS • SURVEYORS

11315 LOCKWOOD DRIVE  
 SILVER SPRING, MARYLAND 20904  
 (301) 583-3400

**SITE DEVELOPMENT PLAN AND SEDIMENT & EROSION CONTROL PLAN**  
 LOTS 23 THRU 27  
**COLUMBIA**  
 VILLAGE OF HICKORY RIDGE  
 SECTION 3 AREA 12  
 5TH ELECTION DISTRICT  
 HOWARD COUNTY, MARYLAND

FOR: MCDONOUGH BUILDERS, INC.  
 6310 Stevens Forest Rd. #104  
 Columbia, Md. 21046

DESIGNED: BAF  
 DRAWN: NIW  
 CHECKED: JME  
 DATE: 7-1-86

SCALE: 1" = 30'  
 DRAWING: 1 OF 1  
 JOB NO.: 86-051  
 FILE NO.: 86-051-X