


VICINITY MAP
Scale: 1 1/2 mile

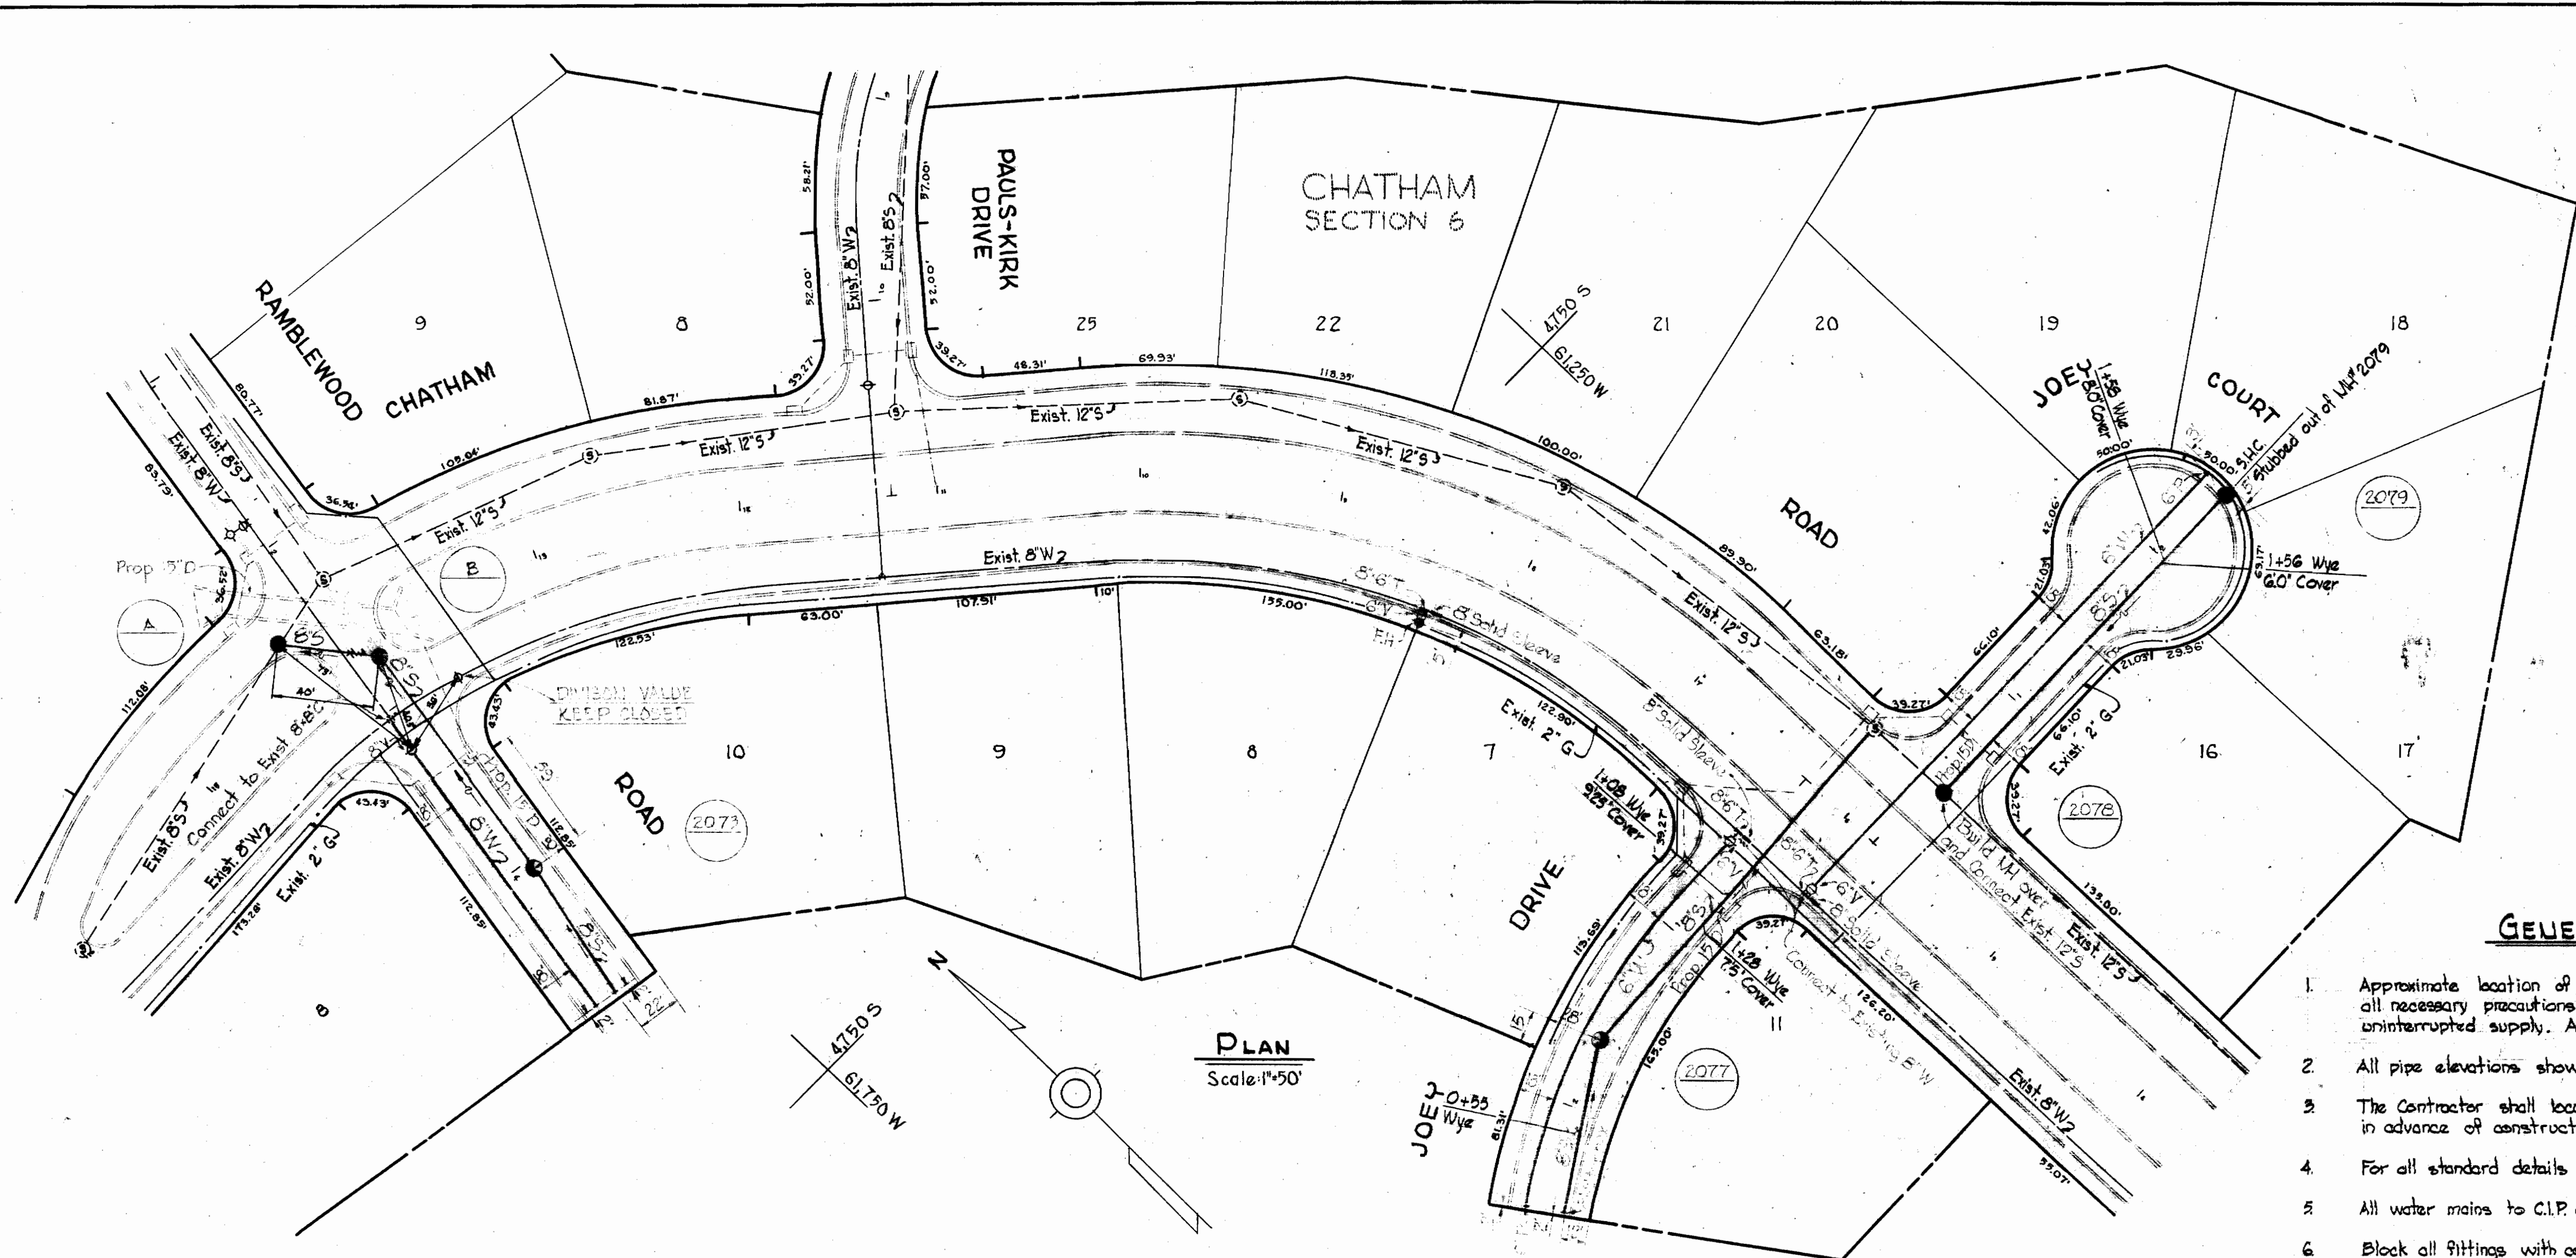


PLAN
Scale: 1\"/>

GENERAL NOTES

1. Approximate location of existing mains are shown. The Contractor shall take all necessary precautions to protect existing mains and services and maintain uninterrupted supply. Any damage incurred shall be repaired immediately.
2. All pipe elevations shown are invert elevations.
3. The Contractor shall locate existing utilities a minimum of two weeks in advance of construction operations in vicinity of utilities.
4. For all standard details see standards bound in Specifications.
5. All water mains to C.I.P. or D.I.P. and have a minimum of 3 1/2' cover.
6. Block all fittings with concrete, see standard details bound in Specifications.
7. Bury line elevation on fire hydrants shall be set the same as edge of paving, top of curb, or as directed by the Engineer in the field.
8. All Fire Hydrants shall be buttressed with concrete in accordance with Standard Detail W-4.
9. The Contractor shall provide a joint in all sewer mains within 2'-0\"/>

W.R.#A. BM.# 99A Elev. 416.07
R.R. spike in base 8\"/>

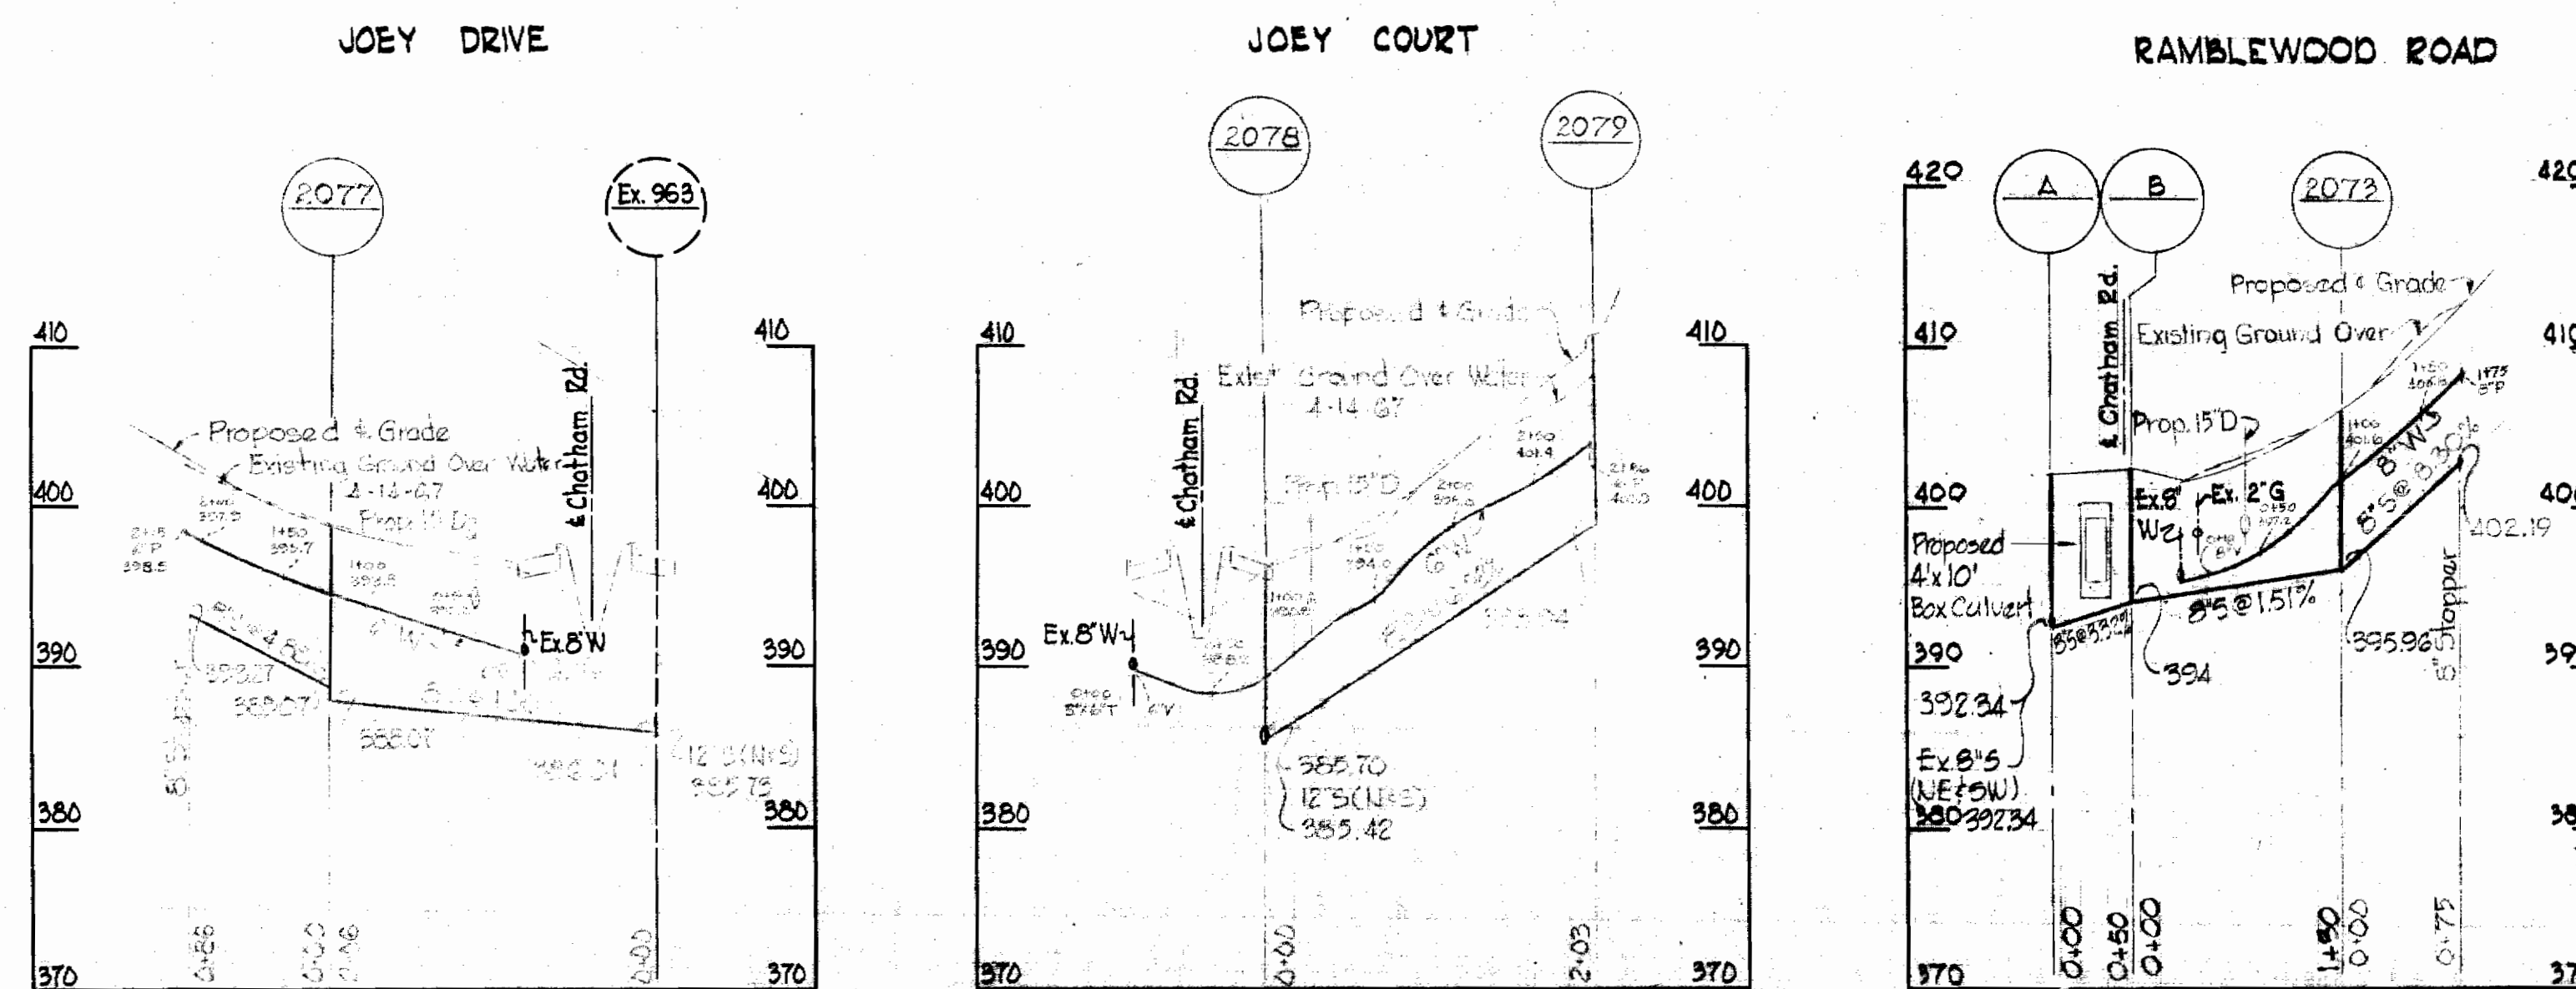

PROFILE
Scale: Hor. 1\"/>

| QUANTITIES | |
|------------|----------|
| ITEM | QUANTITY |
| 6\"/> | |



Kenneth A. McCord

Chatham Contract 1*

WS 156 W-5/1 SM