



Patuxent Institute

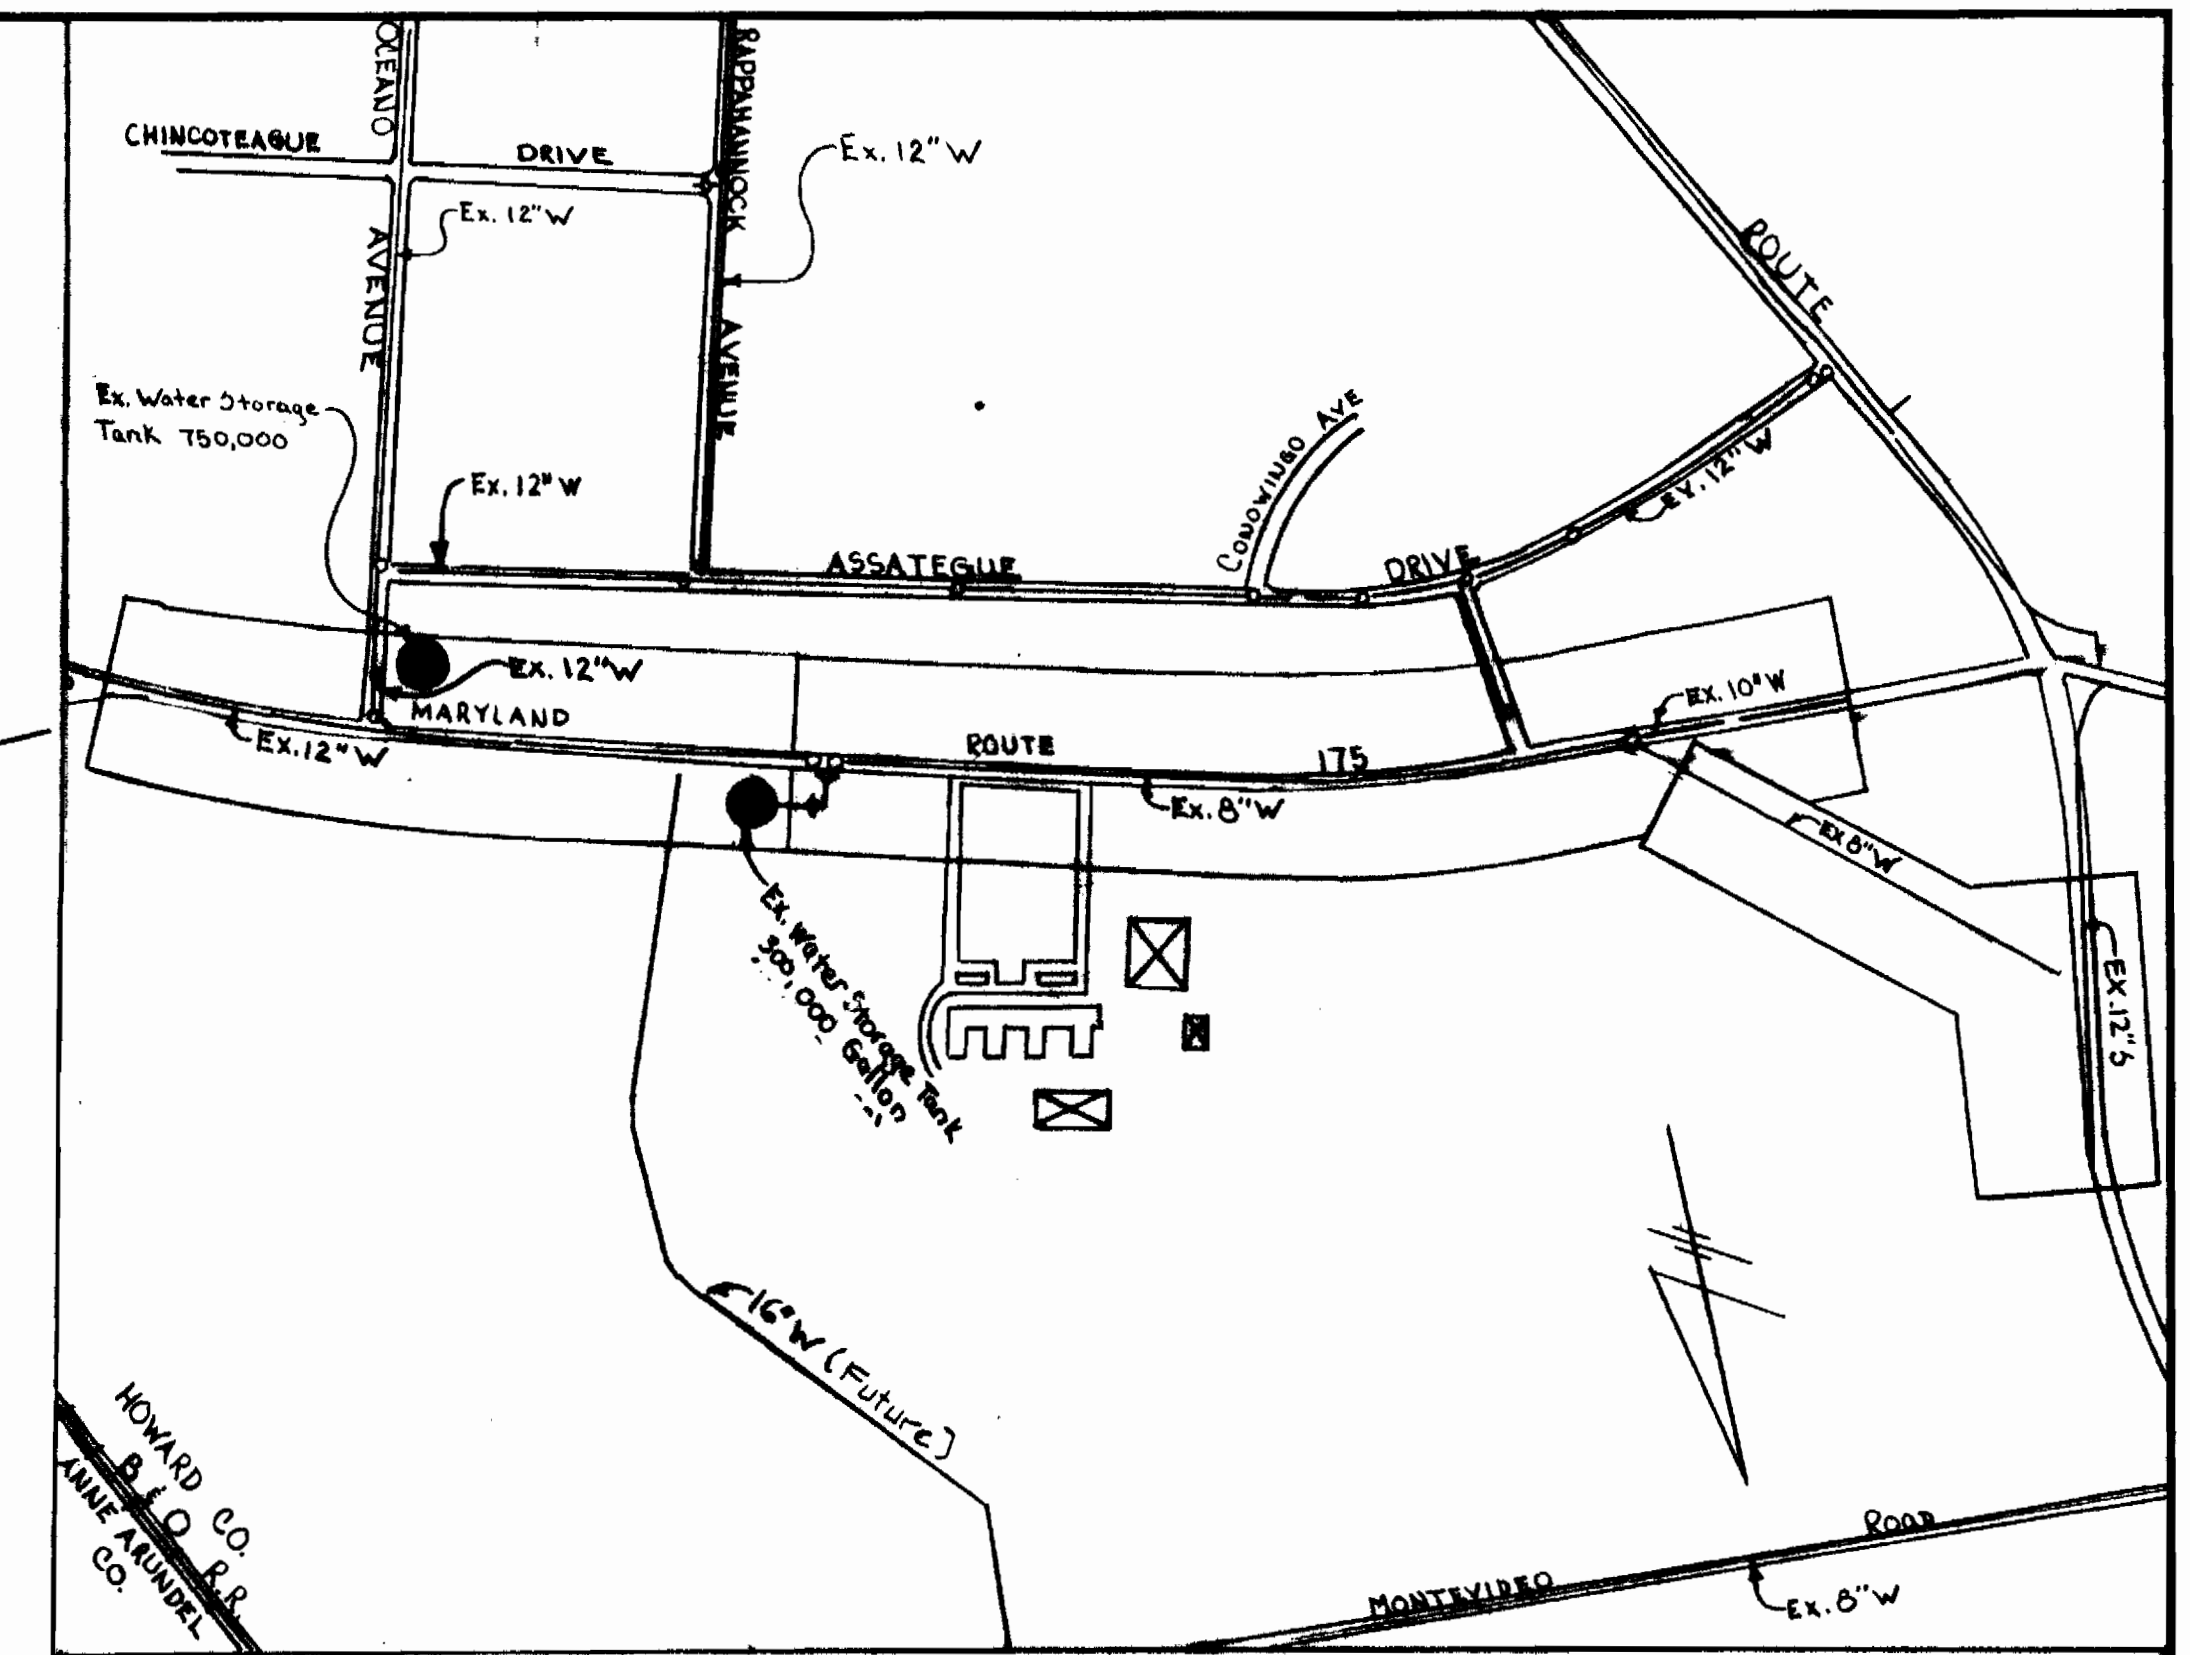


Work Is Restricted With 50' OF Fence Line
(Including Air Space)

Property of the State of Maryland
Patuxent Institute
403/474

Tank Height = 123'

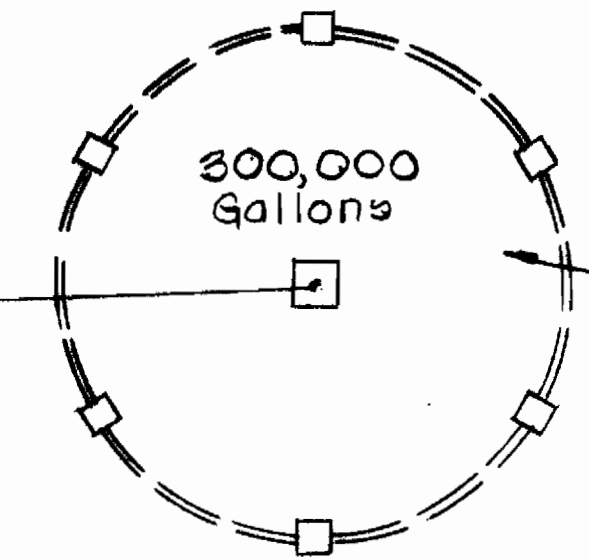

Approximately
E 863125
N 483125

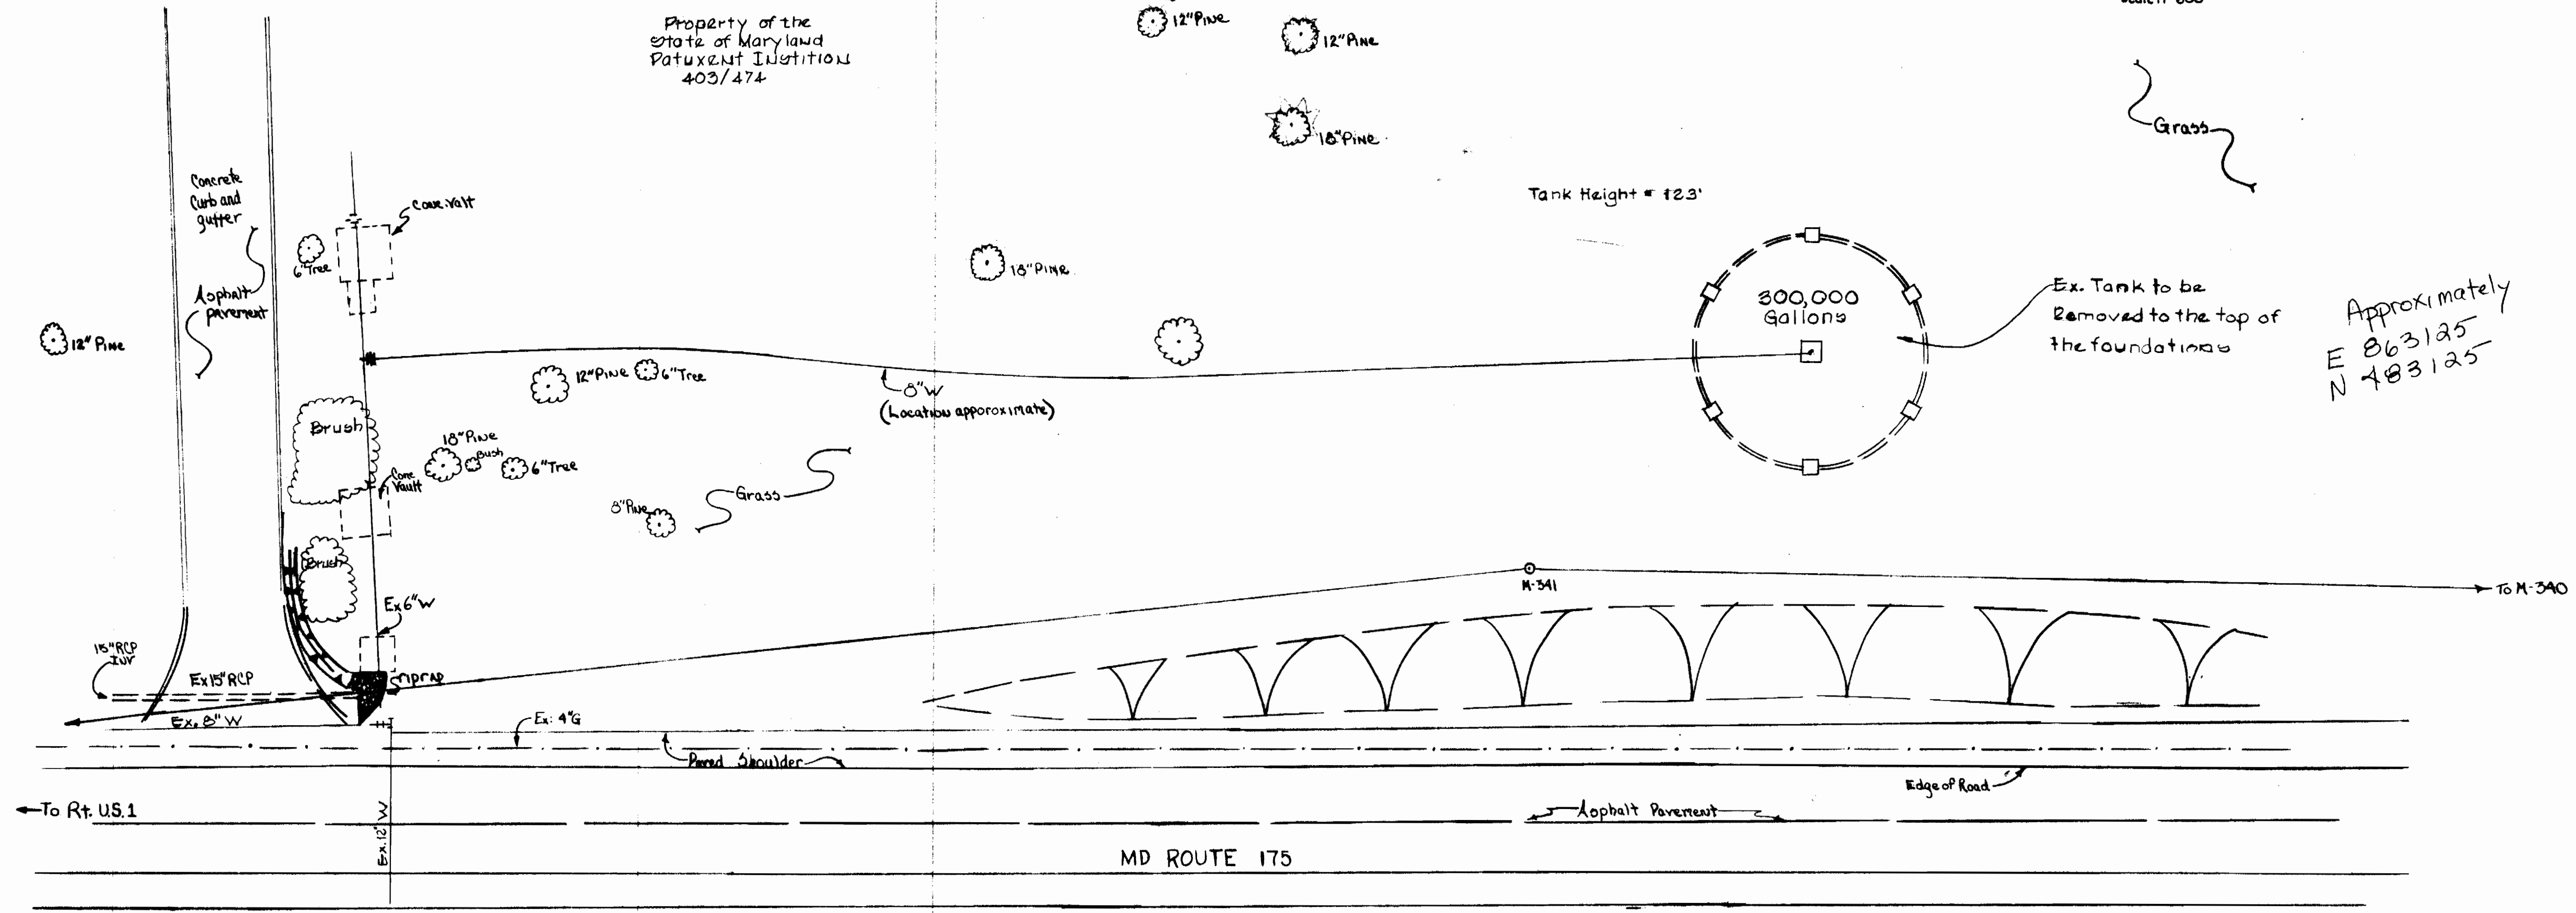

DEPARTMENT OF PUBLIC WORKS HOWARD COUNTY MARYLAND BUREAU OF ENG. DESIGN DIVISION	DEPARTMENT OF PUBLIC WORKS HOWARD COUNTY, MARYLAND DIRECTOR OF PUBLIC WORKS DATE _____ CHIEF-BUREAU OF ENGINEERING DATE _____	CONTRACT NO. <u>827-W</u> CAPITAL PROJECT W-4-8024	PLAN OF PROJECT AREA	PATUXENT INSTITUTE WATERTANK DEMOLITION HOWARD COUNTY, MARYLAND	DRAWING NO. <u>1</u> OF <u>1</u> SCALE 1" = 50'
--	--	---	----------------------	---	---