


QUANTITIES				
ITEM	ESTIMATED	AS-BUILT		
		QUANTITIES	TYPE	SUPPLIER
B" SEWER	2,021 L.F.			
B" D.I.P. SEWER	0.97 L.F.			
4" SHC	1,190 L.F.	2		
MANHOLES	21 EACH			
B" WATER	1,951 L.F.			
G" WATER	107 L.F.			
1" WMC	290 L.F.			
3/4" WMC	902 L.F.			
PIPE HYDRANTS	4 EACH			
B" X B" TEE	3 EACH			
B" X G" TEE	4 EACH			
B" VALVE	5 EACH			
G" VALVE	4 EACH			
B" 1/2" H.B.	1 EACH			
B" 1/4" H.B.	4 EACH			
B" 1/8" H.B.	1 EACH			
B" PLUG & BUTTRESS	4 EACH			
OUTSIDE METER SETTINGS	6 EACH			

NAME OF UTILITY CONTRACTOR: _____
 SURVEY & DRAFTING DIVISION AS-BUILT DATE: _____

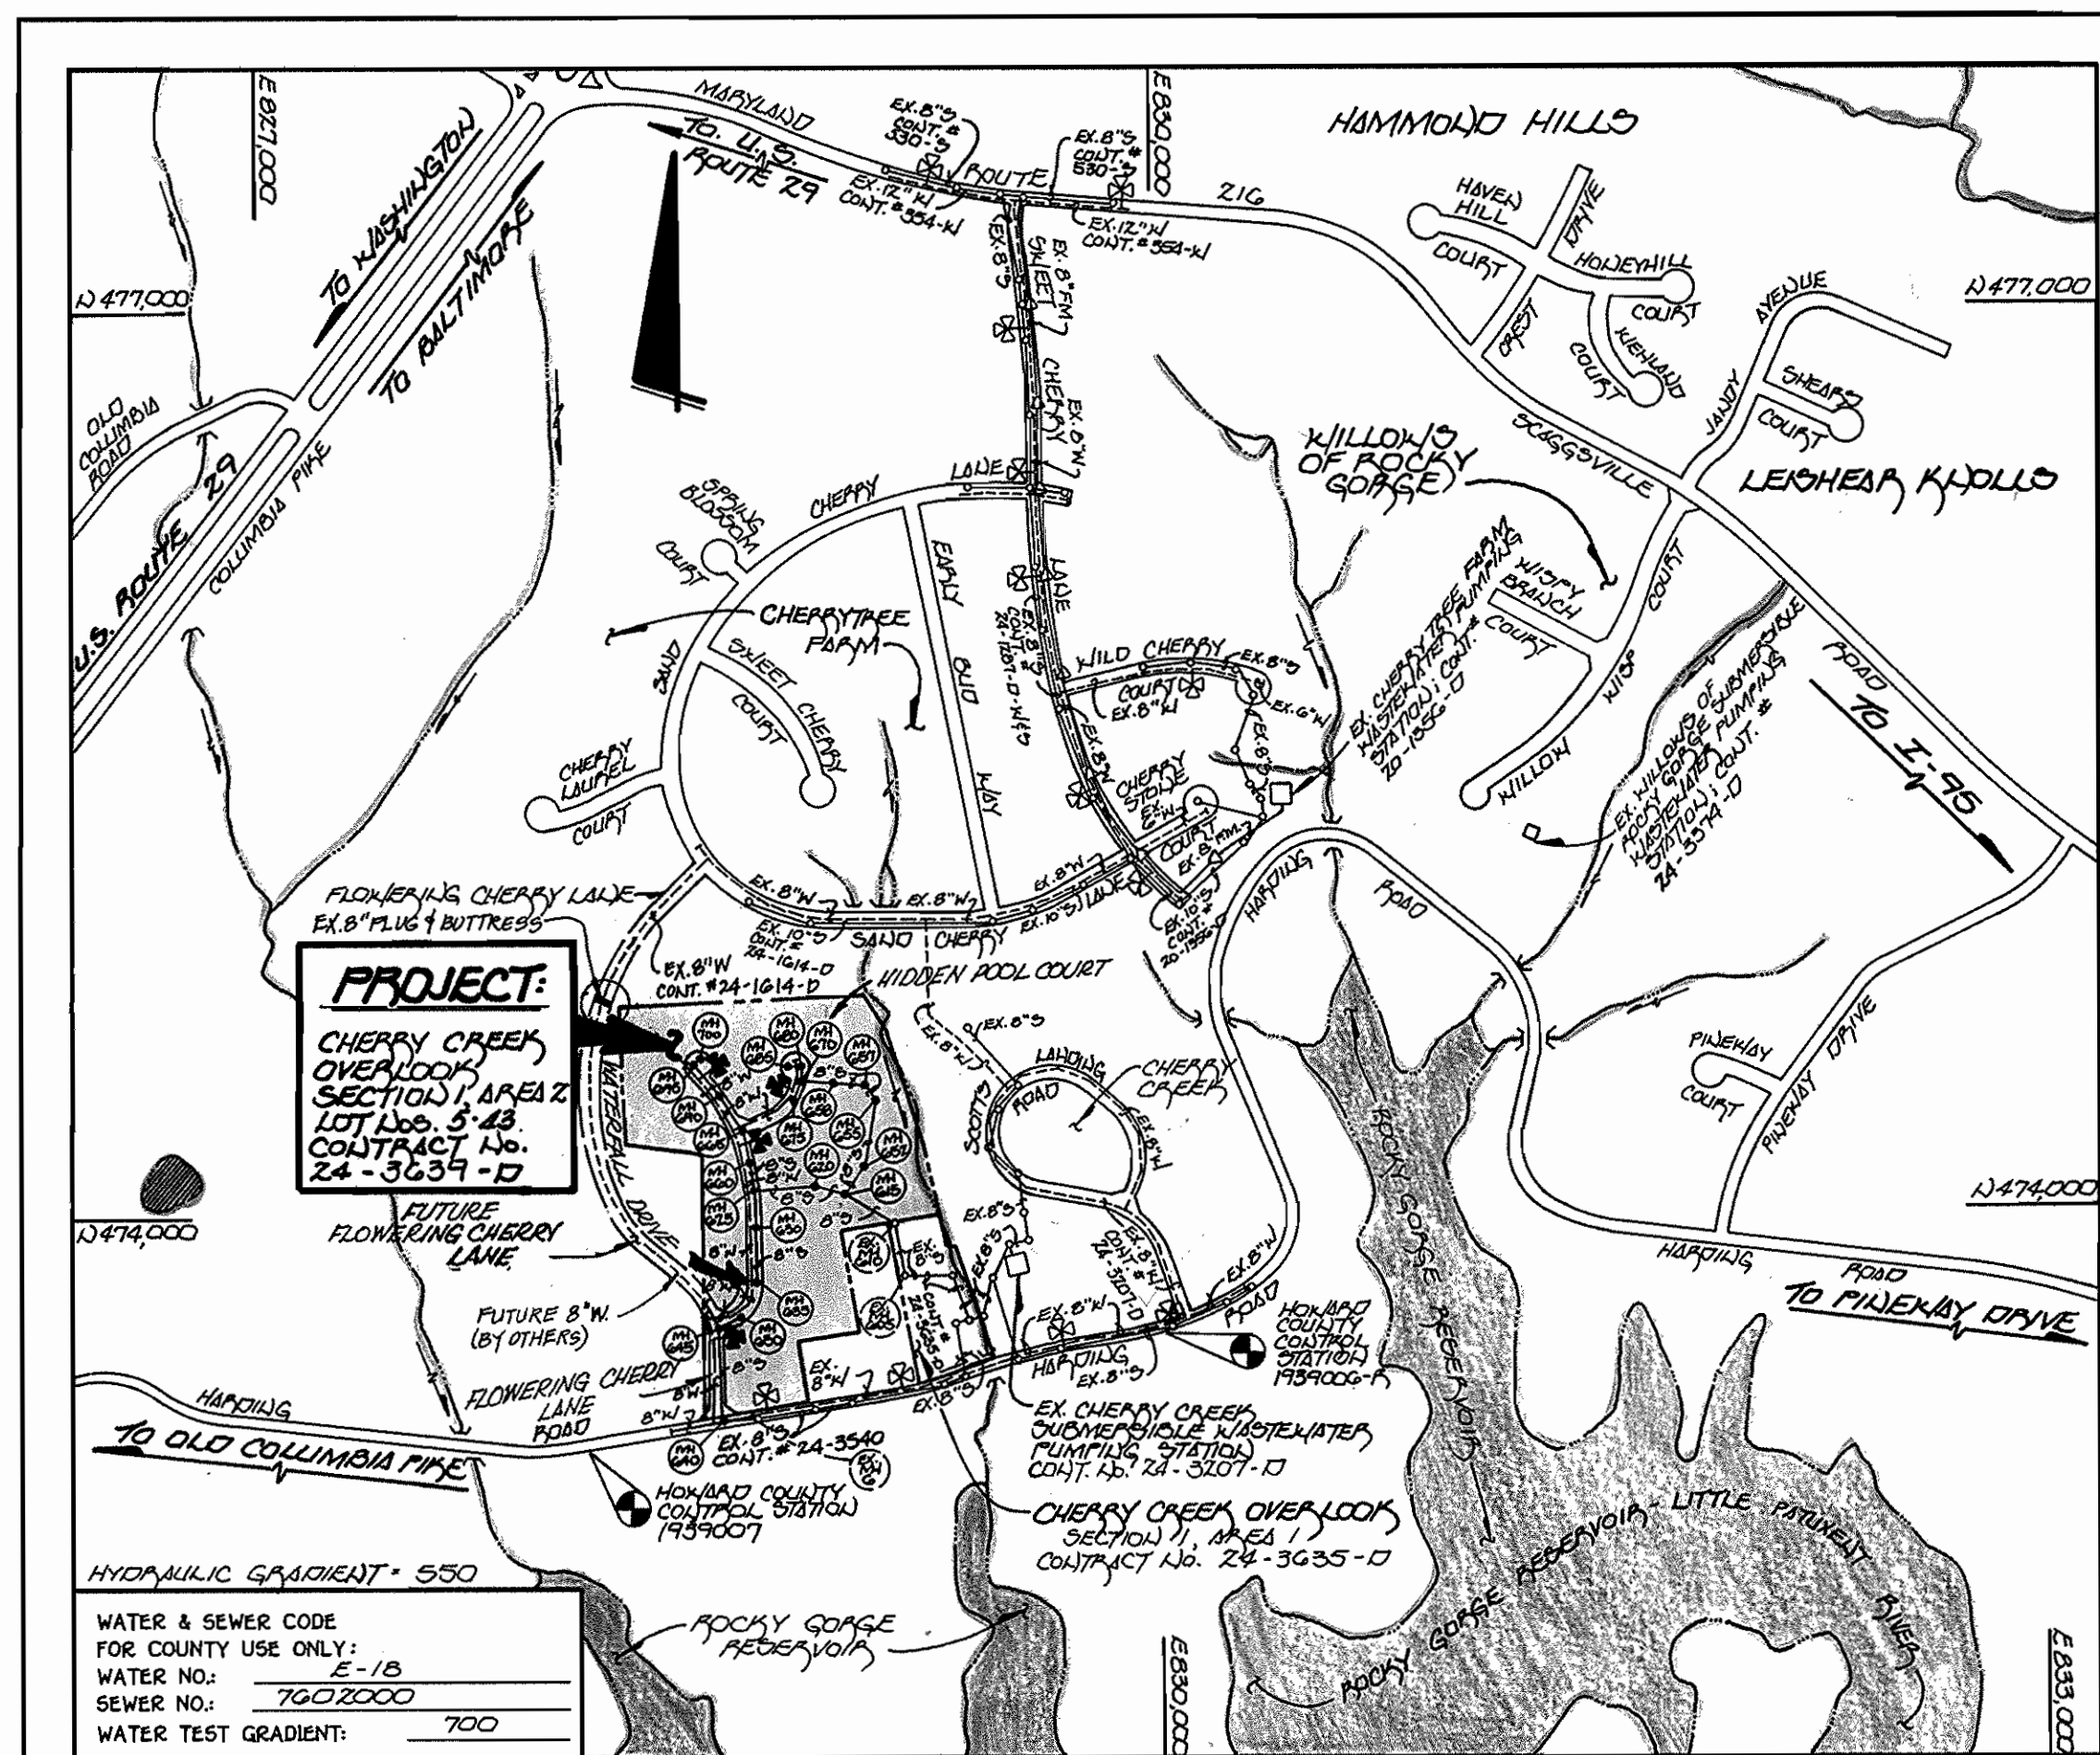

TYPE OF BUILDING:	RESIDENTIAL
NUMBER OF LOTS:	39 (38 BUILDABLE)
NO. OF WATER HOUSE CONNECTIONS:	37*
NO. OF SEWER HOUSE CONNECTIONS:	35
DRAINAGE AREA:	LITTLE PATENT W/FP VIA CHERRY CREEK & CHERRY TREE PIAM W/FP.
TREATMENT PLANT:	LITTLE PATENT W/FP VIA CHERRY CREEK & CHERRY TREE PIAM W/FP.
* LOT 6 WILL RECEIVE WATER SERVICE VIA AN EXISTING 3/4" WMC INSTALLED UNDER CONT. NO. 24-3540, CAPITAL PROJECT S. 6192	
NO. OF WHCs FOR FUTURE LOTS:	5
NO. OF SHCs FOR FUTURE LOTS:	5

VICINITY MAP

SCALE: 1"=600'

PLAN REFERENCE NUMBERS:
F98-17

GENERAL NOTES

- APPROXIMATE LOCATION OF EXISTING MAINS ARE SHOWN. THE CONTRACTOR SHALL TAKE ALL NECESSARY PRECAUTIONS TO PROTECT EXISTING MAINS AND SERVICES AND MAINTAIN UNINTERRUPTED SUPPLY. ANY DAMAGE INCURRED SHALL BE REPAIRED IMMEDIATELY TO THE SATISFACTION OF THE ENGINEER AT THE CONTRACTOR'S EXPENSE.
- ALL HORIZONTAL CONTROLS ARE BASED ON MARYLAND STATE COORDINATES.
- ALL VERTICAL CONTROLS ARE BASED ON U.S.G.S. DATUM.
- ALL PIPE ELEVATIONS ARE INVERT ELEVATIONS.
- CLEAR ALL UTILITIES BY A MINIMUM OF 8'. CLEAR ALL POLES BY 2'-0" MINIMUM.
- FOR DETAILS NOT SHOWN ON THE DRAWINGS, AND FOR MATERIALS AND CONSTRUCTION METHODS, USE HOWARD COUNTY DESIGN MANUAL VOLUME IV, STANDARD SPECIFICATIONS AND DETAILS FOR CONSTRUCTION (091 AMENDMENTS) THE CONTRACTOR SHALL HAVE A COPY OF VOLUME IV ON THE JOB SITE.
- WHERE TEST PITS HAVE BEEN MADE ON EXISTING UTILITIES, THEY ARE NOTED BY THE SYMBOL [] AT THE LOCATION OF THE TEST PIT. A NOTE OR NOTES CONTAINING THE RESULTS OF THE TEST PIT OR PITS IS INCLUDED ON THE DRAWINGS. EXISTING UTILITIES IN THE VICINITY OF THE PROPOSED WORK FOR WHICH TEST PITS HAVE NOT BEEN DUG SHALL BE VERIFIED BY THE CONTRACTOR TO HIS OWN SATISFACTION. ANY DAMAGE TO EXISTING FACILITIES DUE TO THE CONTRACTOR'S NEGLIGENCE SHALL BE REPAIRED AT THE CONTRACTOR'S EXPENSE.
- CONTRACTOR SHALL NOTIFY THE FOLLOWING UTILITIES OR AGENCIES AT LEAST FIVE WORKING DAYS BEFORE STARTING WORK SHOWN ON THESE PLANS:
 - STATE HIGHWAY ADMINISTRATION - 531-5533
 - BALTIMORE GAS & ELECTRIC CO. - CONTRACTOR SERVICES - 850-4620
 - BALTIMORE GAS & ELECTRIC CO. - UNDER GROUND DAMAGE CONTROL - 787-9068
 - MISS UTILITY - 1-800-257-7777
 - COLONIAL PIPELINE CO. - 795-1390
 - BUREAU OF UTILITIES, HOWARD COUNTY DEPARTMENT OF PUBLIC WORKS - 313-4900
- TREES AND SHRUBS ARE TO BE PROTECTED FROM DAMAGE TO MAXIMUM EXTENT. TREES AND SHRUBS LOCATED WITHIN THE CONSTRUCTION STRIP ARE NOT TO BE REMOVED OR DAMAGED BY THE CONTRACTOR.
- CONTRACTOR SHALL REMOVE TREES, STUMPS AND ROOTS ALONG THE LINE OF EXCAVATION. PAYMENT FOR SUCH REMOVAL SHALL BE INCLUDED IN THE UNIT PRICE BID FOR CONSTRUCTION OF THE MAIN.
- ALL SEWER MAINS SHALL BE D.I.P. OR P.V.C. UNLESS OTHERWISE NOTED.
- ALL MANHOLES SHALL BE 4'-0" INSIDE DIAMETER UNLESS OTHERWISE NOTED.
- T.B. DENOTES TEST BORING.
- MANHOLES SHOWN WITH 12" AND 16" WALLS ARE FOR BRICK MANHOLES ONLY.
- MANHOLES DESIGNATED W.T. IN PLAN AND PROFILE SHALL HAVE WATERTIGHT FRAME AND COVERS, STANDARD DETAIL G 552.
- WHERE WATERTIGHT MANHOLE FRAME AND COVER IS USED, SET TOP OF FRAME 1'-6" ABOVE FINISHED GRADE UNLESS OTHERWISE NOTED ON THE PLANS OR IN THE SPECIFICATIONS.
- HOUSES WITH THE SYMBOL "C.N.S." INDICATES THAT THE CELLAR CANNOT BE SERVED.
- ALL WATER HOUSE CONNECTIONS SHALL BE FOR INSIDE METER SETTING, UNLESS OTHERWISE NOTED ON THE PLANS OR IN THE SPECIFICATIONS.
- MANHOLES LOCATED WITHIN THE PROPOSED ROADWAY SHALL HAVE STANDARD HEAVY TRAFFIC MANHOLE FRAMES AND COVERS, STANDARD DETAIL G 551.
- WATER MAINS AND WATER HOUSE CONNECTION LINES MUST BE PLACED AS TO HAVE ONE (1) FOOT SEPARATION FROM THE SEWER MAIN OR SEWER HOUSE CONNECTION AS THEY PASS ABOUT IT.
- ALL WATER MAINS SHALL BE D.I.P., CLASS 52 UNLESS OTHERWISE NOTED.
- TOPS OF ALL WATER MAINS TO HAVE A MINIMUM OF 3'-1/2" COVER UNLESS OTHERWISE NOTED.
- VALVES ADJACENT TO TEES SHALL BE STRAPPED TO TEES.
- ALL FITTINGS SHALL BE BUTTRESSED OR ANCHORED WITH CONCRETE IN ACCORDANCE WITH THE STANDARD DETAILS UNLESS OTHERWISE PROVIDED FOR ON THE DRAWINGS.
- FIRE HYDRANTS SHALL BE SET TO THE BURY LINE ELEVATION SHOWN ON THE DRAWINGS. ALL FIRE HYDRANTS SHALL BE RESTRAINED AND BUTTRESSED WITH CONCRETE IN ACCORDANCE WITH THE STANDARD DETAILS (W11 AND W213). SOIL AROUND THE FIRE HYDRANT SHALL BE COMPACTED IN ACCORDANCE WITH SECTION 1000 AND 1005 OF THE STANDARD SPECIFICATIONS.
- THE CONTRACTOR SHALL NOT OPERATE ANY WATER MAIN VALVES ON THE EXISTING WATER SYSTEM.
- ALL D.I.P. FITTINGS SHALL BE IN ACCORDANCE WITH AWWA SPECIFICATIONS C-153; DUCTILE IRON COMPACT FITTINGS, 3-INCH THROUGH 12-INCH FOR WATER AND OTHER LIQUIDS.
- THE CONTRACTOR SHALL NOTIFY THE BUREAU OF HIGHWAYS, HOWARD COUNTY, * (410) 313-2450 AT LEAST FIVE WORKING DAYS BEFORE ANY OPEN CUT OF ANY COUNTY ROAD OR BORING/JACKING OPERATION IN COUNTY ROADS FOR LAYING WATER/SEWER MAINS OR HOUSE CONNECTIONS. THE APPROVAL OF THESE DRAWINGS WILL CONSTITUTE COMPLIANCE WITH DPW REQUIREMENTS PER SECTION 18.14(d) OF THE HOWARD COUNTY CODE.

CONTRACT NO 24-3639-D

CHERRY CREEK OVERLOOK

SECTION 1 AREA 2

LOT NOS. 5-45

WATER AND SEWER MAIN EXTENSIONS

HOWARD COUNTY, MARYLAND

DEVELOPER'S CERTIFICATE

"I HEREBY CERTIFY THAT ALL DEVELOPMENT & CONSTRUCTION WILL BE DONE ACCORDING TO THIS PLAN OF DEVELOPMENT & PLAN FOR EROSION & SEDIMENT CONTROL, & THAT ALL REQUIRED FEES HAVE BEEN PAID TO THE COUNTY DEPARTMENT OF PUBLIC WORKS. I HAVE A CERTIFICATE OF ATTENDANCE AT A DEPARTMENT OF THE ENVIRONMENT APPROVED TRAINING PROGRAM FOR THE CONTROL OF SEDIMENT & EROSION BEFORE BEGINNING THE PROJECT. I ALSO AUTHORIZE PERIODIC ON-SITE INSPECTION BY THE HOWARD SOIL CONSERVATION DISTRICT OR THEIR AUTHORIZED AGENTS, AS DEEMED NECESSARY."

Michael J. McCann FOR L.D. & D. INC. 1-7-98
 SIGNATURE OF DEVELOPER DATE

ENGINEER'S CERTIFICATE

"I HEREBY CERTIFY THAT THIS PLAN FOR EROSION & SEDIMENT CONTROL REPRESENTS A PRACTICAL & FEASIBLE PLAN BASED ON MY PERSONAL KNOWLEDGE OF THE SITE CONDITIONS & THAT IT HAS BEEN PREPARED IN ACCORDANCE WITH THE REQUIREMENTS OF THE HOWARD SOIL CONSERVATION DISTRICT."

Paul W. Koebel 08/25/97
 SIGNATURE OF ENGINEER DATE

REVIEWED FOR HOWARD COUNTY SOIL CONSERVATION DISTRICT AND MEETS TECHNICAL REQUIREMENTS.

Cheryl Simmons 1/27/98
 U.S.A. NATURAL RESOURCES CONSERVATION SERVICE DATE

THIS DEVELOPMENT IS APPROVED FOR EROSION AND SEDIMENT CONTROL BY HOWARD SOIL CONSERVATION DISTRICT.

APPROVED: John R. Roberts 1/27/98
 HOWARD SOIL CONSERVATION DISTRICT DATE

SEDIMENT CONTROL MEASURES FOR THIS CONTRACT WILL BE IMPLEMENTED IN ACCORDANCE WITH SECTION 219 OF THE HOWARD COUNTY DESIGN MANUAL & STANDARDS AND SPECIFICATIONS FOR SOIL EROSION AND SEDIMENT CONTROL IN DEVELOPING AREAS AS SHOWN ON THESE PLANS AND UNDER F 46-17.

Michael J. McCann FOR L.D. & D. INC. 1-7-98
 SIGNATURE OF DEVELOPER DATE

CONTRACT NO. 24-3639-D
 CHERRY CREEK OVERLOOK
 SECTION 1, AREA 2
 LOT NOS. 5-45
 WATER AND SEWER MAIN EXTENSIONS
 HOWARD COUNTY, MARYLAND

DEPARTMENT OF PUBLIC WORKS HOWARD COUNTY, MARYLAND 1-21-98 DATE	DEPARTMENT OF PLANNING AND ZONING HOWARD COUNTY, MARYLAND 1/20/98 DATE	Fisher, Collins & Carter, Inc. CIVIL ENGINEERING CONSULTANTS & LAND SURVEYORS CENTENNIAL SQUARE OFFICE PARK 10272 Baltimore National Pike Ellicott City, Maryland 21042 (410) 481-2855	DESIGNED BY: M.J.M. DRAWN BY: R.J.M./B.L.K. CHECKED BY: P.W.K. DATE: JANUARY, 1998 BY NO. REVISION DATE	TITLE SHEET 600' SCALE MAP NO. 20 BLOCK NO. 10170 F.C.C. WORK ORDER NO. 30203 FILE NAME: CHERRY CREEK OVERLOOK, SECTION 1, AREA 2	CHERRY CREEK OVERLOOK SECTION 1, AREA 2 LOT NOS. 5-45 CONTRACT NO. 24-3639-D SIXTH ELECTION DISTRICT HOWARD COUNTY, MARYLAND SCALE AS SHOWN SHEET 1 OF 6
--	---	---	---	--	--


MANHOLE TABULATION CHART				
No.	± ROAD STATION	DISTANCE	SLOPE	ELEVATION
G30	3+90	7' RT.	-3.80%	355.64
G35	2+05	7' RT.	-1.65%	352.43
G40	0+23	7' RT.	+4.00%	354.71
G45	3+16	7' RT.	+2.00%	353.31
G50	0+97	7' RT.	-1.50%	354.12

WATER FALL DRIVE
FLOWERING CHERRY LANE
WATER FALL DRIVE

SEE SHEET 4 FOR PROFILES OF WATER & SEWER MAINS IN WATER FALL DRIVE

SEE SHEET 5 FOR PROFILES OF WATER & SEWER MAINS IN FLOWERING CHERRY COURT 4 HARDING ROAD

SHC INVERT @ PROPERTY LINE CHART		
STATION	LOT	ELEVATION
0+30 LT.	MH G30 TO MH G35	342.76
0+38 RT.	43	344.19
1+34 LT.	11	347.02
@ MH G35 LT.	10 (SHC @ MH)	349.57
0+71 RT.	7	343.26
1+66 RT.	8 (DHC)	347.36
	MH G45 TO MH G50	
@ MH G50 RT.	9 @ 1.00% (SHC @ MH)	351.58
@ MH G50 LT.	FUTURE LOT 4 @ (1.00%) (SHC @ MH)	351.68
	EX. MH #5A TO EX. MH #6	
0+12 RT.	5	349.20
0+05 RT.	6	341.51
	MH G40 TO MH G45	
0+52 LT.	FUTURE LOT 1 (SHC @ 5.00%)	344.31
1+28 LT.	FUTURE LOT 2 (DHC @ 5.00%)	349.40
2+05 LT.	FUTURE LOT 3 (DHC @ 5.00%)	352.30
	MH G45 TO 6" PLUG	
0+35 LT.	FUTURE LOT 4 (DHC @ 5.00%)	354.20

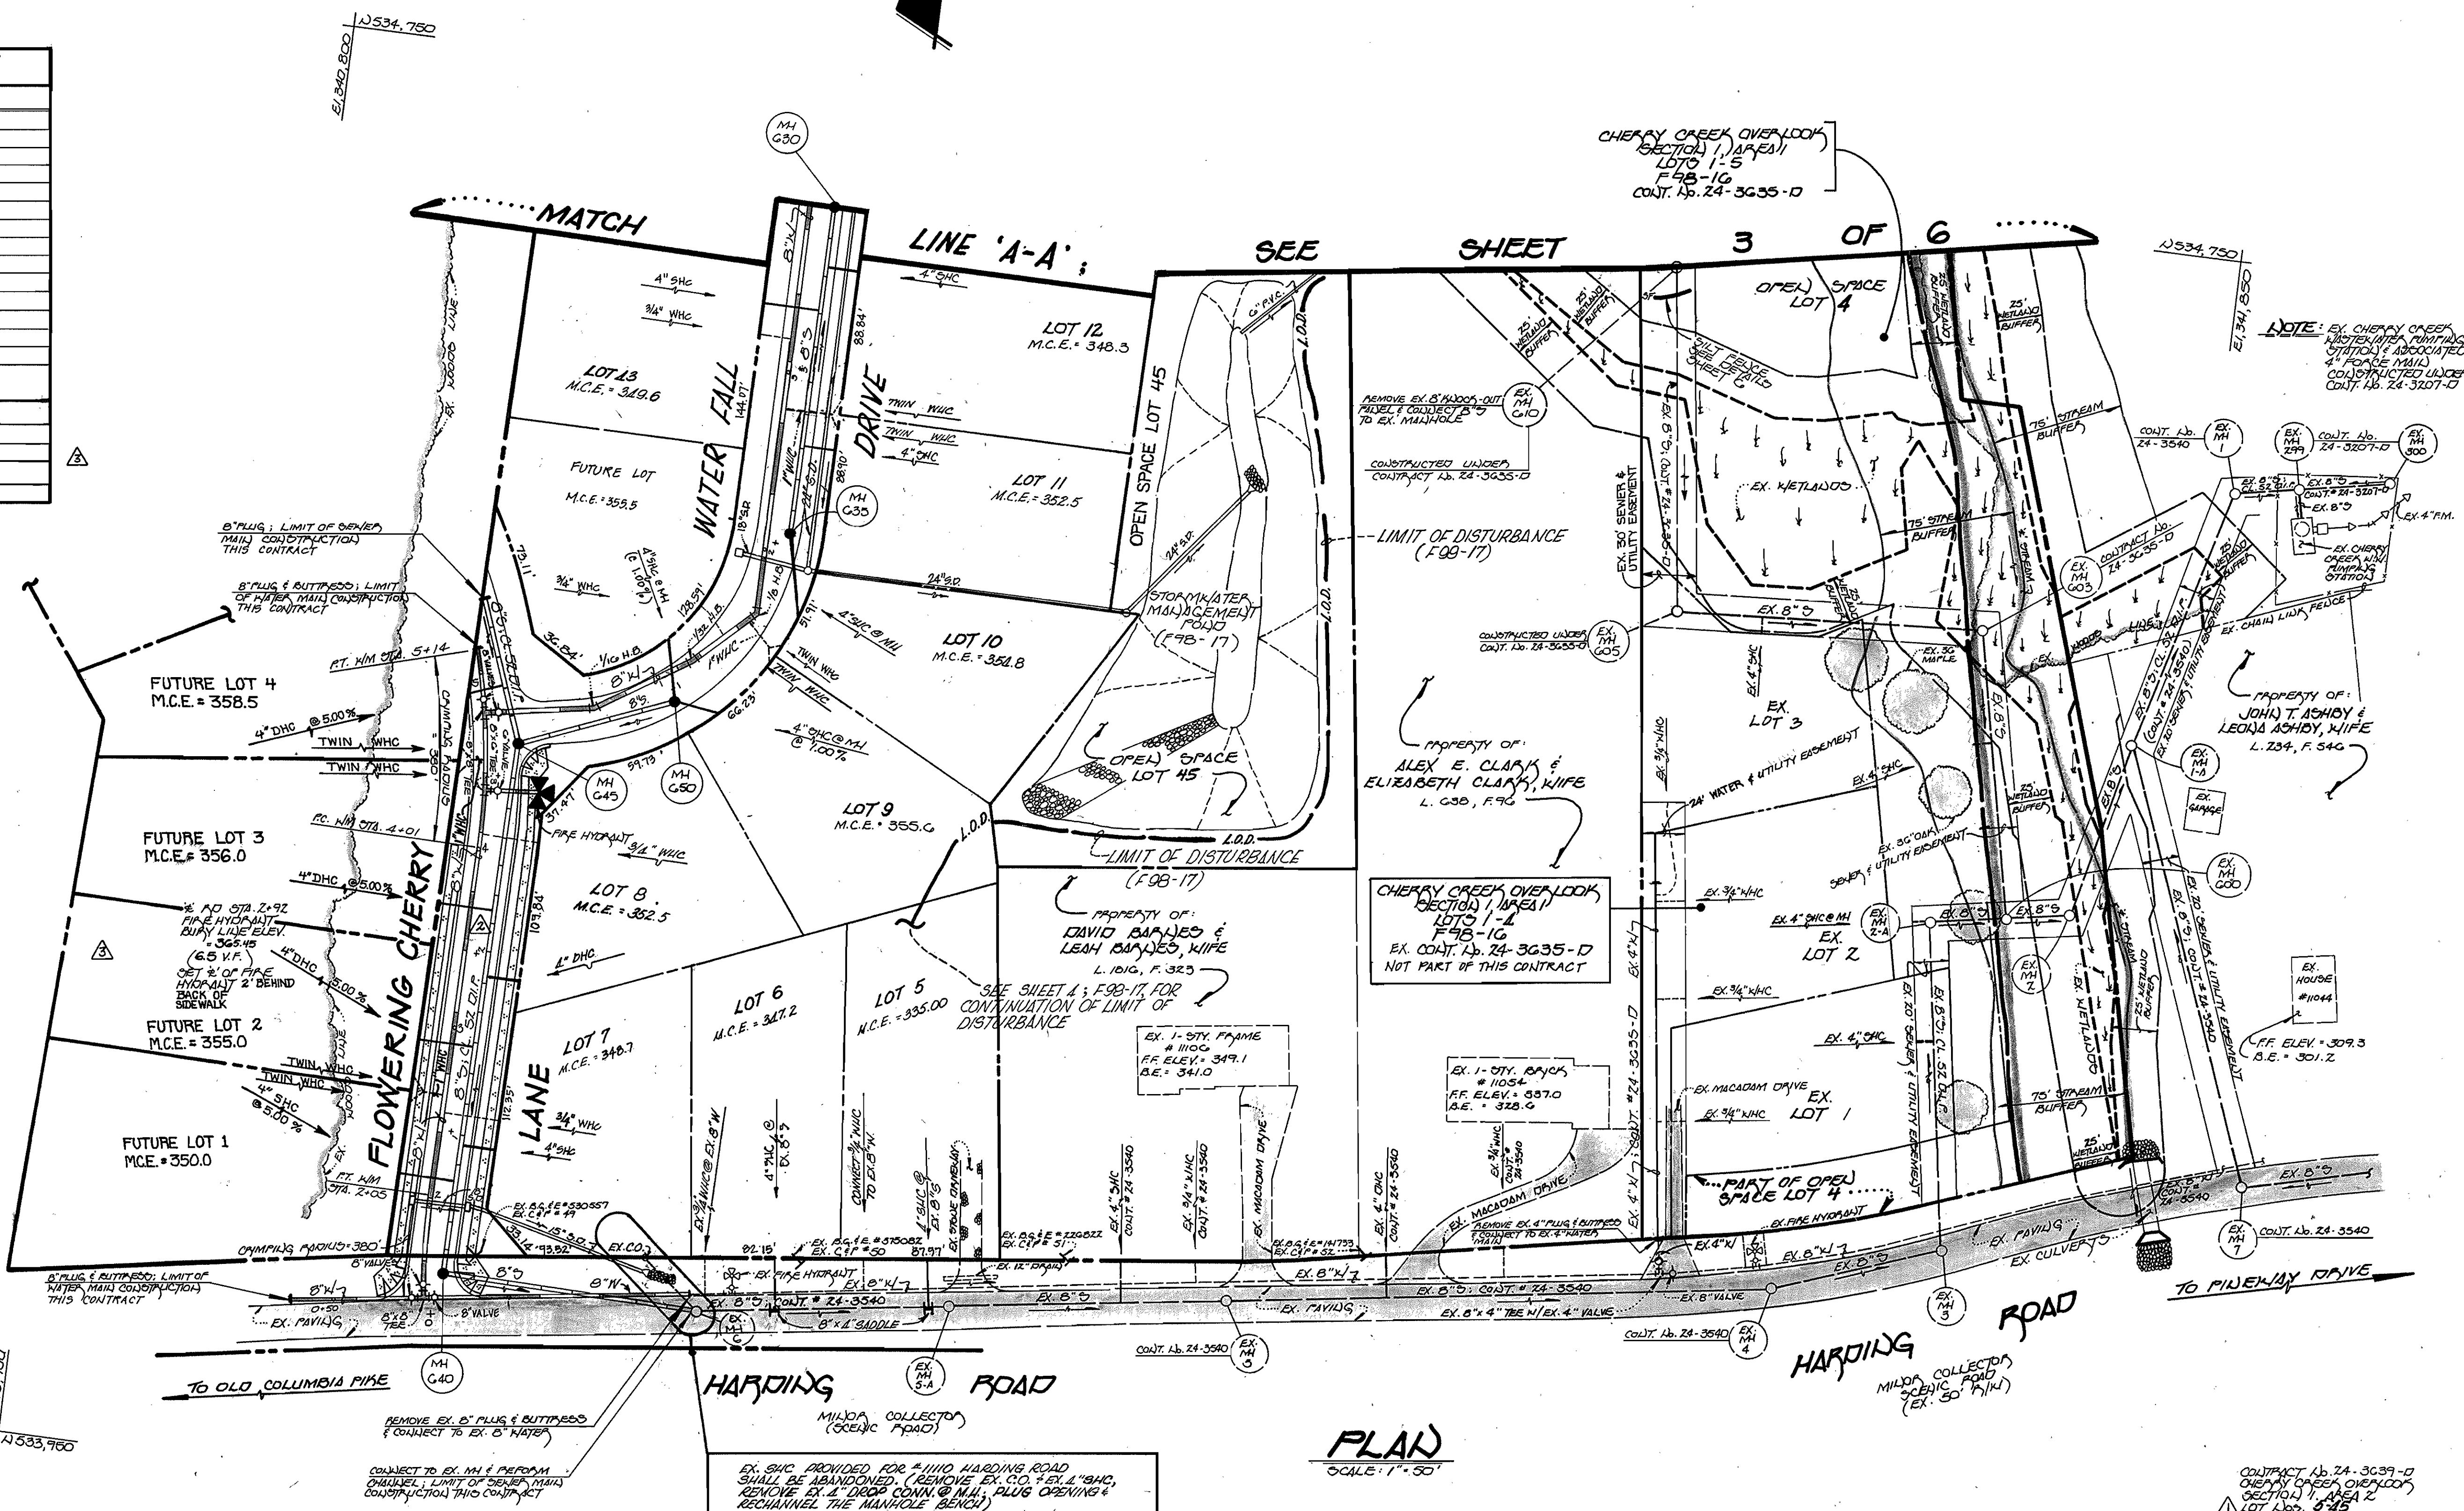

NOTE: THE LENGTH OF OPEN TRENCH SHALL BE LIMITED TO THREE (3) PIPE LENGTHS OR THAT WHICH SHALL BE BACKFILLED & STABILIZED WITHIN ONE (1) WORKING DAY, WHICHEVER IS SHORTER.


EX. SHC PROVIDED FOR 18" HD HARDING ROAD SHALL BE ABANDONED. (REMOVE EX. CO. # 11" SHC, REMOVE EX. 4" DROP CONN. @ MH, PLUS OPENING & REBAR THE MANHOLE BENCH)

PLAN
SCALE: 1" = 50'

DEPARTMENT OF PUBLIC WORKS
HOWARD COUNTY, MARYLAND
1-21-98

DEPARTMENT OF PLANNING AND ZONING
HOWARD COUNTY, MARYLAND
1/20/98

Fisher, Collins & Carter, Inc.
CIVIL ENGINEERING CONSULTANTS & LAND SURVEYORS
CENTENNIAL SQUARE OFFICE PARK
3027 BALTIMORE NATIONAL PIKE
ELLICOTT CITY, MARYLAND 21116
(410) 461-2855

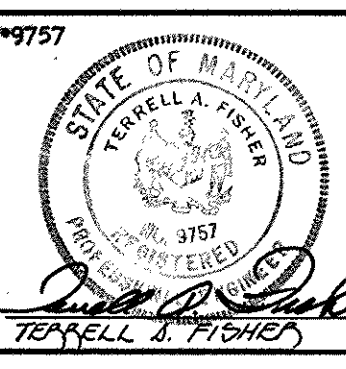

DESIGNED BY:	M. J. M.	DATE:	JANUARY, 1998
CHECKED BY:	T. M. M.	BY:	NO.
DATE:	JANUARY, 1998	REVISION:	
L.M.	INDICATE WHCs/SHCs FOR FUTURE LOTS	DATE:	4/29/98
L.M.	REVISE FLOWERING CHERRY LANE TO CLOSED SECTION ROAD	DATE:	4/29/98
L.M.	REVISE LOT TOTAL TO REFLECT ADDTL. OPEN SPACE LOTS	DATE:	4/29/98

WATER & SEWER MAINS
PLAN VIEW
300' SCALE MAP NO. 36 BLOCK NO. 10 F 10
FCC WADAP ORDER NO. 30253
FILE NAME: CHERRY CREEK OVERLOOK

CHERRY CREEK OVERLOOK
SECTION 1, AREA 2
LOT Nos. 5-45
CONTRACT NO. 24-3639-D
SIXTH ELECTION DISTRICT
HOWARD COUNTY, MARYLAND
SCALE: AS SHOWN
SHEET 2 OF 6

MANHOLE TABULATION CHART

NO.	R.F. STATION	DISTANCE	SLOPE	ELEVATION
G15				338.50
G20				342.00
G25	5+17	8' RT.	-0.32%	333.00
G30	3+90	7' RT.	-3.80%	355.04
G32				333.50
G55				337.50
G57				333.00
G58				349.00
G60	C+15	9' RT.	+2.32%	354.00
G65	7+20	8' RT.	+5.08%	358.02
G70	12 COURTY			357.50
G75	2+04	10' RT.	-2.00%	358.05
G80	12 COURTY			355.84
G85	12 COURTY			355.58
G90	8+00	7' RT.	+8.00%	367.52
G95	12 COURTY			377.00
T00	12 COURTY			378.40

FLOWERING CHERRY LANE
(EX. 50' W/M)

SET MH 1'-6" ABOVE PROPOSED GRADE
SET MH 1'-6" FLUSH W/ EXISTING GRADE

WATER FALL DRIVE
SET MH 1'-6" ABOVE PROPOSED GRADE
SET MH 1'-6" ABOVE EXISTING GRADE
SET MH 1'-6" ABOVE EXISTING GROUND
SET MH FLUSH W/ EXISTING GRADE

WATER FALL DRIVE
HIDDEN POOL COURT
WATER FALL DRIVE

SHC INVERT @ PROPERTY LINE CHART

STATION	LOT	ELEVATION
0+50 RT.	MH G15 TO MH G20	328.26
0+95 RT.	17	331.84
0+22 RT.	MH G20 TO MH G25	336.22
C MH G25 RT.	41 (SHC @ MH)	339.97
0+94 RT.	42	341.31
@ MH G60 LT.	MH G25 TO MH G60	340.48
1+25 LT.	MH G82 TO MH G55	327.12
0+30 RT.	MH G57 TO MH G58	329.91
1+00 LT.	20 (DHC)	338.70
0+25 FT.	MH G60 TO MH G65	341.03
0+30 LT.	MH G65 TO MH G90	348.49
0+60 FT.	27	349.09
@ MH G75 RT.	MH G70 TO MH G75	348.72
@ MH G75 LT.	16 (SHC @ MH)	344.83
@ MH G80 RT.	MH G80 TO MH G85	340.71
0+20 FT.	22 (SHC @ MH)	340.83
@ MH G85 RT.	24 (SHC @ MH)	340.97
@ MH G85 CTR.	25 (DHC @ MH)	345.98
0+15 LT.	MH G90 TO MH G95	350.14
0+20 FT.	28	350.70
1+07 RT.	29 (@ 1.00%)	362.03
1+12 LT.	37 (@ 1.00%)	362.16
1+18 LT.	36 (@ 1.00%)	362.53
@ MH G95 LT.	35 (SHC @ MH)	364.10
@ MH G95 LT.	MH G95 TO MH T00	364.47
0+15 LT.	34 (SHC @ MH)	364.50
0+22 LT.	33	364.68
@ MH T00 LT.	31 (SHC @ MH)	364.89
@ MH T00 CTR.	30 (SHC @ 1.00%)	364.77


NOTE: LOTS 17, 18, 19, 32, 33, 36 & 37 SHALL HAVE OUTSIDE METER SETTINGS AS INDICATED; STANDARD DETAIL W331.


NOTE: THE LENGTH OF OPEN TRENCH SHALL BE LIMITED TO THREE (3) PIPE LENGTHS OR THAT WHICH SHALL BE BACKFILLED & STABILIZED WITHIN ONE (1) WORKING DAY, WHICHEVER IS SHORTER.

SEE SHEET 4 FOR PROFILES OF WATER & SEWER MAINS IN WATER FALL DRIVE

SEE SHEET 5 FOR PROFILES OF WATER & SEWER MAINS IN HIDDEN POOL COURT

SEE SHEET 6 FOR PROFILES OF OUTFALL SEWER MAINS FROM WATER FALL DRIVE & HIDDEN POOL COURT

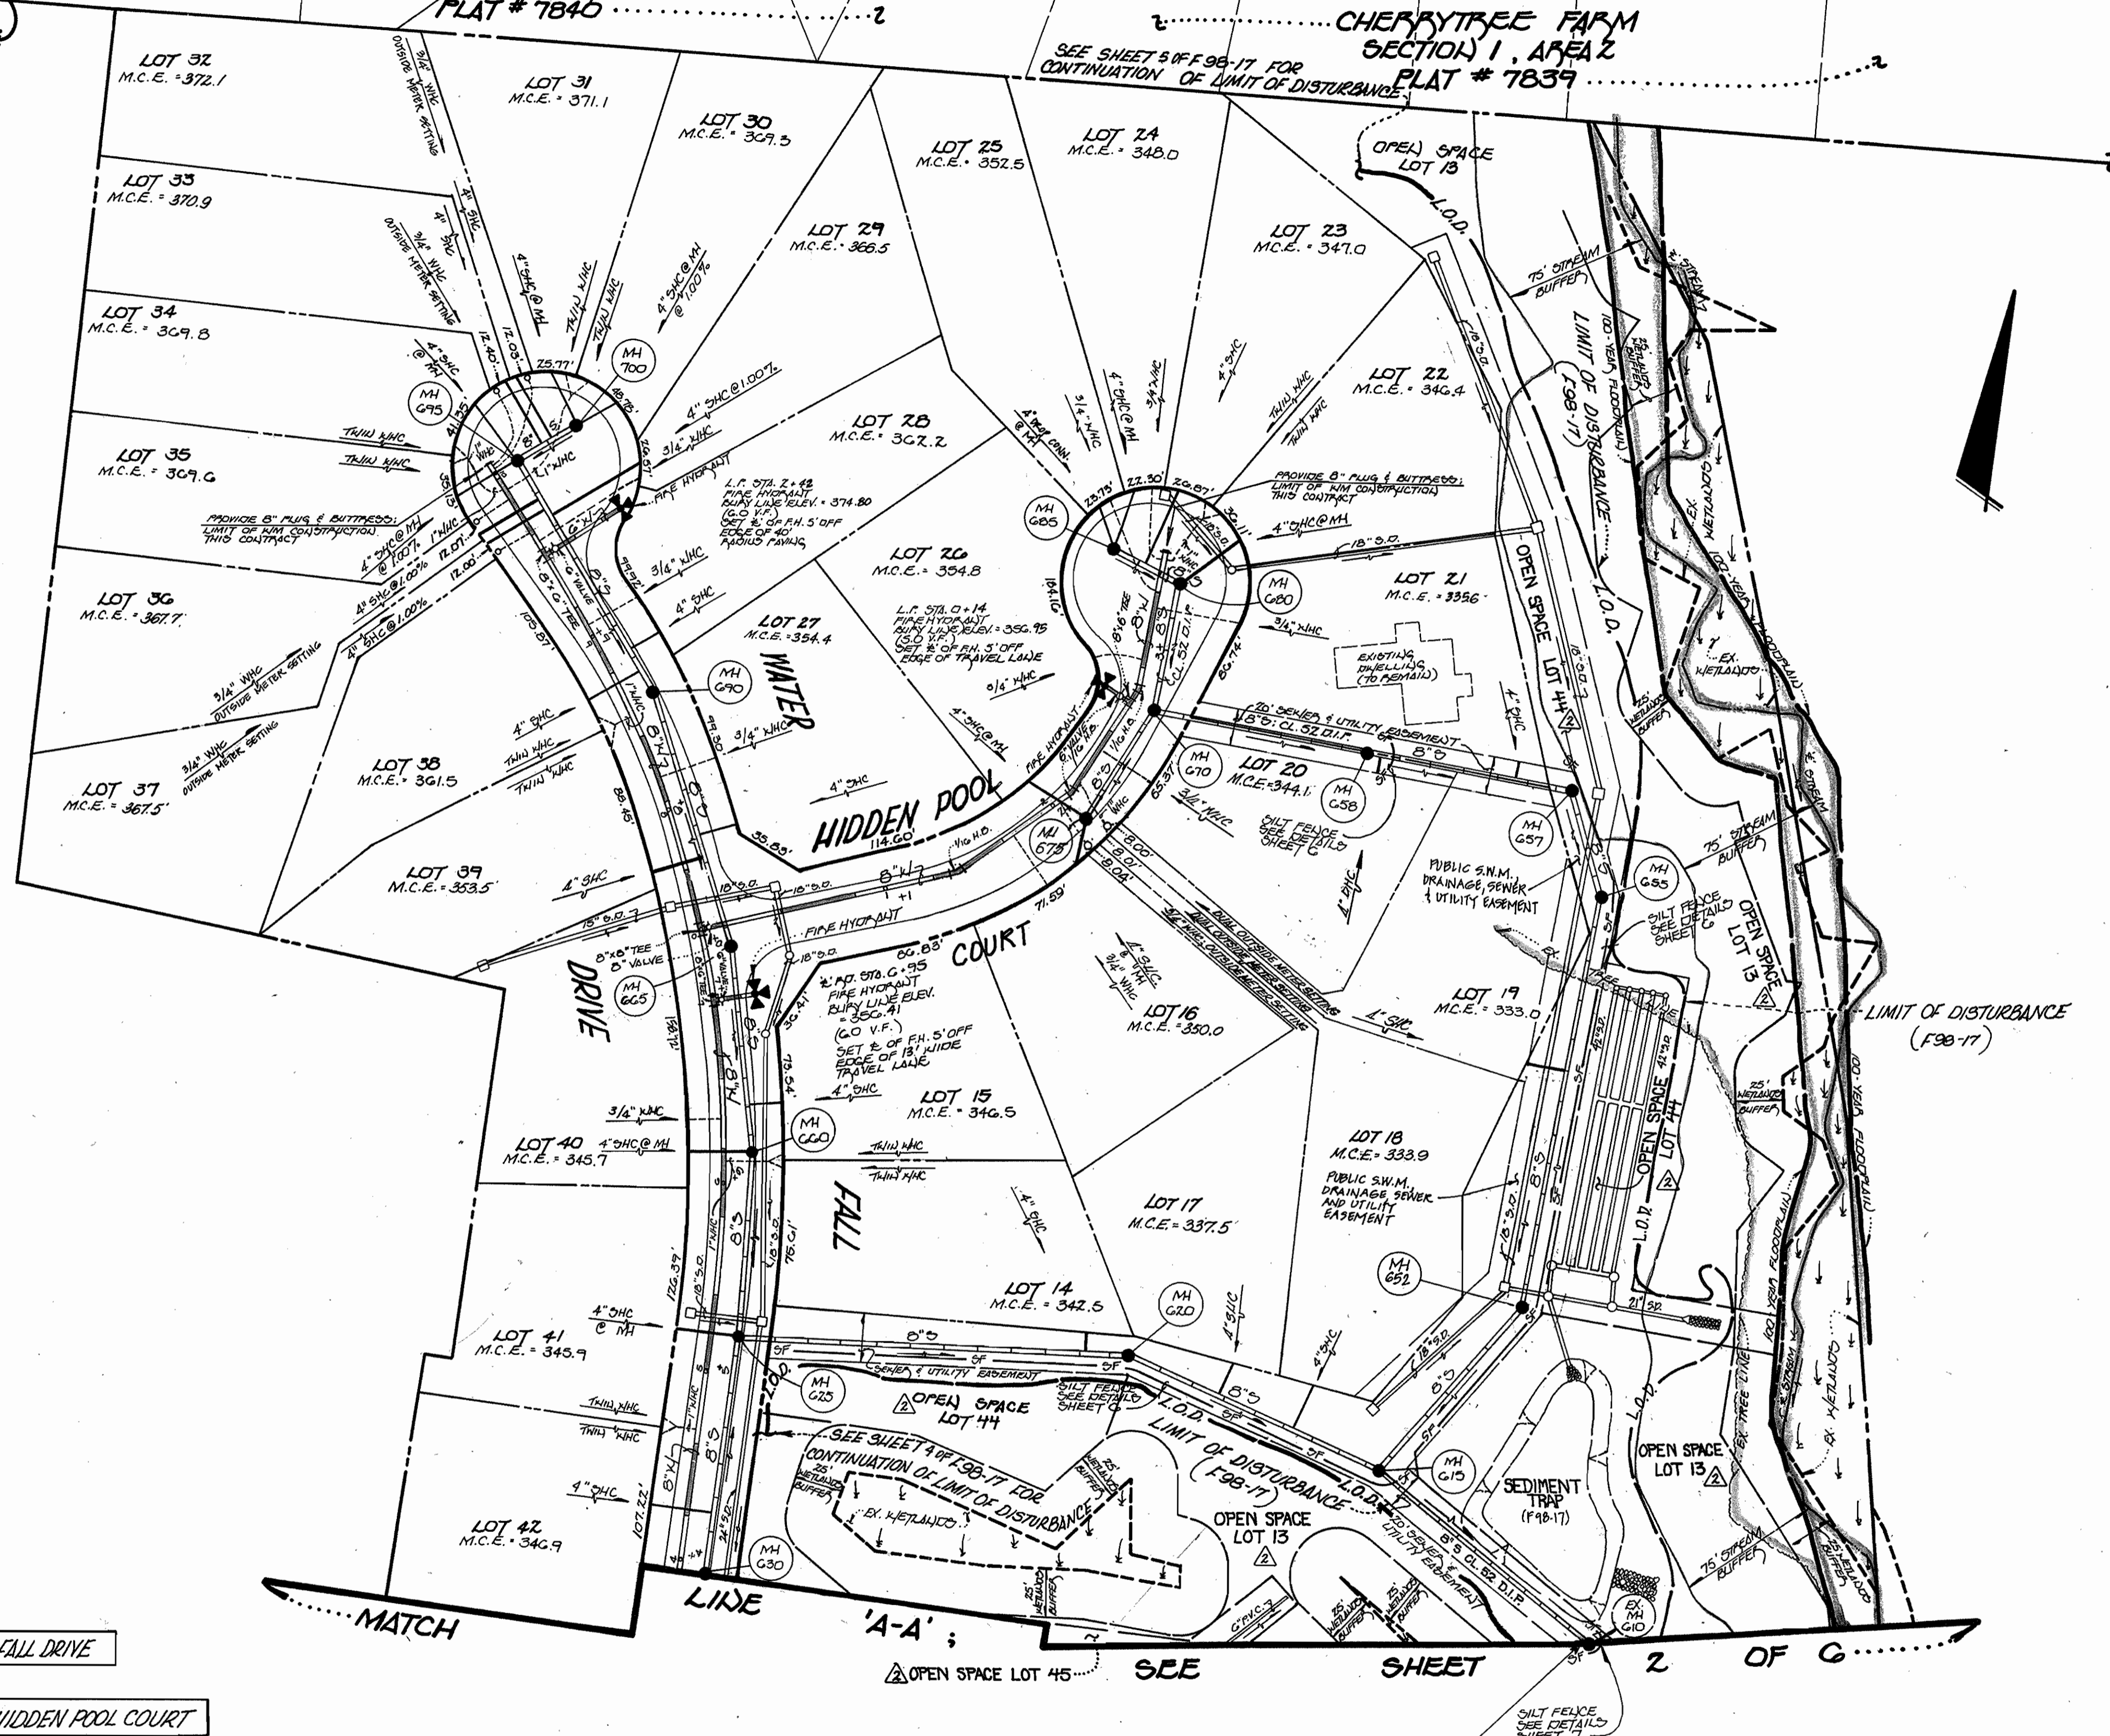

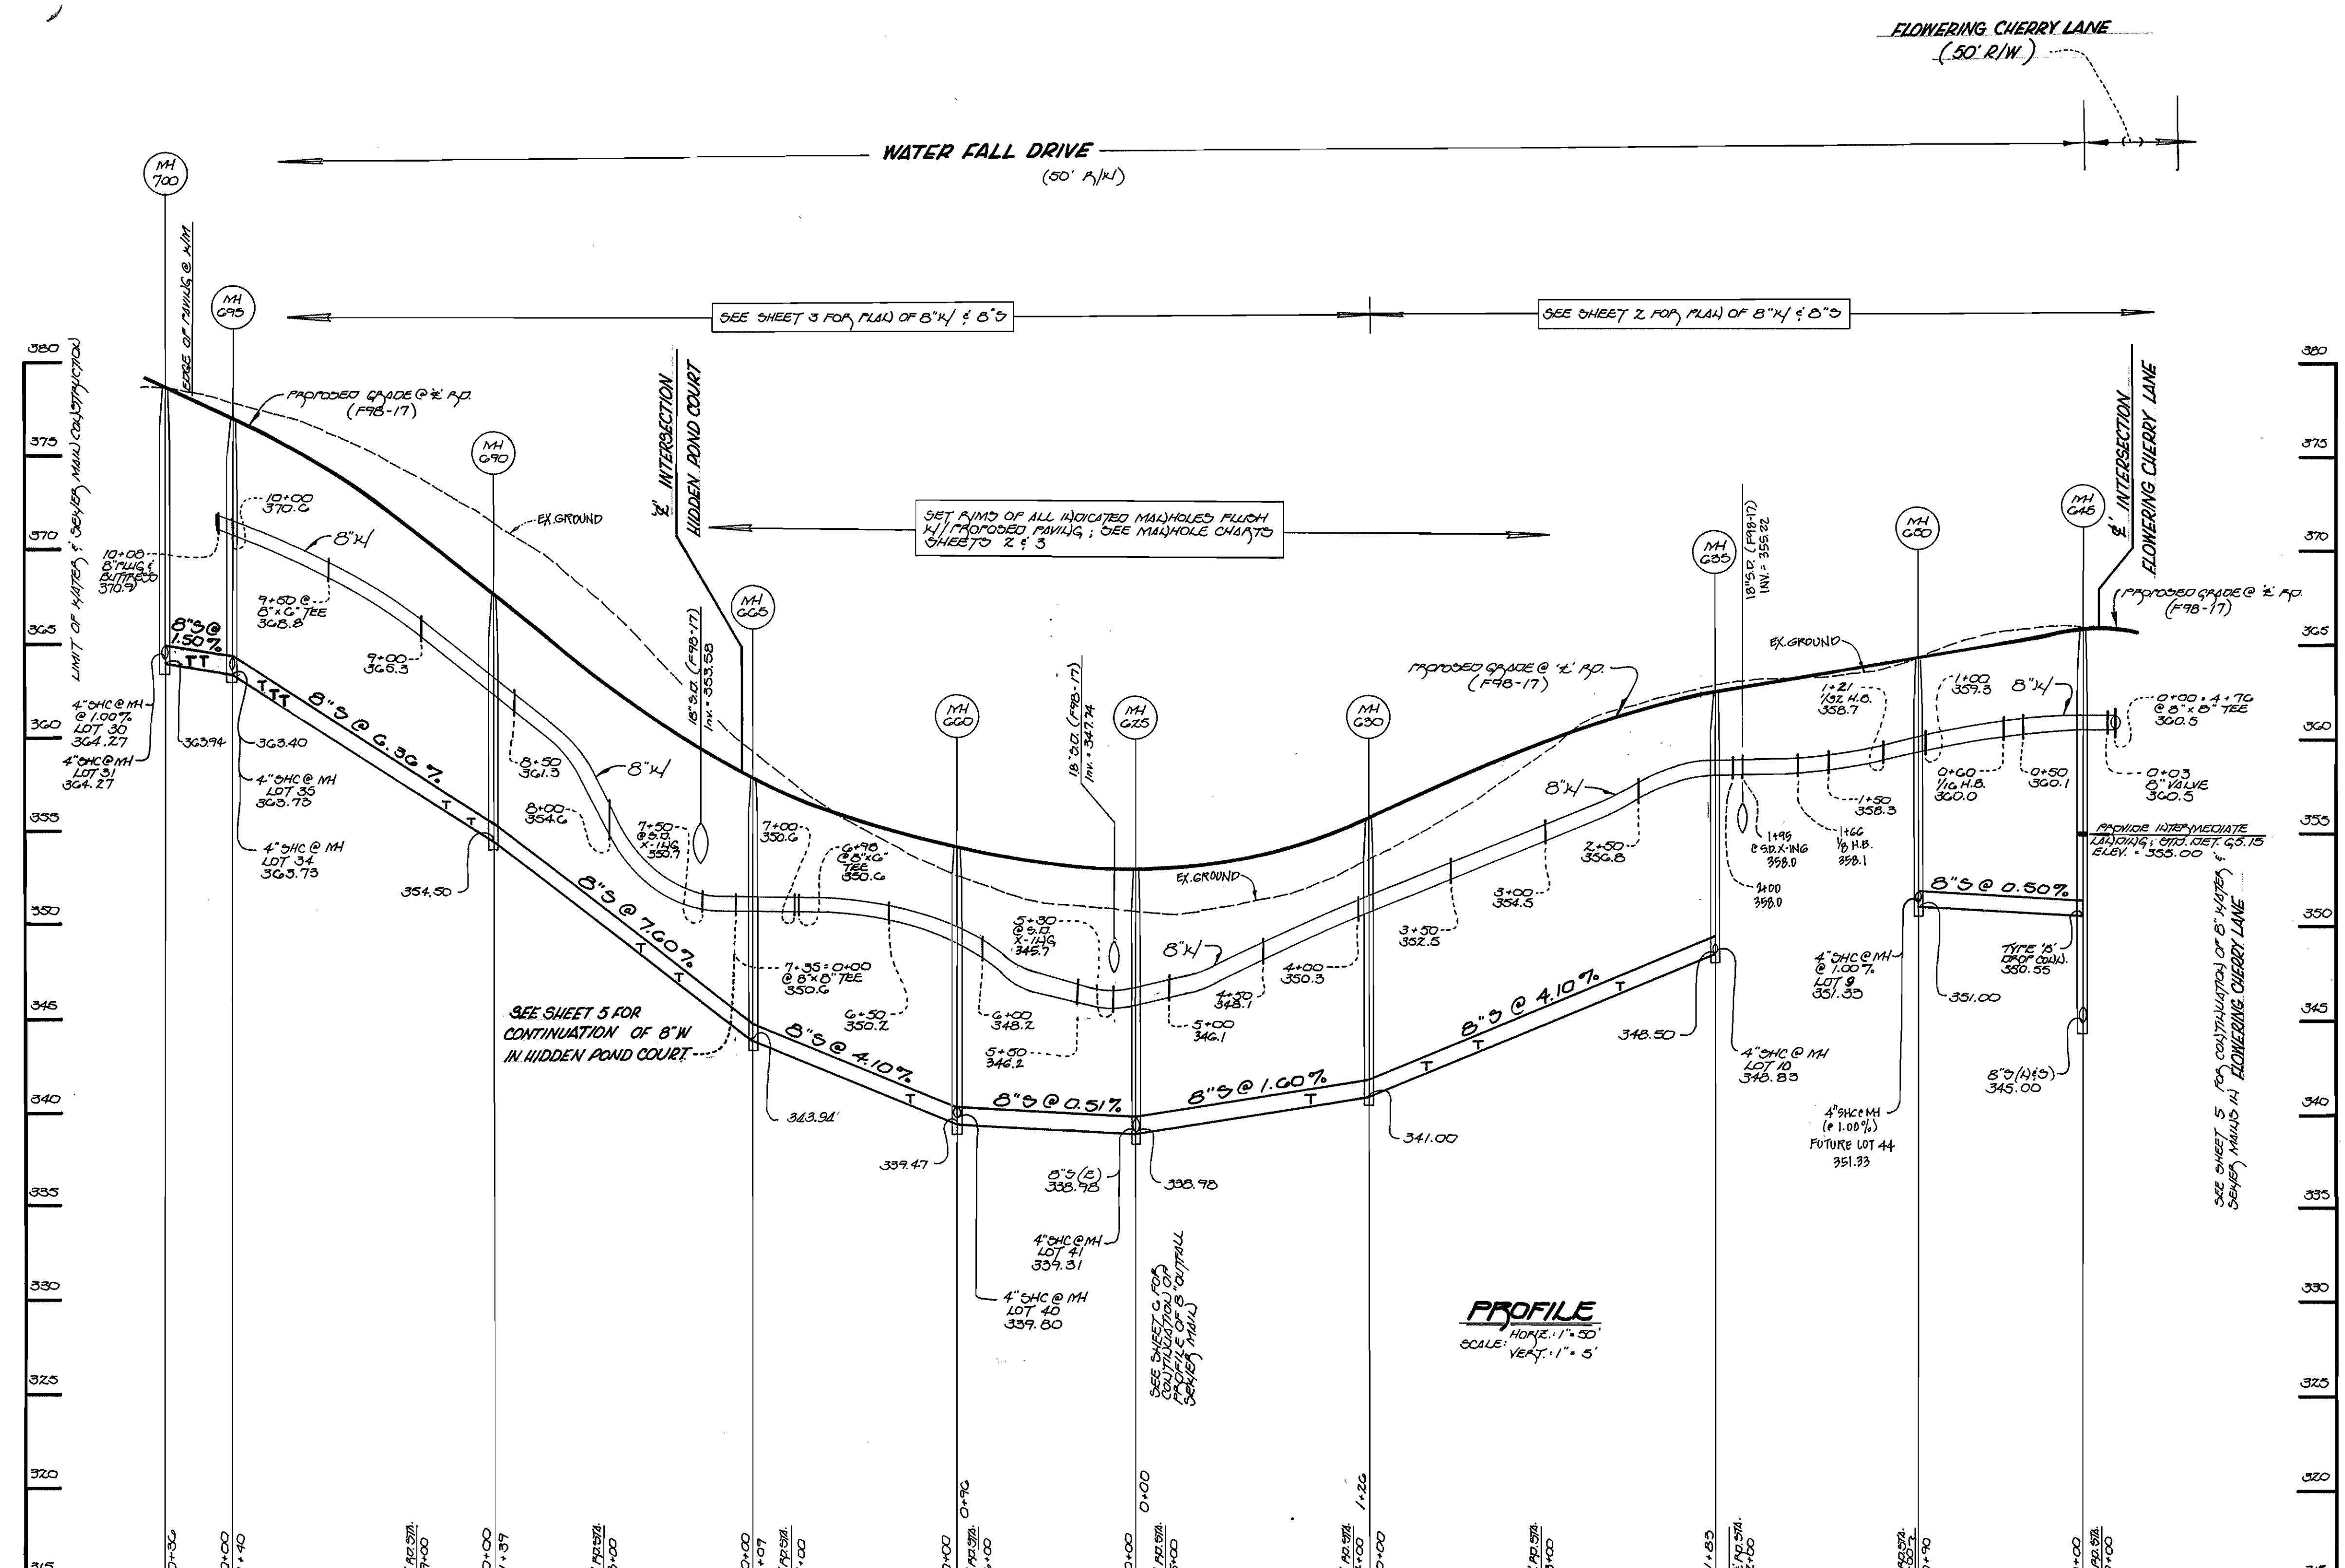

8-INCH WATER & SEWER MAINS: WATER FALL DRIVE


PROFILE
 HORIZ. 1" = 50'
 SCALE: VERT. 1" = 5'

NOTE: THE LENGTH OF OPEN TRENCH SHALL BE LIMITED TO THREE (3) PIPE LENGTHS ON THAT KIND OF CHALL BE BACK-FILLED & STABILIZED WITHIN ONE (1) WORKING DAY, WHICHEVER IS SHORTER.

DEPARTMENT OF PUBLIC WORKS
 HOWARD COUNTY, MARYLAND
 Chief, Bureau of Utilities
 1-21-98
 DATE

DEPARTMENT OF PLANNING AND ZONING
 HOWARD COUNTY, MARYLAND
 Chief, Development Engineering Division
 DATE

FISHER, COLLINS & CARTER, INC.
 CIVIL ENGINEERING CONSULTANTS & LAND SURVEYORS
 CENTENNIAL SQUARE OFFICE PARK - 10722 BALTIMORE NATIONAL FREE
 ELLICOTT CITY, MARYLAND 21114
 (410) 481-2255

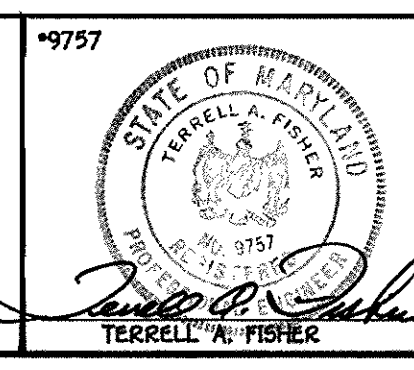


DESIGNED BY: M.J.M.
 DRAWN BY: J.H.H.
 CHECKED BY: P.M.K.
 DATE: JANUARY, 1998
 L.M. REVISION LOT TOTAL TO REFLECT ADD'L. OPEN SPACE LOTS
 4/27/10
 DATE


WATER AND SEWER MAINS PROFILES
 600' SCALE MAP NO. 42 BLOCK NO. 1011G
 F.C.C. WORK ORDER NO. 30003
 FILE NAME: CHERRY CREEK OVERLOOK

CHERRY CREEK OVERLOOK
 SECTION 1, AREA 2
 LOT Nos. 5-45
 CONTRACT No. 24-3039-D
 SIXTH ELECTION DISTRICT
 HOWARD COUNTY, MARYLAND


SCALE AS SHOWN
 SHEET 4 OF 6

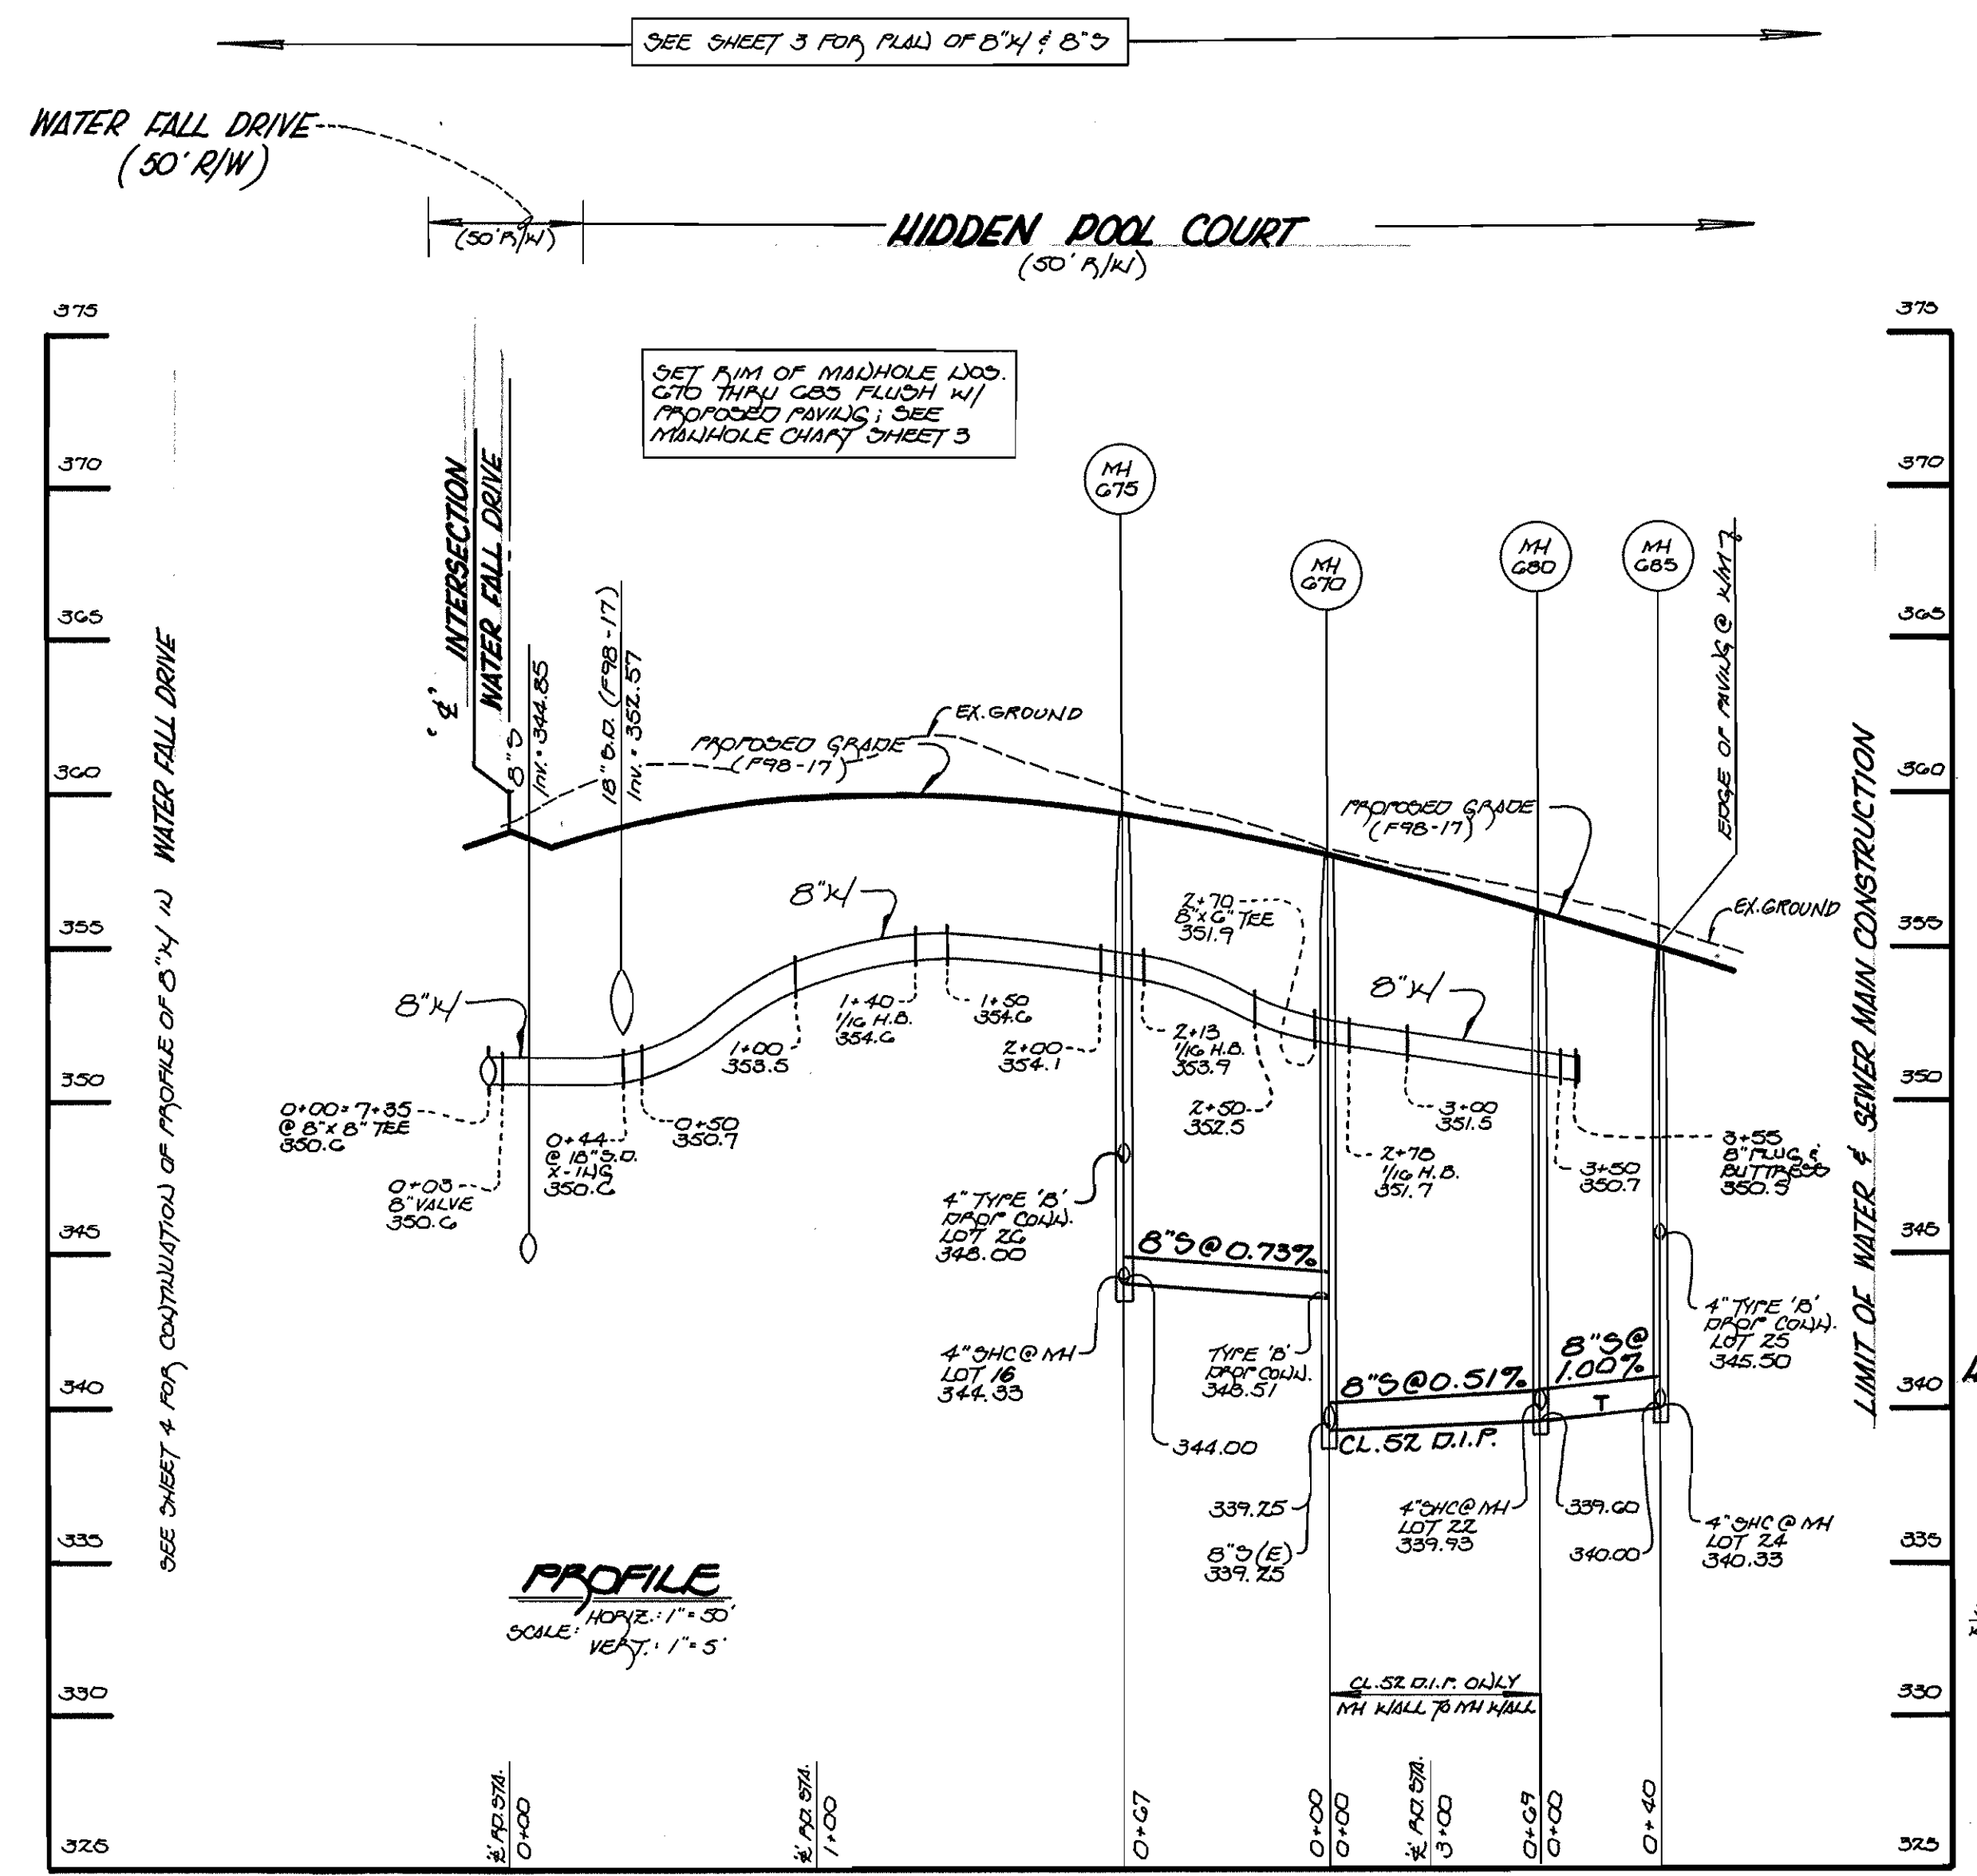


8-INCH WATER & SEWER MAINS: HIDDEN POOL COURT

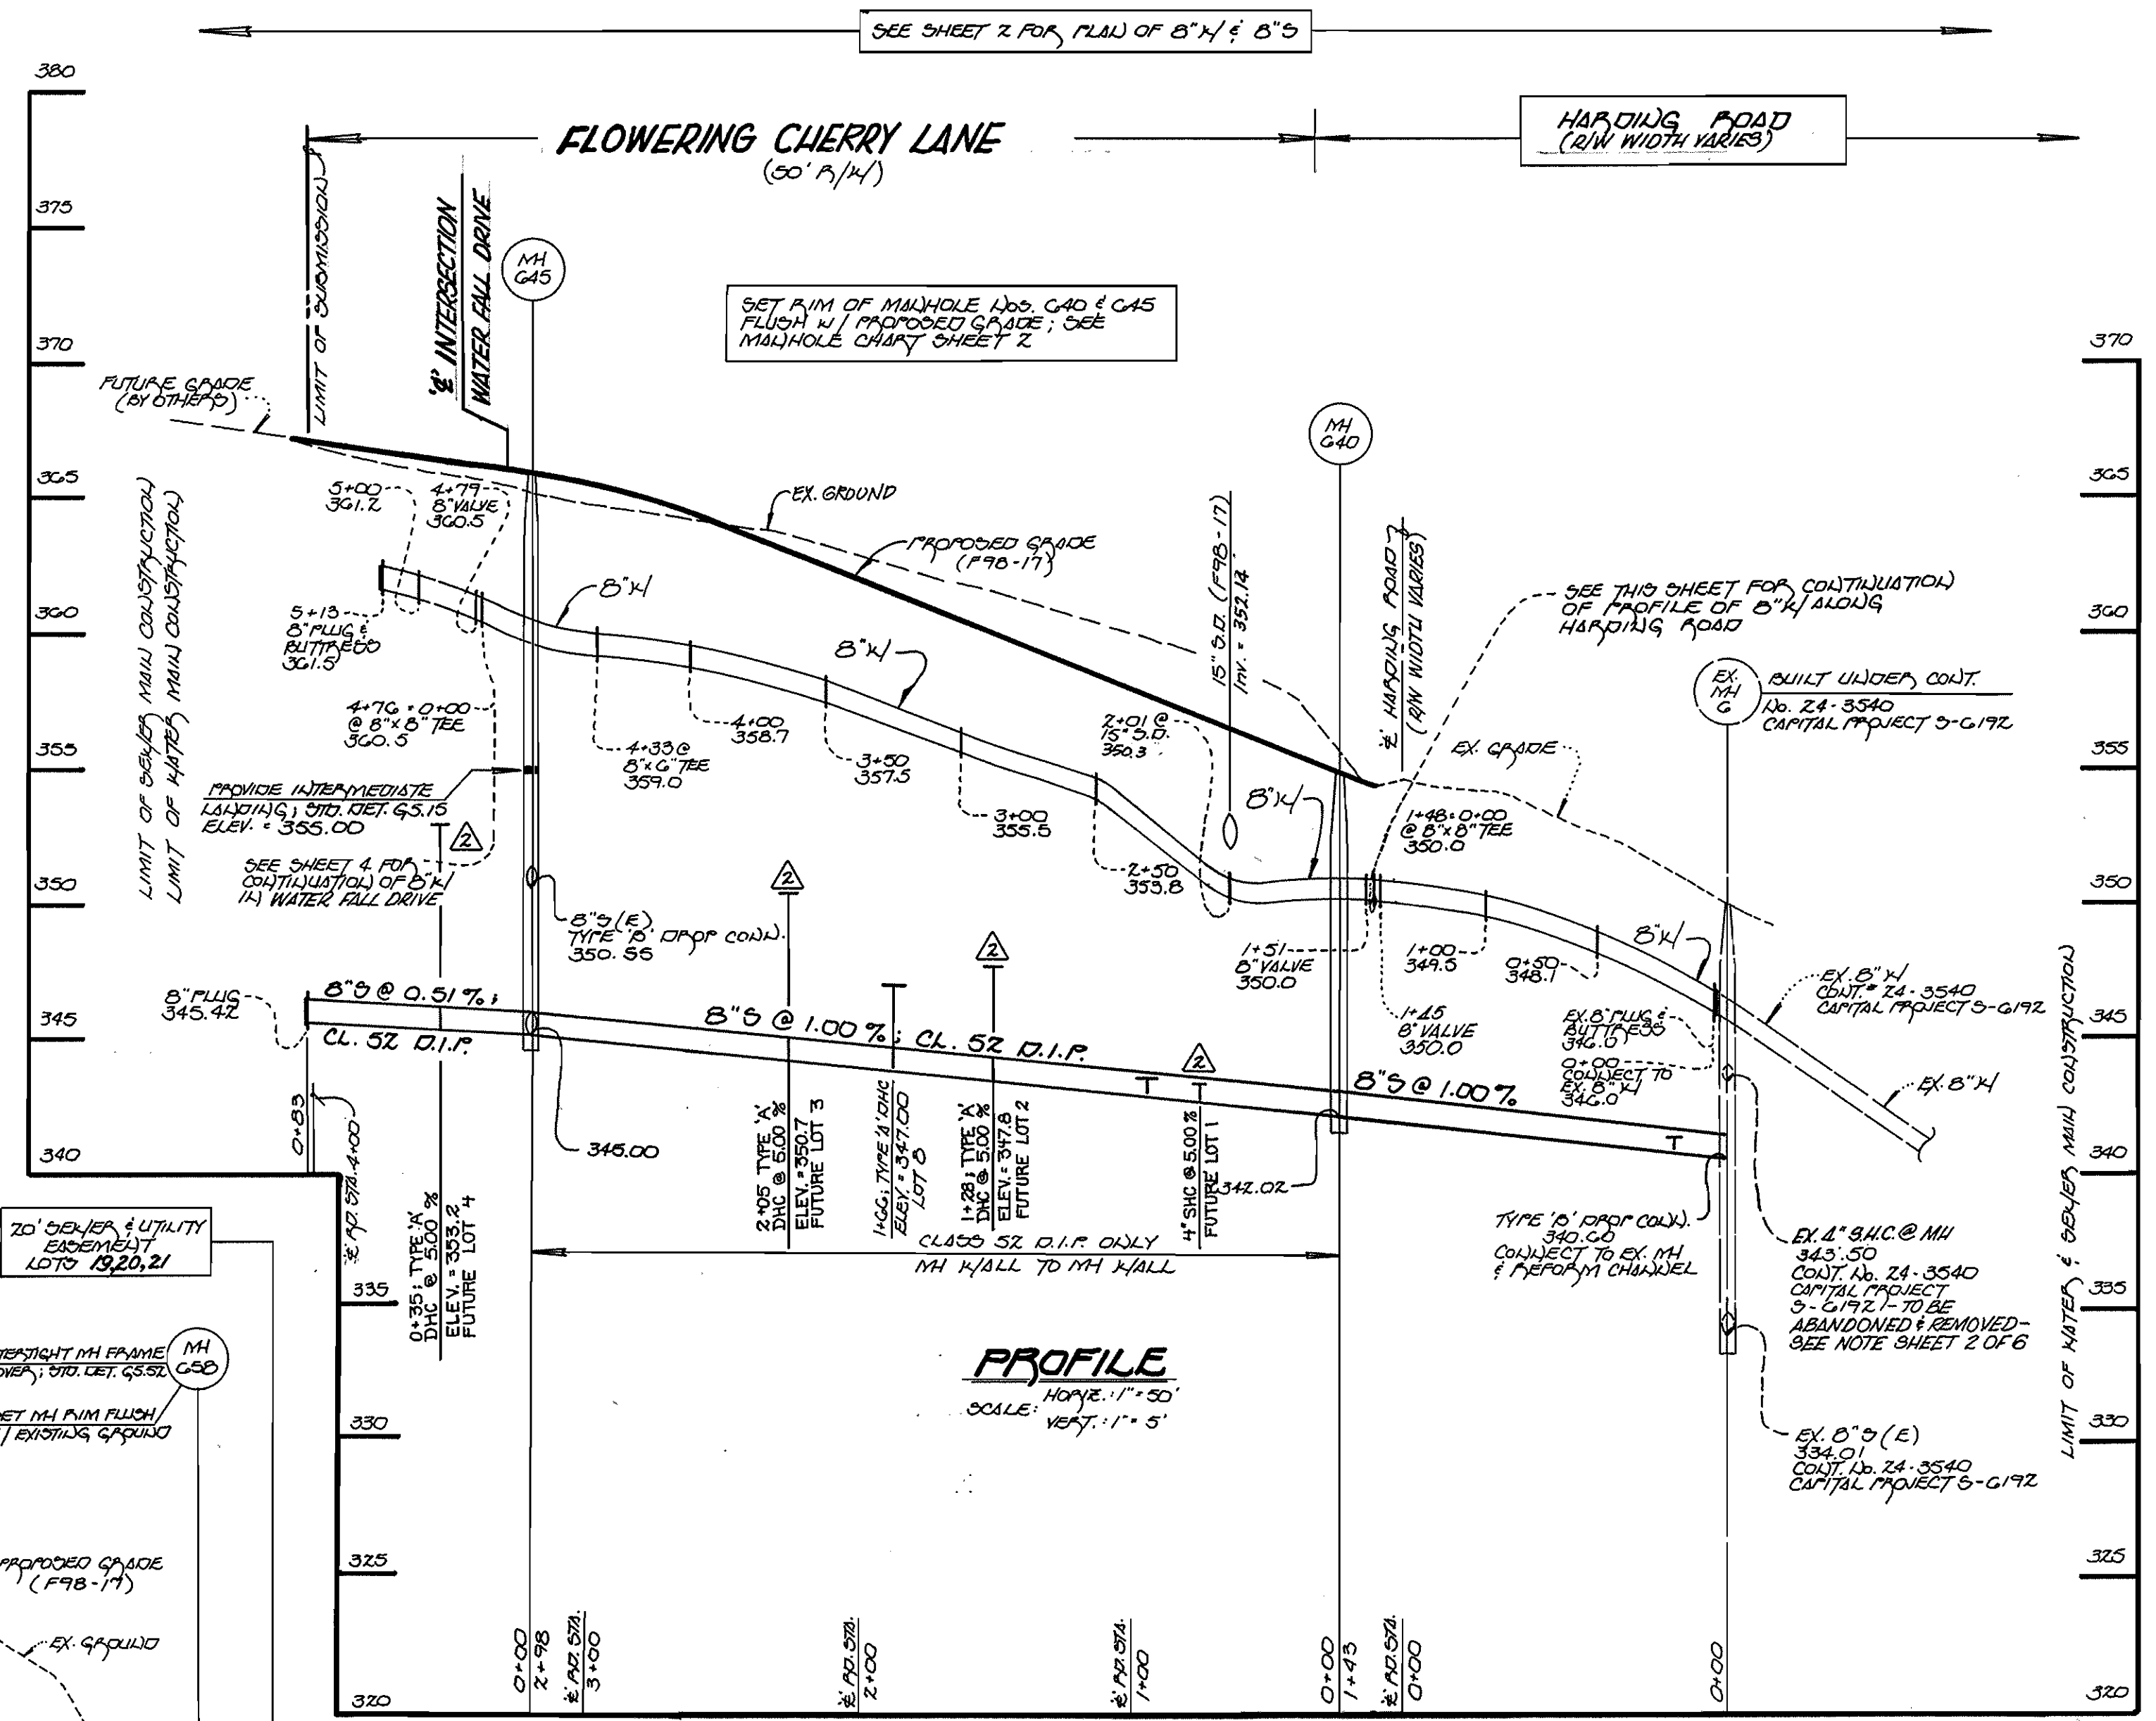

8-INCH WATER & SEWER MAINS: HARDING ROAD & FLOWERING CHERRY LANE

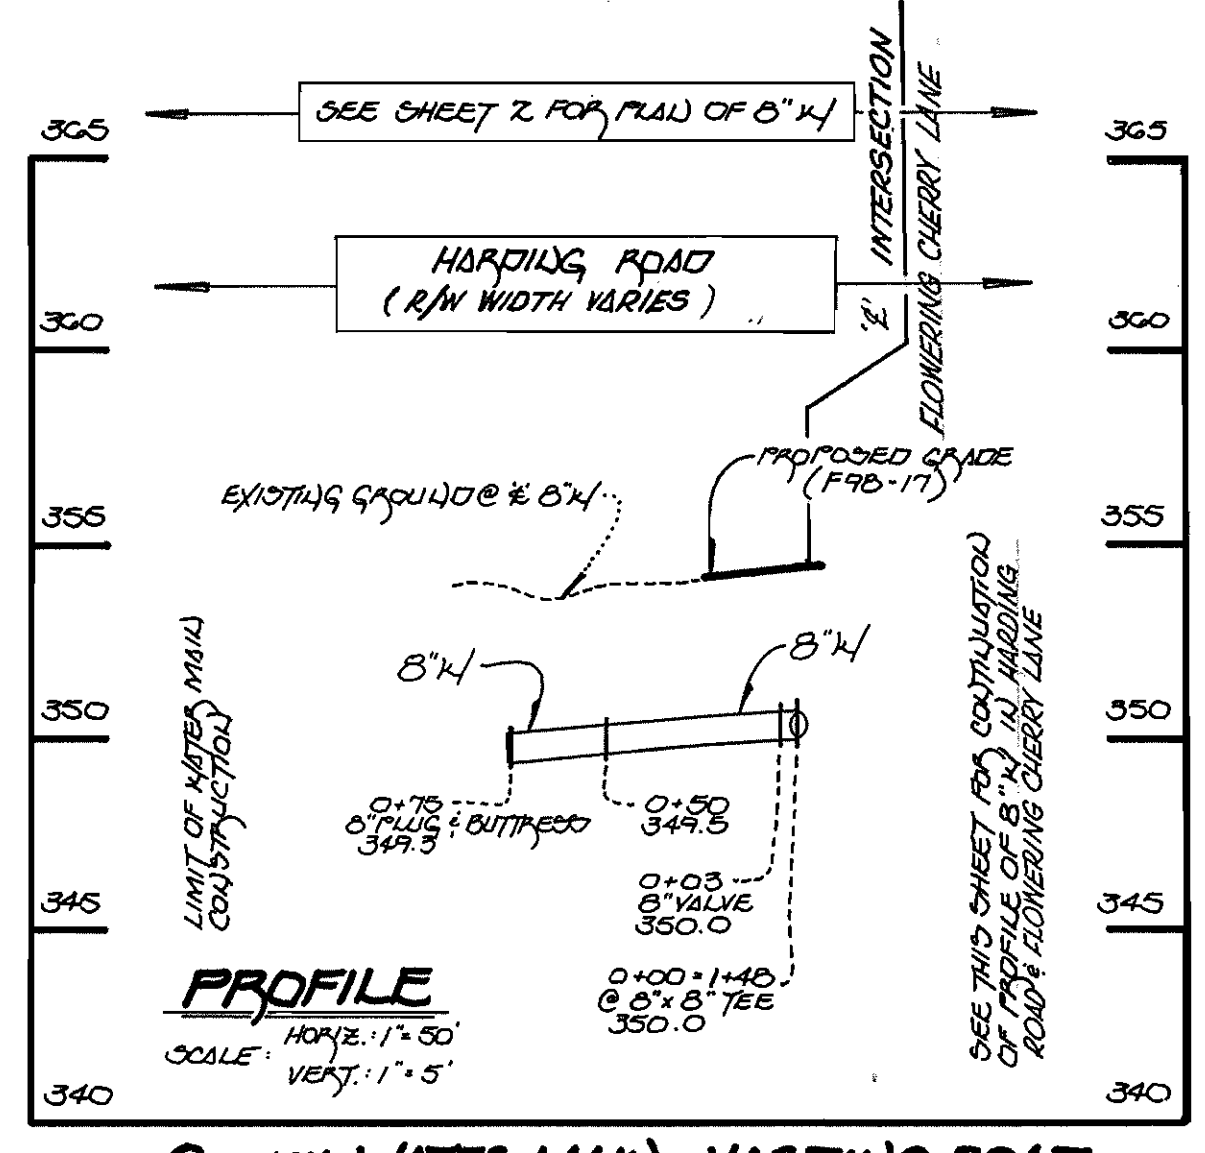

8-INCH WATER MAIN: HARDING ROAD

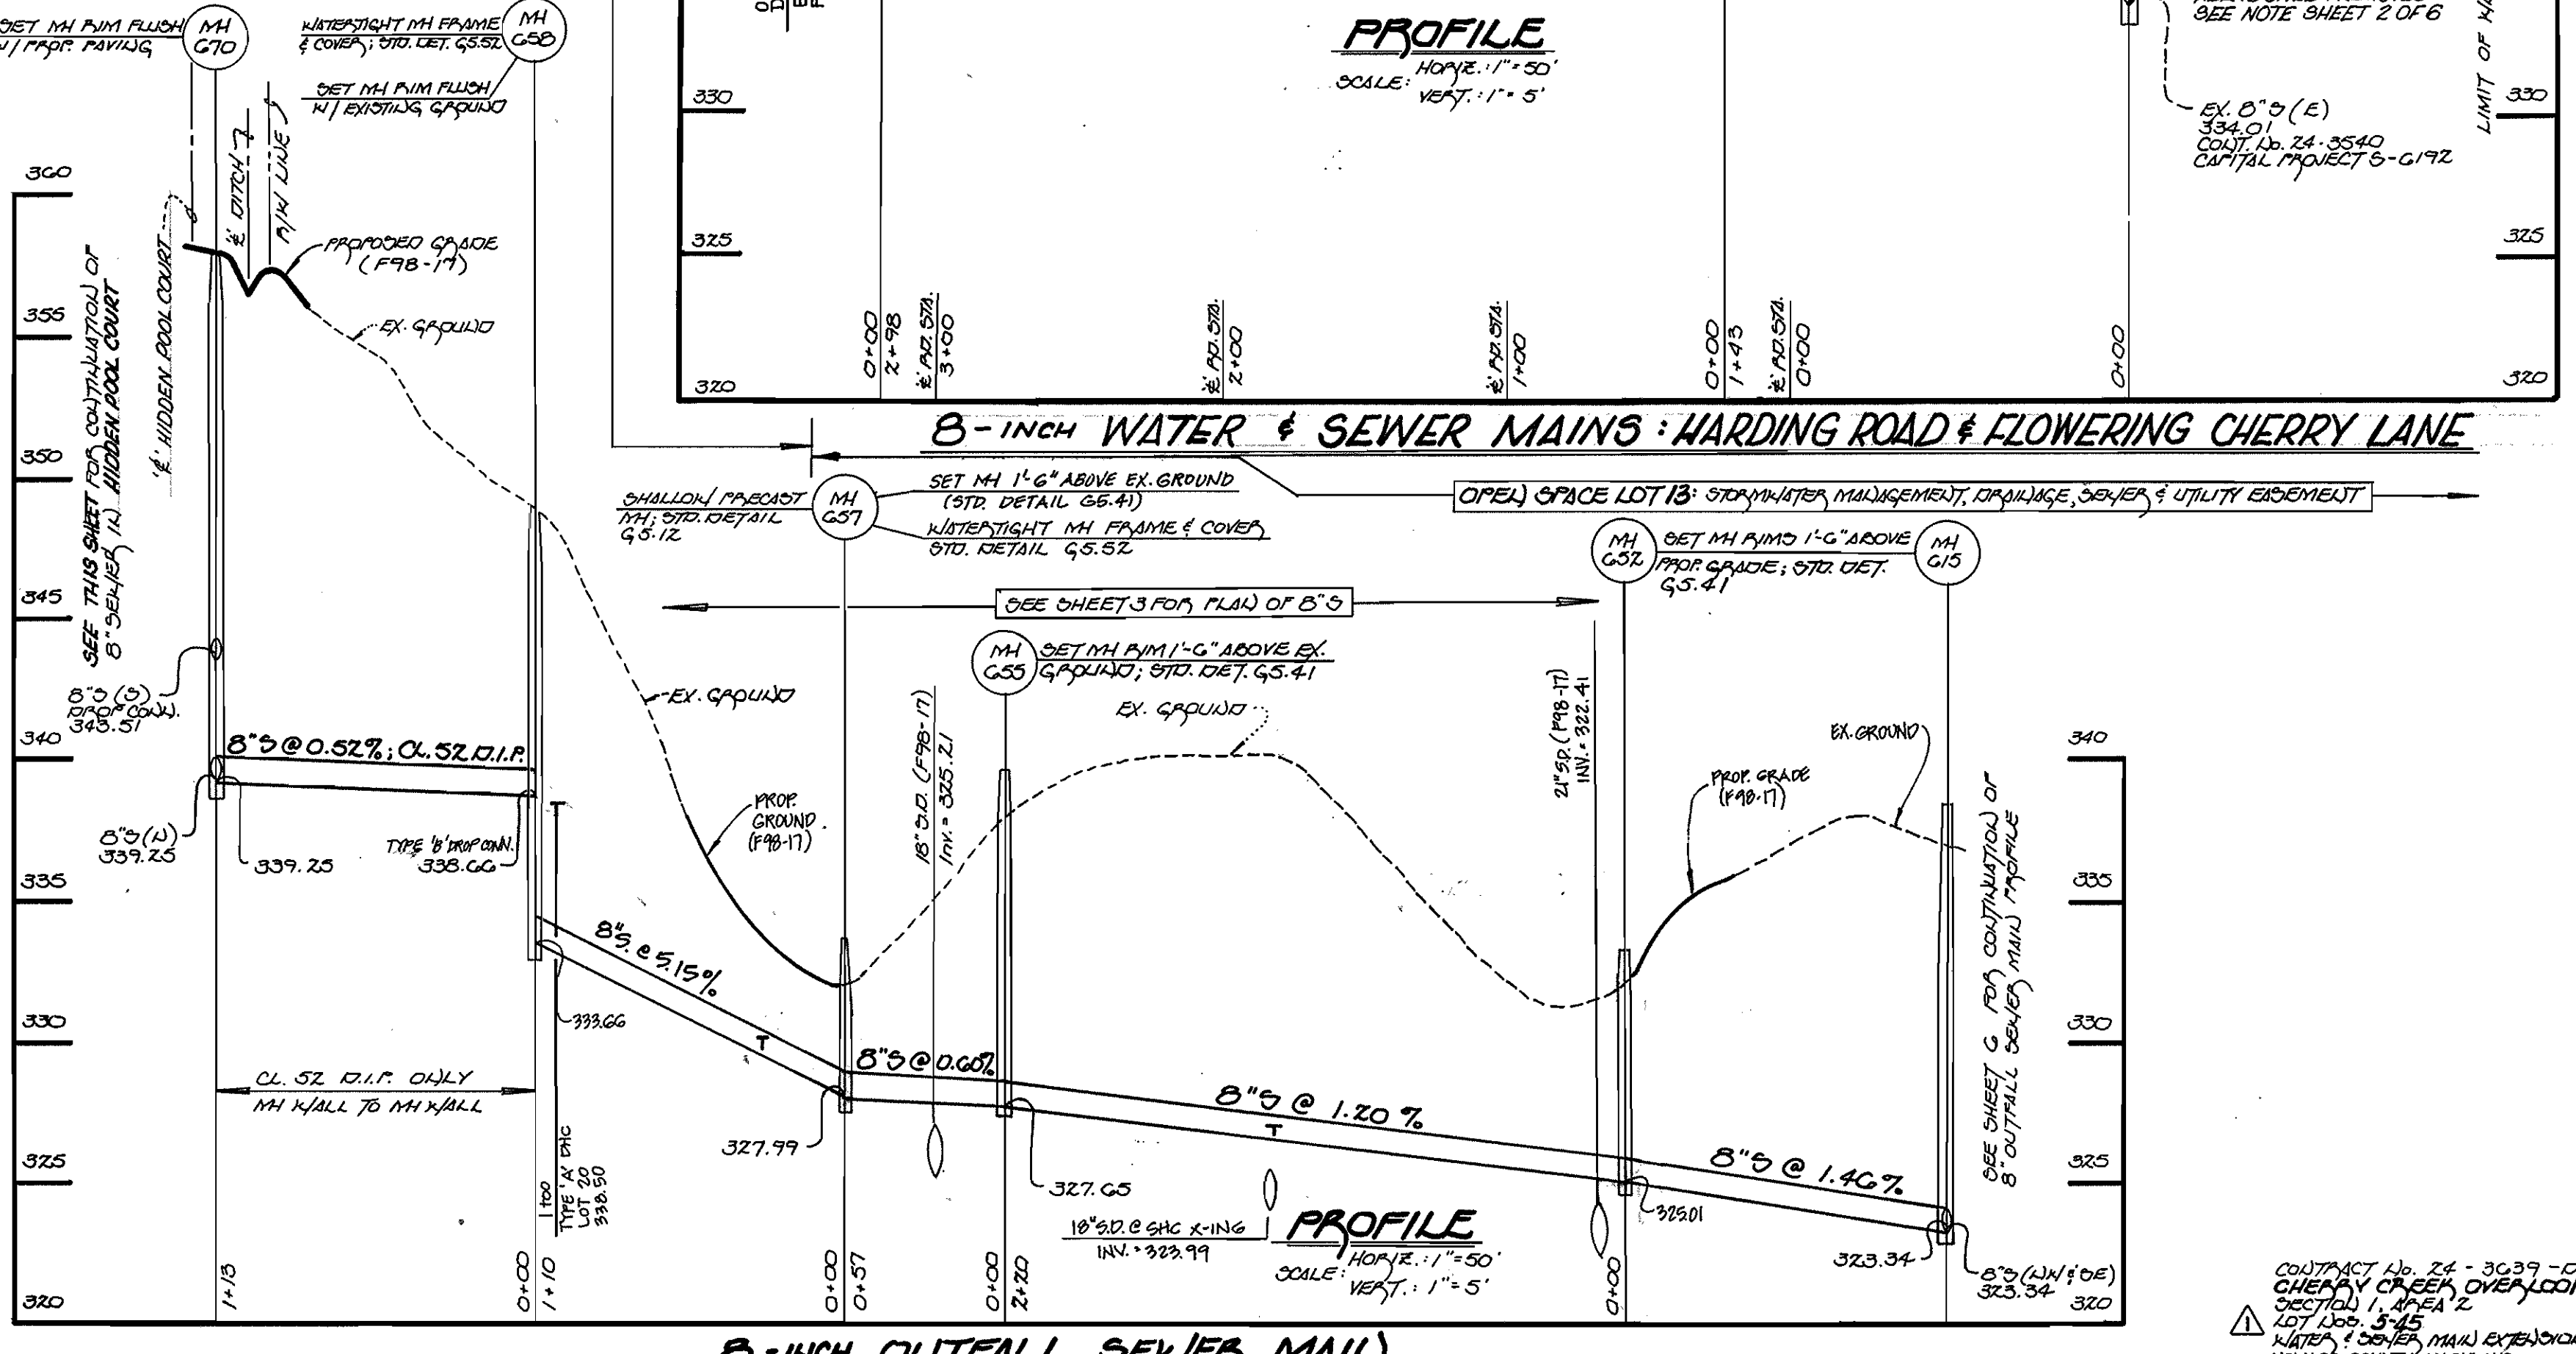


8-INCH OUTFALL SEWER MAIN

NOTE: THE LENGTH OF OPEN TRENCH SHALL BE LIMITED TO THREE (3) PIPE LENGTHS OF THAT WHICH SHALL BE BACKFILLED & SPUN-ON WITH RIGID JOINTS (WHICH EVER IS SHORTER)

DEPARTMENT OF PUBLIC WORKS
HOWARD COUNTY, MARYLAND
Robert A. Bauman
1-21-88
DATE

DEPARTMENT OF PLANNING AND ZONING
HOWARD COUNTY, MARYLAND
[Signature]
DATE

FISHER, COLLINS & CARTER, INC.
CIVIL ENGINEERING CONSULTANTS & LAND SURVEYORS
1109 401 - 2925

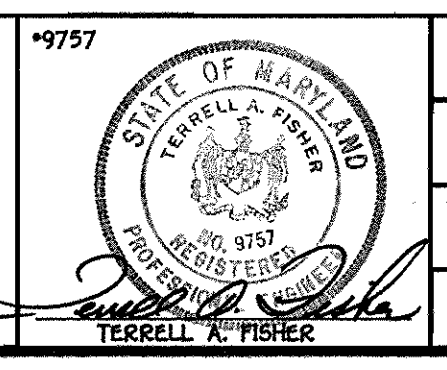

DESIGNED BY:	MJM
DRAWN BY:	JJM
CHECKED BY:	P.W.K.
DATE:	JANUARY, 1978
BY NO.	
REVISION	

WATER AND SEWER MAINS PROFILES
60' SCALE MAP NO. 26 BLOCK NO. 10 1/2
F.C.C. WORK ORDER NO. 30003
FILE NAME: CHERRY CREEK OVERLOOK

CHERRY CREEK OVERLOOK
SECTION 1, AREA 2
LOT Nos. 5-45
CONTRACT No. 24 - 3039 - D
SIXTH ELECTION DISTRICT
HOWARD COUNTY, MARYLAND
SCALE AS SHOWN
SHEET 5 OF 6

SECTION 20 : STANDARDS AND SPECIFICATIONS FOR VEGETATIVE STABILIZATION

DEFINITION: Using vegetation as cover for barren soil to protect it from erosion and to prevent the establishment of vegetation on exposed soil. When soil is stabilized with vegetation, the soil is less likely to erode and more likely to allow infiltration of rainfall, thereby reducing sediment loads and run-off to downstream areas, and improving wildlife habitat and visual resources.

PURPOSE: Vegetative stabilization specifications are used to provide for the establishment of vegetation on exposed soil. When soil is stabilized with vegetation, the soil is less likely to erode and more likely to allow infiltration of rainfall, thereby reducing sediment loads and run-off to downstream areas, and improving wildlife habitat and visual resources.

APPLICABLE SPECIFICATIONS: This practice shall be used on denuded areas as specified on the plans and may be used on highly erodible or critically eroding areas. This specification is divided into Temporary Seeding, to quickly establish vegetative cover for short duration up to one year, and Permanent Seeding, for long term vegetative cover. Applicable areas for Temporary Seeding are Temporary Seeding areas, temporary soil stockpiles, cleared areas being left idle between construction phases, earth dikes, etc. and for Permanent Seeding are lawns, dams, cut and fill slopes and other areas at final grade, former stockpiles and existing areas, etc.

EFFECTS ON WATER QUALITY AND QUANTITY: Planting vegetation in disturbed areas will have an effect on the water budget, especially on volumes and rates of runoff, infiltration, evaporation, transpiration, percolation, and groundwater recharge. Vegetation, over time, will increase organic matter content and improve the water holding capacity of the soil and subsequent plant growth. Vegetation will help reduce the movement of sediment, nutrients, and other chemicals carried by runoff to receiving waters. Plants will also help protect groundwater supplies by assimilating those substances present within the root zone.

SEEDING CONTROL DEVICES: Seeding control devices must remain in place during grading, seeded preparation, seeding, mulching and vegetative establishment to prevent large quantities of sediment and associated chemicals and nutrients from washing into surface waters.

- SECTION 1 - VEGETATIVE STABILIZATION METHODS AND MATERIALS**
- Site Preparation**
 - Install erosion and sediment control structures (either temporary or permanent) such as diversions, grade stabilization structures, berms, waterways, or sediment control basins.
 - Perform all grading operations at right angles to the slope. Final grading and shaping is not usually necessary for temporary seeding.
 - Schedule required soil tests to determine soil amendment composition and application rates for sites having disturbed areas over 5 acres.
 - Soil Amendment (Fertilizer and Lime Specifications)**
 - Soil tests must be performed to determine the exact ratios and application rates for both lime and fertilizer on sites having disturbed areas over 5 acres. Soil analysis may be performed by the University of Maryland or a recognized commercial laboratory. Soil samples taken for engineering purposes may also be used for chemical analysis.
 - Fertilizers shall be uniform in composition, free flowing and suitable for accurate application by approved equipment. Fertilizers may be substituted for fertilizer with prior approval from the appropriate authority. Fertilizers shall all be delivered to the site fully labeled according to the applicable state fertilizer laws and shall bear the name, trade name or trademark and warranty of the producer.
 - Lime materials shall be ground limestone (hydrated or burnt lime may be substituted) which contains at least 90% calcium oxide plus magnesium oxide. Limestone shall be delivered to such fineness that at least 50% will pass through a #100 mesh sieve and 98-100% will pass through a #20 mesh sieve.
 - Incorporate lime and fertilizer into the top 3-5" of soil by diking or other suitable means.
 - Seeded Preparation**
 - Temporary Seeding**
 - Seeded preparation shall consist of loosening soil to a depth of 3" to 5" by means of suitable agricultural or construction equipment, such as disc harrows or chain slows or rippers mounted on construction equipment. After the soil is loosened it should not be rolled or dragged smooth, but left in the roughened condition. Sloped areas greater than 3:1 should be treated by diking or other suitable means. Where diking is used, ridges running parallel to the contour of the slope.
 - Apply fertilizer and lime as prescribed on the plans.
 - Incorporate lime and fertilizer into the top 3-5" of soil by diking or other suitable means.
 - Permanent Seeding**
 - Soil preparation conditions required for permanent vegetative establishment:
 - Soil pH shall be between 6.0 and 7.0.
 - Soil shall contain less than 500 parts per million (ppm) of available phosphorus.
 - The soil shall contain less than 40% clay, but enough fine grained material (D50 silt plus clay) to provide the capacity to hold a moderate amount of moisture. An exception is if *Lespedeza* or *Sesuvia portulacastris* is to be planted, then a sandy soil (D50 silt plus clay) would be acceptable.
 - Soil shall contain 1.5% minimum organic matter by weight.
 - Soil must contain sufficient pore space to permit adequate root penetration.
 - If these conditions cannot be met by soils on site, amendment is required in accordance with Section 21 Standard and Specification for Topsoil.
 - Areas previously graded in conformance with the drawings shall be maintained in a true and even grade, then scarified or otherwise loosened to a depth of 3-5" to permit bonding of the topsoil to the surface area and to create horizontal erosion check slots to prevent topsoil to the surface area and to create horizontal erosion check slots to prevent topsoil from sliding down a slope.
 - Apply soil amendments as per soil test or as included on the plans.
 - Soil amendments into the top 3-5" of topsoil by diking or other suitable means. Lawn areas should be raked to smooth the surface, remove large objects like stones and branches, and reseed and application. Where site conditions will not permit normal seeded preparation, loosen surface soil by dragging with a heavy chain or other equipment to roughen the surface. Steep slopes (steeper than 3:1) should be tracked by a dozer leaving the soil in an irregular condition with ridges running parallel to the contour of the slope. Top 1-3" of soil should be loose and friable. Seeded loosening may not be necessary on newly disturbed areas.
 - Seed Specifications**
 - All seed must meet the requirements of the Maryland State Seed Law. All seed shall be subject to re-testing by a recognized seed laboratory. All seed used shall have been tested within the 6 months immediately preceding the date of sowing such material on the job.
 - Seed tags shall be made available to the inspector to verify type and rate of seed used.
 - Inoculant** - The inoculant used in the seed mixture shall be a pure culture of nitrogen-fixing bacteria prepared specifically for the species. Inoculants shall not be used later than the date indicated on the container. Add fresh inoculant as directed on package. Use four times the recommended rate when hydroseeding. It is very important to keep inoculant at 50-60°F. High temperatures above 75-80°F. can weaken bacteria and make the inoculant less effective.
 - Methods of Seeding**
 - Hydroseeding** - Apply seed uniformly with hydroseeder (slurry includes seed and fertilizer, broadcast or drop seeder).
 - If fertilizer is being applied at the time of seeding, the application rates amounts will not exceed the following: Nitrogen maximum of 100 lbs. per acre total of soluble nitrogen (P205 (phosphorous) 200 lbs./ac; K2O (potassium) 200 lbs./ac.
 - Lime use one ton ground agricultural limestone, up to 3 tons per acre may be applied by hydroseeding. Normally, not more than 2 tons are applied by hydroseeding at any one time. Do not use burnt or hydrated lime when hydroseeding.
 - Seed and fertilizer shall be mixed on site and seeding shall be done immediately and without interruption.
 - Dry Seeding** - This includes use of conventional drop or broadcast spreaders.
 - Seed spread dry shall be incorporated into the subsoil at the rates prescribed on the Temporary or Permanent Seeding Summaries or Tables 285 or 286. The seeded area shall then be rolled with a weighted roller to provide good seed to soil contact.
 - Where practical, seed should be applied in two directions perpendicular to each other. Apply half the seeding rate in each direction.
 - Drill or Outfitter Seeding** - Mechanized seeders that apply and cover seed with soil.
 - Outfitters are required to bury the seed in such a fashion as to provide at least 1/4 inch of soil covering. Seeded must be firm after planting.
 - Where practical, seed should be applied in two directions perpendicular to each other. Apply half the seeding rate in each direction.
 - Mulch Specifications (in order of preference)**
 - Straw shall consist of thoroughbred wheat, rye or oat straw, reasonable bright in color, and shall not be musty, moldy, decayed or excessively dusty and shall be free of noxious weed seeds as specified in the Maryland Seed Law.
 - Wood Cellulose Fiber Mulch (WCFF)**
 - WCFF shall consist of specially prepared wood cellulose processed into a uniform fibrous physical state.
 - WCFF shall be dyed green or contain a green dye in the package that will provide an appropriate color to facilitate visual inspection of the uniformly spread slurry.
 - WCFF, including dye, shall contain no germination or growth inhibiting factors.
 - WCFF materials shall be manufactured and processed in such a manner that the wood cellulose fiber mulch will remain in uniform suspension in water under agitation and will blend with seed, fertilizer and other additives to form a homogeneous slurry.
 - The mulch material shall form a batter-like ground cover, on application, having moisture absorption and percolation properties and shall cover and hold grass seed in contact with the soil without inhibiting the growth of the grass seedlings.
 - WCFF material shall contain no elements or compounds at concentration levels that will be phytotoxic.
 - WCFF must conform to the following physical requirements: fiber length to approximately 1/8 inch, diameter approximately 1 mm, and a minimum of 90% minimum content of 1/8 inch minimum water holding capacity of 90% minimum.
- Mulching Seeded Areas** - Mulch shall be applied to all seeded areas immediately after seeding.
 - If grading is completed outside of the seeding season, mulch shall be applied as prescribed for this section and maintained until the seeding season returns and seeding can be performed in accordance with these specifications.
 - When straw mulch is used, it shall be spread over all seeded areas at the rate of 2 tons/acre. Mulch shall be applied to a uniform loose depth of between 1" and 2". Mulch applied shall achieve a uniform distribution and depth so that the soil surface is not exposed. If a mulch anchoring tool is to be used, the rate should be increased to 2.5 tons/acre.
 - Wood cellulose fiber used as a mulch shall be applied at a net dry weight of 1,500 lbs. per acre. The wood cellulose fiber shall be mixed with water, and the mixture shall contain a maximum of 50 lbs. of wood cellulose fiber per 100 gallons of water.
 - Securing Straw Mulch (Mulch Anchoring)** - Mulch anchoring shall be performed immediately following mulch application to minimize loss by wind or water. This may be done by one of the following methods (listed by preference, depending upon size of area and erosion hazards):
 - A mulch anchoring tool is a tractor drawn implement designed to punch and anchor mulch into the soil surface to a minimum of two (2) inches. This practice is most effective on sloping areas, but is limited to flatter slopes where equipment can operate safely. If used on sloping areas, this practice should be used on the contour if possible.
 - Wood cellulose fiber may be used for anchoring straw. The fiber binder shall be applied at a net dry weight of 500 lbs. per acre. The wood cellulose fiber shall be mixed with water and the mixture shall contain a maximum of 50 pounds of wood cellulose fiber per 100 gallons of water.
 - Application of liquid binders should be heavier at the edges where wind catches mulch, such as in valleys and crests of berms. The remainder of seed should be spread uniform after binder application. Synthetic binders - such as Acrylic DLR (Agro-Tack), DCA-70 Petrosol, Terra Tack II, Terra Tack AS or other approved equal may be used at rates recommended by the manufacturer to anchor mulch.
 - Lightweight plastic netting may be stapled over the mulch according to manufacturer's recommendations. Netting is usually available in rolls 4' to 15' feet wide and 300 to 3,000 feet long.

SEDIMENT CONTROL NOTES

- A MINIMUM OF 48 HOURS NOTICE MUST BE GIVEN TO THE HOWARD COUNTY DEPARTMENT OF INSPECTIONS, LICENSING AND PERMITS, SEDIMENT CONTROL DIVISION PRIOR TO THE START OF ANY CONSTRUCTION (31-1095).
- ALL VEGETATIVE AND STRUCTURAL PRACTICES ARE TO BE INSTALLED ACCORDING TO THE PROVISIONS OF THIS PLAN AND ARE TO BE IN CONFORMANCE WITH THE MOST CURRENT MARYLAND STANDARDS AND SPECIFICATIONS FOR SOIL EROSION AND SEDIMENT CONTROL, AND REVISIONS THERE TO.
- FOLLOWING INITIAL SOIL DISTURBANCE OR RE-DISTURBANCE, PERMANENT OR TEMPORARY STABILIZATION SHALL BE COMPLETED WITHIN 31 CALENDAR DAYS FOR ALL PERMANENT CONSTRUCTION STRUCTURES, DIKES, PERIMETER SLOPES AND ALL SLOPES STEEPER THAN 3:1, 31 DAYS FOR ALL OTHER DISTURBED GRADED AREAS ON THE PROJECT SITE.
- ALL SEDIMENT TRAPDINGS SHOWN MUST BE FENCED AND MARKING SIGNS POSTED AROUND THEIR PERIMETER IN ACCORDANCE WITH VOL. 1, CHAPTER 12 OF THE HOWARD COUNTY DESIGN MANUAL, STORM DRAINAGE.
- ALL DISTURBED AREAS MUST BE STABILIZED WITHIN THE TIME PERIOD SPECIFIED ABOVE IN ACCORDANCE WITH THE 1994 MARYLAND STANDARDS AND SPECIFICATIONS FOR SOIL EROSION AND SEDIMENT CONTROL, FOR PERMANENT SEEDING (SEC. 20, 50D (SEC. 24), TEMPORARY SEEDING (SEC. 50, AND MULCHING (SEC. 52). TEMPORARY STABILIZATION WITH MULCH ALONE CAN ONLY BE DONE WHEN RECOMMENDED SEEDING DATES DO NOT ALLOW FOR PROPER GERMINATION AND ESTABLISHMENT OF GRASSES.
- ALL SEDIMENT CONTROL STRUCTURES ARE TO REMAIN IN PLACE AND ARE TO BE MAINTAINED IN OPERATIVE CONDITION UNTIL PERMITS FOR THEIR REMOVAL HAS BEEN OBTAINED FROM THE HOWARD COUNTY SEDIMENT CONTROL INSPECTOR.
- SITE ANALYSIS:**
 - TOTAL AREA OF SITE: 20.665 ACRES (TOTAL AREA OF SURVEYED)
 - AREA DISTURBED: 5.403 ACRES (OFF-ROAD OVERLAP, MUD)
 - AREA TO BE SOOLED OR PAVED: 0.00 ACRES
 - AREA TO BE VEGETATIVELY STABILIZED: 15.262 ACRES (OFF-ROAD OVERLAP, MUD)
 - TOTAL CUT: 0.00 CUBIC YARDS
 - TOTAL FILL: 0.00 CUBIC YARDS
 - OFF-SITE WASTE/BORROW AREA LOCATION: NOT APPLICABLE
- ANY SEDIMENT CONTROL PRACTICE WHICH IS DISTURBED BY GRADING OR OTHER ACTIVITY FOR PLACEMENT OF UTILITIES MUST BE REPAIRED ON THE SAME DAY OF DISTURBANCE.
- ADDITIONAL SEDIMENT CONTROLS MUST BE PROVIDED, IF DEEMED NECESSARY BY THE HOWARD COUNTY SEDIMENT CONTROL INSPECTOR.
- ON ALL SITES WITH DISTURBED AREAS IN EXCESS OF 2 ACRES, APPROVAL OF THE INSPECTION AGENCY SHALL BE REQUESTED UPON COMPLETION OF INSTALLATION OF PERMITS, EROSION AND SEDIMENT CONTROLS, BUT BEFORE PROCEEDING WITH ANY OTHER EARTH DISTURBANCE OR GRADING OR OTHER BUILDING OR INSPECTION APPROVALS MAY NOT BE AUTHORIZED UNTIL THIS LITERAL APPROVAL BY THE INSPECTION AGENCY IS MADE.
- TRENCHES FOR THE CONSTRUCTION OF UTILITIES IS LIMITED TO THREE PIPE LENGTHS OR THAT WHICH SHALL BE BACK-FILLED AND STABILIZED WITHIN ONE WORKING DAY, WHICHEVER IS SHORTER.

PERMANENT SEEDING NOTES

- ALL DISTURBED AREAS SHALL BE STABILIZED AS FOLLOWS:
- SEEDING PREPARATION:**
LOOSEN UPPER THREE INCHES OF SOIL BY RAKING, DISCING OR OTHER ACCEPTABLE MEANS BEFORE SEEDING.
- SOIL AMENDMENTS:**
APPLY TWO TONS PER ACRE DOLOMITE LIMESTONE (92 LBS./1,000 SQ.FT.) AND 600 LBS. PER ACRE 0-20-20 FERTILIZER (4 LBS./1,000 SQ.FT.) BEFORE SEEDING. APPLY 400 LBS. PER ACRE 0-20-20 FERTILIZER (4 LBS./1,000 SQ.FT.) AND 500 LBS. PER ACRE 0-15 LBS./1,000 SQ.FT.) OF 10-20-20 FERTILIZER.
- SEEDING:**
FOR THE PERIODS MARCH 1 THROUGH APRIL 30, AND AUGUST 1 THROUGH OCTOBER 15, SEED WITH 15 BUSHELS PER ACRE OF ANNUAL RYE (3.2 LBS./ACRE OF WEEDING LOVEGRASS 0.7 LBS./1,000 SQ.FT.) FOR THE PERIOD NOVEMBER 15 THROUGH FEBRUARY 28, PROTECT SITE BY APPLYING 2 TONS PER ACRE OF WOOD ANCHORED STRAW MULCH AND SEED AS SOON AS POSSIBLE IN THE SPRING. OPTION (2) - SEED WITH 100 LBS./ACRE KENTUCKY 31 TALL FESCUE AND MULCH WITH TWO TONS/ACRE WELL ANCHORED STRAW. ALL SLOPES SHOULD BE HYDROSEED.
- MULCHING:**
APPLY 1 TO 2 TONS PER ACRE (60 TO 90 LBS./1,000 SQ.FT.) OF UNMOTTLED SMALL GRASS STRAW IMMEDIATELY AFTER SEEDING. ANCHOR MULCH IMMEDIATELY AFTER SEEDING USING 200 GALLONS PER ACRE OF GAL/1,000 SQ.FT. OF EMULSIFIED ASPHALT ON FLAT ACRES, ON SLOPES 8 FEET OR HIGHER, USE 340 GALLONS PER ACRE (340 GAL./1,000 SQ.FT.) FOR ANCHORING.
- MAINTENANCE:**
INSPECT ALL SEEDING AREAS AND MAKE NEEDED REPAIRS, REPLACEMENTS AND RESEEDINGS.

TEMPORARY SEEDING NOTES

- APPLY TO GRADED OR CLEARED AREAS LIKELY TO BE REDISTURBED BY A SHORT-TERM VEGETATIVE COVER IS NEEDED.
- SEEDING PREPARATION:**
LOOSEN UPPER THREE INCHES OF SOIL BY RAKING, DISCING OR OTHER ACCEPTABLE MEANS BEFORE SEEDING, IF NOT PREVIOUSLY LOOSENED.
- SOIL AMENDMENTS:**
APPLY 500 LBS. PER ACRE 10-10-10 FERTILIZER (4 LBS./1,000 SQ.FT.)
- SEEDING:**
FOR THE PERIODS MARCH 1 THROUGH APRIL 30, AND AUGUST 15 THROUGH NOVEMBER 15, SEED WITH 15 BUSHELS PER ACRE OF ANNUAL RYE (3.2 LBS./ACRE OF WEEDING LOVEGRASS 0.7 LBS./1,000 SQ.FT.) FOR THE PERIOD NOVEMBER 15 THRU FEBRUARY 28, PROTECT SITE BY APPLYING 2 TONS PER ACRE OF WOOD ANCHORED STRAW MULCH AND SEED AS SOON AS POSSIBLE IN THE SPRING, OR USE 500.
- MULCHING:**
APPLY 1.5 TO 2 TONS PER ACRE (70 TO 90 LBS./1,000 SQ.FT.) OF UNMOTTLED SMALL GRASS STRAW IMMEDIATELY AFTER SEEDING. ANCHORING TOOL OR 210 GALLONS PER ACRE (5 GALLONS SQ.FT.) OF EMULSIFIED ASPHALT ON FLAT ACRES, ON SLOPES 8 FEET OR HIGHER, USE 340 GALLONS PER ACRE (340 GAL./1,000 SQ.FT.) FOR ANCHORING.
- REFER TO THE 1994 MARYLAND STANDARDS AND SPECIFICATIONS FOR SOIL EROSION AND SEDIMENT CONTROL, FOR RATES AND METHODS NOT COVERED.

SECTION 21 : STANDARDS AND SPECIFICATIONS FOR TOPSOIL

- DEFINITION:** PLACEMENT OF TOPSOIL OVER A PREPARED SUBSOIL PRIOR TO ESTABLISHMENT OF PERMANENT VEGETATION.
- PURPOSE:** TO PROVIDE A SUITABLE SOIL MEDIUM FOR VEGETATIVE GROWTH.
- SPECIFICATIONS:**
 - TOPSOIL SHALL BE A LOAM, SANDY LOAM, CLAY LOAM, SILT LOAM, SANDY CLAY LOAM, OR LOAMY SAND.
 - TOPSOIL SHALL NOT BE A MIXTURE OF CONTRASTING SUBSOILS.
 - TOPSOIL SHALL CONTAIN LESS THAN 5% BY VOLUME OF CHISELS, GRAVEL, STICKS, ROOTS, TRASH, OR OTHER MATERIALS LARGER THAN 1 1/2" IN DIAMETER.
 - TOPSOIL SHALL BE UNIFORMLY DISTRIBUTED IN A 4" LAYER AND LIGHTLY COMPACTED TO A MINIMUM THICKNESS OF 4". AVOID SURFACE HETEROGENEITIES. PLACE TOPSOIL AND APPLY SOIL AMENDMENTS AS SPECIFIED IN STANDARDS AND SPECIFICATIONS FOR VEGETATIVE STABILIZATION.
 - TOPSOIL SHALL NOT BE PLACED DURING FROZEN, MUDDY, OR EXCESSIVELY WET CONDITIONS.
- APPLICATION:** TOPSOIL SHALL BE PLACED OVER A PREPARED SUBSOIL PRIOR TO ESTABLISHMENT OF PERMANENT VEGETATION.

SEQUENCE OF CONSTRUCTION

- OBTAIN THE REQUIRED GRADING PERMIT.
- NOTIFY MISS UTILITY 48 HOURS BEFORE BEGINNING ANY WORK (1-800-257-1777). NOTIFY HOWARD COUNTY CONSTRUCTION/INSPECTION DIVISION 24 HOURS BEFORE STARTING ANY MORE (410-313-8770).
- INSTALL THE REQUIRED SEDIMENT AND EROSION CONTROL DEVICES AS INDICATED ON SHEETS 24-30 AND 24-31 (DAY 1).
- CLEAR AND GRUB AS NECESSARY, ONLY AS REQUIRED FOR EXCAVATION AND INSTALLATION OF THE WATER AND SEWER MAINS, AND ONLY WITHIN THE DESIGNATED WATER, SEWER AND UTILITY EASEMENTS (1.5 DAY).
- NOTE: THE LENGTH OF OPEN WATER AND SEWER MAIN TRENCH SHALL BE LIMITED TO THREE (3) PIPE LENGTHS (30' PIPE LENGTHS) AND STABILIZED WITHIN ONE (1) WORKING DAY, WHICHEVER IS SHORTER.
- CONSTRUCT THE SEWER MAIN AND APPURTENANCES (30 DAYS).
- STABLE SEED AND MULCH ALL DISTURBED AREAS IN ACCORDANCE WITH THE PERMANENT SEEDING NOTES SHOWN ON THIS SHEET (1 DAY).
- FOLLOWING SUCCESSFUL STABILIZATION OF ALL DISTURBED AREAS, DISTURBANCE OR GRADING OR OTHER BUILDING OR INSPECTION APPROVALS MAY NOT BE AUTHORIZED UNTIL THIS LITERAL APPROVAL BY THE INSPECTION AGENCY IS MADE.
- TRENCHES FOR THE CONSTRUCTION OF UTILITIES IS LIMITED TO THREE PIPE LENGTHS OR THAT WHICH SHALL BE BACK-FILLED AND STABILIZED WITHIN ONE WORKING DAY, WHICHEVER IS SHORTER.

PERMANENT SEEDING NOTES

- ALL DISTURBED AREAS SHALL BE STABILIZED AS FOLLOWS:
- SEEDING PREPARATION:**
LOOSEN UPPER THREE INCHES OF SOIL BY RAKING, DISCING OR OTHER ACCEPTABLE MEANS BEFORE SEEDING.
- SOIL AMENDMENTS:**
APPLY TWO TONS PER ACRE DOLOMITE LIMESTONE (92 LBS./1,000 SQ.FT.) AND 600 LBS. PER ACRE 0-20-20 FERTILIZER (4 LBS./1,000 SQ.FT.) BEFORE SEEDING. APPLY 400 LBS. PER ACRE 0-20-20 FERTILIZER (4 LBS./1,000 SQ.FT.) AND 500 LBS. PER ACRE 0-15 LBS./1,000 SQ.FT.) OF 10-20-20 FERTILIZER.
- SEEDING:**
FOR THE PERIODS MARCH 1 THROUGH APRIL 30, AND AUGUST 1 THROUGH OCTOBER 15, SEED WITH 15 BUSHELS PER ACRE OF ANNUAL RYE (3.2 LBS./ACRE OF WEEDING LOVEGRASS 0.7 LBS./1,000 SQ.FT.) FOR THE PERIOD NOVEMBER 15 THROUGH FEBRUARY 28, PROTECT SITE BY APPLYING 2 TONS PER ACRE OF WOOD ANCHORED STRAW MULCH AND SEED AS SOON AS POSSIBLE IN THE SPRING. OPTION (2) - SEED WITH 100 LBS./ACRE KENTUCKY 31 TALL FESCUE AND MULCH WITH TWO TONS/ACRE WELL ANCHORED STRAW. ALL SLOPES SHOULD BE HYDROSEED.
- MULCHING:**
APPLY 1 TO 2 TONS PER ACRE (60 TO 90 LBS./1,000 SQ.FT.) OF UNMOTTLED SMALL GRASS STRAW IMMEDIATELY AFTER SEEDING. ANCHOR MULCH IMMEDIATELY AFTER SEEDING USING 200 GALLONS PER ACRE OF GAL/1,000 SQ.FT. OF EMULSIFIED ASPHALT ON FLAT ACRES, ON SLOPES 8 FEET OR HIGHER, USE 340 GALLONS PER ACRE (340 GAL./1,000 SQ.FT.) FOR ANCHORING.
- MAINTENANCE:**
INSPECT ALL SEEDING AREAS AND MAKE NEEDED REPAIRS, REPLACEMENTS AND RESEEDINGS.

TEMPORARY SEEDING NOTES

- APPLY TO GRADED OR CLEARED AREAS LIKELY TO BE REDISTURBED BY A SHORT-TERM VEGETATIVE COVER IS NEEDED.
- SEEDING PREPARATION:**
LOOSEN UPPER THREE INCHES OF SOIL BY RAKING, DISCING OR OTHER ACCEPTABLE MEANS BEFORE SEEDING, IF NOT PREVIOUSLY LOOSENED.
- SOIL AMENDMENTS:**
APPLY 500 LBS. PER ACRE 10-10-10 FERTILIZER (4 LBS./1,000 SQ.FT.)
- SEEDING:**
FOR THE PERIODS MARCH 1 THROUGH APRIL 30, AND AUGUST 15 THROUGH NOVEMBER 15, SEED WITH 15 BUSHELS PER ACRE OF ANNUAL RYE (3.2 LBS./ACRE OF WEEDING LOVEGRASS 0.7 LBS./1,000 SQ.FT.) FOR THE PERIOD NOVEMBER 15 THRU FEBRUARY 28, PROTECT SITE BY APPLYING 2 TONS PER ACRE OF WOOD ANCHORED STRAW MULCH AND SEED AS SOON AS POSSIBLE IN THE SPRING, OR USE 500.
- MULCHING:**
APPLY 1.5 TO 2 TONS PER ACRE (70 TO 90 LBS./1,000 SQ.FT.) OF UNMOTTLED SMALL GRASS STRAW IMMEDIATELY AFTER SEEDING. ANCHORING TOOL OR 210 GALLONS PER ACRE (5 GALLONS SQ.FT.) OF EMULSIFIED ASPHALT ON FLAT ACRES, ON SLOPES 8 FEET OR HIGHER, USE 340 GALLONS PER ACRE (340 GAL./1,000 SQ.FT.) FOR ANCHORING.
- REFER TO THE 1994 MARYLAND STANDARDS AND SPECIFICATIONS FOR SOIL EROSION AND SEDIMENT CONTROL, FOR RATES AND METHODS NOT COVERED.

DEVELOPER'S CERTIFICATION



I/WE HEREBY CERTIFY THAT ALL DEVELOPMENT AND CONSTRUCTION WILL BE DONE ACCORDING TO THIS PLAN OF DEVELOPMENT AND PLAN FOR EROSION AND SEDIMENT CONTROL, AND THAT ALL RESPONSIBLE PERSONNEL INVOLVED IN THE CONSTRUCTION PROJECT WILL HAVE A CERTIFICATE OF ATTENDANCE AT A DEPARTMENT OF THE ENVIRONMENT APPROVED TRAINING PROGRAM FOR THE CONTROL OF SEDIMENT AND EROSION BEFORE BEGINNING THE PROJECT. I ALSO AUTHORIZE PERIODIC ON-SITE INSPECTION BY THE HOWARD SOIL CONSERVATION DISTRICT OR THEIR AUTHORIZED AGENTS, AS ARE DEEMED NECESSARY.

Michael J. McCann, P.E. 10/10/90
SIGNATURE OF DEVELOPER DATE


ENGINEER'S CERTIFICATION

I HEREBY CERTIFY THAT THIS PLAN FOR EROSION AND SEDIMENT CONTROL REPRESENTS A PRACTICAL AND WORKABLE PLAN BASED ON MY PERSONAL KNOWLEDGE OF THE SITE CONDITIONS AND THAT IT WAS PREPARED IN ACCORDANCE WITH THE REQUIREMENTS OF THE HOWARD SOIL CONSERVATION DISTRICT.

Paul W. Keidel
SIGNATURE OF ENGINEER DATE 08/23/97

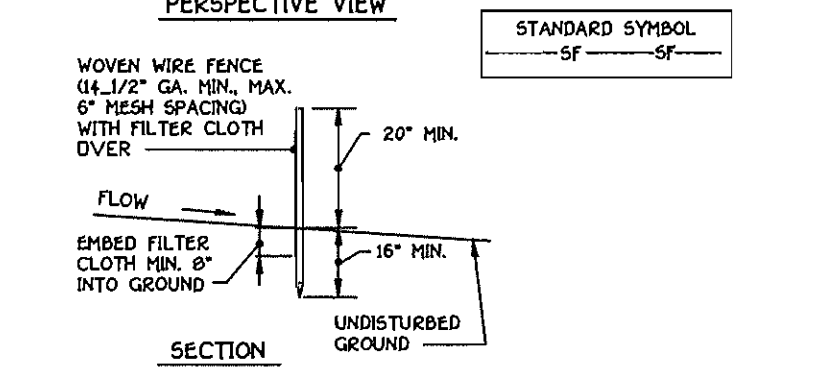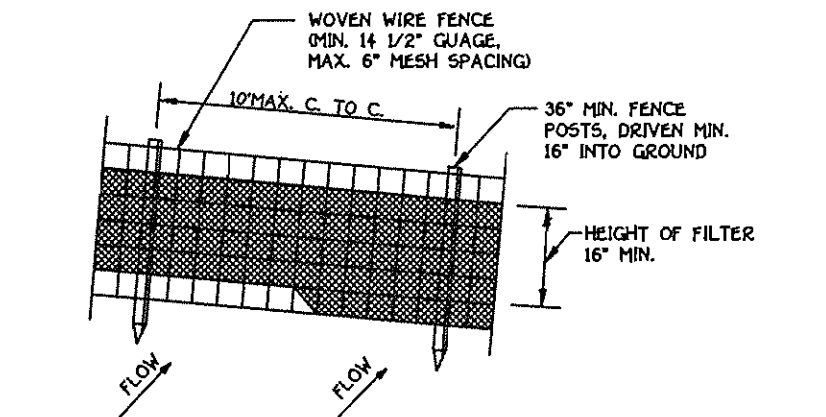

- CONSTRUCTION NOTES FOR FABRICATED SILT FENCE**
- WOVEN WIRE FENCE TO BE FASTENED SECURELY TO FENCE POSTS WITH WIRE TIES OF STAPLES.
 - FILTER CLOTH TO BE FASTENED SECURELY TO WOVEN WIRE FENCE WITH TIES SPACED EVERY 24" AT TOP AND MID SECTION.
 - WHEN TWO SECTIONS OF FILTER CLOTH ADJOIN EACH OTHER THEY SHALL BE OVERLAPPED BY SIX INCHES AND FOLDED.
 - MAINTENANCE SHALL BE PERFORMED AS NEEDED AND MATERIALS REMOVED WHEN "BULGES" DEVELOP IN THE SILT FENCE.
- SILT FENCE**
NOT TO SCALE
- POSTS: STEEL EITHER T OR U TYPE OR 2" HARDWOOD
- FENCE: WOVEN WIRE, 14 GA. 6" MAX. MESH OPENING
- FILTER CLOTH: FILTER 2, HRAFT 100X, STABILIZED TH OR APPROVED EQUAL
- PREFABRICATED LINER: GEOTEX, ENVIRONMENTAL OR APPROVED EQUAL
- NOTE: SEE PLAN SHEETS 24-3 FOR LOCATIONS OF SILT FENCE INSTALLATION.

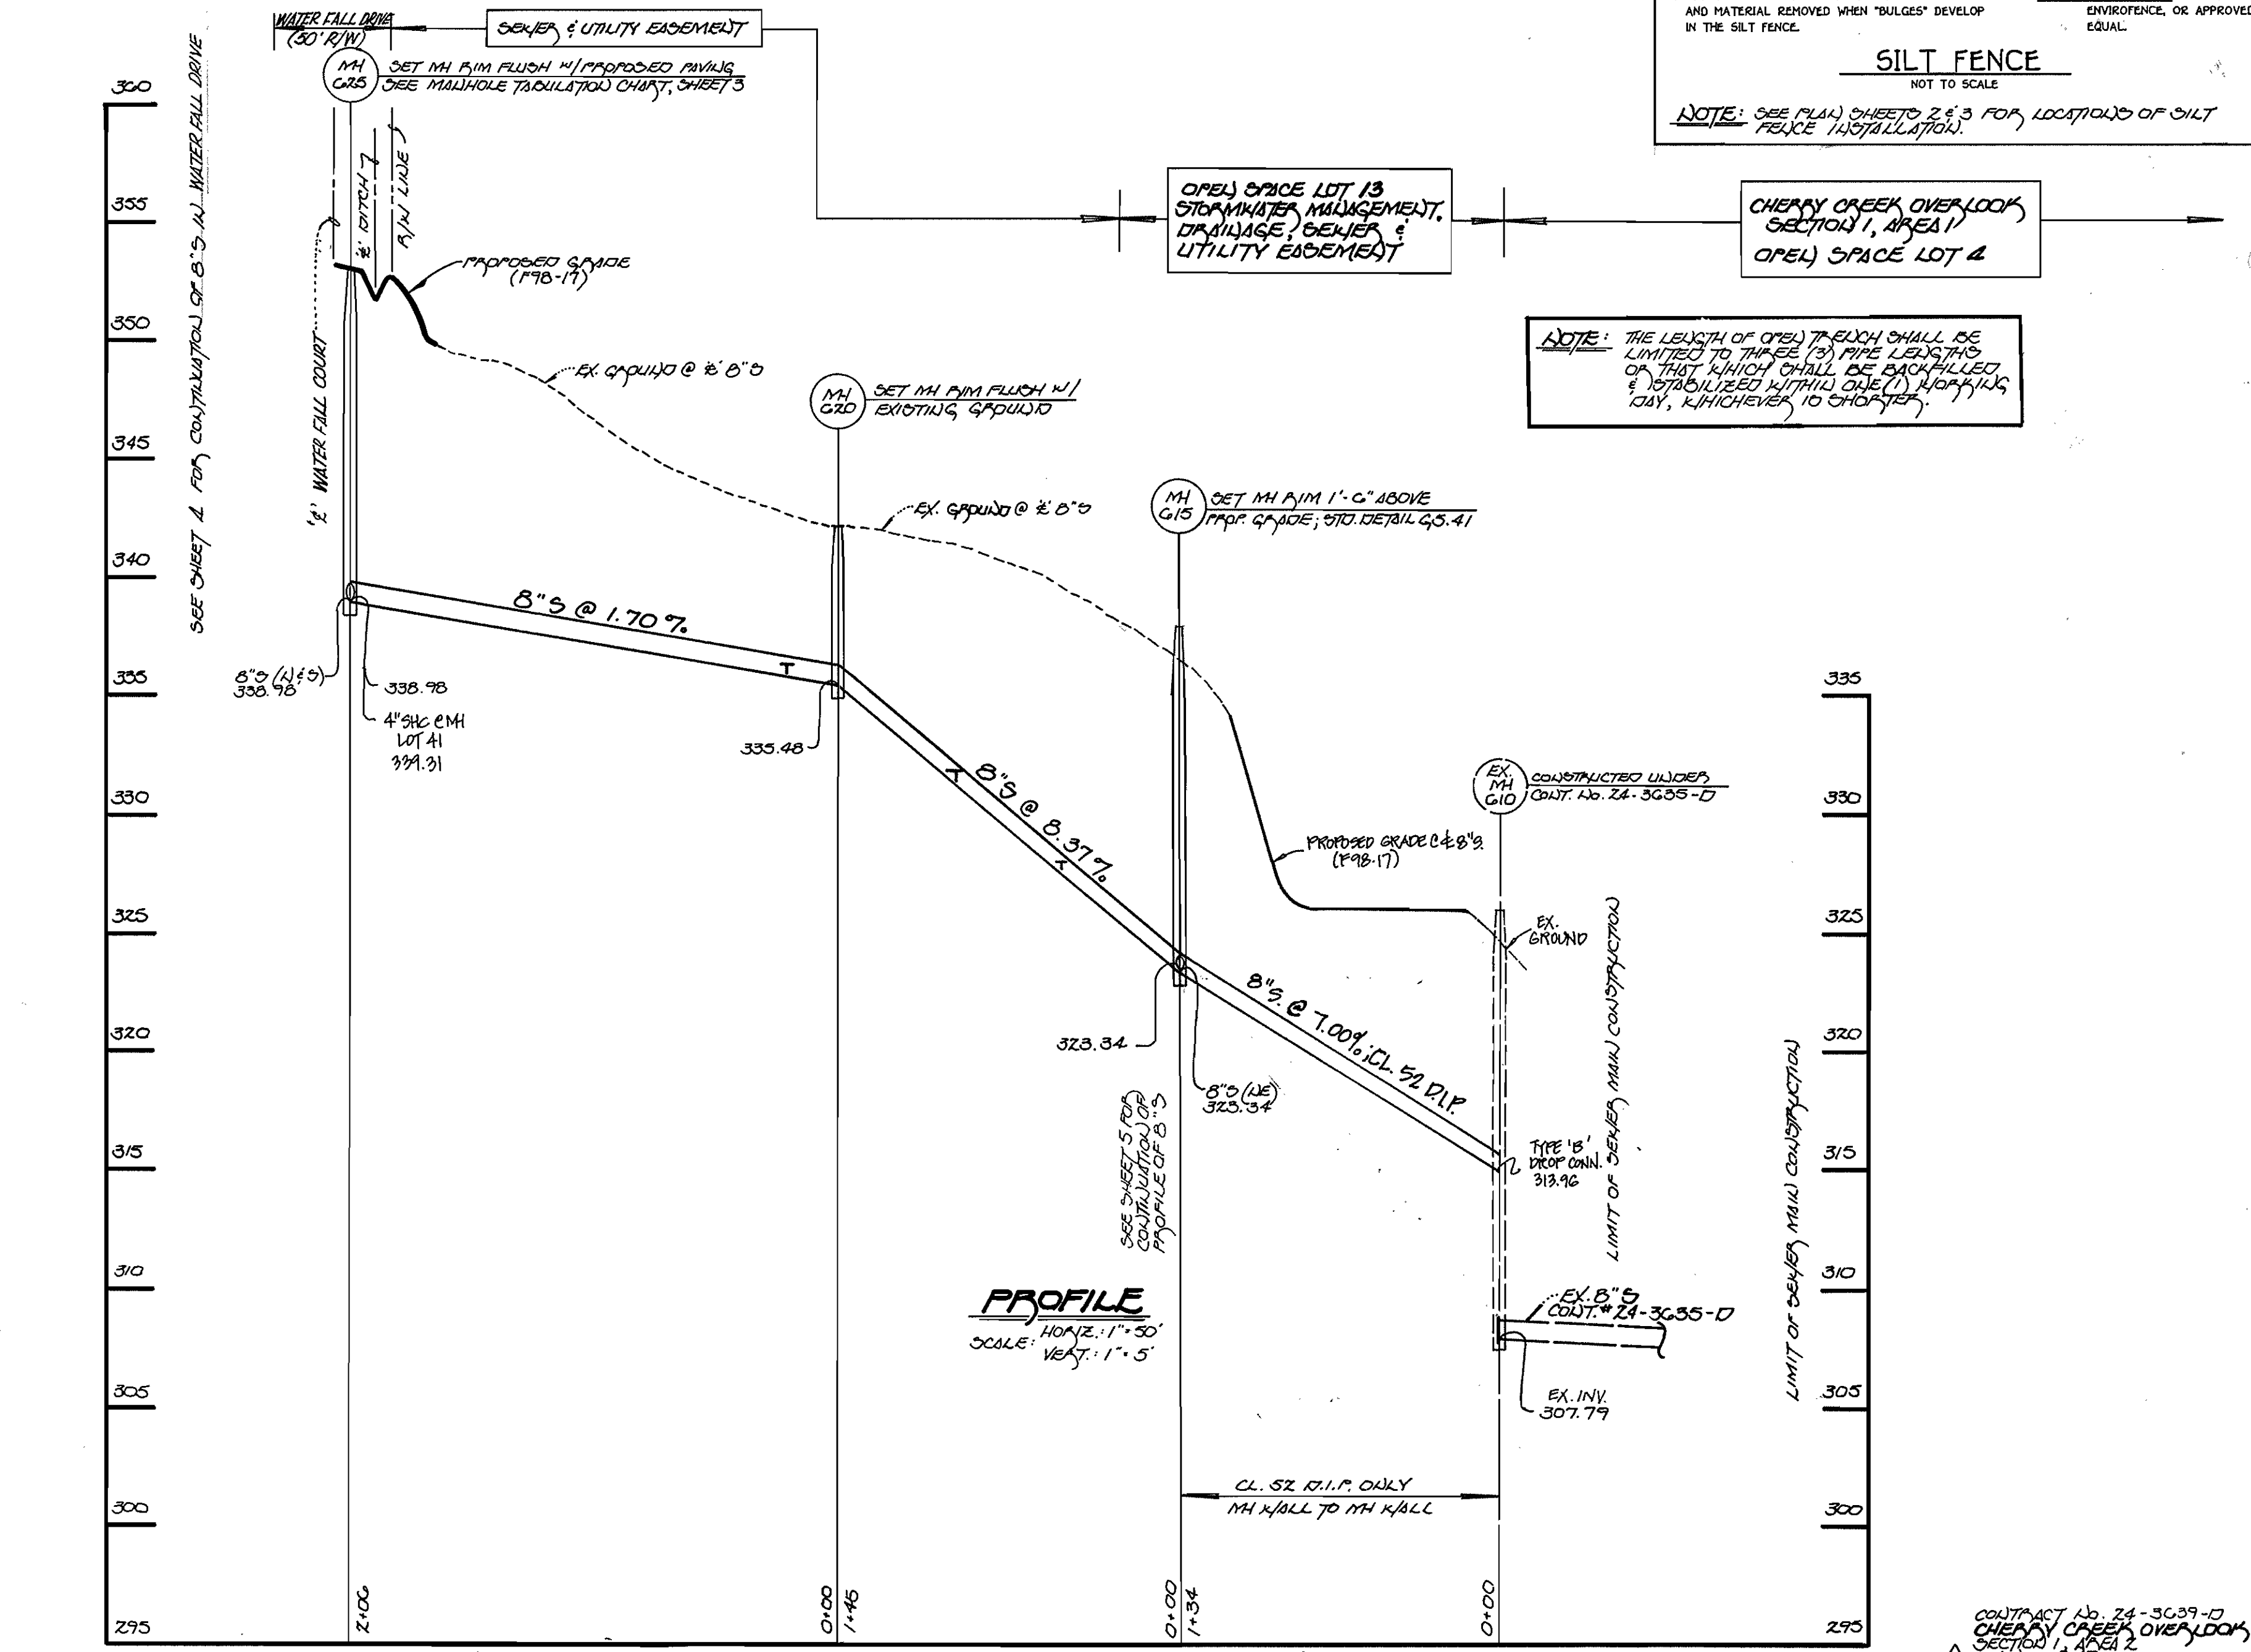

DEPARTMENT OF PUBLIC WORKS
HOWARD COUNTY, MARYLAND

DEPARTMENT OF PLANNING AND ZONING
HOWARD COUNTY, MARYLAND

Fisher, Collins & Carter, Inc.
CIVIL ENGINEERING CONSULTANTS & LAND SURVEYORS
CENTENNIAL SQUARE OFFICE PARK
18272 Ballantyne
Billicott City, Maryland 21042
(410) 481-2855

DATE: 1-21-98

DATE: 1/20/98

DESIGNED BY: M.J.M.

DRAWN BY: M.J.M./J.M. B.L.M.

CHECKED BY: P.W.K.

DATE: JANUARY 1998

REVISION: REVISE LOT TOTAL TO REFLECT ADD'L OPEN SPACE LOTS

DATE: 4/29/98

SEDIMENT & EROSION CONTROL NOTES & DETAILS & SEWER MAIN PROFILE

600' SCALE MAP NO. 46 BLOCK NO. 10/10

F.C.C. WORK ORDER NO. 30203

FILE NAME: CHERRY CREEK OVERLOOK

CHERRY CREEK OVERLOOK SECTION 1, AREA 2 LOT Nos. 5-15

CONTRACT No. 24-3639-D

SIXTH ELECTION DISTRICT HOWARD COUNTY, MARYLAND

SCALE AS SHOWN

SHEET 6 OF 6