
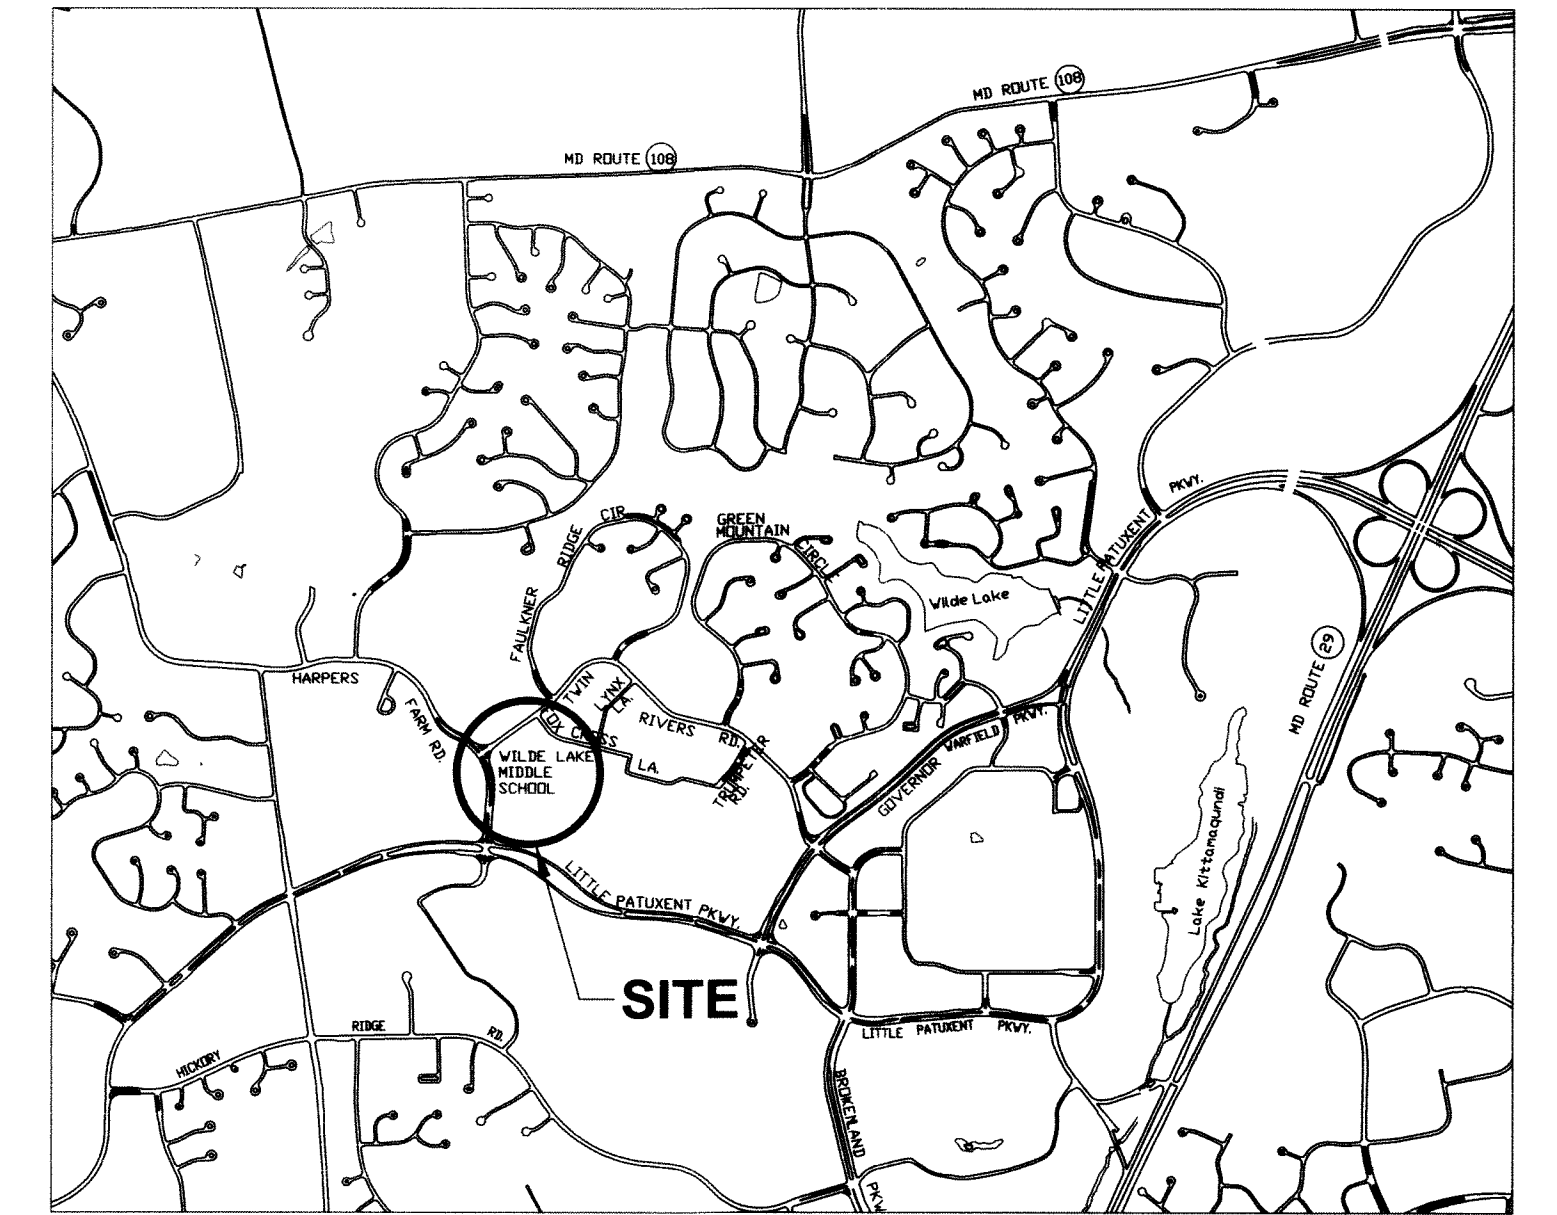


WILDE LAKE MIDDLE SCHOOL Bioretention Design

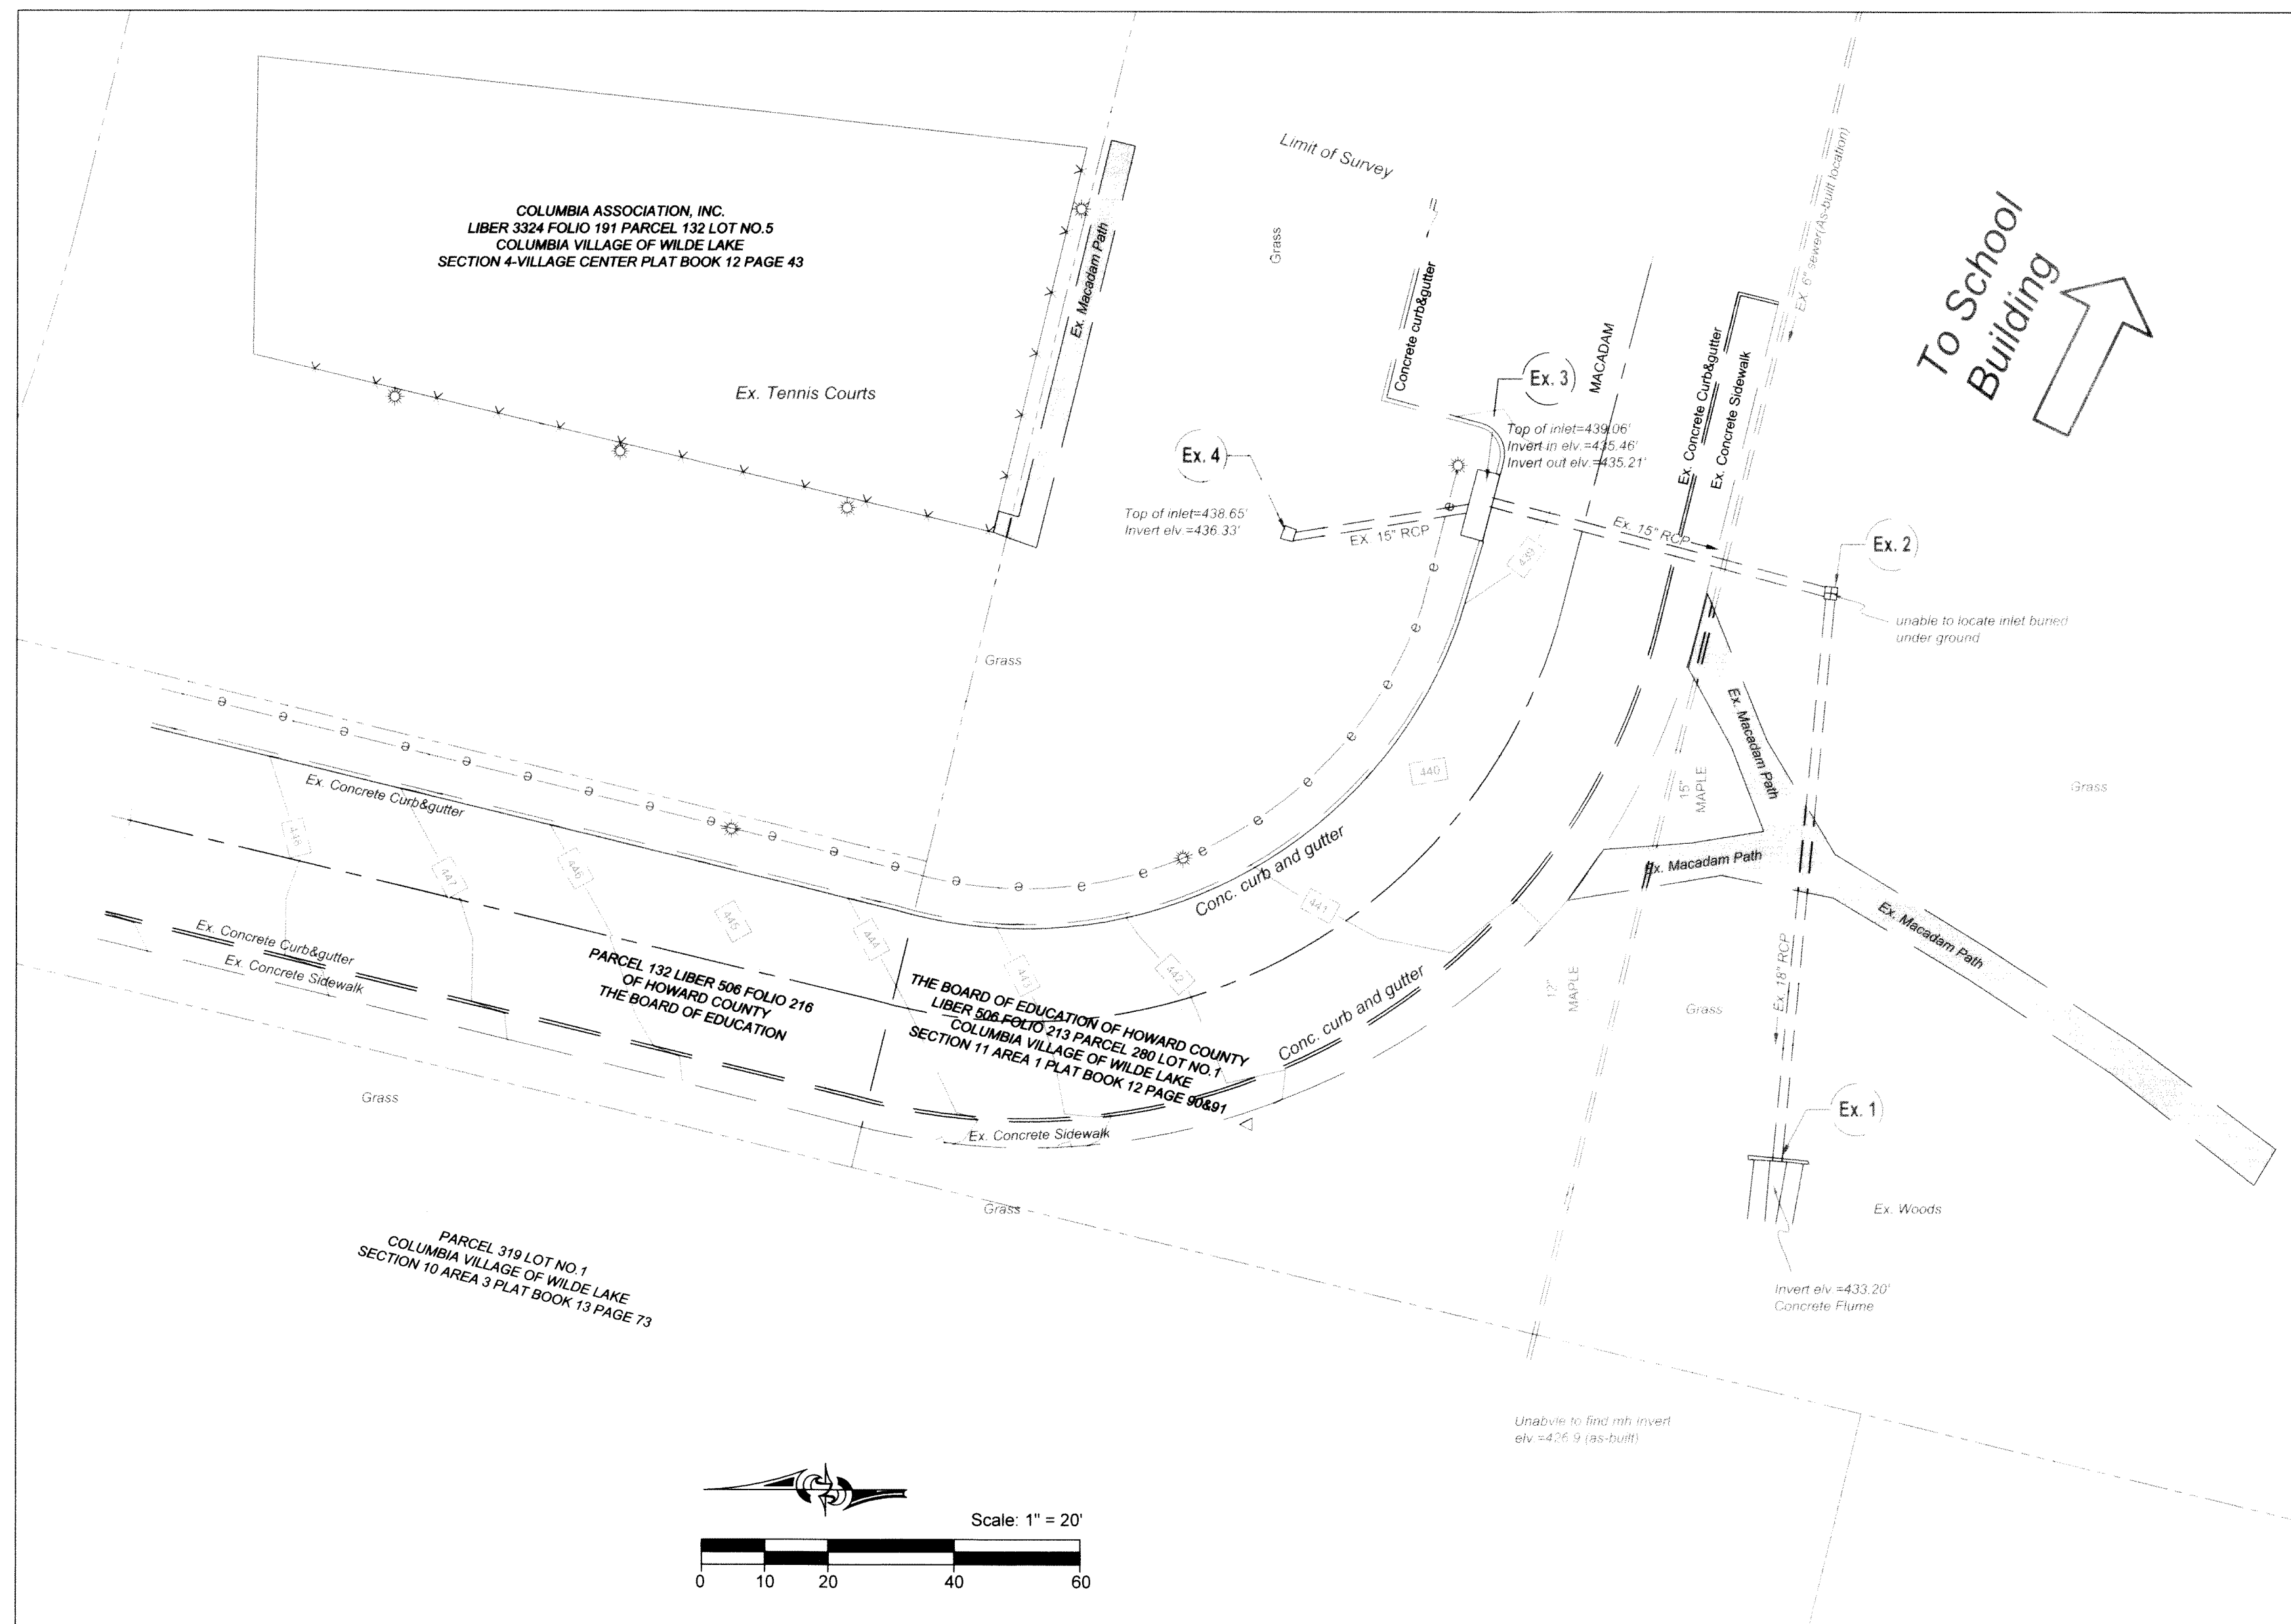

Vicinity Map
Scale 1"=2000'
Source: Howard County GIS 1998

Sequence of Construction

1. Obtain county grading permits. Conduct pre-construction meeting. (1 day)
 2. Clear and grub in preparation to install silt fence, pedestrian fence and inlet protection. (1day).
 3. Install sediment control items (1 day).
 4. Install de-watering sump pit and de-water basin area if permanent pool saturated soils exist (1 day).
 5. Install sand underdrain system and drainage/planting media as shown on plans (2 days).
 6. Install plantings (with assistance of Wilde Lake Middle School students) and permanent seeding (1 day).
 7. With sediment control inspectors permission remove remaining sediment control devices and stabilize areas disturbed by this process. (1 day).
- Total = 8 days**

General Notes

1. These plans were prepared with the field information at the time of project survey. It is possible that field conditions as of the date of construction vary from these plans and it is the contractor's responsibility to verify field conditions such as elevations, depths, etc. prior to proceeding with work. It is the contractor's responsibility to verify with the supplier / manufacturer of any proprietary product that their product will function per the design for the field conditions at time of construction. The design engineer should be notified immediately if any deviations from the design plan are found.
2. All specified and/or proprietary products shown hereon may be subject to substitution with other products recommended by the contractor, subject to written review and approval by the design engineer.
3. All construction shall be in accordance with the latest standards and specifications of Howard County.
4. The contractor shall notify the Department of Public Works / Bureau of Engineering / Construction Inspection Division at (410) 313-4900 at least five (5) working days prior to the start of work.
5. The contractor shall notify "Miss Utility" at 1-800-257-7777 at least 48 hours prior to any excavation work.
6. The coordinates shown hereon are based upon the Howard County Geodetic control which is based upon the Maryland State Plane Coordinate System.
7. The contractor shall field visit and familiarize themselves with the site prior to bidding and construction.
8. All vegetative and structural practices are to be installed according to the provisions of this plan and are to be in conformance with the most current *Maryland Standards and Specifications for Soil and Erosion and Sediment Control* and any revisions thereto.
9. The appropriate federal/state and local permits must be obtained before work commences.
10. Source of existing topography is Howard County G.I.S. dated 1999 and J.A. Rice Inc. field survey dated Jan. 2006. Horizontal and Vertical Datum is based on Howard County Monuments 35C2 and 36AA.
11. Contractor shall not store any material and/ or equipment within 2 feet of private property.
12. Contractor shall take caution not to damage any existing trees, except those designated on the plan to be removed. Any damaged tree shall be replaced at contractor's expense.
13. All quantities are estimates only. The contractor is responsible for verifying quantities through a field visit and his own quantity takeoffs.

SHEET INDEX

1. Title Sheet
2. Design View
3. Sediment Control
4. Profiles
5. Sediment Control Notes and Details
6. Planting Plan
7. Planting Notes and Details

Summary of Environmental Impacts

	Tree Removal (each)	Stream Disturbance (lf)	Wetland Disturbance (sq.ft)	Limits of Disturbance (sq.ft)	Limits of Disturbance (ac)	Cut (cy)	Fill (cy)	Net (cy)
Total	0	0	0	5,000	0.11	250	10	240

MISS Utility

Call "Miss Utility" at 1-800-257-7777, 48 hours prior to the start of work. The excavator must notify all public utility companies with underground facilities in the area of proposed excavation and have those facilities located by the utility companies prior to commencing excavation.

HOWARD COUNTY DPW - ENVIRONMENTAL SERVICES
6751 COLUMBIA GATEWAY DRIVE, SUITE 514
COLUMBIA, MD 21046
PHONE: (410) 313-6413
ATTN: Mark Richmond


HOWARD COUNTY, MD
PARCEL 106
ELECTION DISTRICT # 4
MAP 14

BIORETENTION DESIGN WILDE LAKE MIDDLE SCHOOL TITLE SHEET

DATE:	05/06				
DESIGNED:	CW/HT				
DRAFTED:	HT				
CHECKED:	TCS				
BASE DATA:	J.A. RICE	NO.	REVISIONS	BY	DATE


CPJ Charles P. Johnson & Associates, Inc.
PLANNERS • ENGINEERS • LANDSCAPE ARCHITECTS • SURVEYORS
1751 ELTON ROAD SUITE 300 SILVER SPRING, MARYLAND 20903
Phone: (301) 434-7000 E-mail: info@cpja.com Fax: (301) 434-9394
FREDERICK, MD FAIRFAX, VA

SCALE AS SHOWN
SHEET 1 OF 7 SHEETS
JOB NO. 36-501

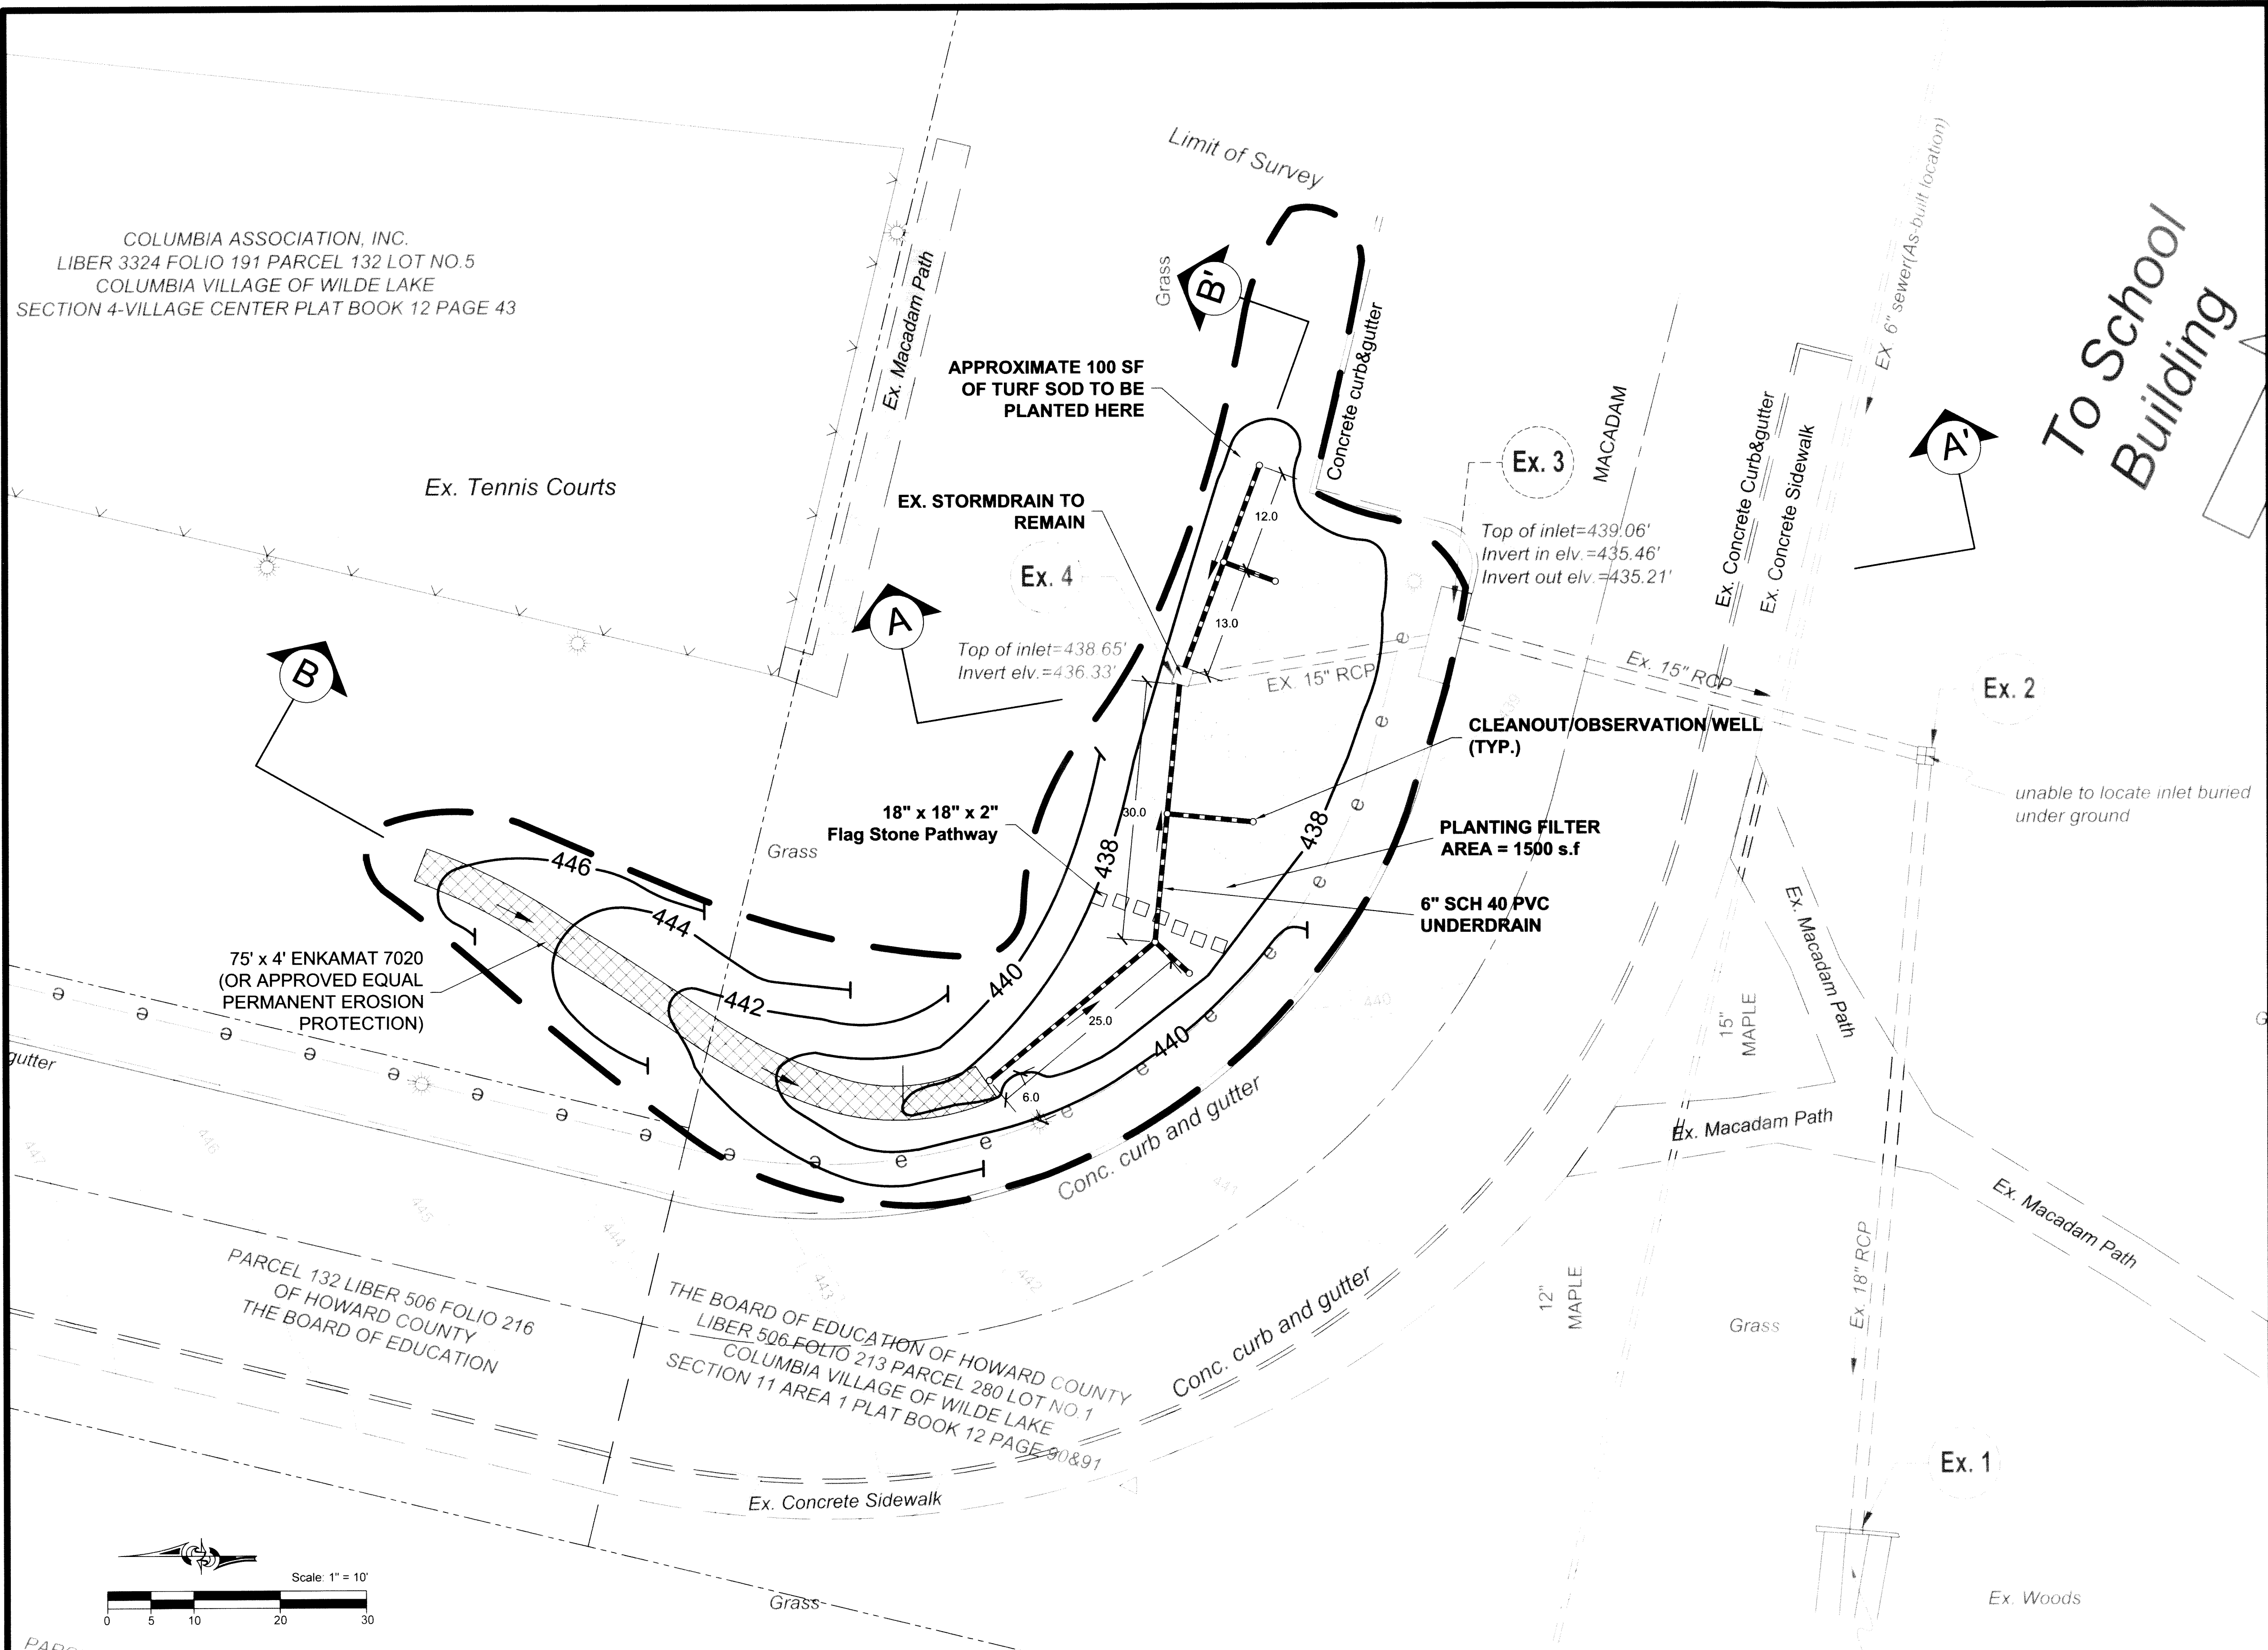

Legend

	Limits of Disturbance
	Existing Contours
	Proposed Contours
	Light pole
	Existing Fence
	Profile
	Property Line

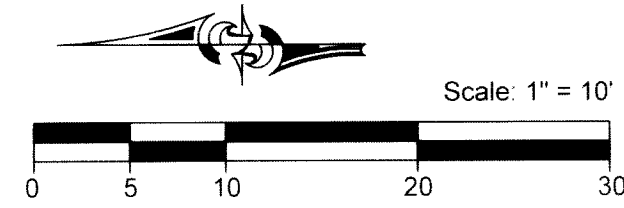

HOWARD COUNTY DPW - ENVIRONMENTAL SERVICES
 6751 COLUMBIA GATEWAY DRIVE, SUITE 514
 COLUMBIA, MD 21046
 PHONE: (410) 313-6413
 ATTN: Mark Richmond

HOWARD COUNTY, MD
 PARCEL 106
 ELECTION DISTRICT # 4
 MAP 14


BIORETENTION DESIGN WILDE LAKE MIDDLE SCHOOL DESIGN VIEW

DATE:	05/06				
DESIGNED:	CW/HT				
DRAFTED:	HT				
CHECKED:	TCS				
BASE DATA:	J.A. RICE	NO	REVISIONS	BY	DATE

Simon
5.25.06

CPJ Charles P. Johnson & Associates, Inc.
 PLANNERS • ENGINEERS • LANDSCAPE ARCHITECTS • SURVEYORS
 1751 ELTON ROAD SUITE 300 SILVER SPRING, MARYLAND 20903
 Phone: (301) 434-7000 E-mail: info@cpja.com Fax: (301) 434-9394
 FREDERICK, MD FAIRFAX, VA


SCALE AS SHOWN
SHEET 2
OF 7 SHEETS
JOB NO. 36-501

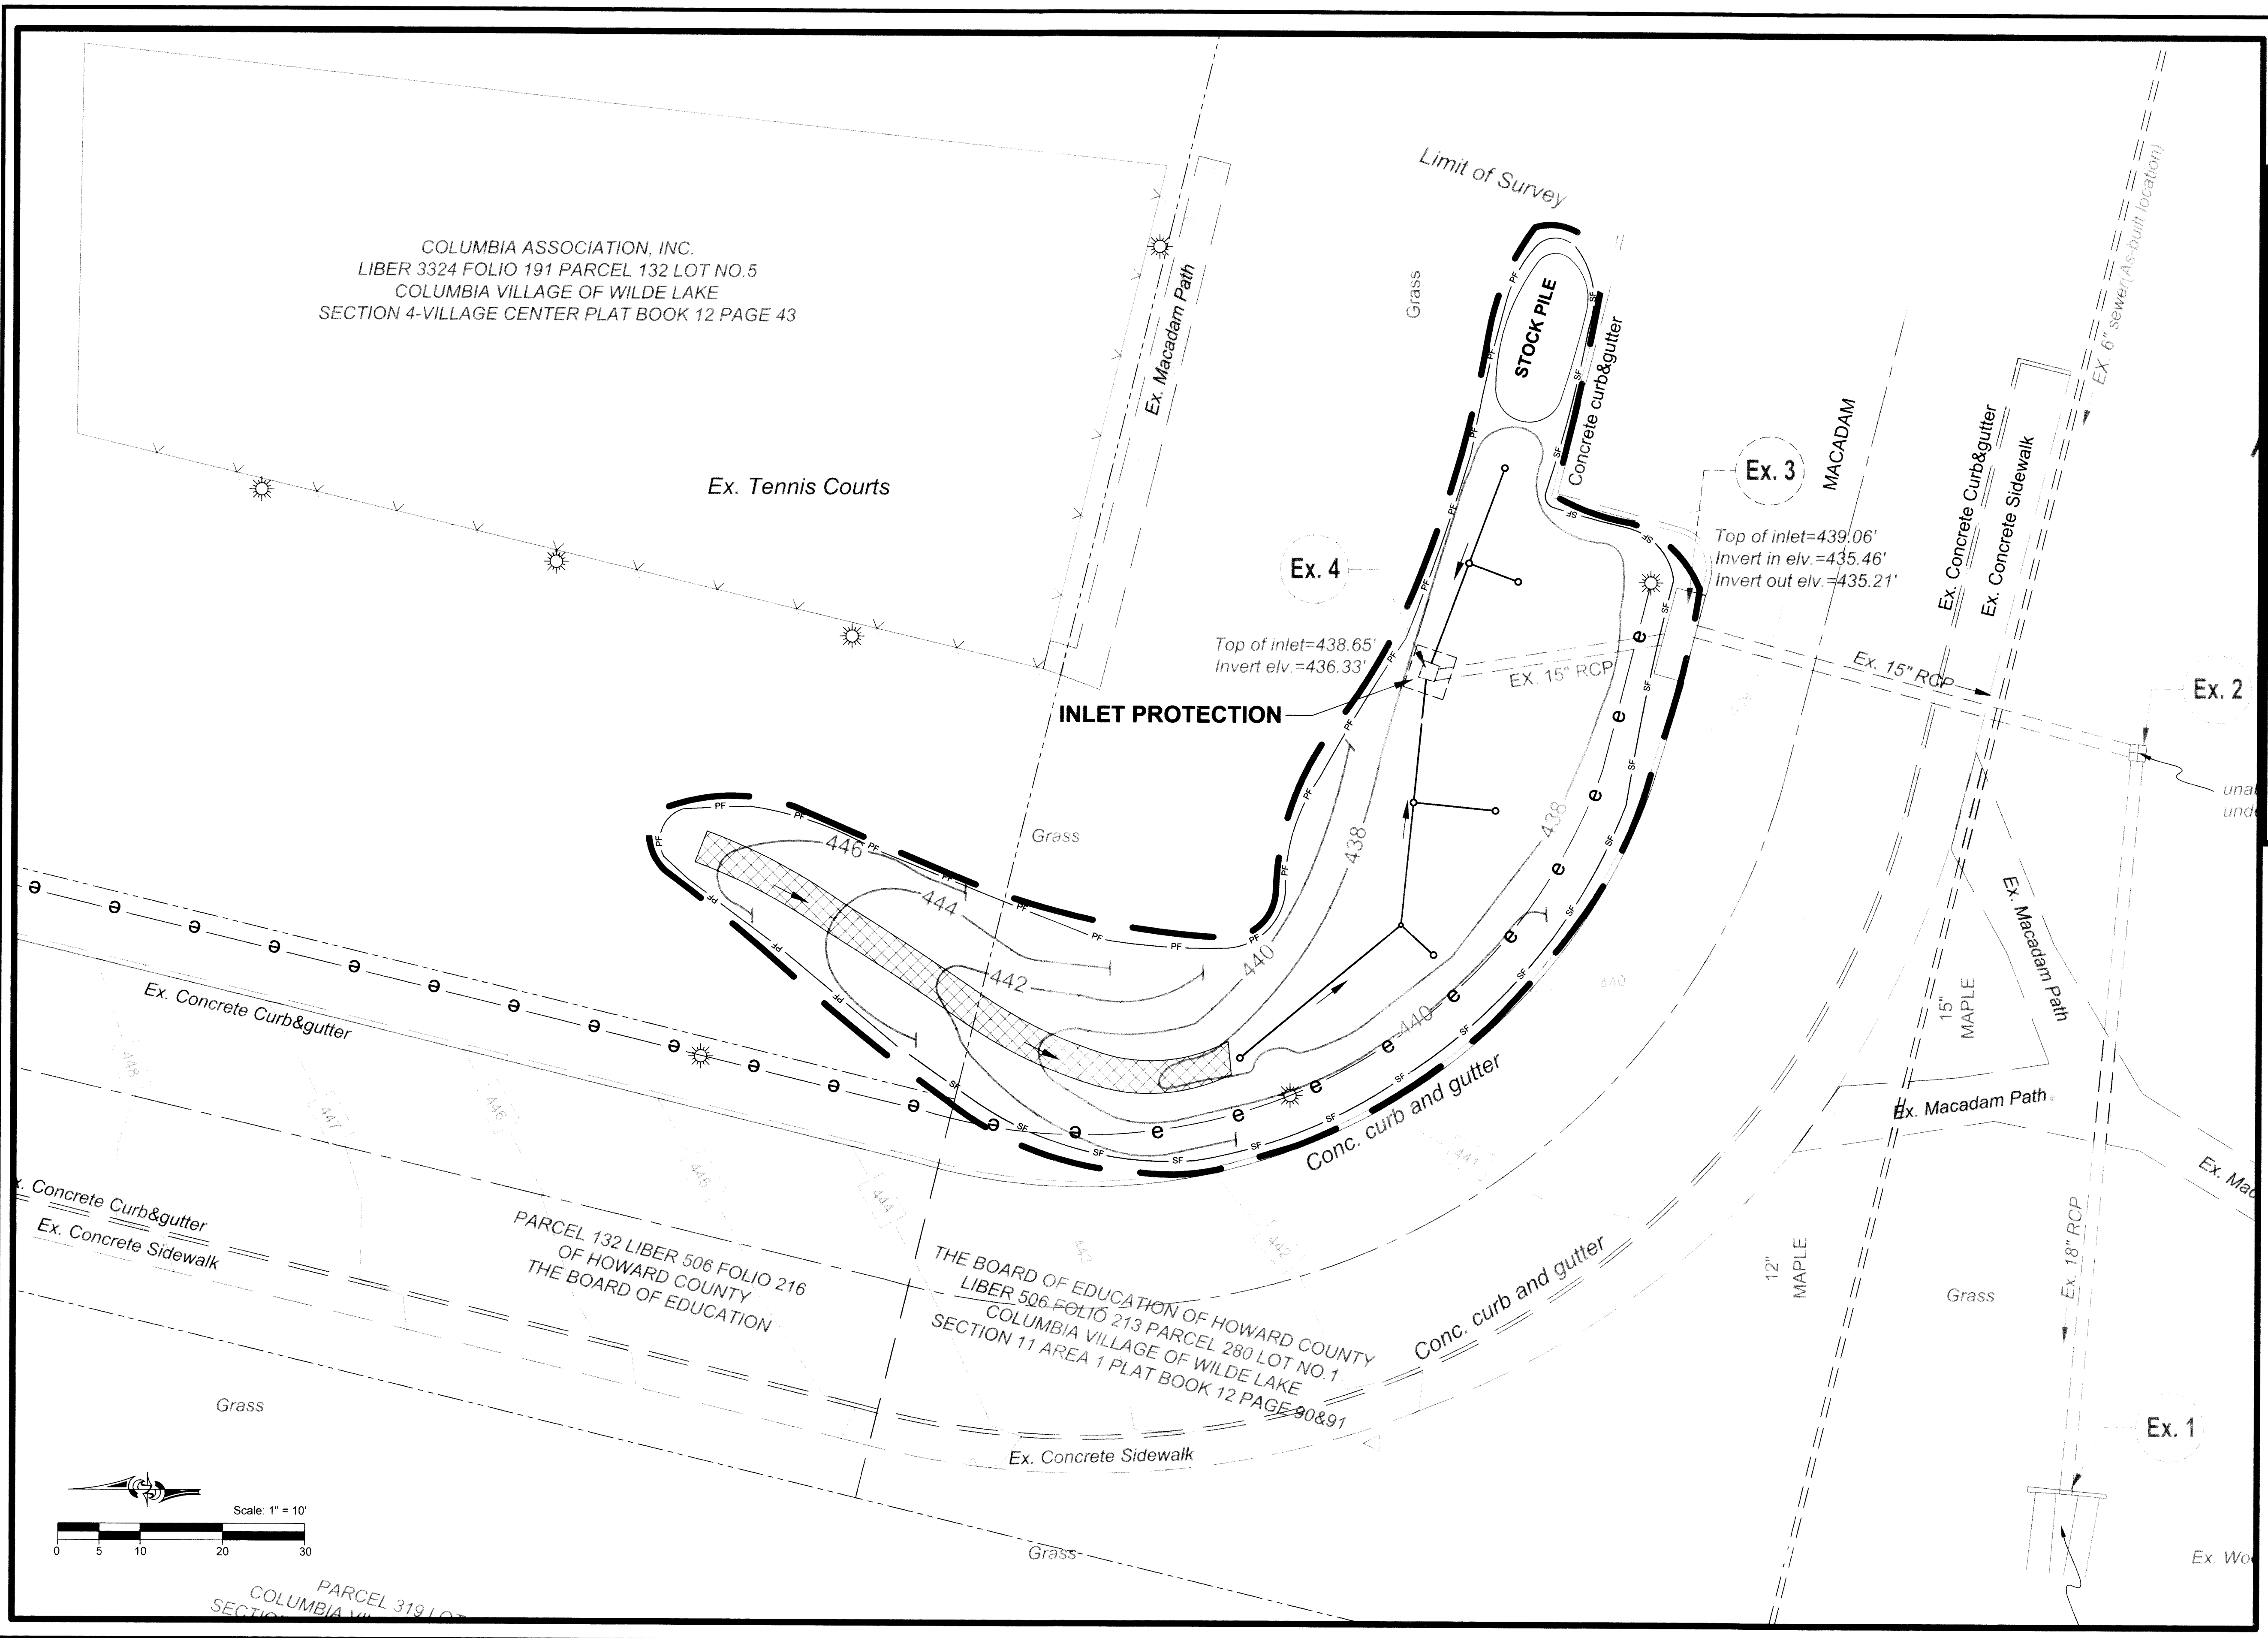

COLUMBIA ASSOCIATION, INC.
 LIBER 3324 FOLIO 191 PARCEL 132 LOT NO.5
 COLUMBIA VILLAGE OF WILDE LAKE
 SECTION 4-VILLAGE CENTER PLAT BOOK 12 PAGE 43

PARCEL 132 LIBER 506 FOLIO 216
 OF HOWARD COUNTY
 THE BOARD OF EDUCATION

THE BOARD OF EDUCATION OF HOWARD COUNTY
 LIBER 506 FOLIO 213 PARCEL 280 LOT NO.1
 COLUMBIA VILLAGE OF WILDE LAKE
 SECTION 11 AREA 1 PLAT BOOK 12 PAGE 90&91

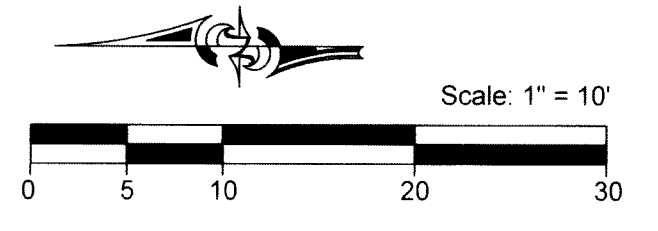

Legend	
	Limits of Disturbance
	Existing Contours
	Proposed Contours
	Light pole
	Existing Fence
	Silt Fence
	Pedestrian Fence
	Property Line

HOWARD COUNTY DPW - ENVIRONMENTAL SERVICES
 6751 COLUMBIA GATEWAY DRIVE, SUITE 514
 COLUMBIA, MD 21046
 PHONE: (410) 313-6413
 ATTN: Mark Richmond

HOWARD COUNTY, MD
 PARCEL 106
 ELECTION DISTRICT # 4
 MAP 14

BIORETENTION DESIGN WILDE LAKE MIDDLE SCHOOL SEDIMENT CONTROL

DATE:	05/06				
DESIGNED:	CW/HT				
DRAFTED:	HT				
CHECKED:	TCS				
BASE DATA:	J.A. RICE	NO.	REVISIONS	BY	DATE

Mark Richmond
 5.25.06

CPI Associates
 Charles P. Johnson & Associates, Inc.
 PLANNERS • ENGINEERS • LANDSCAPE ARCHITECTS • SURVEYORS
 1751 ELTON ROAD SUITE 300 SILVER SPRING, MARYLAND 20903
 Phone: (301) 434-7000 E-mail: cpi@cpj.com Fax: (301) 434-9394
 FREDERICK, MD FAIRFAX, VA

SCALE AS SHOWN
SHEET 3
OF 7 SHEETS
JOB NO. 36-501

GENERAL BIORETENTION INSTALLATION NOTES

- Contractor to strictly follow the approved design and construction specifications. Any substitutions are to be pre-approved by the inspector and design engineer in writing prior to placement of materials.
- The bioretention facility may not be constructed until all contributing drainage areas to each facility are stabilized. Construction of the facility shall not proceed without prior authorization of the inspector.
- No "rock dust" can be used for sand.
- Unless otherwise noted, all poured in place concrete shall be 3500 psi at 28 days.
- Contact "Miss Utility" at 1-800-257-7777 at least 48 hours prior to the start of construction.

UNDERDRAIN INSTALLATION SPECIFICATIONS

- Pipe shall be 6" diameter perforated SDR 35 PVC with 3/8" diameter holes, or approved equivalent.
- Perforations are to be 3/8-inch diameter, located 90 degrees on center, every four inches on center along the underdrain pipe. More rows may be used, if desired.
- Pipe shall be surrounded by a bed of 3/4" diameter clean gravel.
- Under drains to be placed on a 3'-0" wide section of filter cloth (Mirafi 140 N, or approved equivalent). Pipe is placed next, followed by the gravel bedding.
- The ends of under drain pipes not terminating in an observation well shall be capped.

BIORETENTION AREA SOIL SPECIFICATIONS

1. Soil Texture and Structure

Topsil for bioretention shall have a sandy loam, loamy sand, or loam texture per USDA textural triangle. Maximum clay content is 5%; soil mixture shall be 50-60% sand; 20-30% leaf mulch; and 20-30% topsoil. The soil shall be a uniform mix, free of stones, stumps, roots, or other similar objects larger than two inches. No other materials or substances shall be mixed or dumped within the bioretention that may be harmful to plant growth, or prove a hindrance to the planting or maintenance operations. The planting soil shall be free of Bermuda Grass, Quackgrass, Johnson Grass, Mugwort, Nutsedge, Poison Ivy, Canadian Thistle, Tearthumb, or other noxious weeds.

2. Soil Testing:

Planting soil for bioretention areas must be tested prior to installation for pH and organic matter. The soil should meet the following criteria (Landscape Contractors Association, 1986).

pH Range: 5.5-6.5
Organic Matter: 1.5-3.0%

It is required that a sieve analysis, pH, and organic matter test be performed per each bioretention area.

3. Soil Placement:

Placement of the planting soil in the bioretention area should be in lifts of 12 to 18 inches and lightly compacted. Minimal compaction effort can be applied to the soil by tamping with a bucket from a dozer or backhoe. Refer also to Section 6 - Compaction.

4. Mulch Specifications:

Individual planting shall be mulched (refer to landscaping details, this sheet). Acceptable mulch shall be shredded hardwood only. Mulch must be well aged, uniform in color, and free of foreign material including plant material. Well aged mulch is defined as mulch that has been stockpiled or stored for at least twelve (12) months.

5. Sand Specifications:

Provide clean sand, free of deleterious materials. Sand shall meet AASHTP M-6 or ASTM C-33 with grain size of 0.02"-0.04".

6. Compaction:

It is very important to minimize compaction of both the base of the bioretention area and the required backfill. When possible, use excavation hoes to remove original soil. If bioretention areas is excavated using a loader, the contractor should use wide track or marsh track equipment, or light equipment with turf type tires.

Use of equipment with narrow tracks or narrow tires, rubber tires with large lugs, or high pressure tires will cause excessive compaction resulting in reduced infiltration rates and storage volumes and is not acceptable. Compaction will significantly contribute to design failure. Compaction can be alleviated at the base of the bioretention facility by using a primary tilling operation such as a chisel plow, ripper, or subsoiler. These tilling operations are to refracture the soil profile through the 12 inch compaction zone. Substitute methods must be approved by the engineer. Rototillers typically do not till deep enough to reduce the effects of compaction from heavy equipment.

When back filling the bioretention facility, place soil in lifts 12" or greater. Do not use heavy equipment within the bioretention basin. Heavy equipment can be used around the perimeter of the basin to supply soils and sand. Grade bioretention materials with light equipment such as a compact loader or a dozer/loader with marsh tracks.

7. Geotextile Specifications:

Geotextile fabric shall meet ASTM D-751 (puncture strength - 125 lb)
ASTM D-1117 (Mullen burst strength - 400 PSI)
ASTM D-1682 (Tensile strength - 300 lb)
Fabric shall have 0.08" thick E.O.S. of #80 sieve, and maintain 125 GPM per sq. ft. flow rate.

8. Gravel Filter Specifications:

Underdrain gravel blanket shall be double washed, #57 stone, 1-1/2" in size. Pea Gravel shall be washed, river-run, round diameter, 1/2"-3/4" in size.



9. Inspection Requirements:

- The contractor shall arrange a "preconstruction meeting" with the owner and architect/engineer prior to beginning work on the bioretention facility.
- At the completion of excavation to inspect subgrade preparation.
- During underdrain and filter installation.
- Back fill of soil into the bioretention areas. Soil certifications for back fill are required.
- The final topsoil layers should be thoroughly wetted achieve settlement of the soil/sand backfill mix.
- Additional soil backfill should be placed as required to achieve the design top surface elevations.
- The work shall be inspected by the owner/architect prior to final stabilization and planting.
- Sediment & erosion control practices may be removed upon approval by the County inspector.

GENERAL PLANTING SPECIFICATIONS

The plant root ball should be planted so 1/8th of the ball is above final grade surface.

- Fertilization:** The topsoil specifications provide enough organic material to adequately supply nutrients from natural cycling. The primary function of the bioretention structure is to improve water quality. Adding fertilizers defeats, or at a minimum, impedes this goal. Only add fertilizer if wood chips or mulch is used to amend the soil. Rototill urea fertilizer at a rate of 2 pounds per 1000 square feet.
- Grass Seeding (slopes adjacent to bioretention area):** Seed areas according to the following schedule: Panicum virgatum (Switchgrass) 0.25 lb. per 1000 sq. ft. Poa trivialis (Rough-stalked bluegrass) 1.00 lb. per 1000 sq. ft. Festuca ovina var. duriuscula (Hard fescue) 1.00 lb. per 1000 sq. ft.

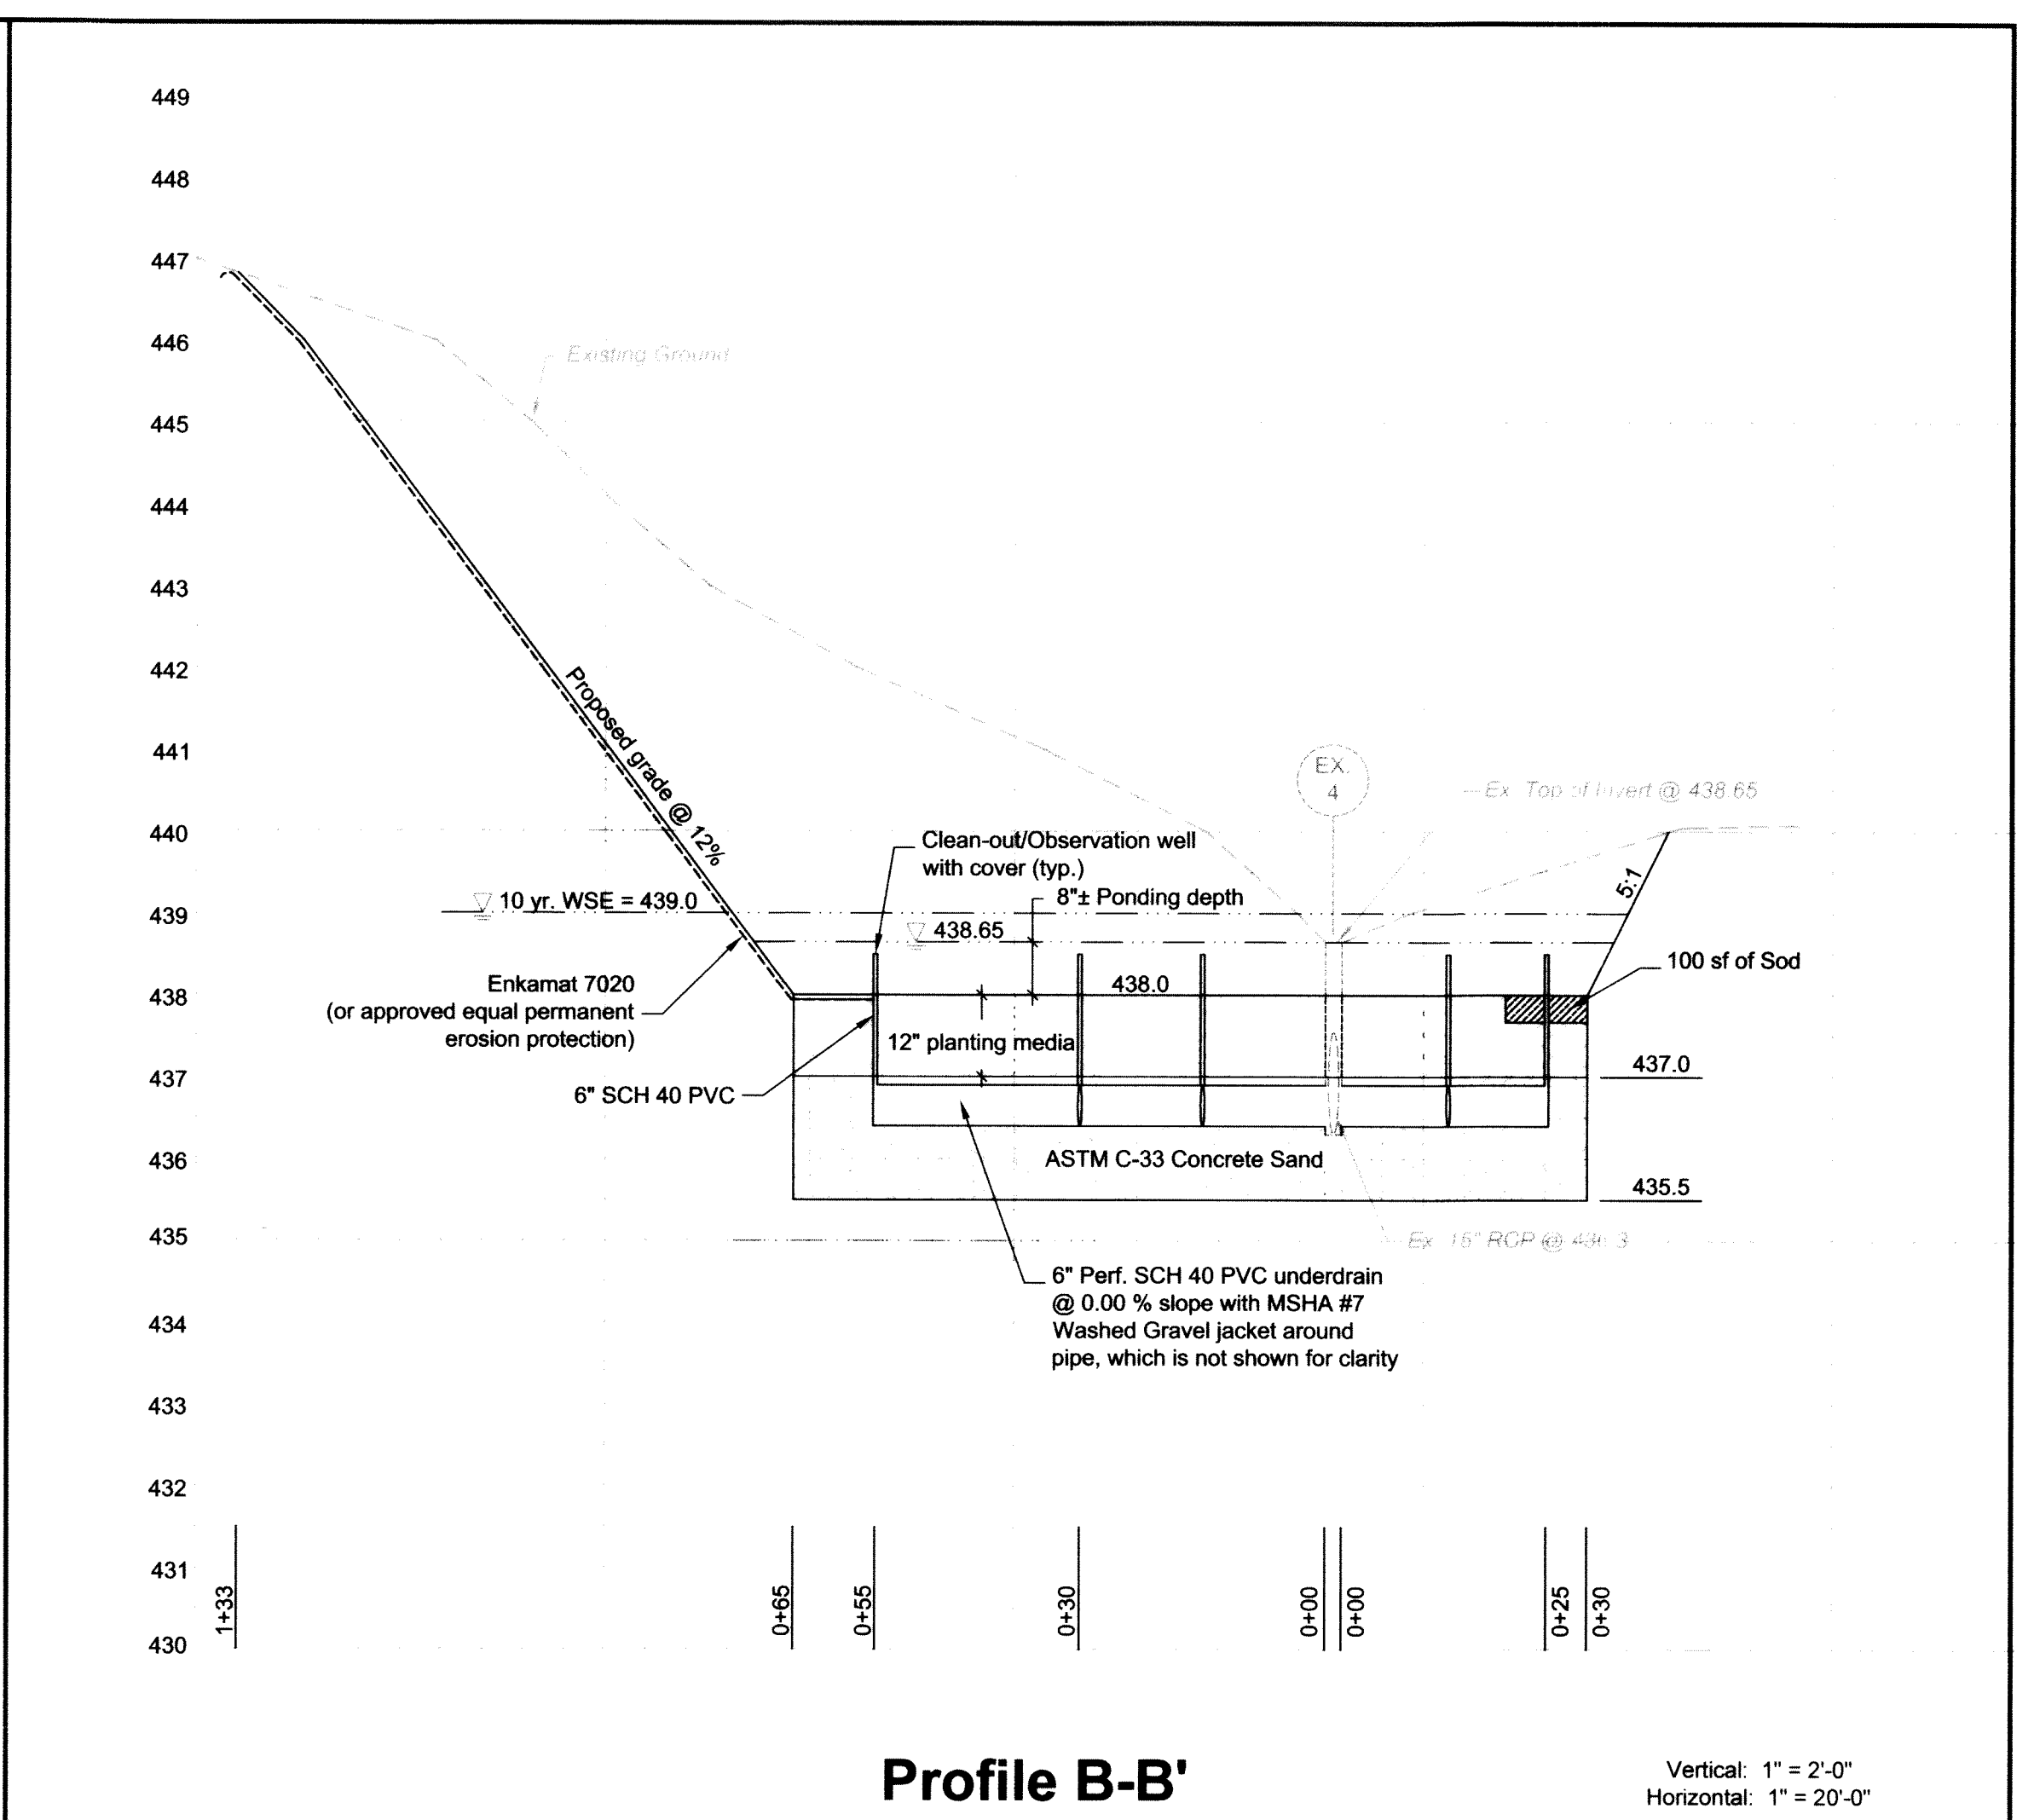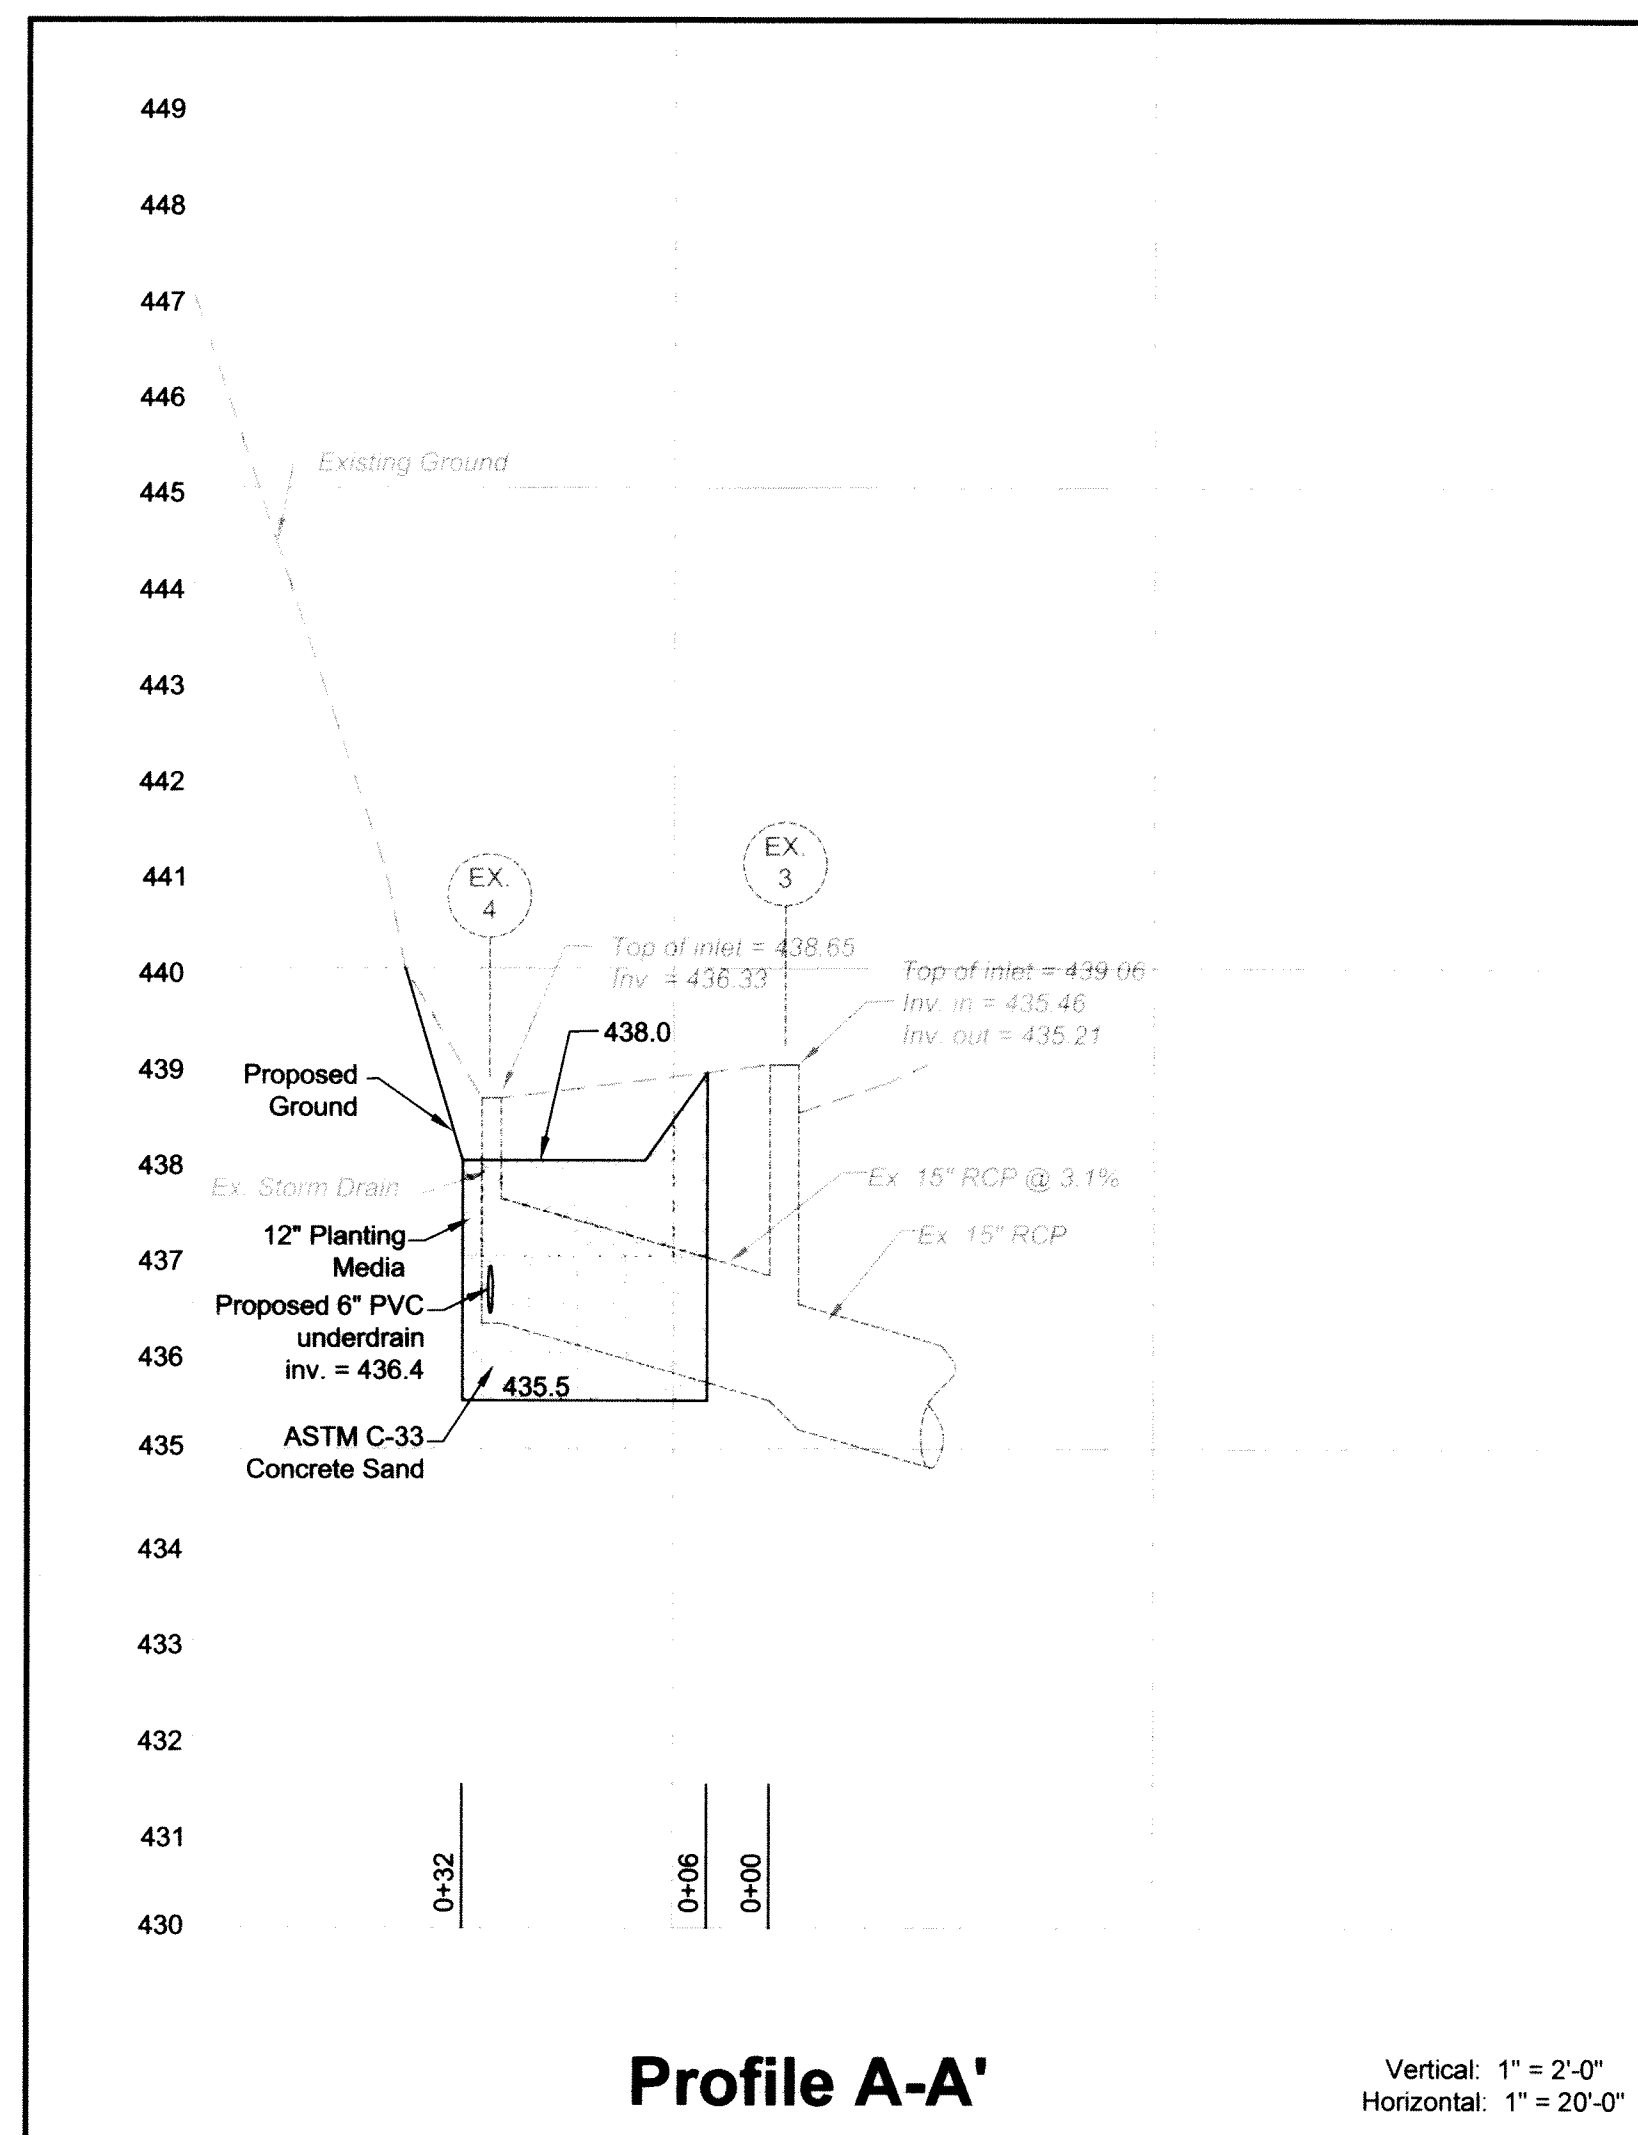

PIPE SCHEDULE

Location	Material	Length	Specification
Wells	Solid 6" PVC	13'	Schedule 40
Underdrain	Perforated 6" PVC	100'	Schedule 40

Plot: 11x17 Title.dwg
 CPJ.dwg
 24/36 Title.dwg
 Plot: 11x17 Title.dwg
 CPJ.dwg
 24/36 Title.dwg

HOWARD COUNTY DPW - ENVIRONMENTAL SERVICES
6751 COLUMBIA GATEWAY DRIVE, SUITE 514
COLUMBIA, MD 21046
PHONE: (410) 313-6413
ATTN: Mark Richmond

HOWARD COUNTY, MD
PARCEL 106
ELECTION DISTRICT # 4
MAP 14




**BIORETENTION DESIGN
WILDE LAKE MIDDLE SCHOOL
PROFILES**

DATE:	05/06				
DESIGNED:	CW/HT				
DRAFTED:	HT				
CHECKED:	TCS				
BASE DATA:	J.A. RICE	NO.	REVISIONS	BY	DATE


Handwritten signature and date: 5/16/06

CPJ Charles P. Johnson & Associates, Inc.
PLANNERS • ENGINEERS • LANDSCAPE ARCHITECTS • SURVEYORS
1751 ELTON ROAD SUITE 300 SILVER SPRING, MARYLAND 20903
Phone: (301) 434-7000 E-mail: cpj@cpja.com Fax: (301) 434-9394
FREDERICK, MD FAIRFAX, VA

SCALE AS SHOWN
SHEET 4 OF 7 SHEETS
JOB NO. 36-501

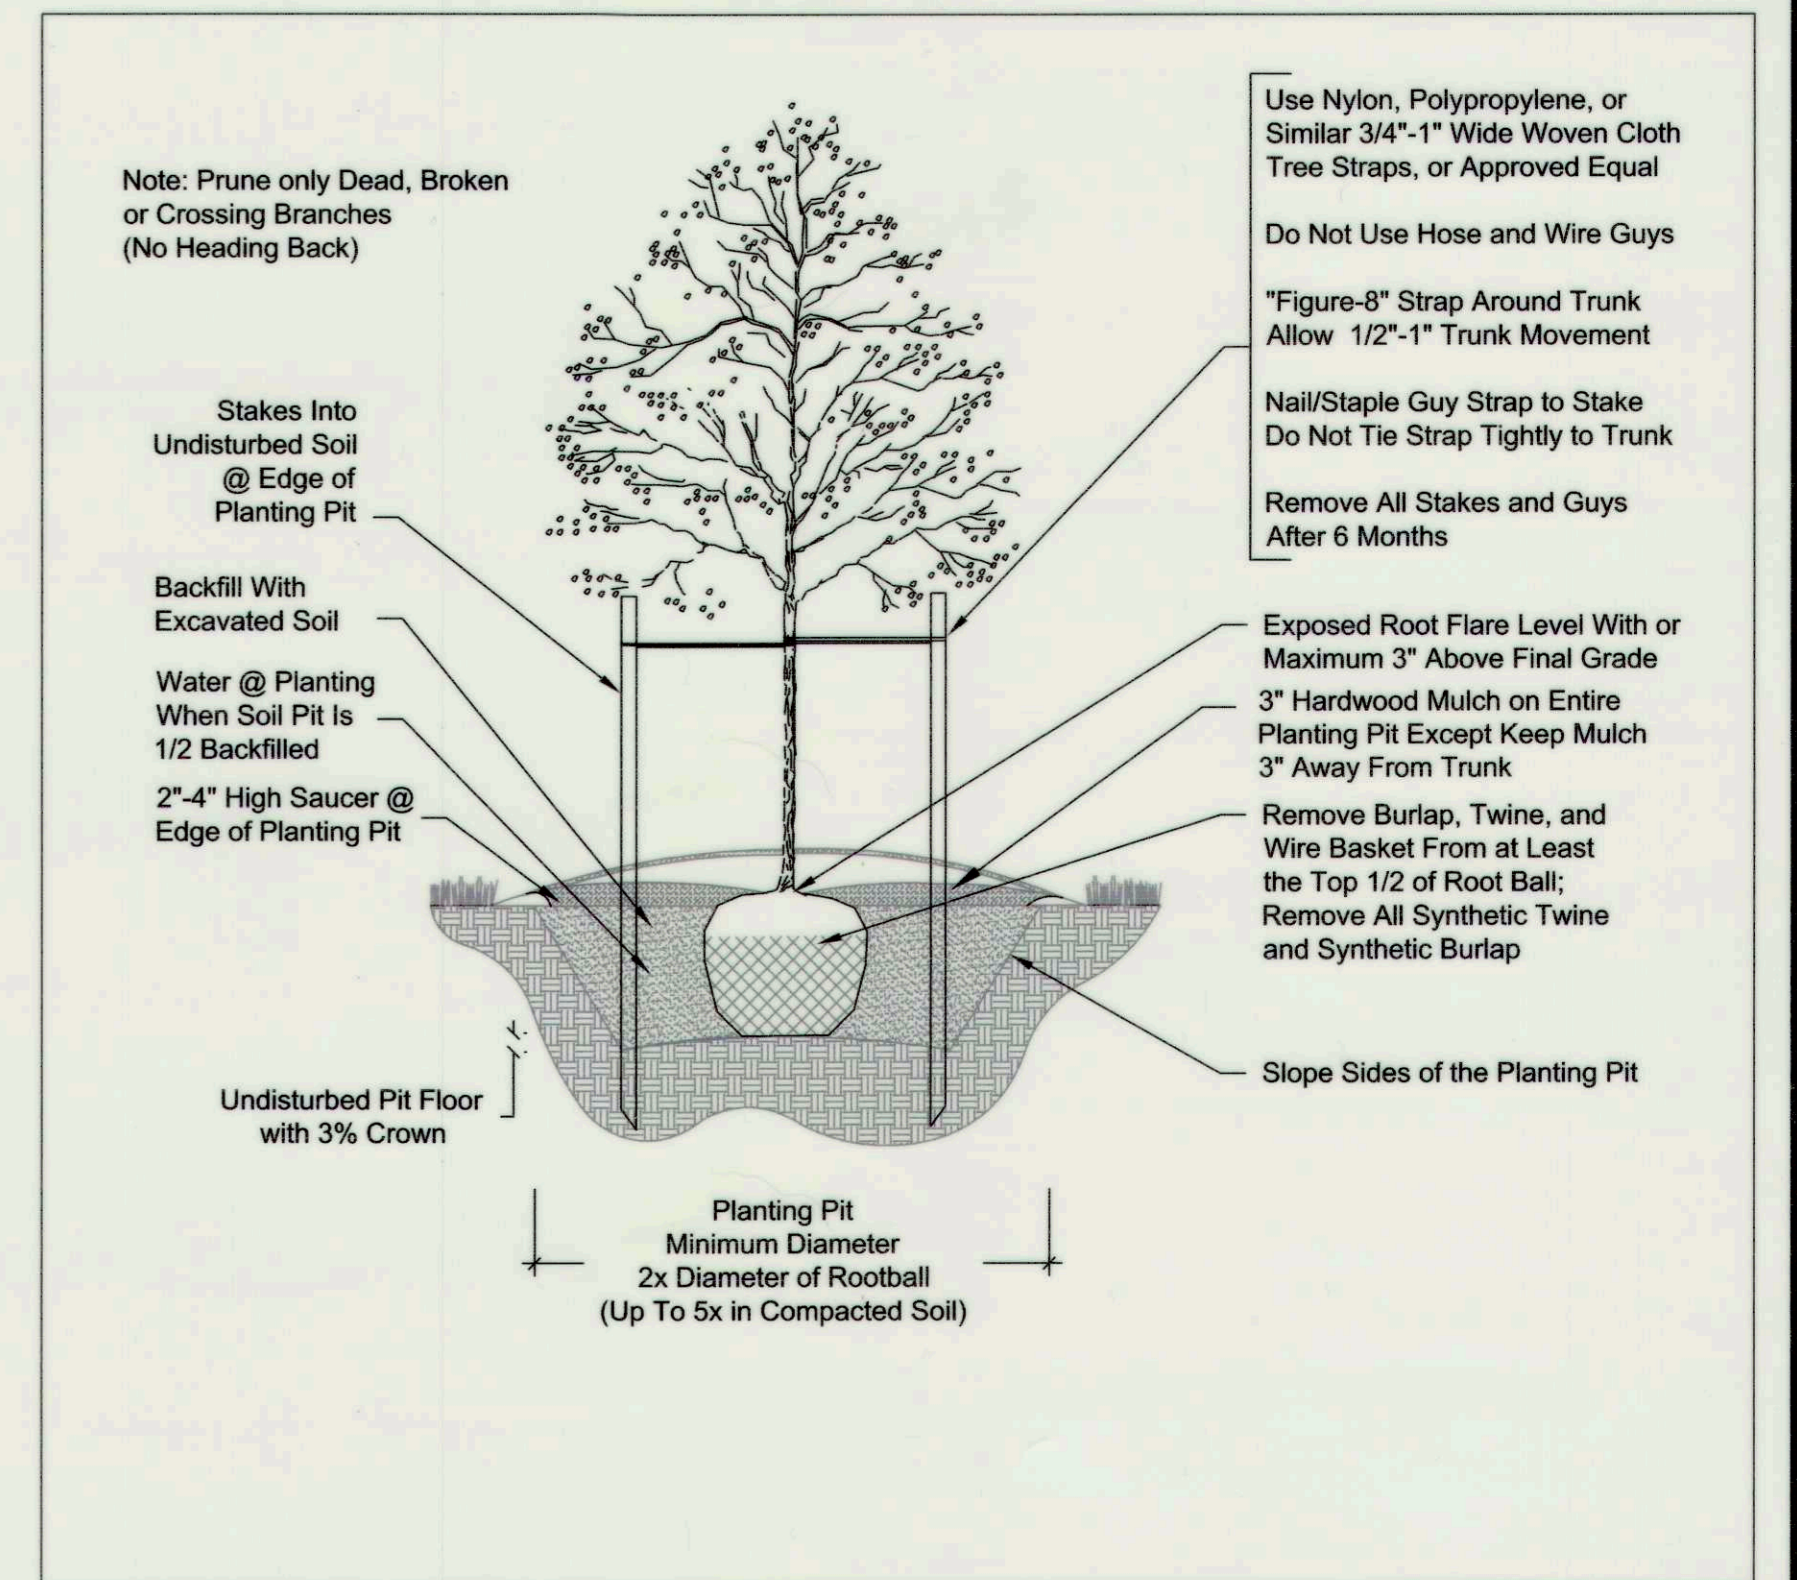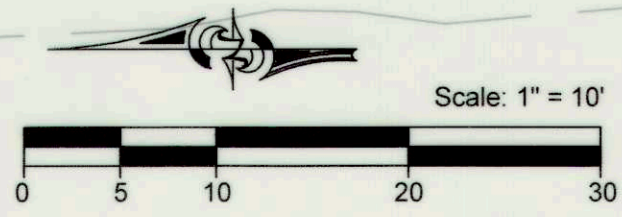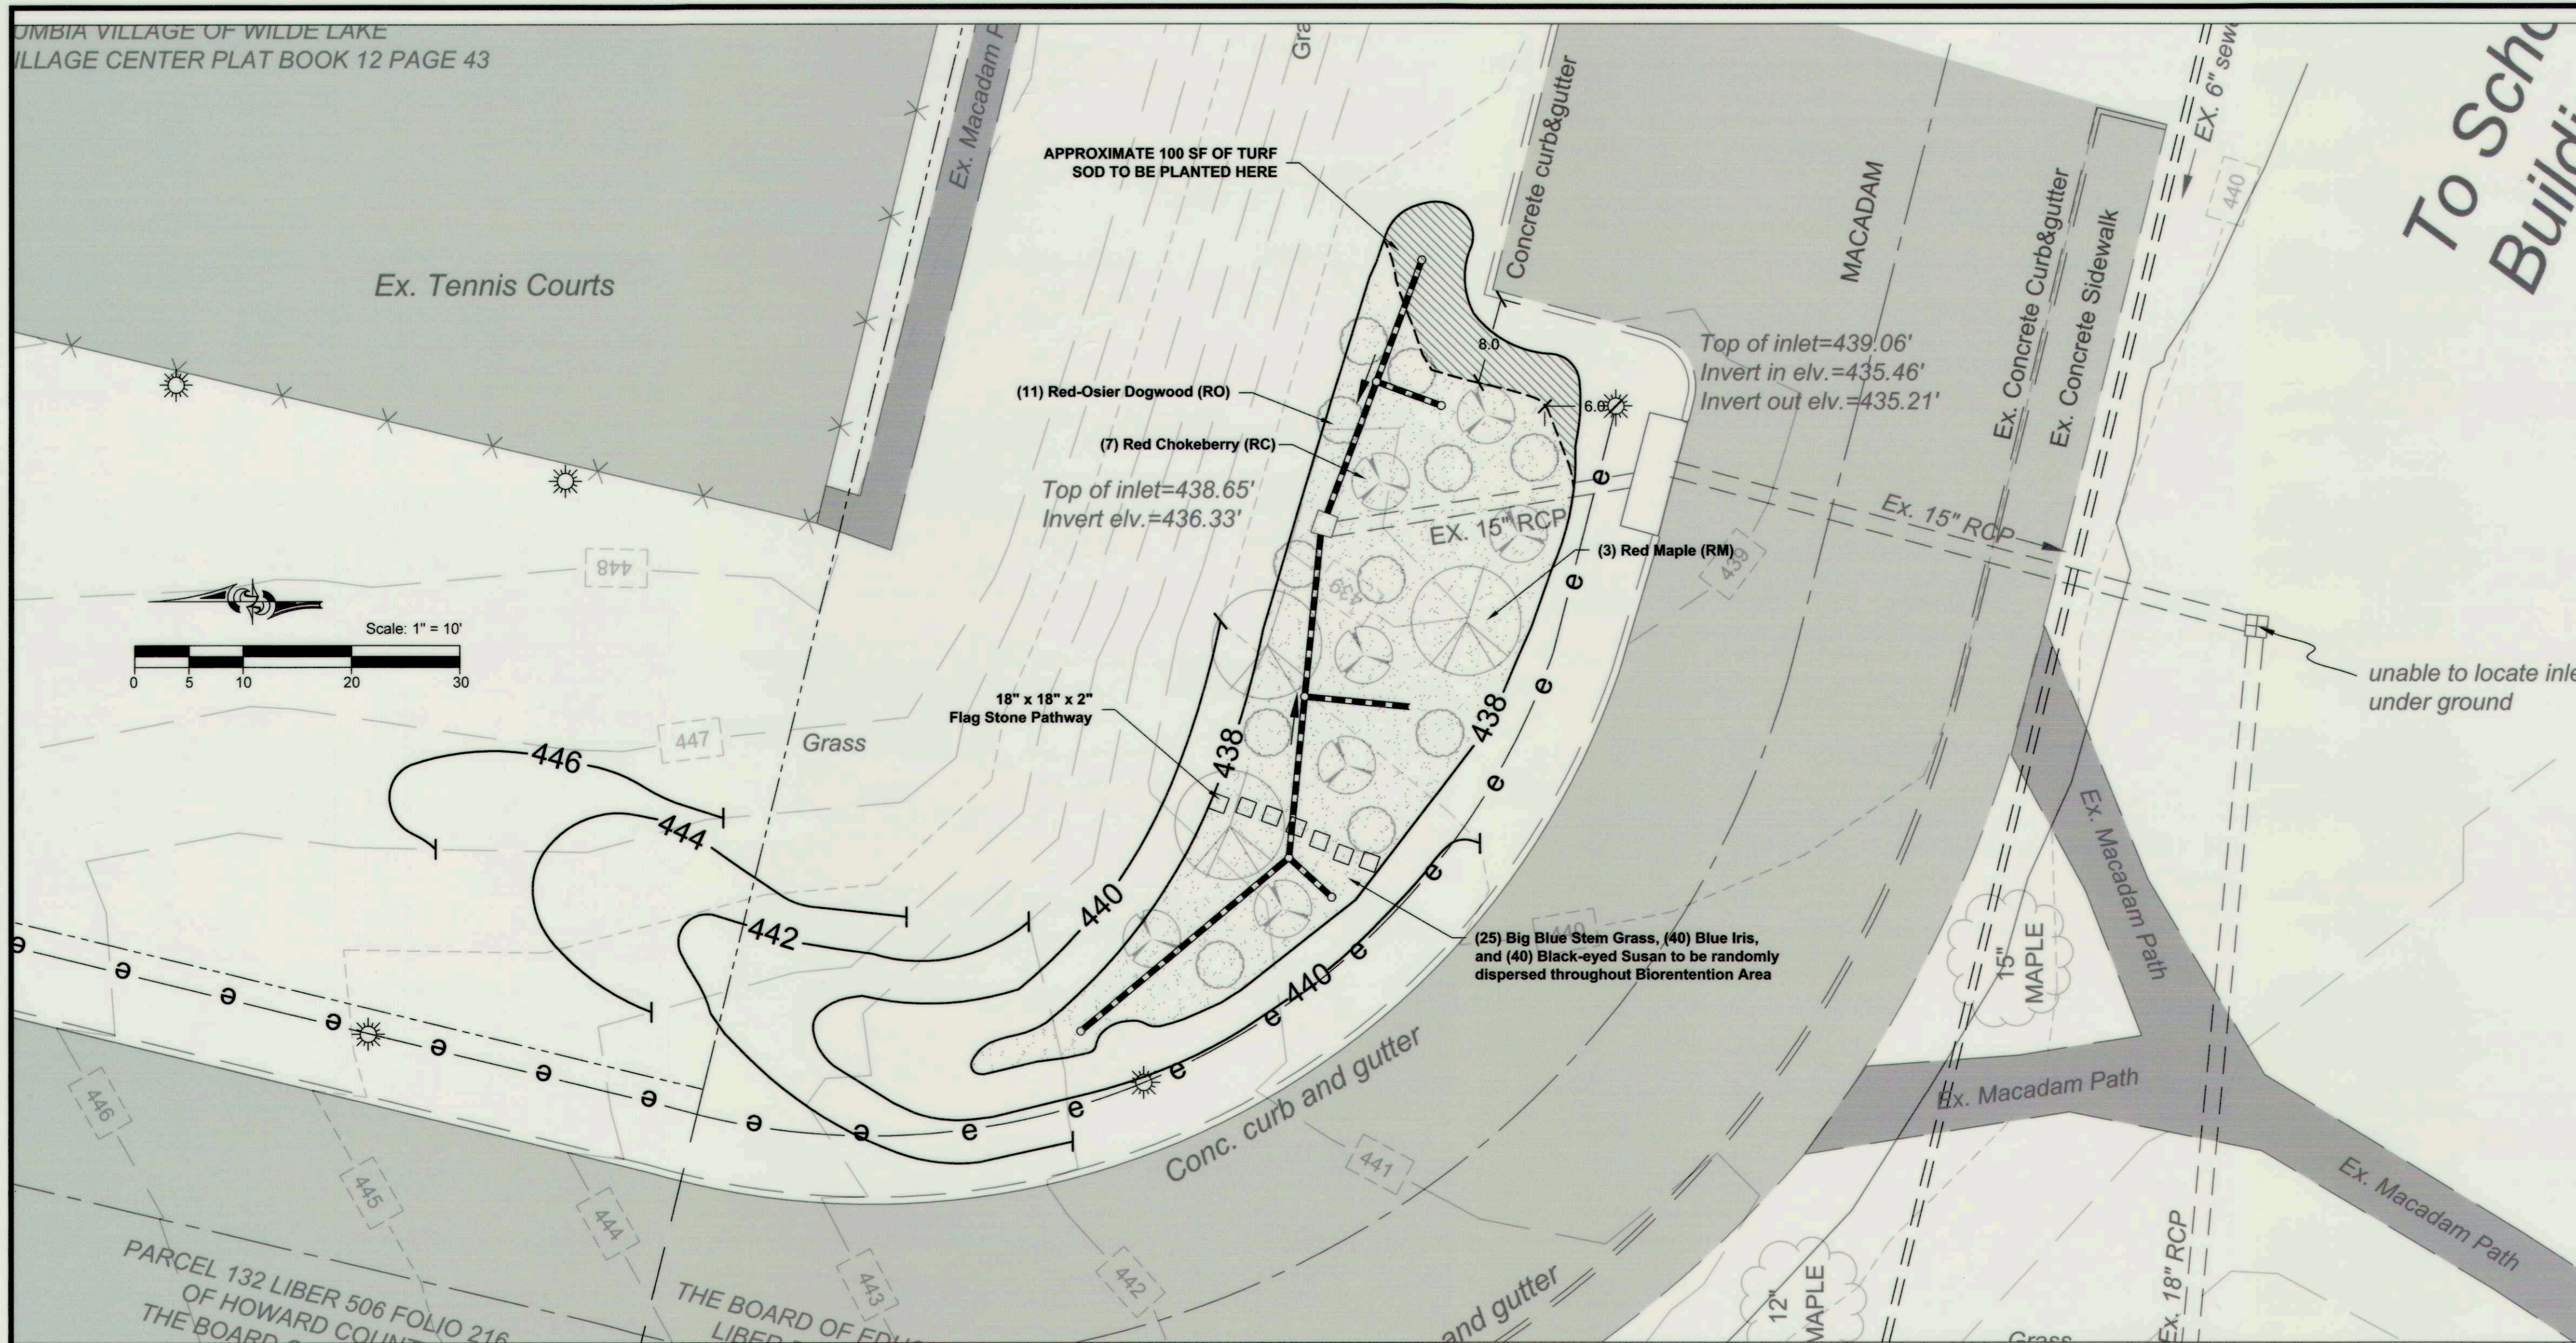


1 TREE PLANTING DETAIL
Not to Scale

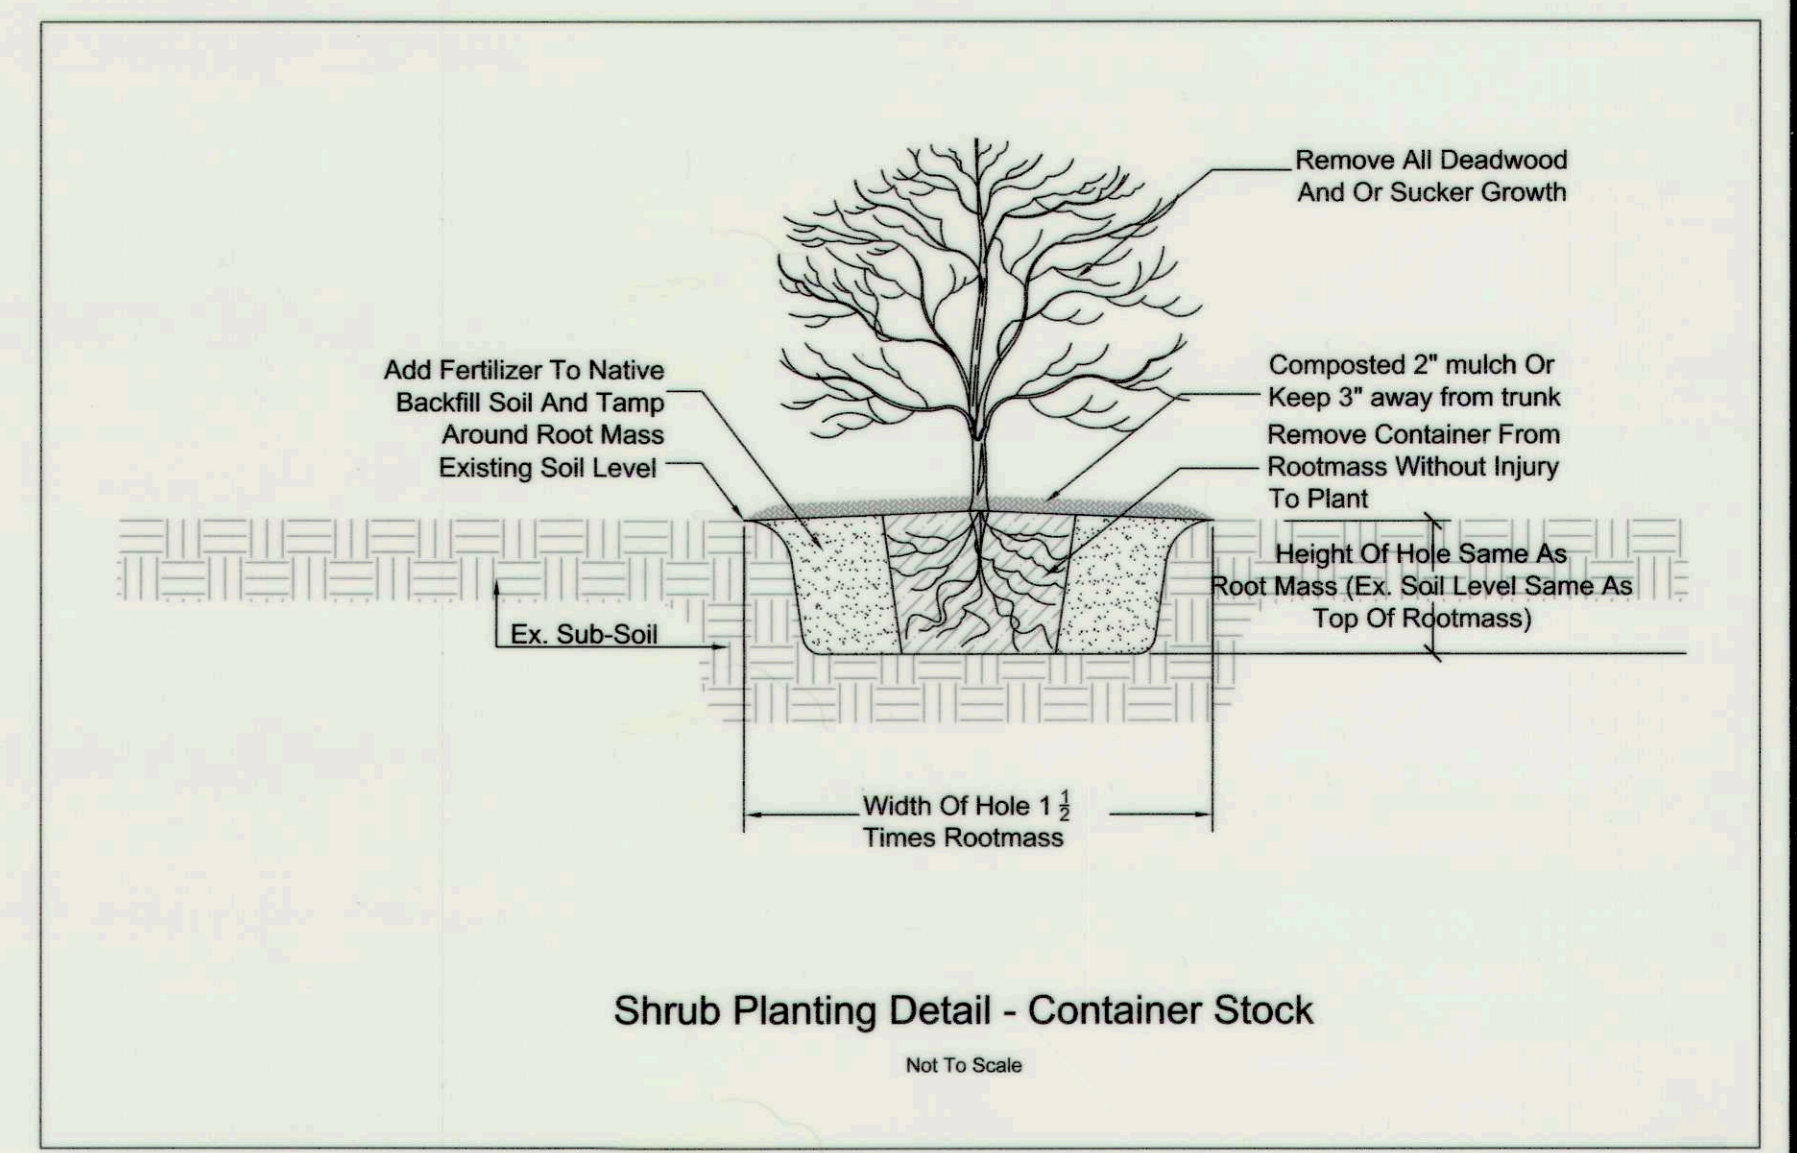


2 SHRUB PLANTING DETAIL
Not to Scale

Hand Planting Method for Reforestation
(1-3 gal. container to 1 1/2" B&B stock)

1. Begin planting upon the completion of site preparation (see planting specifications for site specific preparation information).
2. Dig hole twice the width (36" min.) and no deeper than the actual size of the root mass. Scarify the sides of the hole to prevent glazing and to encourage root penetration.

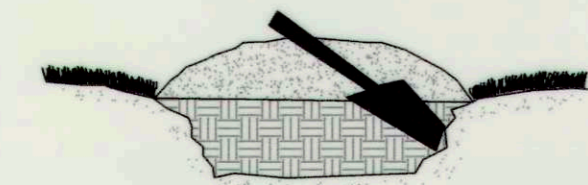

3. Slice sides of the root ball if pot bound, and place onto the bottom of the hole. Hole should be the same depth as the root ball. Do not butterfly root ball, as the method causes air pockets. Backfill with the existing native soil. A polymer gel soil moisture enhancer mixed into backfill soil is optional depending on site conditions.

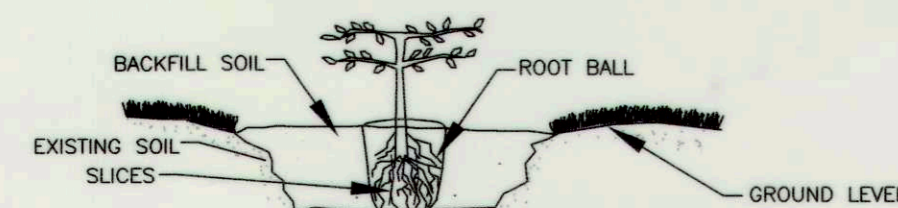

4. Tamp existing back fill soil around root ball. Avoid excessive tamping and other soil compacting activities.
5. No fertilizer is necessary at the time of planting because site specific fertilizer determines by soil test results was applied during site preparation.
6. Mulch with 3" of shredded hardwood mulch, shredded pinebark mulch or composted woodchips in a 36" diameter ring.
7. Water all plants at the time of initial planting.

3 HAND-PLANTING DETAIL
Not to Scale

BIORETENTION PLANTING SCHEDULE

Common Name	Scientific Name	Size	QTY	Spacing	Notes
Red Maple	<i>Acer rubrum</i>	2.5" Cal.	3	15' O.C.	as shown
Red Osier Dogwood	<i>Cornus sericea</i>	2 Gal.	11	3' O.C.	as shown
Red Chokeberry	<i>Aronia arbutifolia</i>	2 Gal.	7	3' O.C.	as shown
Big Blue Stem Grass	<i>Andropogon gerardii</i>	1 Gal.	25	2' O.C.	Within treeline of BA
Blue Flag Iris	<i>Iris versicolor</i>	1 Gal.	40	2' O.C.	Lowest point of BA
Black-eyed Susan	<i>Rudbeckia hirta</i>	1 Gal.	40	2' O.C.	Within treeline of BA

HOWARD COUNTY DPW - ENVIRONMENTAL SERVICES
6751 COLUMBIA GATEWAY DRIVE, SUITE 514
COLUMBIA, MD 21046
PHONE: (410) 313-6413
ATTN: Mark Richmond

HOWARD COUNTY, MD
PARCEL 106
ELECTION DISTRICT # 4
MAP 14

**BIORETENTION DESIGN
WILDE LAKE MIDDLE SCHOOL
PLANTING PLAN**

DATE:	05/06				
DESIGNED:	CW/HT				
DRAFTED:	HT				
CHECKED:	TCS				
BASE DATA:	J.A. RICE	NO.	REVISIONS	BY	DATE



CPJ Charles P. Johnson & Associates, Inc.
PLANNERS • ENGINEERS • LANDSCAPE ARCHITECTS • SURVEYORS
1751 ELTON ROAD SUITE 300 SILVER SPRING, MARYLAND 20903
Phone: (301) 434-7000 E-mail: cpj@cpja.com Fax: (301) 434-9394
FREDERICK, MD FAIRFAX, VA

SCALE AS SHOWN
SHEET 6
OF 7 SHEETS
JOB NO. 36-501

SECTION I - VEGETATIVE STABILIZATION METHODS AND MATERIALS

A. Site Preparation

- i) Install erosion and sediment control structures (either temporary or permanent) such as diversions, grade stabilization structures, berms, waterways, or sediment control basins.
- ii) Perform all grading operations at right angles to the slope. Final grading and shaping is not usually necessary for temporary seeding.
- iii) Schedule required soil tests to determine soil amendment composition and application rates for sites having disturbed area over 5 acres.

B. Soil Amendments (Fertilizer and Lime Specifications per Howard County Public Schools System Grounds Dept. Spec. Sect.#02490)

- i) Lime shall be agricultural grade lime material (ground limestone, hydrated or burnt lime) which contains total carbonates of 85 % with a minimum of 30 % magnesium carbonate and which contains at least 50 % total oxides (calcium oxide plus magnesium oxide). Limestone shall be ground so that not less than 50% passes a 100-mesh sieve and 90-100% passes a 20-mesh sieve.
- ii) Lawn fertilizer. Complete fertilizer of neutral character and uniform composition that is suitable for applications with approved equipment. Lawn fertilizer shall be the only used after seeding operations

- a. Fertilizer shall contain some elements derived from organic sources and provide nitrogen in a form that will be available to the lawn during its initial period of growth.
- b. Fertilizer shall be delivered to the site fully labeled according to applicable state fertilizer laws and shall bear the name, trade name or trademark and warranty or the producer.
- c. Fertilizer shall, at a minimum contain the following percentages of available plant nutrients: 18 % N, 24% P, 12% K, 50% SCU applied at a rate of 1 lb. per 1,000 square feet lawn area.

C. Seedbed Preparation

- i) Temporary Seeding
 - a. Seedbed preparation shall consist of loosening soil to a depth of 3" to 5" by means of suitable agricultural or construction equipment, such as disc harrows or chisel plows or rippers mounted on construction equipment. After the soil is loosened it should not be rolled or dragged smooth but left in the roughened condition. Sloped areas (greater than 3: 1) should be tracked leaving the surface in an irregular condition with ridges running parallel to the contour of the slope.

b. Apply fertilizer and lime as prescribed on the plans.

c. Incorporate lime and fertilizer into the top 3 -5" of soil by disking or other suitable means.

ii) Permanent Seeding

a. Minimum soil conditions required for permanent vegetative establishment:

- 1. Soil pH shall be between 6.0 and 7.0.
- 2. Soluble salts shall be less than 500 parts per million (ppm).
- 3. The soil shall contain less than 40 % clay but enough fine grained material (> 30 % silt plus clay) to provide the capacity to hold a moderate amount of moisture. An exception is if lovegrass or *sercia lespedeza* is to be planted, then a sandy soil (< 30 % silt plus clay) would be acceptable.
- 4. Soil shall contain 1.5% minimum organic matter by weight.
- 5. Soil must contain sufficient pore space to permit adequate root penetration.
- 6. If these conditions cannot be met by soils on site, adding topsoil is required in accordance with Section 21 Standard and Specification for Topsoil.

b. Areas previously graded in conformance with the drawings shall be maintained in a true and even grade, then scarified or otherwise loosened to a depth of 3 -5" to permit bonding of the topsoil to the surface area and to create horizontalfactive. 7. Erosion check slots to prevent topsoil from sliding down a slope.

c. Apply soil amendments as per soil test or as included on the plans.

d. Mix soil amendments into the top 3 -5" of topsoil by disking or other suitable means. Lawn areas should be raked to smooth the surface, remove large objects like stones and branches, and ready the area for seed application. Where site conditions will not permit normal seedbed preparation, loosen surface soil by dragging with a heavy chain or other equipment to roughen the surface. Steep slopes (steeper than 3:1 should be tracked by a dozer leaving the soil in an irregular condition with ridges running parallel to the contour of the slope. The top 1 -3" of soil should be loose and friable. Seedbed loosening may not be necessary on newly disturbed areas.

D. Seed Specifications

i) All seed must meet the requirements of the Maryland State Seed Law. All seed shall be subject to re-testing by a recognized seed laboratory. All seed used shall have been tested within the 6 months immediately preceding the date of sowing such material on this job.

Note: Seed tags shall be made available to the inspector to verify type and rate of seed used.

ii) Inoculant -The inoculant for treating legume seed in the seed mixtures shall be a pure culture of nitrogen-fixing bacteria prepared specifically for the species. Inoculants shall not be used later than the date indicated on the container. Add fresh inoculant as directed on package. Use four times the recommended rate when hydroseeding. Note: It is very important to keep inoculant as cool as possible until used. Temperatures above 75-80 F. can weaken bacteria and make the inoculant less effective.

E. Methods of Seeding

i. **Hydroseeding:** Apply seed uniformly with hydroseeder (slurry includes seed and fertilizer), broadcast or drop seeder, or a cultipacker seeder.

a. If fertilizer is being applied at the time of seeding, the application rates amounts will not exceed the following: nitrogen; maximum of 100 lbs. per acre total of soluble nitrogen; P2O5 (phosphorous): 200 lbs/acre; K2O (potassium): 200 lbs/acre.

b. Lime -use only ground agricultural limestone. (Up to 3 tons per acre may be applied by hydroseeding). Normally, not more than 2 tons are applied by hydroseeding at any time. Do not use burnt or hydrated lime when hydroseeding.

c. Seed and fertilizer shall be mixed on site and seeding shall be done immediately and without interruption.

ii) **Dry Seeding:** This includes use of conventional drop or broadcast spreaders.

a. Seed spread dry shall be incorporated into the subsoil at the rates prescribed on the Temporary or Permanent Seeding Summaries or Tables 25 or 26. The seeded area shall then be rolled with a weighted roller to provide good seed to soil contact.

b. Where practical, seed should be applied in two directions perpendicular to each other. Apply half the seeding rate in each direction.

iii) **Drill or Cultipacker Seeding:** Mechanized seeders that apply and cover seed with soil.

a. Cultipacking seeders are required to bury the seed in such a fashion as to provide at least 1/4 inch of soil covering. Seedbed must be firm after planting.

b. Where practical, seed should be applied in two directions perpendicular to each other. Apply half the seeding rate in each direction.

ii) Wood Cellulose Fiber Mulch (WCFM)

a. WCFM shall consist of specially prepared wood cellulose processed into a uniform fibrous physical state, down a sil

b. WCFM shall be dyed green or contain a green dye in the package that will provide an appropriate color to facilitate visual inspection of the uniformly spread slurry.

c. WCFM, including dye, shall contain no germination or growth inhibiting factors.

d. WCFM materials shall be manufactured and processed in such a manner that the wood cellulose fiber mulch will remain in uniform suspension in water under agitation and will blend with seed, fertilizer and other additives to form a homogeneous slurry. The mulch material shall form a blotter-like ground cover, on application, having moisture absorption and percolation properties and shall cover and hold grass seed in contact with the soil without inhibiting the growth of the grass seedlings.

e. WCFM material shall contain no elements or compounds at concentration levels that will be phyto-toxic.

f. WCFM must conform to the following physical requirements: fiber length to approximately 10 mm, diameter approximately 1 mm, pH range of 4.0 to 8.5, ash content of 1.6 % maximum and water holding capacity of 90 % minimum.

Note: Only sterile straw mulch should be used in areas where one species of grass is desired.

G. Mulching Seeded Areas - Mulch shall be applied to all seeded areas immediately after seeding.

i) (per Howard County Public School Spec. Sect.#02490) Mulch shall be thrashed barley, wheat or oat straw. It shall be clean and free of noxious weeds, weed seeds, and other foreign materials. Mulch all seeded areas as follows:

a. Mulch shall be applied at a rate of 2,000 pounds per acre in a uniform manner. The material shall be anchored immediately after application.

ii) If grading is completed outside of the seeding season, mulch alone shall be applied as prescribed in this section and maintained until the seeding season returns and seeding can be performed in accordance with these specifications.

iii) When straw mulch is used, it shall be spread over all seeded areas at the rate of 2 tons/acre. Mulch shall be applied to a uniform loose depth of between 1" and 2". Mulch applied shall achieve a uniform distribution and depth so that the soil surface is not exposed. If a mulch anchoring tool is to be used, the rate should be increased to 2.5 tons/acre.

H. Securing Straw Mulch (Mulch Anchoring): Mulch anchoring shall be performed immediately following mulch application to minimize loss by wind or water. This may be done by one of the following methods (listed by preference), depending upon size of area and erosion hazard:

i) A mulch anchoring tool is a tractor drawn implement designed to punch and anchor mulch into the soil surface a minimum of two (2) inches. This practice is most effective on large areas, but is limited to flatter slopes where equipment can operate safely. If used on sloping land, this practice should be used on the contour if possible.

ii) Wood cellulose fiber may be used for anchoring straw. The fiber binder shall be applied at a net dry weight of 750 pounds/acre. The wood cellulose fiber shall be mixed with water and the mixture shall contain a maximum of 50 pounds of wood cellulose fiber per 100 gallons of water.

iii) Application of liquid binders should be heavier at the edges where wind catches mulch, such as in valleys and on crests of banks. The remainder of area should be appear uniform after binder application. Synthetic binders -such as Acrylic DLR (Agro-Tack), DCA-70, Petrosel, Terra Tax II, Terra Tack AR or other approved equal may be used at rates recommended by the manufacturer to anchor mulch.

iv) Lightweight plastic netting may be stapled over the mulch according to manufacturer's recommendations. Netting is usually available 100' in roll 4' to 15' wide and 300 to 3,000 feet long.

SECTION II -TEMPORARY SEEDING

Vegetation -annual grass or grain used to provide cover on disturbed areas for up to 12 months. For longer duration of vegetative cover, Permanent Seeding is required.

A. Seed Mixtures - Temporary Seeding

i) Select one or more of the species or mixtures listed in Table 26 for the appropriate Plant Hardiness Zone (from Figure 5) and enter them in the Temporary Seeding Summary below, along with application rates, seeding dates and seeding depths. If this Summary is not put on the plans and completed, then Table 26 must be put on the plans.

ii) For sites having soil tests performed, the rates shown on this table shall be deleted and the rates recommended by the testing agency shall be written in. Soil tests are not required for Temporary Seeding.

SECTION III: PERMANENT SEEDING (per Howard County Public School System Grounds Dept. Sect.#02490)

A. GENERAL

i)Description

a. The extent of seeding work is as shown on drawings and as specified. Contractor shall produce a dense, well-established turf.

b. Furnish, install, and remove temporary seeding as shown and specified.

c. Seed all disturbed site areas.

d. Seeding notes appearing on Sediment Control drawings shall pertain only to temporary stabilization seeding and shall apply only to work covered on those drawings. Permanent seeding of all areas of the project to be seeded shall be performed in accordance with this specification.

ii) Job Conditions

a. Seed shall be sown from August 15 to October 15 inclusive as soon as the soil is dry enough to allow proper penetration of a seedbed. Extensions beyond these time periods may be granted by the Contract Manager, depending upon weather conditions for the period in question. Any planting outside of these seasons shall be solely at the Contractor's risk and shall not be subject to compensation until stabilization has been accomplished in accordance with these Specifications.

- 1. No seeding shall be done in frozen ground or when the temperature is 32 degrees F or lower.
- 2. No seeding shall be done during windy weather or when ground is wet or otherwise untellable.
- 3. Seed all areas within the project limits that are not paved or designated on the drawings to receive special treatment. Seed disturbed areas in the public right-of-way.
- 4. Complete seeding of all playfields. Playfields shall be over seeded and refertilized in the spring of 2003, as directed by the Contract Manager. Contractor shall maintain, water, and mow all seeded areas until date of substantial completion.

iii) Workmanship

a. During seeding, all areas shall be kept neat and clean, and precautions shall be taken to avoid damage to existing plants, turf, and structures.

b. Upon completion, all debris and waste material resulting from seeding operations shall be removed from the project and the area cleaned up.

c. Any areas damaged by the seeding contractor shall be restored to the original condition.

B. PRODUCTS

i)Materials

a. Grass Seeds

- 1. Seed lots must be state certified and blended under the supervision of the Maryland Department of Agriculture (MDA) Turf and Seed Section.
- 2. All seed and labeling must fully comply with the Maryland Seed Law and these Specifications.
- 3. Seed shall be packed 50 lbs. net weight and packed in new, clean, poly-woven bags, tightly woven to prevent leaking and contamination.
- 4. Each container shall have permanently affixed to it an accurate analysis tag and a certification tag.
- 5. All seed lots to be used in this mixture shall have been previously tested by the Maryland Seed Laboratory to insure compliance with Specification.
- 6. A quality control sample of the delivered mixture shall be submitted to the Maryland Seed Laboratory for testing prior to payment and any lots found not to comply with the Specification shall be returned at the Contractor's expense.
- 7. The Contractor shall submit seed certification tags to Contractor Manager's representative prior to the beginning of any seed work.
- 8. Application rate: Grass seed mixture shall be applied at the rate of eight (8) pounds per 1,000 square feet immediately after fertilizing rake and/or drag mat fertilizer is applied.

b. Seed Mixture: Irrigated Athletic Fields

- 1. The turfgrass seed mixture shall conform to the following requirements.
- 2. Improved varieties of each species are required. Acceptable varieties of Tall Fescue mix is to contain any two (2) certified varieties from the latest issue of the University of Maryland Memo No. 77.
- 3. Acceptable varieties of certified Kentucky Bluegrass include Baron, Cheeri, Columbia, Monopoly, Nassau, Ram I, Vantage, and Victa.
- 4. Acceptable varieties of certified Perennial Ryegrass include Birdie II, Citation II, Cowboy, Derby, Manhattan II, Palmer, Pennant, Pennfine, Prelude, Regal, and Repell.
- 5. Seed mixtures must be free of all prohibited and restricted noxious weeds in accordance with the Maryland Seed Law.
- 6. Seed lots must be blended and certified as per the general certification specifications of the Maryland Department of Agriculture.
- 7. Seed filling must comply with the MARYLAND SEED AND REGULATIONS LAW.
- 8. All seed shall be certified with complete and accurate analysis tags attached to each container. The Contractor shall have all seed tags and submit them to the Contract Manager.

SECTION IV -SOD: TO PROVIDE QUICK COVER ON DISTURBED AREAS (2:1 GRADE OR FLATTER).

A. General specifications

i) Class of turf grass sod shall be Maryland or Virginia State Certified or Approved. Sod labels shall be made available to the job foreman and inspector.

ii) Sod shall be machine cut at a uniform soil thickness of 3/4", plus or minus 1/4", at the time of cutting. Measurement for thickness shall exclude top growth and thatch. Individual pieces of sod shall be cut to the suppliers width and length. Maximum allowable deviation from standard widths and lengths shall be 5 percent. Broken pads and torn or uneven ends will not be acceptable.

iii) Standard size sections of sod shall be strong enough to support their own weight and retain their size and shape when suspended vertically with a firm grasp on the upper 10 percent of the section.

iv) Sod shall not be harvested or transplanted when moisture content (excessively dry or wet) may adversely affect its survival.

v) Sod shall be harvested, delivered, and installed within a period of 36 hours. Sod not transplanted within this period shall be approved by an agronomist or soil scientist prior to its installation.

B. Sod Installation

i) During periods of excessively high temperature or in areas having dry subsoil, the subsoil shall be lightly irrigated immediately prior to laying the sod.

ii) The first row of sod shall be laid in a straight line with subsequent rows placed parallel to and tightly wedged against each other. Lateral joints shall be staggered to promote more uniform growth and strength. Ensure that sod is not stretched or overlapped and that all joints are butted tight in order to prevent voids which would cause air drying of the roots.

iii) Wherever possible, sod shall be laid with the long edges parallel to the contour and with staggering joints. Sod shall be rolled and tamped, pegged or otherwise secured to prevent slippage on slopes and to ensure solid contact between sod roots and the underlying soil surface.

iv) Sod shall be watered immediately following rolling or tamping until the underside of the new sod pad and soil surface below the sod are thoroughly wet. The operations of laying, tamping and irrigating for any piece of sod shall be completed within eight hours.

C. Sod Maintenance

i) In the absence of adequate rainfall, watering shall be performed daily or as often as necessary during the first week and in sufficient quantities to maintain moist soil to a depth of 4" .Watering should be done during the heat of the day to prevent wilting.

ii) After the first week, sod watering is required as necessary to maintain adequate moisture content.

iii) The first mowing of sod should not be attempted until the sod is firmly rooted. No more than 1/3 of the grass leaf shall be removed by the initial cutting or subsequent cuttings. Grass height shall be maintained between 2" and 3" unless otherwise specified.

SECTION V - FILTER CLOTH

CLASS	APPARENT OPENING SIZE	GRAB TENSILE STRENGTH	BURST STRENGTH P.S.I.
	MM. MAX	LB. MIN	MIN
A	0.30**	250	500
B	0.50	200	320
C	0.30	200	320
D	0.50	90	145
E	0.30	90	145
F	0.40-0.80*	90	190

← USE CLASS "C"

*US Std Sieve CW - 02215 ** 0.50 mm. max. for Super Silt Fence

The properties shall be determined in accordance with the following procedures:

-Apparent opening size MSMT 323

-Grab tensile strength ASTM D 1682. 4x8" specimen, 1x2" clamps, 12"/min. strain rate in both principal directions of geotextile fabric.

-Burst strength ASTM D 3786

The fabric shall be inert to commonly encountered chemicals and hydrocarbons, and will be rot and mildew resistant. It shall be manufactured from fibers consisting of long chain synthetic polymers, and composed of a minimum of 85 % by weight of polyolephins, polyesters, or polyamides. The geotextile fabric shall resist deterioration from ultraviolet exposure.

In addition, Classes A through E shall have a 0.01 cm./sec. minimum permeability when tested in accordance with MSMT 507, and an apparent minimum elongation of 20 percent (20%) when tested in accordance with the grab tensile strength requirements listed above.

SECTION VI - SILT FENCE MATERIALS:

Class F geotextile fabrics for silt fence shall have a 50 lb./in. minimum tensile strength and a 20 lb./in. minimum tensile modulus when tested in accordance with MSMT 509. The material shall also have a 0.3 gal./ft.2/min. flow rate and seventy-five percent (75 %) minimum filtering efficiency when tested in accordance with MSMT 322.

Geotextile fabrics used in the construction of silt fence shall resist deterioration from ultraviolet exposure. The fabric shall contain sufficient amounts of ultraviolet ray inhibitors and stabilizers to provide a minimum of 12 months of expected usable construction life at a temperature of 0 to 120 degrees F.

SECTION VII - PERMANENT GEOTEXTILE MATTING:

- A. Use Enkamat 7020 matting or approved equal.
- B. Install per manufacturer's instructions; see detail Sheet 5.

HOWARD COUNTY DPW - ENVIRONMENTAL SERVICES
6751 COLUMBIA GATEWAY DRIVE, SUITE 514
COLUMBIA, MD 21046
PHONE: (410) 313-6413
ATTN: Mark Richmond

HOWARD COUNTY, MD
PARCEL 106
ELECTION DISTRICT # 4
MAP 14

**BIORETENTION DESIGN
WILDE LAKE MIDDLE SCHOOL
PLANTING NOTES**

DATE:	05/06				
DESIGNED:	CW/HT				
DRAFTED:	HT				
CHECKED:	TCS				
BASE DATA:	J.A. RICE	NO.	REVISIONS	BY	DATE



CPJ Charles P. Johnson & Associates, Inc.
PLANNERS - ENGINEERS - LANDSCAPE ARCHITECTS - SURVEYORS
1751 ELTON ROAD SUITE 300 SILVER SPRING, MARYLAND 20903
Phone:(301)434-7000 E-mail:cpj@cpja.com Fax:(301)434-9394
FREDERICK, MD FAIRFAX, VA

SCALE AS SHOWN
SHEET 7
OF 7 SHEETS
JOB NO. 36-501